MIAMI-DADE

BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

Collier a Division of System Design & Mfg. Inc.
48 Dalkeith Drive
Brantford, Ontario Canada N3P1N6

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Insulated Overhead Sectional Garage Door 9' Wide.

APPROVAL DOCUMENT: Drawing No. D-CFL3WLP-98-IN, titled "Collier/Fortress Level 3 Wind Load Hardware Package" ", sheets 1 through 2, prepare by Collier, signed and sealed by F. A. Fore, P.E., dated 5/01/02, with no revisions, bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.
This NOA consists of this page 1 as well as approval document mentioned above.
The submitted documentation was reviewed by **Candido F. Font, PE.**



LOCK POSITION (BOTH ENDS)
TWO POINT LOCKING CONFORMS TO SFBC 3603.2 REGARDING GARAGE DOORS WITH 5/8" MIN. ENGAGEMENT. DOOR TESTED FOR FORCED ENTRY WITH BOTH OUTSIDE KEYED LOCK & INSIDE SLIDE BOLT LOCK OPTIONS.

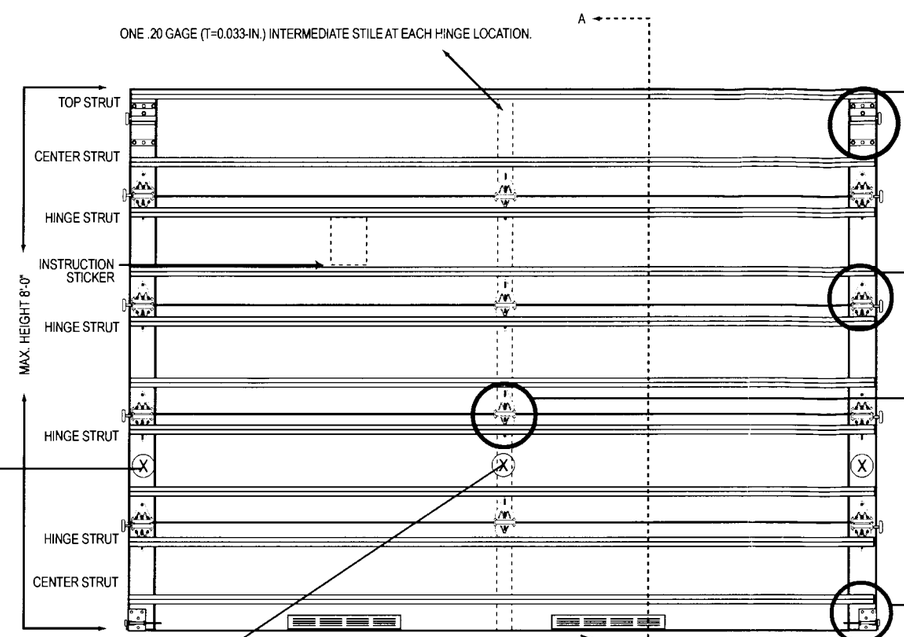

NOTE:
DOORS UP TO 7'-0" HIGH CONSIST OF (4) SECTIONS (NOT SHOWN)
DOORS OVER 7'-0" HIGH CONSIST OF (5) SECTIONS (SHOWN)

TYPICAL INSULATED 26 GAGE STEEL SANDWICH STYLE CONSTRUCTION WITH AN EXTERIOR SKIN MIN THICKNESS 0.016 AND AN INTERIOR SKIN MIN THICKNESS 0.016 MIN GALV COAT G90 AS PER ASTM E-8 (YEILD KSI 37.1) WITH A POLYSTYRENE CORE SANDWICHED BETWEEN TWO WOOD GRAIN TEXTURE SKINS



COLLIER RESIDENTIAL (T=0.060-IN.)
GALV. STEEL EMBOSSED
ADJUSTABLE TOP ROLLER BRACKET
FASTENED WITH SIX
1/4" X 3/4" SELF TAPPING SCREWS



9 - 1/4" X 3/4"
SELF TAPPING SCREWS
INTO A COLLIER WIDE BODY EMBOSSED
14 GAGE (T=0.071-IN.) END HINGE
NOTE:
2-1/4" X DOOR WIDTH - 19 GAGE (T=0.044-IN.)
STRUT TO BE FASTENED ON TOP OF BOTTOM HALF OF HINGES AS SHOWN AT EACH END STILE WITH
2 - 1/4" X 3/4" SELF TAPPING SCREWS



9 - 1/4" X 3/4"
SELF TAPPING SCREWS
INTO A COLLIER WIDE BODY EMBOSSED
18 GAGE (T=0.048-IN.) INTERMEDIATE HINGE



COLLIER RESIDENTIAL (T=0.083-IN.)
GALV. STEEL BOTTOM BRACKET
FASTENED WITH FOUR 1/4" X 3/4"
SELF TAPPING SCREWS

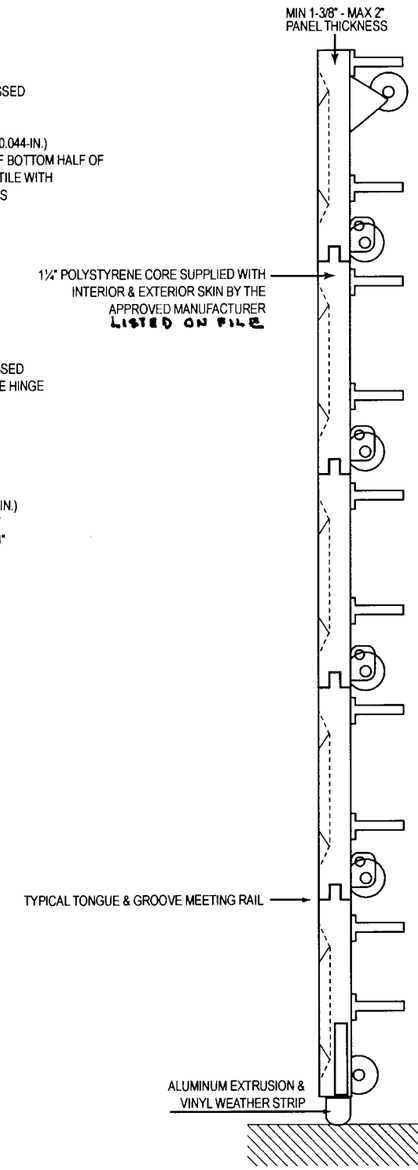

SECTION A - A (SIDE VIEW)

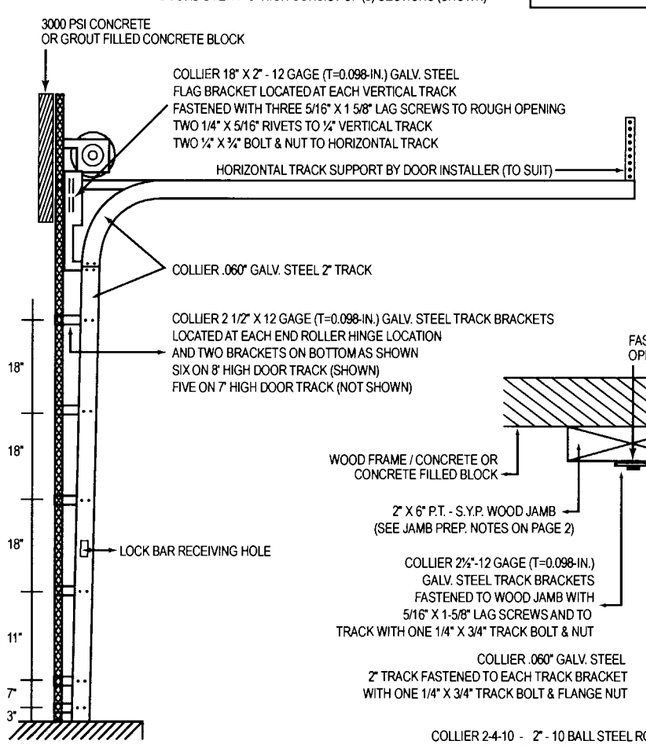

DOOR HEIGHT	21" SEC	19" SEC	18" SEC	TRACK BRACKETS
6'-0"	-	-	4	5
6'-6"	2	-	2	5
7'-0"	4	-	-	5
7'-6"	-	-	5	6
8'-0"	2	-	3	6
8'-0"	-	5	-	6

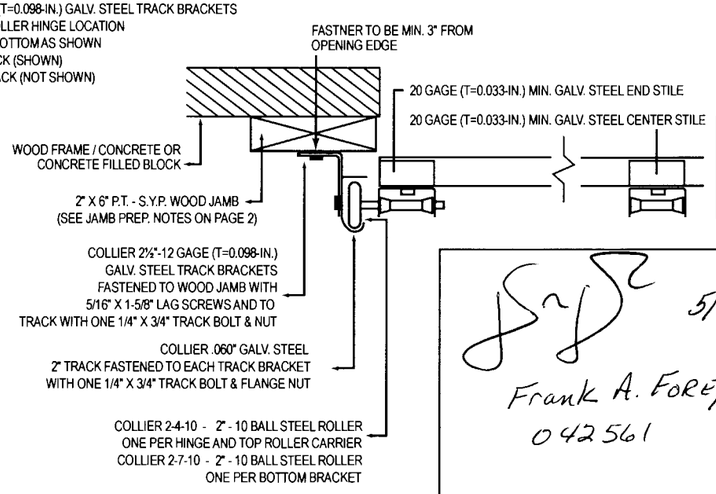

Sizes	# of Posts	Design Load* (+)	Design Load* (-)
MIN 5' - 0" X 6' - 0"	0	50	54
MAX 9' - 0" X 8' - 0"	0	50	54

*All posts must be engaged to achieve design wind load

5/8/02
Frank A. Fore, P.E.
042561

Approved as complying with the Florida Building Code
Date 9/26/02
NOA# 02-0807.04
Miami Dade Product Control Division
By

DESIGN LOAD +50 -54 PSF

COLLIER
A DIVISION OF SYSTEM DESIGN & MFG. INC.

FORTRESS™ A FORD SECURITY SERVICE
U.S. PATENT NO. 5732758

Collier/Fortress Level 3 Wind Load Hardware Package

48 Dalkeith Drive
Brantford, Ontario N3P 1N6
Phone: 519-759-8090
Fax: 519-759-4912

4200 Westroads Drive
West Palm Beach, FL 33407
Phone: 561-863-0650
Fax: 561-881-5635

Collier / Fortress All Rights Reserved.
The arrangement depicted herein are the sole property of Collier/Fortress and may not be reproduced in any form without written permission.

Drawing Number
D-CFL3WLP-98-IN

5.1.02

Sheet No. 1 of 2

2X6 JAMB TO SUPPORTING STRUCTURE ATTACHMENT

A) ALL THE LOAD FROM THE DOOR IS TRANSFERRED TO THE TRACK AND THEN FROM THE TRACK TO THE 2"x6" PRESSURE TREATED VERTICAL JAMBS (GRADE #2 OR BETTER YELLOW PINE). NO LOAD FROM THE DOOR IS TRANSFERRED TO THE HORIZONTAL (TOP) JAMB.
B) EACH VERTICAL JAMB SEES A MAXIMUM DESIGN LOAD OF **+1800 LBS AND -1944 LBS**
C) EACH VERTICAL JAMB BRACKET AND WALL LAG SEES A MAXIMUM DESIGN LOAD OF **+338 LBS AND -365 LBS**
D) ALL JAMB FASTENERS MAY BE (BUT NOT REQUIRED) COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE.

WOOD FRAME BUILDINGS

A) STUD WALLS OF DOOR OPENING SHALL BE FRAMED SOLID BY NOT LESS THAN (3) 2x6 PRESSURE TREATED GRADE #2 OR BETTER WOOD STUD OF A STRESS GRADE NOT LESS THAN **1200 PSI** NOMINAL EXTREME FIBER STRESS BENDING (Fb).
B) STUD WALLS TO BE CONTINUOUS FROM FOOTING TO TIE BEAMS AND IN ACCORDANCE WITH FBC SECTION 2308.1.

BLOCK WALL OR CONCRETE

A) 2x6 WOOD JAMB SHALL BE ANCHORED TO GROUT REINFORCED BLOCK WALL OR CONCRETE COLUMN.
B) BLOCK WALL CELLS SHALL BE FILLED WITH CONCRETE AND REINFORCED WITH #5 BAR EXTENDING INTO FOOTING AND INTO TIE BEAMS.
C) ALL BARS SHALL BE CONTINUOUS FROM THE TIE BEAMS TO FOOTING PER BLOCK WALL OR CONCRETE COLUMN.
D) BLOCK WALLS AND CONCRETE COLUMNS TO BE DESIGNED BY BUILDING PROFESSIONAL OF RECORD AND IN ACCORDANCE WITH FBC SECTION 2121.2.

BUILDING TYPE	FASTENER TYPE	MIN. NO. OF FASTENERS PER VERTICAL JAMB	MAXIMUM ON CENTER DISTANCE BETWEEN FASTENERS	STEEL WASHERS REQUIRED
WOOD FRAME (SYP)	½" x 3" EMBED LAG SCREW (ASTM A307, GRADE A)	6	16"	YES
BLOCK WALL OR CONCRETE	¼" x 1-¾" MIN. EMBED ITW TAPCON CONCRETE ANCHOR	9	10"	YES
BLOCK WALL OR CONCRETE	3/8" x 1-¾" MIN. EMBED RAWL-STUD EXPANSION ANCHOR (7400 SERIES)	5	19"	NO
BLOCK WALL OR CONCRETE	3/8" x 1-¾" MIN. EMBED RAWL LOK/BOLT ANCHOR BOLT (5000 SERIES)	6	16"	NO

*MINIMUM DISTANCE BETWEEN CENTER OF ANCHOR AND EDGE OF CONCRETE BLOCK: 3", EXCLUDING STUCCO THICKNESS.
COLLIER/FORTRESS DOES NOT SUPPLY JAMB ATTACHMENT FASTENERS.
WHEN USING RAWL-STUD; THE CONCRETE BLOCK MUST BE GROUT FILLED WITH 2000 PSI GROUT

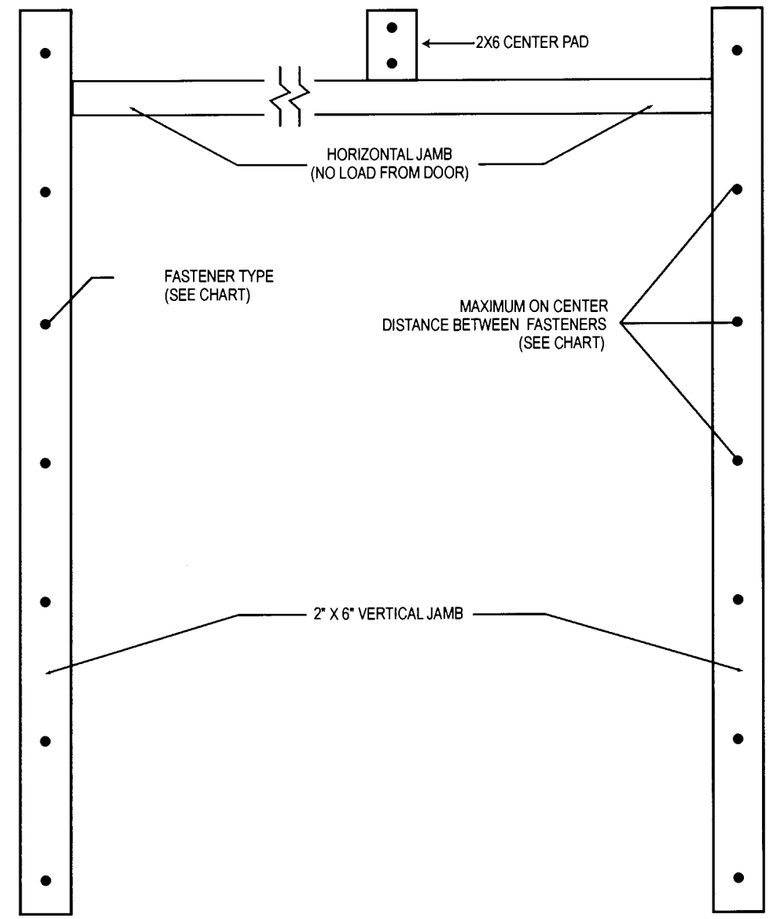

JAMB PREPARATION NOTE

A) EACH TRACK AND FLAG BRACKET SHALL BE FASTENED TO PRESSURE TREATED 2x6 YELLOW PINE WOOD JAMBS WITH 5/16"x1-5/8" LAG SCREWS (9) LAG SCREWS PER SIDE UP TO 7'0" HIGH AND (10) LAG SCREWS PER SIDE UP TO 8'0" HIGH.
B) THE METHOD OF ATTACHMENT TO THE SUPPORTING STRUCTURE OF THE PRESSURE TREATED 2x6 WOOD JAMBS SHALL BE APPROVED BY THE PROFESSIONAL OF RECORD FOR THE STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.
C) PREPARATION OF JAMBS BY OTHERS.
D) ALL MOUNTING OF TRACK, ANGLES, HORIZONTAL TRACK SUPPORTS, AND ALL OTHER DOOR HARDWARE TO BE INSTALLED PER COLLIER/FORTRESS INSTALLATION INSTRUCTIONS SUPPLIED WITH DOOR SYSTEM UNLESS OTHERWISE NOTED.

GENERAL NOTES

THIS APPROVAL REQUIRES THE MANUFACTURER TO DO TESTING OF ALL COILS USED TO FABRICATE DOOR PANELS UNDER THIS NOTICE OF ACCEPTANCE. A MINIMUM OF 2 SPECIMENS SHALL BE CUT FROM EACH COIL AND TENSILE TESTED ACCORDING TO ASTM E-8 BY A DADE COUNTY APPROVED LABORATORY SELECTED AND PAID BY THE MANUFACTURER. EVERY 3 MONTHS 4 TIMES A YEAR THE MANUFACTURER SHALL MAIL TO THIS OFFICE A COPY OF THE TEST REPORTS WITH CONFIRMATION THAT THE SPECIMENS WERE SELECTED FROM COILS AT THE MANUFACTURER'S PRODUCTION FACILITIES. AND A NOTARIZED STATEMENT FROM THE MANUFACTURER THAT ONLY COIL WITH YIELD STRENGTH OF 37,100 PSI OR MORE SHALL BE USED TO MAKE DOOR PANELS FOR DADE COUNTY UNDER THIS NOTICE OF ACCEPTANCE.

5/8/02
Frank A. Fore, P.E.
042561

Approved as complying with the Florida Building Code
Date 9/26/02
NOA# 02-0207.04
Miami Dade Product Control Division
By

DESIGN LOAD +50 -54 PSF

COLLIER
A DIVISION OF SYSTEM DESIGN & MFG. INC.
FORTRESS
U.S. PATENT NO. 5732758

Collier/Fortress Level 3 Wind Load Hardware Package

48 Dalkeith Drive
Brantford, Ontario N3P 1N6
Phone: 519-759-8090
Fax: 519-759-4912

4200 Westroads Drive
West Palm Beach, FL 33407
Phone: 561-863-0650
Fax: 561-881-5635

Collier / Fortress All Rights Reserved.
The arrangement depicted herein are the sole property of Collier/Fortress and may not be reproduced in any form without written permission.

Drawing Number
D-CFL3WLP-98-IN
5.1.02

Sheet No. 2 of 2