



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Besam Automated Entrance System, Inc.
84 Twin Rivers Drive
Hightstown, NJ 08520-5213**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Power Glide Model AMD-2” Automatic Aluminum Sliding Glass Door-Impact

APPROVAL DOCUMENT: Drawing No. WB19710, titled “Power-Glide AMD-2 Windbreaker Door System Fixed Sidelite BI-Parting Sliding Door”, sheets 1 through 6 of 6, prepared, signed and sealed by manufacturer, dated 3/4/02, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA # 01-0502.08** and, consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by **Raul Rodriguez**.




**NOA No 02-0313.05
Expiration Date: December 08, 2003
Approval Date: May 09, 2002
Page 1**



81 TWIN RIVERS DRIVE
 HIGHTSTOWN, NJ 08520-5212
 TELEPHONE: 609-443-5800.
 TELEFAX: 609-443-3440.

POWER-GLIDE AMD-2
 WINDBREAKER DOOR SYSTEM
 FIXED SIDELITE BI-PARTING SLIDING DOOR.

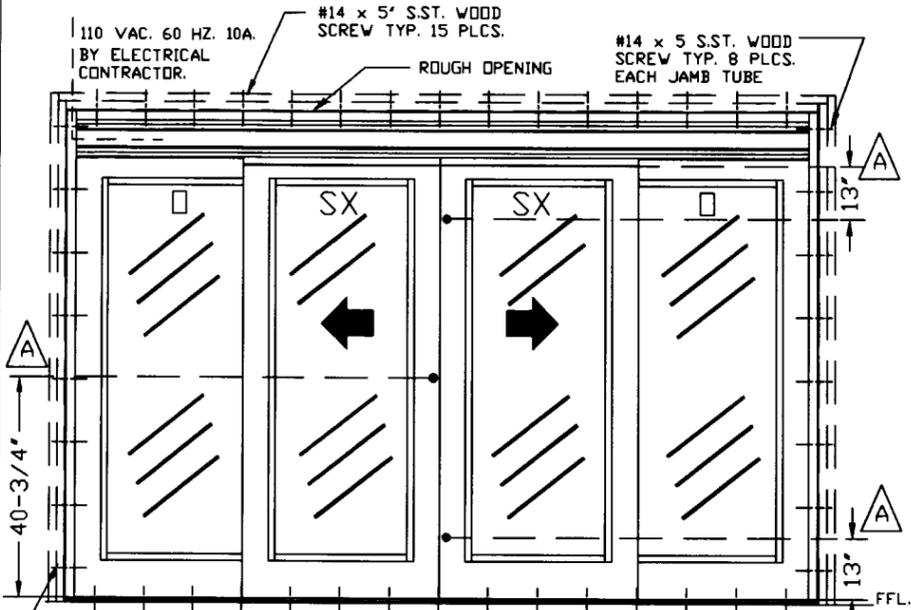


2x PRETREATED WOOD BUCK SUPPLIED AND INSTALLED FINISHED TO MEET ARCHITECTURAL REQUIREMENTS AS NECESSARY BY OTHERS.

1/4" x 2-1/4" PERMA-SEAL TAPPER SCREW TYP. 15 PLCS.

"HURRICANE PROTECTION SHUTTERS ARE NOT REQUIRED" DPR +/- 70 PSF


EXTERIOR ELEVATION (N.T.S.)

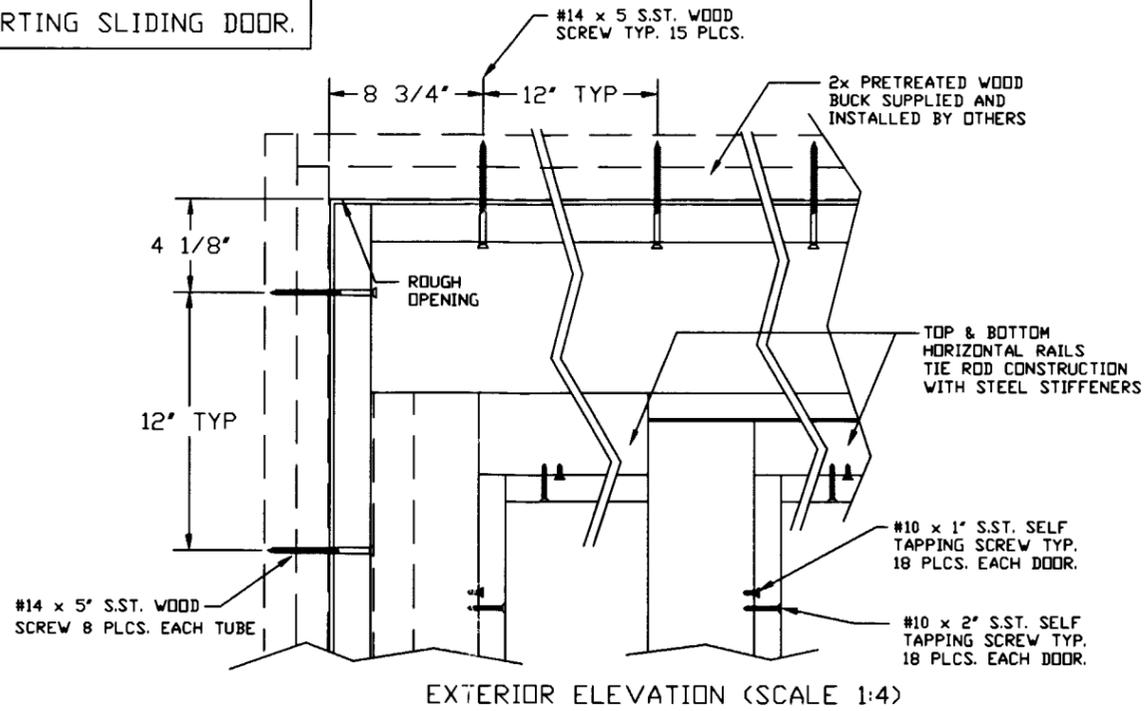

EXTERIOR ELEVATION (SCALE 1:4)


NOTE: FROM NDA #96-0119.07
 4.1 SCREWS & METHOD OF ATTACHMENT
 SILL: SINGLE ROW OF FIFTEEN (15) #14x3" FH SS WS, WITH 1-1/2" MIN. PENETRATION INTO 2x WOOD BUCK, STAGGERED THRU SILL TRACK & GUIDE SLIDE TRACK
 OR SINGLE ROW OF FIFTEEN (15) 1/4"x2-1/4" RAWL PERMA-SEAL TAPPER, WITH A 1-1/2" MIN. PENETRATION INTO MASONRY, STAGGERED THRU SILL TRACK.
 OR SINGLE ROW OF FIFTEEN (15) 1/4"-20 SS SELF TAPPING SCREWS OR CARBON STEEL TEK SCREWS, INTO A 12 GA. MIN STEEL STUDS, STAGGERED THRU SILL TRACK & GUIDE SLIDE TRACK, ALL LOCATED AT 8-3/4" FROM EACH CORNER WITH REMAINING SPACED AT 12" O.C. MAX.
 HEAD: SINGLE ROW OF FIFTEEN (15) #14x5" FH SS WS, WITH 1-1/2" MIN. PENETRATION INTO 2x WOOD BUCK, THRU HEADER TUBE AND STEEL STIFFENER
 OR SINGLE ROW OF FIFTEEN (15) 1/4"x5" RAWL PERMA-SEAL TAPPER, WITH A 1-1/2" MIN. PENETRATION INTO MASONRY, THRU HEADER TUBE AND STEEL STIFFENER
 OR SINGLE ROW OF FIFTEEN (15) 1/4"-20 SS SELF TAPPING SCREWS OR CARBON STEEL TEK SCREWS, INTO A 12 GA. MIN STEEL STUDS, THRU HEADER TUBE AND STEEL STIFFENER, ALL LOCATED AT 8-3/4" FROM EACH CORNER WITH REMAINING SPACED AT 12" O.C. MAX.
 JAMBS: SINGLE ROW OF EIGHT (8) #14x5" FH SS WS, WITH 1-1/2" MIN. PENETRATION INTO 2x WOOD BUCK, THRU JAMB TUBE
 OR SINGLE ROW OF EIGHT (8) 1/4"x5" RAWL PERMA-SEAL TAPPER, WITH A 1-1/2" MIN. PENETRATION INTO MASONRY, THRU JAMB TUBE
 OR SINGLE ROW OF EIGHT (8) 1/4"-20 SS SELF TAPPING SCREWS OR CARBON STEEL TEK SCREWS, INTO A 12 GA. MIN STEEL STUDS, THRU JAMB TUBE, ALL LOCATED AT 4 1/8" FROM EACH CORNER WITH REMAINING SPACED AT 12" O.C. MAX

INTERIOR SIDE

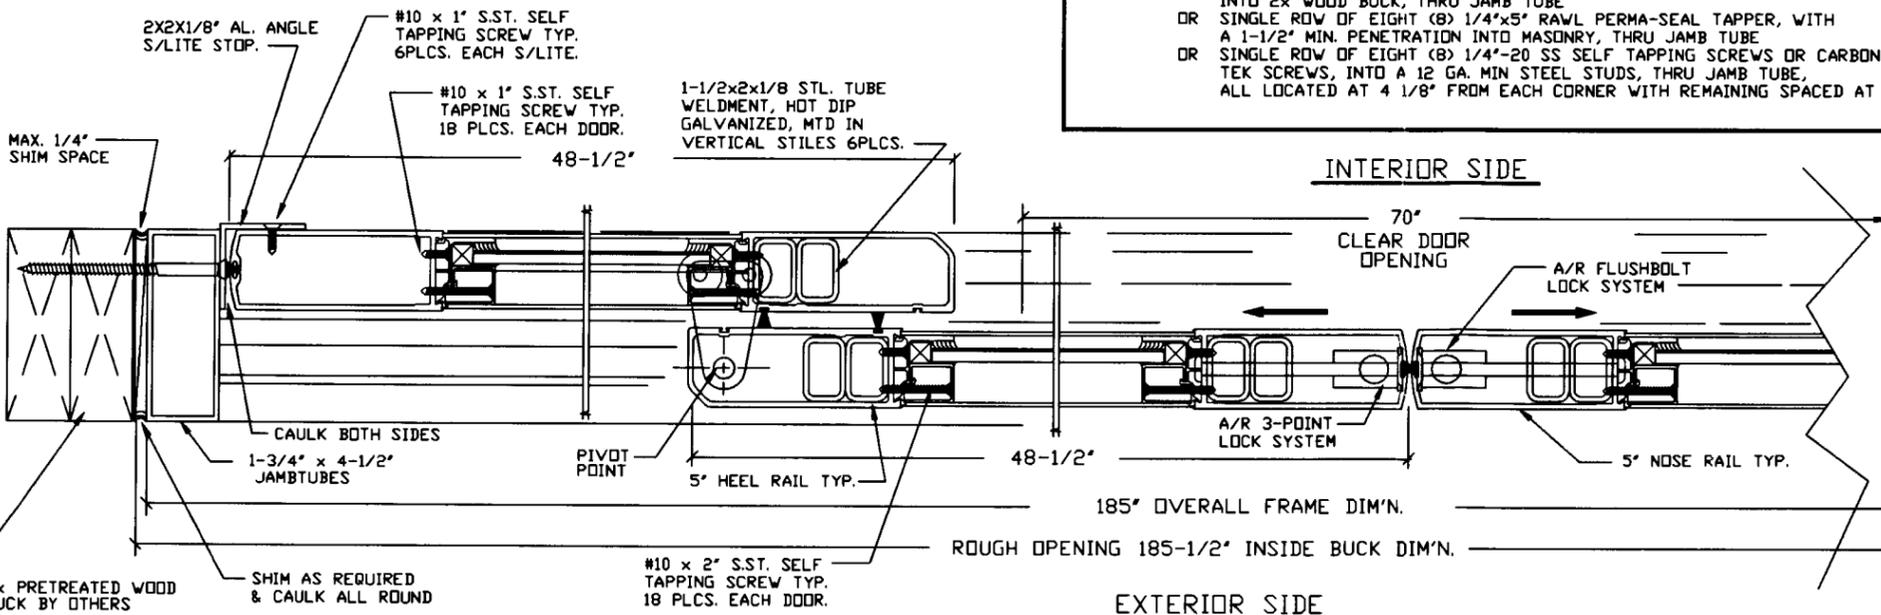

PLAN VIEW (SCALE 1:2)

EXTERIOR SIDE


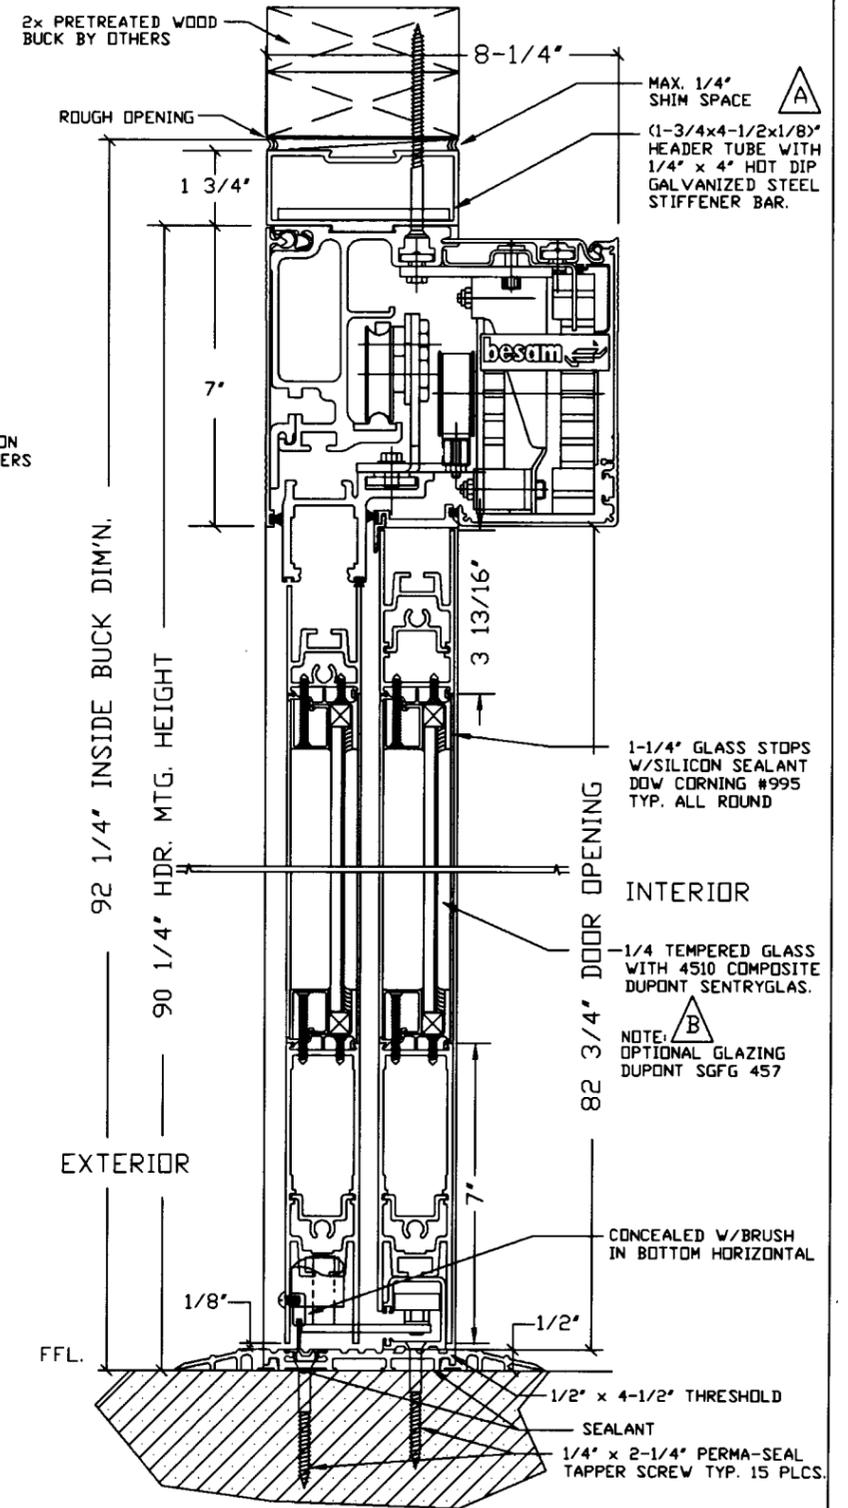


SIDE ELEVATION (SCALE 1:2)

PRODUCT REVISED as complying with the Florida Building Code
 Acceptance No. 02-0313.05
 Expiration Date 12/06/03
 By *[Signature]*
 Miami Dade Product Control Division

DWG. # WB19710 (REV. C 03/02)
 WINDBREAKER DOOR SYSTEM
 DPR +/- 70 PSF
 SHT. 1 OF 6 REV. C
 03-01-02

OPTIONAL GLAZING.
1/4" TEMPERED GLASS
WITH 457 COMPOSITE
DUPONT SENTRYGLAS
WITH FLOATING CAP
TOTAL THICKNESS .597"

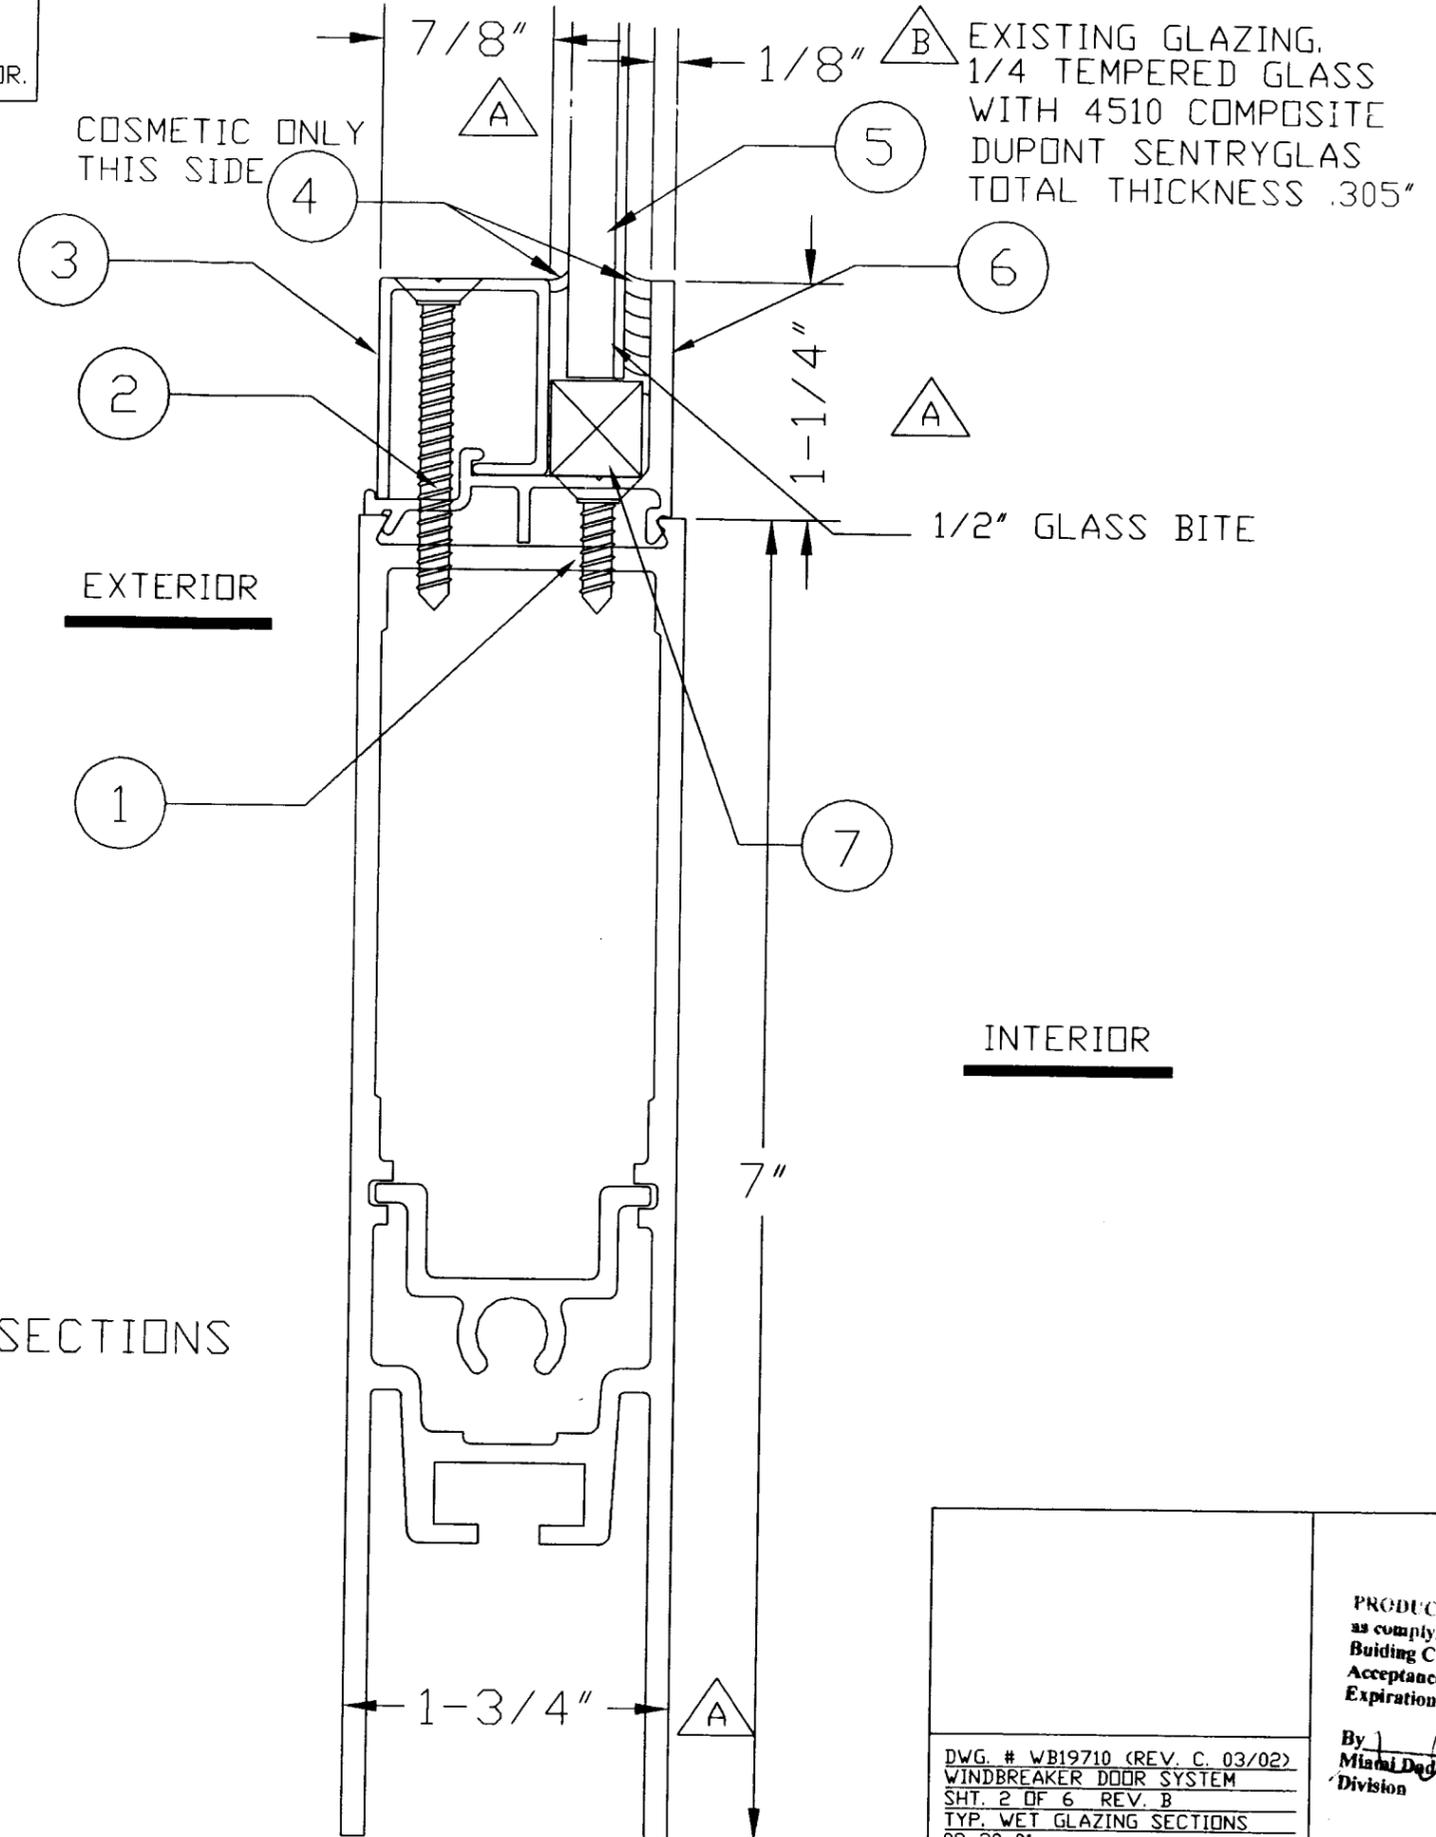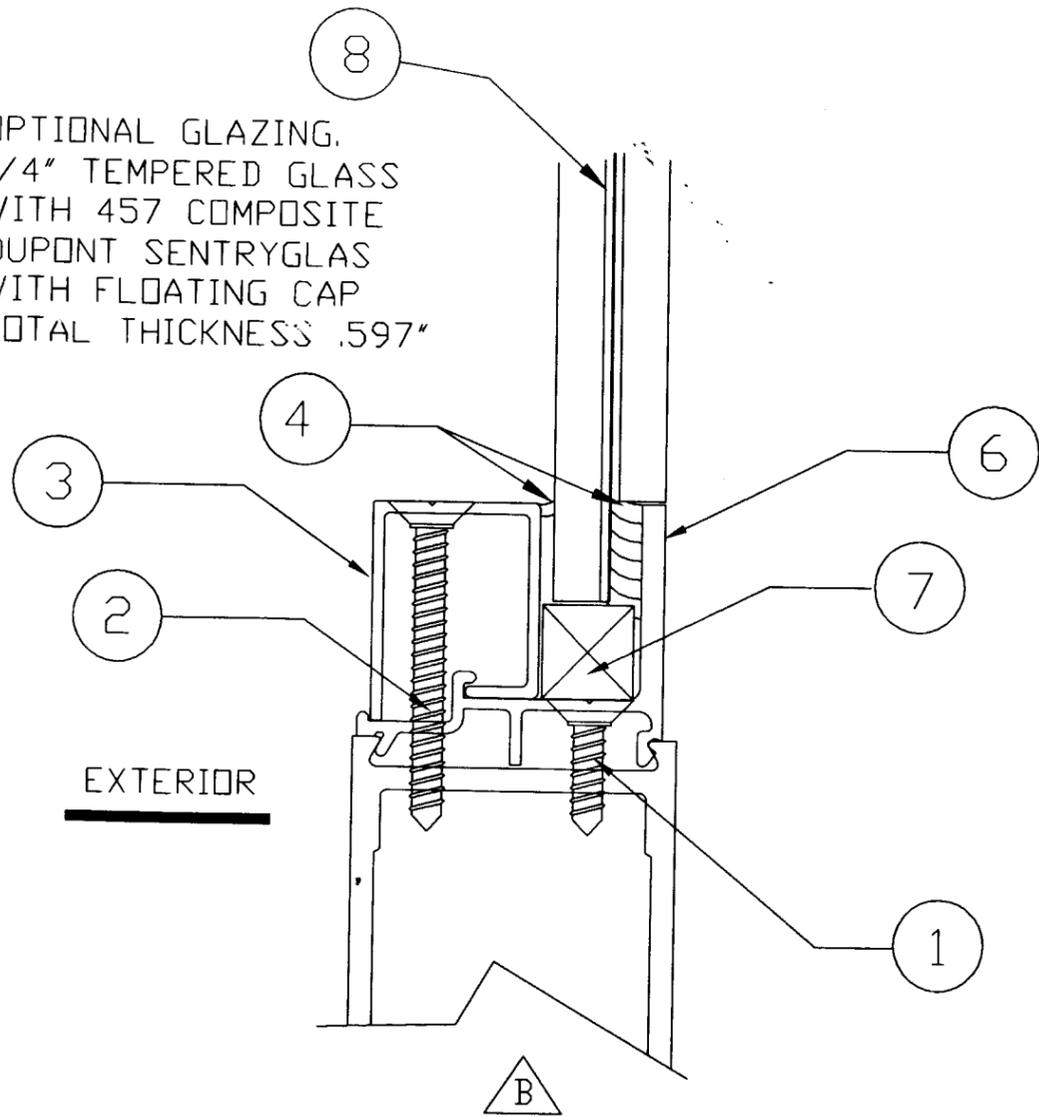

TYPICAL WET GLAZING CROSS SECTIONS



ITEM #	DESCRIPTION	REMARKS
8	FLOATING CAP 457 SENTRY GLAS.	457 SGFG
7	RUBBER GLASS SETTING BLOCK.	1/2x1/2x2"
6	GLASS GUTTER EXTR.	DIE# 32668
5	1/4" TEMP. 4510 SENTRY GLAS.	4510 SG
4	WET GLAZE SILICON.	D.C. #995
3	GLASS STOP EXTR.	DIE# T51312
2	#10x2" FH SCREW SELF TAPPING.	ST. STEEL.
1	#10x1" FH SCREW SELF TAPPING.	ST. STEEL

△ B

DWG. # WB19710 (REV. C. 03/02)
WINDBREAKER DOOR SYSTEM
SHT. 2 OF 6 REV. B
TYP. WET GLAZING SECTIONS
09-20-01

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 02-0313.05
Expiration Date 12/08/03

By: *[Signature]*
Miami Dade Product Control
Division



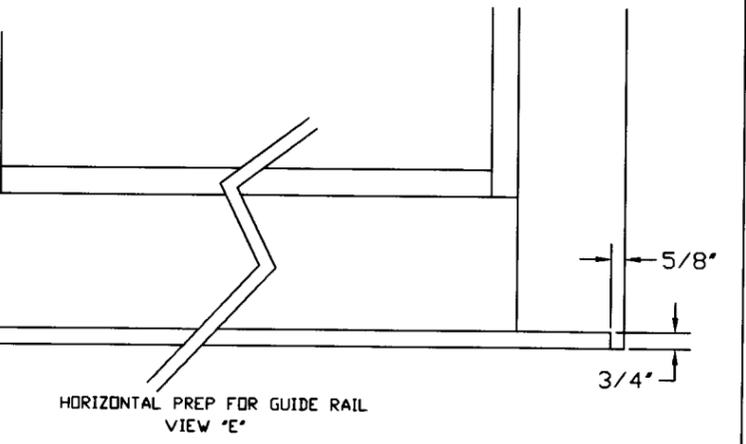
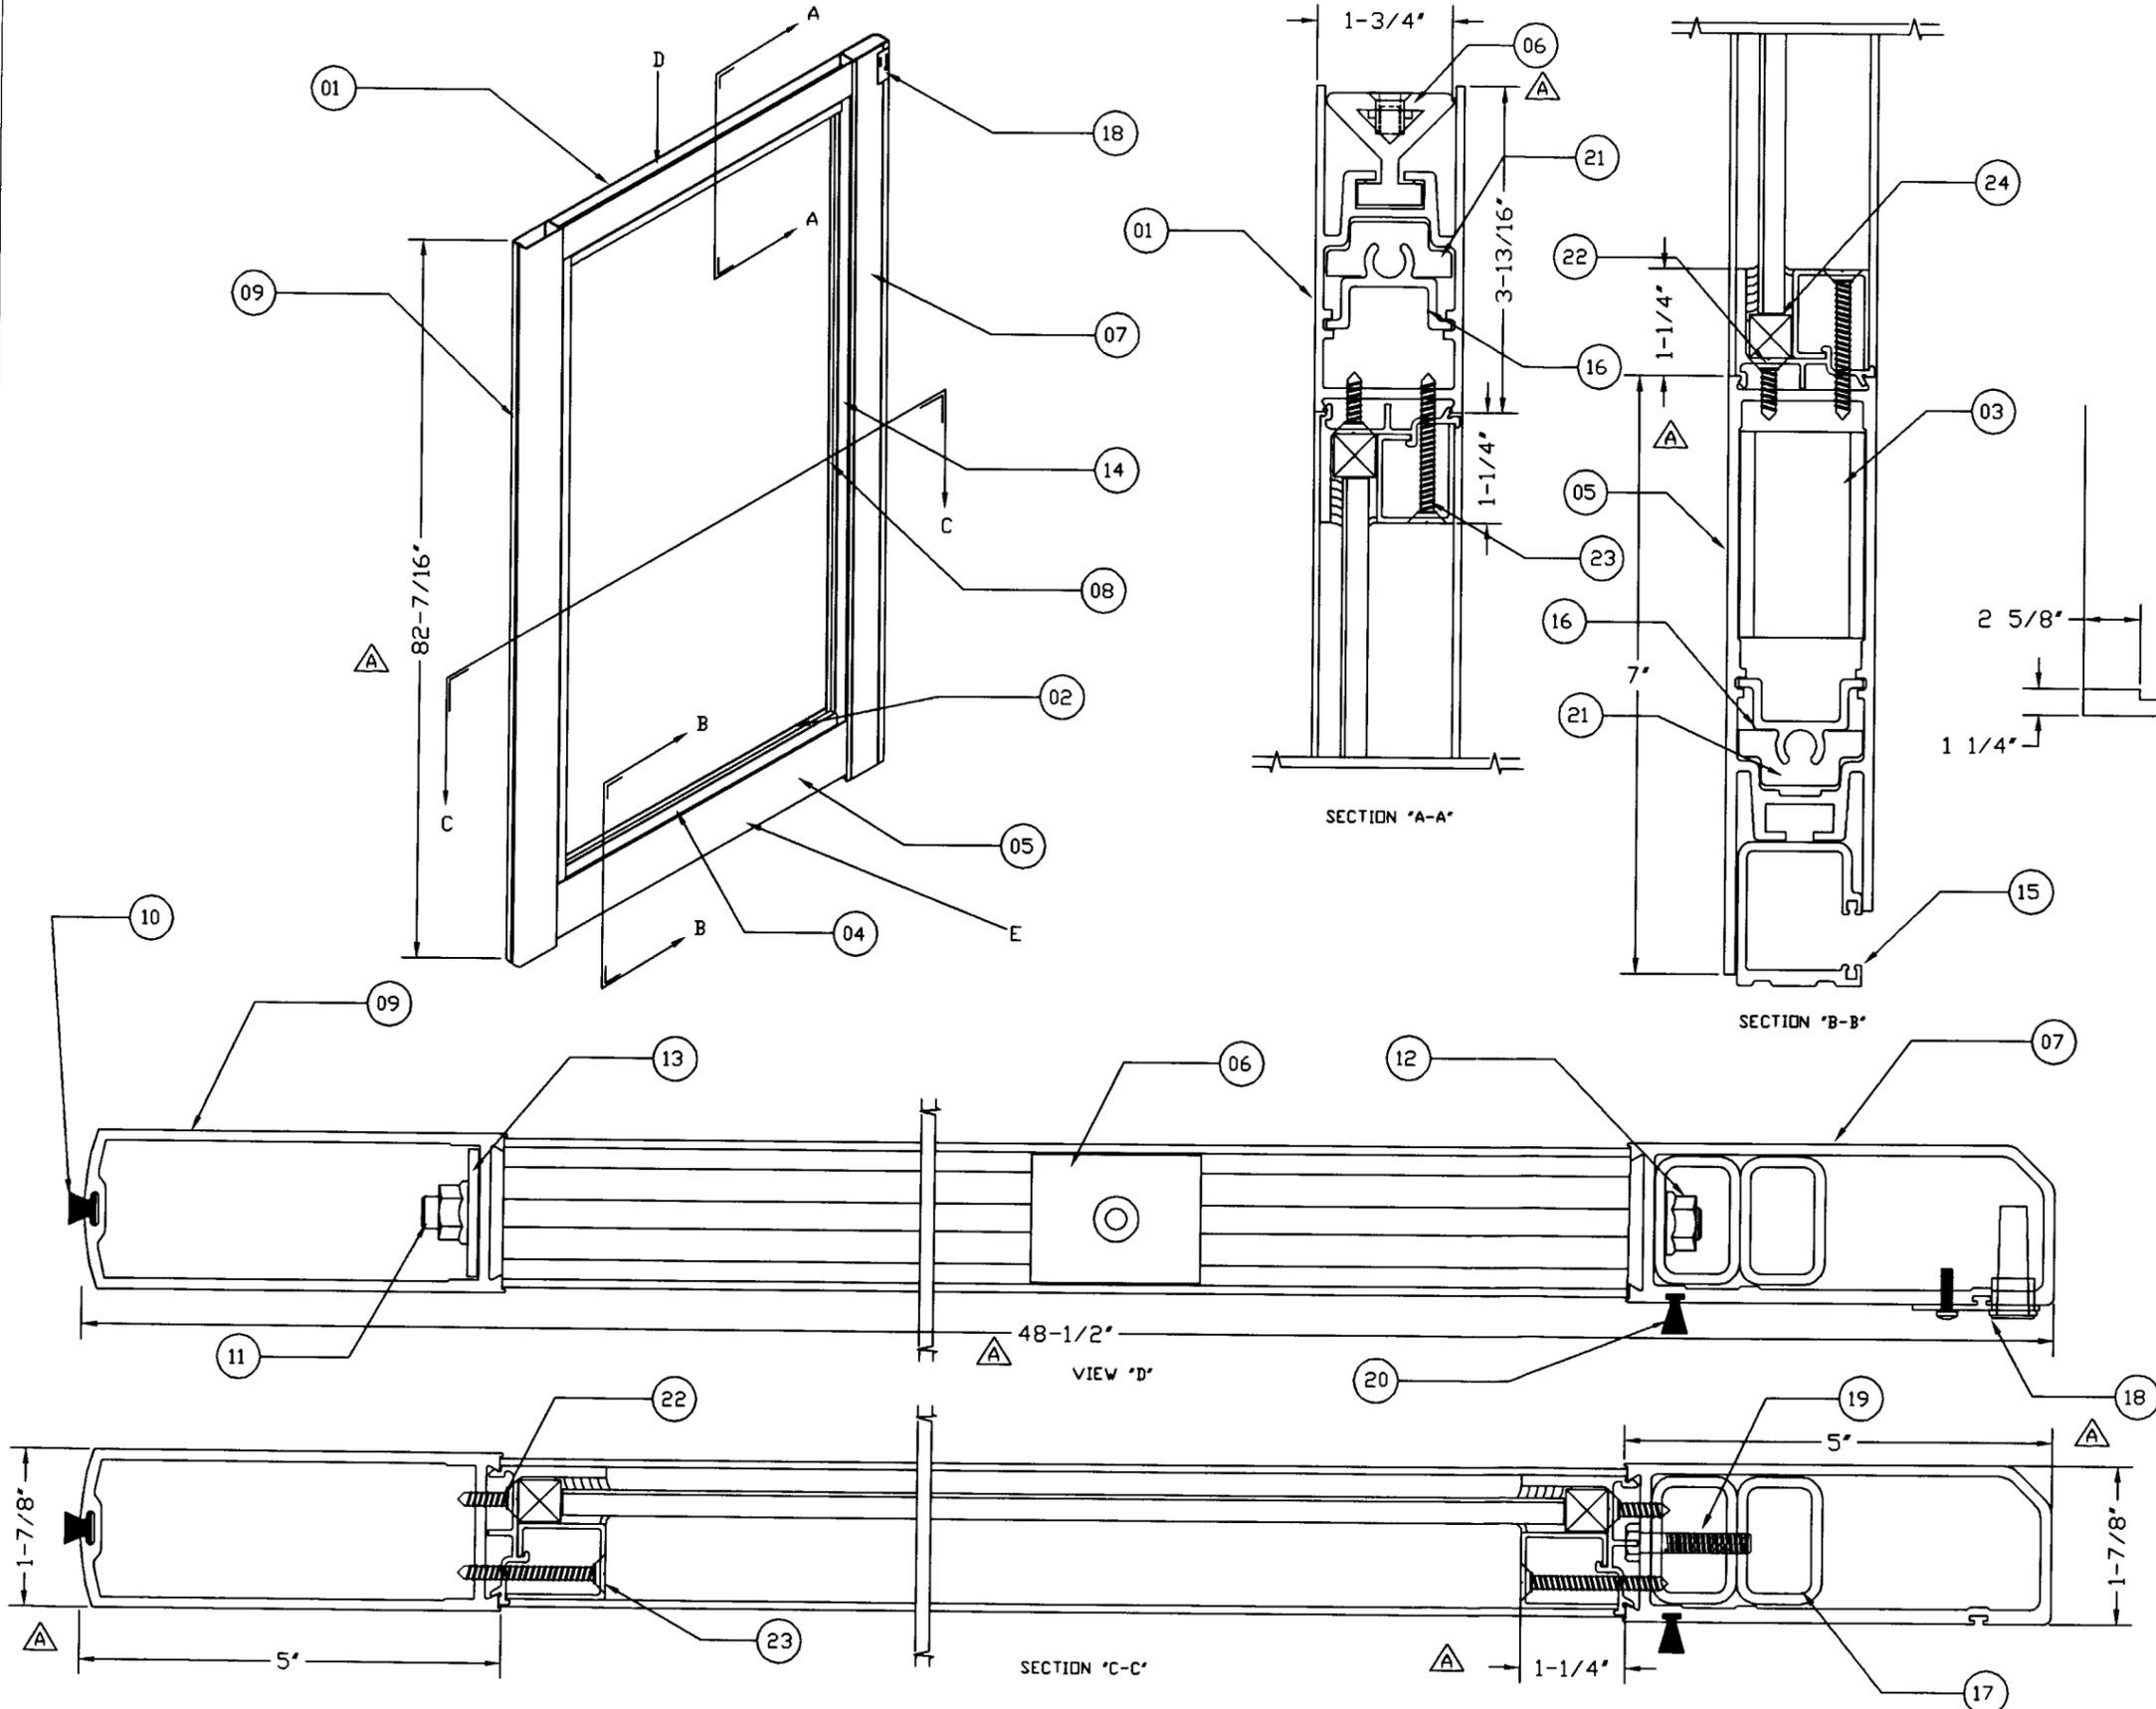


24	4	GLASS BLOCK	TPR565	1/2"x1/2"x2"
23	18	STOP SCREW - ST. STL.		#10x2" FHST.
22	18	GUTTER SCREW - ST. STL.		#10x1" FHST.
21	4	CLIP (DOOR RAIL)	B28290	
20	1	WEATHERBRUSH PILE		7936-6001-6
19	6	MTG BOLT (STIFFENER)		1/4"-20TPI. HHCS
18	1	BREAK-OUT SWITCH ASSY.	B28250	REF. INSTALL DWG.
17	1	STIFFENER	B28776	
16	2	CONTAINMENT EXTR. (TIE ROD)	32664	DIE DWG.
15	1	ROLLER GUIDE SLIDE TRACK	4934XA	DIE DWG.
14	2	GLASS STOP EXTR. (VERT.)	T51312	DIE DWG.
13	2	STL. WASHER	A28072	
12	4	3/8 FLANGED NUT		3/8-16TPI.
11	2	TENSION (TIE) ROD 3/8"		3/8-16TPI. STL.
10	1	WEATHERBRUSH PILE		8634-5771-1
09	1	VERTICAL (NOSE) RAIL 5'	H31044-A	DIE DWG.
08	2	GLASS GUTTER EXTR. (VERT.)	32668	DIE DWG.
07	1	VERTICAL (HEEL) RAIL 5'	H31048	DIE DWG.
06	3	DELTA MTG. CLIP	A28349	
05	1	BOTTOM RAIL 7"	H32711-B	DIE DWG.
04	2	GLASS STOP EXTR. (HORIZ.)	T51312	DIE DWG.
03	2	HORIZ. RAIL CLIP	A28283	
02	2	GLASS GUTTER EXTR. (HORIZ.)	32668	DIE DWG.
01	1	TOP RAIL 3 13/16"	H32710	DIE DWG.
ITEM#	QTY.	DESCRIPTION	DWG.#	REMARKS

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 02-0315.05
Expiration Date 12/08/03

By *[Signature]*
Miami Dade Product Control
Division



DWG. # WB19710 (REV. C. 03/02)
WINDBREAKER DOOR SYSTEM
SHT. 3 OF 6 REV. B
SIDELITE LHS.
09-20-01

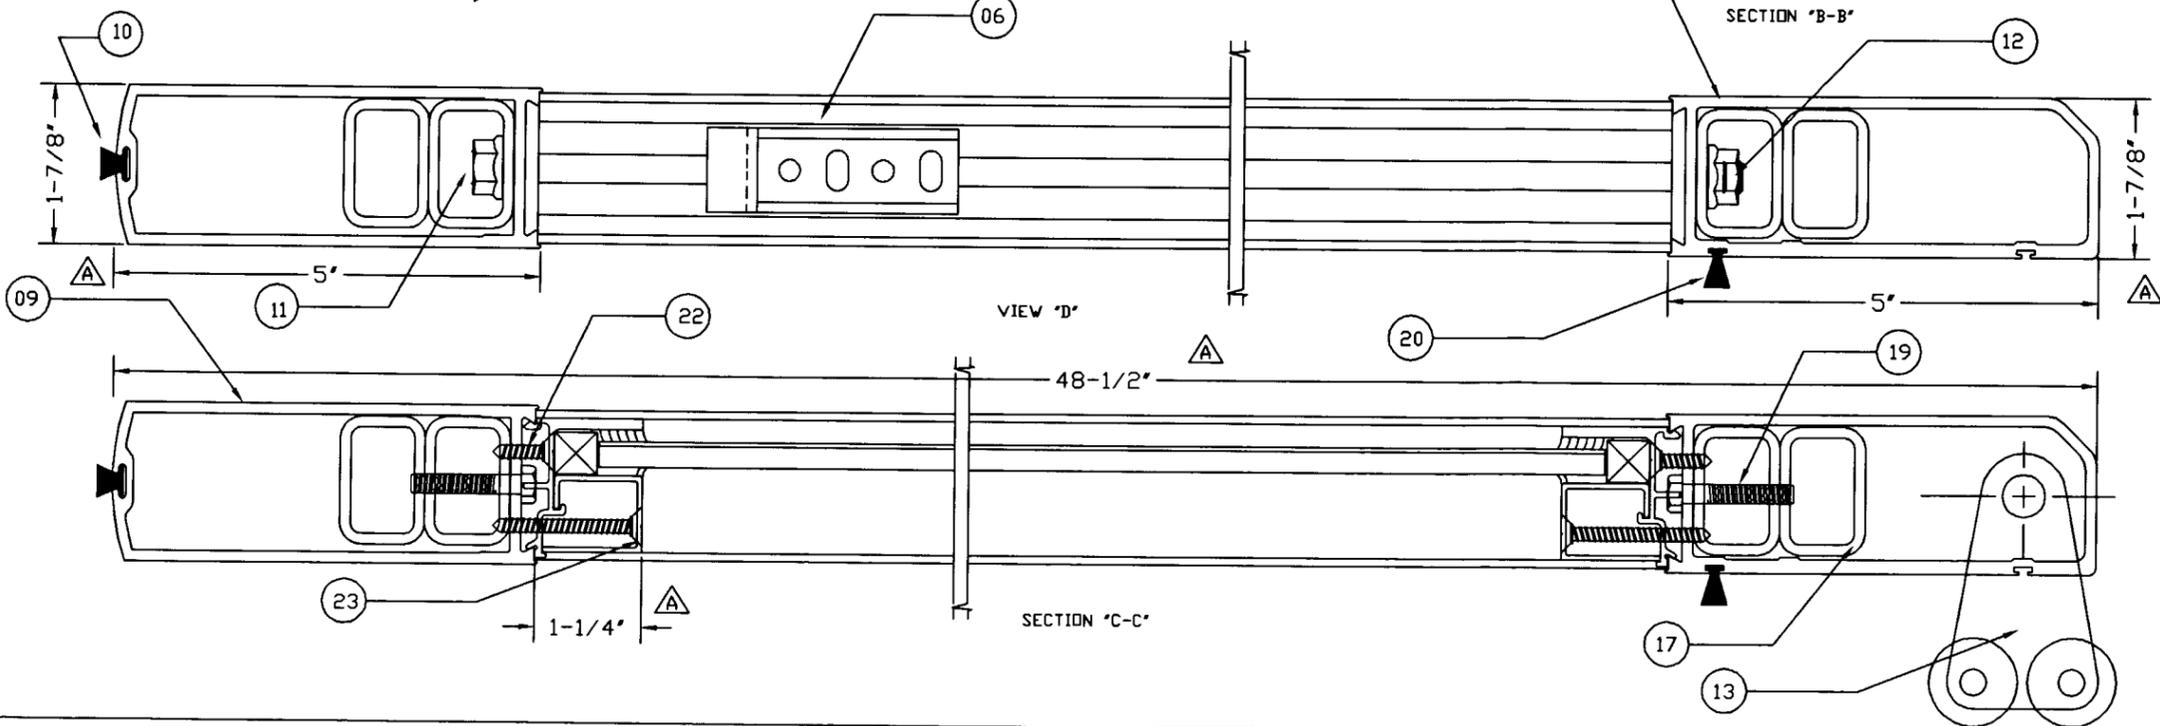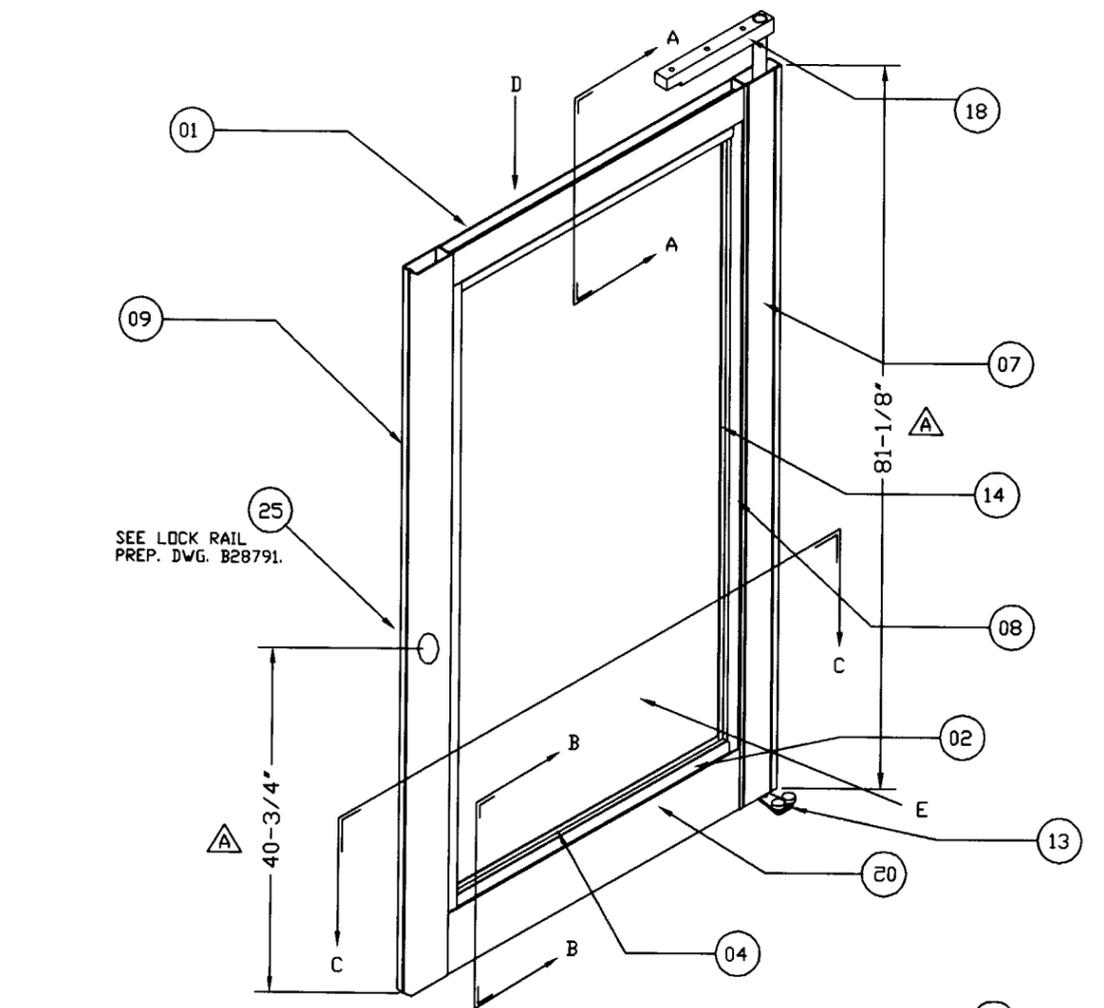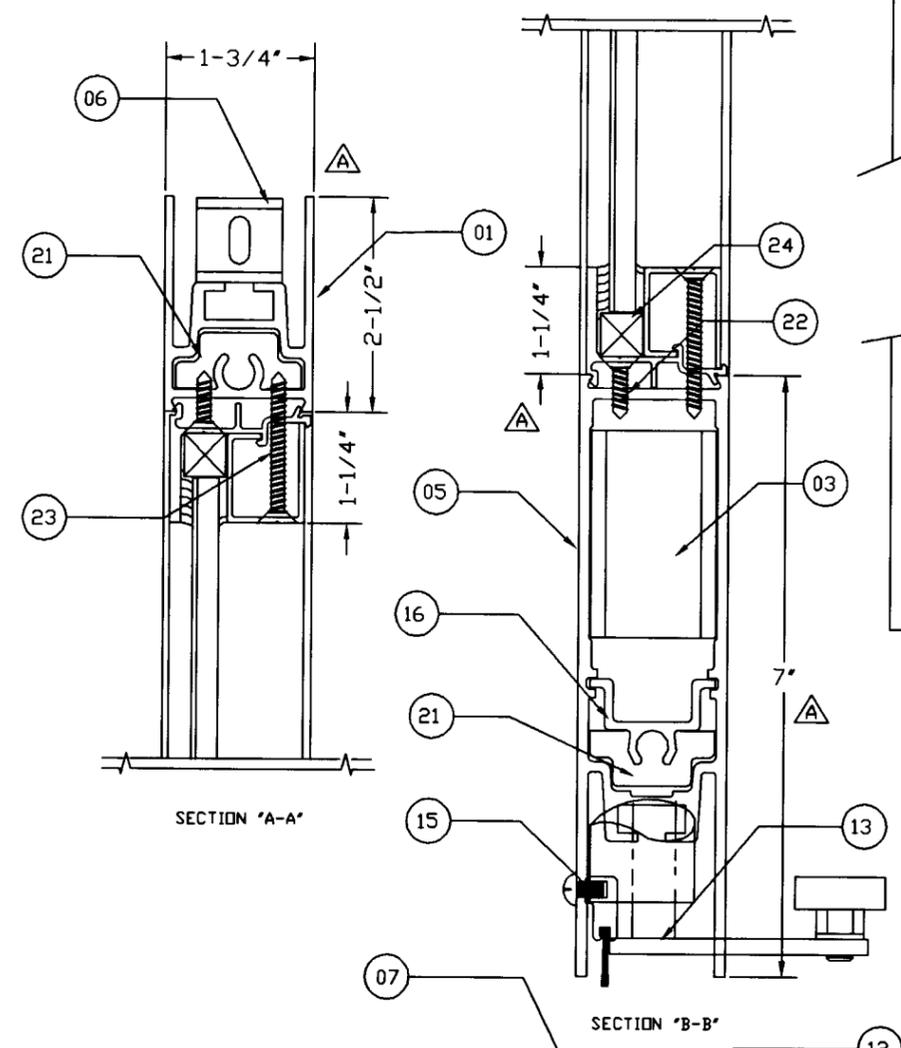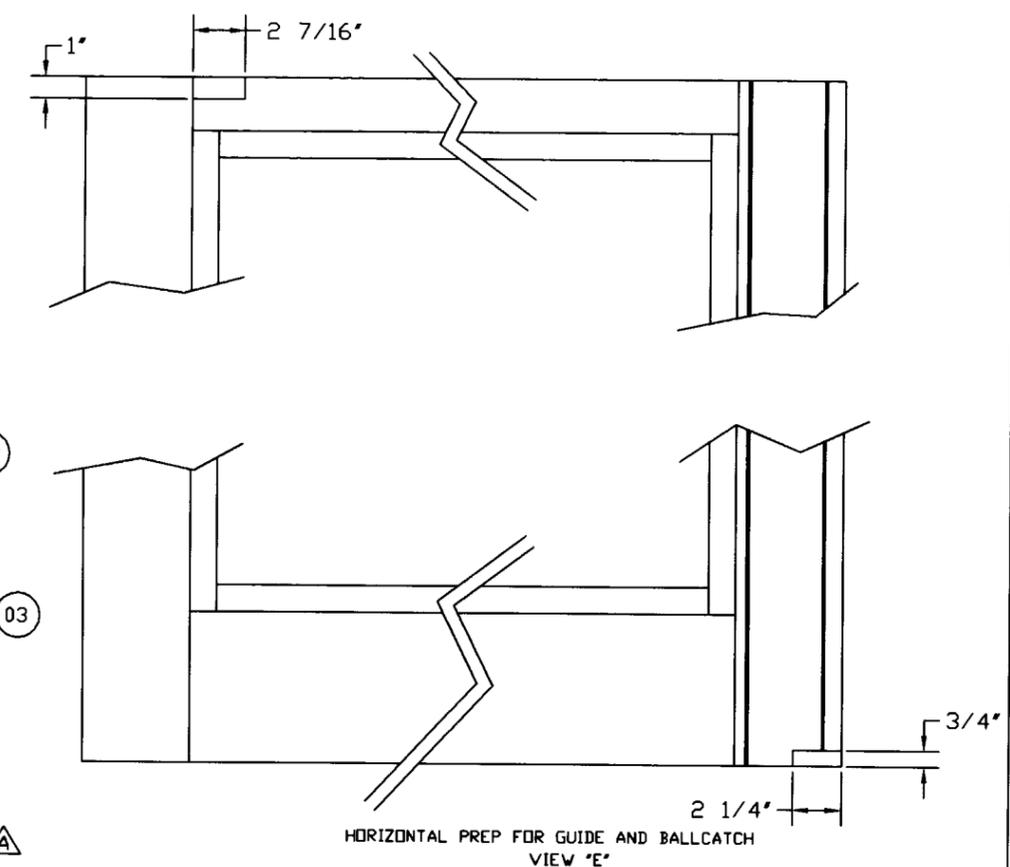

25	1	3-POINT LOCK SYSTEM	A/R	4015/4016 COMBO
24	4	GLASS BLOCK	TPR565	1/2"x1/2"x2"
23	18	STOP SCREW - ST.STL.		#10x2" FHST.
22	18	GUTTER SCREW - ST.STL.		#10x1" FHST.
21	4	CLIP (DOOR RAIL)	B2B290	
20	1	WEATHERBRUSH PILE		7936-6001-6
19	12	MTG BOLT (STIFFENER)		1/4-20TPI. HHCS
18	1	PSA (PANIC ARM) ASSY.	A2-831437	
17	2	STIFFENER	B2B776	
16	2	CONTAINMENT EXTR. (TIE ROD)	32664	DIE DWG.
15	1	DOOR SWEEP KIT	B2B375	
14	2	GLASS STOP EXTR. (VERT.)	T51312	DIE DWG.
13	1	ROLLER GUIDE ASSY.	A2B07B	
12	4	3/8 FLANGED NUT		3/8-16TPI.
11	2	TENSION (TIE) ROD 3/8"		3/8-16TPI. STL.
10	1	WEATHERBRUSH PILE		8634-5771-1
09	1	VERTICAL (NOSE) RAIL 5"	H31044-A	DIE DWG.
08	2	GLASS STOP EXTR. (VERT.)	32668	DIE DWG.
07	1	VERTICAL (HEEL) RAIL 5"	H31048	DIE DWG.
06	1	BALLCATCH LATCHPLATE	B31616	
05	1	BOTTOM RAIL 7"	H32711-B	DIE DWG.
04	2	GLASS STOP EXTR. (HORIZ.)	T51312	DIE DWG.
03	2	HORIZ. RAIL CLIP	A2B283	
02	2	GLASS GUTTER EXTR. (HORIZ.)	32668	DIE DWG.
01	1	TOP RAIL 2 1/2"	H2979	DIE DWG.
ITEM#	QTY.	DESCRIPTION	DWG.#	REMARKS

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 02-0313.05
Expiration Date 12/08/03
By *[Signature]*
Miami Dade Product Control
Division

DWG. # WB19710 (REV. C. 03/02)
WINDBREAKER DOOR SYSTEM
SHT. 4 OF 6 REV. B
ACTIVE LEAF LHS.
09-20-01




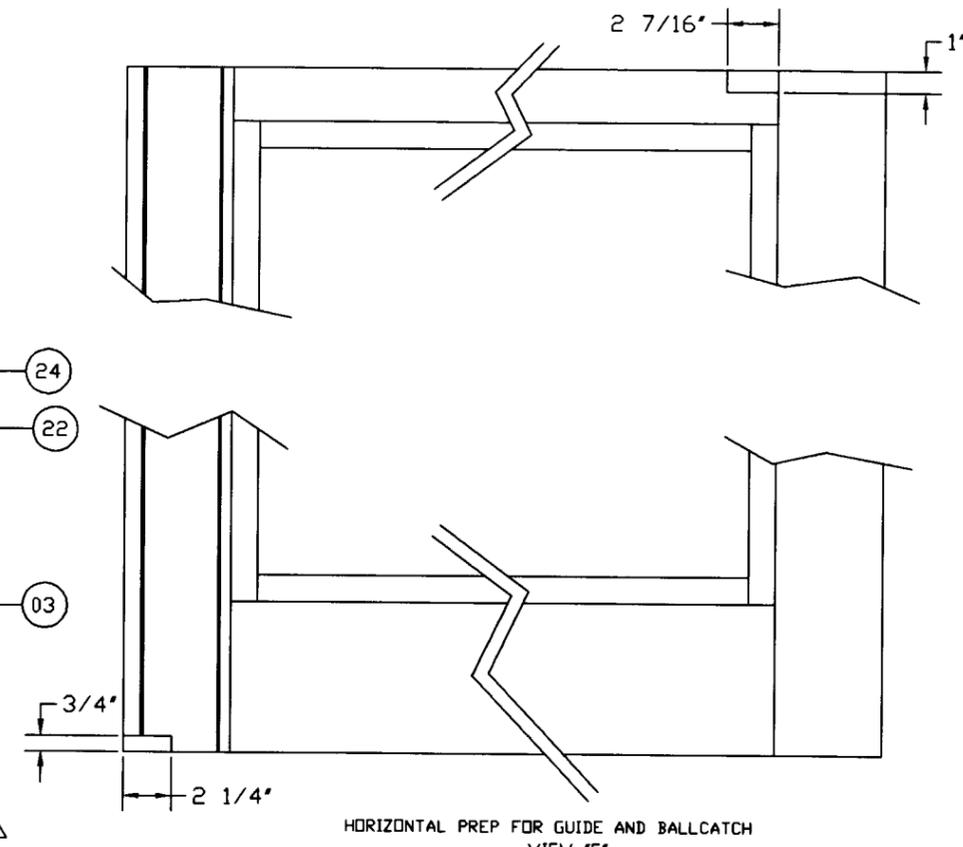
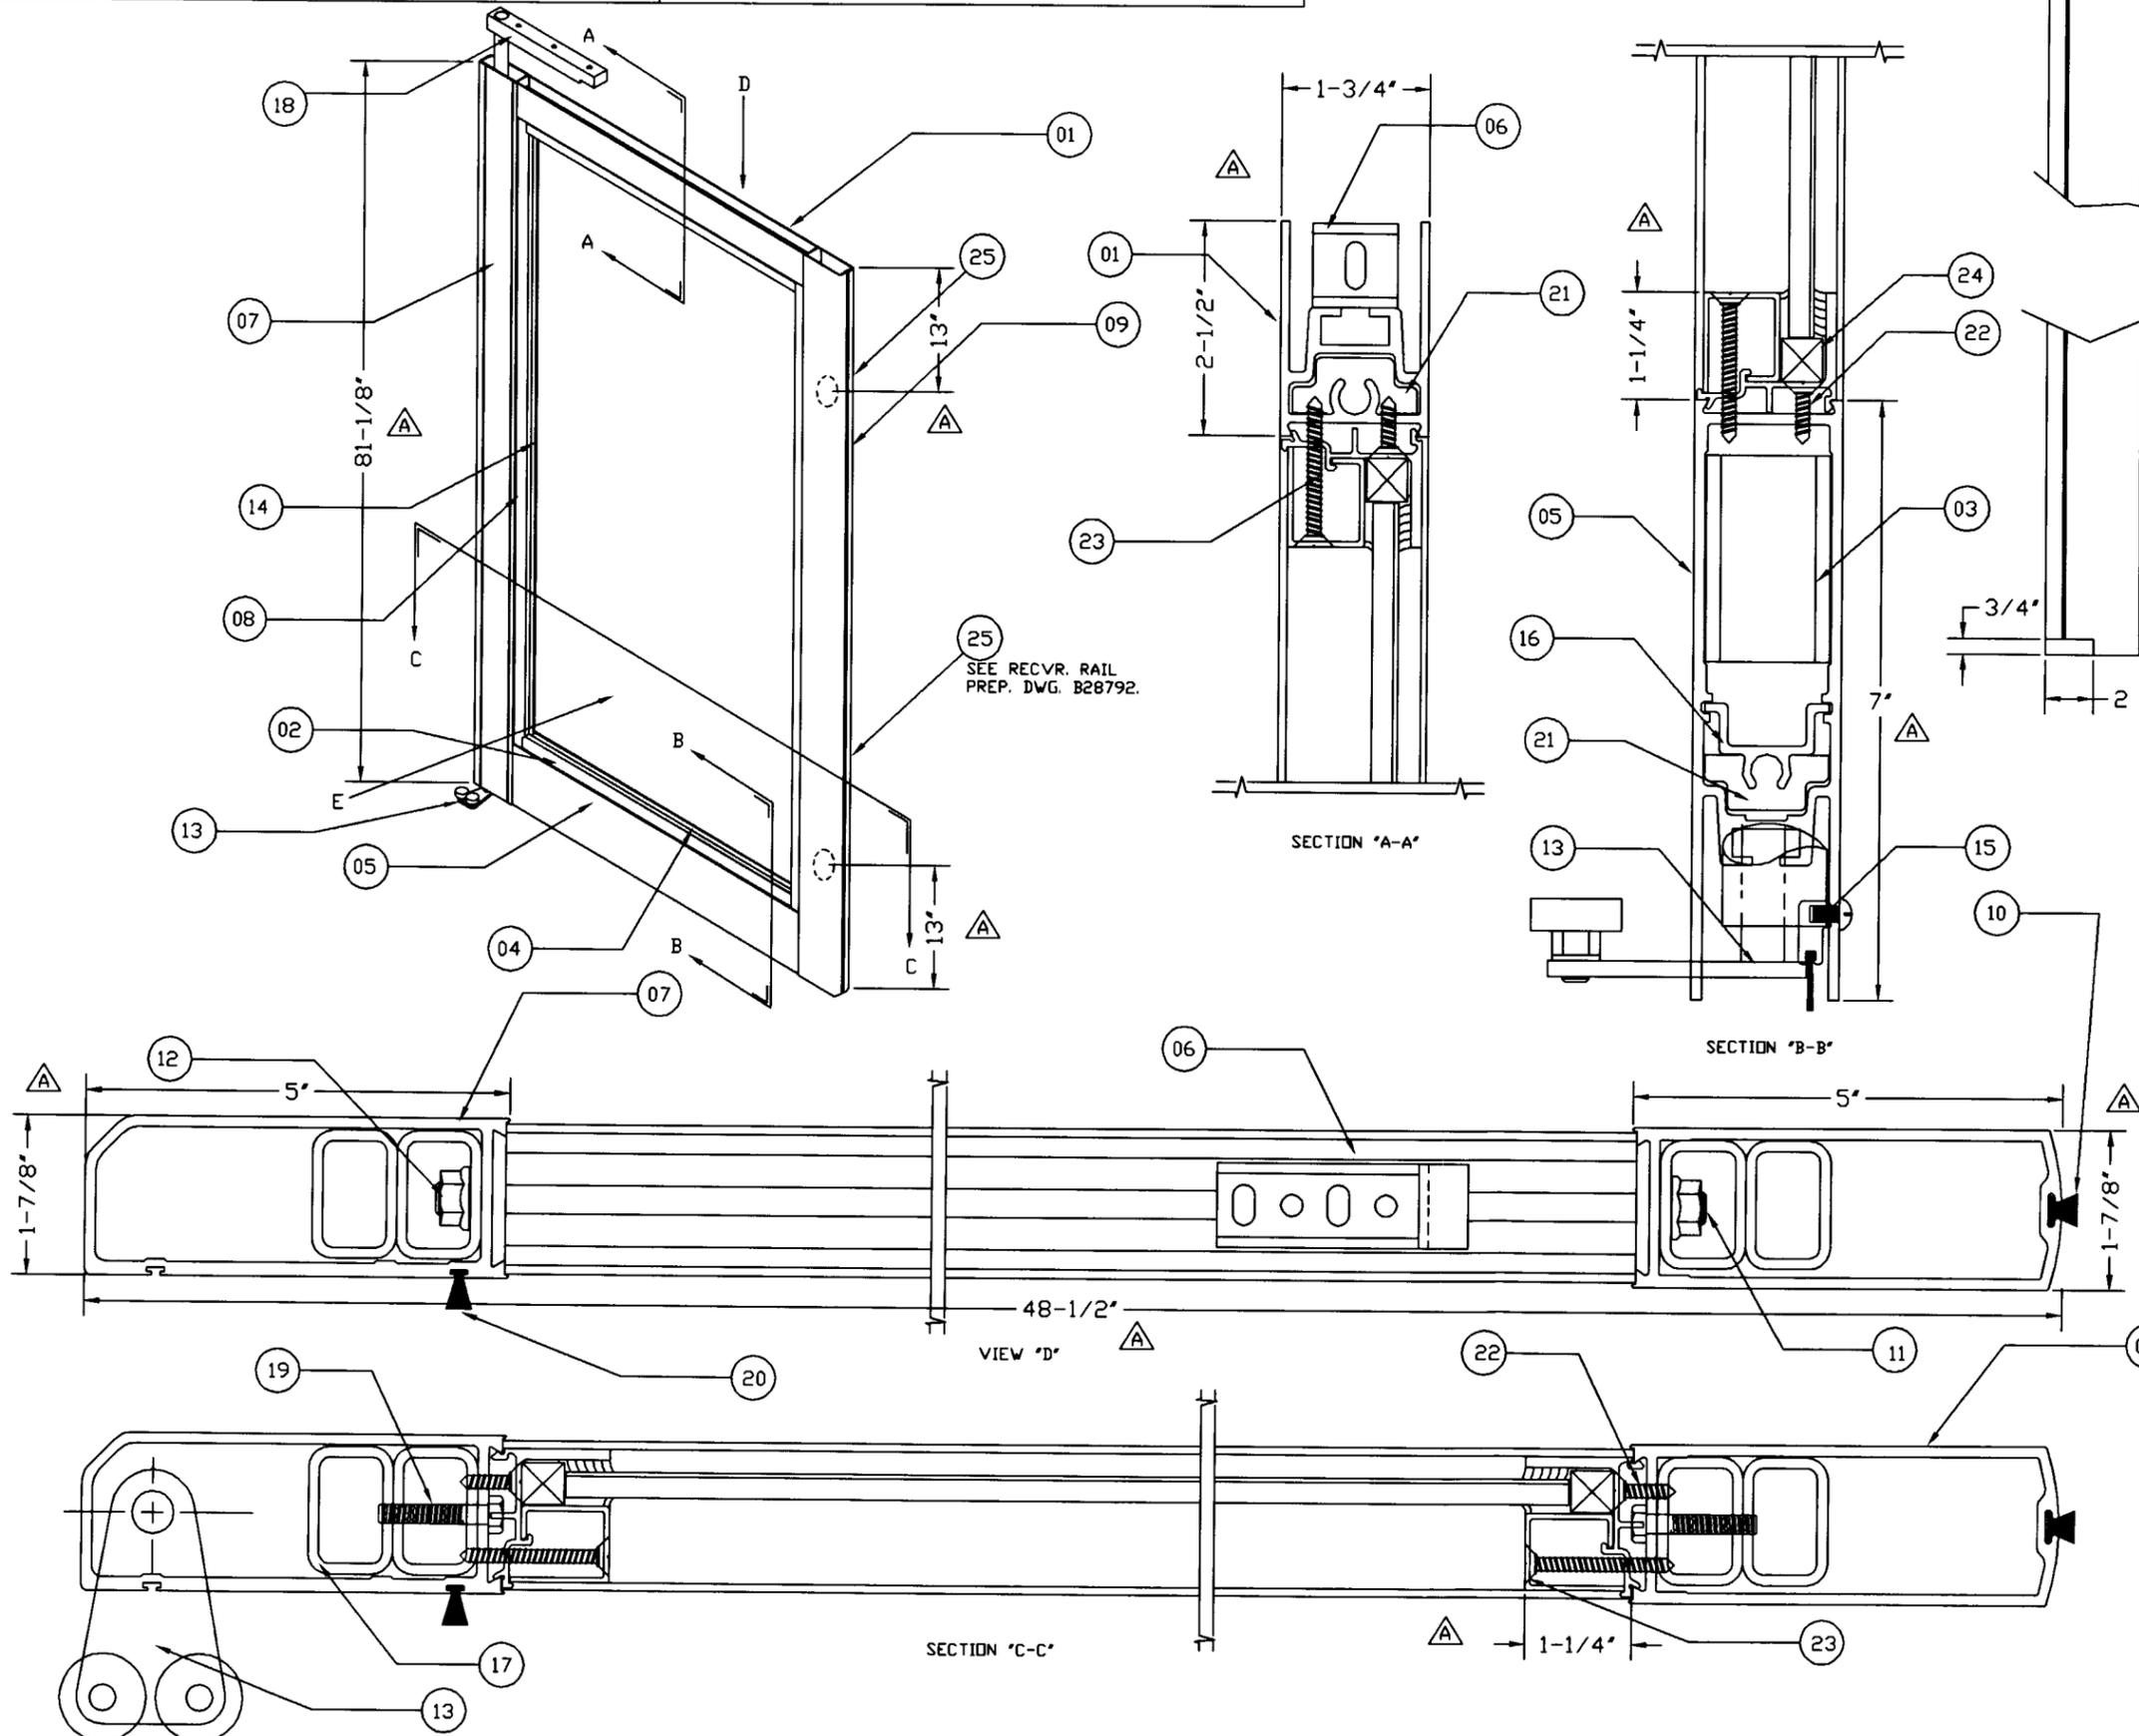


25	2	FLUSHBOLT WITH HOOKLATCH	A/R	1850/1870 COMBO
24	4	GLASS BLOCK	TPR565	1/2"x1/2"x2"
23	18	STOP SCREW - ST.STL.		#10x2" FHST.
22	18	GUTTER SCREW - ST.STL.		#10x1" FHST.
21	4	CLIP (DOOR RAIL)	B28290	
20	1	WEATHERBRUSH PILE		7936-6001-6
19	6	MTG BOLT (STIFFENER)		1/4"-20TPI. HHCS
18	1	PSA (PANIC ARM) ASSY.	B31437	
17	2	STIFFENER	B28776	
16	2	CONTAINMENT EXTR. (TIE ROD)	32664	DIE DWG.
15	1	DOOR SWEEP KIT	B28375	
14	2	GLASS STOP EXTR. (VERT.)	T51312	DIE DWG.
13	1	ROLLER GUIDE ASSY.	A28078	
12	4	3/8 FLANGED NUT		3/8-16TPI.
11	2	TENSION (TIE) ROD 3/8"		3/8-16TPI. STL.
10	1	WEATHERBRUSH PILE		8634-5771-1
09	1	VERTICAL (NOSE) RAIL 5'	H31044-A	DIE DWG.
08	2	GLASS GUTTER EXTR. (VERT.)	32668	DIE DWG.
07	1	VERTICAL (HEEL) RAIL 5'	H31048	DIE DWG.
06	1	BALLCATCH LATCHPLATE	B31616	
05	1	BOTTOM RAIL 7'	H32711-B	DIE DWG.
04	2	GLASS STOP EXTR. (HORIZ.)	T51312	DIE DWG.
03	2	HORIZ. RAIL CLIP	A28283	
02	2	GLASS GUTTER EXTR. (HORIZ.)	32668	DIE DWG.
01	1	TOP RAIL 2 1/2"	H2979	DIE DWG.
ITEM#	QTY.	DESCRIPTION	DWG.#	REMARKS

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No **02-0313.05**
Expiration Date **12/08/03**

By *[Signature]*
Miami Dade Product Control
Division

DWG. # WB19710 (REV. C. 03/02)
WINDBREAKER DOOR SYSTEM
SHT. 5 OF 6 REV. B
ACTIVE LEAF RHS.
09-20-01

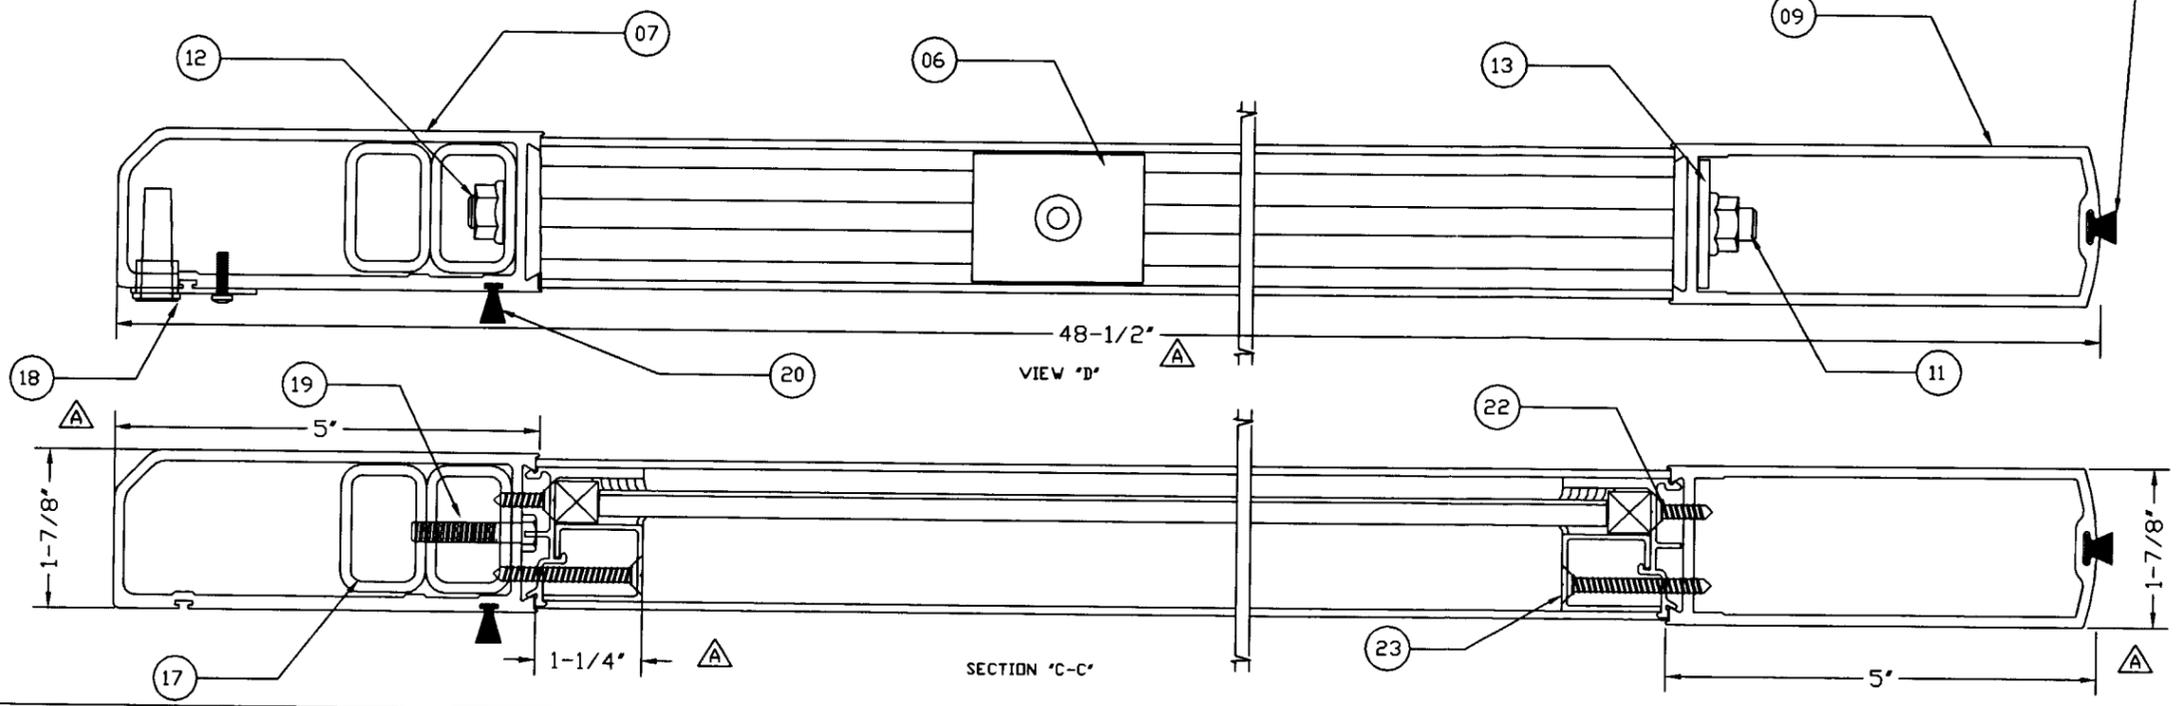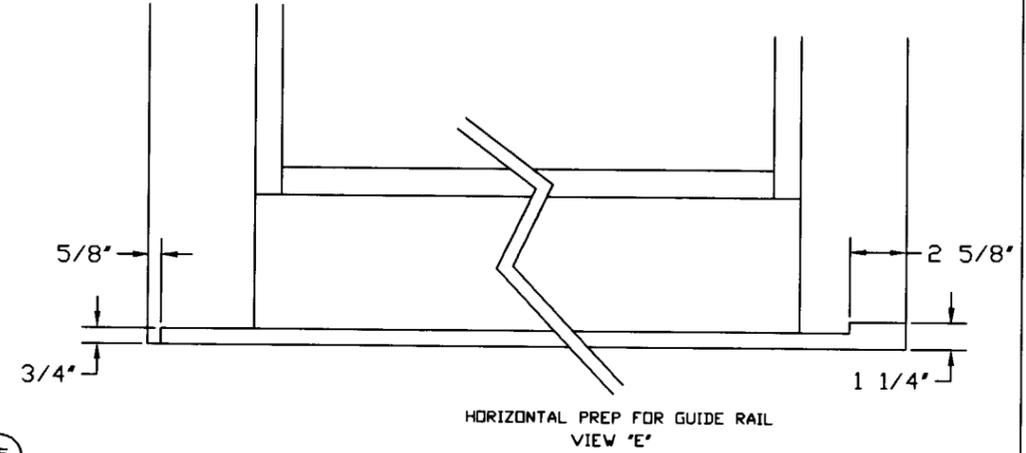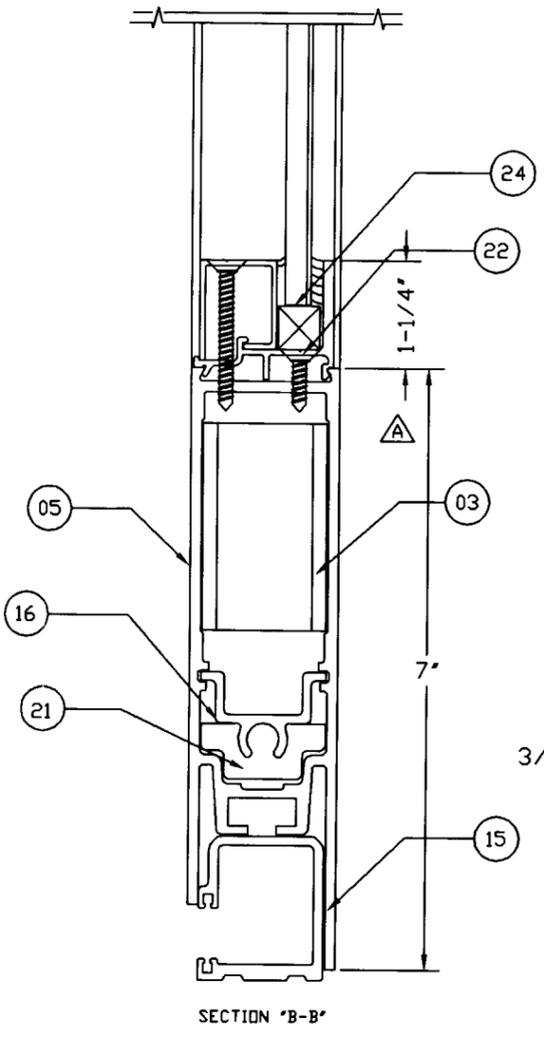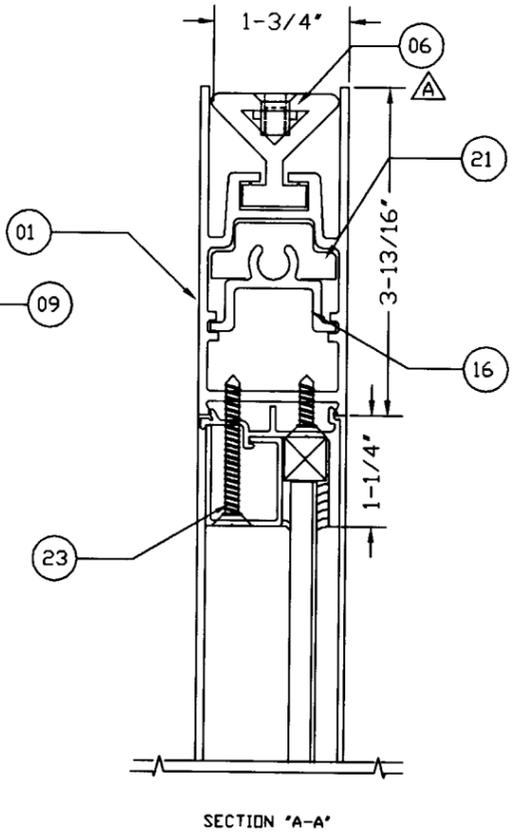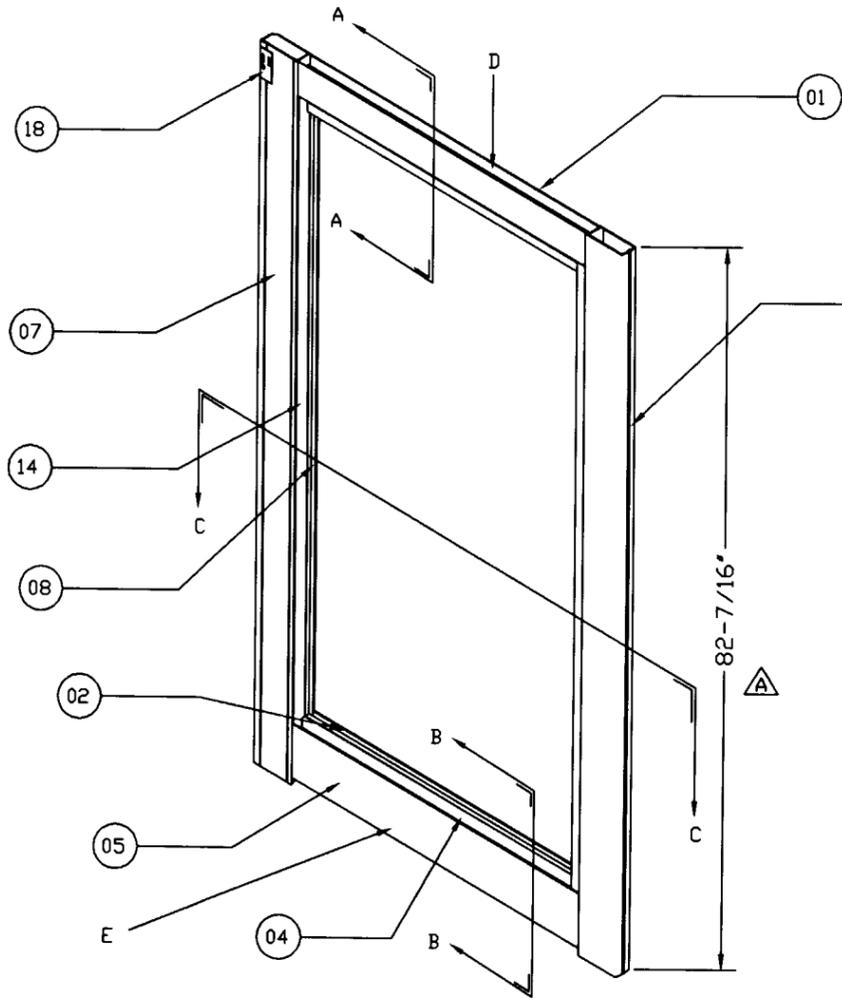

24	4	GLASS BLOCK	TPR565	1/2"x1/2"x2"
23	18	STOP SCREW - ST. STL.		#10x2" FHST.
22	18	GUTTER SCREW - ST. STL.		#10x1" FHST.
21	4	CLIP (DOOR RAIL)	B28290	
20	1	WEATHERBRUSH PILE		7936-6001-6
19	6	MTG BOLT (STIFFENER)		1/4"-20TPI. HHCS
18	1	BREAK-OUT SWITCH ASSY.	B28250	REF. INSTALL DWG.
17	1	STIFFENER	B28776	
16	2	CONTAINMENT EXTR. (TIE ROD)	32664	DIE DWG.
15	1	ROLLER GUIDE SLIDE TRACK	4934XA	DIE DWG.
14	2	GLASS STOP EXTR. (VERT.)	T51312	DIE DWG.
13	2	STL. WASHER	A28072	
12	4	3/8 FLANGED NUT		3/8-16TPI.
11	2	TENSION (TIE) ROD 3/8"		3/8-16TPI. STL.
10	1	WEATHERBRUSH PILE		8634-5771-1
09	1	VERTICAL (NOSE) RAIL 5"	H31044-A	DIE DWG.
08	2	GLASS GUTTER EXTR. (VERT.)	32668	DIE DWG.
07	1	VERTICAL (HEEL) RAIL 5"	H31048	DIE DWG.
06	3	DELTA MTG. CLIP	A28349	
05	1	BOTTOM RAIL 7"	H32711-B	DIE DWG.
04	2	GLASS STOP EXTR. (HORIZ.)	T51312	DIE DWG.
03	2	HORIZ. RAIL CLIP	A28283	
02	2	GLASS GUTTER EXTR. (HORIZ.)	32668	DIE DWG.
01	1	TOP RAIL 3 13/16"	H32710	DIE DWG.
ITEM#	QTY.	DESCRIPTION	DWG.#	REMARKS

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 02-0313.05
Expiration Date 12/08/03
By *[Signature]*
Miami Dade Product Control
Division

DWG. # WB19710 (REV. C. 03/02)
WINDBREAKER DOOR SYSTEM
SHT. 6 OF 6 REV. B
SIDELITE RHS.
09-20-01