



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

---

**F.P.G. Wholesale Inc.  
7190 Coral Way  
Miami, FL 33155**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: Series 2130 Outswinging Raised Wood Panel Door**

**APPROVAL DOCUMENT:** Drawing No. 99001, titled "FBMA Series 2130 Wood Door", sheets 1 through 3 of 3, prepared, by E.D. & D., dated 12/06/99, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: None**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.


**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA # 99-0316.04** and, consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by **Raul Rodriguez**.



**NOA No 02-0318.05  
Expiration Date: April 16, 2007  
Approval Date: April 12, 2002  
Page 1**

DOOR AND FRAME SYSTEM			
ITEM #	DESCRIPTION		
1	DOOR MODEL 2130-MANUFACTURER(S)	WOOD ROGUE VALLEY OR SIMPSON	
2	JR300 T-ASTRAGAL WITH (2) 1/8" SCHED 40x 8 1/4" LONG STL PIPE SLEEVES BORED TO CLEAR #3. WITH GLUE, 7/16" X 2" STAPLES 15" OC, & (16) #8 X 2" FHWS (4 EA SIDE OF SLEEVE). WEATHERSTRIP - SCHLEGEL #QDS-650		
3	12" EXTENSION CONCEALED FLUSH BOLTS - QUALITY MFG #1358 - 1/2" # X 1-1/2" LONG STEEL W/ 3/4" THROW. .077" THICK BRASS STRIKE AT FRAME HEADER ABOVE INACTIVE DOOR AT UPPER CONCEALED FLUSH BOLT. THERE ARE NO STRIKES AT THE BOTTOM OF DOORS. THE LOCKS ENGAGE HOLES DRILLED INTO THE ALUMINUM THRESHOLD.		
4	SINGLE SURFACE DEAD BOLTS - MFR & MODEL #.	KWKSET #666 OR SCHLAGE #B180N	
5	PASSAGE LOCK - MFR & MODEL #.	KWKSET #200E OR SCHLAGE #F10N	
6	SINGLE CYLINDER DEAD BOLT - MFR & MODEL #.	KWKSET #660 OR SCHLAGE #B160N	
7	4" X 4" BUTT HINGE WITH SAFETY STUD - HAGER #1843 OR PENROD #MH40ALAC (MIXED), CENTER 8-3/4" AND 84" FROM TOP OF DOOR, SCREWS - TO DOOR: (4) #9 X 3/4" FHWS. TO JAMB: (3) #9 X 3/4" FHWS & (1) #9 X 2-1/2" FHWS.		
8	4" X 4" BUTT HINGE - HAGER #1841 OR PENROD #MH40ALWS, CENTER 31-3/4" AND 58" FROM TOP OF DOOR. SCREWS - TO DOOR: (4) #9 X 3/4" FHWS. TO JAMB: (3) #9 X 3/4" FHWS & (1) #9 X 2-1/2" FHWS.		
9	THRESHOLD-MODEL #JR100 (DEPTH X NOSE HEIGHT)	2-1/2" X 1-1/8"	2-1/2" X 7/8" OR 3" X 1-1/8"
10	FRAME - 1-1/4" X (WOOD)	4-9/16" OR	5-1/4"
11	HEAD PLATE TO MATCH FRAME - WITH 3/8" PLYWOOD ATTACHED WITH GLUE & 3/4" STAPLES 1" TO 1-1/4" FROM EACH EDGE & 8-3/4" (AVG) O.C. AND (3) STAPLES PER JAMB.		
12	WEATHERSTRIP - SCHLEGEL MODEL #	#QDS-650 OR	QEB-928
13	2" X 3" X 0.007" VINYL FLAP GLUED TO BOTTOM OF ASTRAGAL.		
13a	FRAME SCREWS TO 2X WOOD BUCK - #10 X 2-1/2" FHWS. 6" FROM CORNERS & 24" OC (MAX). FRAME JAMBS AND @ HEAD 6" FROM CORNERS AND 20" O.C. MAX.		
13b	FRAME SCREWS TO MASONRY - 3/16" FH TAPCONS W/ 1-1/4" MIN. ENBEDMENT INTO MASONRY. SPACING IS SAME AS ABOVE.		
14	PEMCO #S88 SELF ADHESIVE WEATHERSTRIP AT OUTSIDE EDGE AT TOP OF BOTH DOORS.		
15	PEMCO #S88 AT OUTSIDE EDGE AT LOCK STILE OF ACTIVE DOOR.		
16	PEMCO #345AV RAIN DRIP & SWEEP ATTACHED W/ #6 X 5/8" RHSWS @ 6" O.C.		
16a	PAD/DIVERTER AT BOTTOM OF EACH JAMB.	1" X 2" X 3/16" SELF ADHESIVE PILE PAD.	
16b	PAD/DIVERTER AT BOTTOM OF ASTRAGAL		

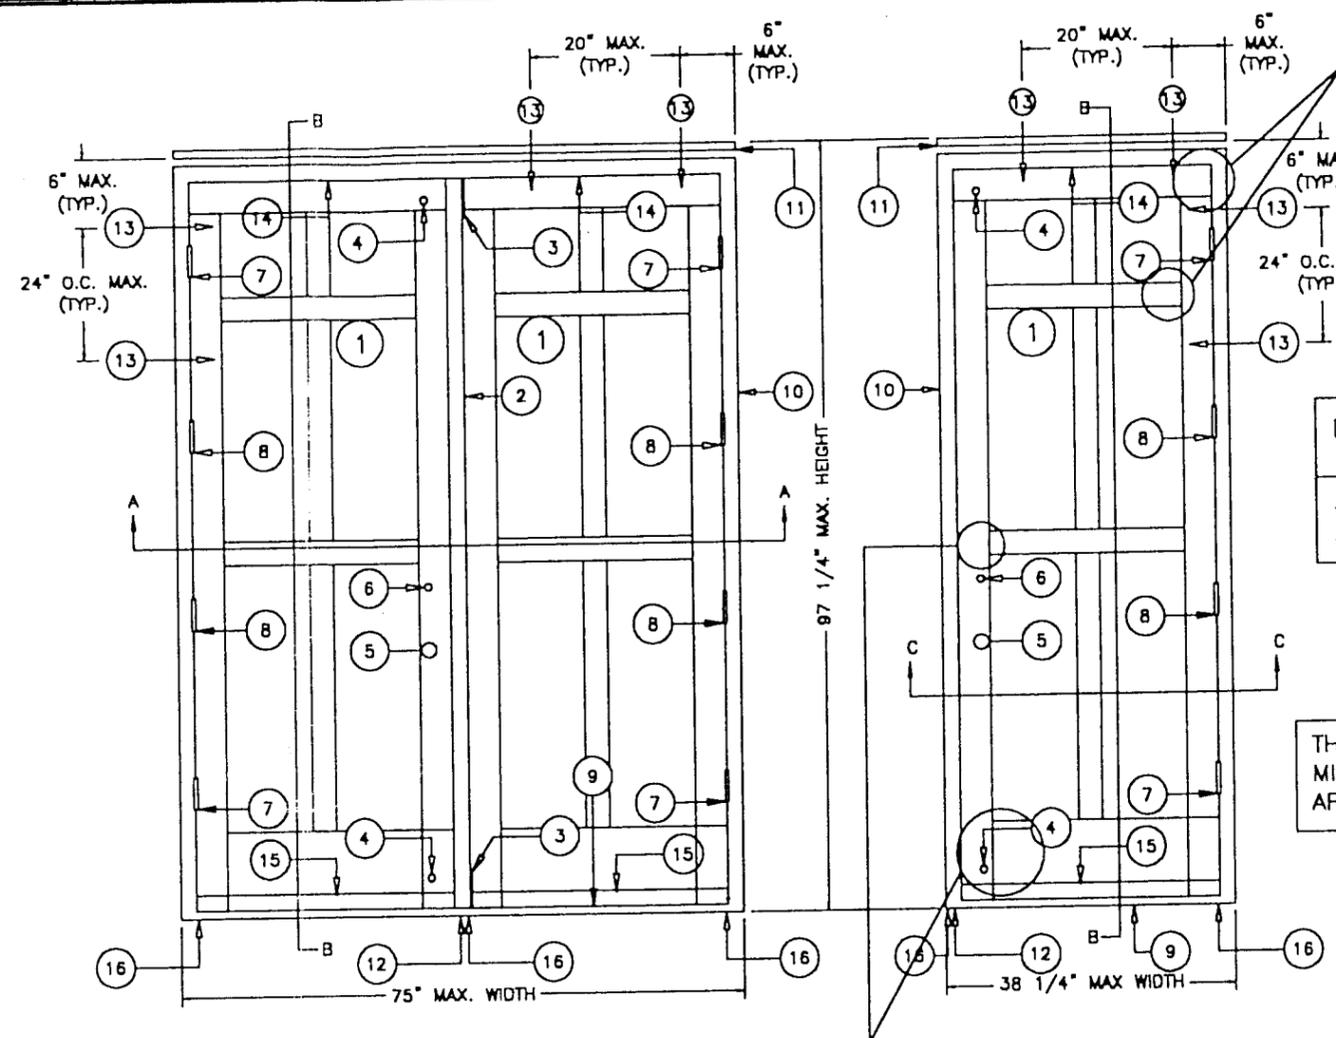

**CORNER CONSTRUCTION**  
 BUTTED AND THE ENDS AND THE ENDS OF ALL INTERMEDIATE FRAME MEMBERS ARE COPED TO TIGHTLY FIT THE INTERSECTING FRAMING AND ATTACHED AT 4-1/2" RAILS TO STILES WITH MIN. TWO (2) 5/8" X 4-5/8" LONG WOOD DOWELS, 2-3/4" PENETRATION INTO RAIL.

**DESIGN PRESSURE RATING**  
 +48.3 PSF  
 -63.4 PSF


THESE DOORS REQUIRE MIAMI DADE COUNTY APPROVED SHUTTERS.

**CORNER CONSTRUCTION**  
 BUTTED AND THE ENDS OF ALL INTERMEDIATE FRAME MEMBERS ARE COPED TO TIGHTLY FIT THE INTERSECTING FRAMING AND ATTACHED AT 7-1/2" AND 8-1/8" RAILS TO STILE WITH A MINIMUM THREE (3) 5/8" X 4-5/8" LONG WOOD DOWELS, 2-3/4" PENETRATION INTO RAIL.


**SEALANT**  
 THE FRAME INTERSECTION, ENDS OF THE THRESHOLD, AND ALL WEATHER-STRIP INTERSECTIONS MUST BE CAULKED WITH POLYSEAMSEAL OR DAP ADHESIVE SEALANT DURING ASSEMBLY.

NOTE:  
 COMPONENTS ABOVE CAN BE SUBSTITUTED BY APPROVED EQUAL WITH A MIAMI-DADE COUNTY NOTICE OF ACCEPTANCE.

**ITEM #2**  
 J-R #300 ASTRAGAL W/ SLEEVES & KERFED FOR WEATHERSTRIP

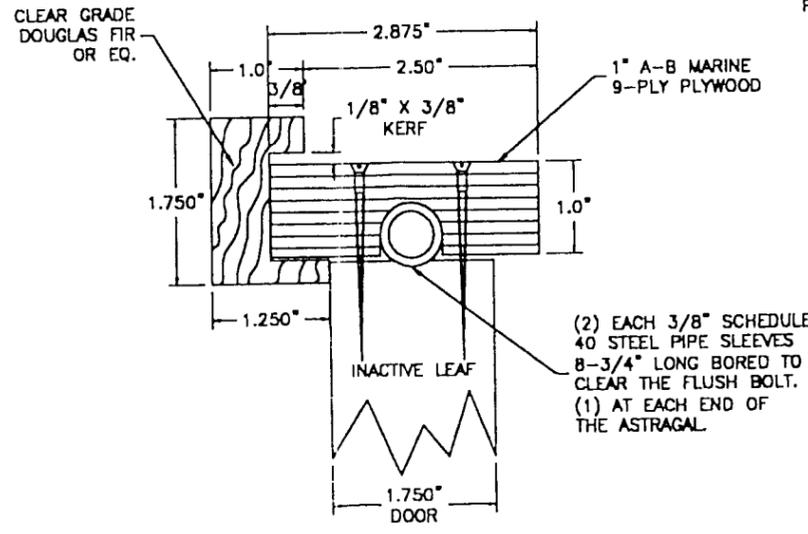






**ITEM #9**  
 J-R #100 THRESHOLD WOOD & ALUM W/ QDS WEATHERSTRIP

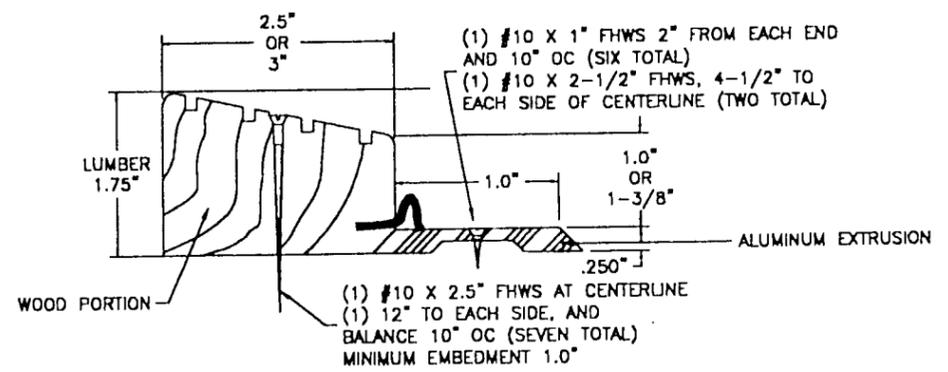

**PRODUCT RENEWED**  
 as complying with the Florida Building Code  
 Acceptance No 02-0319.05  
 Expiration Date 04/16/07

By: *[Signature]*  
 Miami Dade Product Control Division

Drawn by: E.D. & D.  
 Date: 12/6/99  
 Revisions:  
 Drawing #99001  
 Drawing Title:  
 FBMA SERIES 2130 WOOD DOOR  
 Page 1 of 3

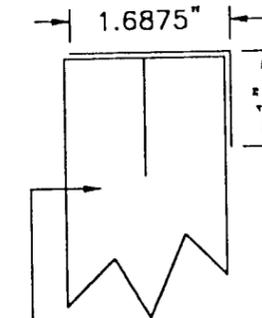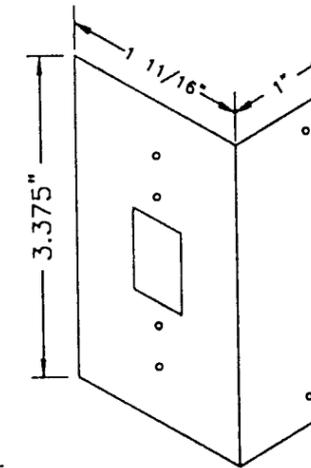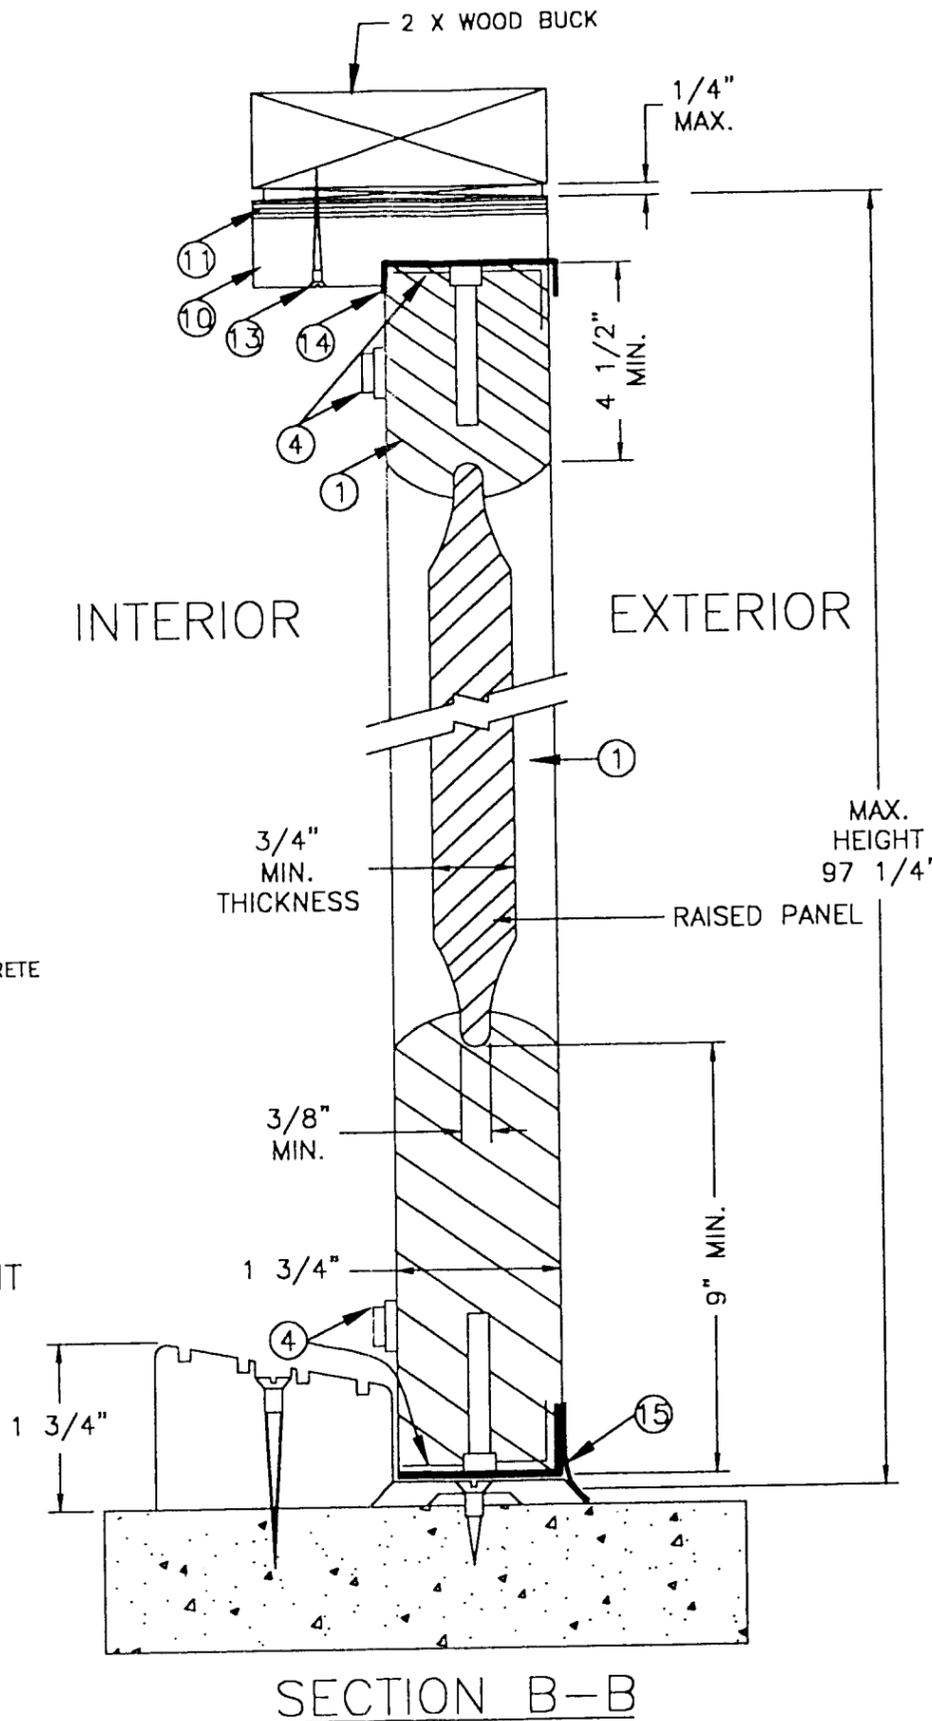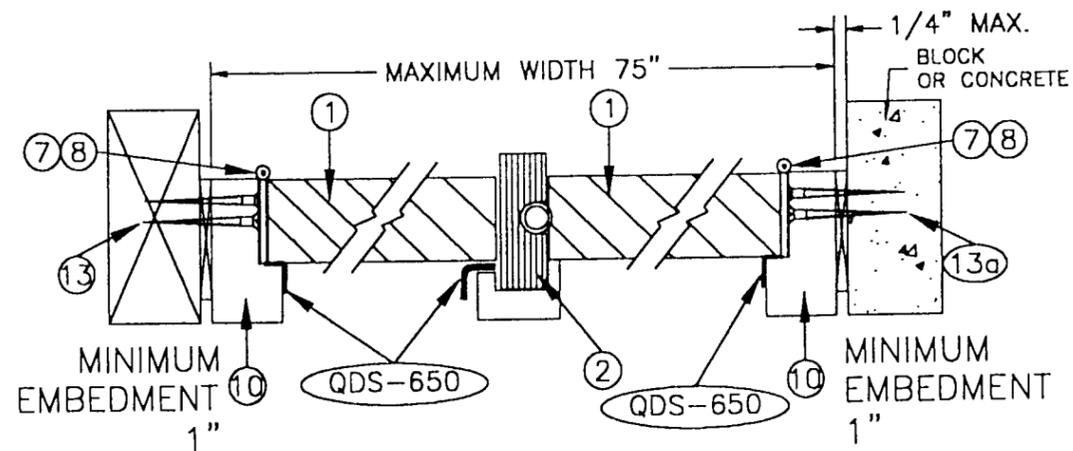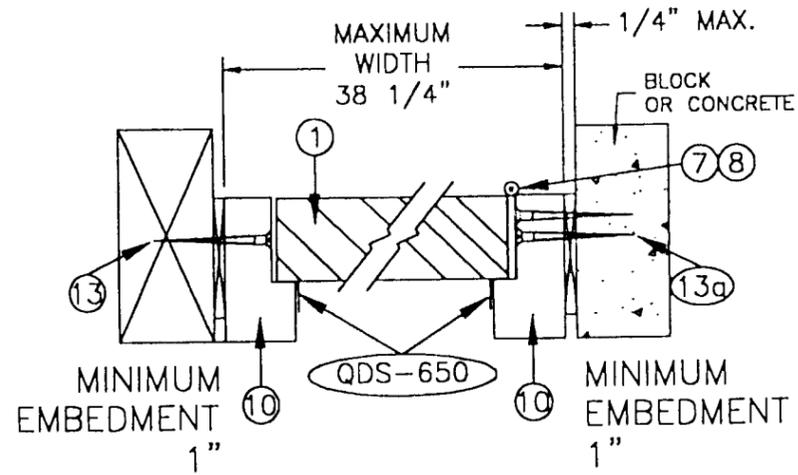

THIS SIDE OF DOOR TO WEATHERSTRIP

ITEM #4

LOCK REINFORCER BY M.A.G. ENG. MODIFIED

PRODUCT RENEWED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 02-0318.05  
 Expiration Date 09/16/07  
 By  
 Miami Dade Product Control  
 Division


Drawn by: E.D. & D.
Date: 12/6/99
Revisions:
Drawing #99001
Drawing Title: FBMA SERIES 2130 WOOD DOOR
Page 2 of 3

# 1 3/4 FRONT ENTRANCE DOORS (EXTERIOR) – MODEL 2130


MAXIMUM PANEL WIDTH 36"

Minimum Dimensions


Stiles & top rail.....	4-1/2"
Lock rail.....	7-1/2"
Intermediate rail & mullion.....	2-1/8"
Bottom rail.....	9"
Panels Raised.....	3/4" thick

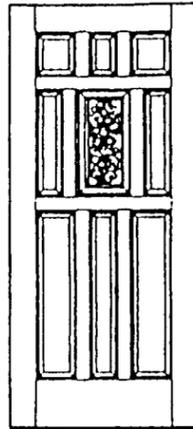


FLORENTINE 4101

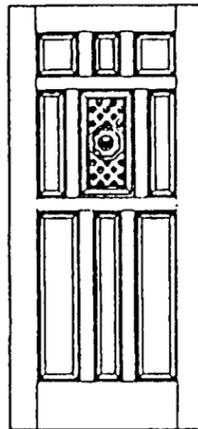


TANGIER 4104

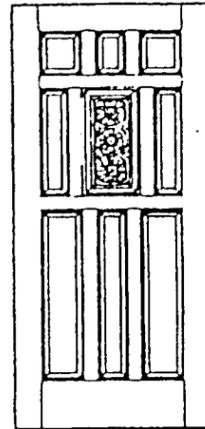


AZTEC 4105




BRITANIA 4108

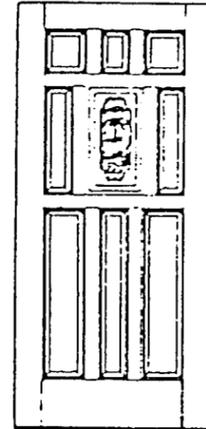


MARINER 4109




2060




2010




2130




2011




2009

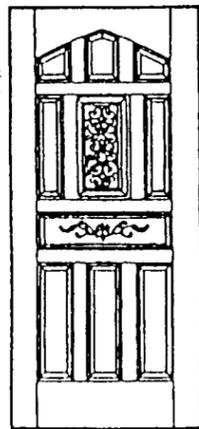


FLORENTINE 4401

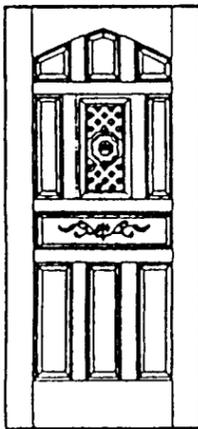


TANGIER 4404

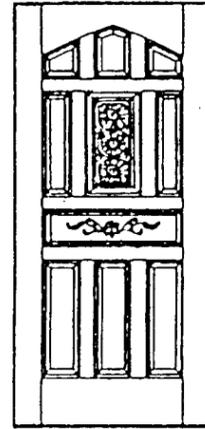


AZTEC 4405




BRITANIA 4408

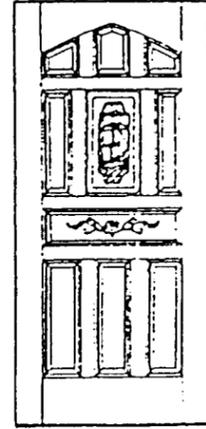


MARINER 4409




Duadrille 4060




Grandee 4115




Colonial VI 3130




Colonial VIII 3010




Madrid 4112

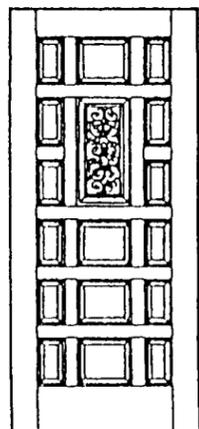


FLORENTINE 4201

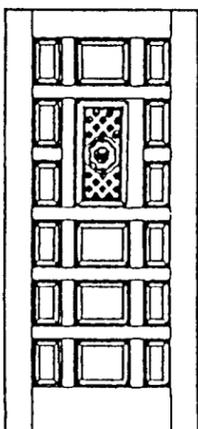


TANGIER 4204

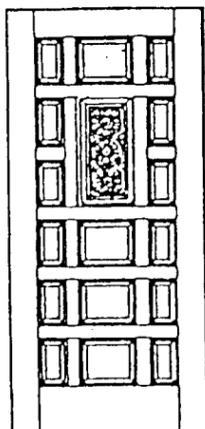


AZTEC 4205




BRITANIA 4208

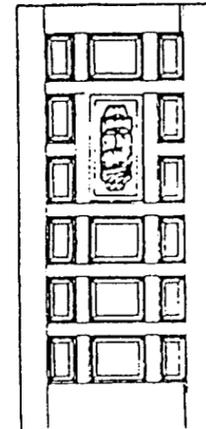

MARINER 4209

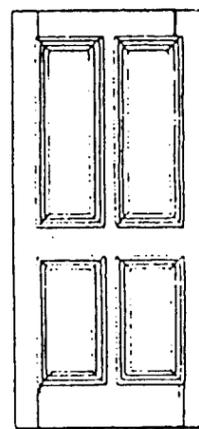

Colonial IV 3044  
6'-8" ONLY



Chateau 4180  
6'-8" ONLY

**PRODUCT RENEWED**  
as complying with the Florida  
Building Code  
Acceptance No. 02-0318.05  
Expiration Date 04/16/07  
By *[Signature]*  
Miami Dade Product Control  
Division

Drawn by: E.D. & D.
Date: 12/6/99
Revisions:
Drawing #99001
Drawing Title: FBMA SERIES 2130 WOOD DOOR
Page 3 of 3