



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

---

**Monier Lifetile, LLC.  
135 NW 20<sup>th</sup> Street  
Boca Raton, FL 33431**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: Premium Duralite Villa Lightweight Concrete Roofing Tile**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This consists of pages 1 through 4.

The submitted documentation was reviewed by Frank Zuloaga, RRC.



**NOA No.: 02-0328.05  
Expiration Date: 05/02/07  
Approval Date: 05/02/02  
Page 1 of 4**

## ROOFING ASSEMBLY APPROVAL:

**Category:** Roofing  
**Sub-Category:** Low Profile Tile  
**Material:** Concrete

### 1. SCOPE:

This is a new roofing system using “Monier Lifetile Premium Duralite Villa Roofing Tile”, as manufactured by Monier Lifetile, LLC., described in section 2 of this Notice of Acceptance. For the locations where the pressure requirements, as determined by applicable building code does not exceed the design pressure values obtained by calculations in compliance with RAS 127 using the values listed in section 4 herein. The attachment calculations shall be done as a moment based system.

### 2. PRODUCT DESCRIPTION:

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
Premium Duralite Villa Roofing Tile	Length: 16½" Width: 13" Thickness: ½"	PA 112	Low profile, interlocking, high pressure extruded lightweight concrete roof tile equipped with one nail hole and double roll ribs. For direct deck or battened nail-on, adhesive set applications.
Trim Pieces	Length: varies Width: varies varying thickness	PA 112	Accessory trim, concrete roof pieces for use at hips, rakes, ridges and valley terminations. Manufactured for each tile profile.

### 3. LIMITATIONS:

- 3.1 Fire classification is not part of this acceptance.
- 3.2 Applicant shall retain the services of a Miami Dade county Certified Laboratory to perform quarterly tests in accordance with PA 112, appendix ‘A’. such testings shall be submitted to the Miami dade County Product Control Division for review.
- 3.3 Minimum underlayment shall be in compliance with the applicable Roofing Application Standards listed in section 4.1 herein.
- 3.4 30/90 hot mopped underlayment applications may be installed perpendicular to the roof slope unless stated otherwise by the underlayment material manufacturers published literature.
- 3.5 This acceptance is for wood deck applications. Minimum deck requirements shall be in compliance with applicable building code.
- 3.6 May be installed on slopes 7:12 and greater.

### 4. INSTALLED:

- 4.1 “Premium DuraLite Villa Roofing Tile” and its components shall be installed in strict compliance with Roofing Application Standard RAS 118, RAS 119 and RAS 120.
- 4.2 Data for Attachment Calculations.



NOA No.: 02-0328.05  
Expiration Date: 05/02/07  
Approval Date: 05/02/02  
Page 2 of 4

<b>Table 1: Aerodynamic Multipliers - <math>\lambda</math> (ft<sup>3</sup>)</b>		
<b>Tile Profile</b>	<b><math>\lambda</math> (ft<sup>3</sup>) Batten Application</b>	<b><math>\lambda</math> (ft<sup>3</sup>) Direct Deck Application</b>
<b>Premium Duralite Villa</b>	0.27	0.29

<b>Table 2: Restoring Moments due to Gravity - <math>M_g</math> (ft-lbf)</b>										
<b>Tile Profile</b>	<b>3":12"</b>		<b>4":12"</b>		<b>5":12"</b>		<b>6":12"</b>		<b>7":12" or greater</b>	
	Battens	Direct Deck	Battens	Direct Deck						
<b>Premium Duralite Villa</b>	3.0	3.9	3.0	3.8	2.9	3.7	2.8	3.6	2.7	3.5

<b>Table 3: Attachment Resistance Expressed as a Moment - <math>M_f</math> (ft-lbf) for Nail-On Systems</b>		
<b>Tile Profile</b>	<b>Tile Application</b>	<b>Approved Screws</b>
		2 screws
<b>Premium Duralite Villa</b>	Battens	17.9
	Direct Deck	25.1

1 Data noted in Table 3 is for installation with a 3" tile headlap.



<b>Table 4: Attachment Resistance Expressed as a Moment - <math>M_f</math> (ft-lbf) for Mortar or Adhesive Set Systems</b>		
<b>Tile Profile</b>	<b>Tile Application</b>	<b>Attachment Resistance</b>
<b>Premium DuraLiteVilla</b>	Adhesive Set	45.8*

\*Average patty weight was 45.6 grams



**PROFILE DRAWINGS  
MONIER LIFETILE VILLA**

**Villa**

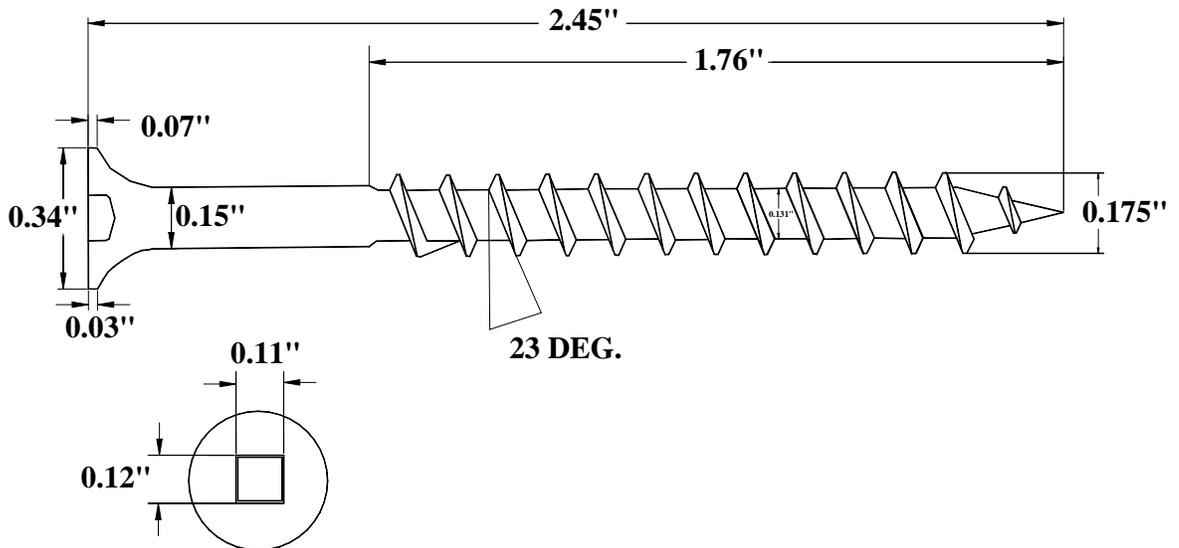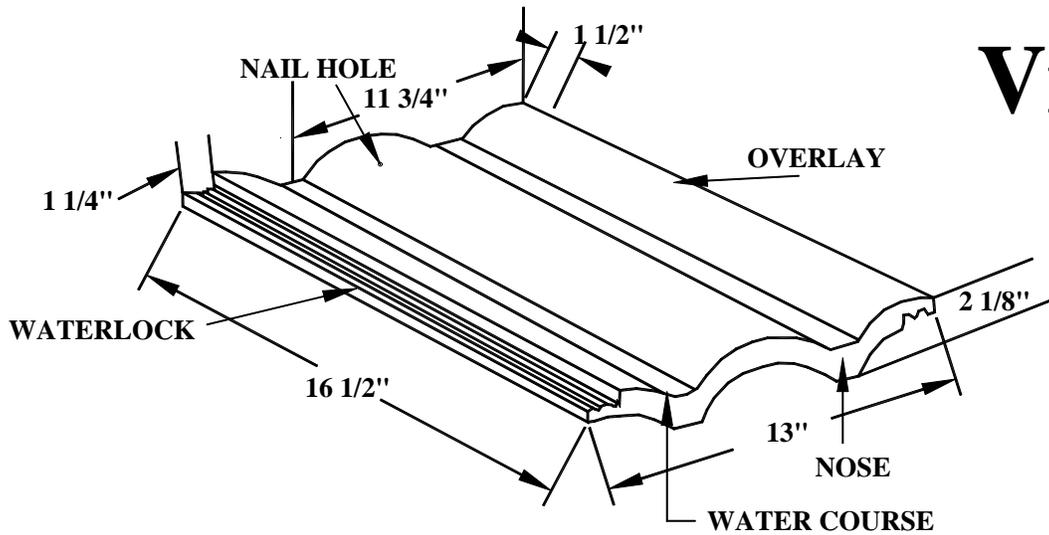

**END OF THIS ACCEPTANCE**



NOA No.: 02-0328.05  
 Expiration Date: 05/02/07  
 Approval Date: 05/02/02  
 Page 4 of 4

## EVIDENCE SUBMITTED

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
Redland Technologies	7161-03 Appendix III	Static Uplift Testing PA 102	Dec. 1991
Redland Technologies	7161-03 Appendix III	Static Uplift Testing PA 102(A)	Dec. 1991
The Center for Applied Engineering, Inc.	94-084	Static Uplift Testing PA 101 (Mortar Set)	May 1994
The Center for Applied Engineering, Inc.	94-060B	Static Uplift Testing PA 101 (Adhesive Set)	March, 1994
The Center for Applied Engineering, Inc.	25-7094-1	Static Uplift Testing PA 102 (4" Headlap, Nails, Direct Deck, New Construction)	Oct. 1994
The Center for Applied Engineering, Inc.	25-7094-7	Static Uplift Testing PA 102 (4" Headlap, Nails, Battens)	Oct. 1994
The Center for Applied Engineering, Inc.	25-7094-4	Static Uplift Testing PA 102 (4" Headlap, Nails, Direct Deck, Recover/Reroof)	Oct. 1994
The Center for Applied Engineering, Inc.	25-7183-1	Static Uplift Testing PA 102 (2 Quik-Drive Screws, Direct Deck)	Feb. 1995
The Center for Applied Engineering, Inc.	25-7183-2	Static Uplift Testing PA 102 (2 Quik-Drive Screws, Battens)	Feb. 1995
The Center for Applied Engineering, Inc.	25-7214-2	Static Uplift Testing PA 102 (1 Quik-Drive Screw, Direct Deck)	March, 1995
The Center for Applied Engineering, Inc.	25-7214-6	Static Uplift Testing PA 102 (1 Quik-Drive Screw, Battens)	March, 1995
The Center for Applied Engineering, Inc.	257814-3PA	Static Uplift Testing PA 102 (2 Screws)	Sept. 1996
The Center for Applied Engineering, Inc.	257834-3PA	Static Uplift Testing PA 102 (2 Screws; Batten)	Oct. 1996
The Center for Applied Engineering, Inc.	257834-1PA	Static Uplift Testing PA 101 (Adhesive)	Oct. 1996
Redland Technologies	7161-03 Appendix II	Wind Tunnel Testing PA 108 (Nail-On)	Dec. 1991
Redland Technologies	Letter Dated Aug. 1, 1994	Wind Tunnel Testing PA 108 (Nail-On)	Aug. 1994
Redland Technologies	P0631-01	Wind Tunnel Testing PA 108 (Mortar Set)	July 1994
Redland Technologies	P0402	Withdrawal Resistance Testing of screw vs. smooth shank nails	Sept. 1993
The Center for Applied Engineering, Inc.	Project No. 307025 Test #MDC-76	Wind Driven Rain PA 100	Oct. 1994
Professional Service Industries, Inc.	224-47099	Physical Properties PA 112	Sept. 1994