MIAMI-DADE

BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

Trinity Glass International.
4617 192nd Street East.
Tacoma, WA 98446

SCOPE: This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami Dade-County Product Control Division (In Miami-Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.
This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Trinity Lite Frame
APPROVAL DOCUMENT: Drawing No. S2240, with no title, sheet 1 of 1, dated 04/08/02, prepared by R. W. Building Consultants, Inc., signed and sealed by L. F. Schmidt PE, bearing the Miami Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami Dade County Product Control Division.
MISSILE IMPACT RATING: None.

LABELING: Each carton containing certified extrusions shall be labeled with the extruder name city, state and "MDCA". In addition, each Certified Extrusion shall be labeled every 4 ft or less on the underside with the Extruder Name and "MDCA.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.
This NOA consists of pages 1 and 2.
The submitted documentation was reviewed by **Candido F. Font PE.**

PRODUCT CONTROL ACCEPTED

NOTE: THIS IS A COMPONENT APPROVAL AND DOES NOT INCLUDE AN EVALUATION OF THE STRUCTURAL PERFORMANCE OF THIS COMPONENT. SYSTEMS INCORPORATING TRINITY LITE FRAMES SHALL APPLY FOR AN NOA TO THIS OFFICE AND SHALL SUBMIT TEST REPORTS AND OTHER REQUIRED DOCUMENTS SHOWING THAT THE SYSTEM USING THIS COMPONENT WILL RESIST THE LOADS ACCORDING TO CHAPTER 16 OF THE FBC 2001.

Approved as complying with the Florida Building Code
Date 01/03/03
NOA# 02-0429.11
Miami Dade Product Control Division
By

FOR OFFICE USE ONLY

TRINITY GLASS INTERNATIONAL
4617 192ND STREET EAST
TACOMA, WA 98446
PH. (253) 875-6711

Notes:

1. Plastic Type – LUPOY EU-5007
2. Color – White
3. Tensile Strength – 7,616.0 psi
4. Process – Molded
5. Mfg. Facility – Tacoma, WA

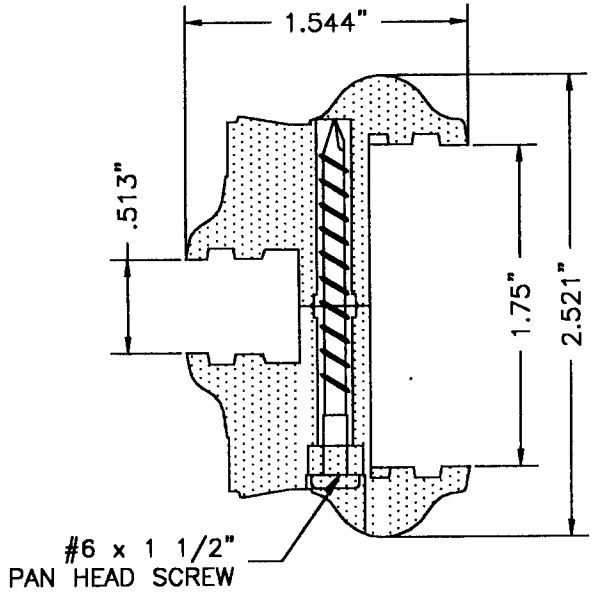

TRINITY LITE FRAME

PRODUCT PROPERTIES

TEST DESCRIPTION	TEST DESIGNATION	TEST RESULT
SELF IGNITION TEMP.	ASTM D1929	880 °F
RATE OF BURNING	ASTM D635	1.10 IN. / MIN.
SMOKE DENSITY	ASTM D2843	69.6%
TENSILE STRENGTH	ASTM D638	* BEFORE 7372 PSI
		* AFTER 7616 PSI

* WEATHERING PER SECTION 2605.2 OF THE FBC 2001

5-28-02

Lyndon F. Schmidt
Florida P. E. No. 43409
19506 French Lace Drive
Lutz, FL 33558

NO.	DATE	REVISIONS	BY
1	5/28/02	GENERAL REVISION	THJ

RW BUILDING CONSULTANTS, INC.
813.684.3831

DATE: 4/08/02
SCALE: N.T.S.
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2240
SHEET 1 OF 1