



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

---

**Parrett Manufacturing  
810 Second Avenue East  
Dorchester, WI 54425-0440**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: Direct Set Fixed Wood Window with Brickmold**

**APPROVAL DOCUMENT:** Drawing No. S-2170, titled "Parrett Windows, Wood Direct Set/Direct Set Sash Fixed Frame Windows", sheets 1 through 6, prepared by R.W. Building Consultants, Inc., dated 3/5/02, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

The submitted documentation was reviewed by **Raul Rodriguez**



**NOA No 02-0515.01  
Expiration Date: April 18, 2007  
Approval Date: April 18, 2002  
Page 1**

**Parrett Manufacturing, Inc.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

(For File ONLY. Not part of NOA)

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No **S-2170**, titled "Parrett Windows, Wood Direct Set/Direct Set Sash Fixed Frame Windows", sheets 1 through 6, prepared by R.W. Building Consultants, Inc., dated 3/5/02.

**B. TESTS**

1. Test reports on 1) Air Infiltration Test, per SFBC, PA 202-94  
2) Uniform Static Air Pressure Test, Loading per SFBC PA 202-94  
3) Water Resistance Test, per SFBC, PA 202-94  
4) Large Missile Impact Test per SFBC, PA 201-94  
5) Cyclic Wind Pressure Loading per SFBC, PA 203-94  
along with marked-up drawings and installation diagram of aluminum clad direct set wood fixed window, prepared by Certified Testing Laboratories, Test Report No. **CTLA-699W**, dated 8/2/01, signed and sealed by Ramesh Patel, P.E.
2. Test reports on 1) Air Infiltration Test, per SFBC, PA 202-94  
2) Uniform Static Air Pressure Test, Loading per SFBC PA 202-94  
3) Water Resistance Test, per SFBC, PA 202-94  
4) Large Missile Impact Test per SFBC, PA 201-94  
5) Cyclic Wind Pressure Loading per SFBC, PA 203-94  
along with marked-up drawings and installation diagram of aluminum clad direct set wood fixed window, prepared by Certified Testing Laboratories, Test Report No. **CTLA-642W**, dated 1/22/01, signed and sealed by Ramesh Patel, P.E.

**C. CALCULATIONS**

1. Anchor Calculations and structural analysis, prepared by Wendell Haney, P.E. dated 12/3/01, signed and sealed by Wendell Haney, P.E.

**D. MATERIAL CERTIFICATIONS**


1. None

**E. STATEMENTS**

1. None

**F. OTHER**

1. Letter from R.W. Building Consultants, Inc.
2. This replaces NOA 01-1220.02, which was issued with the incorrect product description

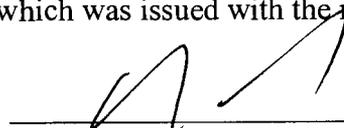

**Raul Rodriguez, Chief  
Product Control Division  
NOA No 02-0515.01  
Expiration Date: April 18, 2007  
Approval Date: April 18, 2002**

# PARRETT WINDOWS

WOOD FIXED FRAME DIRECT SET WINDOWS  
WITH BRICKMOLD & W/ & W/OUT SASH

### GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. PRODUCT MEETS LARGE MISSILE IMPACT RESISTANT CODE.
5. THIS PRODUCT MEETS THE WATER REQUIREMENT FOR THE FLORIDA BUILDING CODE.
6. FOR DESIGN PRESSURE RATINGS SEE CHART ON SHEET 2.

### WOOD FIXED FRAME WINDOWS W/ & W/OUT SASH

(Common to all conditions)

Wood Main Frame: Finger Jointed Pine, .625" THK. X 4.563" DEEP.

Wood Sash: Finger Jointed Pine, 2.375" WIDE X 1.125" HIGH.

Wood Glass Stop W/out sash: Finger Jointed Pine, .813" high x 1.125" wide.

Wood Glass Stop W/sash: Finger Jointed Pine, .813" high x .875" wide.


### WINDOW CONSTRUCTION:

The Wood Main Frame corners are butted and secured with (3) #8 x 2 1/4" square head zinc plated screws and (2) 1/2" wire staples at each corner joint. The wood brickmold has mitered and butted corners and is attached to the main frame with #6 x 1 1/4" Phillips flathead wood screws at 12" O.C.


**SASH CONSTRUCTION:** The wood sash has butted corners which are secured with (2) #8 x 2 1/4" square head zinc plated screws at each corner joint. The sash is attached to the Wood Main Frame with #8 x 1 1/2" Philips flathead wood screws at a max. of 12" O.C.

**GLAZING: Without Sash:** The .5625" Laminated glass is captured on the interior and the exterior by the .813" x 1.125" wood glass stop. The unit is wet glazed with Dow Corning 995 Structural Silicone.

**GLAZING: With Sash:** The .5625" Laminated glass is captured on the interior and exterior by the .813" x .875" wood glass stop. The unit is wet glazed with Dow Corning 995 Structural Silicone. Both glass stops are secured with #6 x 1 1/4" Philips flathead wood screws at 4.0" from all corners and a maximum of 12" O.C.

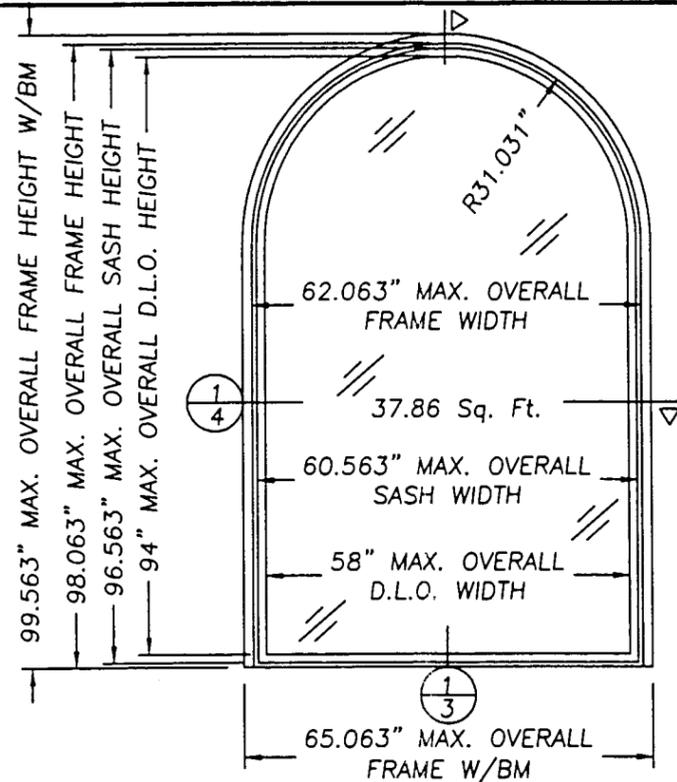


HALF CIRCLE TOP DIRECT SET W/SASH

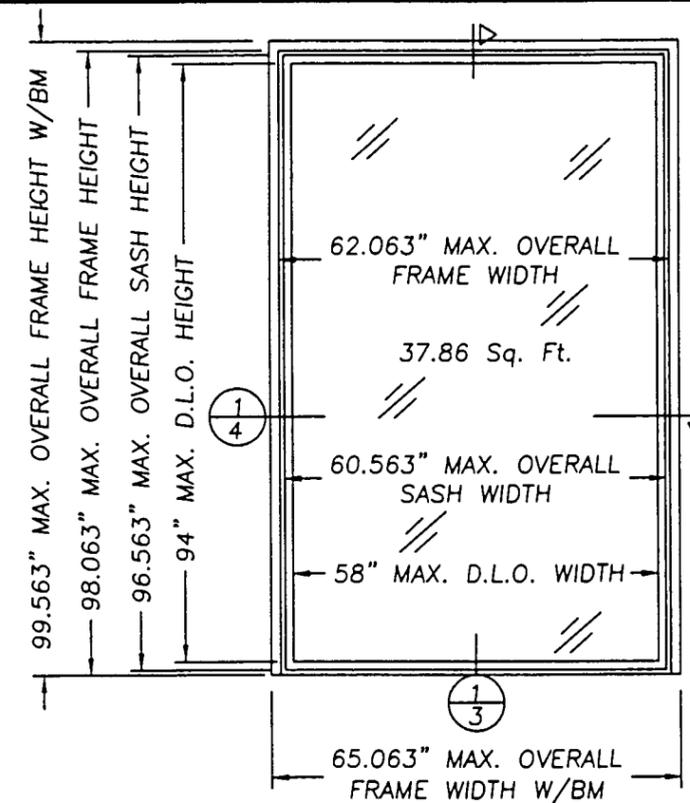


RECTANGLE DIRECT SET W/SASH

ALL WINDOW UNITS ARE VIEWED FROM THE EXTERIOR

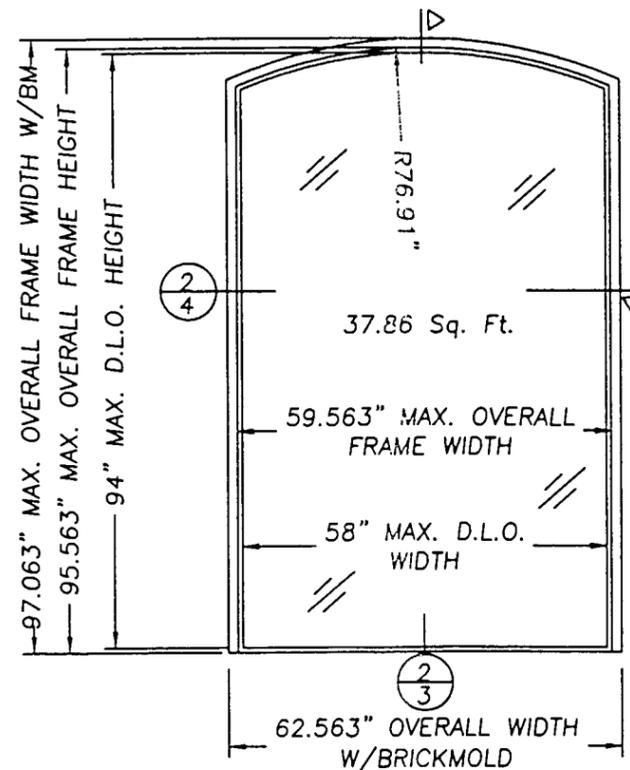

ARCH TOP DIRECT SET WITHOUT SASH

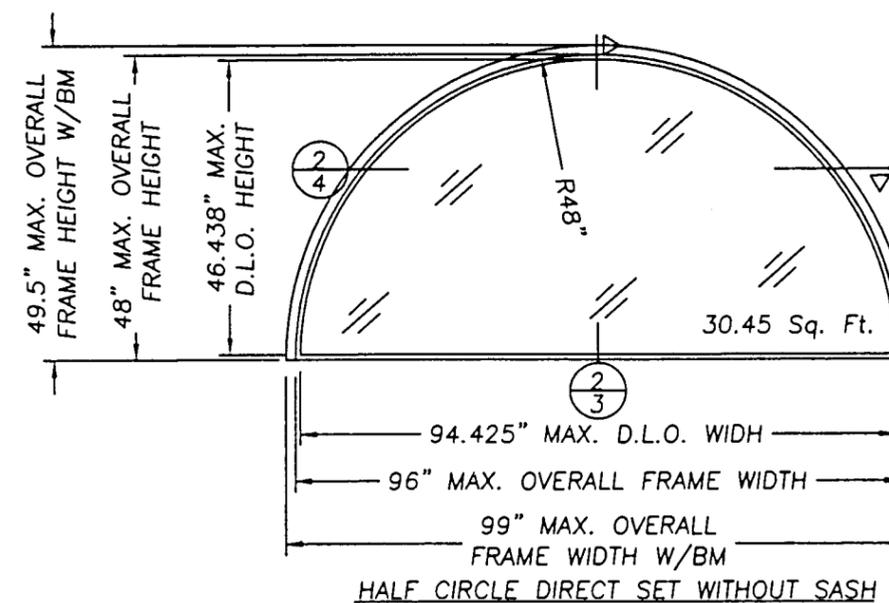


HALF CIRCLE DIRECT SET WITHOUT SASH

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATIONS
2	DESIGN PRESSURE RATING & GLASS SIZE CHART
3	VERTICAL CROSS SECTIONS & GLAZING DETAILS
4	HORIZONTAL CROSS SECTIONS
5	ANCHORING LOCATIONS
6	BILL OF MATERIALS & UNIT COMPONENTS

Approved as complying with the Florida Building Code  
Date April 18, 2007  
NOA# 62-6515.01  
Miami Dade Product Control  
Division  
By: *[Signature]*

**Parrett Windows**  
Quality Crafted Specialty Windows  
PARRETT MFG., INC. 810 2nd Ave. East  
P.O. Box 440, Dorchester, WI 54425  
Phone (715)678-2155 FAX (715)678-2155



PRODUCT: PARRETT WINDOWS, WOOD DIRECT SET/DIRECT SET SASH FIXED FRAME WINDOWS  
PART OR ASSEMBLY:  
GENERAL NOTES & TYPICAL ELEVATIONS


NO.	DATE	GENERAL	ANCHORING DETAIL	TJH	RW	BY
2	3/05/02					
1	2/01/02					

**RW** BUILDING CONSULTANTS, INC.  
813.684.3831

DATE: 11/06/01  
SCALE: N.T.S.  
DWG. BY: TJH  
CHK. BY: RW  
DRAWING NO.: S-2170  
SHEET 1 OF 6

DESIGN PRESSURE RATE & GLASS SIZE CHART				
UNIT D.L.O. SIZE		UNIT Sq. Ft OF GLASS	UNIT DESIGN PRESSURE RATING	
D.L.O. WIDTH	D.L.O. HEIGHT			
58.0"	94.0"	37.86	+46.7	-46.7
57.0"	93.0"	36.81	+48.2	-48.2
56.0"	92.0"	35.78	+49.9	-49.9
55.0"	91.0"	34.76	+51.5	-51.5
54.0"	90.0"	33.75	+53.2	-53.2
53.0"	89.0"	32.76	+54.9	-54.9
52.0"	88.0"	31.78	+56.7	-56.7
51.0"	87.0"	30.81	+58.4	-58.4
50.0"	86.0"	29.86	+60.1	-60.1
49.0"	85.0"	28.92	+61.9	-61.9
48.0"	84.0"	28.00	+64.4	-64.4
47.0"	83.0"	27.09	+67.4	-67.4
46.0"	82.0"	26.19	+70.5	-70.5
45.0"	81.0"	25.31	+73.6	-73.6
44.0"	80.0"	24.44	+76.7	-76.7
43.0"	79.0"	23.59	+80.3	-80.3
42.0"	78.0"	22.75	+84.5	-84.5
41.0"	77.0"	21.92	+88.9	-88.9
40.0"	76.0"	21.11	+93.3	-93.3
39.0"	75.0"	20.31	+97.9	-97.9
38.75"	74.0"	19.91	+98.8	-98.8

**Parrett Windows**  
 Quality Crafted Specialty Windows  
 PARRETT MFG., INC. 810 2nd Ave. East  
 P.O. Box 440, Dorchester, WI 54425  
 Phone (715)678-2125 FAX (715)678-2155




PRODUCT:  
 PARRETT WINDOWS, WOOD  
 DIRECT SET/DIRECT SET  
 SASH FIXED FRAME WINDOWS  
 PART OR ASSEMBLY:  
 DESIGN PRESSURE RATING  
 AND GLASS SIZE CHART

NO.	DATE	REVISIONS		
		ANCHORING DETAIL	GENERAL	BY
2	3/05/02			TJH
1	2/01/02			RW


**RW** BUILDING  
 CONSULTANTS, INC.  
 813.684.3831

Approved as complying with the  
 Florida Building Code  
 Date April 18 2002  
 NOA# 02-0515-01  
 Miami Dade Product Control  
 Division  
 By [Signature]


DATE: 11/06/01  
 SCALE: N.T.S.  
 DWG. BY: TJH  
 CHK. BY: RW  
 DRAWING NO.: S-2170  
 SHEET 2 OF 6

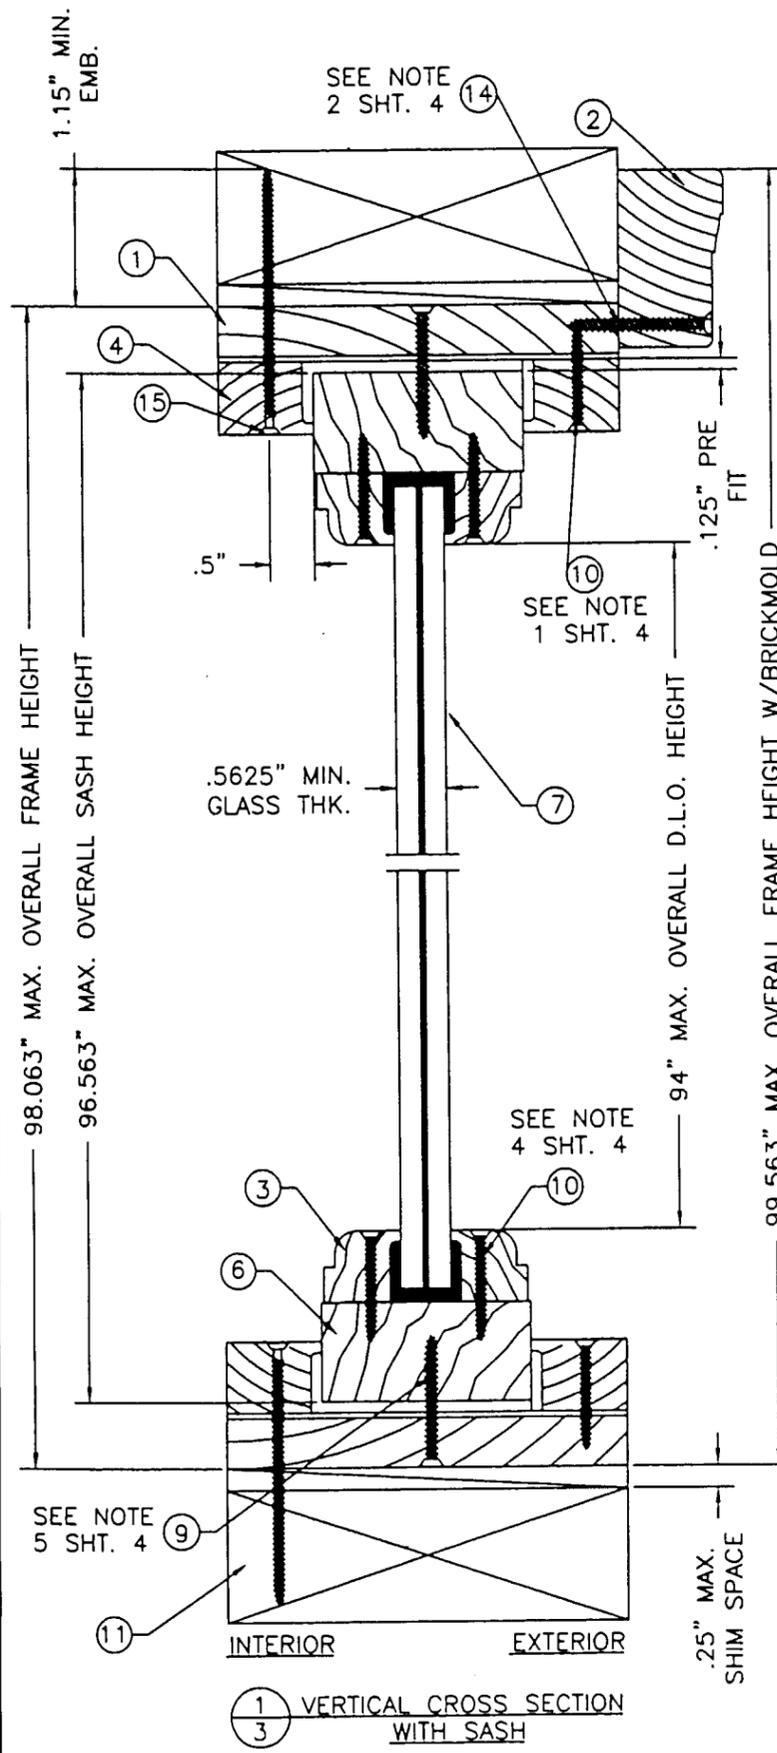


1 VERTICAL CROSS SECTION WITH SASH  
 3 VERTICAL CROSS SECTION WITHOUT SASH

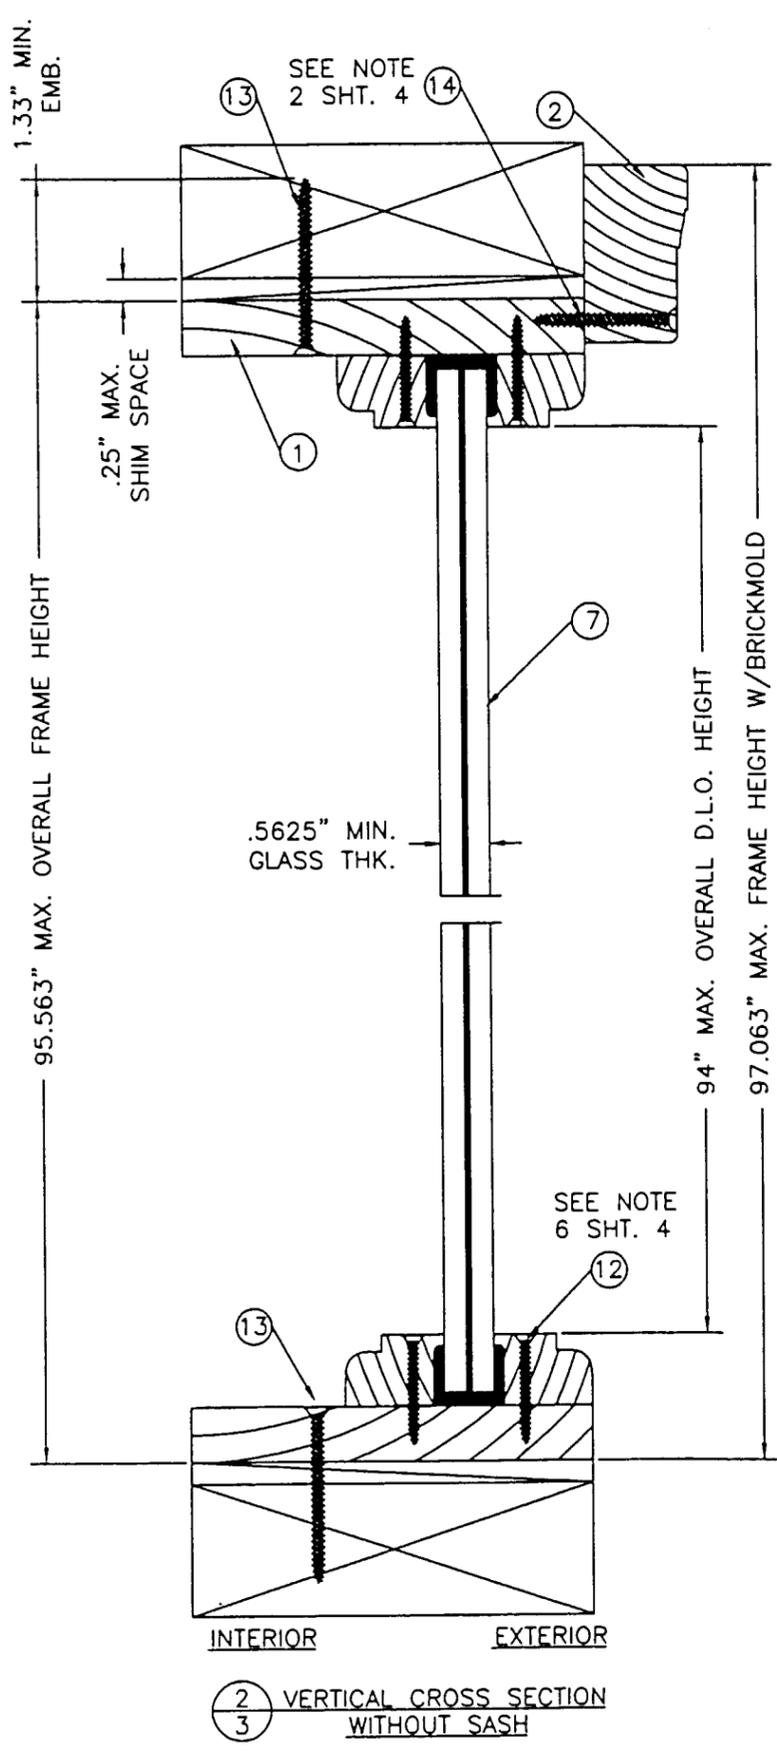

2 VERTICAL CROSS SECTION WITHOUT SASH  
 3 VERTICAL CROSS SECTION WITHOUT SASH

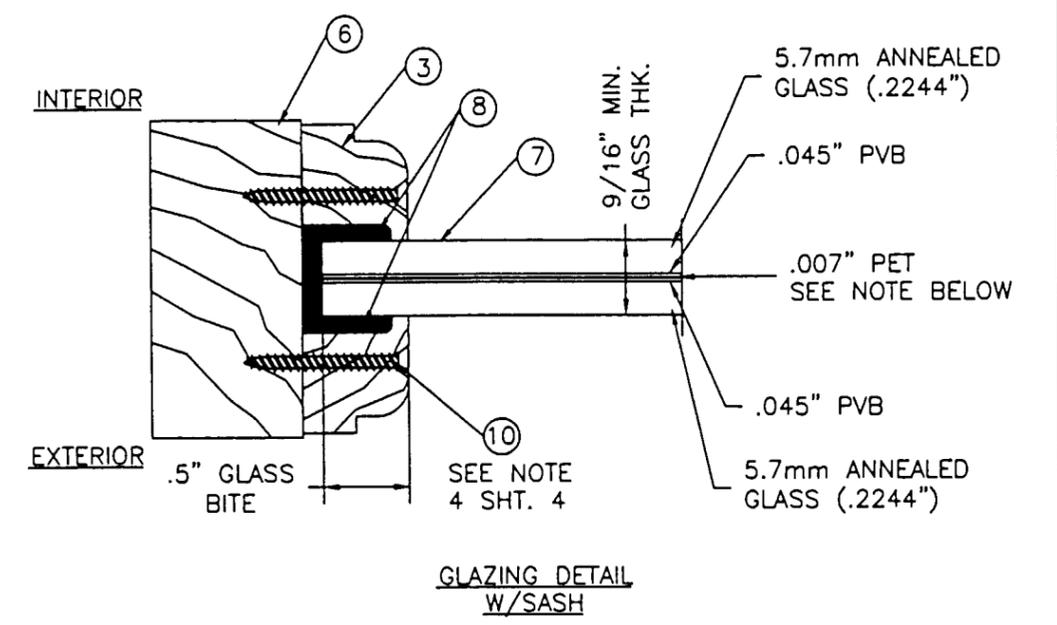

GLAZING DETAIL W/SASH

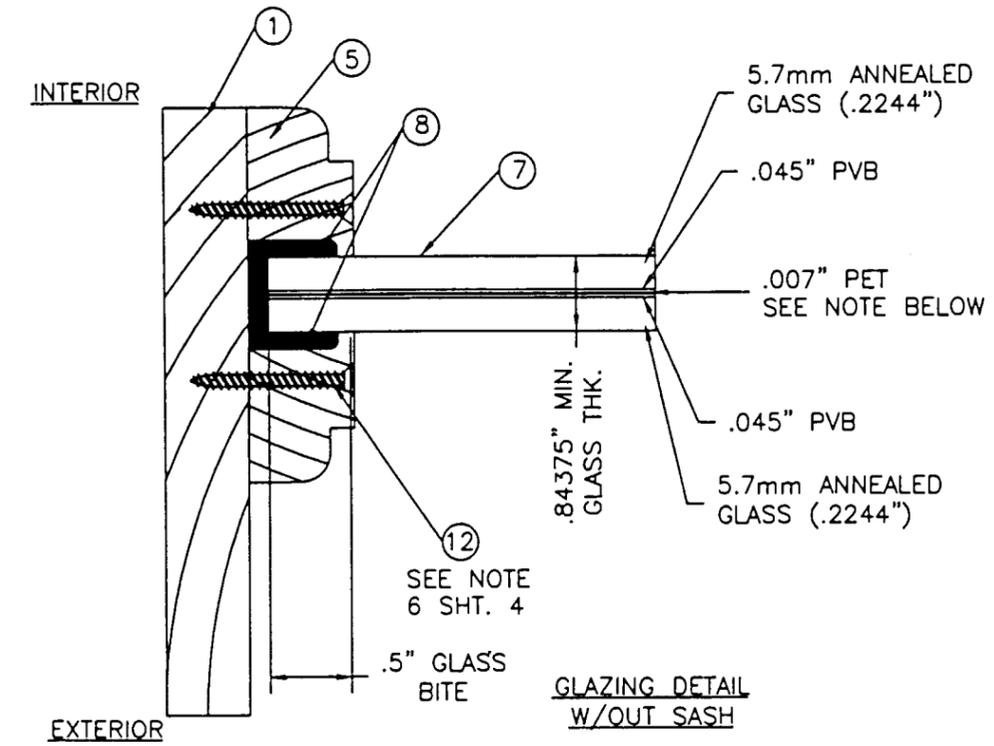

GLAZING DETAIL W/OUT SASH

NOTE:  
 THE .007" PET TAIL IS 1.0" LONG AND IS MECHANICALLY FASTENED TO THE SASH OR FRAME BY THE GLAZING STOP.

Approved as complying with the Florida Building Code  
 Date April 18, 2002  
 NOA# 02-0515-01  
 Miami Dade Product Control Division  
 By [Signature]

**Parrett Windows**  
 Quality Crafted Specialty Windows  
 PARRETT MFG., INC. 810 2nd Ave. East  
 P.O. Box 440, Dorchester, WI 54425  
 Phone (715) 978-2125 FAX (715) 978-2155


PRODUCT: PARRETT WINDOWS, WOOD DIRECT SET/DIRECT SET SASH FIXED FRAME WINDOWS PART OR ASSEMBLY: VERTICAL CROSS SECTIONS & GLAZING DETAILS

NO.	DATE	REVISIONS
2	3/05/02	ANCHORING DETAIL
1	2/01/02	GENERAL


TJH RW BY

**RW BUILDING CONSULTANTS, INC.**  
 813.684.3831

DATE: 11/06/01  
 SCALE: 1/2" = 1"  
 DWG. BY: TJH  
 CHK. BY: RW  
 DRAWING NO.: S-2170  
 SHEET 3 OF 6

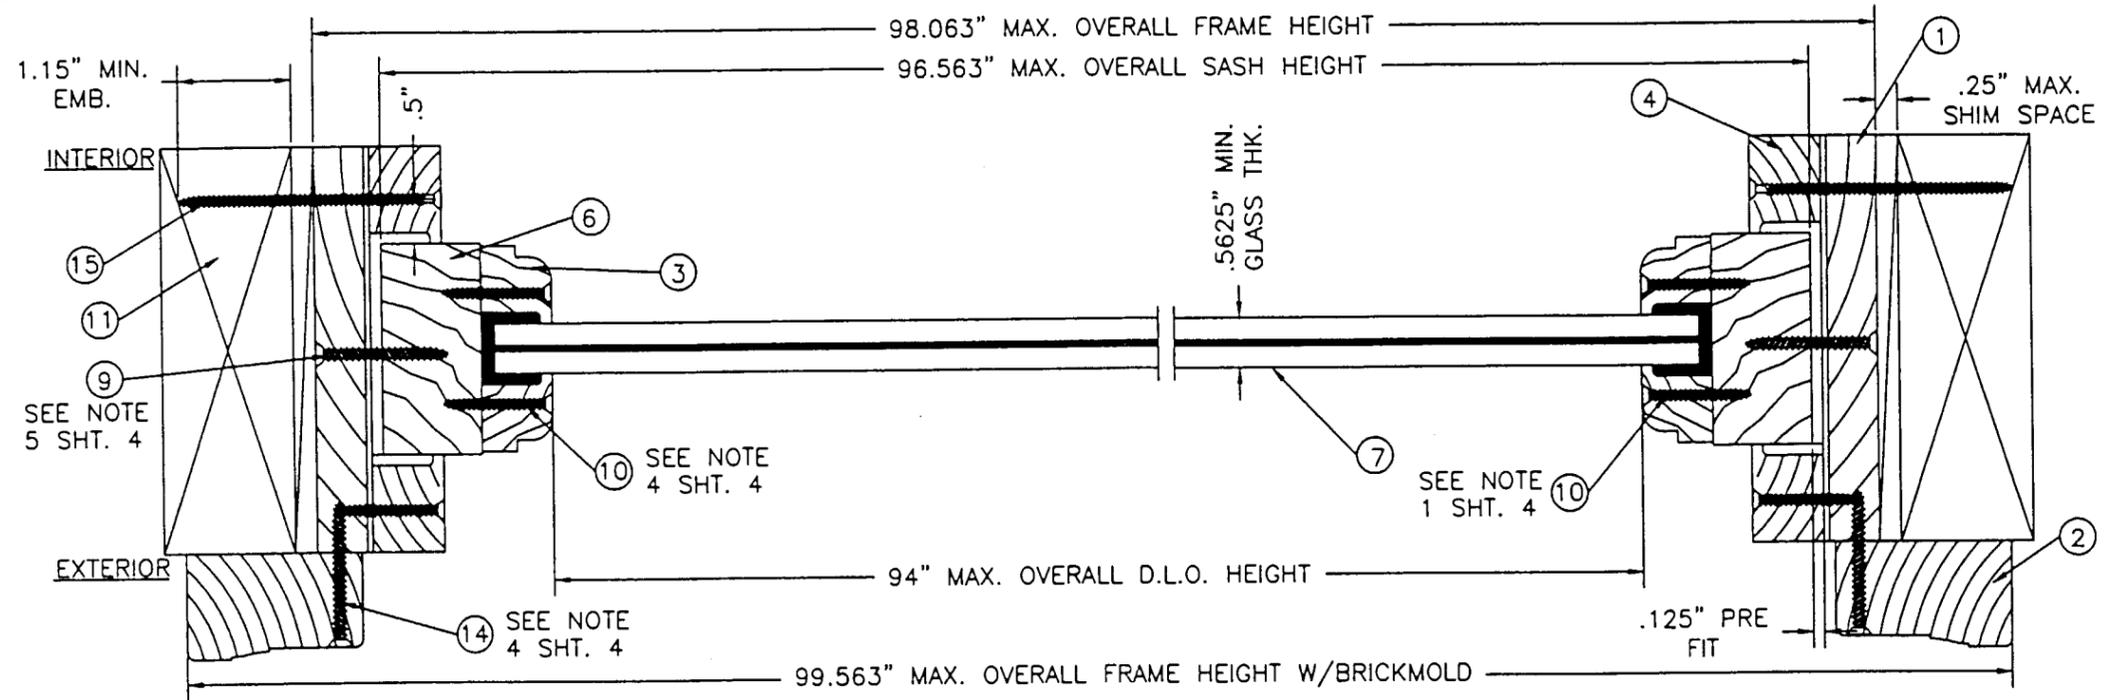

1  
4 HORIZONTAL CROSS SECTION WITH SASH

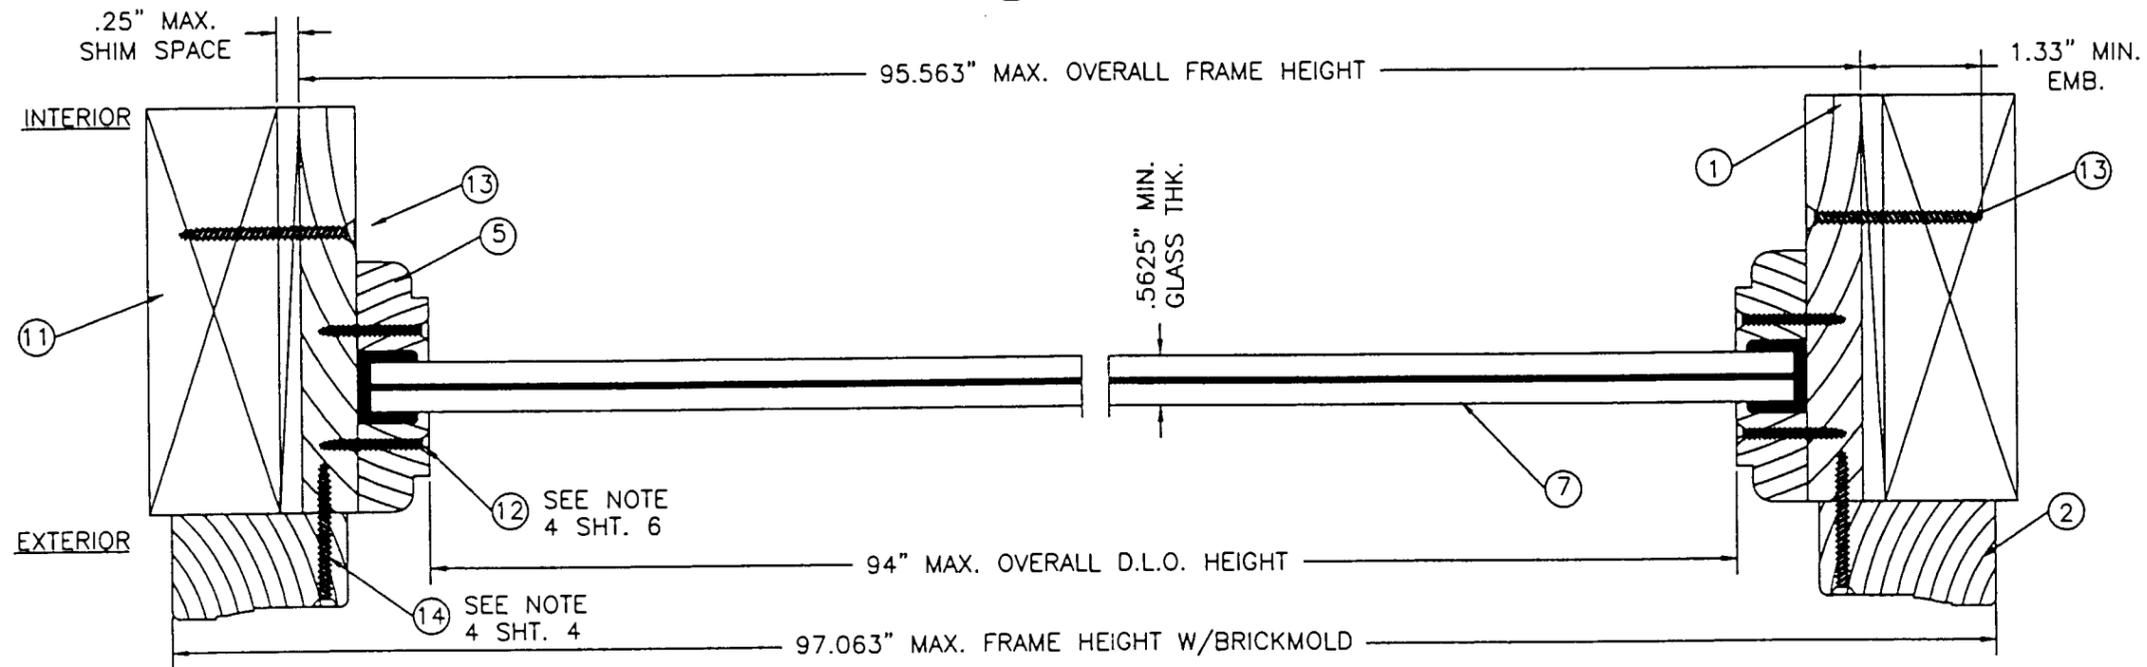


2  
4 HORIZONTAL CROSS SECTION WITH SASH

NOTES:

1. SPACING FOR ITEM #10 ATTACHING THE SASH STOP TO THE FRAME IS AS FOLLOWS; 4.0" IN FROM ALL CORNERS AND A MAX. OF 12.0" O.C.
2. SPACING FOR ITEM #14 ATTACHING THE BRICKMOLD TO THE FRAME IS AS FOLLOWS; A MAX. OF 12" O.C.
3. NOT USED.
4. SPACING FOR ITEM #10 ATTACHING THE GLAZING STOP TO THE SASH IS AS FOLLOWS; 4.0" FROM ALL CORNERS AND A MAX. OF 12.0" O.C.
5. SPACING FOR ITEM #9 ATTACHING THE SASH TO THE WOOD FRAME IS AS FOLLOWS; A MAX. OF 12" O.C.
6. SPACING FOR ITEM #12 ATTACHING THE GLAZING STOP TO THE WOOD FRAME IS AS FOLLOWS; A MAX. OF 12" O.C.

Approved as complying with the Florida Building Code  
 Date April 13, 2002  
 NOA# 02-0515.01  
 Miami Dade Product Control Division  
 By *[Signature]*

**Parrett Windows**  
 Quality Crafted Specialty Windows  
 PARRETT MFG., INC. 810 2nd Ave. East  
 P.O. Box 440, Dorchester, WI 54425  
 Phone (715)678-2125 FAX (715)678-2155




PRODUCT: PARRETT WINDOWS, WOOD DIRECT SET/DIRECT SET SASH FIXED FRAME WINDOWS  
 PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS


NO.	DATE	REVISIONS
2	3/05/02	ANCHORING DETAIL
1	2/01/02	GENERAL
		TJH
		RW
		BY

**RW** BUILDING CONSULTANTS, INC.  
 813.684.3831


DATE: 11/06/01  
 SCALE: 1/2" = 1"  
 DWG. BY: TJH  
 CHK. BY: RW  
 DRAWING NO.: S-2170  
 SHEET 4 OF 6

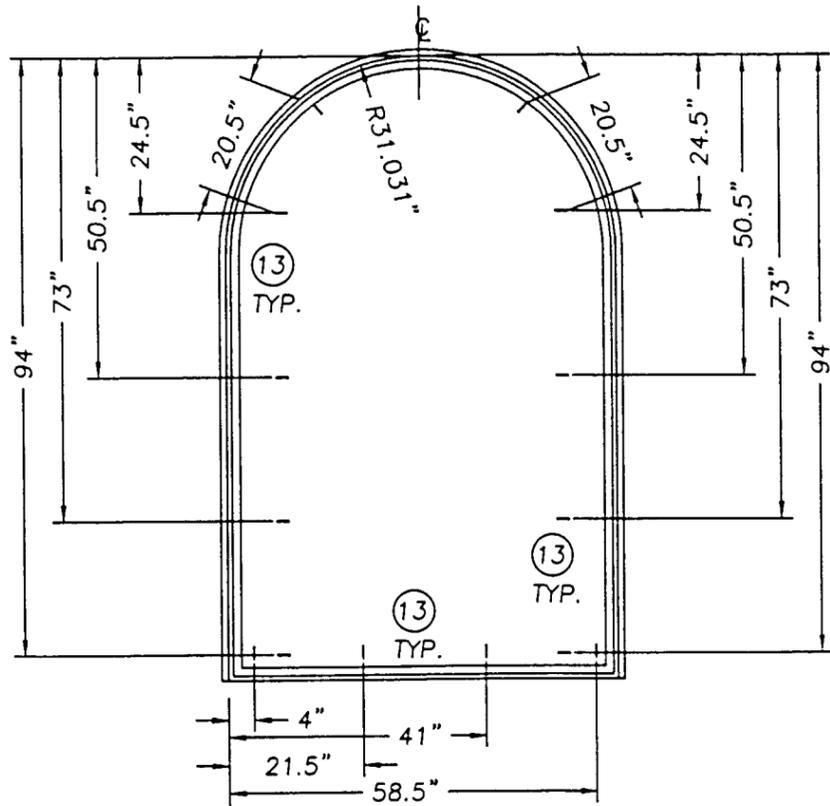


HALF CIRCLE TOP DIRECT SET W/SASH

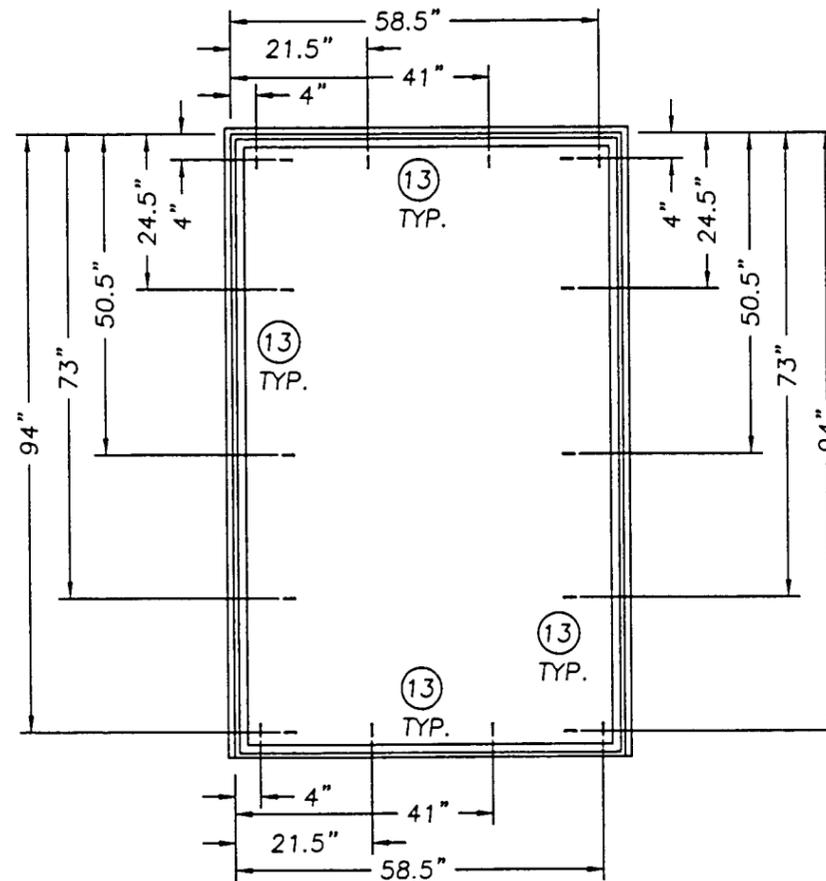

RECTANGLE DIRECT SET W/SASH

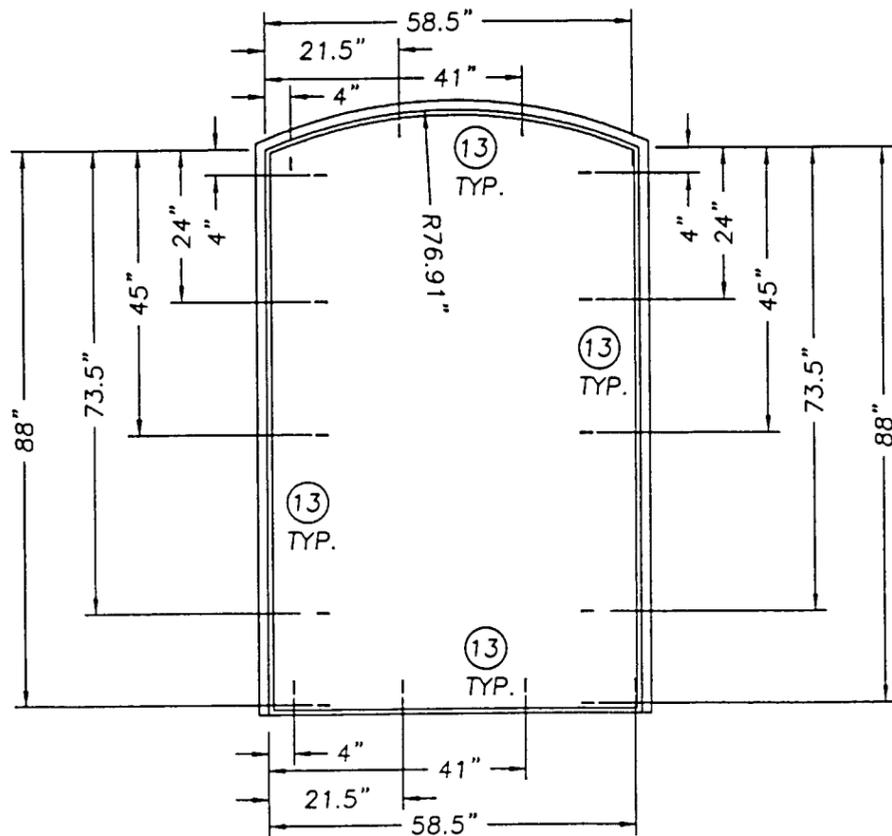


ARCH TOP DIRECT SET WITHOUT SASH

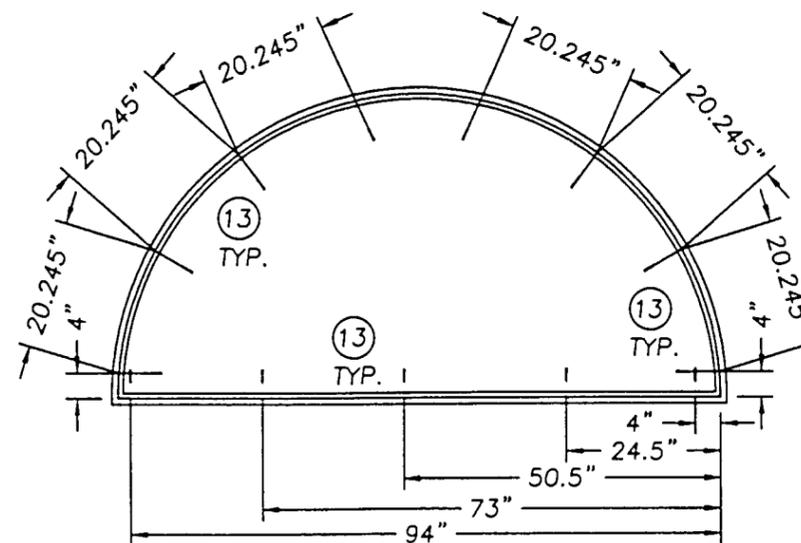

HALF CIRCLE DIRECT SET WITHOUT SASH

Approved as complying with the  
 Florida Building Code  
 Date April 18, 2002  
 NOA# 02-0515-01  
 Miami Dade Product Control  
 Division  
 By *[Signature]*

**Parrett Windows**  
 Quality Crafted Specialty Windows  
 PARRETT MFG., INC. 810 2nd Ave. East  
 P.O. Box 440, Dorchester, WI 54425  
 Phone (715)678-2125 FAX (715)678-2155




PRODUCT: PARRETT WINDOWS, WOOD  
 DIRECT SET/DIRECT SET  
 SASH FIXED FRAME WINDOWS  
 PART OR ASSEMBLY:  
 ANCHORING LOCATIONS

ANCHORING DETAIL		REVISIONS	
NO.	DATE	TJH	BY
2	3/05/02	TJH	
1	2/01/02	RW	


**RW** BUILDING  
 CONSULTANTS, INC.  
 813.684.3831

DATE: 11/06/01  
 SCALE: N.T.S.  
 DWG. BY: TJH  
 CHK. BY: RW  
 DRAWING NO.: S-2170  
 SHEET 5 of 6


ITEM	DESCRIPTION	MATERIAL
1	MAIN FRAME, F. J. PONDEROSA PINE (PARRETT WINDOWS)	PINE
2	BRICKMOLD F. J. PONDEROSA PINE	WOOD
3	GLAZING STOP (UNIT W/SASH) F. J. PONDEROSA PINE (PARRETT WINDOWS)	PINE
4	SASH STOP F. J. PONDEROSA PINE (PARRETT WINDOWS)	PINE
5	GLAZING STOP (UNIT W/OUT SASH) F. J. PONDEROSA PINE (PARRETT WINDOWS)	PINE
6	WOOD SASH F. J. PONDEROSA PINE (PARRETT WINDOWS)	PINE
7	GLAZING .5625" MIN. LAMINATED ANNEALED GLASS BY CARDINAL GLASS (SEA-STORM TYPE B)	-
8	GLAZING COMPOUND DOW 995 STRUCTURAL SILICONE	SILICONE
9	#8 x 1 1/2" PFH WOOD SCREW (S & G FASTENERS)	STEEL
10	#6 x 1 1/4" PFH WOOD SCREW (S & G FASTENERS)	STEEL
11	2X WOOD BUCK	WOOD
12	#8 x 1 1/4" PFH WOOD SCREW (S & G FASTENERS)	STEEL
13	#10 x 2" PFH WOOD SCREW (S & G FASTENERS)	STEEL
14	#8 x 1 5/8" SQUARE HEAD WOOD SCREW (S & G FASTENERS)	STEEL
15	#8 x 3" PFH WOOD SCREW (S & G FASTENERS)	STEEL

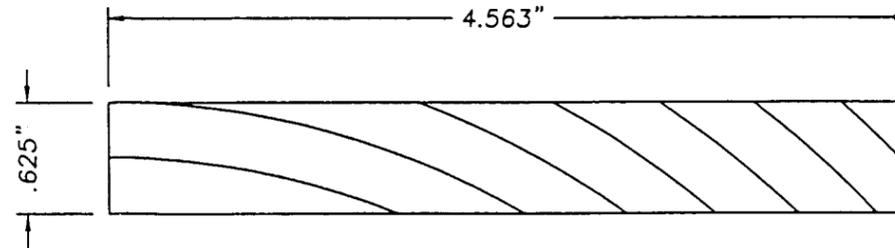


① MAIN FRAME, F. J. PONDEROSA PINE

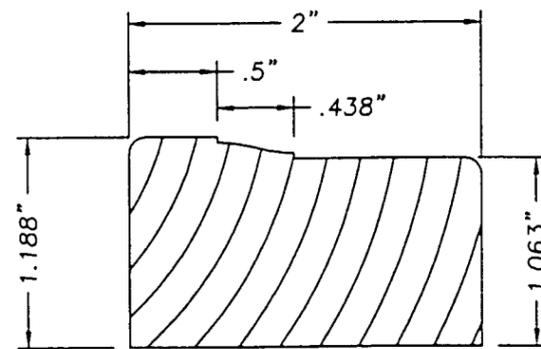


BRICKMOLD  
F. J. PONDEROSA PINE ②

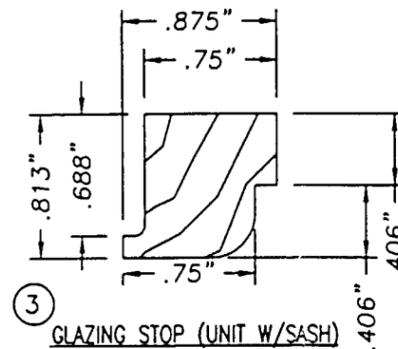


③ GLAZING STOP (UNIT W/SASH)  
F. J. PONDEROSA PINE  
PARRETT WINDOWS

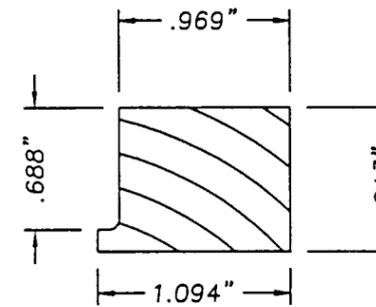

SASH STOP  
F. J. PONDEROSA PINE  
PARRETT WINDOWS ④

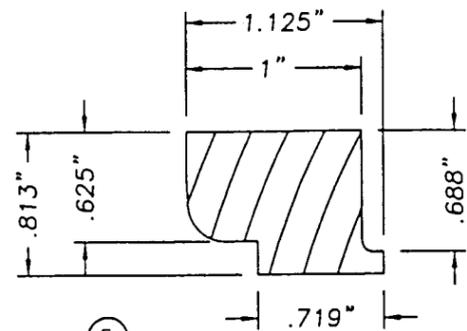


⑤ GLAZING STOP (UNIT W/OUT SASH)  
F. J. PONDEROSA PINE  
PARRETT WINDOWS

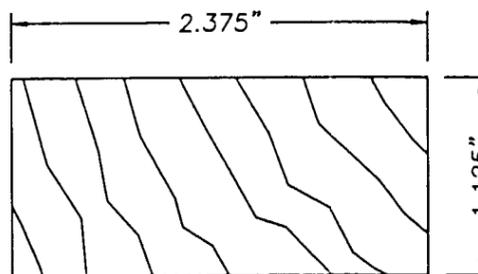

⑥ WOOD SASH  
F. J. PONDEROSA PINE  
PARRETT WINDOWS

Approved as complying with the  
Florida Building Code  
Date April 18, 2002  
NOA# 02-0515101  
Miami Dade Product Control  
Division  
By [Signature]

**Parrett Windows**  
Quality Crafted Specialty Windows  
PARRETT MFG., INC. 810 2nd Ave. East  
P.O. Box 440, Dorchester, WI 54425  
Phone (715)678-2125 FAX (715)678-2155



PRODUCT:  
PARRETT WINDOWS, WOOD  
DIRECT SET/DIRECT SET  
SASH FIXED FRAME WINDOWS  
PART OR ASSEMBLY:  
BILL OF MATERIALS  
& UNIT COMPONENTS

NO.	DATE	GENERAL	TJH	RW	BY	REVISIONS
2	3/05/02	ANCHORING DETAIL	TJH			
1	2/01/02	GENERAL	RW			

**RW** BUILDING  
CONSULTANTS, INC.  
813.684.3831

DATE: 11/06/01  
SCALE: N.T.S.  
DWG. BY: TJH  
CHK. BY: RW  
DRAWING NO.:  
S-2170  
SHEET 6 OF 6