



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**All American Supply Company
12920 SW 120 Street
Miami, FL 33186**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series 2130 Outswinging Raised Wood Panel Door

APPROVAL DOCUMENT: Drawing No. 99001, titled "FBMA Series 2130 Wood Door", sheets 1 through 3, prepared by manufacturer, dated 12/6/99, bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA # 99-0505.02** and, consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by **Raul Rodriguez**.





**NOA No 02-0528.01
Expiration Date: July 1, 2007
Approval Date: June 11, 2002
Page 1**


DOOR AND FRAME SYSTEM			
ITEM #	DESCRIPTION	STILE AND RAIL CONSTRUCTION	
1	DOOR MODEL 2130-MANUFACTURER(S)	WOOD ROGUE VALLEY OR SIMPSON	
2	JR300 T-ASTRAGAL WITH (2) 1/8" SCHED 40x 8 1/4" LONG STL PIPE SLEEVES BORED TO CLEAR #3. WITH GLUE, 7/16" X 2" STAPLES 15" OC, & (10) #8 X 2" FHWS (4 EA SIDE OF SLEEVE). WEATHERSTRIP - SCHLEGEL #QDS-650		
3	12" EXTENSION CONCEALED FLUSH BOLTS - QUALITY MFG #1358 - 1/2" Ø X 1-1/2" LONG STEEL W/ 3/4" THROW. .077" THICK BRASS STRIKE AT FRAME HEADER ABOVE INACTIVE DOOR AT UPPER CONCEALED FLUSH BOLT. THERE ARE NO STRIKES AT THE BOTTOM OF DOORS. THE LOCKS ENGAGE HOLES DRILLED INTO THE ALUMINUM THRESHOLD.		
4	SINGLE SURFACE DEAD BOLTS - MFR & MODEL #.	KWIKSET #666 OR SCHLAGE #B180N	
	WITH A MODIFIED M.A.G. ENG. LOCK REINFORCER #20-PB AND STRIKE ASSEMBLY CONSISTING OF 0.082" THICK BRASS SURFACE STRIKE WITH A CONCEALED 0.120" THICK PLATED STEEL REINFORCEMENT PLATE		
5	PASSAGE LOCK - MFR & MODEL #.	KWIKSET #200E OR SCHLAGE #F10N	
	CENTER 36" FROM BOTTOM OF DOOR. 0.050" THICK BRASS STRIKE		
6	SINGLE CYLINDER DEAD BOLT - MFR & MODEL #.	KWIKSET #660 OR SCHLAGE #B160N	
	(CENTER 6" - 12" ABOVE PASSAGE LOCK).		
7	4" X 4" BUTT HINGE WITH SAFETY STUD - HAGER #1843 OR PENROD #MH40AJAC (MIXED). CENTER 8-3/4" AND 84" FROM TOP OF DOOR. SCREWS - TO DOOR: (4) #9 X 3/4" FHWS. TO JAMB: (3) #9 X 3/4" FHWS & (1) #9 X 2-1/2" FHWS.		
8	4" X 4" BUTT HINGE - HAGER #1841 OR PENROD #MH40AUWS. CENTER 31-3/4" AND 56" FROM TOP OF DOOR. SCREWS - TO DOOR: (4) #9 X 3/4" FHWS. TO JAMB: (3) #9 X 3/4" FHWS & (1) #9 X 2-1/2" FHWS.		
9	THRESHOLD-MODEL #JR100 (DEPTH X NOSE HEIGHT) WITHRSTRIP-SCHLEGEL MODEL #	2-1/2" X 1-1/8" #QDS-650 OR 2-1/2" X 7/8" #QDS-650 OR 3" X 1-1/8" #QEB-928	
10	FRAME - 1-1/4" X (WOOD)	4-9/16" OR 5-1/4"	
	RABBETTED AND KERFED FOR WEATHERSTRIP. EACH CORNER WAS CAULKED AND ATTACHED WITH (3) 3/4" X 2" GUN DRIVEN STAPLES. WEATHERSTRIP - SCHLEGEL #QDS-650.		
11	HEAD PLATE TO MATCH FRAME - WITH 3/8" PLYWOOD ATTACHED WITH GLUE & 3/4" STAPLES 1" TO 1-1/4" FROM EACH EDGE & 8-3/4" (AVG) O.C. AND (3) STAPLES PER JAMB.		
	WEATHERSTRIP - SCHLEGEL MODEL #	#QDS-650 OR QEB-928	
12	2" X 3" X 0.007" VINYL FLAP GLUED TO BOTTOM OF ASTRAGAL.		
13	FRAME SCREWS TO 2X WOOD BUCK - #10 X 2-1/2" FHWS. 8" FROM CORNERS & 24" OC (MAX). FRAME JAMBS AND @ HEAD 6" FROM CORNERS AND 20" O.C. MAX.		
13a.	FRAME SCREWS TO MASONRY - 3/16" FH TAPCONS W/ 1-1/4" MIN. EMBEDMENT INTO MASONRY. SPACING IS SAME AS ABOVE.		
14	PENKO #S88 SELF ADHESIVE WEATHERSTRIP AT OUTSIDE EDGE AT TOP OF BOTH DOORS.		
	PENKO #S88 AT OUTSIDE EDGE AT LOCK STILE OF ACTIVE DOOR.		
15	PENKO #345AV RAIN DRIP & SWEEP ATTACHED W/ #6 X 5/8" RHMS @ 6" O.C.		
16	PAD/DIVERTER AT BOTTOM OF EACH JAMB.	1" X 2" X 3/16" SELF ADHESIVE PILE PAD.	
	PAD/DIVERTER AT BOTTOM OF ASTRAGAL.		

NOTE: COMPONENTS ABOVE CAN BE SUBSTITUTED BY APPROVED EQUAL WITH A MIAMI-DADE COUNTY NOTICE OF ACCEPTANCE.

ITEM #9
J-R #100 THRESHOLD
WOOD & ALUM W/ QDS WEATHERSTRIP

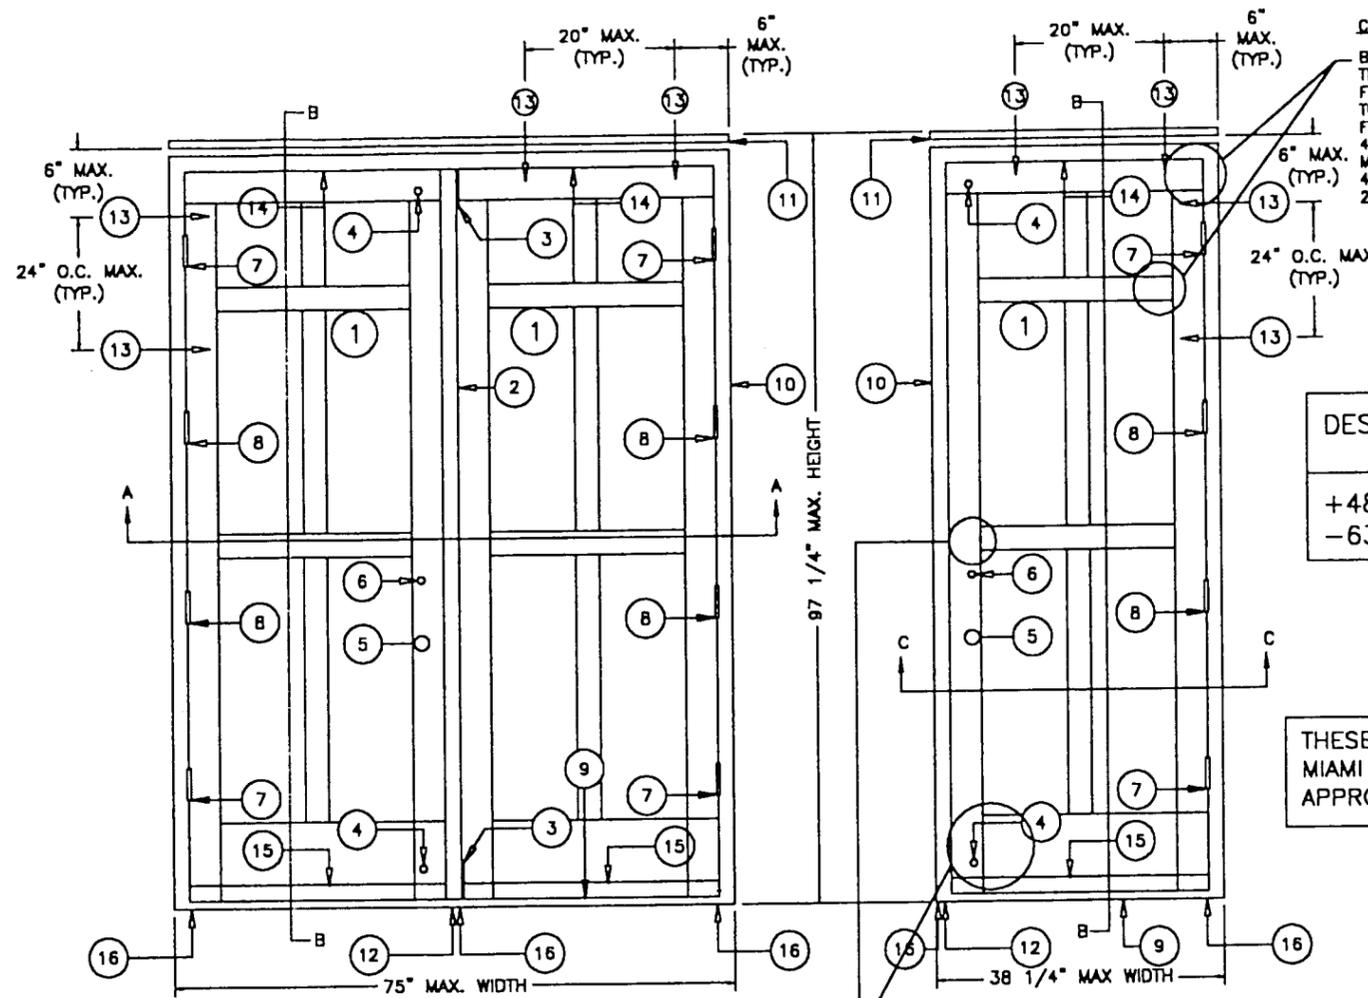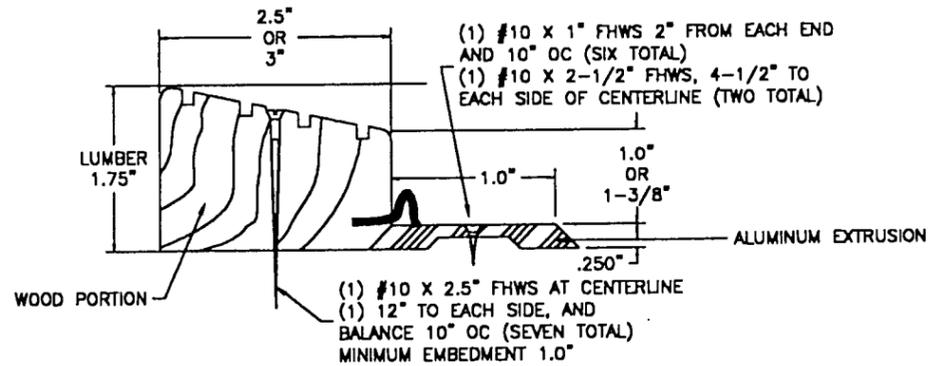

ITEM #2
J-R #300 ASTRAGAL W/ SLEEVES
& KERFED FOR WEATHERSTRIP

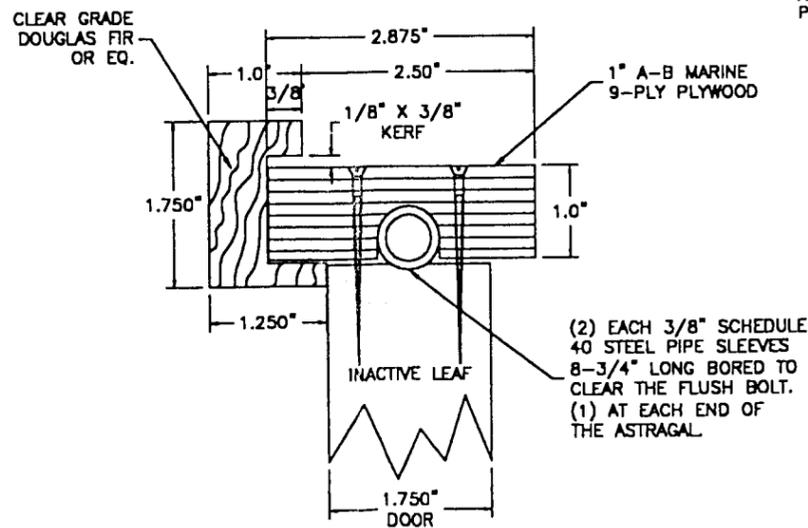

CORNER CONSTRUCTION
BUTTED AND THE ENDS AND THE ENDS OF ALL INTERMEDIATE FRAME MEMBERS ARE COPE TO TIGHTLY FIT THE INTERSECTING FRAMING AND ATTACHED AT 4-1/2" RAILS TO STILES WITH MIN. TWO (2) 5/8" X 4-5/8" LONG WOOD DOWELS, 2-3/4" PENETRATION INTO RAIL.

DESIGN PRESSURE RATING
+48.3 PSF
-63.4 PSF


THESE DOORS REQUIRE MIAMI DADE COUNTY APPROVED SHUTTERS.

CORNER CONSTRUCTION
BUTTED AND THE ENDS OF ALL INTERMEDIATE FRAME MEMBERS ARE COPE TO TIGHTLY FIT THE INTERSECTING FRAMING AND ATTACHED AT 7-1/2" AND 9-1/8" RAILS TO STILE WITH A MINIMUM THREE (3) 5/8" X 4-5/8" LONG WOOD DOWELS, 2-3/4" PENETRATION INTO RAIL.


SEALANT
THE FRAME INTERSECTION, ENDS OF THE THRESHOLD, AND ALL WEATHER-STRIP INTERSECTIONS MUST BE CAULKED WITH POLYSEAMSEAL OR DAP ADHESIVE SEALANT DURING ASSEMBLY.

PRODUCT RENEWED
as complying with the Florida Building Code
Acceptance No. 02-0528.01
Expiration Date July 1, 2007
By *[Signature]*
Miami Dade Product Control Division


Drawn by: E.D. & D.
Date: 12/6/99
Revisions:
Drawing #99001
Drawing Title:
FBMA SERIES 2130
WOOD DOOR
Page 1 of 3

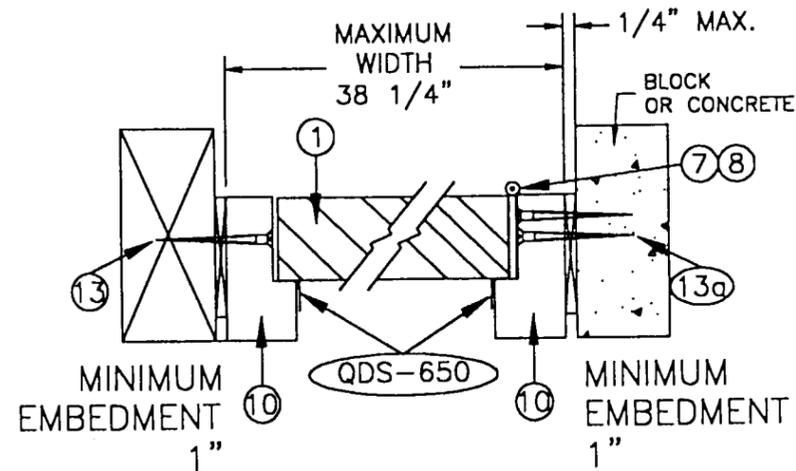



SECTION C-C

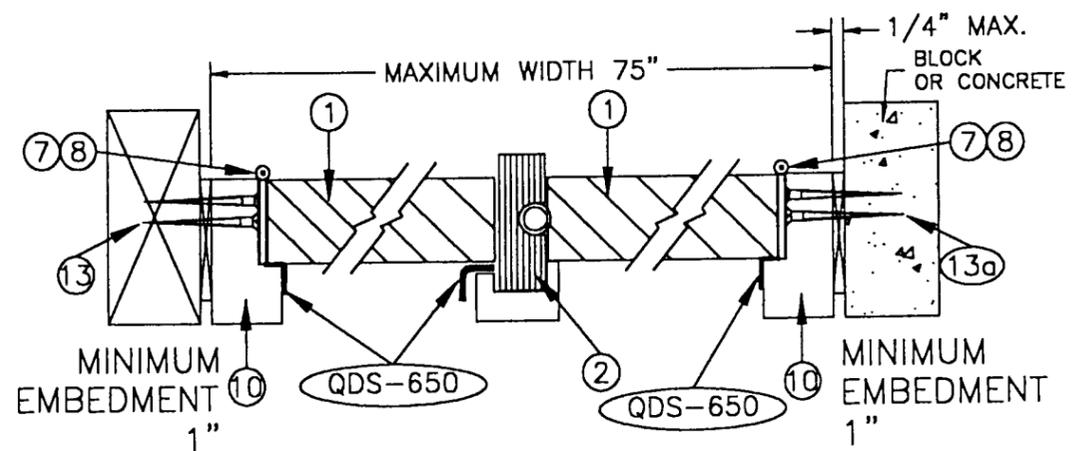

SECTION A-A

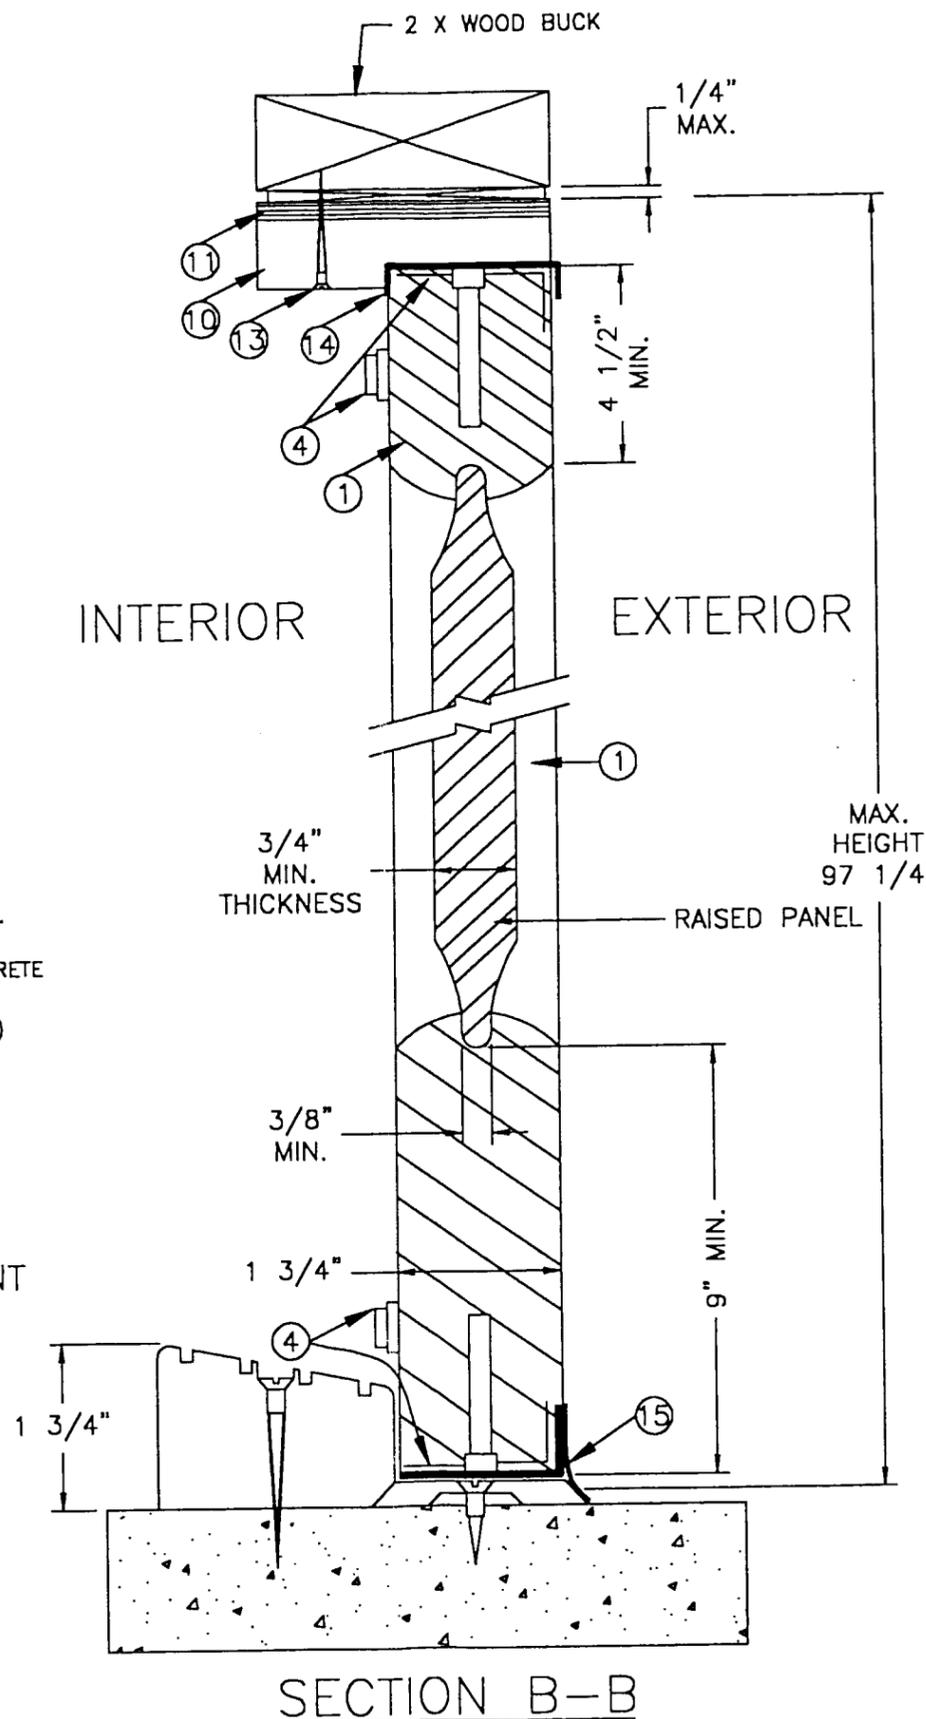

SECTION B-B

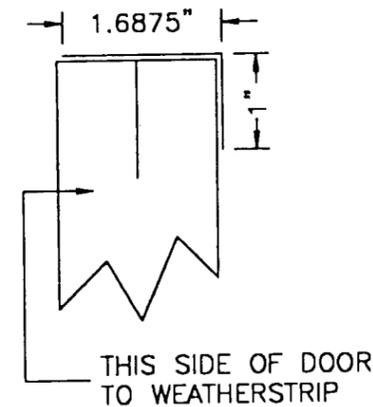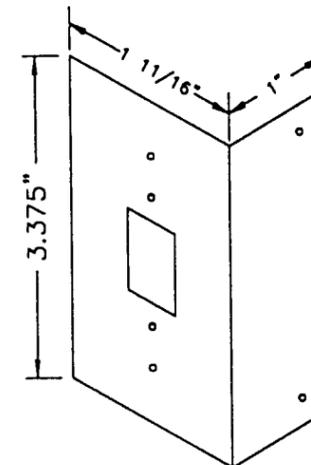

ITEM #4

LOCK REINFORCER BY M.A.G. ENG. MODIFIED

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 02-0528.01
Expiration Date July 1, 2007
By
Miami Dade Product Control
Division

Drawn by: E.D. & D.

Date: 12/6/99

Revisions:

Drawing #99001

Drawing Title:

FBMA SERIES 2130
WOOD DOOR


Page 2 of 3

1 3/4 FRONT ENTRANCE DOORS (EXTERIOR) — MODEL 2130


MAXIMUM PANEL WIDTH 36"

Minimum Dimensions


Stiles & top rail..... 4-1/2"
 Lock rail..... 7-1/2"
 Intermediate rail & mullion..... 2-1/8"
 Bottom rail..... 9"
 Panels Raised..... 3/4" thick

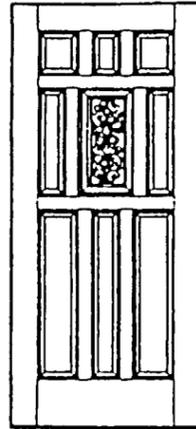


FLORENTINE 4101




TANGIER 4104




AZTEC 4105




BRITANNIA 4108




MARINER 4109




2060




2010




2130

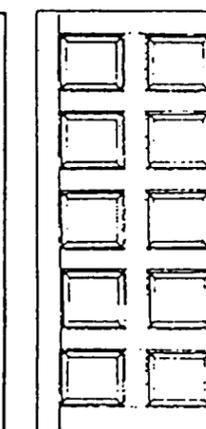


2011




2009

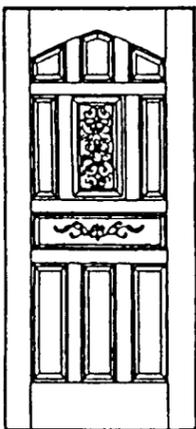


FLORENTINE 4401




TANGIER 4404




AZTEC 4405




BRITANNIA 4408




MARINER 4409




Duadrille 4060




Grandee 4115




Colonial VI 3130

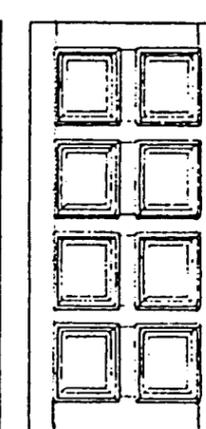


Colonial VIII 3010




Madrid 4112

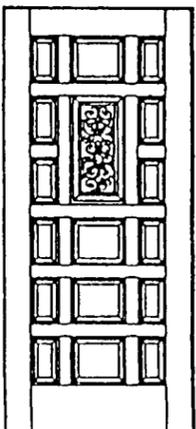


FLORENTINE 4201




TANGIER 4204




AZTEC 4205




BRITANNIA 4208



MARINER 4209




Colonial IV 3044
6'-8" ONLY



Chateau 4180
6'-8" ONLY

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 02-0528-01
 Expiration Date July 1, 2007

By 
 Miami Dade Product Control
 Division

Drawn by: E.D. & D.

Date: 12/6/99

Revisions:

Drawing #99001

Drawing Title:

FBMA SERIES
 2130 WOOD DOOR

Page 3 of 3