MIAMI-DADE

BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

Georgia Pacific Corporation.
4300 Wildwood Pkwy, Suite 300
Atlanta GA 30339

SCOPE:
This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Vinyl Siding & Soffit

APPROVAL DOCUMENT: Drawing No. 1150001, 2. 3, 4 & 5, titled "Vinyl Siding Soffit", sheets 1 through 5, prepared, by Georgia Pacific Corporation, dated 01/1999,with no revisions, signed and sealed R. Boyette, PE, bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.
This NOA **renews NOA # 99-0825.04** and, consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by **Candido Font, PE.**

PRODUCT CONTROL ACCEPTED

Georgia Pacific Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED
(For File ONLY. Not part of NOA)

A. DRAWINGS
See NOA 99-0825.04

1. Drawing prepared by Georgia Pacific Corporation titled "Vinyl Siding Soffit", drawing No.1150001, 2, 3, 4 & 5, dated 01/1999, with no revisions, signed and sealed by R. Boyette, PE.

B. TESTS
See NOA 99-0825.04

	Laboratory Report	Test	Date	Signature
1.	ATI-17925	PA 202 & 203	09/12/96	A.N. Reeves, PE
2.	ATI 17929	PA 202 & 203	09/12/96	A.N. Reeves, PE
3.	ATI 17926	PA 202 & 203	09/12/96	A.N. Reeves, PE
4.	ATI 17931	PA 202 & 203	09/12/96	A.N. Reeves, PE
5.	ATI 17930	PA 202 & 203	09/12/96	A.N. Reeves, PE
6.	ATI 17927	PA 202 & 203	09/12/96	A.N. Reeves, PE
7.	RADCO-C4009	ASTM D3679	May/99	R. F. Tucker, PE

C. CALCULATIONS
N/A

D. MATERIAL CERTIFICATIONS
N/A

F. OTHER
See NOA 99-0825.0 4

1. Code Compliance letter issued by R. Boyette, dated 10/23/98, signed and sealed by R. Boyette, PE.
2. Private Labeler Agreement prepared by Variform, Inc. and Georgia Pacific Corp. notarized by J. S. Rardon on 11/16/98
3. Notice of Acceptance No. 02-0610.02 issued to Variform, Inc. approved on 11/07/02 and expiring on 10/31/07.

Candido F. Font, PE
Product Control Division
NOA No 02-0610. 01
Expiration Date: October 31, 2007
Approval Date: November 7, 2002

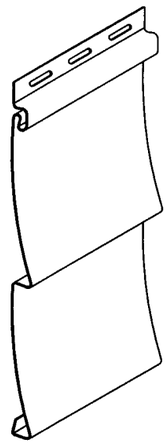

D/4
TRADITIONAL LAP

APPROVED MODELS

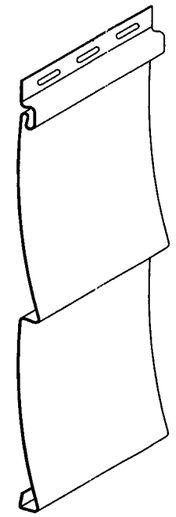

D/5
TRADITIONAL LAP

APPROVED MODELS

TYPICAL INSTALLATION
VINYL SIDING/SOFFIT

5/8" 5 PLY PLYWOOD

STUDS @ MAXIMUM
SPACING 16" O.C.

GALVANIZED ROOFING NAIL
1/8" RING SHANK DIAMETER
3/8" HEAD DIAMETER
1 1/2" LONG. @ 8" O.C.
THROUGH THE NAIL HEM
HOLES, ALTERNATELY
THROUGH THE PLYWOOD
AND THE STUDS.

NAME	DWG#	EXPOSURE INCHES	THICKNESS -0.001 INCHES	DESIGN PRESSURE P.S.F.
CASTLE RIDGE	1110102	DOUBLE 4	.042	46.6
FOREST RIDGE	1110502	DOUBLE 4	.042	46.6
VISION PRO	1112502	DOUBLE 4	.040	46.6
CEDAR LANE	1112602	DOUBLE 4	.046	46.6
PARKSIDE	1110712	DOUBLE 4	.038	46.6
WYNDHAM LANE	1119102	DOUBLE 4	.046	46.6
OAKSIDE	1118302	DOUBLE 4	.036	46.6
PARK RIDGE	1118402	DOUBLE 4	.036	46.6

NAME	DWG#	EXPOSURE INCHES	THICKNESS -0.001 INCHES	DESIGN PRESSURE P.S.F.
CASTLE RIDGE	1111102	DOUBLE 5	.042	40.0
VISION PRO	1113502	DOUBLE 5	.040	40.0
CEDAR LANE	1113602	DOUBLE 5	.046	40.0
PARKSIDE	1111712	DOUBLE 5	.038	40.0
FOREST RIDGE	1111602	DOUBLE 5	.042	40.0
WYNDHAM LANE	1119302	DOUBLE 5	.046	40.0
PARK RIDGE	1118502	DOUBLE 5	.036	40.0

NOTE 1.- GEORGIA PACIFIC VINYL SIDING/SOFFIT IS MANUFACTURED FROM A FORMULATED P.V.C. POWDER COMPOUND MEETING THE SPECIFICATIONS OF ASTM D3679
2.- WALLS AND SOFFIT RECEIVING VINYL SIDING/SOFFIT SHALL BE CHECKED FOR STUCTURAL ADEQUACY CRACKS OR DEFECTS THAT SHALL BE ELIMINATED
3.- WALLS SHALL BE WATER PROOFED WITH EQUIVALENT OF 15 POUND FELT AS DESCRIBED IN SECTION 2704.6 (b) OF THE SFBC
4.- WALLS AND SOFFIT WHERE VINYL SIDING/SOFFIT WILL BE INSTALLED SHALL BE DESIGNED BY AN ENGINEER OR ARCHITECT PER THE SFBC AND THE REQUIREMENTS OF THESE NOA
5.- INSTALLATION OF SIDING/SOFFIT ACCESORIES SUCH AS CORNER POSTS, STARTER STRIPS, TRIMS AROUND OPENINGS SHALL BE DONE IN ACCORDANCE WITH THE MANUFACTURES INSTRUCTIONS AND THE SFBC

02-0610.01
10/31/07
By
Miami Dade Product Control Division

RICHARD BOYETTE
FL Civil PE #42485
4031 Coconut Blvd
Royal Palm Bch FL 33411
(561) 790-5766 Voice / Fax

02-1013 10/9/02

GEORGIA PACIFIC
4300 WILDWOOD PKWY SUITE 300
ATLANTA GA. 30339

UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN INCHES
TOLERANCES
DECIMALS .XX ± .010 .XXX ± .005
ANGULAR ± 1°
DO NOT SCALE DRAWING

DRAWN LRB DATE 1/99
DESIGN ACTIVITY

COMPANY NAME GEORGIA PACIFIC
TITLE VINYL_SIDING SOFFIT
SIZE B
DWG NO. 1150001
SHEET

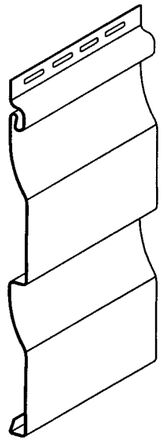

D/4
DUTCH LAP

APPROVED MODELS

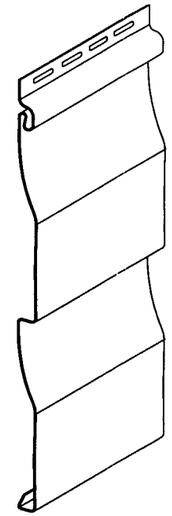

D/5
DUTCH LAP

APPROVED MODELS

TYPICAL INSTALLATION
VINYL SIDING/SOFFIT

5/8" 5 PLY PLYWOOD

STUDS @ MAXIMUM
SPACING 16" O.C.

GALVANIZED ROOFING NAIL
1/8" RING SHANK DIAMETER
3/8" HEAD DIAMETER
1 1/2" LONG. @ 8" O.C.
THROUGH THE NAIL HEM
HOLES, ALTERNATELY
THROUGH THE PLYWOOD
AND THE STUDS.

NAME	DWG#	EXPOSURE INCHES	THICKNESS -0.001 INCHES	DESIGN PRESSURE P.S.F.
CEDAR LANE	1112702	DOUBLE 4	.046	46.6
VISION PRO	1112902	DOUBLE 4	.040	46.6
PARKSIDE	1110612	DOUBLE 4	.038	46.6
SHADOW RIDGE	1110902	DOUBLE 4	.042	46.6
WYNDHAM LANE	1119202	DOUBLE 4	.046	46.6
OAKSIDE	1118002	DOUBLE 4	.036	46.6
PARK RIDGE	1118702	DOUBLE 4	.036	46.6

NAME	DWG#	EXPOSURE INCHES	THICKNESS -0.001 INCHES	DESIGN PRESSURE P.S.F.
VISION PRO	1113902	DOUBLE 5	.040	40.0
CEDAR LANE	1113702	DOUBLE 5	.046	40.0
PARKSIDE	1111512	DOUBLE 5	.038	40.0
SHADOW RIDGE	1111902	DOUBLE 5	.042	40.0
WYNDHAM LANE	1119402	DOUBLE 5	.046	40.0
OAKSIDE	1118202	DOUBLE 5	.036	40.0
PARK RIDGE	1118902	DOUBLE 5	.036	40.0

NOTE 1.- GEORGIA PACIFIC VINYL SIDING/SOFFIT IS MANUFACTURED FROM A FORMULATED P.V.C. POWDER COMPOUND MEETING THE SPECIFICATIONS OF ASTM D3679
2.- WALLS AND SOFFIT RECEIVING VINYL SIDING/SOFFIT SHALL BE CHECKED FOR STUCTURAL ADEQUACY CRACKS OR DEFECTS THAT SHALL BE ELIMINATED
3.- WALLS SHALL BE WATER PROOFED WITH EQUIVALENT OF 15 POUND FELT AS DESCRIBED IN SECTION 2704.6 (b) OF THE SFBC
4.- WALLS AND SOFFIT WHERE VINYL SIDING/SOFFIT WILL BE INSTALLED SHALL BE DESIGNED BY AN ENGINEER OR ARCHITECT PER THE SFBC AND THE REQUIREMENTS OF THESE NOA
5.- INSTALLATION OF SIDING/SOFFIT ACCESORIES SUCH AS CORNER POSTS, STARTER STRIPS, TRIMS AROUND OPENINGS SHALL BE DONE IN ACCORDANCE WITH THE MANUFACTURES INSTRUCTIONS AND THE SFBC

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance # 02-0610.01
Expiration Date 10/31/07
By
Miami Dade Product Control
Division

RICHARD BOYETTE
FL Civil PE #42485
4031 Coconut Blvd
Royal Palm Bch FL 33411
561-790-5766 Voice / Fax

10/9/02

GEORGIA PACIFIC
4300 WILDWOOD PKWY SUITE 300
ATLANTA GA. 30339

UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN INCHES
TOLERANCES
DECIMALS .XX ± .010 .XXX ± .005
ANGULAR ± 1°
DO NOT SCALE DRAWING

DRAWN LRB DATE 1/99

DESIGN ACTIVITY

COMPANY NAME GEORGIA_PACIFIC

TITLE VINYL_SIDING SOFFIT

SIZE B

DWG NO. 1150002

SHEET

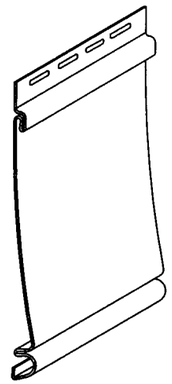

6 1/2"
HORIZONTAL

APPROVED MODELS

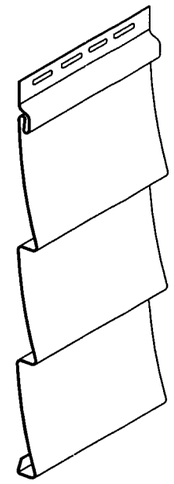

T/3
HORIZONTAL

APPROVED MODELS

TYPICAL INSTALLATION
VINYL SIDING/SOFFIT

5/8" 5 PLY PLYWOOD

STUDS @ MAXIMUM
SPACING 16" O.C.

GALVANIZED ROOFING NAIL
1/8" RING SHANK DIAMETER
3/8" HEAD DIAMETER
1 1/2" LONG. @ 8" O.C.
THROUGH THE NAIL HEM
HOLES, ALTERNATELY
THROUGH THE PLYWOOD
AND THE STUDS.

NAME	DWG#	EXPOSURE INCHES	THICKNESS -0.001 INCHES	DESIGN PRESSURE P.S.F.
SOMERSET	1112002	SINGLE 6 1/2	.044	60.0

NAME	DWG#	EXPOSURE INCHES	THICKNESS -0.001 INCHES	DESIGN PRESSURE P.S.F.
CHATHAM RIDGE	1117102	TRIPLE 3	.040	40.0

NOTE 1.- GEORGIA PACIFIC VINYL SIDING/SOFFIT IS MANUFACTURED FROM A FORMULATED P.V.C. POWDER COMPOUND MEETING THE SPECIFICATIONS OF ASTM D3679
2.- WALLS AND SOFFIT RECEIVING VINYL SIDING/SOFFIT SHALL BE CHECKED FOR STUCTURAL ADEQUACY CRACKS OR DEFECTS THAT SHALL BE ELIMINATED
3.- WALLS SHALL BE WATER PROOFED WITH EQUIVALENT OF 15 POUND FELT AS DESCRIBED IN SECTION 2704.6 (b) OF THE SFBC

4.- WALLS AND SOFFIT WHERE VINYL SIDING/SOFFIT WILL BE INSTALLED SHALL BE DESIGNED BY AN ENGINEER OR ARCHITECT PER THE SFBC AND THE REQUIREMENTS OF THESE NOA
5.- INSTALLATION OF SIDING/SOFFIT ACCESORIES SUCH AS CORNER POSTS, STARTER STRIPS, TRIMS AROUND OPENINGS SHALL BE DONE IN ACCORDANCE WITH THE MANUFACTURES INSTRUCTIONS AND THE SFBC

PRODUCT REVIEWED
as complying with Florida
Date
Accepted 02-0610.01
Expiration 10/31/07
By
Miami Dade Product Control
Division

RICHARD BOYETTE
FL Civil PE #42485
4031 Coconut Blvd
Royal Palm Bch FL 33411
(561) 790-5766 Voice / Fax
10/9/02

GEORGIA PACIFIC
4300 WILDWOOD PKWY SUITE 300
ATLANTA GA. 30339

UNLESS OTHERWISE SPECIFIED:
DIMENSIONS ARE IN INCHES
TOLERANCES
DECIMALS .XX ± .010 .XXX ± .005
ANGULAR ± 1°
DO NOT SCALE DRAWING

DRAWN LRB DATE 1/99

DESIGN ACTIVITY

COMPANY NAME GEORGIA_PACIFIC

TITLE VINYL_SIDING SOFFIT

SIZE B

DWG NO. 1150003

SHEET

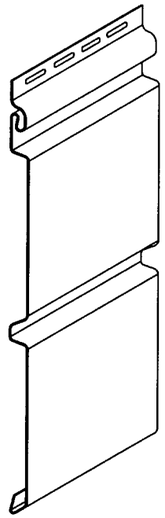

D/5
VERTICAL/SOFFIT

APPROVED MODELS

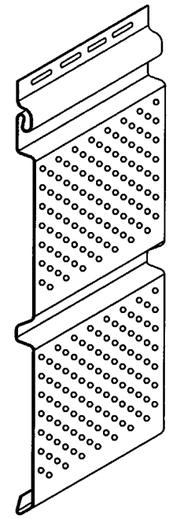

.D/5
PERFORATED
SOFFIT

APPROVED MODELS

TYPICAL INSTALLATION
VINYL SIDING/SOFFIT

5/8" 5 PLY PLYWOOD

STUDS @ MAXIMUM
SPACING 16" O.C.

GALVANIZED ROOFING NAIL
1/8" RING SHANK DIAMETER
3/8" HEAD DIAMETER
1 1/2" LONG. @ 8" O.C.
THROUGH THE NAIL HEM
HOLES, ALTERNATELY
THROUGH THE PLYWOOD
AND THE STUDS.

NAME	DWG#	EXPOSURE INCHES	THICKNESS -0.001 INCHES	DESIGN PRESSURE P.S.F.
CEDAR LANE VERTICAL/SOFFIT	1115502	DOUBLE 5	.046	40.0
VERTICAL/SOFFIT	1114002	DOUBLE 5	.044	40.0

NAME	DWG#	EXPOSURE INCHES	THICKNESS -0.001 INCHES	DESIGN PRESSURE P.S.F.
CEDAR LANE PERFORATED SOFFIT	1115602	DOUBLE 5	.046	40.0
PERFORATED SOFFIT	1114102	DOUBLE 5	.044	40.0

NOTE 1.– GEORGIA PACIFIC VINYL SIDING/SOFFIT IS MANUFACTURED FROM A FORMULATED P.V.C. POWDER COMPOUND MEETING THE SPECIFICATIONS OF ASTM D3679
2.– WALLS AND SOFFIT RECEIVING VINYL SIDING/SOFFIT SHALL BE CHECKED FOR STUCTURAL ADEQUACY CRACKS OR DEFECTS THAT SHALL BE ELIMINATED
3.– WALLS SHALL BE WATER PROOFED WITH EQUIVALENT OF 15 POUND FELT AS DESCRIBED IN SECTION 2704.6 (b) OF THE SFBC
4.– WALLS AND SOFFIT WHERE VINYL SIDING/SOFFIT WILL BE INSTALLED SHALL BE DESIGNED BY AN ENGINEER OR ARCHITECT PER THE SFBC AND THE REQUIREMENTS OF THESE NOA
5.– INSTALLATION OF SIDING/SOFFIT ACCESORIES SUCH AS CORNER POSTS, STARTER STRIPS, TRIMS AROUND OPENINGS SHALL BE DONE IN ACCORDANCE WITH THE MANUFACTURES INSTRUCTIONS AND THE SFBC

PRODUCT REVIEWED
as conforming to the Florida
Building Code
Product Control
Application No. 02-0610.01
Expiration Date 10/31/07
By
Miami Dade Product Control
Division

RICHARD BOYETTE
FL Civil PE #42485
4031 Coconut Blvd
Royal Palm Bch FL 33411
(561) 790-5766 Voice / Fax

10/9/02

GEORGIA PACIFIC
4300 WILDWOOD PKWY SUITE 300
ATLANTA GA. 30339

UNLESS OTHERWISE SPECIFIED:
DIMENSIONS ARE IN INCHES
TOLERANCES
DECIMALS .XX ± .010 .XXX ± .005
ANGULAR ± 1°
DO NOT SCALE DRAWING

DRAWN LRB DATE 1/99

DESIGN ACTIVITY

COMPANY NAME GEORGIA_PACIFIC

TITLE VINYL_SIDING SOFFIT

SIZE B

DWG NO. 1150004

SHEET

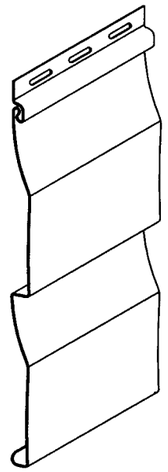

D/4.5
DUTCH LAP

TYPICAL INSTALLATION
VINYL SIDING/SOFFIT

5/8" 5 PLY PLYWOOD

STUDS @ MAXIMUM
SPACING 16" O.C.

GALVANIZED ROOFING NAIL
1/8" RING SHANK DIAMETER
3/8" HEAD DIAMETER
1 1/2" LONG. @ 8" O.C.
THROUGH THE NAIL HEM
HOLES, ALTERNATELY
THROUGH THE PLYWOOD
AND THE STUDS.

APPROVED MODELS

NAME	DWG#	EXPOSURE INCHES	THICKNESS -0.001 INCHES	DESIGN PRESSURE P.S.F.
PARKSIDE	1111012	DOUBLE 4.5	.038	40.0
OAKSIDE	1118102	DOUBLE 4.5	.036	40.0
CASTLE RIDGE	1112402	DOUBLE 4.5	.042	40.0
PARK RIDGE	1118802	DOUBLE 4.5	.036	40.0

NOTE 1.- GEORGIA PACIFIC VINYL SIDING/SOFFIT IS MANUFACTURED FROM A FORMULATED P.V.C. POWDER COMPOUND MEETING THE SPECIFICATIONS OF ASTM D3679
2.- WALLS AND SOFFIT RECEIVING VINYL SIDING/SOFFIT SHALL BE CHECKED FOR STUCTURAL ADEQUACY CRACKS OR DEFECTS THAT SHALL BE ELIMINATED
3.- WALLS SHALL BE WATER PROOFED WITH EQUIVALENT OF 15 POUND FELT AS DESCRIBED IN SECTION 2704.6 (b) OF THE SFBC

4.- WALLS AND SOFFIT WHERE VINYL SIDING/SOFFIT WILL BE INSTALLED SHALL BE DESIGNED BY AN ENGINEER OR ARCHITECT PER THE SFBC AND THE REQUIREMENTS OF THESE NOA
5.- INSTALLATION OF SIDING/SOFFIT ACCESORIES SUCH AS CORNER POSTS, STARTER STRIPS, TRIMS AROUND OPENINGS SHALL BE DONE IN ACCORDANCE WITH THE MANUFACTURES INSTRUCTIONS AND THE SFBC

PRODUCT APPROVED
State of Florida
Application No. 02-0610.01
Expiration Date 10/31/07
By
Miami Dade Product Control Division

RICHARD BOYETTE
FL Civil PE #42485
4031 Coconut Blvd
Palm Bch FL 33411
766 Voice / Fax

10/9/02

GEORGIA PACIFIC
4300 WILDWOOD PKWY SUITE 300
ATLANTA GA. 30339

UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN INCHES
TOLERANCES
DECIMALS .XX ± .010 .XXX ± .005
ANGULAR ± 1°
DO NOT SCALE DRAWING

DRAWN LRB DATE 1/99

DESIGN ACTIVITY

COMPANY NAME GEORGIA_PACIFIC

TITLE VINYL_SIDING SOFFIT

SIZE B

DWG NO. 1150005

SHEET