



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

**Weather Shield Windows & Doors  
One Weather Shield Plaza  
Medford, WI 54451**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: Series "Picture Contempra TFT" Aluminum Clad Wood Fixed Window**

**APPROVAL DOCUMENT:** Drawing No. **W96-08**, titled "Contempra TFT Stationary Casement Windows", sheets 1 through 5 of 5, dated 2/22/96 with revision B dated 12/20/02, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: None**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises and renews** NOA # **00-0802.02** and, consists of this page 1 as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No 02-0619.01  
Expiration Date: November 21, 2007  
Approval Date: February 20, 2003  
Page 1**

**Weather Shield Windows & Doors**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

(For File ONLY. Not part of NOA)

**A. DRAWINGS**


1. Manufacturer's die drawings and sections.
2. Drawing No. **W96-08**, titled "Contempra TFT Stationary Casement Windows", sheets 1 through 5 of 5, dated 2/22/96 with revision B dated 12/20/02, prepared by Al Farooq Corporation, signed and sealed by Humayoun Farooq, P.E.  
*Submitted under original file No. 95-0927.03*

**B. TESTS**

1. Test reports on
  - 1) Air Infiltration Test, per PA 202-94
  - 2) Uniform Static Air Pressure Test, Loading per PA 202-94
  - 3) Water Resistance Test, per PA 202-94along with installation diagram of an aluminum fixed window, overall size 4' - 4-1/2" wide by 4' - 6" high by 5-3/4" deep with 1" insulated unit w/two 5/32" annealed sheets or monolithic 1/4" tempered glass, prepared by Architectural Testing Inc., report No. **ATI-16283-N** dated September 1, 1995 signed and sealed by Allen Reeves, P.E.
2. Test reports on
  - 1) Air Infiltration Test, per PA 202-94
  - 2) Uniform Static Air Pressure Test, Loading per PA 202-94
  - 3) Water Resistance Test, per PA 202-94along with installation diagram of an aluminum fixed window, overall size 8' - 4-7/16" wide by 6' - 0" high by 5-3/4" deep with 1" insulated unit w/two 1/4" annealed sheets, prepared by Architectural Testing Inc., report No. **ATI-16283-N-1** dated September 1, 1995 signed and sealed by Allen Reeves, P.E.

**C. CALCULATIONS**

1. Comparative analysis and anchor calculations, dated Feb. 12, 1996, prepared by Al Farooq Corporation, signed and sealed by Humayoun Farooq, P.E. (*Submitted under NOA#00-0802.02*)
2. Comparative analysis and anchor calculations, dated Dec. 24, 2002, prepared by Al Farooq Corporation, signed and sealed by Humayoun Farooq, P.E.

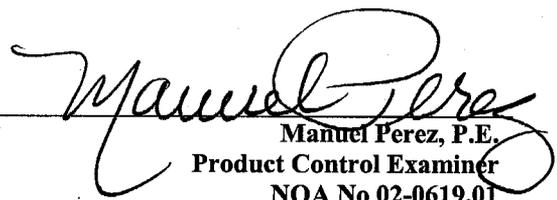  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No 02-0619.01

Expiration Date: November 21, 2007

Approval Date: February 20, 2003

**Weather Shield Windows & Doors**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

(For File ONLY. Not part of NOA)

**D. MATERIAL CERTIFICATIONS**

1. None.

**E. STATEMENTS**

1. Statement letter of conformance, dated December 24, 2002, signed and sealed by Humayoun Farooq, P.E.
2. Statement letter of no financial interest, dated December 24, 2002, signed and sealed by Humayoun Farooq, P.E.

**F. OTHER**


1. Notice of Acceptance No. **00-0802.02** Weather Shield Windows & Doors, Series "Picture Contempra TFT" Aluminum Clad Wood Fixed Window, approved on 11/02/00 and expiring on 11/21/02.

  
Manuel Perez, P.E.  
Product Control Examiner


NOA No 02-0619.01

Expiration Date: November 21, 2007

Approval Date: February 20, 2003

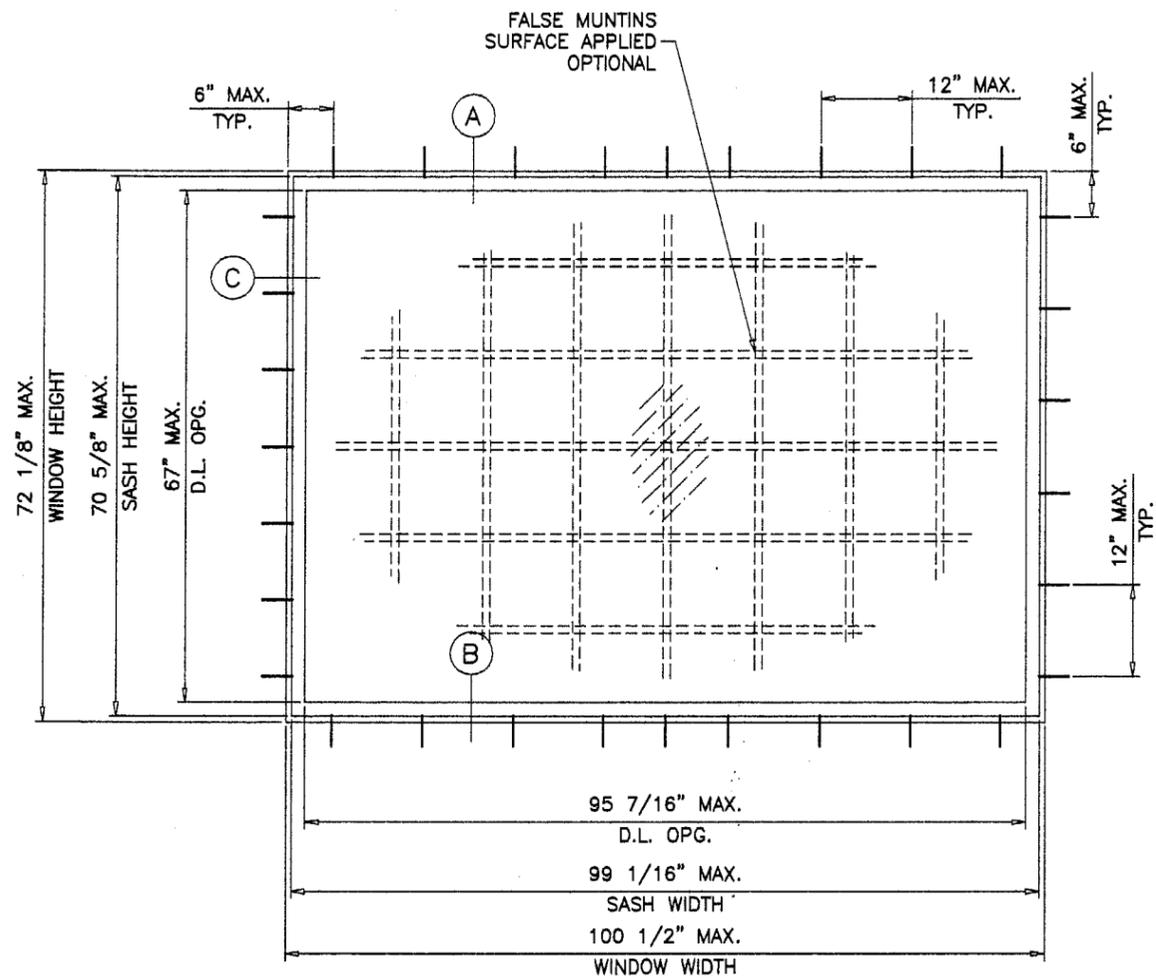

TYPICAL ELEVATION

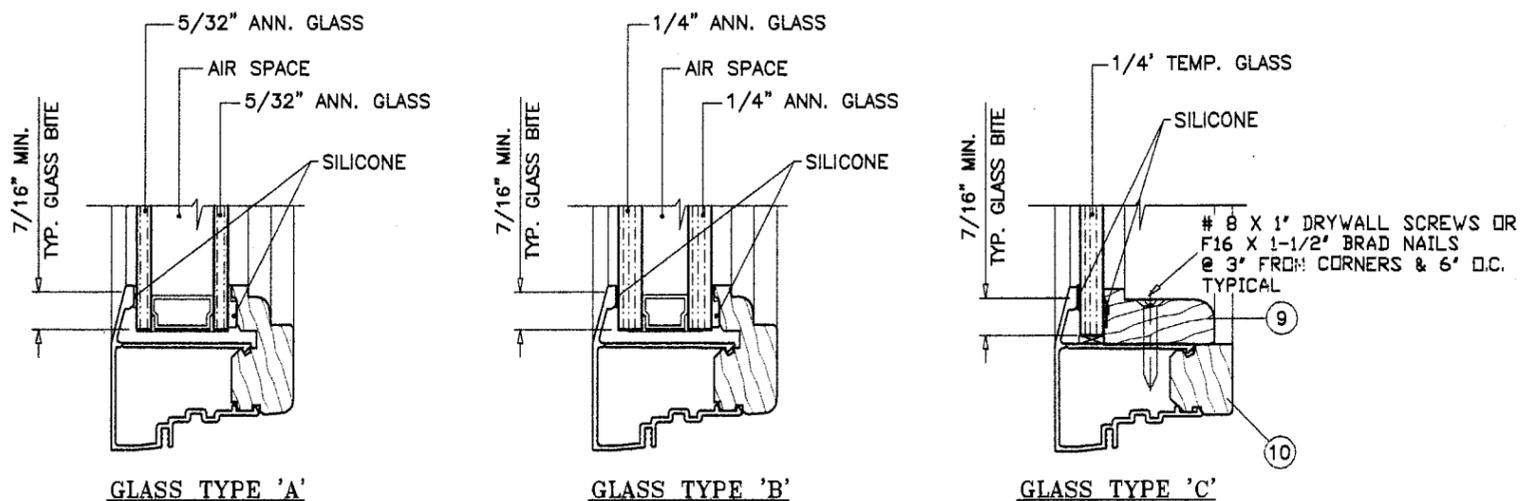

GLAZING OPTIONS

**'CONTEMPRA' TFT ALUMINUM CLAD WOOD STATIONARY CASEMENT WINDOWS**

DESIGN LOAD RATING FOR THESE WINDOWS TO BE AS PER CHART SHOWN ON SHEET 2.

APPROVAL APPLIES TO SINGLE WINDOWS OR SIDE BY SIDE COMBINATIONS OF TWO OR MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS.

WINDOWS NOT RATED FOR IMPACT AND REQUIRE PROTECTION BY MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS.

THIS PRODUCT IS DESIGNED TO COMPLY WITH THE HIGH VELOCITY HURRICANE ZONE OF THE 2001 FLORIDA BUILDING CODE. ALSO FOR WIND LOADS AS PER ASCE 7-88, ASCE 7-93, ASCE 7-95 OR ASCE 7-98 AS REQUIRED BY PREVAILING BUILDING CODE.

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

Engr: DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

JAN 17 2003

Approved as complying with the Florida Building Code  
Date FEB. 20, 2003  
NOA# 02-0619.01  
Miami Dade Product Control  
Division  
By *[Signature]*

**AL-FAROOQ CORPORATION**  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W96-08-NEW

**'CONTEMPRA' TFT STATIONARY CASEMENT WINDOWS**  
**WEATHER SHIELD WINDOWS & DOORS**  
MEDFORD, WISCONSIN. 54451  
TEL. (715) 748-2100 FAX (715) 748-6064


no	date	description
A	12.02.96	SASH ANCHORS REV.
B	12.20.02	GENERAL REVISION

date: 02-22-96  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W96-08**  
sheet 1 of 5

DESIGN LOAD CAPACITY - PSF							
WINDOW DIMS.		GLASS TYPE 'A'		GLASS TYPE 'B'		GLASS TYPE 'C'	
WIDTH	LENGTH	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
36"	28-1/8"	132.3	132.3	100.0	161.3	100.0	161.3
40"		115.6	115.6	100.0	161.3	100.0	161.3
44"		101.2	101.2	100.0	161.3	100.0	161.3
48"		89.1	89.1	100.0	161.3	100.0	161.3
52-1/2"		78.7	78.7	100.0	151.6	100.0	161.3
60-1/2"		66.2	66.2	100.0	132.3	100.0	160.5
68-1/2"		59.6	59.6	100.0	121.1	100.0	155.0
76-1/2"		56.0	56.0	100.0	115.0	100.0	150.9
84-1/2"		54.0	54.0	100.0	111.2	100.0	147.8
100-1/2"		50.2	50.2	100.0	104.4	100.0	143.2
36"	32-1/8"	117.5	117.5	100.0	141.2	100.0	141.2
40"		106.0	106.0	100.0	141.2	100.0	141.2
44"		94.5	94.5	100.0	141.2	100.0	141.2
48"		84.1	84.1	100.0	141.2	100.0	141.2
52-1/2"		73.8	73.8	100.0	128.3	100.0	141.2
60-1/2"		59.9	59.9	100.0	107.8	100.0	141.2
68-1/2"		51.1	51.1	94.5	94.5	100.0	140.9
76-1/2"		45.5	45.5	86.4	86.4	100.0	136.5
84-1/2"		42.3	42.3	81.7	81.7	100.0	133.2
100-1/2"		X	X	77.0	77.0	100.0	128.4
36"	36-1/8"	103.3	103.3	100.0	126.0	100.0	126.0
40"		95.9	95.9	100.0	125.6	100.0	125.6
44"		88.0	88.0	100.0	125.6	100.0	125.6
48"		79.9	79.9	100.0	125.6	100.0	125.6
52-1/2"		71.3	71.3	100.0	115.7	100.0	125.6
60-1/2"		58.3	58.3	96.1	96.1	100.0	125.6
68-1/2"		48.6	48.6	81.9	81.9	100.0	125.6
76-1/2"		41.8	41.8	72.2	72.2	100.0	125.5
84-1/2"		X	X	65.9	65.9	100.0	122.0
100-1/2"		X	X	59.6	59.6	100.0	116.9
36"	40-1/8"	96.1	96.1	100.0	126.0	100.0	126.0
40"		85.9	85.9	100.0	113.4	100.0	113.4
44"		80.6	80.6	100.0	113.0	100.0	113.0
48"		74.9	74.9	100.0	113.0	100.0	113.0
52-1/2"		68.2	68.2	100.0	106.9	100.0	113.0
60-1/2"		57.1	57.1	89.6	89.6	100.0	113.0
68-1/2"		47.9	47.9	75.6	75.6	100.0	113.0
76-1/2"		X	X	65.2	65.2	100.0	113.0
84-1/2"		X	X	57.8	57.8	100.0	113.0
100-1/2"		X	X	49.3	49.3	100.0	107.9
36"	44-1/8"	88.0	88.0	100.0	126.0	100.0	126.0
40"		80.6	80.6	100.0	113.4	100.0	113.4
44"		72.9	72.9	100.0	103.1	100.0	103.1
48"		68.9	68.9	100.0	102.8	100.0	102.8
52-1/2"		64.1	64.1	99.0	99.0	100.0	102.8
60-1/2"		55.3	55.3	85.0	85.0	100.0	102.8
68-1/2"		X	X	72.2	72.2	100.0	102.8
76-1/2"		X	X	61.9	61.9	100.0	102.8
84-1/2"		X	X	53.8	53.8	100.0	102.8
100-1/2"		X	X	43.7	43.7	97.2	97.2
36"	48-1/8"	79.9	79.9	100.0	126.0	100.0	126.0
40"		74.9	74.9	100.0	113.4	100.0	113.4
44"		69.1	69.1	100.0	103.1	100.0	103.1
48"		63.2	63.2	94.5	94.5	94.5	94.5
52-1/2"		59.6	59.6	91.3	91.3	94.3	94.3
60-1/2"		X	X	80.5	80.5	94.3	94.3
68-1/2"		X	X	69.7	69.7	94.3	94.3
76-1/2"		X	X	60.1	60.1	94.3	94.3
84-1/2"		X	X	52.2	52.2	94.3	94.3
100-1/2"		X	X	41.0	41.0	91.2	91.2

DESIGN LOAD CAPACITY - PSF							
WINDOW DIMS.		GLASS TYPE 'A'		GLASS TYPE 'B'		GLASS TYPE 'C'	
WIDTH	LENGTH	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
36"	52-1/8"	72.2	72.2	100.0	117.2	100.0	126.0
40"		68.9	68.9	100.0	108.2	100.0	113.4
44"		64.6	64.6	100.0	100.1	100.0	103.1
48"		59.9	59.9	92.2	92.2	94.5	94.5
52-1/2"		54.9	54.9	83.7	83.7	87.0	87.0
60-1/2"		X	X	75.6	75.6	87.0	87.0
68-1/2"		X	X	67.0	67.0	87.0	87.0
76-1/2"		X	X	58.5	58.5	87.0	87.0
84-1/2"		X	X	51.1	51.1	87.0	87.0
100-1/2"		X	X	40.0	40.0	87.0	87.0
36"	58-1/8"	61.9	61.9	100.0	101.7	100.0	126.0
40"		60.3	60.3	94.7	94.7	100.0	113.4
44"		58.0	58.0	89.1	89.1	100.0	103.1
48"		54.7	54.7	83.9	83.9	94.5	94.5
52-1/2"		X	X	77.6	77.6	86.4	86.4
60-1/2"		X	X	68.2	68.2	78.0	78.0
68-1/2"		X	X	62.3	62.3	78.0	78.0
76-1/2"		X	X	56.0	56.0	78.0	78.0
84-1/2"		X	X	49.7	49.7	78.0	78.0
100-1/2"		X	X	39.4	39.4	78.0	78.0
36"	62-1/8"	56.0	56.0	93.1	93.1	100.0	126.0
40"		55.1	55.1	86.6	86.6	100.0	113.4
44"		53.6	53.6	82.3	82.3	100.0	103.1
48"		X	X	78.3	78.3	94.5	94.5
52-1/2"		X	X	73.4	73.4	86.4	86.4
60-1/2"		X	X	64.4	64.4	75.0	75.0
68-1/2"		X	X	58.9	58.9	73.0	73.0
76-1/2"		X	X	53.8	53.8	73.0	73.0
84-1/2"		X	X	48.4	48.4	73.0	73.0
100-1/2"		X	X	39.1	39.1	73.0	73.0
36"	72-1/8"	45.2	45.2	77.2	77.2	100.0	126.0
40"		X	X	70.6	70.6	100.0	113.4
44"		X	X	67.3	67.3	100.0	103.1
48"		X	X	65.2	65.2	94.5	94.5
52-1/2"		X	X	62.8	62.8	86.4	86.4
60-1/2"		X	X	57.8	57.8	75.0	75.0
68-1/2"		X	X	51.8	51.8	66.2	66.2
76-1/2"		X	X	47.5	47.5	62.9	62.9
84-1/2"		X	X	44.1	44.1	62.9	62.9

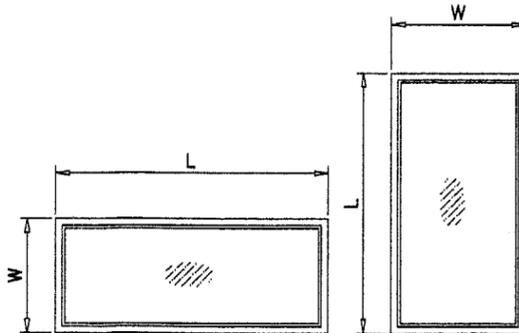

NOTE:  
WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

Engr. DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

JAN 17 2003




Approved as complying with the  
Florida Building Code  
Date FEB. 20, 2003  
NOA# 02-0619.01  
Miami Dade Product Control  
Division  
By *Muhammad*

**AL-FAROOQ CORPORATION**  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W96-08-NEW

'CONTEMPRA' TFT STATIONARY CASEMENT WINDOWS  
**WEATHER SHIELD WINDOWS & DOORS**  
MEDFORD, WISCONSIN. 54451  
TEL. (715) 748-2100 FAX (715) 748-6064

no.	date	description

date: 02-22-96  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:  
drawing no.  
**W96-08**  
sheet 2 of 5

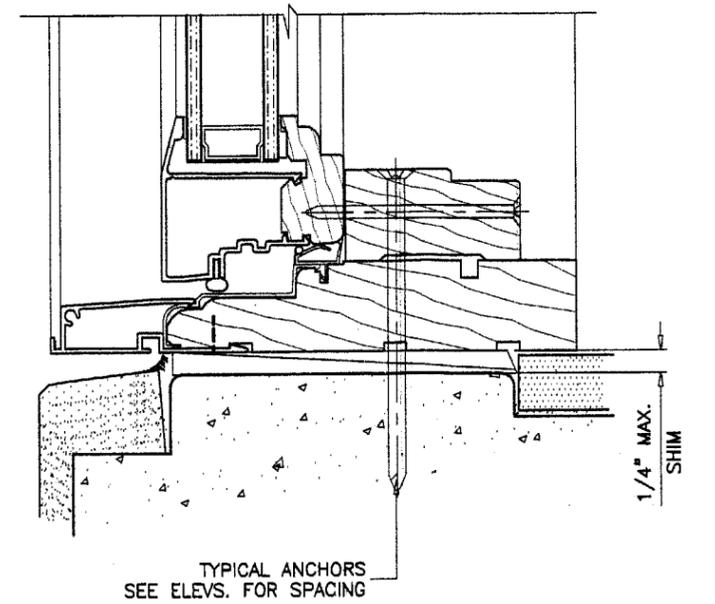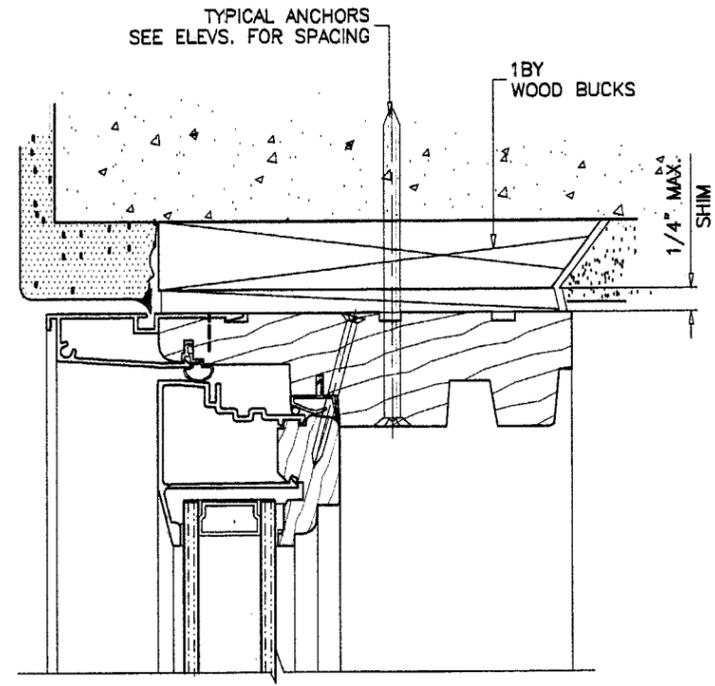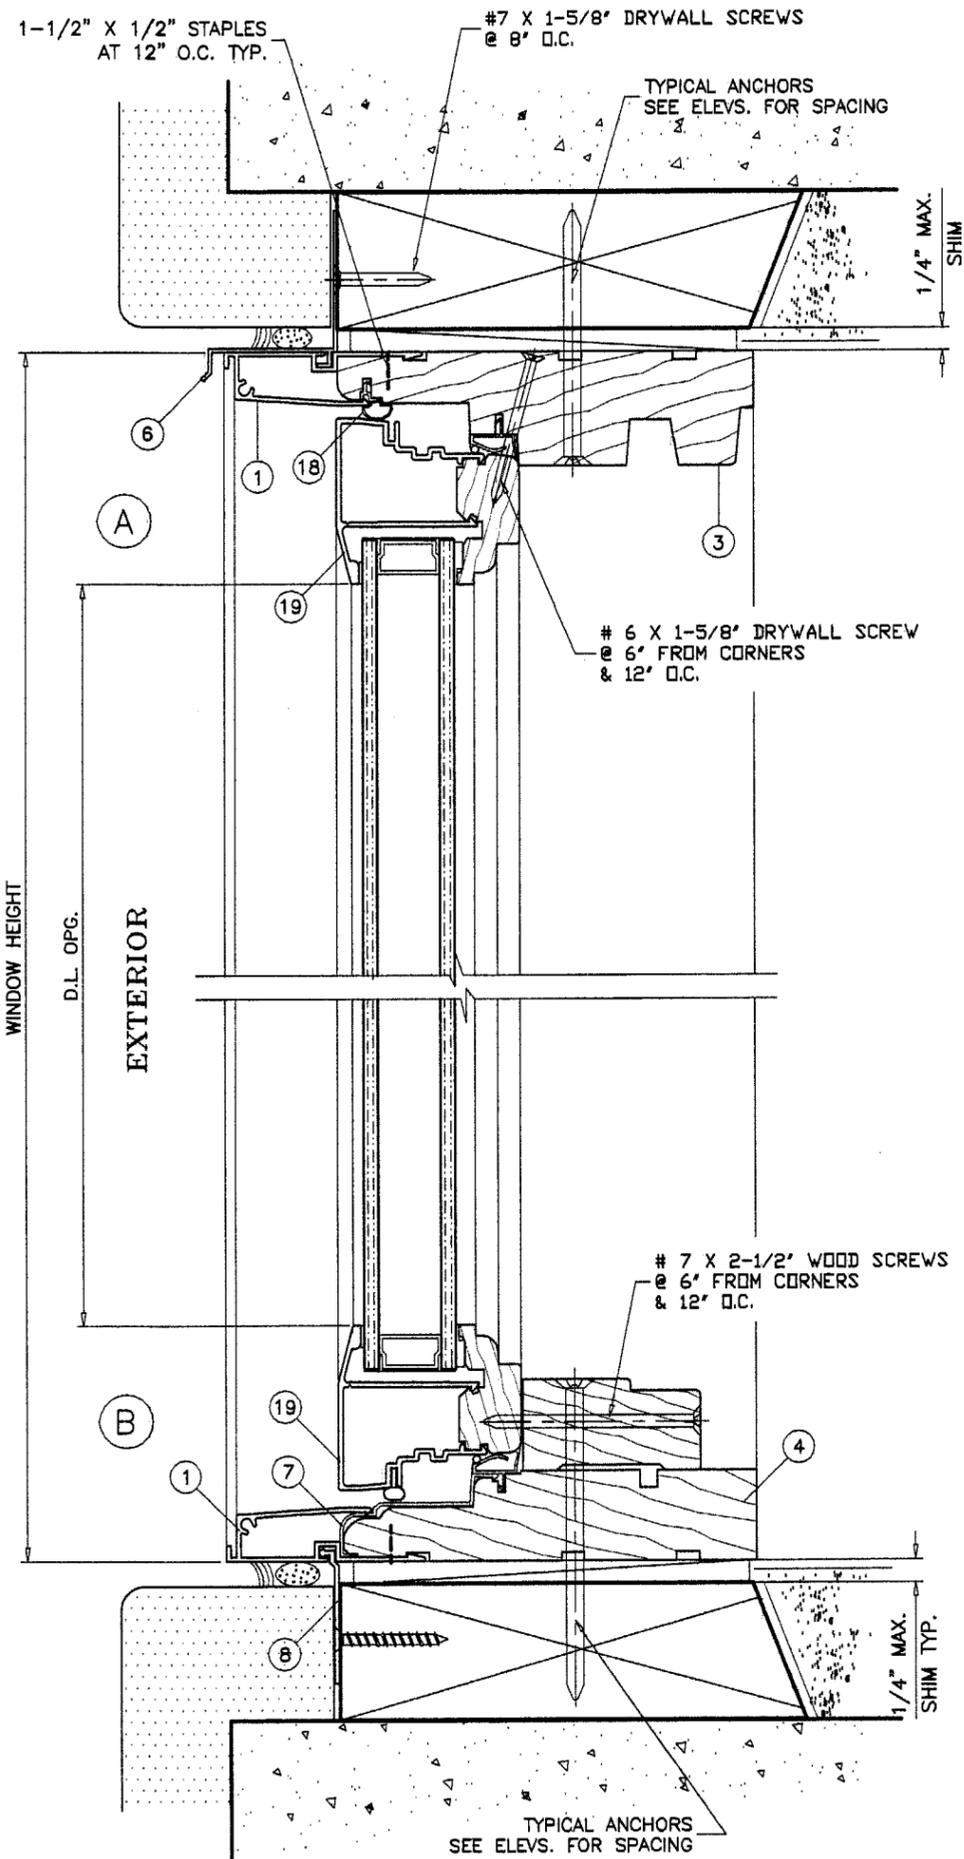

WOOD BUCKS NOT BY WEATHER SHIELD, MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

**TYPICAL ANCHORS:** SEE ELEV. FOR SPACING  
**#10 WOOD SCREWS OR S.M.S.**  
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURE  
 1-3/8" MIN. PENETRATION INTO WOOD  
**3/16" TAPCONS**  
 THRU 1BY WOOD BUCKS INTO MASONRY OR CONC.  
 1-1/4" MIN. EMBED INTO MASONRY OR CONC.

**SEALANTS:**  
 GLAZING SEAL - GE SILGLAZE 2801  
 EXT. CAP & FRAME JOINTS - GE SILGLAZE 2801

Engr: DR. HUMAYOUN FAROOQ  
 STRUCTURES  
 FLA. PE # 16557  
 C.A.N. 3538

*JAN 17 2003*

Approved as complying with the  
 Florida Building Code  
 Date FEB. 20, 2003  
 NOA# 02-0619.01  
 Miami Dade Product Control  
 Division  
 By *Manuel Perez*

*afc*


**AL-FAROOQ CORPORATION**  
 ENGINEERS, PLANNERS & PRODUCT DESIGN  
 1235 SW 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W96-08-NEW

---


'CONTEMPRA' TFT STATIONARY CASEMENT WINDOWS  
**WEATHER SHIELD WINDOWS & DOORS**  
 MEDFORD, WISCONSIN. 54451  
 TEL. (715) 748-2100 FAX (715) 748-6064

revisions:	no	date	by	description

date: 02-22-96	scale: 1/2" = 1"	dr. by: HAMID	chk. by:
drawing no. <b>W96-08</b>		sheet 3 of 5	

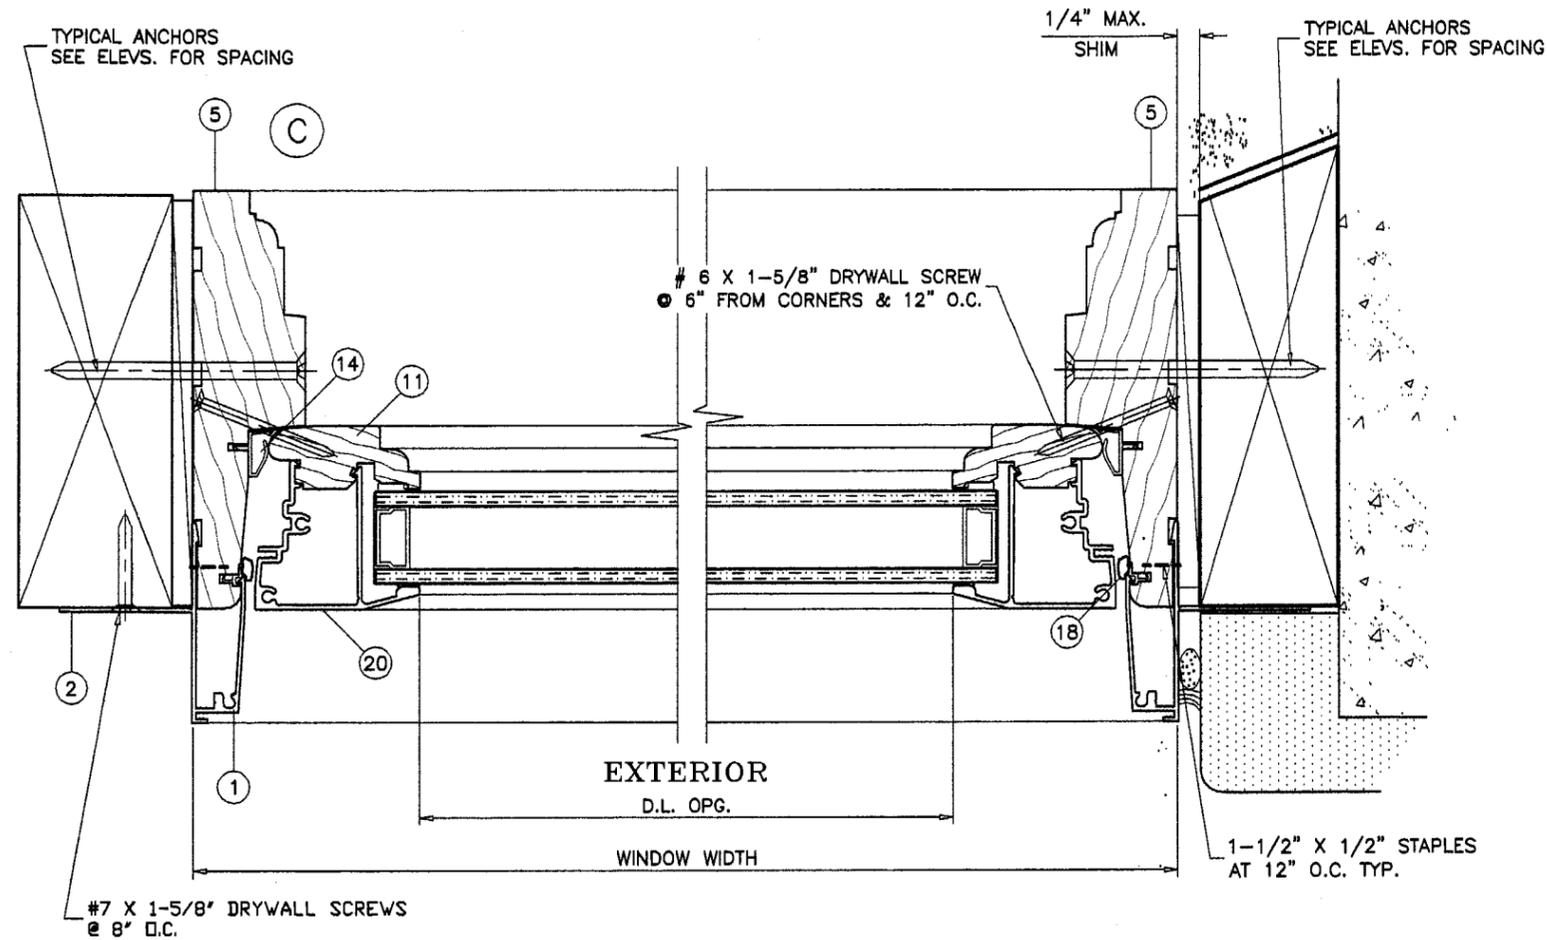


ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	900508	2	HEAD & SILL TFT	ALUMINUM	CAPITOL
2	780002	2	SIDE TRIM WITH NAILING FIN	ALUMINUM	CAPITOL
3	310003	1	FRAME HEAD	WOOD	WEATHER SHIELD
4	310004	1	FRAME SILL	WOOD	WEATHERSHIELD
5	310021	2	FRAME JAMB	WOOD	WEATHER SHIELD
6	780011	1	DRIP CAP	ALUMINUM	CAPITOL
7	969911	1	SILL CLAD	ALUMINUM	CAPITOL
8	760103	1	SILL NAILING FIN	-	WEATHER SHIELD
9	-	4/SASH	GLASS STOP	WOOD	WEATHER SHIELD
10	-	2	SASH RAIL	WOOD	WEATHER SHIELD
11	-	2	SASH STILE	WOOD	WEATHER SHIELD
12	-	-	-	-	-
13	-	-	-	-	-
14	7600611	4	WEATHER STRIP	-	AMESBURY
15	-	-	-	-	-
16	-	-	-	-	-
17	-	-	-	-	-
18	760013	3	HEAD & SIDE JAMB W'STRIP	VINYL	WEATHER SHIELD
19	969378	2	SASH RAIL COVER	ALUMINUM	CAPITOL
20	969381	2	SASH STILE COVER	ALUMINUM	CAPITOL

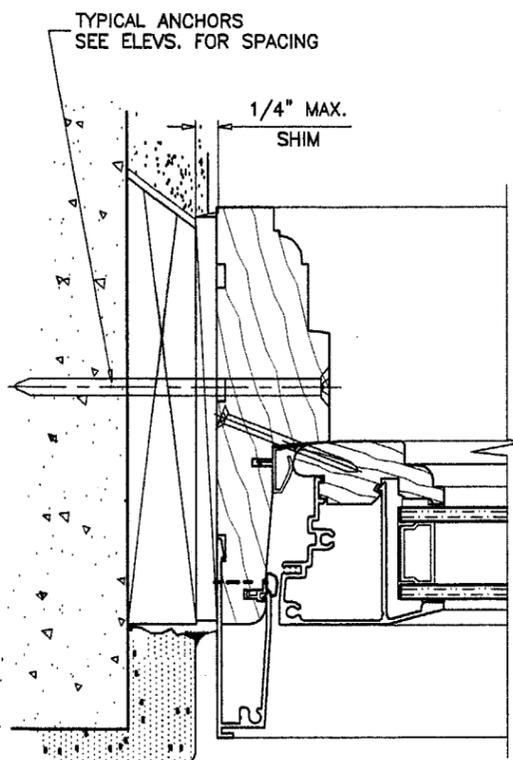

SEE MULLIONS APPROVAL FOR MULLION TYPE AND SIZE

#12 SMS AT 6" FROM ENDS AND 12" O.C.

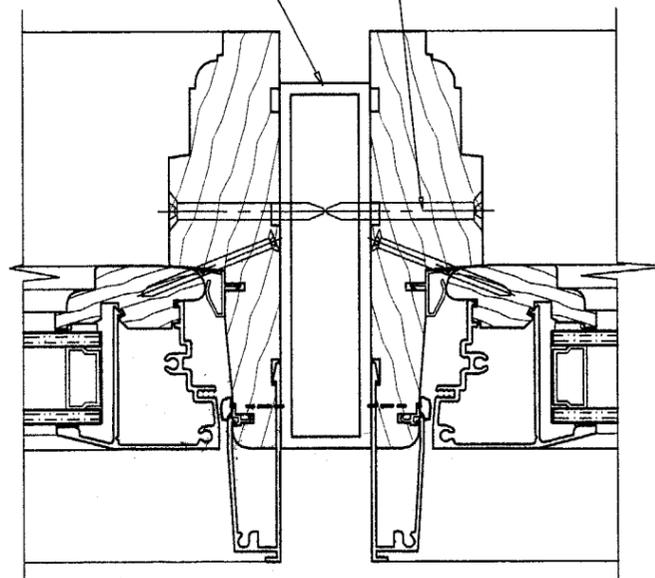

MULLIONS TO HAVE THEIR OWN N.O.A.

Engr: DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

JAN 17 2003

Approved as complying with the  
Florida Building Code  
Date **FEB. 20, 2003**  
NOA# **02-0619-01**  
Miami Dade Product Control  
Division  
By *Muhammad Farooq*


**AL-FAROOQ CORPORATION**  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978

'CONTEMPRA' TFT STATIONARY CASEMENT WINDOWS  
**WEATHER SHIELD WINDOWS & DOORS**  
MEDFORD, WISCONSIN. 54451  
TEL. (715) 748-2100 FAX (715) 748-6064


no	date	description

date: 02-22-96  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:


drawing no. **W96-08**  
sheet 4 of 5

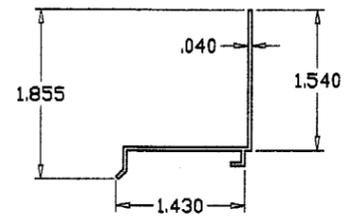


DRIP CAP

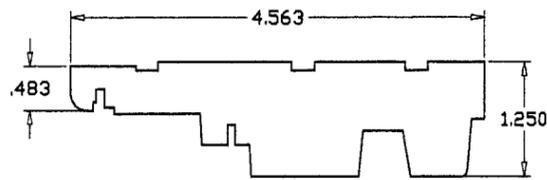


FRAME HEAD

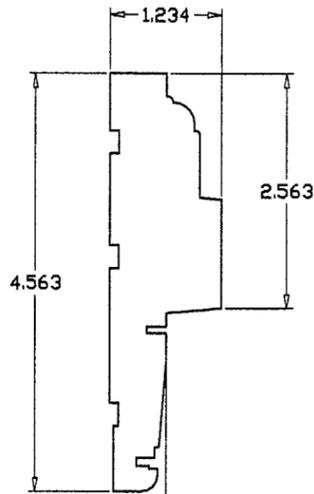


FRAME JAMB




SASH STILE COVER




SASH STILE

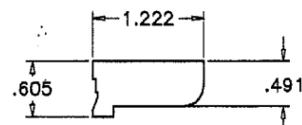


GLASS STOP




SASH RAIL

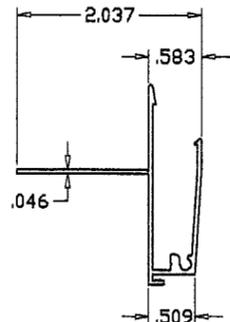


SIDE TRIM WITH NAILING FIN

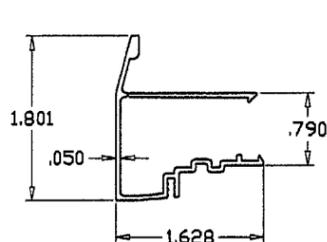


SASH RAIL COVER

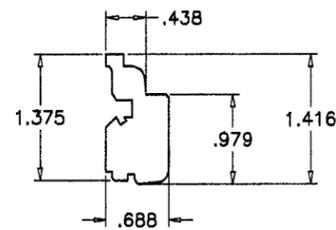


GLASS STOP (INSUL. GLASS)




THIN FIN TRIM MULL STRIP




SILL NAILING FIN

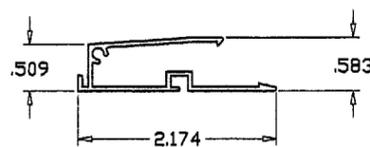



HEAD & SILL THIN FIN TRIM

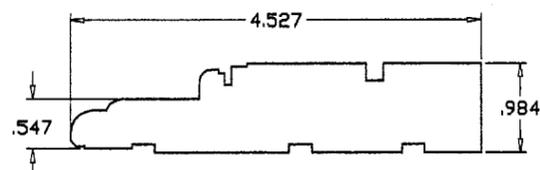


SILL

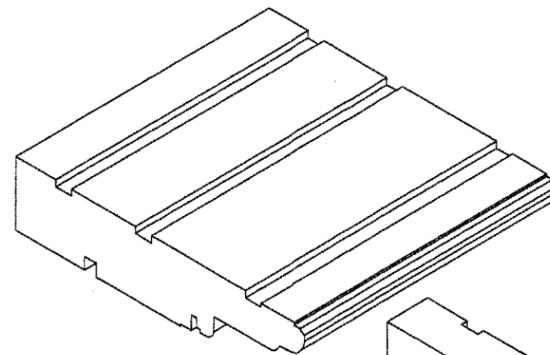

1-1/2" X 1/2" STAPLES  
3 PER CORNER

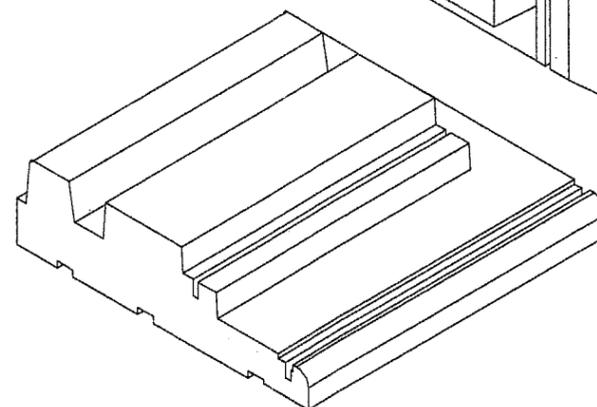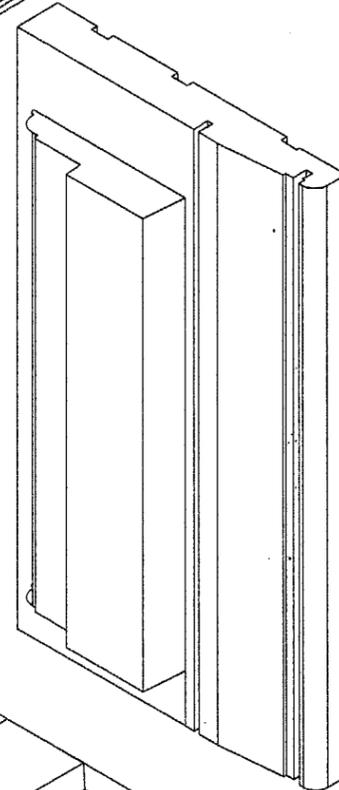


FRAME CORNER CONSTRUCTION

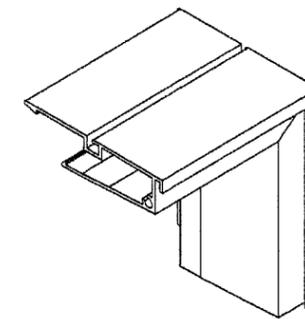

# 7 X 3/8" SCREW  
1/ CORNER

FIN CORNER CONSTRUCTION

# 6 X 1-1/4" SCREWS  
2/ CORNER

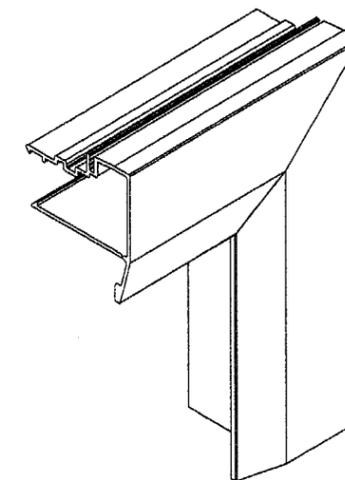

SASH CORNER CONSTRUCTION

**SEALANT:**

ALL FRAME CORNERS, JOINTS AND EXTERIOR CAP  
SEALED WITH GE SILGLAZE 2801.

Engr: DR. HUMAYOON FAROOQ  
STRUCTURES  
FLA. PE # 18557  
C.A.N. 3538

JAN 17 2003

Approved as complying with the  
Florida Building Code  
Date FEB. 20, 2003  
NOA# 02-0619.01  
Miami Dade Product Control  
Division  
By *Muhammad*



**AL-FAROOQ CORPORATION**  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978

'CONTEMPRA' TFT STATIONARY CASEMENT WINDOWS  
**WEATHER SHIELD WINDOWS & DOORS**  
MEDFORD, WISCONSIN. 54451  
TEL. (715) 748-2100 FAX (715) 748-6064

no	date	description

date: 02-22-96  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W96-08**  
sheet 5 of 5

COMP-ANL\W96-08-NEW