



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Jeld-Wen, Inc.
31725 Highway 97 N.
Chiloquin, OR 97624**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series "DoorCraft® Steel" Single Outswing Opaque W/E Insulated Steel Door - Impact

APPROVAL DOCUMENT: Drawing No. **DC9920**, dated 09/25/00, titled "Outswing Opaque Insulated Steel Single Door in Wood Frame", sheets 1 through 5, prepared by R. W. Building Consultant, Inc., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA # 00-1006.05** and consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No 02-0712.06
Expiration Date: August 05, 2007
Approval Date: August 08, 2002
Page 1**

DoorCraft® Steel

OUTSWING OPAQUE SINGLE DOOR
WOOD EDGE INSULATED STEEL DOOR WITH WOOD FRAMES


GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE SOUTH FLORIDA BUILDING CODE 1994 EDITION FOR MIAMI-DADE COUNTY.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. IMPACT RESISTANT SHUTTERS NOT REQUIRED
5. DESIGN PRESSURE RATING SHALL BE AS FOLLOWS:
 - FOR 6'8" WOOD FRAMES; SEE TABLE ON SHEET 2
 - FOR 8'0" WOOD FRAMES; SEE TABLE ON SHEET 3

OUTSWING INSULATED STEEL DOOR
(Common to all frame conditions)

Door Leaf Construction:

Face sheets: 24 ga. (0.020") minimum thickness, Galvanized steel A-525 commercial quality - AKDQ per ASTM 620 with min. yield strength $F_y=23,300$ psi.
Core design: Expanded polystyrene with 1.0 to 1.25 lbs. density.
Construction: steel face sheets glued to expanded polystyrene (EPS), with wood rails and Laminated Veneered Lumber stiles or wood lock block reinforcement.

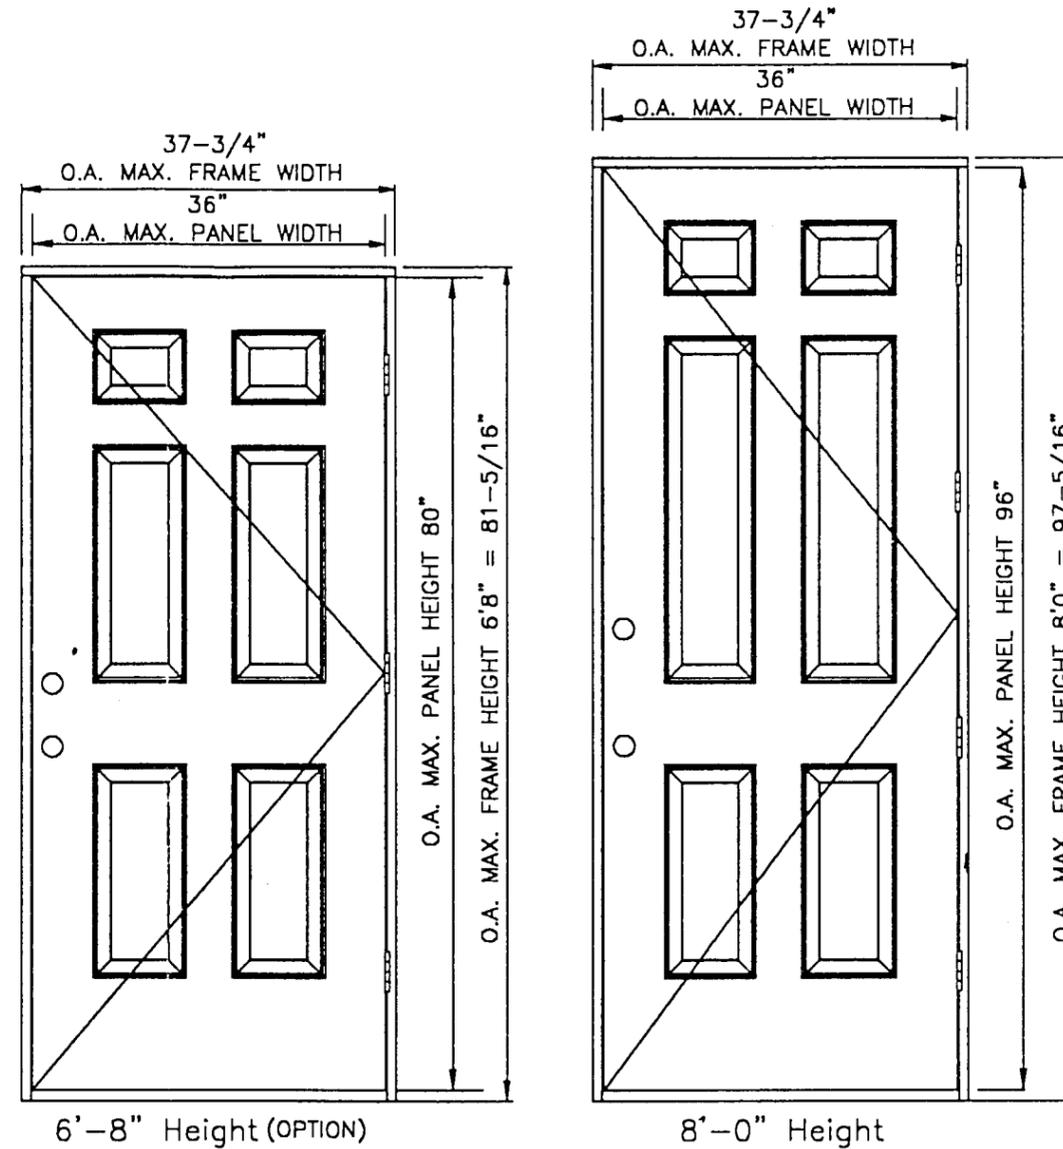

6 PANEL EMBOSSED DOORS
VIEWED FROM EXTERIOR
(SHOWN FOR CLARITY OF VIEW)

TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	COMMON (GENERAL NOTES, TYPICAL ELEVATION)
2	ANCHORS AND ELEVATIONS
3	ANCHORS, ELEVATIONS AND BILL OF MATERIALS
4	VERTICAL AND HORIZONTAL CROSS SECTIONS
5	COMMON (DOOR MODELS, LOCK DETAILS)

DESIGN PRESSURE RATING		
	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED	WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED
POSITIVE	+ 50.0 psf	+ 50.0 psf
NEGATIVE	- 53.0 psf	- 53.0 psf

PRODUCT RENEWED
as complying with the Florida Building Code
Acceptance No. 02-0712.06
Expiration Date AUG. 5, 2007
By *Maurice Perry*
Miami/Dade Product Control Division

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE *January 14, 2001*
BY *Maurice Perry*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. *00-1006.05*


JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT: OUTSWING OPAQUE INSULATED STEEL SINGLE DOOR IN WOOD FRAME
PART OR ASSEMBLY: ELEVATIONS AND GENERAL NOTES


NO.	DATE	BY	REVISIONS

RW BUILDING CONSULTANTS, INC.
813.684.3831

DATE: 9/25/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: DC9920
SHEET 1 OF 5

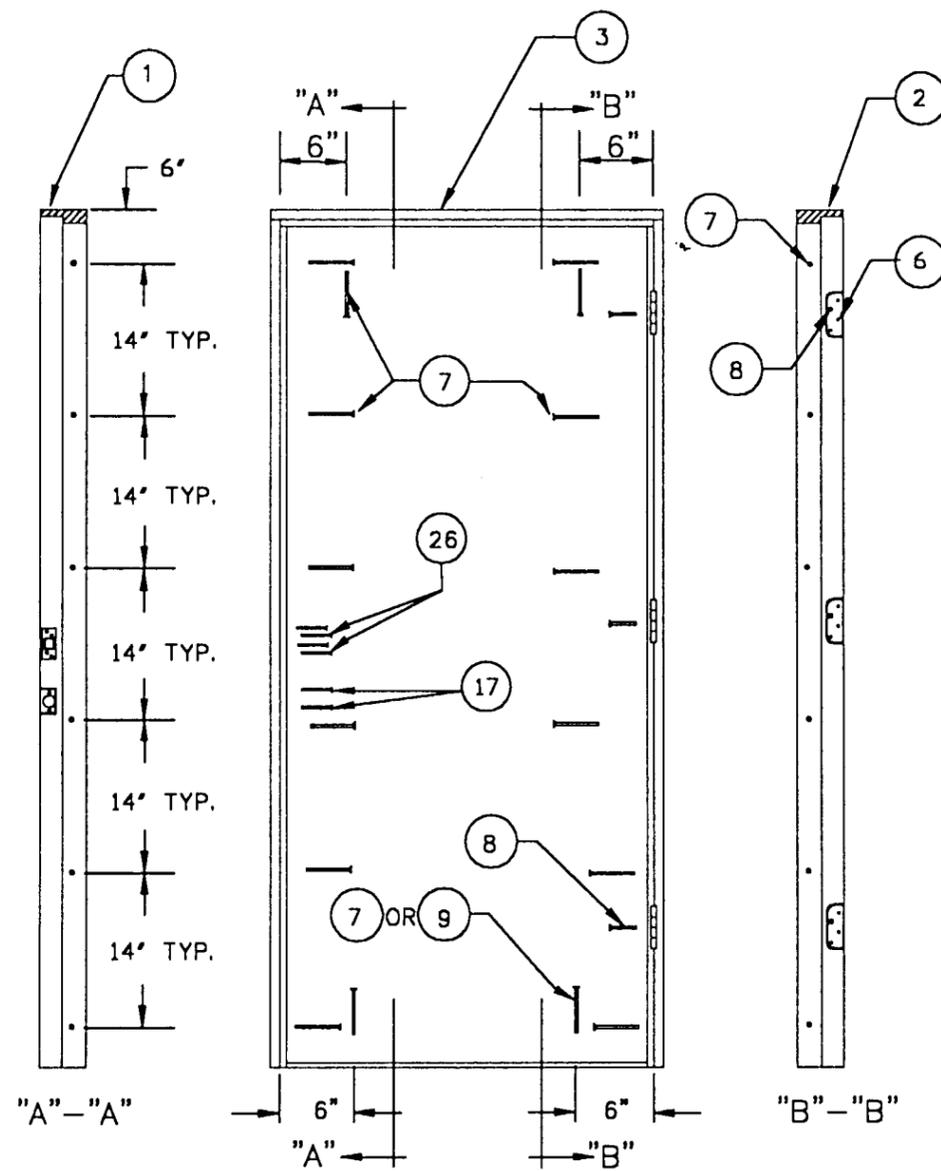

ANCHOR LOCATIONS

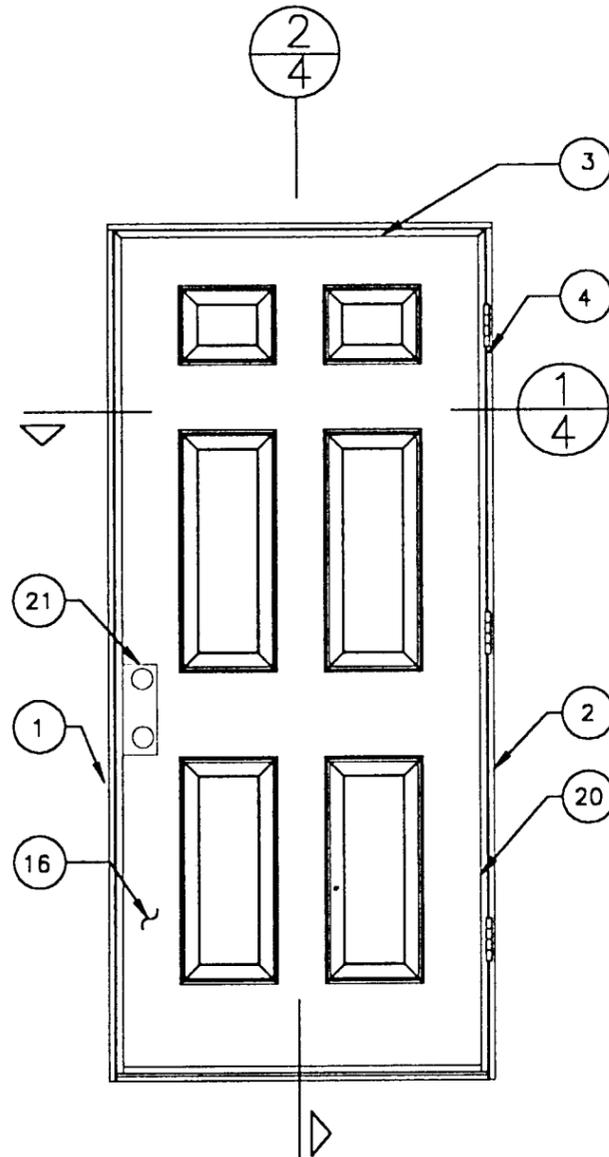

6'8" 6 PANEL DOOR
VIEWED FROM EXTERIOR
(SHOWN FOR CLARITY OF VIEW)

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT:
OUTSWING OPAQUE
INSULATED STEEL SINGLE
DOOR IN WOOD FRAME

PART OR ASSEMBLY:
ANCHORS
AND ELEVATIONS

NO.	DATE	REVISIONS	BY


RW BUILDING
CONSULTANTS, INC.
813.684.3831

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 02-0712-06
Expiration Date 05/5/2007


By Maurice Perry
Miami Dade Product Control
Division

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE January 11, 2001
BY Maurice Perry
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-1006-05

DATE: 9/25/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.:
DC9920
SHEET 2 OF 5

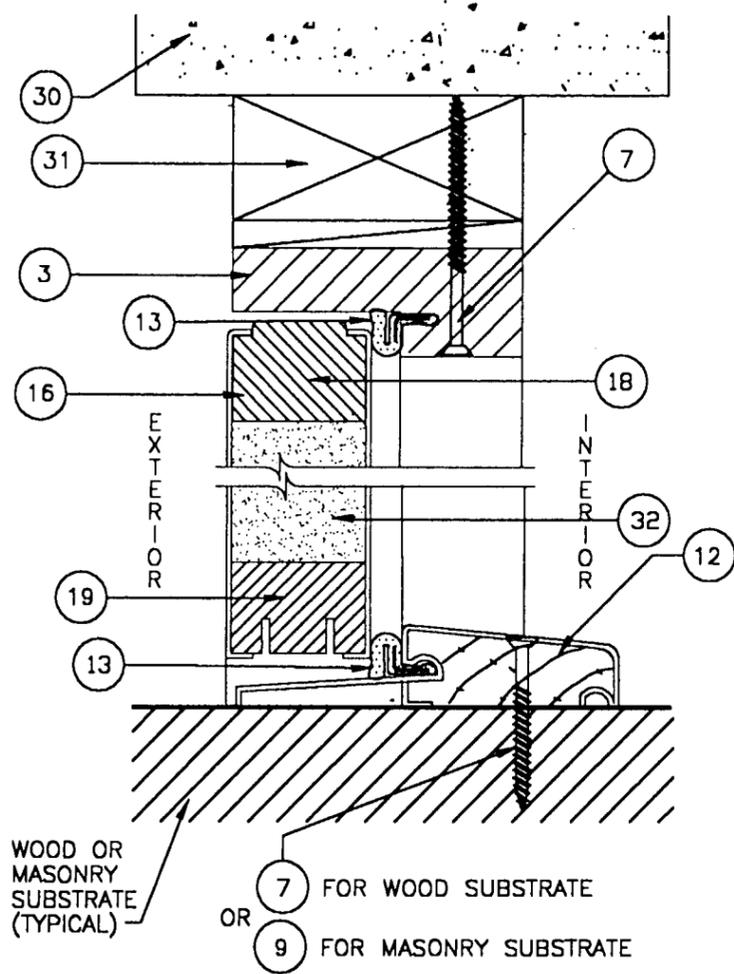

2 VERTICAL CROSS SECTION
4

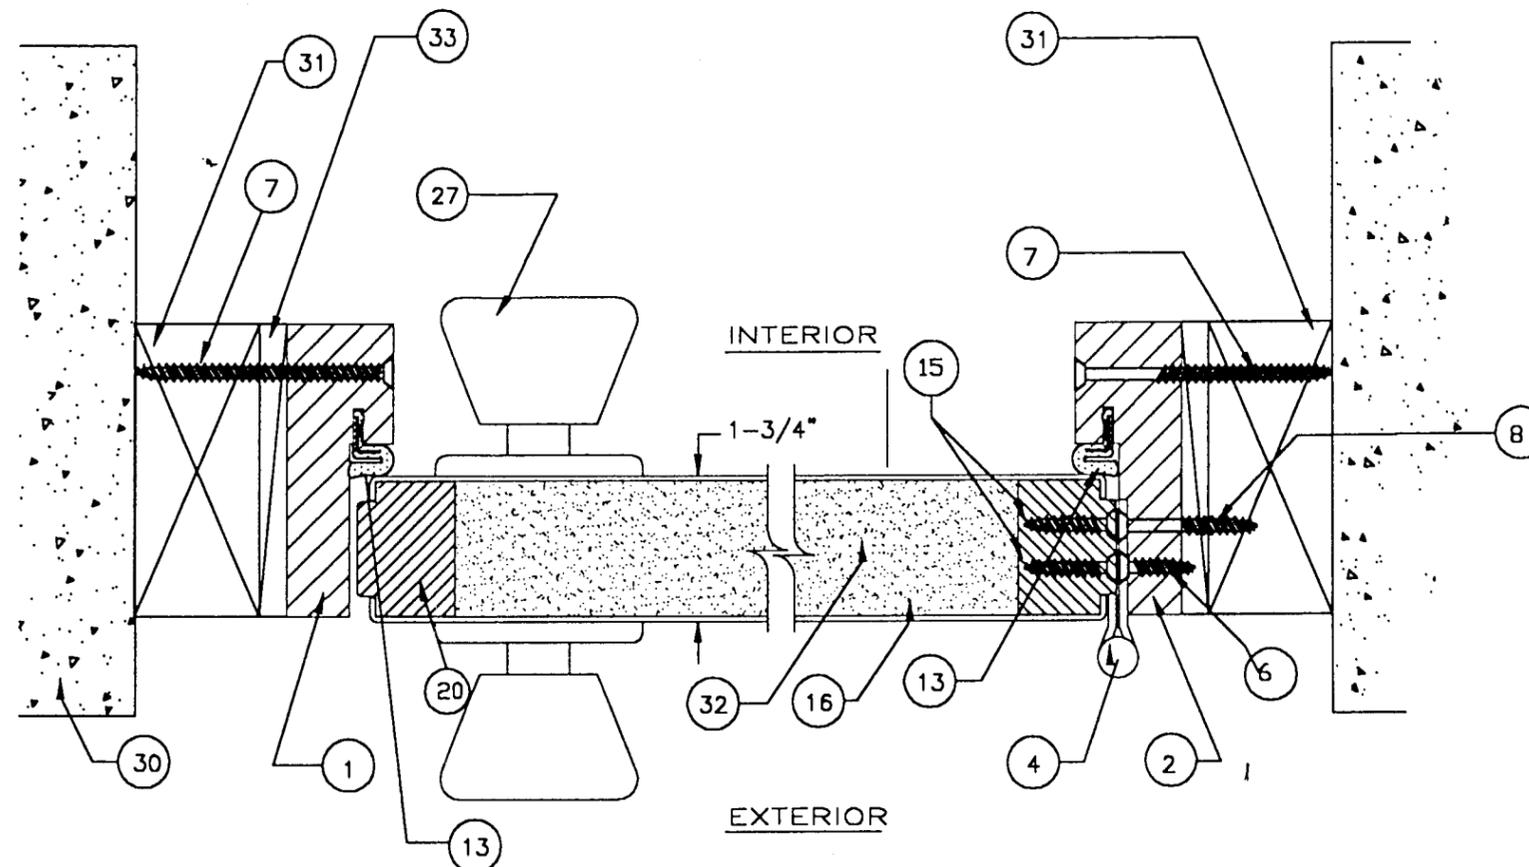

1 HORIZONTAL CROSS SECTION
4 (TYP. INSTALLATION INTO 2X WOOD BUCK)

GENERAL NOTE: ATTACHMENT OF WOOD SUB-BUCK TO MASONRY TO BE SPECIFIED BY ARCHITECT OF RECORD.

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT: OUTSWING OPAQUE INSULATED STEEL SINGLE DOOR IN WOOD FRAME
PART OR ASSEMBLY: VERTICAL AND HORIZONTAL CROSS SECTIONS



NO.	DATE	REVISIONS	BY

RW BUILDING CONSULTANTS, INC.
813.684.3831

PRODUCT RENEWED as complying with the Florida Building Code
Acceptance No 02-0712.06
Expiration Date AUG. 5, 2007
By *Manuel Cruz*
Miami Dade Product Control Division

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE *January 11, 2001*
BY *Manuel Cruz*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. *00-1006-08*

DATE: 9/25/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: DC9920
SHEET 4 of 5

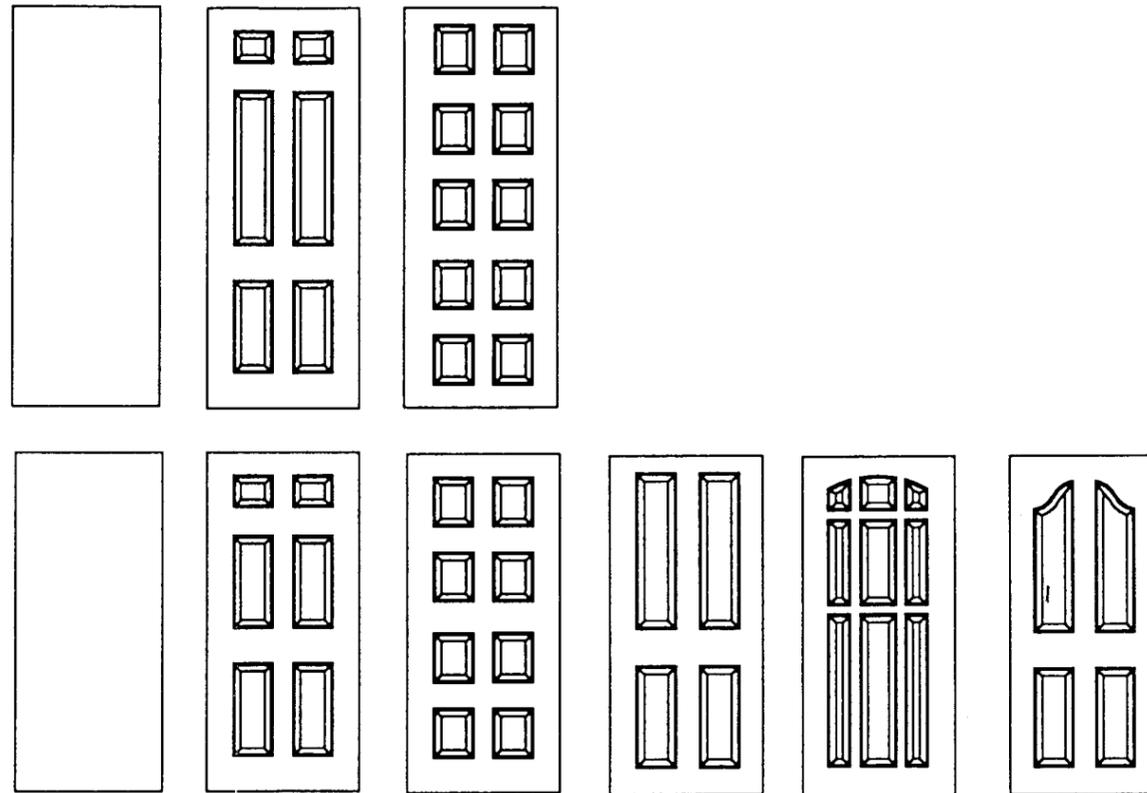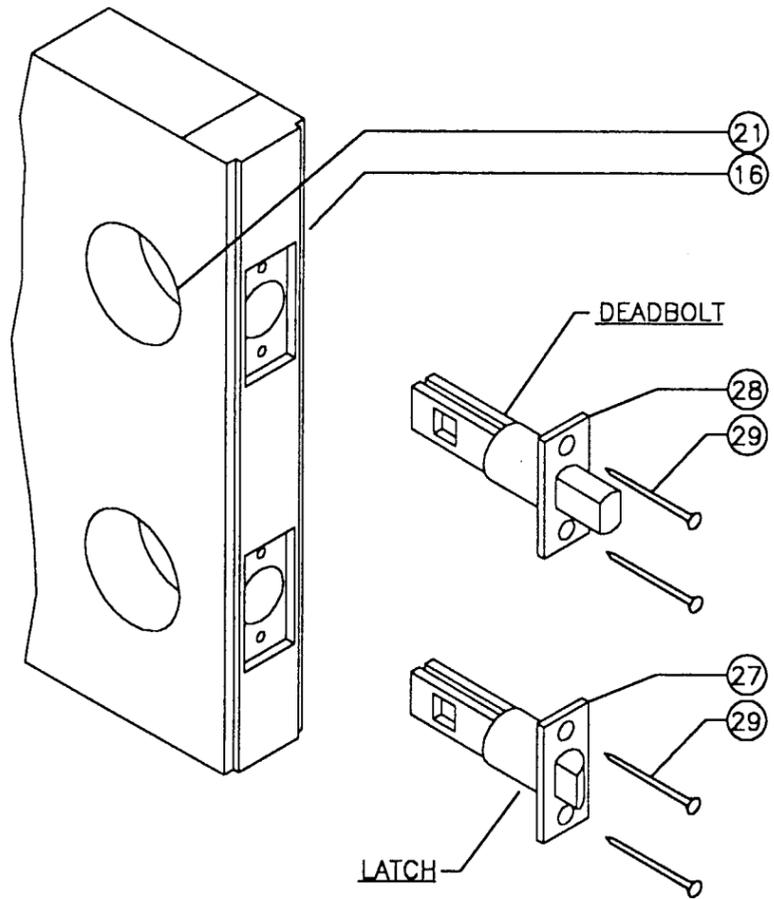

OPTIONAL FLUSH AND EMBOSSED DOOR MODELS

NOTE: DOOR PANELS NOT TO EXCEED 3'0 X 8'0

JELD-WEN, INC.
 31725 HIGHWAY 97 NORTH
 CHILOQUIN, OR. 97624
 PH. 541.783.2057

PRODUCT: OUTSWING OPAQUE
 INSULATED STEEL SINGLE
 DOOR IN WOOD FRAME
 PART OR ASSEMBLY:
 DOOR MODELS
 AND LOCK DETAILS

NO.	DATE	BY	REVISIONS

RW BUILDING
 CONSULTANTS, INC.
 813.684.3831

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 02-0712-06
 Expiration Date AUG-5, 2007
 By Miami Trade Product Control
 Division

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE January 11, 2001
 BY Maurice J. [Signature]
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 00-1006-05

DATE: 9/25/00
 SCALE: N.T.S.
 DWG. BY: TJH
 CHK. BY: RW
 DRAWING NO.: DC9920
 SHEET 5 OF 5