



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Jeld-Wen, Inc.
31725 Highway 97 North
Chiloquin, OR 97624**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Jeld-Wen Series "Nord/Morgan" Inswing Glazed Double Wood Door w/ Surfacebolts

APPROVAL DOCUMENT: Drawing No. S-2040, titled "Wood stile & rail door, Glazed 6-8/8-0 Inswing Double Doors" Sheets 1 through 7 of 7, prepared by R. W. Building Consultant Inc dated 07/24/00 and last revised on 06-27-02 by manufacturer, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 01-0206.26 and, consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by **Ishaq I. Chanda, P. E.**



**NOA No 02-0722.06
Expiration Date: September 20, 2004
Approval Date: September 19, 2002
Page 1**

Nord/Morgan/Nicolai Wood Door

6-8 AND 8-0 GLAZED INSWING
DOUBLE DOOR


GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE SOUTH FLORIDA BUILDING CODE 1994 EDITION FOR MIAMI-DADE COUNTY.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS ARE REQUIRED
5. DESIGNED PRESSURE RATING SEE TABLE PAGE 1.
6. THIS SYSTEM DOES NOT MEET THE WATER REQUIREMENTS IN MIAMI-DADE COUNTY.

RESIDENTIAL STILE & RAIL WOOD DOOR (Common to all frame conditions)

Frame Construction: The head and side jambs are finger jointed ponderosa pine measuring 4.625" x 1.25". The head and side jambs are mortised, butted and joined using (3) 16GA. 2" X 1/2" crown staples at the top corners. The inswing threshold is attached to the floor.

Door Panel Construction: The panel is a stile and rail construction. The stiles and rails are constructed from solid wood of either Douglas Fir or Western Hemlock. They are laminated with a .0625" thk. wood veneer of the following species: Douglas Fir, Western Hemlock, Ponderosa Pine, Northern Red Oak, Red Maple, Black Cherry, Yellow Poplar, True Hickory, True Mahogany, Black Walnut, & Red Alder. The veneer face sheet is glued to the stiles and rails. The top rail is connected to the perimeter stiles w/(2) .5" dia. min. x 4" long wooden dowels and the bottom rail is connected to the perimeter stile w/(3) .5" dia. min. x 4" long wooden dowels. The glazing is captured between the wood cap on the exterior and the wood glass stop on the interior. The panels are wet glazed using PRC 365 silicone.

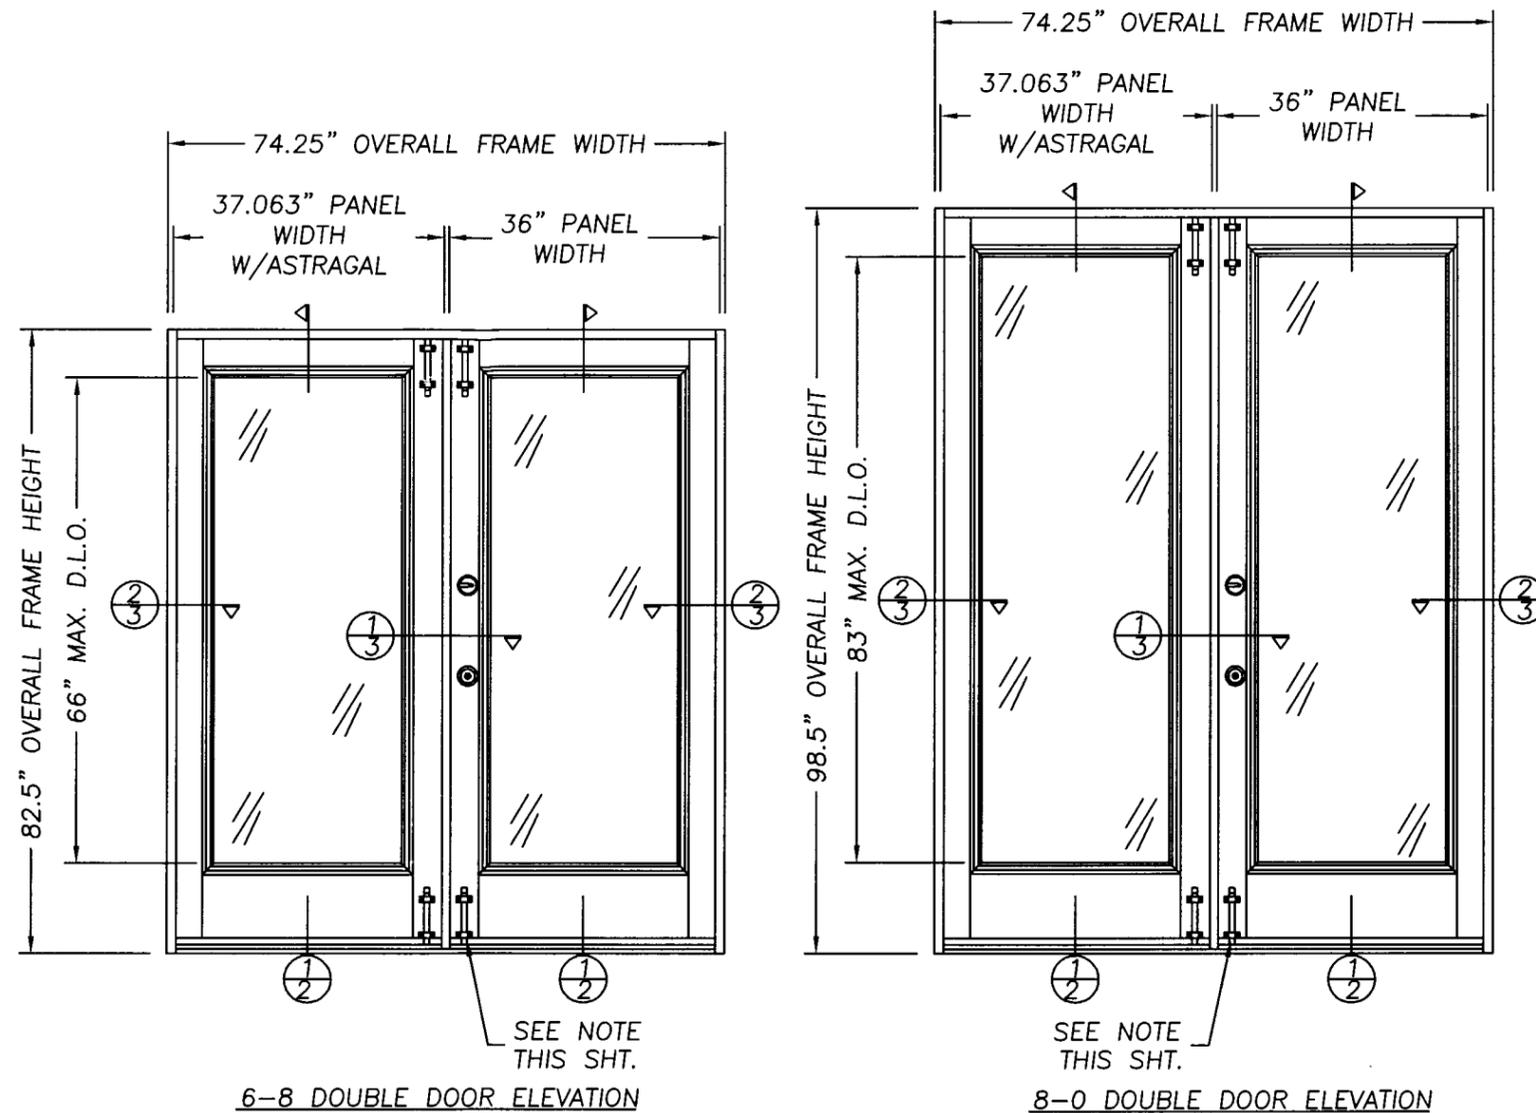

6-8 DOUBLE DOOR ELEVATION

8-0 DOUBLE DOOR ELEVATION

ALL MODELS ARE INSWING DOORS & VIEWED FROM INTERIOR

NOTE
THE SURFACE BOLTS ARE AN OPTION ON THE ACTIVE DOOR AND ARE USED TO ACHIEVE A HIGHER PRESSURE SEE SHT. 3 SECTION 1/3 & NOTE 2 SHT. 3 FOR SURFACE BOLT OPTIONS.
(SEE DESIGN PRESSURE TABLE)

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	COMMON (GENERAL NOTES, TYPICAL ELEVATION)
2	VERTICAL CROSS SECTION & B.O.M.
3	HORIZONTAL CROSS SECTIONS 1/3 & 2/3
4	ANCHORING LOCATIONS & DETAILS
5	RAIL DETAILS
6	UNIT COMPONENTS
7	DOOR MODELS

DESIGN PRESSURE RATING (INSWING DOORS) WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED			
DOOR SIZE	W/SURFACE BOLTS ON INACTIVE PANEL	W/SURFACE BOLTS ON BOTH PANEL	
6-8	+47.0psf -47.0psf	+65.0psf -70.0psf*	
8-0	+32.0psf -32.0psf	+60.0psf -60.0psf	

*NOTE: 6-8 TRUE DIVIDED MUNTIN LITE DOOR PANELS CANNOT EXCEED +65.0psf -65.0psf

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057


PRODUCT:
WOOD STILE & RAIL DOOR
GLAZED 6-8/8-0
INSWING DOUBLE DOOR
PART OR ASSEMBLY:
ELEVATIONS
AND GENERAL NOTES

NO.	DATE	BY	REVISIONS
3	06/27/02	KMN	GENERAL REVISION
2	08/24/08	TJH	GENERAL REVISION
1	04/04/01	TJH	GENERAL REVISION

RW BUILDING
CONSULTANTS, INC.
813.684.3831

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 02-0722.06
Expiration Date SEP 20, 2004
By Ishag I. Chanda
Miami Dade Product Control
Division

DATE: 7/24/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.:
S-2040
SHEET 1 OF 7

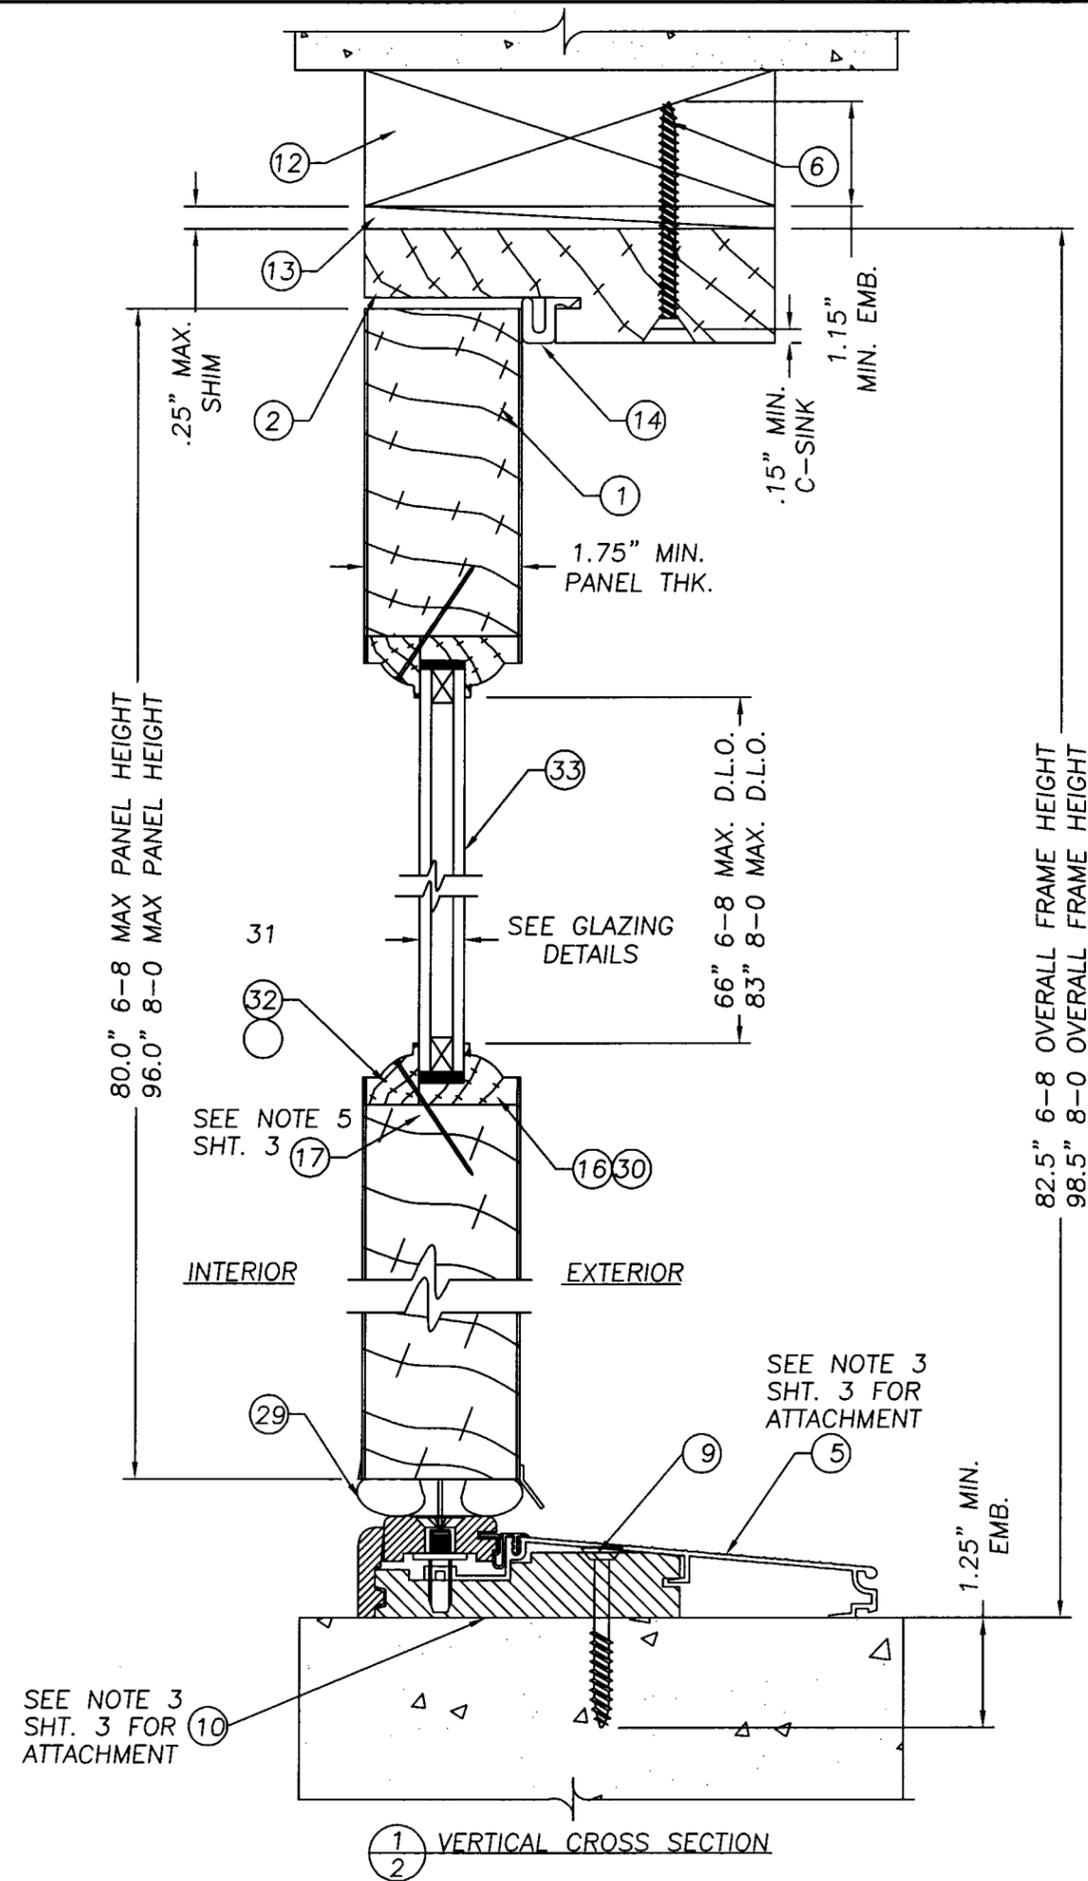

Item	DESCRIPTION	Material
1	NORD/MORGAN/NICOLAI STILE & RAIL 6-8/8-0 WOOD DOOR (DOUGLAS FIR, WESTERN HEMLOCK, PONDEROSA PINE, NORTHERN RED OAK, RED MAPLE, BLACK CHERRY, YELLOW POPLAR, TRUE HICKORY, TRUE MAHOGANY, BLACK WALNUT, & RED ALDER)	
2	HEAD JAMB (1 1/4" x 4 5/8" PONDEROSA PINE)	PINE
3	HINGE JAMB (1 1/4" x 4 5/8" PONDEROSA PINE)	PINE
4	(1) PIECE WOOD ASTRAGAL	PINE
5	INSWING ADJUSTABLE THRESHOLD (.051" WALL BY IMPERIAL)	ALUMINUM
6	#8 x 2 1/2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
7	KWIKSET TITAN SERIES 400 LOCK	
8	KWIKSET TITAN SERIES 720 DEADBOLT	
9	1/4" x 2 1/2" LG. TAPCON OR ITW BUILDEX TAPCON (PER CURRENT NOA) OR ELCO TAPCON (PER CURRENT NOA)	STEEL
10	SILICONE CAULK (CR LAWRENCE 33S)	SILICONE
11	NOT USED	-
12	2x WOOD BUCK	WOOD
13	1/4" MAX. SHIMS	WOOD
14	COMPRESSION WEATHERSTRIP (Q-LON QDS-650)	FOAM
15	#10 x 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
16	WOOD CAP FOR .50" THK. GLASS	PINE
17	BRAD TRIM NAIL 1 1/2" L.	STEEL
18	4" x 4" BUTT HINGE 12GA. (.089" MIN)	STEEL
19	#9 x 1" PHILLIPS FLATHEAD WOOD SCREW	STEEL
20	#8 x 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
21	SURFACE BOLT (IVES, .25" STEEL)	STEEL
22	SURFACE BOLT STRIKE PLATE (IVES, .125" STEEL)	STEEL
23	1/4" CARRIAGE BOLT x 3" LG.	STEEL
24	1/4" JAMB NUT	STEEL
25	#10 x 2 1/2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
26	NOT USED	-
27	NOT USED	-
28	NOT USED	-
29	INSWING VINYL DOOR BOTTOM SWEEP	VINYL
30	WOOD CAP FOR .125" THK. GLASS	PINE
31	WOOD GLASS STOP FOR .50" THK. GLASS	PINE
32	WOOD GLASS STOP FOR .125" THK. GLASS	PINE
33	1/2" INSULATED TEMPERED GLASS (BY PPG) 1/8" TEMPERED GLASS (BY PPG)	GLASS GLASS
34	GLAZING COMPOUND (PRC 365 BY DE-SOTO INTER.)	SILICONE
35	BRAD TRIM NAIL 3/4" L.	STEEL
36	TRUE DIVIDED GLASS GLAZING STOP	WOOD

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057


PRODUCT:
WOOD STILE & RAIL DOOR
GLAZED 6-8/8-0
INSWING DOUBLE DOOR
PART OR ASSEMBLY:
VERTICAL CROSS SECTION
& BILL OF MATERIALS

NO.	DATE	BY	REVISIONS
3	06/27/02	KMN	GENERAL REVISION
2	08/24/01	TJH	GENERAL REVISION
1	04/04/01	TJH	GENERAL REVISION


RW BUILDING
CONSULTANTS, INC.
813.684.3831

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 02-0722-06
Expiration Date SEP 30, 2004
By Ishaq Chanda
Miami Dade Product Control
Division

DATE: 7/24/00
SCALE: 1/2" = 1"
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2040
SHEET 2 OF 7

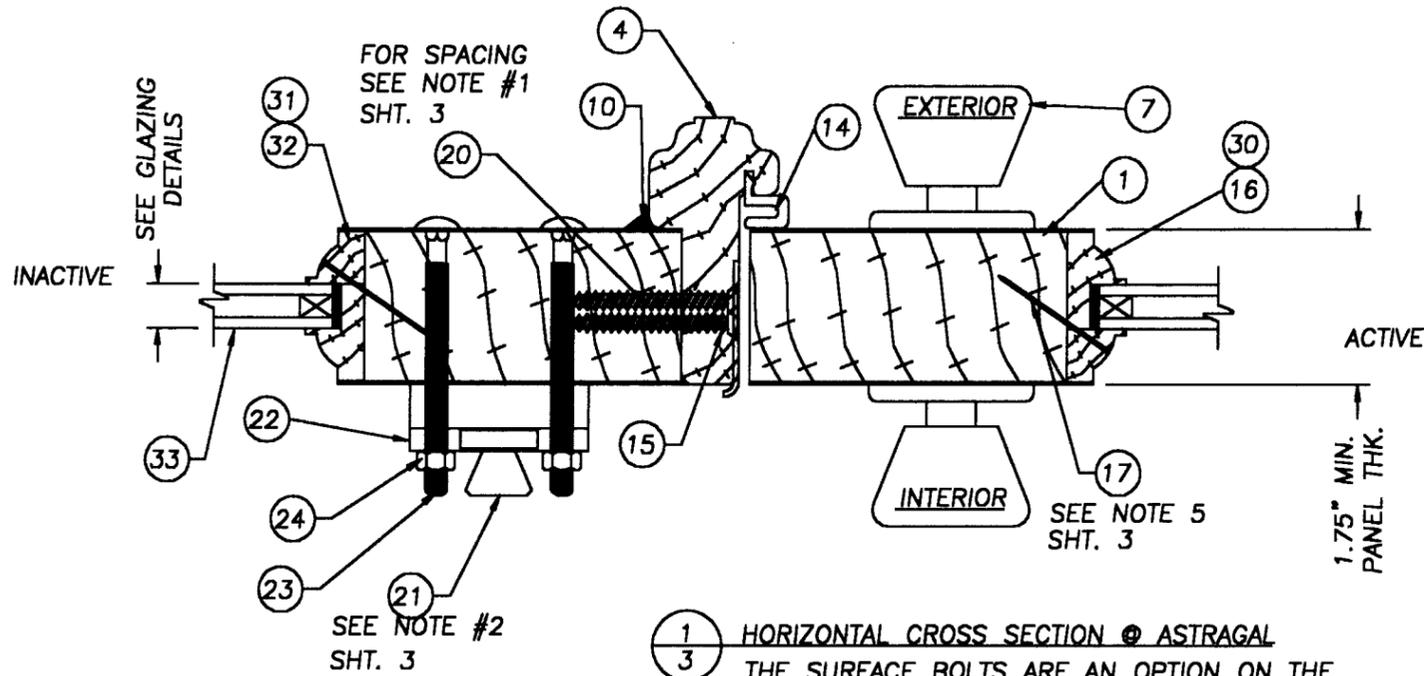

1
3 HORIZONTAL CROSS SECTION @ ASTRAGAL
THE SURFACE BOLTS ARE AN OPTION ON THE ACTIVE DOOR TO ACHIEVE HIGHER PRESSURES SEE NOTE 2 SHEET 3 (SEE DESIGN PRESSURE TABLE)

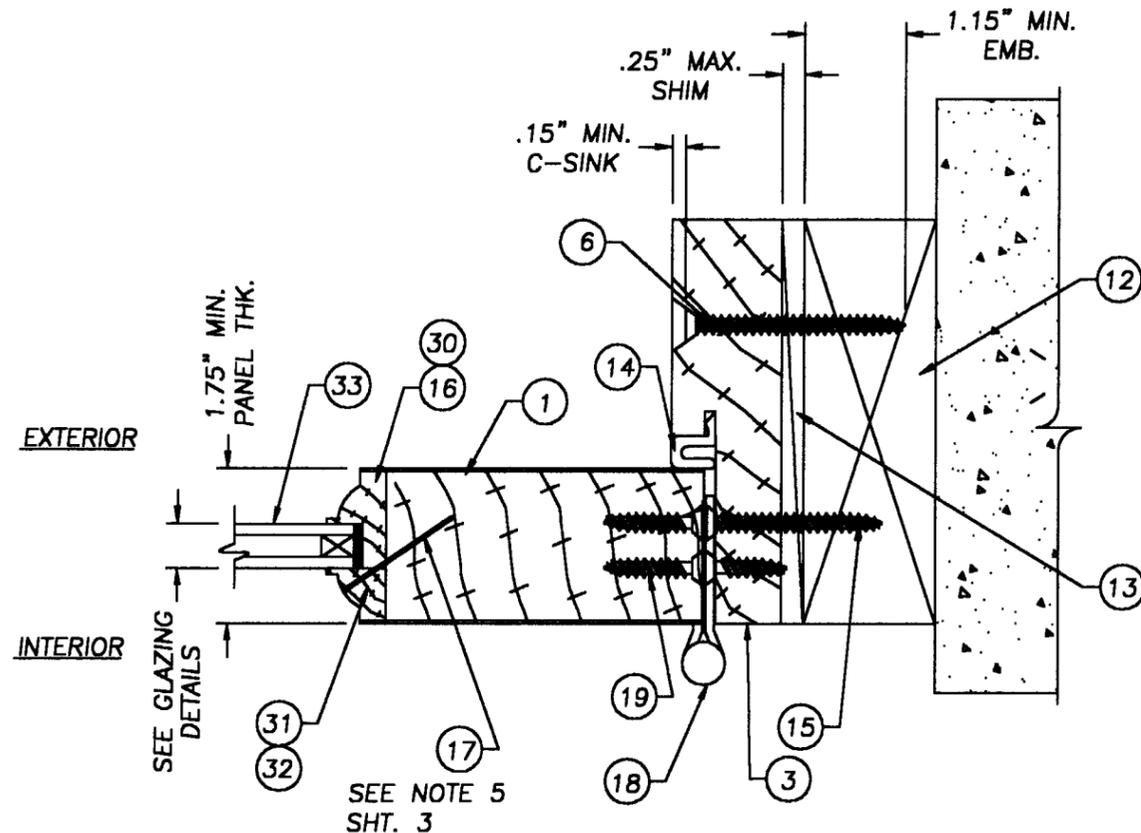

2
3 HORIZONTAL CROSS SECTION @ HINGE JAMB TO BUCK

NOTES: (TYP. TO ALL FRAME CONFIGURATIONS)

1. SPACING FOR ITEM #20 (#8 x 2" SCREW) TO ATTACH THE WOOD ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS: FOR THE 6-8 UNIT TOP DOWN; 3", 12" & 21", FOR THE 8-0 UNIT TOP DOWN; 3", 14", 25" & 36". THE SPACING FROM THE BOTTOM UP IS THE SAME FOR BOTH UNITS; 3", 13 3/8" & 24 1/8".
2. THE SURFACE BOLT IS INSTALLED ON BOTH THE ACTIVE AND INACTIVE DOOR, AT THE TOP AND BOTTOM. IT IS NOT SHOWN ON THE ACTIVE DOOR IN SECTION 1/3 FOR CLARITY. SURFACE BOLTS ON THE DOORS ARE AN OPTION TO ACHIEVE HIGHER DESIGN PRESSURES. SEE DESIGN PRESSURE TABLE.
3. THE THRESHOLD IS NOT ATTACHED TO THE FRAME, IT IS NOTCHED AND ATTACHED TO THE FLOOR WITH ITEM #26 1/4" x 2 3/4" TAPCON AND #10 (CR LAWRENCE 33S SILICONE CAULK). APPLY A CONTINUOUS BEAD .125" THK. x .375" W. AROUND ALL (4) OUTER EDGES IN THE MIDDLE THE ENTIRE LENGTH OF THE THRESHOLD, .125" THK. x .375" W.
4. THE TOP CORNERS OF THE DOOR FRAME, ARE STAPLED TOGETHER USING (3) 16GA. x 2" LG. x 1/2" CROWN STAPLES.
5. SPACING FOR ITEM #17 IS A MAX. OF 12" O.C.

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT:
WOOD STILE & RAIL DOOR
GLAZED 6-8/8-0
INSWING DOUBLE DOOR
PART OR ASSEMBLY:
HORIZONTAL CROSS
SECTIONS 1/3 & 2/3


NO.	DATE	BY	REVISIONS
2	08/24/01	TJH	GENERAL REVISION
1	04/04/01	TJH	GENERAL REVISION

RW BUILDING
CONSULTANTS, INC.
813.684.3831


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 02-0722-06
Expiration Date SEP 20, 2004
By Ishaq I. Chanda
Miami Dade Product Control
Division

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE SEP 20, 2001
BY Ishaq I. Chanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0206-26


DATE: 7/24/00
SCALE: 1/2" = 1"
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2040
SHEET 3 OF 7

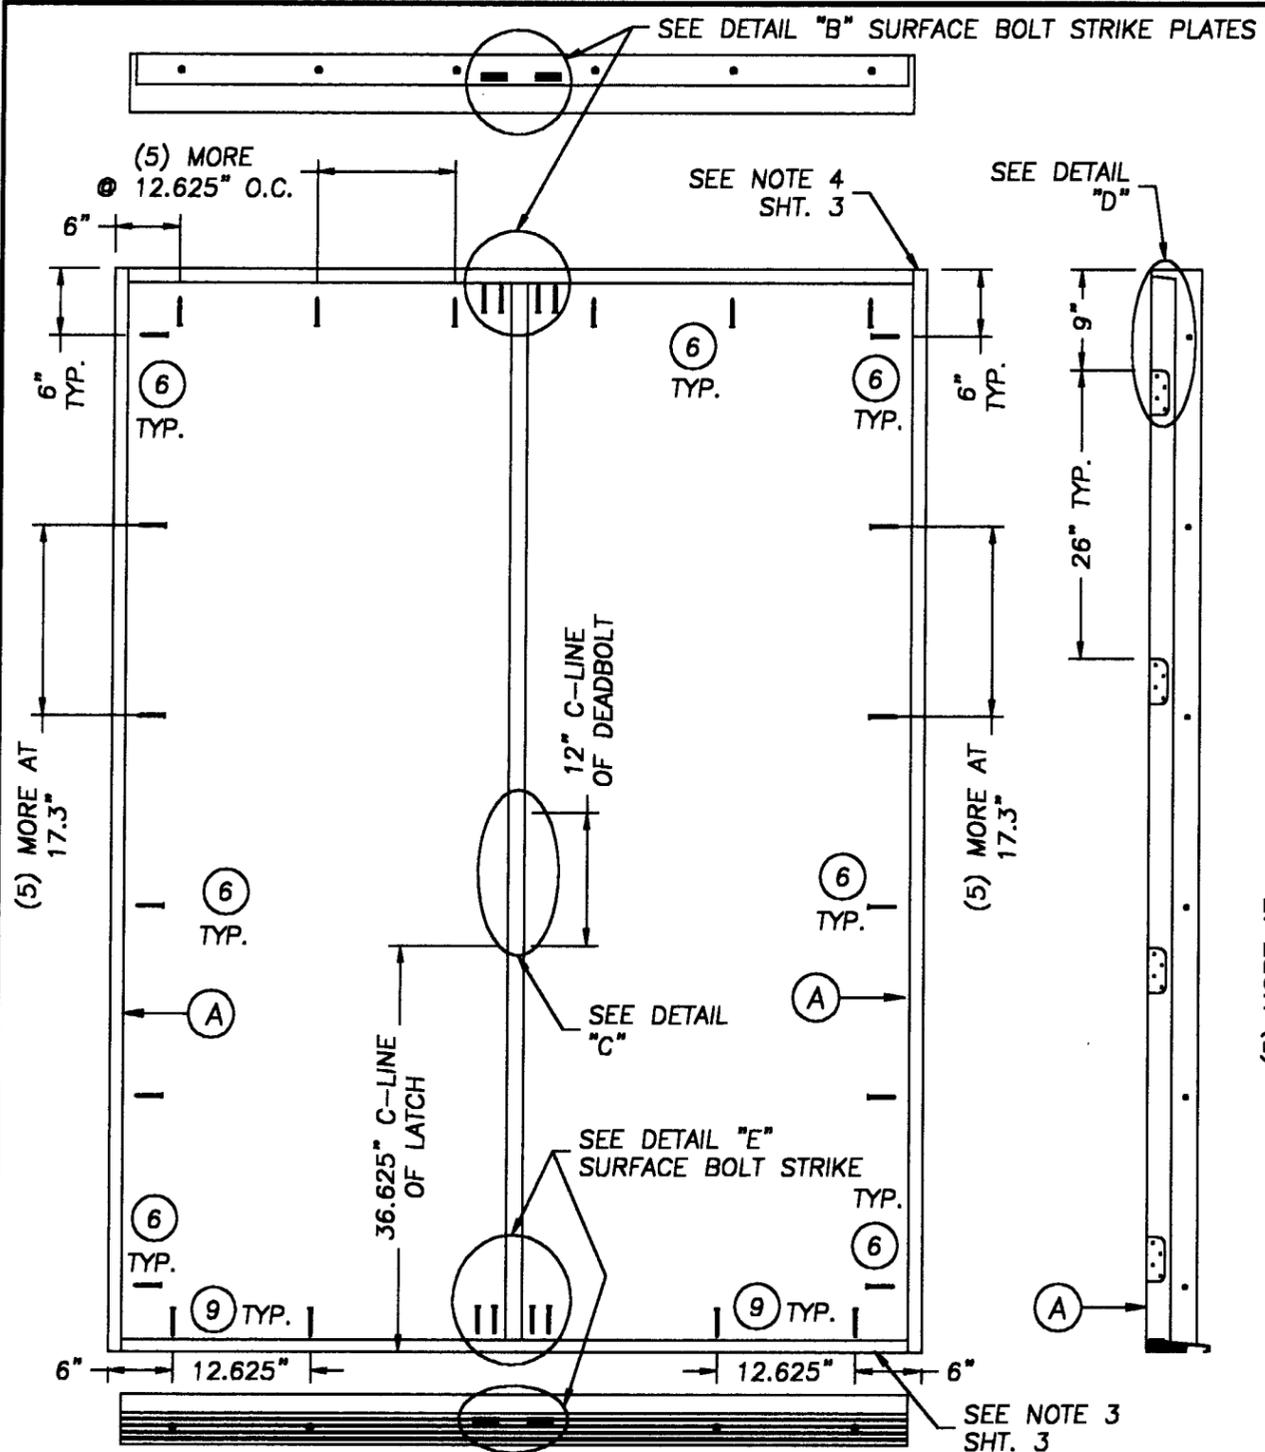


8-0 ANCHORING LOCATIONS

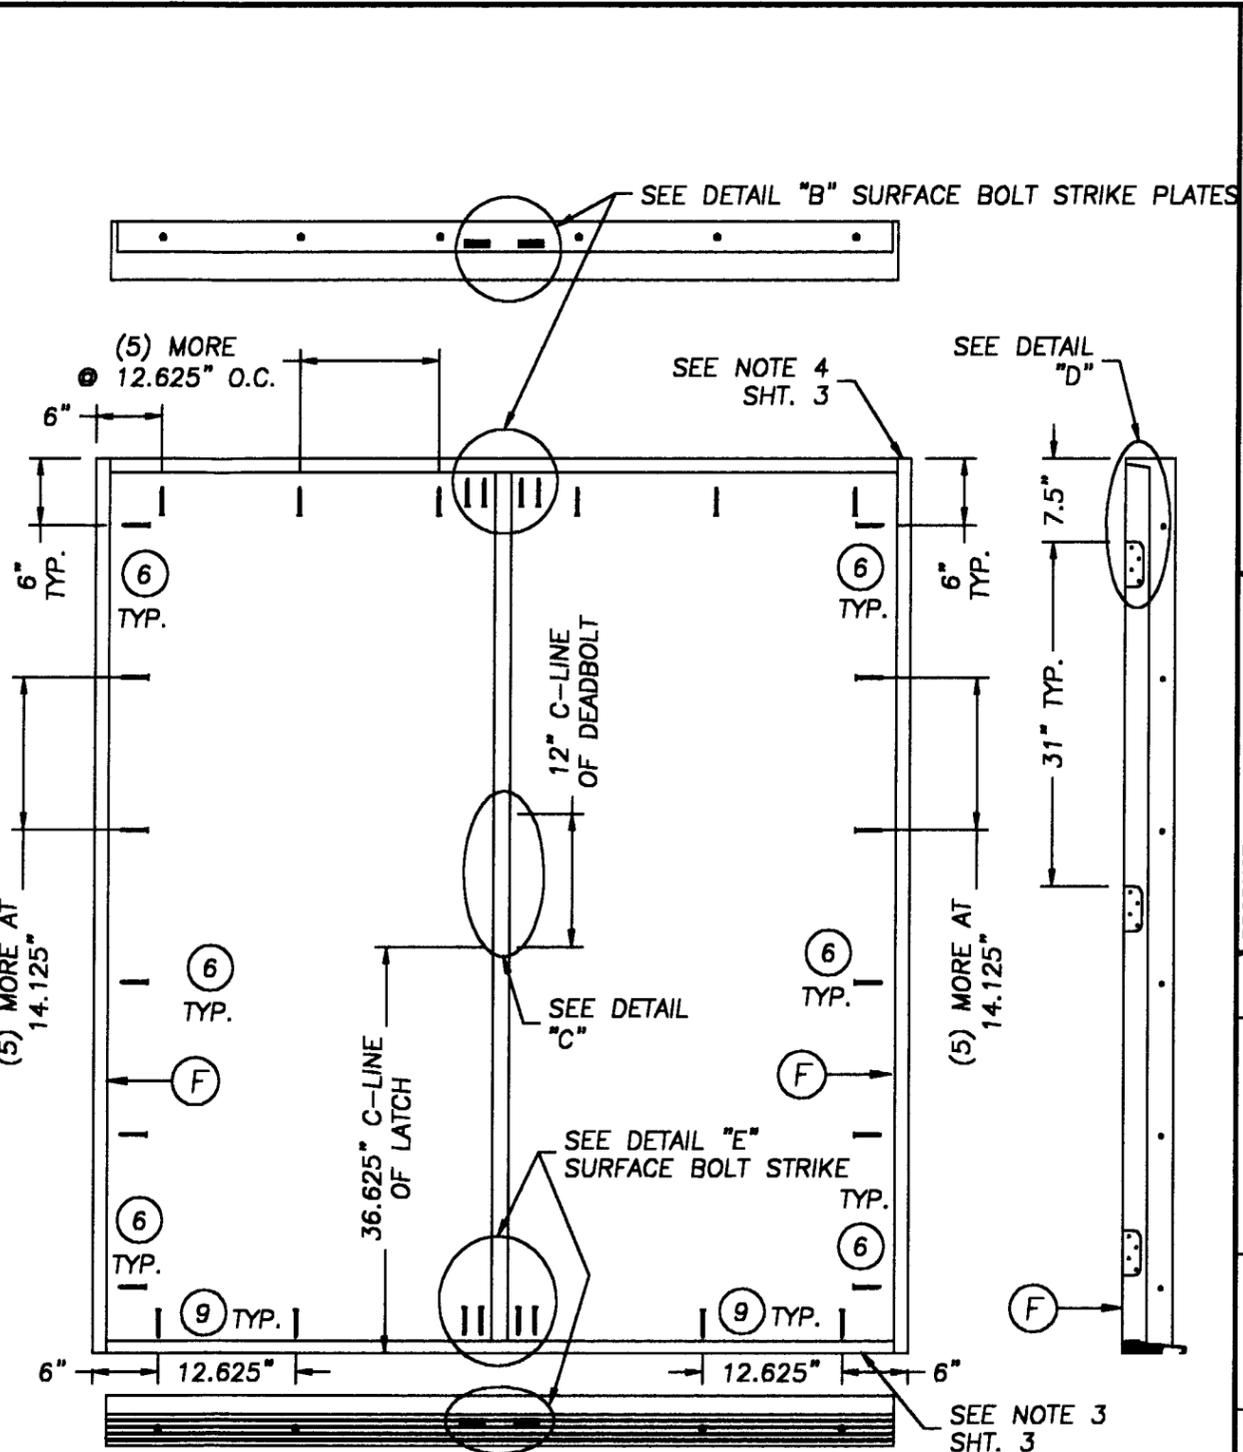


6-8 ANCHORING LOCATIONS




DETAIL "B"
SURFACE BOLT STRIKE PLATE

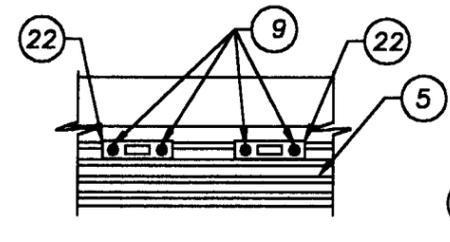

DETAIL "E"
SURFACE BOLT STRIKE PLATE

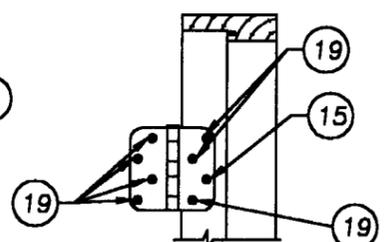

DETAIL "D"

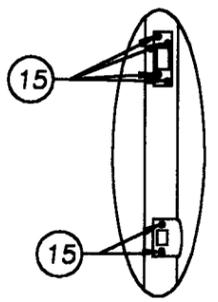

DETAIL "C"
FOR ITEM #4

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT:
WOOD STILE & RAIL DOOR
GLAZED 6-8/B-0
INSWING DOUBLE DOOR
PART OR ASSEMBLY:
ANCHORING LOCATIONS
& DETAILS


NO.	DATE	REVISIONS	BY
2	08/24/01	GENERAL REVISION	TJH
1	04/04/01	GENERAL REVISION	TJH

RW BUILDING
CONSULTANTS, INC.
813.684.3831


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 02-0222-06
Expiration Date, SEP 20, 2004
By Ishag I. Lhanda
Miami Dade Product Control
Division

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE SEP 20, 2001
BY Ishag I. Lhanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0206-26

DATE: 7/24/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2040
SHEET 4 OF 7

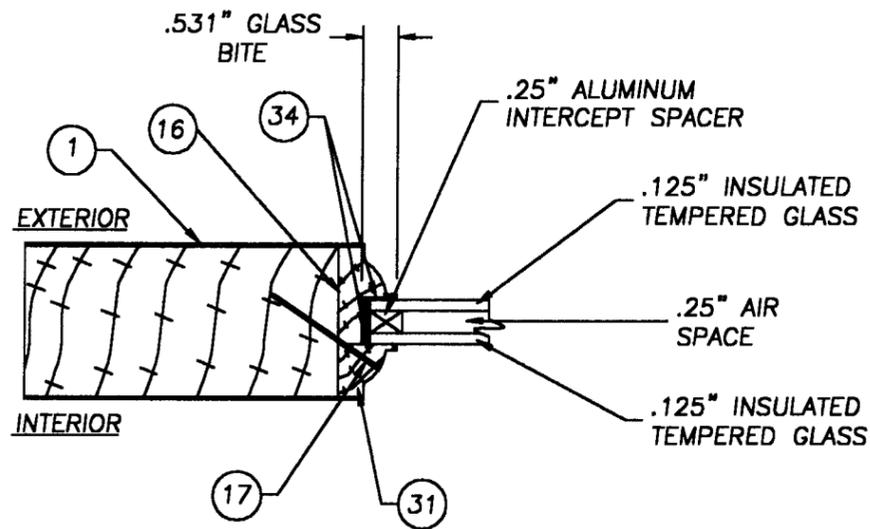


**.50" INSULATED TEMPERED GLASS
GLAZING DETAIL**
SCALE: 1/2" = 1"

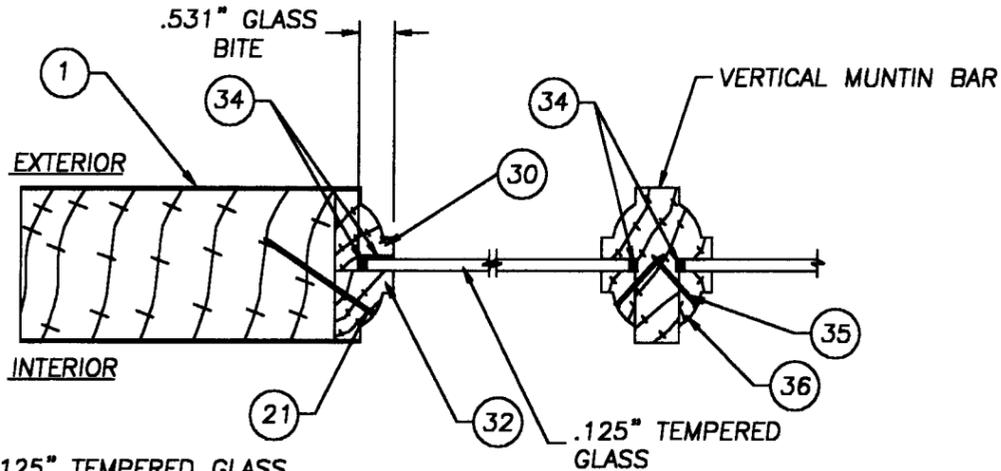


**.125" TEMPERED GLASS
GLAZING DETAIL**
SCALE: 1/2" = 1"


NOTE:
THE MULTI-LITE DOOR PANEL
IS MADE UP OF TRUE
DIVIDED GLASS PANELS.




TRUE DIVIDED GLASS GLAZING STOP
SCALE: FULL

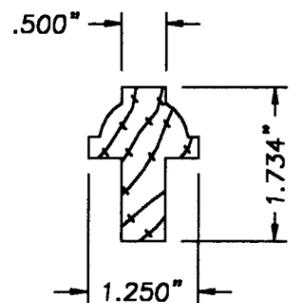

VERTICAL MUNTIN BAR DETAIL
SCALE: 1/2" = 1"

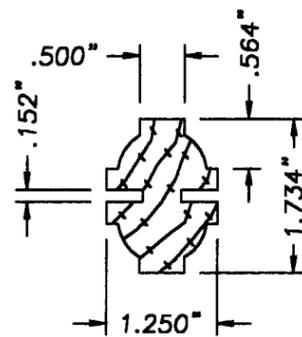

CENTER BAR DETAIL
SCALE: 1/2" = 1"

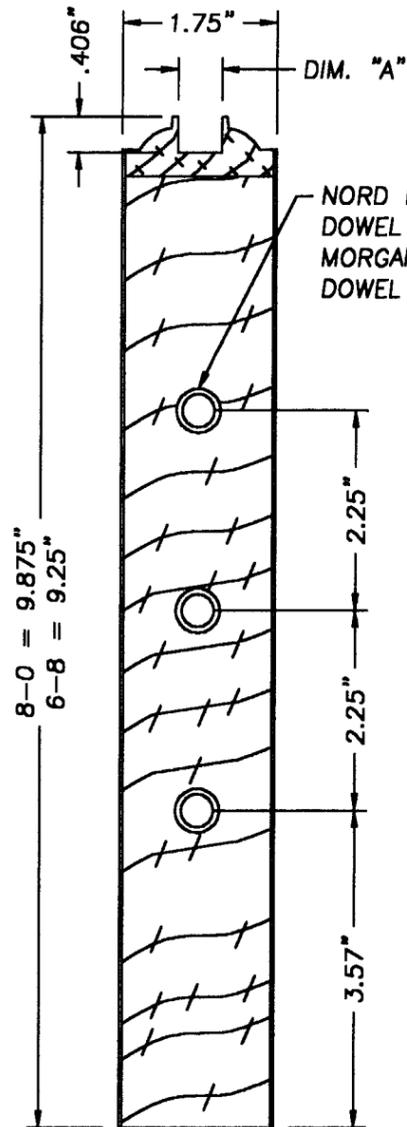


BOTTOM RAIL
SCALE: 1/2" = 1"


NORD DOOR .50" WOOD
DOWEL x 4.0" LG., 2PLCS
MORGAN/NICOLAI DOOR .625" WOOD
DOWEL x 4.0" LG., 2PLCS

DIMENSION "A" CHART	
OPENING FOR	DIM. "A"
1/8" GLASS	.152"
1/2" GLASS	.527"

NORD DOOR HOLE FOR .50" WOOD
DOWEL x 4.0" LG., 2PLCS
MORGAN/NICOLAI DOOR HOLES FOR
.625" WOOD DOWEL x 4.0" LG., 2PLCS

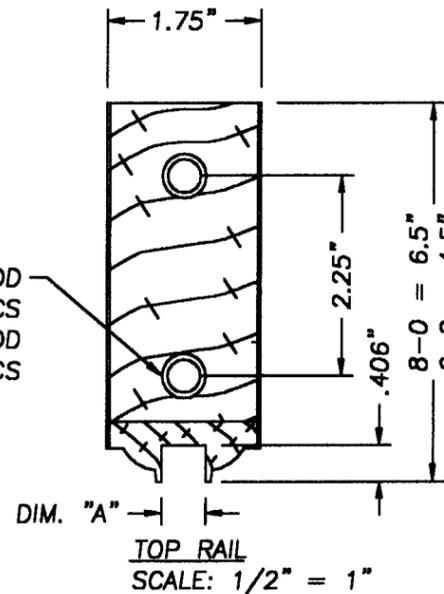

TOP RAIL
SCALE: 1/2" = 1"

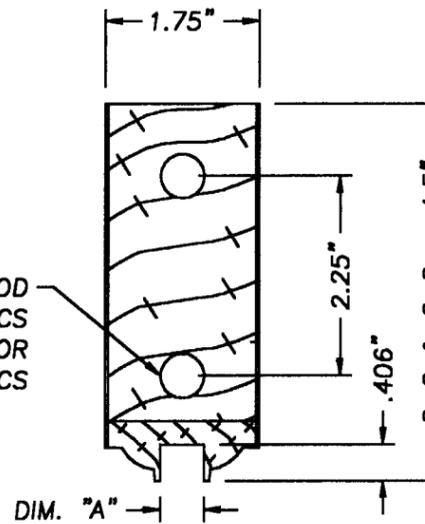

SIDE STILE
SCALE: 1/2" = 1"

NOTE:
DOWELS ARE GLUED AND PRESSED 2.0" INTO
THE RAILS AND STILES AT PANEL ASSEMBLY.

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT:
WOOD STILE & RAIL DOOR
GLAZED 6-8/8-0
INSWING DOUBLR DOOR

PART OR ASSEMBLY:
GLAZING DETAILS,
& RAIL DETAILS

NO.	DATE	BY	REVISIONS
2	08/24/01	TJH	GENERAL REVISION
1	04/04/01	TJH	GENERAL REVISION


RW BUILDING
CONSULTANTS, INC.
813.684.3831

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 02-0722-06
Expiration Date SEP 20, 2004


By: Ishag J. Chauda
Miami Dade Product Control
Division

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE SEP 20, 2001
BY Ishag J. Chauda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0206-26


DATE: 7/24/00
SCALE: AS NOTED
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2040
SHEET 5 OF 7

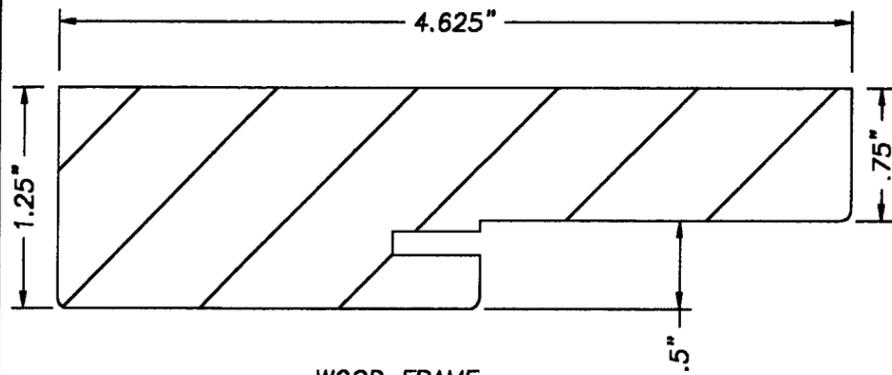


WOOD FRAME

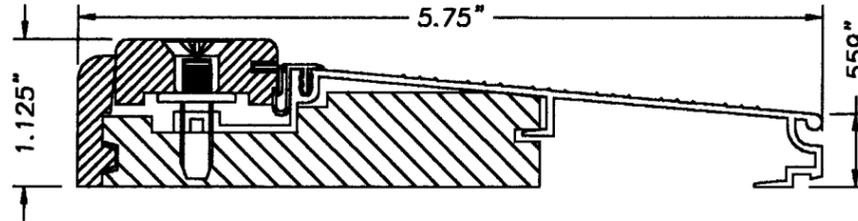


ADJUSTABLE INSWING THRESHOLD
.051" WALL THK.

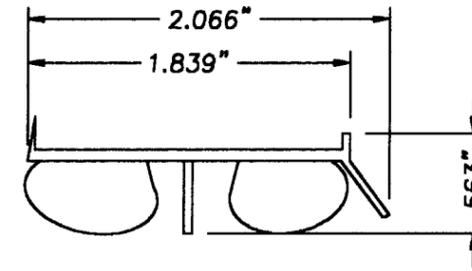


EXTRUDED VINYL INSWING
DOOR BOTTOM SWEEP

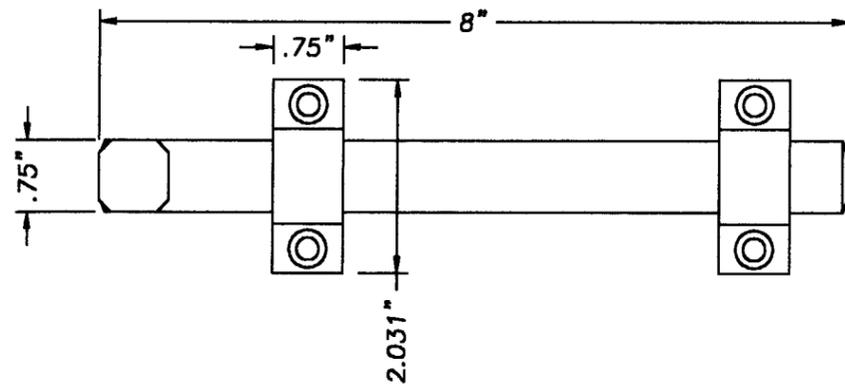


SURFACE BOLT (IVES. MODEL 455 .25" STEEL)

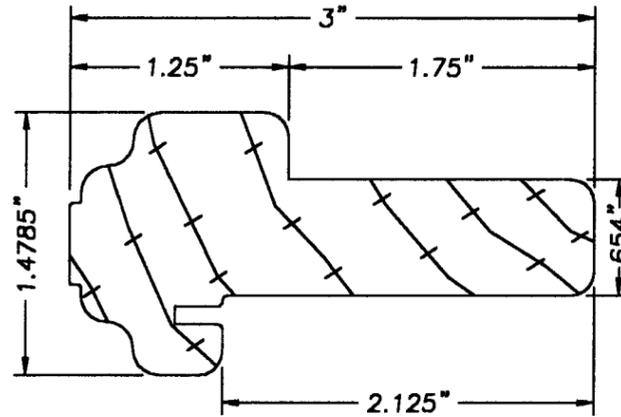

(1) PIECE WOOD ASTRAGAL

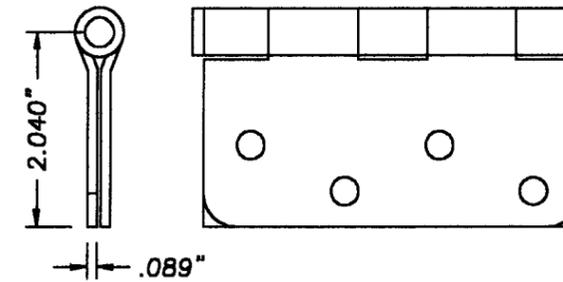

4 x 4 DOOR HINGE

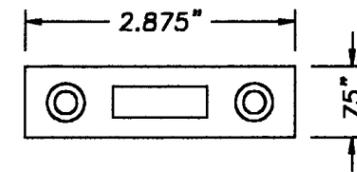

SURFACE BOLT STRIKE (IVES .125" STEEL)

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT:
WOOD STILE & RAIL DOOR
GLAZED 6-8/8-0
INSWING DOUBLE DOOR
PART OR ASSEMBLY:
UNIT COMPONENTS

NO.	DATE	REVISIONS	BY
2	08/24/01	GENERAL REVISION	TJH
1	04/04/01	GENERAL REVISION	TJH

RW BUILDING
CONSULTANTS, INC.
813.684.3831


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 02-0722.06
Expiration Date SEP 20, 2004
By Ishaq I. Chanda
Miami Dade Product Control
Division

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE SEP 20, 2001
BY Ishaq I. Chanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0206.26

DATE: 7/24/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2040
SHEET 6 OF 7



8-0 DOOR MODELS
SEE NOTE THIS SHEET

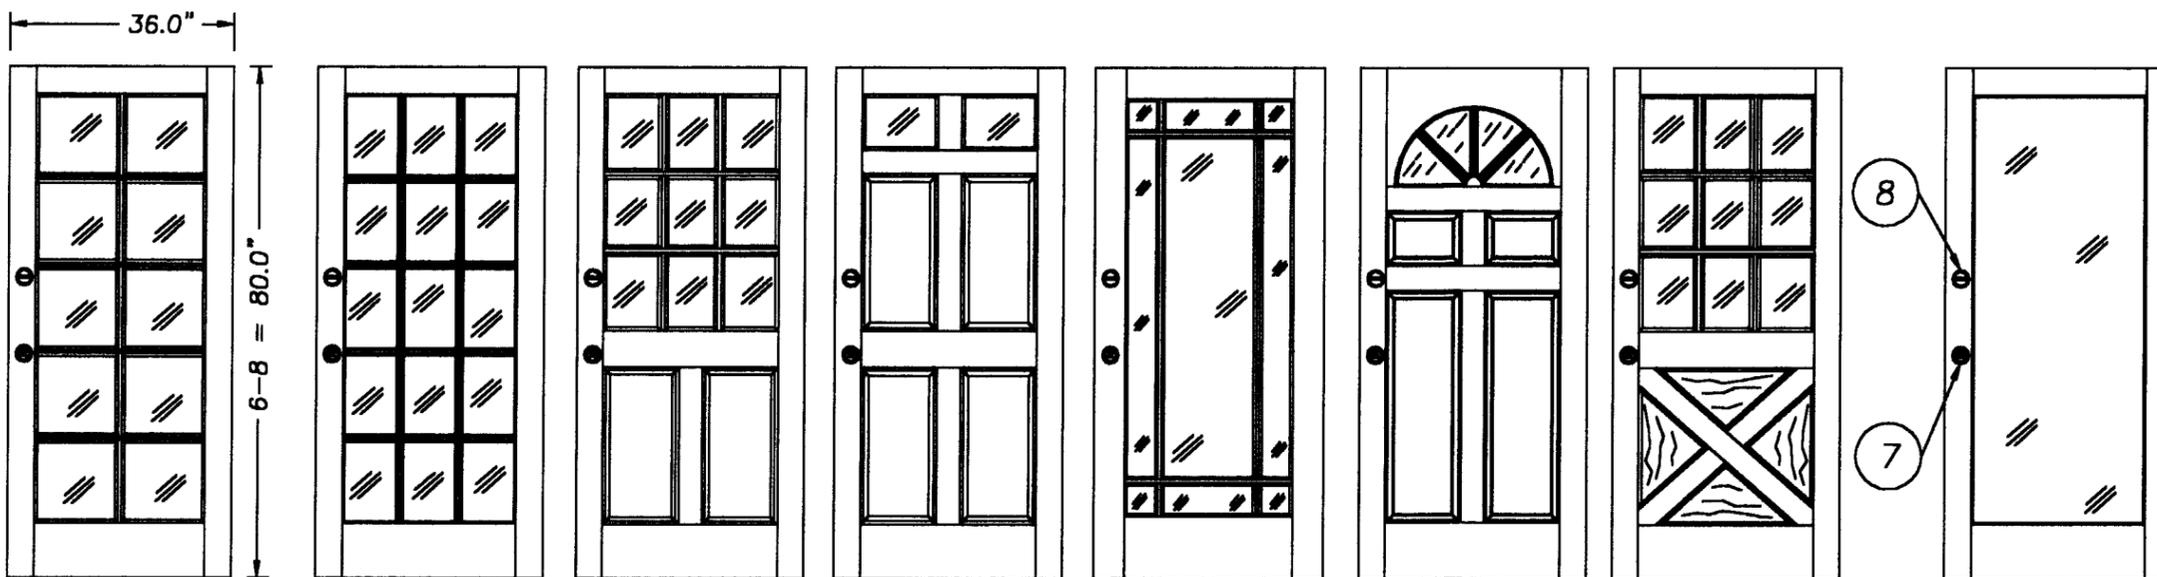

6-8 DOOR MODELS N.T.S.
SEE NOTE THIS SHEET

NOTE:
THE MULTI-LITE DOOR PANEL
IS MADE UP OF TRUE DIVIDED
GLASS PANELS. THE MAX. DESIGN
PRESSURE FOR THE 6-8 DOORS W/TRUE
DIVIDED GLASS IS +65 psf -65 psf
SEE DESIGN PRESSURE TABLE SHT. 1.

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. <u>02-0722-06</u> Expiration Date <u>SEP 20, 2004</u> By <u>Ishay J. Chanda</u> Miami Dade Product Control Division	APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE DATE <u>SEPTEMBER 20, 2001</u> BY <u>Ishay J. Chanda</u> PRODUCT CONTROL DIVISION BUILDING CODE COMPLIANCE OFFICE ACCEPTANCE NO. <u>01-0206-26</u>	DATE: 7/24/00
		SCALE: N.T.S.
		DWG. BY: TJH
		CHK. BY: RW
		DRAWING NO.: S-2040
		SHEET 7 OF 7

PRODUCT:
WOOD STILE & RAIL DOOR
GLAZED 6-8/8-0
INSWING DOUBLE DOORS
PART OR ASSEMBLY:
DOOR MODELS

NO.	DATE	REVISIONS	BY
2	08/24/01	GENERAL REVISION	TJH
1	04/04/01	GENERAL REVISION	TJH

RW BUILDING
CONSULTANTS, INC.
813.684.3831

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILQUIN, OR. 97624
PH. 541.783.2057