



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

---

**Jeld-Wen, Inc.  
31725 Highway 97 North  
Chiloquin, OR 97624**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION:** The Jeld-Wen Series "Nord/Morgan"- Outswing Opaque Double Wood Door w/ surface bolts

**APPROVAL DOCUMENT:** Drawing No. S-2035, titled "Wood stile & rail door, Opaque 6-8/8-0 Outswing" Sheets 1 through 7 of 7, prepared by R. W. Building Consultant Inc dated 07/20/00 and last revised on 07-15-02 by manufacturer, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING:** None

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 00-0915.06 and, consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by Ishaq I. Chanda, P. E.



**NOA No 02-0722.13  
Expiration Date: December 06, 2004  
Approval Date: September 19, 2002  
Page 1**

# Nord/Morgan/Nicolai Wood Door

6-8 AND 8-0 OPAQUE OUTSWING  
DOUBLE DOOR


## GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE SOUTH FLORIDA BUILDING CODE 1994 EDITION FOR MIAMI-DADE COUNTY.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS ARE REQUIRED
5. DESIGNED PRESSURE RATING SEE TABLE PAGE 1.

## RESIDENTIAL STILE & RAIL WOOD DOOR (Common to all frame conditions)

**Frame Construction:** The head and side jambs are finger jointed ponderosa pine measuring 4.5625" X 1.25". The head and side jambs are mortised, butted and joined using (3) 16GA. 2" X 1/2" crown staples at the top corners. The bump threshold is attached to the floor.

**Door Panel Construction:** The panel is a stile and rail construction. The stiles and rails are constructed from solid wood of either Douglas Fir or Western Hemlock. They are laminated with a .0625" thk. wood veneer of the following species: Douglas Fir, Western Hemlock, Ponderosa Pine, Northern Red Oak, Red Maple, Black Cherry, Yellow Poplar, True Hickory, True Mahogany, Black Walnut, & Red Alder. The veneer face sheet is glued to the stiles and rails. The top and intermediary rails are connected to the perimeter stiles w/(2) 1/2" min. dia. x 4" long wooden dowels and the bottom rail is connected to the perimeter stile w/(3) 1/2" dia. min. x 4" long wooden dowels. The inset panels are of Ponderosa Pine or Douglas Fir and are glued into the stiles and rails.

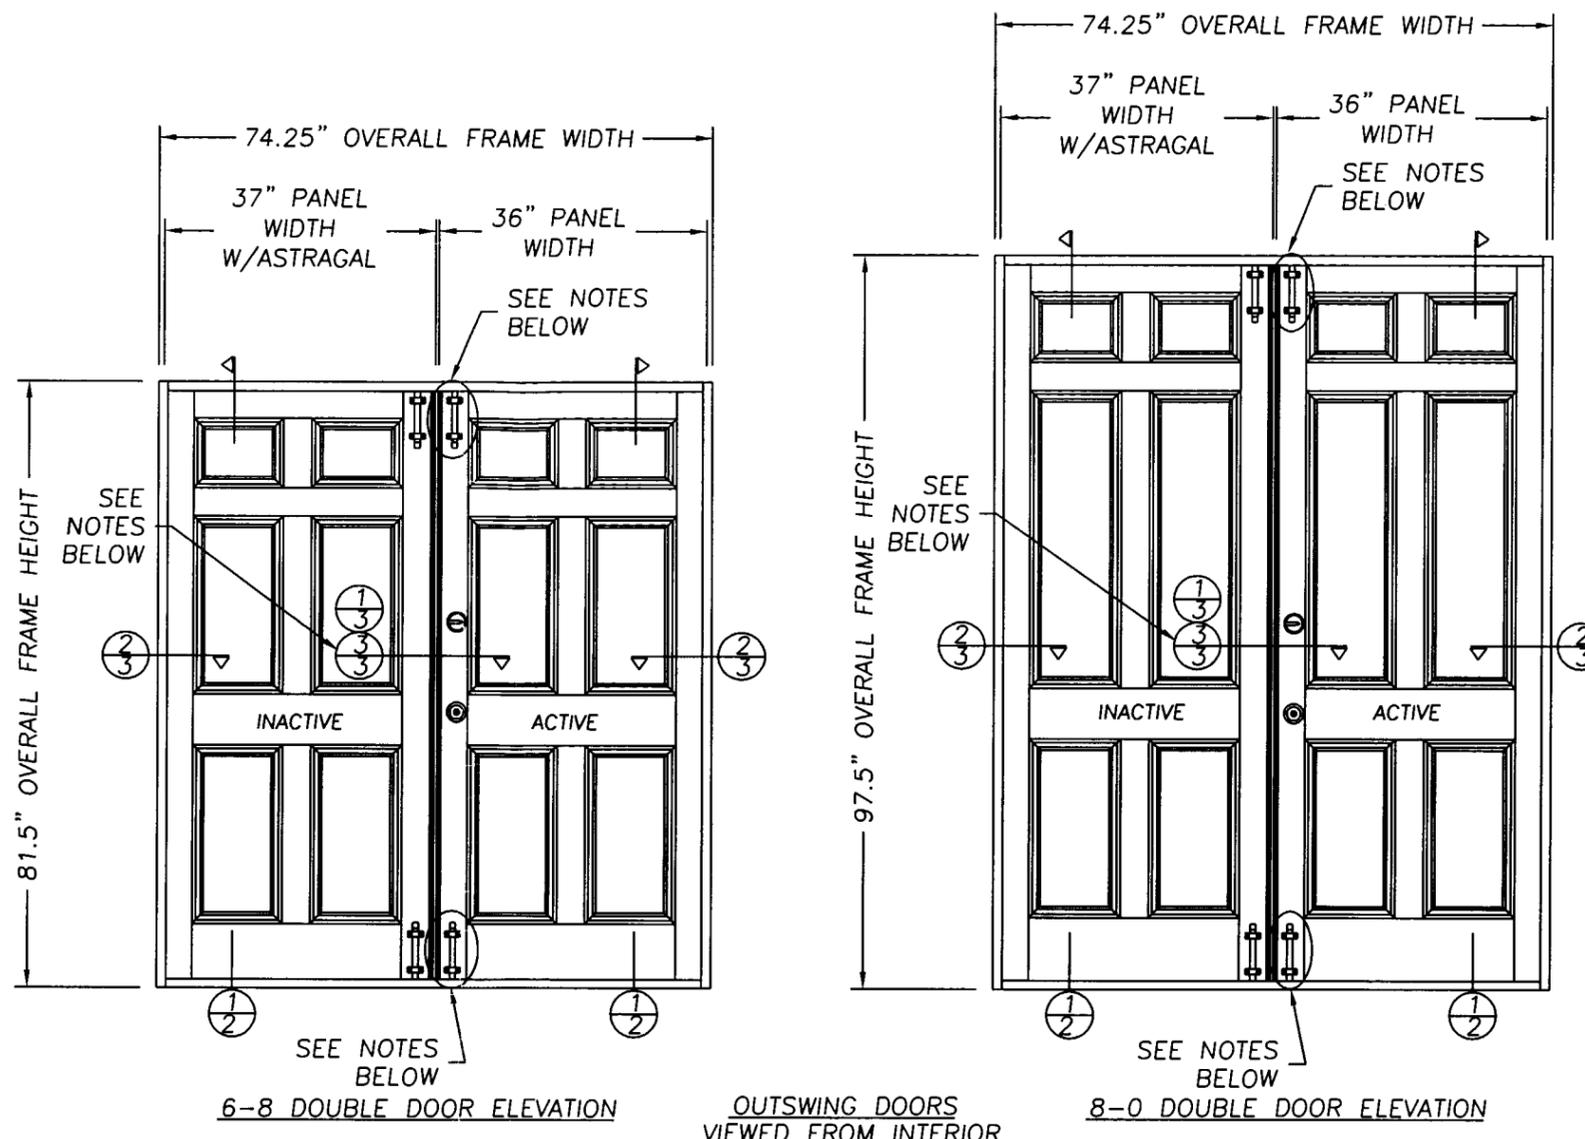

- NOTES:
1. THE SURFACE BOLTS ARE AN OPTION ON THE ACTIVE DOOR, WHEN USING THE WOOD ASTRAGAL, AND ARE USED TO ACHIEVE A HIGH PRESSURE. SEE SHEET 3 SECTION 1/3, NOTE 2 SHEET 3 AND DESIGN PRESSURE TABLE BELOW.
  2. SECTION 3/3 (SEE DETAILS SHT. 3 OF 7) IS FOR THE OPTIONAL WINDJAMBER II ASTRAGAL. THE SURFACE BOLTS ARE NOT REQUIRED WHEN USING THE WINDJAMBER II ASTRAGAL BECAUSE IT HAS (4) INTERNAL RETAINER BOLTS. IT IS USED TO ACHIEVE A HIGHER PRESSURE WITHOUT THE USE OF SURFACE BOLTS. SEE THE DESIGN PRESSURE TABLE BELOW.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	COMMON (GENERAL NOTES, TYPICAL ELEVATION)
2	VERTICAL CROSS SECTION & B.O.M.
3	HORIZONTAL CROSS SECTIONS 1/3, 2/3 & 3/3
4	ANCHORING LOCATIONS & DETAILS
5	RAIL DETAILS
6	FRAME COMPONENTS
7	DOOR MODELS

DESIGN PRESSURE RATING (OUTSWING DOORS) WHERE WATER INFILTRATION REQUIREMENT IS NEEDED					
DOOR SIZE	W/SURFACE BOLTS ON INACTIVE PANEL & WOOD ASTRAGAL		W/SURFACE BOLTS ON BOTH PANEL & WOOD ASTRAGAL		W/WINDJAMBER II ASTRAGAL, ASTRAGAL RETAINER BOLTS & NO SURFACE BOLTS
6-8	+47.0psf	-47.0psf	+65.0psf	-70.0psf	+65.0psf -70.0psf
8-0	+47.0psf	-47.0psf	+65.0psf	-70.0psf	+65.0psf -70.0psf

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILQUIN, OR. 97624  
PH. 541.783.2057


PRODUCT: WOOD STILE & RAIL DOOR  
OPAQUE 6-8/8-0  
PART OR ASSEMBLY: OUTSWING DOUBLE DOOR  
ELEVATIONS AND GENERAL NOTES

NO.	DATE	REVISIONS		
		BY	DATE	REVISIONS
5	07/15/02	KMN	GENERAL REVISION	
4	09/05/01	TJH	GENERAL REVISION	
3	07/16/01	TJH	GENERAL REVISION	
2	05/03/01	TJH	GENERAL REVISION	
1	04/20/01	TJH	GENERAL REVISION	

**RW** BUILDING CONSULTANTS, INC.  
813.684.3831

**PRODUCT REVISED**  
as complying with the Florida Building Code  
Acceptance No 02-0722-13  
Expiration Date December 2004  
By Ishaq I. Chandra  
Miami Dade Product Control Division

DATE: 7/20/00  
SCALE: N.T.S.  
DWG. BY: TJH  
CHK. BY: RW  
DRAWING NO.: S-2035  
SHEET 1 OF 7

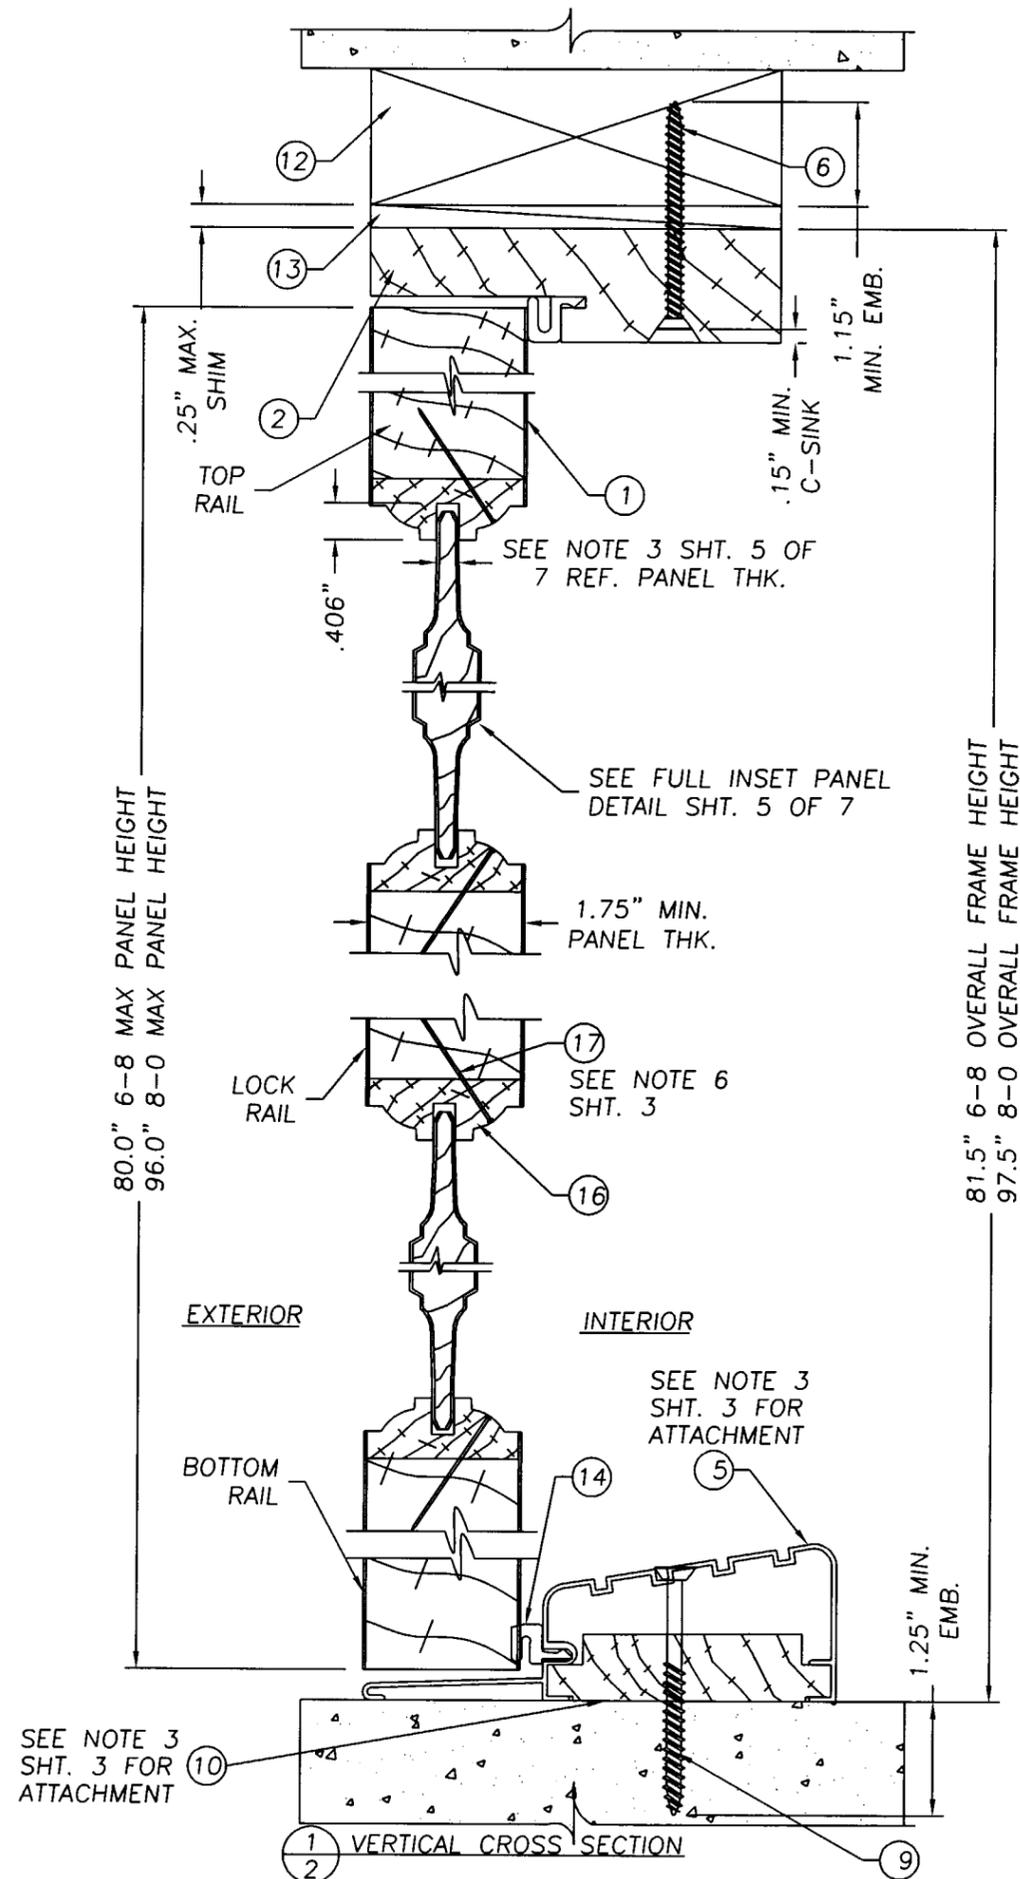

Item	DESCRIPTION	Material
1	NORD/MORGAN/NICOLAI STILE & RAIL 6-8/8-0 WOOD DOOR (DOUGLAS FIR, WESTERN HEMLOCK, PONDEROSA PINE, NORTHERN RED OAK, RED MAPLE, BLACK CHERRY, YELLOW POPLAR, TRUE HICKORY, TRUE MAHOGANY, BLACK WALNUT, & RED ALDER)	PINE
2	HEAD JAMB (1 1/4" x 4 5/8" PONDEROSA PINE)	PINE
3	HINGE JAMB (1 1/4" x 4 5/8" PONDEROSA PINE)	PINE
4	(1) PIECE WOOD ASTRAGAL	PINE
5	BUMPER THRESHOLD (.051" WALL EXTRUDED ALUM. IMPERIAL)	ALUMINUM
6	#8 x 2 1/2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
7	KWIKSET TITAN 400 SERIES LOCK	
8	KWIKSET TITAN 780 SERIES DEADBOLT	
9	1/4" x 2 3/4" LG. TAPCON OR ITW BUILDDEX TAPCON OR ELCO TAPCON	STEEL
10	SILICONE CAULK (CR LAWRENCE 33S)	SILICONE
11	NOT USED	-
12	2x WOOD BUCK	WOOD
13	1/4" MAX. SHIMS	WOOD
14	COMPRESSION WEATHERSTRIP (Q-LON QDS-650)	FOAM
15	#10 X 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
16	WOOD CAP FOR DOOR EMBOSS PANEL	PINE
17	BRAD TRIM NAIL 1 1/2" L.	STEEL
18	4" x 4" BUTT HINGE 12GA. (.089" MIN)	STEEL
19	#9 x 1" PHILLIPS FLATHEAD WOOD SCREW	STEEL
20	#8 x 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
21	SURFACE BOLT (IVES, .25" STEEL MODEL 454)	STEEL
22	SURFACE BOLT STRIKE PLATE (IVES, .125" STEEL)	STEEL
23	1/4" CARRIAGE BOLT x 3" LG. (SURFACE BOLT ATTACH.)	STEEL
24	1/4" JAMB NUT (SURFACE BOLT ATTACH.)	STEEL
25	#10 x 2 1/2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
26	ASTRAGAL EXTRUDED ALUM. (WR68J WINDJAMBER II)	ALUM.
27	ASTRAGAL EXTRUDED ALUM. (WR80J WINDJAMBER II)	ALUM.
28	#8 x 2" PHILLIPS PANHEAD WOOD SCREW	STEEL

JELD-WEN, INC.  
 31725 HIGHWAY 97 NORTH  
 CHILOQUIN, OR. 97624  
 PH. 541.783.2057


PRODUCT: WOOD STILE & RAIL DOOR OPAQUE 6-8/8-0 OUTSWING DOUBLE DOOR  
 PART OR ASSEMBLY: VERTICAL CROSS SECTION & BILL OF MATERIALS

NO	DATE	REVISIONS	BY
5	07/15/02	GENERAL REVISION	KMN
4	09/05/01	GENERAL REVISION	TJH
3	07/16/01	GENERAL REVISION	TJH
2	05/03/01	GENERAL REVISION	TJH
1	04/20/01	GENERAL REVISION	TJH


**RW** BUILDING CONSULTANTS, INC.  
 813.684.3831

PRODUCT REVISED as complying with the Florida Building Code Acceptance No 02-0722-13 Expiration Date DEC 06 2004  
 By: Shag L. Lhanda  
 Miami Dade Product Control Division

DATE: 7/20/00  
 SCALE: 1/2" = 1"  
 DWG. BY: TJH  
 CHK. BY: RW  
 DRAWING NO.: S-2035  
 SHEET 2 OF 7

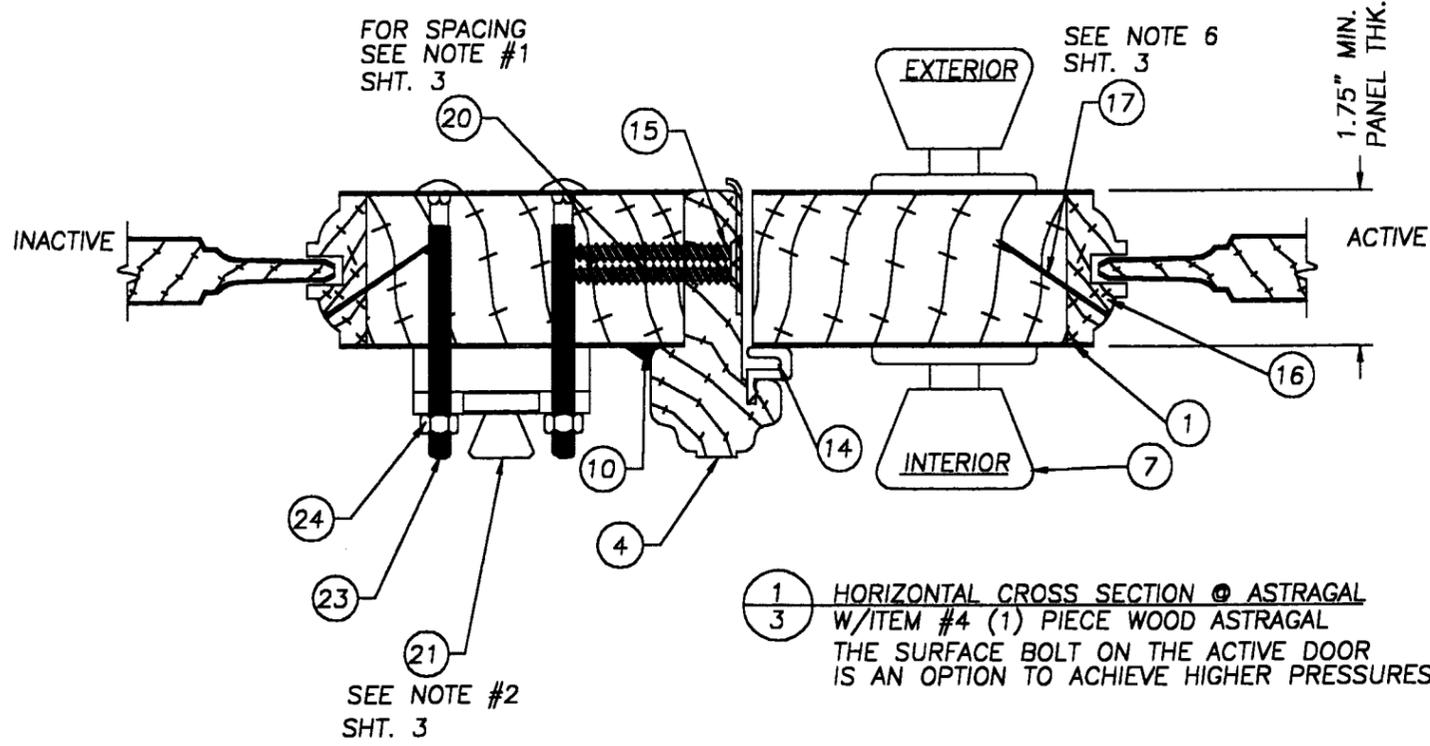


1 HORIZONTAL CROSS SECTION @ ASTRAGAL  
 3 W/ITEM #4 (1) PIECE WOOD ASTRAGAL  
 THE SURFACE BOLT ON THE ACTIVE DOOR IS AN OPTION TO ACHIEVE HIGHER PRESSURES

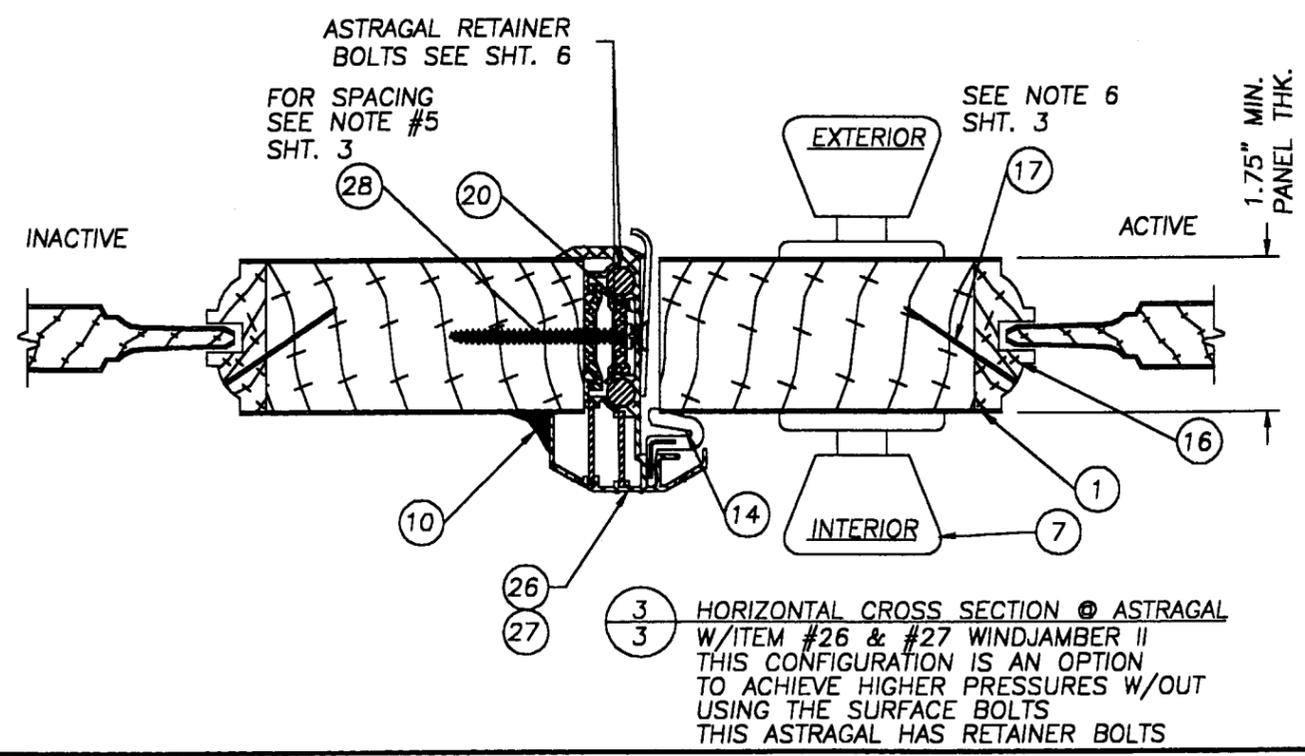

3 HORIZONTAL CROSS SECTION @ ASTRAGAL  
 3 W/ITEM #26 & #27 WINDJAMBER II  
 THIS CONFIGURATION IS AN OPTION TO ACHIEVE HIGHER PRESSURES W/OUT USING THE SURFACE BOLTS  
 THIS ASTRAGAL HAS RETAINER BOLTS

NOTES: (TYP. TO ALL FRAME CONFIGURATIONS)

1. SPACING FOR ITEM #20 (#8 x 2" SCREW) TO ATTACH THE WOOD ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS: FOR THE 6-8 UNIT TOP DOWN; 3", 12" & 21", FOR THE 8-0 UNIT TOP DOWN; 3", 14", 25" & 36". THE SPACING FROM THE BOTTOM UP IS THE SAME FOR BOTH UNITS; 3", 13 3/8" & 24 1/8".
2. THE SURFACE BOLT IS INSTALLED ON BOTH THE ACTIVE AND INACTIVE DOOR, AT THE TOP AND BOTTOM. IT IS NOT SHOWN ON THE ACTIVE DOOR IN SECTION 1/3 FOR CLARITY. SURFACE BOLTS ON THE ACTIVE DOORS ARE AN OPTION TO ACHIEVE HIGHER PRESSURES.
3. THE THRESHOLD IS NOT ATTACHED TO THE FRAME, IT IS NOTCHED AND ATTACHED TO THE FLOOR WITH ITEMS #9 2 3/4" TAPCON & #10 (CR LAWRENCE 33S SILICONE CAULK). APPLY A CONTINUOUS BEAD .125" THK. x .375" W. AROUND ALL (4) OUTER EDGES WITH A MINIMUM OF (2) ROWS IN A ZIG ZAG PATTERN IN THE MIDDLE THE ENTIRE LENGTH OF THE THRESHOLD, .125" THK. x .375" W.
4. THE TOP CORNERS OF THE DOOR FRAME, ARE STAPLED TOGETHER USING (3) 16GA. x 2" LG. x 1/2" CROWN STAPLES.
5. SPACING FOR ITEM #28 (#8 x 2" PANHEAD) TO ATTACH THE WINDJAMBER ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS: FOR BOTH WR68J & WR80J UP FROM BOTTOM & DOWN FROM TOP; 1", 3", 5", 26" & 6" UP FROM STRIKE.
6. SPACING FOR ITEM #17 IS A MAX. OF 12" O.C.

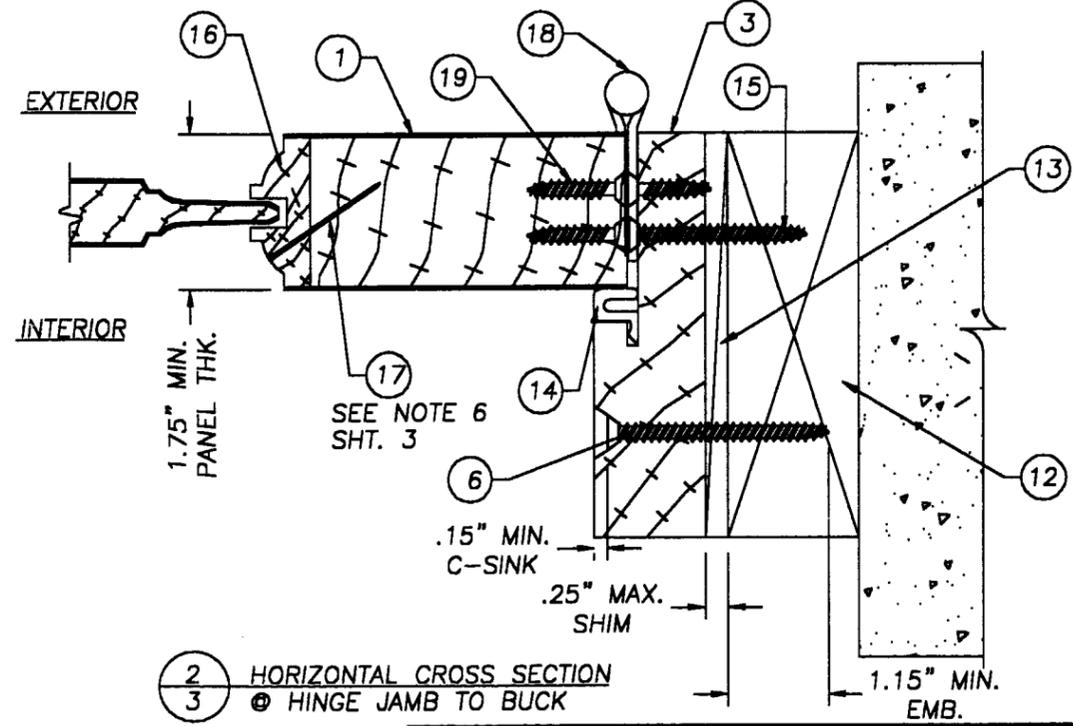

2 HORIZONTAL CROSS SECTION  
 3 @ HINGE JAMB TO BUCK

JELD-WEN, INC.  
 31725 HIGHWAY 97 NORTH  
 CHILOQUIN, OR. 97624  
 PH. 541.783.2057

PRODUCT: WOOD STILE & RAIL DOOR  
 OPAQUE 6-8/8-0  
 OUTSWING DOUBLE DOOR  
 PART OR ASSEMBLY:  
 HORIZONTAL CROSS SECTIONS 1/3, 2/3 & 3/3


NO.	DATE	BY	REVISIONS
4	09/05/01	TJH	GENERAL REVISION
3	07/16/01	TJH	GENERAL REVISION
2	05/03/01	TJH	GENERAL REVISION
1	04/20/01	TJH	GENERAL REVISION

RW BUILDING CONSULTANTS, INC.  
 813.684.3831


PRODUCT REVISED as complying with the Florida Building Code  
 Acceptance No. 02-0722-13  
 Expiration Date DEC 06, 2004  
 By Ishag I. Chanda  
 Miami Dade Product Control Division

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
 DATE DEC 06, 2001  
 BY Ishag I. Chanda  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 00-0915-06

DATE: 7/20/00  
 SCALE: 1/2" = 1"  
 DWG. BY: TJH  
 CHK. BY: RW  
 DRAWING NO.: S-2035  
 SHEET 3 OF 7

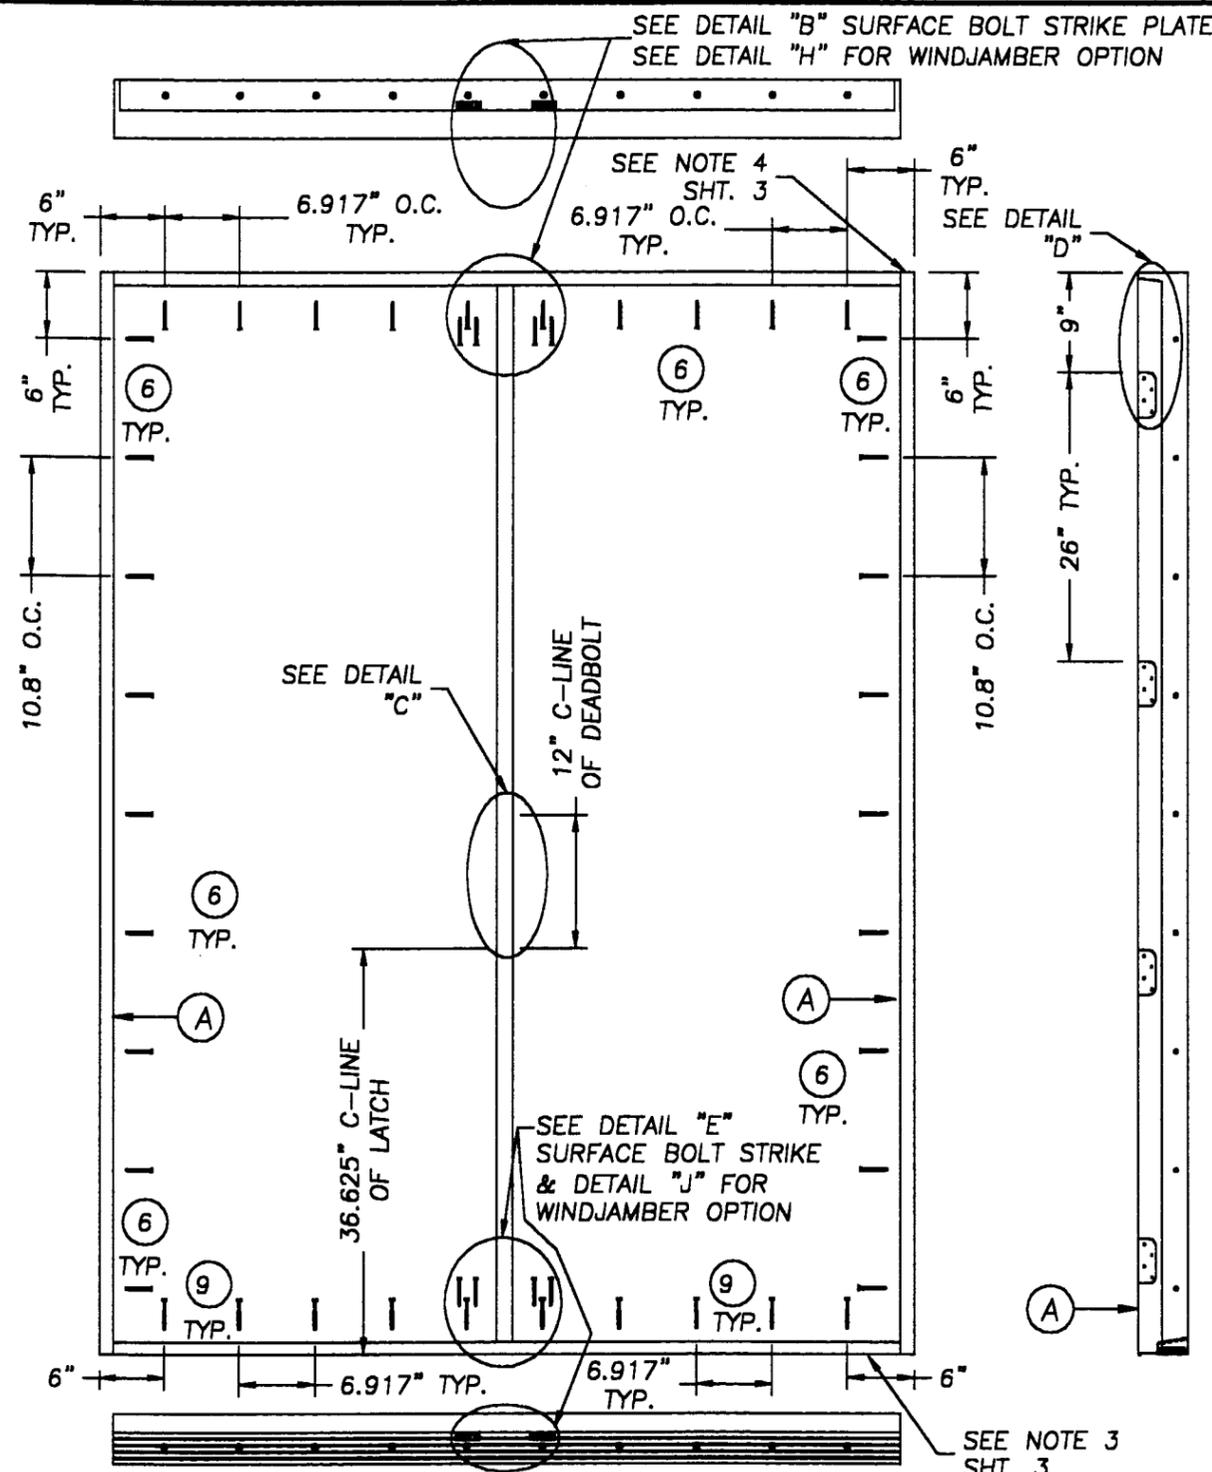


8-0 ANCHORING LOCATIONS

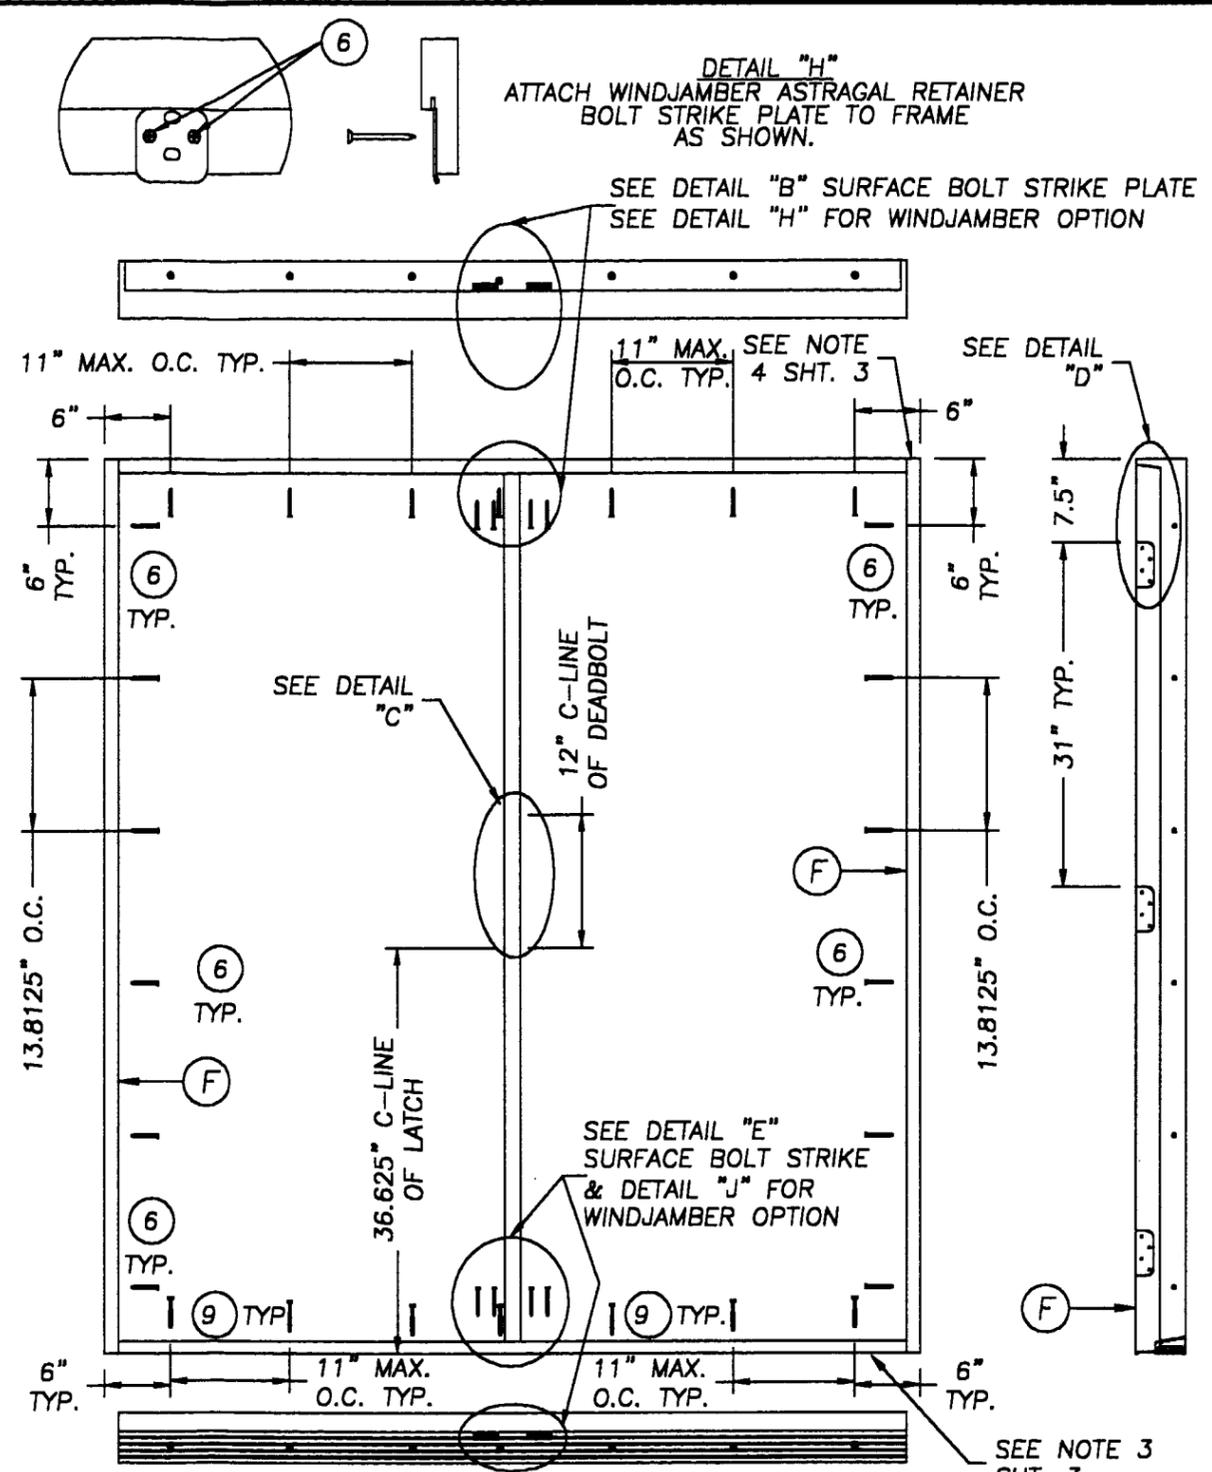


6-8 ANCHORING LOCATIONS


ASTRAGAL RETAINER BOLT HOLES MUST BE DRILLED THROUGH THE THRESHOLD & INTO THE MASONRY DEEP ENOUGH FOR A 2" THROW

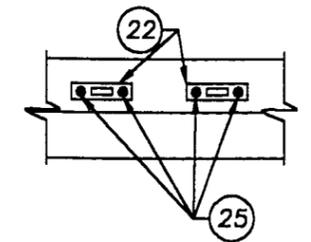


DETAIL "B" SURFACE BOLT STRIKE PLATE

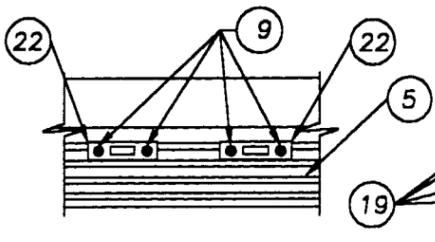


DETAIL "E" SURFACE BOLT STRIKE PLATE



DETAIL "D"




DETAIL "C"



DETAIL "J" WINDJAMBER ASTRAGAL RETAINER BOLT HOLES



DETAIL "H" ATTACH WINDJAMBER ASTRAGAL RETAINER BOLT STRIKE PLATE TO FRAME AS SHOWN.



SEE DETAIL "B" SURFACE BOLT STRIKE PLATE SEE DETAIL "H" FOR WINDJAMBER OPTION

PRODUCT REVISED as complying with the Florida Building Code Acceptance No 02-0722-13 Expiration Date DEC 06, 2004 By Ishag I. Chanda Miami Dade Product Control Division

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE DATE DEC 06, 2001 BY Ishag I. Chanda PRODUCT CONTROL DIVISION BUILDING CODE COMPLIANCE OFFICE ACCEPTANCE NO 00-0915-06

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057


PRODUCT: WOOD STILE & RAIL DOOR OPAQUE 6-8/8-0 OUTSWING DOUBLE DOOR PART OR ASSEMBLY: ANCHORING LOCATIONS & DETAILS

NO	DATE	REVISIONS	BY
4	09/05/01	GENERAL REVISION	TJH
3	07/16/01	GENERAL REVISION	TJH
2	05/03/01	GENERAL REVISION	TJH
1	04/20/01	GENERAL REVISION	TJH


RW BUILDING CONSULTANTS, INC. 813.684.3831

DATE: 7/20/00  
SCALE: N.T.S.  
DWG. BY: TJH  
CHK. BY: RW  
DRAWING NO.: S-2035  
SHEET 4 OF 7


NORD DOOR .50" WOOD  
DOWEL x 4.0" LG., 3PLCS  
MORGAN/NICOLAI DOOR .625" WOOD  
DOWEL x 4.0" LG., 3PLCS

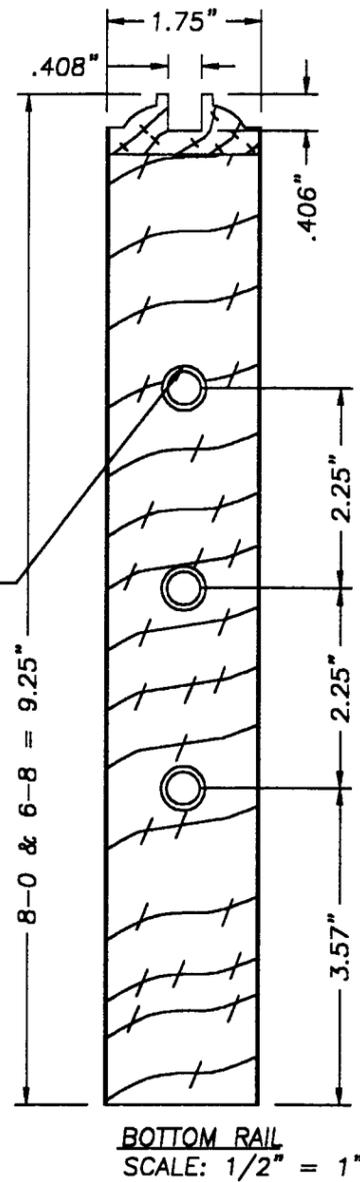


NORD DOOR .50" WOOD  
DOWEL x 4.0" LG., 3PLCS  
MORGAN/NICOLAI DOOR .625" WOOD  
DOWEL x 4.0" LG., 3PLCS

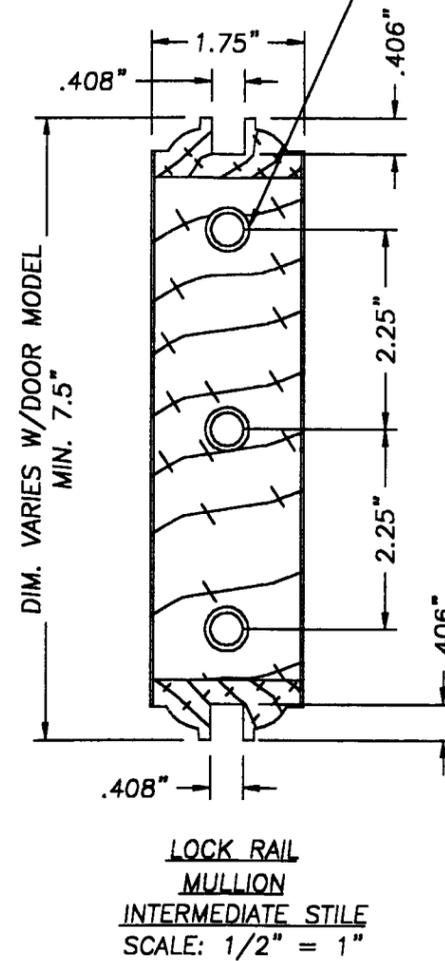

NORD DOOR .50" WOOD  
DOWEL x 4.0" LG., 2PLCS  
MORGAN/NICOLAI DOOR .625" WOOD  
DOWEL x 4.0" LG., 2PLCS

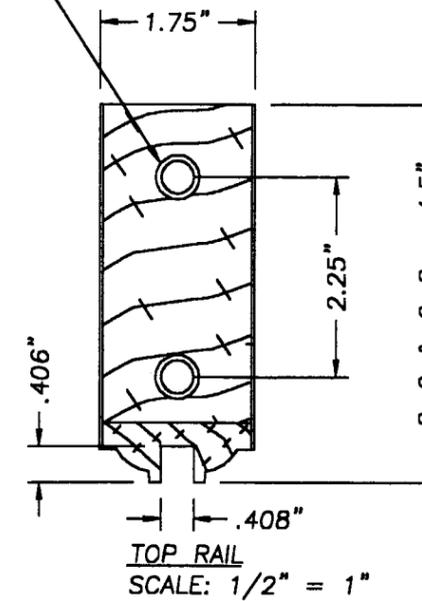


NORD DOOR HOLE FOR .50" WOOD  
DOWEL x 4.0" LG., 2PLCS  
MORGAN/NICOLAI DOOR HOLES FOR  
.625" WOOD DOWEL x 4.0" LG., 2PLCS

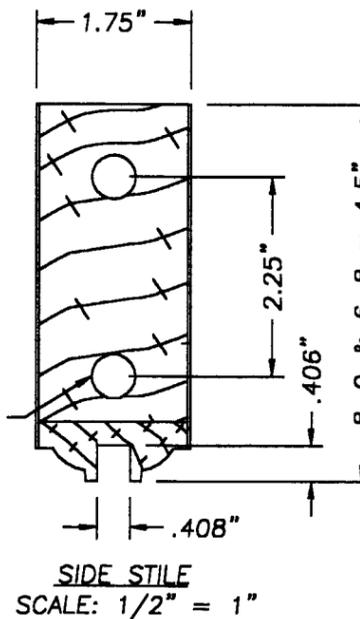

**NOTES:**

1. DOWELS ARE GLUED AND PRESSED 2.0" INTO THE RAILS AND STILES AT PANEL ASSEMBLY WITH PVA TYPE "1" EXTERIOR GLUE.
2. THE INSET PANELS ARE NOT GLUED INTO THE STILES OR RAILS. THEY ARE LEFT TO FLOAT WITH THE DOOR AS IT EXPANDS AND CONTRACTS TO ELIMINATE DOOR CRACKING.
3. SECTION 3603.2(e)(1)(cc) OF THE SOUTH FLORIDA BUILDING CODE REQUIRES SWINGING DOORS OF STILE, RAIL AND PANEL CONSTRUCTION SHALL HAVE RAILS AND STILES NOT LESS THAN 1-3/4" IN THICKNESS WITH RETAINING TONGUES OR SPLINES NOT LESS THAN 3/8" IN LEAST DIMENSION.

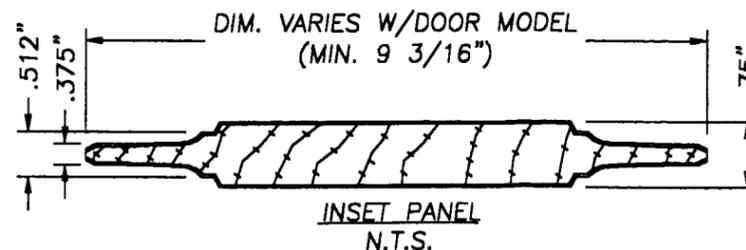

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 02-0722-13  
Expiration Date DEC 06, 2004  
By Ishaq I. Chanda  
Miami Dade Product Control  
Division

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE DEC 06, 2001  
By Ishaq I. Chanda  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 00-0915-06


DATE: 7/20/00  
SCALE: AS NOTED  
DWG. BY: TJH  
CHK. BY: RW  
DRAWING NO.: S-2035  
SHEET 5 OF 7

PRODUCT: WOOD STILE & RAIL DOOR  
OPAQUE 6-8/8-0  
OUTSWING DOUBLE DOOR  
PART OR ASSEMBLY:  
RAIL DETAILS


NO	DATE	REVISIONS	BY
4	09/05/01	GENERAL REVISION	TJH
3	07/16/01	GENERAL REVISION	TJH
2	05/03/01	GENERAL REVISION	TJH
1	04/20/01	GENERAL REVISION	TJH

**RW** BUILDING  
CONSULTANTS, INC.  
813.684.3831


JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

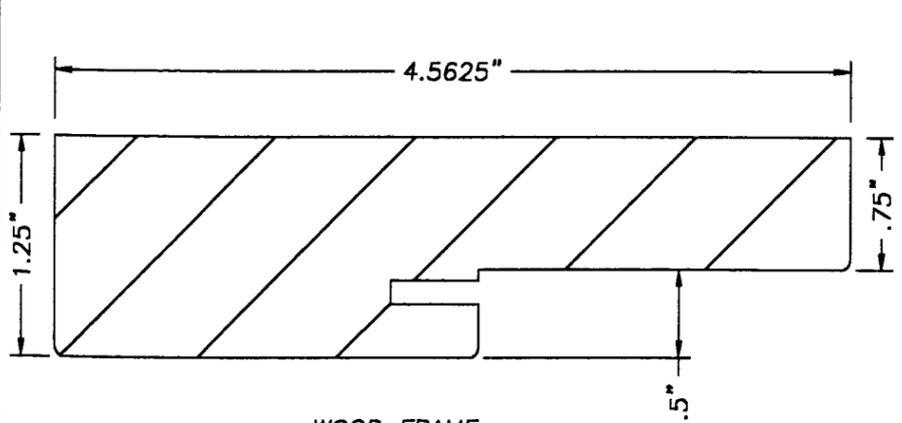


WOOD FRAME

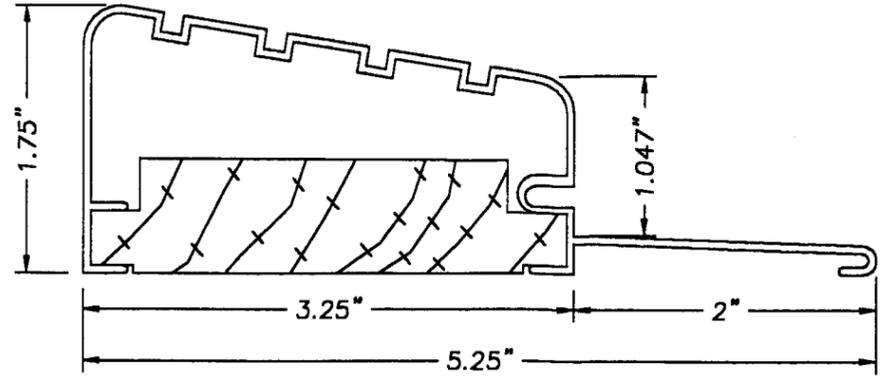


OUTSWING BUMP FACE ALUMINUM THRESHOLD  
.051" WALL THK.

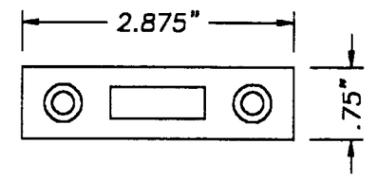


SURFACE BOLT STRIKE (IVES .125" STEEL)

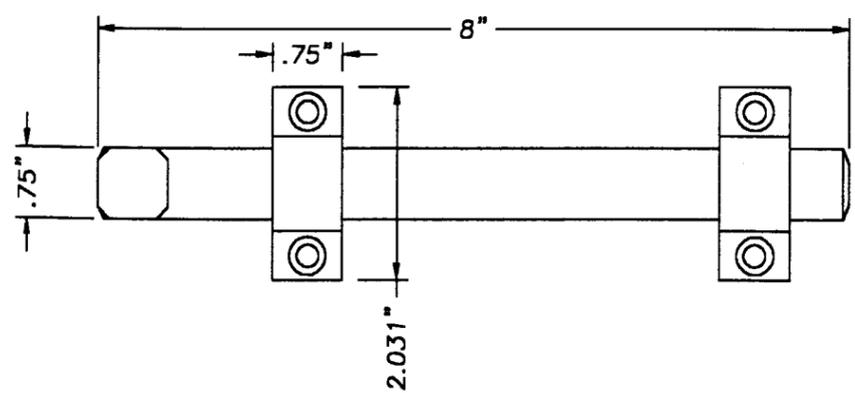

SURFACE BOLT (IVES .25" STEEL MODEL 454)

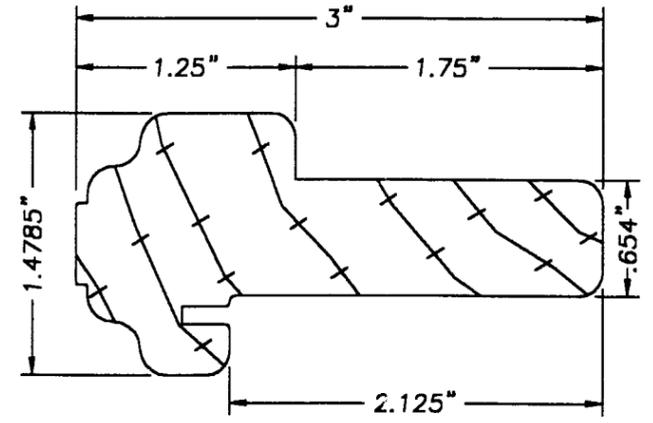


(1) PIECE WOOD ASTRAGAL

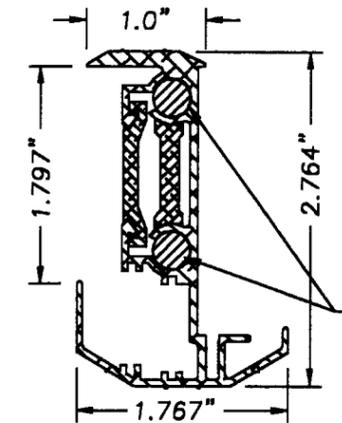


ASTRAGAL WINDJAMBER II  
(WR68J & WR80J) T-6063 EXTRUDED ALUMINUM

8-0 ASTRAGAL HAS  
(2) 8 1/4" BOLTS @ BOTTOM & (2) 17 3/4" BOLTS @ TOP  
6-8 ASTRAGAL HAS  
(2) 8 1/4" BOLTS @ BOTTOM & (2) 8 1/4" BOLTS @ TOP

5/16" Ø ASTRAGAL RETAINER BOLT

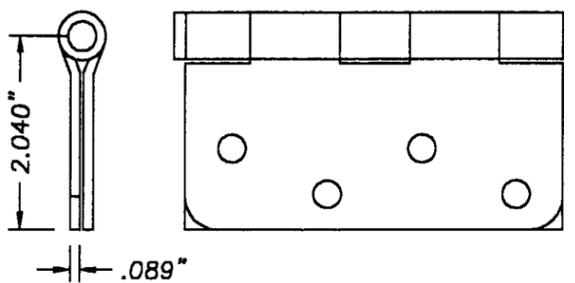

4 x 4 DOOR HINGE

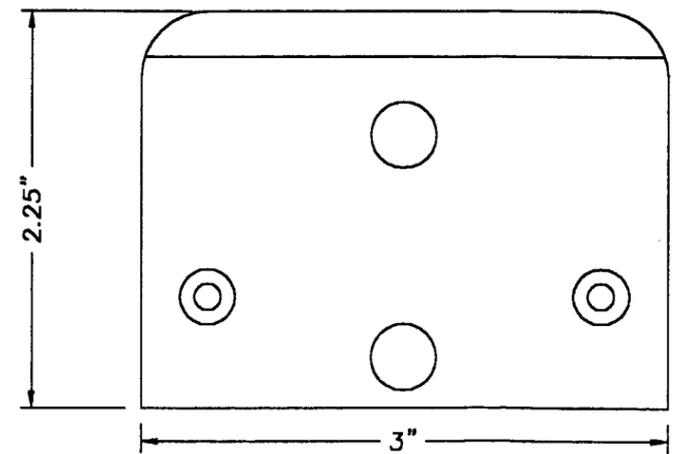

ASTRAGAL HEADER STRIKE PLATE  
WR80J & WR68J 18GA. STEEL

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

PRODUCT: WOOD STILE & RAIL DOOR OPAQUE 6-8/8-0  
PART OR ASSEMBLY: OUTSWING DOUBLE DOOR  
FRAME COMPONENTS


NO.	DATE	REVISIONS	BY
4	09/05/01	GENERAL REVISION	TJH
3	07/16/01	GENERAL REVISION	TJH
2	05/03/01	GENERAL REVISION	TJH
1	04/20/01	GENERAL REVISION	TJH

**RW** BUILDING CONSULTANTS, INC.  
813.684.3831


PRODUCT REVISED as complying with the Florida Building Code  
Acceptance No. 02-0722-13  
Expiration Date DEC 06, 2004  
By Isaac I. Chanda  
Miami Dade Product Control Division

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
DATE DEC 06, 2001  
BY Isaac I. Chanda  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 00-0915.06


DATE: 7/20/00  
SCALE: N.T.S.  
DWG. BY: TJH  
CHK. BY: RW  
DRAWING NO.: S-2035  
SHEET 6 OF 7

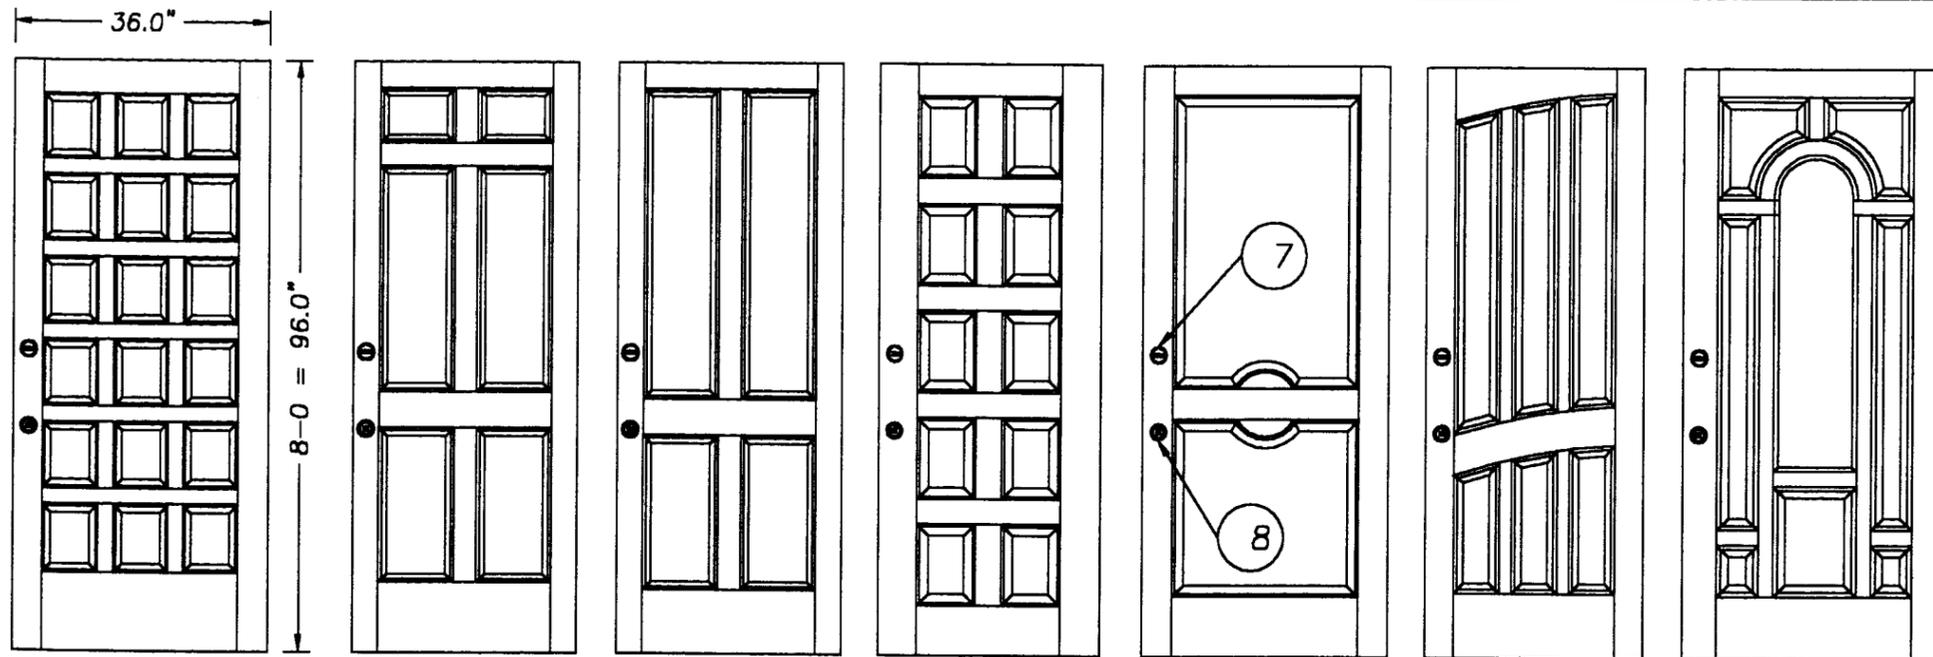

8-0 DOOR MODELS (OPAQUE) N.T.S. OUTSWING PANELS INTERIOR VIEW

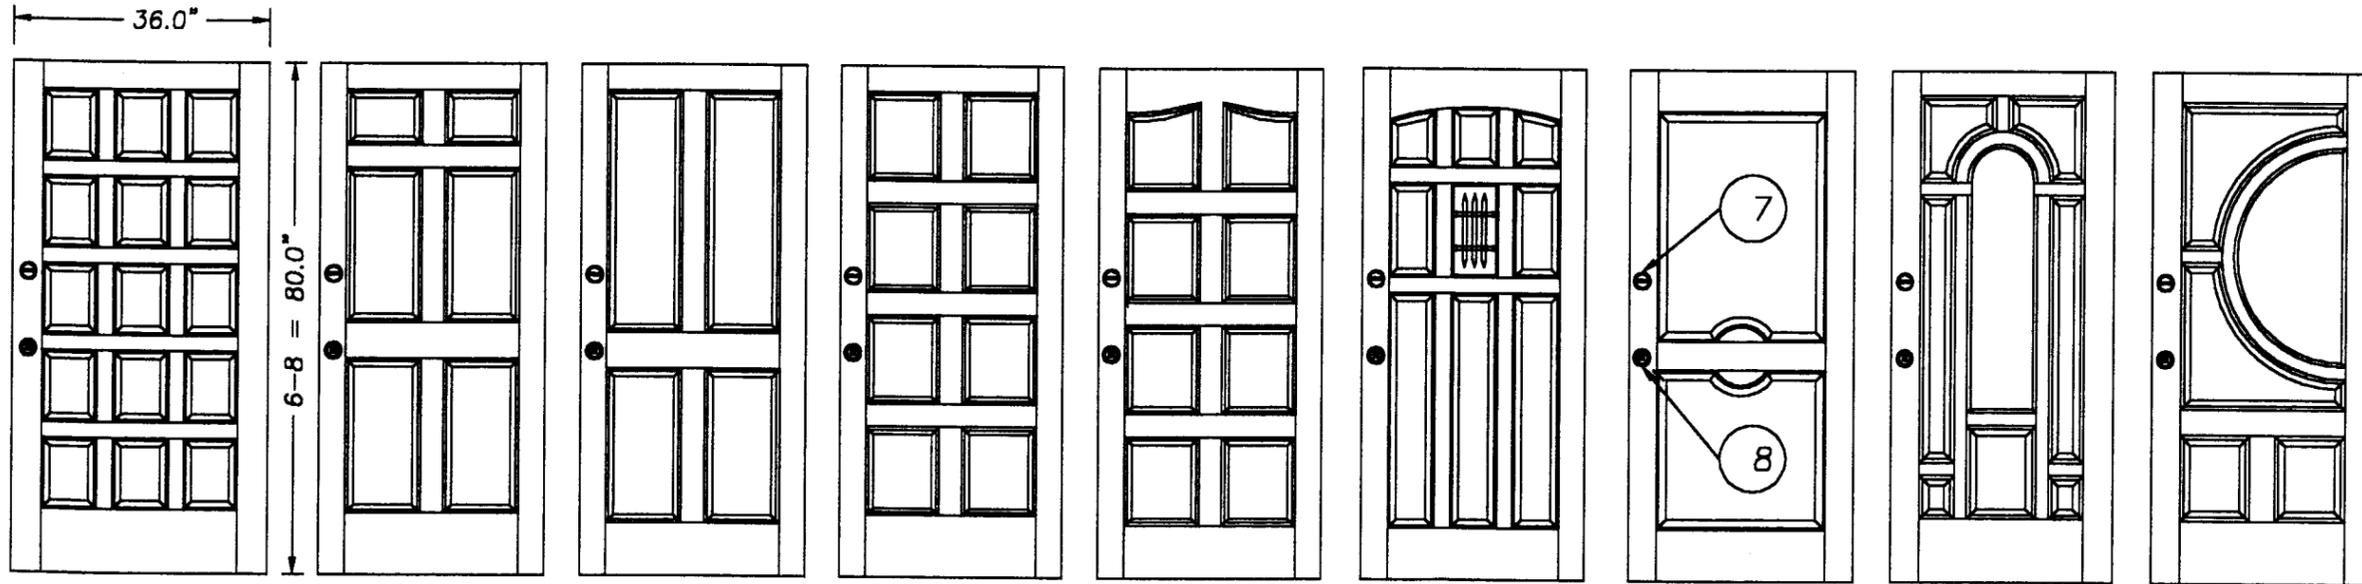

6-8 DOOR MODELS (OPAQUE) N.T.S. OUTSWING PANELS INTERIOR VIEW

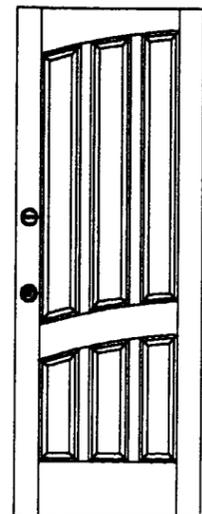

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

PRODUCT: WOOD STILE & RAIL DOOR  
OPAQUE 6-8/8-0  
OUTSWING DOUBLE DOORS  
PART OR ASSEMBLY:  
DOOR MODELS

NO.	DATE	REVISIONS	BY
4	09/05/01	GENERAL REVISION	TJH
3	07/16/01	GENERAL REVISION	TJH
2	05/03/01	GENERAL REVISION	TJH
1	04/20/01	GENERAL REVISION	TJH

**RW** BUILDING  
CONSULTANTS, INC.  
813.684.3831

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 02-0722-13  
Expiration Date DEC 06, 2004  
By Ishaq I. Lhanda  
Miami Dade Product Control  
Division

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE DECEMBER 06, 2001  
BY Ishaq I. Lhanda  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 00-0915-06

DATE: 7/20/00  
SCALE: N.T.S.  
DWG. BY: TJH  
CHK. BY: RW  
DRAWING NO.:  
S-2035  
SHEET 7 OF 7