



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Vistawall Architectural Products
803 Airport Road
Terrell, TX 75160**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series 375 Medium Stile Aluminum Outswing Storefront Doors w/transom

APPROVAL DOCUMENT: Drawing No. CW-250-MSD titled "375 Aluminum Storefront Door (MS) with Transom." Sheets 1 through 7 of 7, prepared by manufacturer, dated 8-15-95 and last revised on 08-21-02, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.


INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises and renews NOA # 99-0127.04 and, consists of this page 1 as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



**NOA No 02-0904.07
Expiration Date: October 24, 2007
Approval Date: October 24, 2002
Page 1**

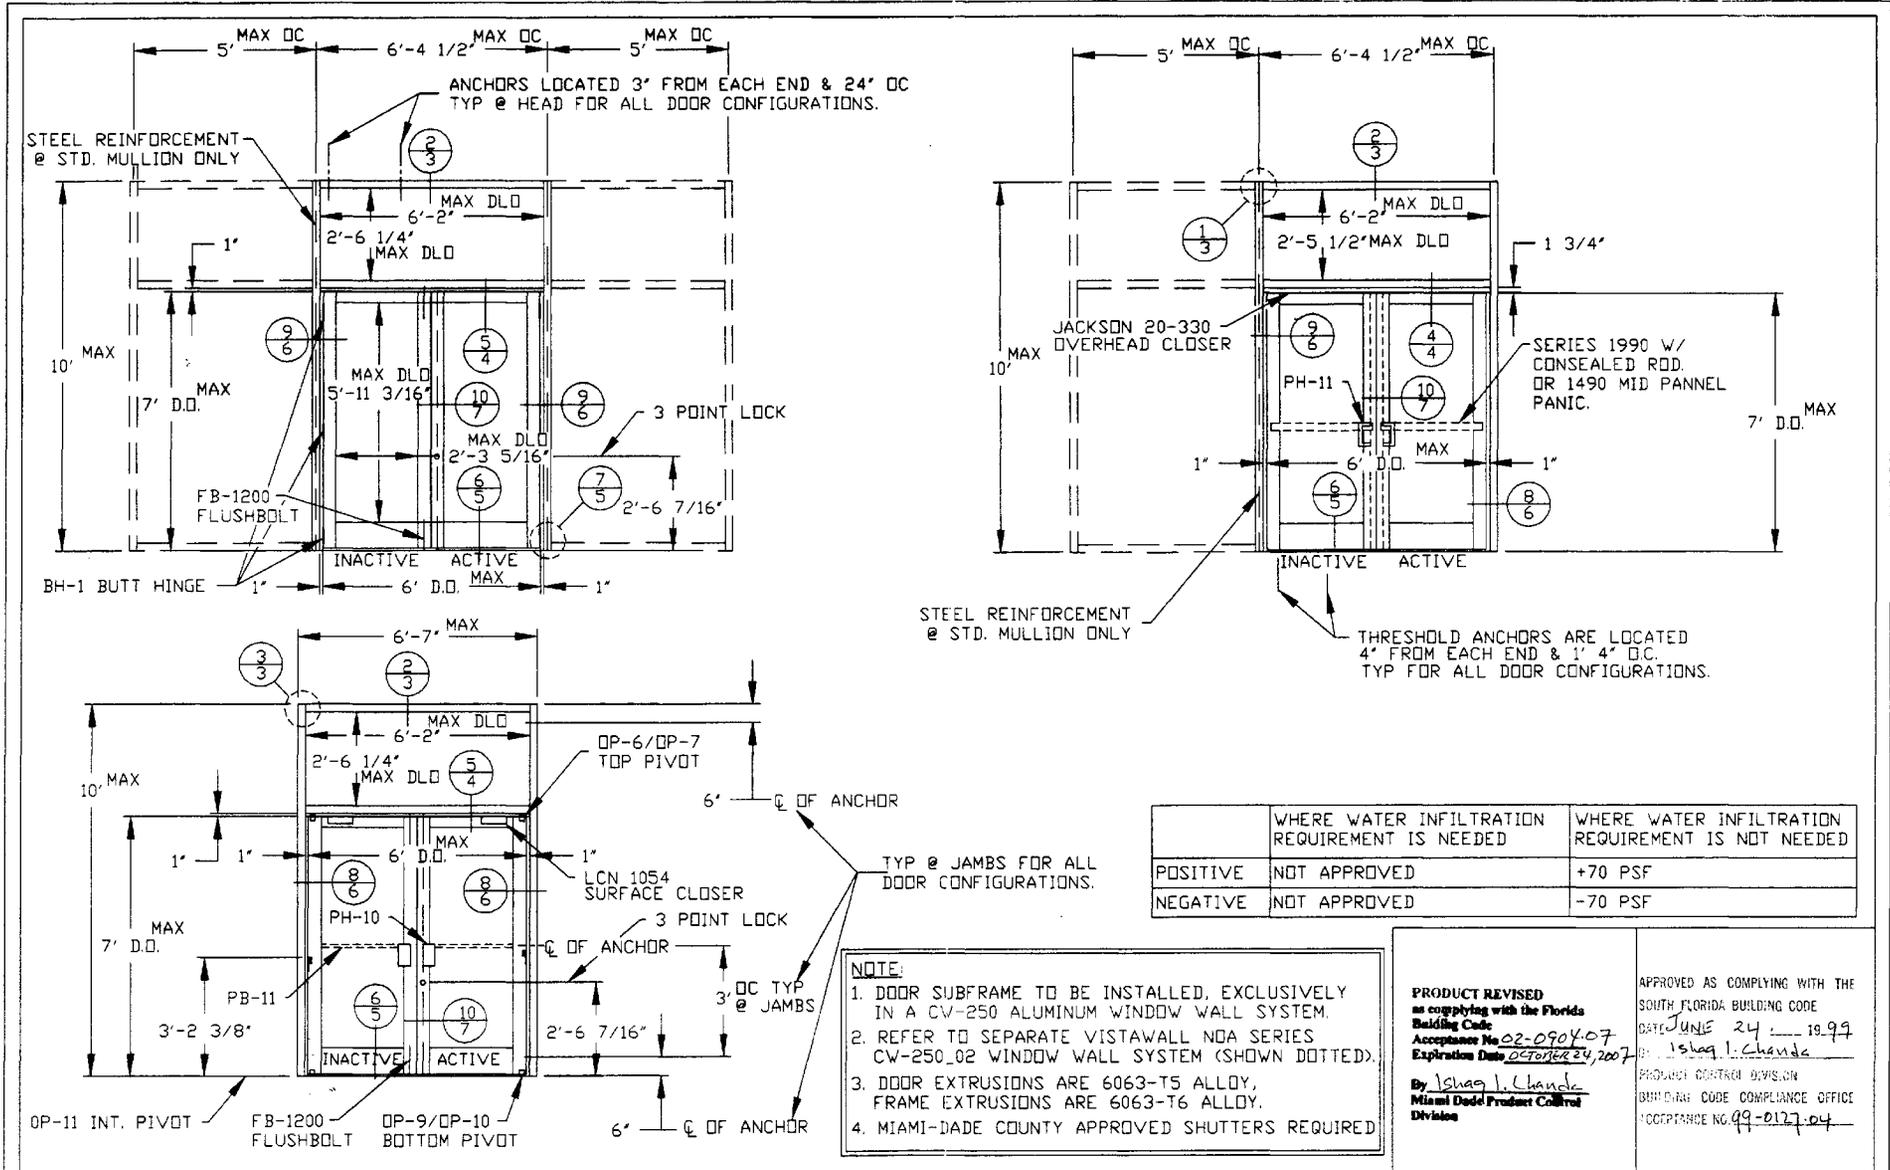

	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED	WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED
POSITIVE	NOT APPROVED	+70 PSF
NEGATIVE	NOT APPROVED	-70 PSF

NOTE:

1. DOOR SUBFRAME TO BE INSTALLED, EXCLUSIVELY IN A CV-250 ALUMINUM WINDOW WALL SYSTEM.
2. REFER TO SEPARATE VISTAWALL NOA SERIES CW-250_02 WINDOW WALL SYSTEM (SHOWN DOTTED).
3. DOOR EXTRUSIONS ARE 6063-T5 ALLOY, FRAME EXTRUSIONS ARE 6063-T6 ALLOY.
4. MIAMI-DADE COUNTY APPROVED SHUTTERS REQUIRED

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No. 02-090407
 Expiration Date OCTOBER 24, 2007

By: Ishaq I. Chande
 Miami Dade Product Control Division

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE: JUNE 24, 1999
 By: Ishaq I. Chande
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 09-0127-04

A	PER DADE COUNTY	5/20/99	J.G.
No.	REVISION	DATE	BY

VISTAWALL
 ARCHITECTURAL PRODUCTS
 800 AIRPORT RD. TIRRELL, TX 75160 (972) 551-4100

THE VISTAWALL GROUP
 BUTLER MANUFACTURING COMPANY

375 ALUMINUM STOREFRONT DOOR (MS) WITH TRANSOM

DATE: 8-15-95
 DRAWN BY: L.F.B.
 DWG. No.: CW250-MSD

SHEET 1
 OF 7

DOOR HARDWARE SCHEDULE

DESCRIPTION	PART NO.	QUANTITY	MANUFACTURER
3 POINT LOCK	MS1850-3PT	1	ADAMS-RITE
MOD FLUSH BOLTS W/ 1/4-20 GRD 5 THREADED ROD & THREADED STL TIP	FB-1200	2	INTERNATIONAL
AIRTIGHT THRESHOLD	TH-49	1	VISTAWALL
DOOR SWEEP	D-118, D-120	2	VISTAWALL
OFFSET PIVOT	DP-6,7,9, & 10	2 SETS	INTERNATIONAL
INTERMEDIATE PIVOT	DP-11	2	INTERNATIONAL
PULL HANDLE	PH-10	2	VISTAWALL
PUSHBAR	PB-11	2	VISTAWALL
SURFACE MOUNTED CLOSER	1054	2	NORTON
CONCEALED ROD PANIC	SERIES 1990	2	DDR-D-MATIC
* BUTT HINGES	BH-1	2	HAGER
PULL HANDLE	PH-11	2	VISTAWALL
CONCEALED OVERHEAD CLOSER	20-330	2	JACKSON
VIP 1 MID-PANEL PANIC	1490	2	DDR-D-MATIC

***NOTE:**

HAGER STEEL HINGE
FINISH US26D SATIN CHROME FOR STANDARD FINISH.
DURANODIC LACQUER PAINT FOR BRONZE OR BLACK FINISH.

WEATHERSTRIPPING SCHEDULE

DESCRIPTION	PART NO.	MATERIAL	MANUFACTURER	LOCATION
GASKET	CW-17	EPDM	VISTAWALL	EXTERIOR FRAME
5/16" X 5/16" DSA TAPE	V-2110	THERMALBOND	NORTON	INTERIOR FRAME
GLASS SETTING BLOCK	CW-51	EPDM	VISTAWALL	CW250 HORIZ
DOOR STOP GASKET	D-125	DUAL-DURO EPDM	VISTAWALL	FG-2120 DOOR STOP
DOOR SWEEP	D-120	SILICONE	VISTAWALL	D-118 DOOR STOP
DOOR GASKET	V-28	PVC	VISTAWALL	S-20 GLASS STOP
MEETING STILE SWEEP	WP-081	WOOLPILE	VISTAWALL	CW250 HORIZ
DOOR SETTING BLOCK	NSB-804	RIGID PVC	VISTAWALL	CORNERS OF DOORS

GLASS SCHEDULE

DESCRIPTION
1/4" CLEAR TEMPERED GLASS

FASTENER SCHEDULE

DESCRIPTION	PART NO.	MANUFACTURER	LOCATION
#12 X 1" PFH	FS-323	VISTAWALL	HORIZ & STEEL
#12-14 X 7/8" HWH	FS-327	VISTAWALL	PRESSURE PLATES
#8 X 1/2" PFH	FS-2	VISTAWALL	D-118 & S-20
1/4"-20 X 2 1/2" PRH	FS-18	VISTAWALL	GLASS JACK
NYLON END CAP	323	VISTAWALL	GLASS JACK
#12 INT TOOTH LOCKWSHR	FSW-324	VISTAWALL	SHEAR BLOCKS
#10 X 3/4" PFH	FS-7	VISTAWALL	DOOR RAILS
#12 X 1/2" PPH STS	FS-27	VISTAWALL	DOOR FRAME
#14 X 1 1/2" PRH	FA-229	VISTAWALL	FRAME SILL
1/4-20 X 1" HEX HD	FS-39	VISTAWALL	FRAME RAILS
1/4" X 2" FH		TAPCON	THRESHOLD
#10 X 3/8" PFH STS	FS-119	VISTAWALL	TOP DOOR STOP (EA. END)
#10 X 2" PFH STS	FS-201	VISTAWALL	TOP DOOR STOP (CTR)
3/8-16 GARDE 5 BDLT		VISTAWALL	PERIMETER ANCHOR (HEAD)
3/8-16 SLEEVE ANCHOR WITH 2 PART EPOXY SET		RED HEAD ITW	PERIMETER ANCHOR (JAMBS)
3/8" FLAT WASHER	FSW-80	VISTAWALL	FRAME JAMBS
#8-32 X 1/2" PFH MS	FS-50	VISTAWALL	FLUSHBOLT BRACKETS

ACCESSORY SCHEDULE

DESCRIPTION	PART NO.	PART NO.	LOCATION
MULL PLUG	457	NIAGRA	FRAME JAMBS
SILL MULL ANCHOR	CW250-FP-105	VISTAWALL	SILL ANCHOR
HEAD MULL ANCHOR	CW250-FP-103	VISTAWALL	HEAD ANCHOR
SHEAR BLOCK	CW250-FP-1	VISTAWALL	TYP FRAME SHEAR BLOCK
DOOR SHEAR BLOCK	B10-D8	VISTAWALL	TOP DOOR RAIL
DOOR SHEAR BLOCK	B10-D71	VISTAWALL	BOTTOM DOOR RAIL
DOOR SHEAR BLOCK	B10-D11	VISTAWALL	MUNTIN

PRODUCT REVISED
in compliance with the Florida
Building Code
Amendment No. 02-0904.07
Expiration Date OCT 24, 2007
By Ishag I. Chaudh
Miami Dade Product Control
Division


B	REV LOCK & GSK.	8/21/02	P.C.
A	PER DADE COUNTY	5/20/99	J.G.
No.	REVISION	DATE	BY

VISTAWALL
ARCHITECTURAL PRODUCTS
809 AIRPORT RD. TERRELL TX 75159 (972) 551-6100
THE VISTAWALL GROUP
RUTLER MANUFACTURING COMPANY

375 ALUMINUM STOREFRONT
DOOR (MS) WITH TRANSOM

DATE: 8-15-95
DRAWN BY: L.F.B.
DWG. No: CW250-MSD


SHEET 2
OF 7

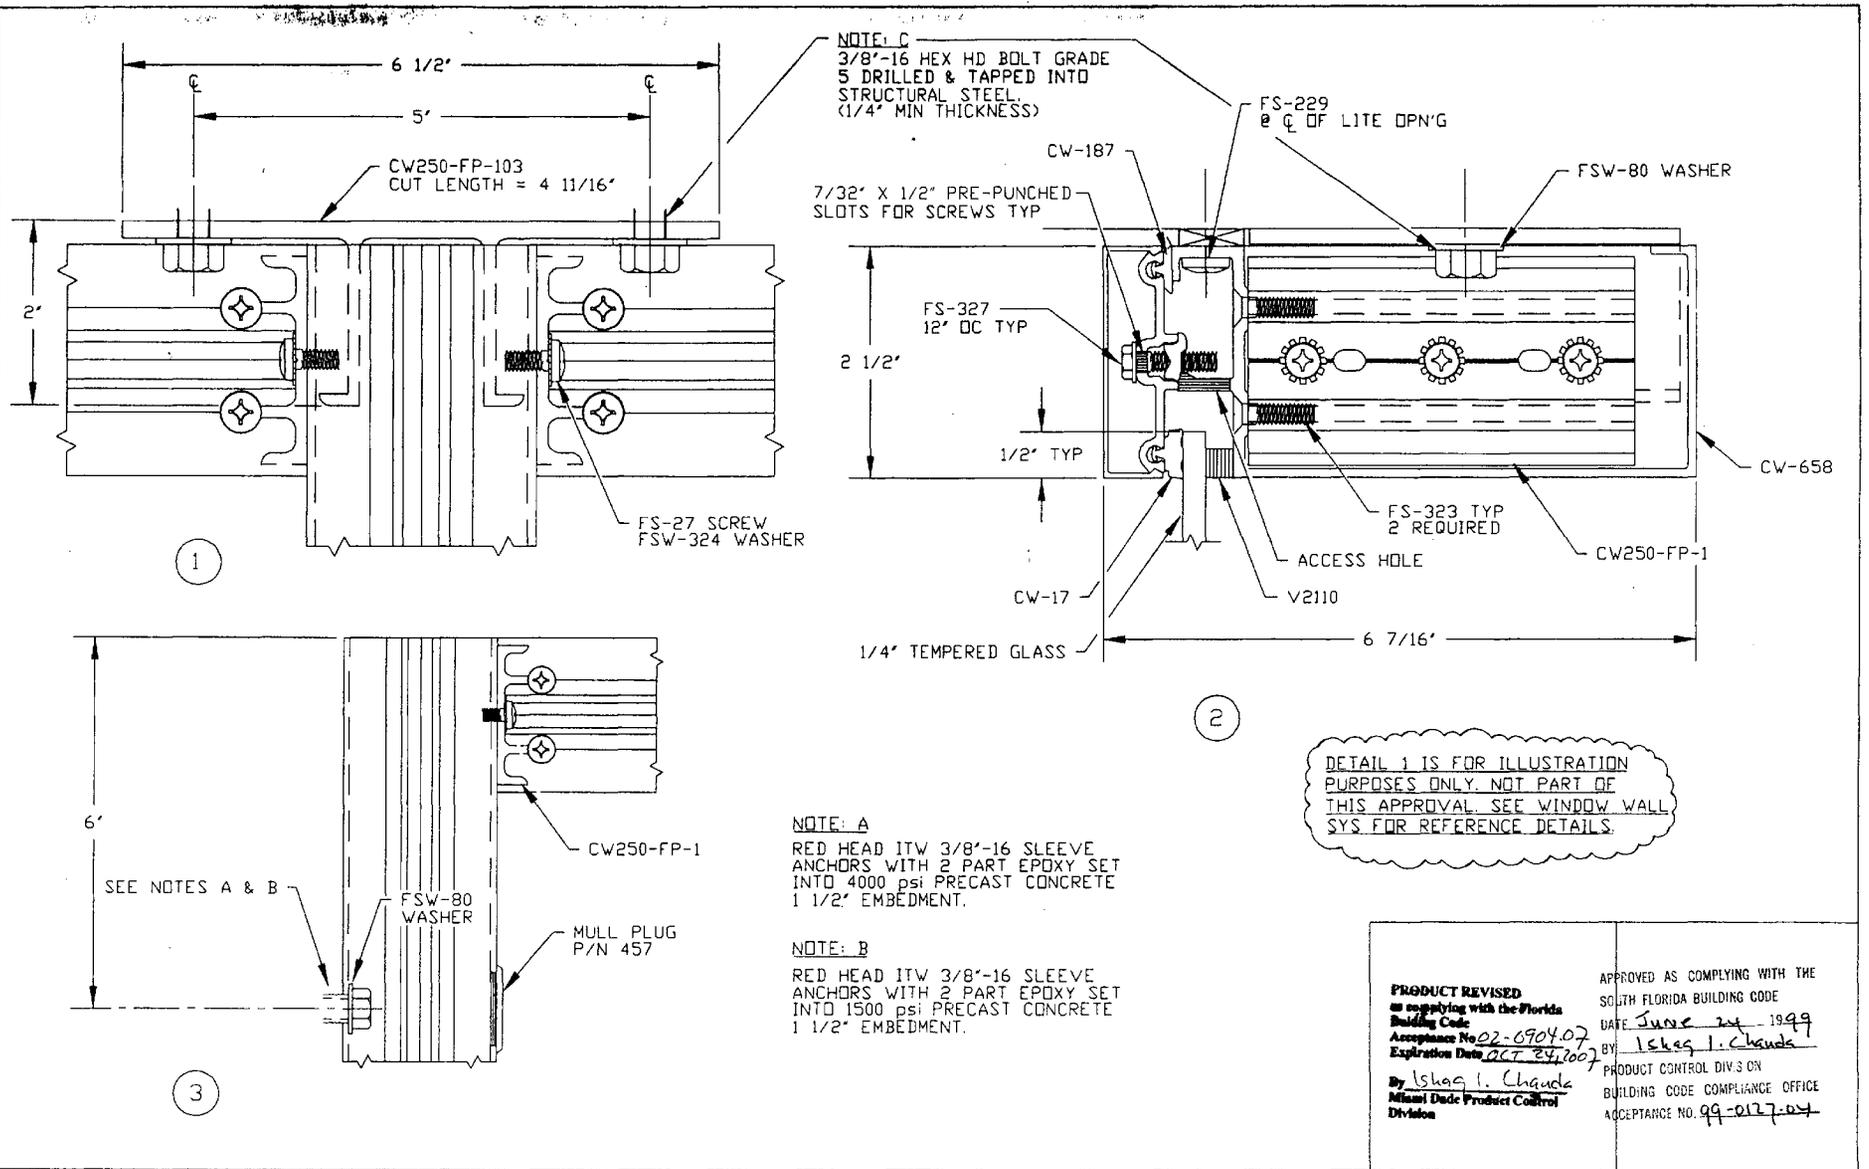

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 02-090407
 Expiration Date 02/24/2007
 By: Ishag I. Chaudhry
 Miami Dade Product Control
 Division

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE June 24, 1999
 BY: Ishag I. Chaudhry
 PRODUCT CONTROL DIV. 3 ON
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 99-027-04

				ISTAWALL ARCHITECTURAL PRODUCTS <small>80 AIRPORT RD. TERRELL TX 75160 (972) 551-6100</small> <small>THE VISTA WALL GROUP BUTLER MANUFACTURING COMPANY</small>	375 ALUMINUM STOREFRONT DOOR (MS) WITH TRANSOM	DATE: 8-15-95	SHEET 3
A	PER DADE COUNTY	5/20/99	J.G.			DRAWN BY: L.F.B.	
No.	REVISION	DATE	BY	DWG. No.: CW250-MSD	OF 7		

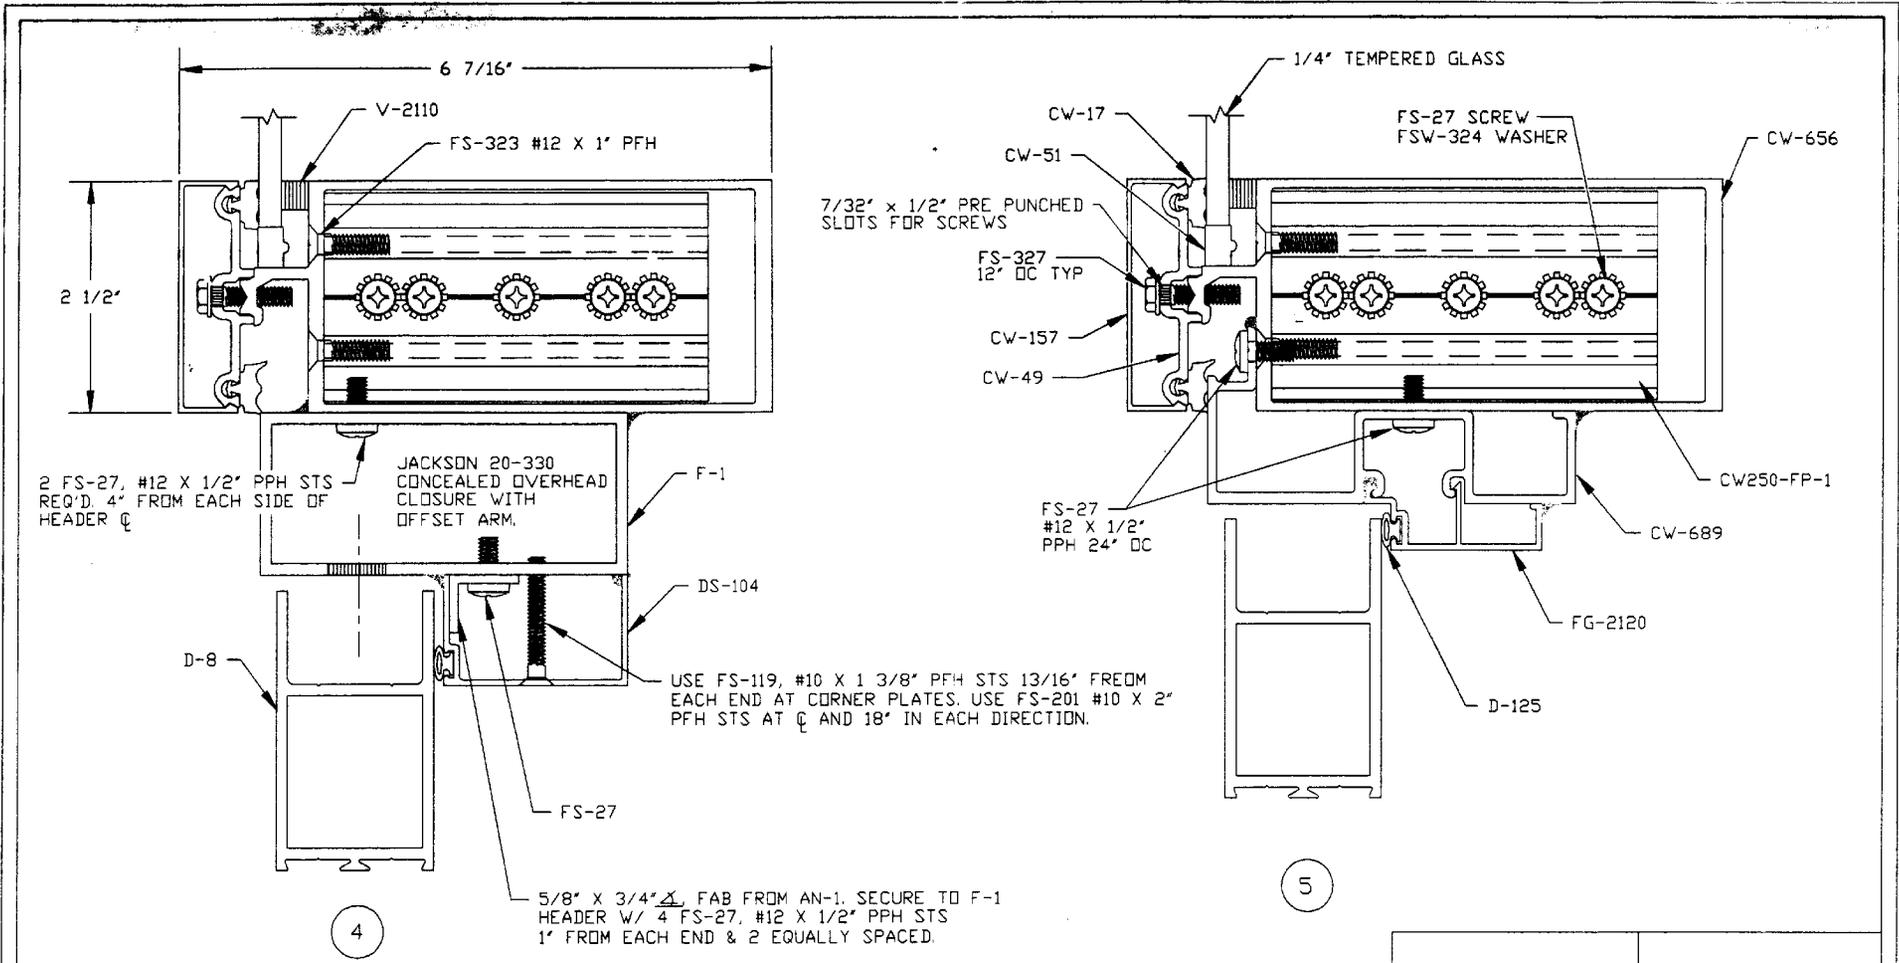

NOTE:

1. 'F' CLIP MUST BE INSTALLED IN F-1 HEADER AND THEN SECURED TO SUB FRAME JAMBS.
2. CLOSER PLATE IS SEALED TO HEADER.

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No. 22-0904-07
 Expiration Date 06/24/2007
 By: Ishaq I. Chaudhry
 Miami Dade Product Control Division

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE June 24, 1999
 BY Ishaq I. Chaudhry
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 99-0127-04



No.	REVISION	DATE	BY
A	PER DADE COUNTY	5/20/99	J.G.

VISTAWALL
 ARCHITECTURAL PRODUCTS
 800 AIRPORT RD. TERRELL TX 75160 (972) 551-6100
 THE VISTAWALL GROUP
 BUTLER MANUFACTURING COMPANY

375 ALUMINUM STOREFRONT
 DOOR (MS) WITH TRANSOM


DATE:	8-15-95
DRAWN BY:	L.F.B.
DWG. No.:	CW250-MSD

SHEET	4
OF	7

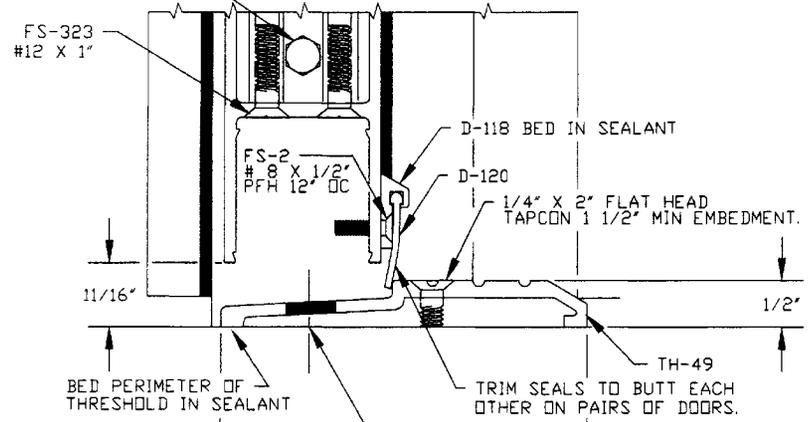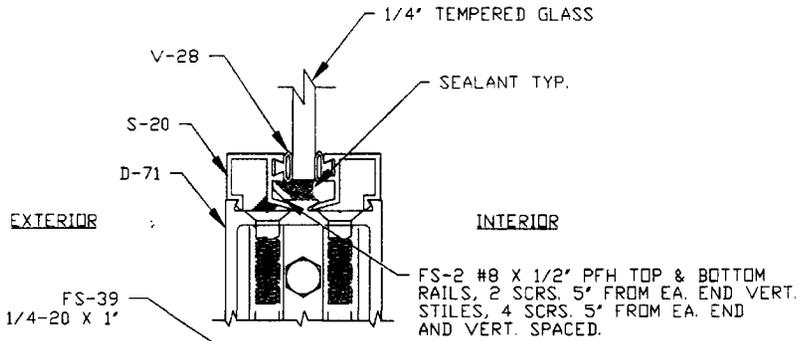

NOTE:
D-120 WEATHER SEAL - MATERIAL
50 DUROMETER SILICONE, BY EPG.

NOTE:
SEAL FRONT (SEE NOTE) AND
BACK, TOP, AND BOTTOM OF
FG-2120, 3 SIDES.

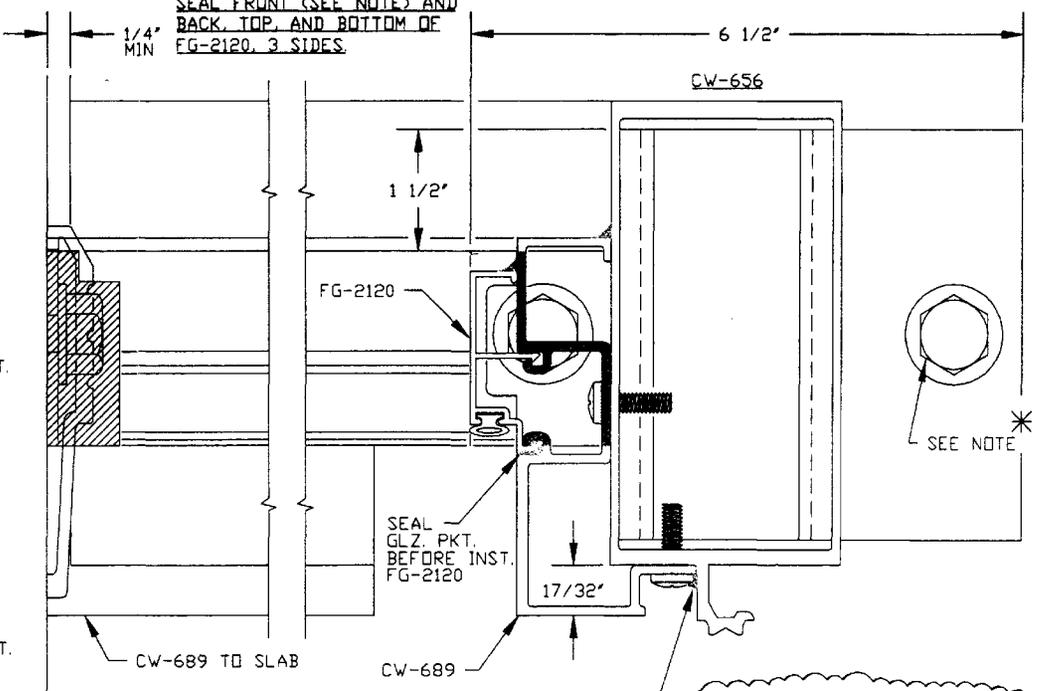

DETAIL 7 IS FOR ILLUSTRATION
PURPOSES ONLY. NOT PART OF
THIS APPROVAL. SEE WINDOW WALL
SYS FOR REFERENCE DETAILS.

- NOTE:
1. ANCHOR THRESHOLD TO SLAB ONLY.
 2. STD PREP FOR O.P.
 - * 3. RED HEAD ITW 3/8"-16 SLEEVE ANCHORS WITH 2 PART EPOXY SET INTO 4000 PSI PRECAST CONCRETE 1/2" EMBEDMENT.
 4. PERIMETER SEAL UNDER SIDE OF MULL ANCHOR, ONCE SECURED SEAL OUTSIDE OF MULL TO SLAB AND ANCHOR PERIMETER SEAL SUBFRAME, CW-689, TO MULL, CW-686, ANCHOR AT SLAB.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 02-0904-07
Expiration Date 02/24/2007

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE: June 24, 1999
BY: Ishag J. Chaudh
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 99-0127-04

By: Ishag J. Chaudh
Miami Dade Product Control
Division

A	PER DADE COUNTY	5/20/99	J.G.
No.	REVISION	DATE	BY


VISTAWALL
ARCHITECTURAL PRODUCTS
809 AIRPORT RD. TERRELL TX 75160 (972) 551-4100

THE VISTAWALL GROUP
BUTLER MANUFACTURING COMPANY

375 ALUMINUM STOREFRONT
DOOR (MS) WITH TRANSOM

DATE:	8-15-95
DRAWN BY:	L.F.B
DWG. No.:	CW250-MSD

SHEET	5
OF	7

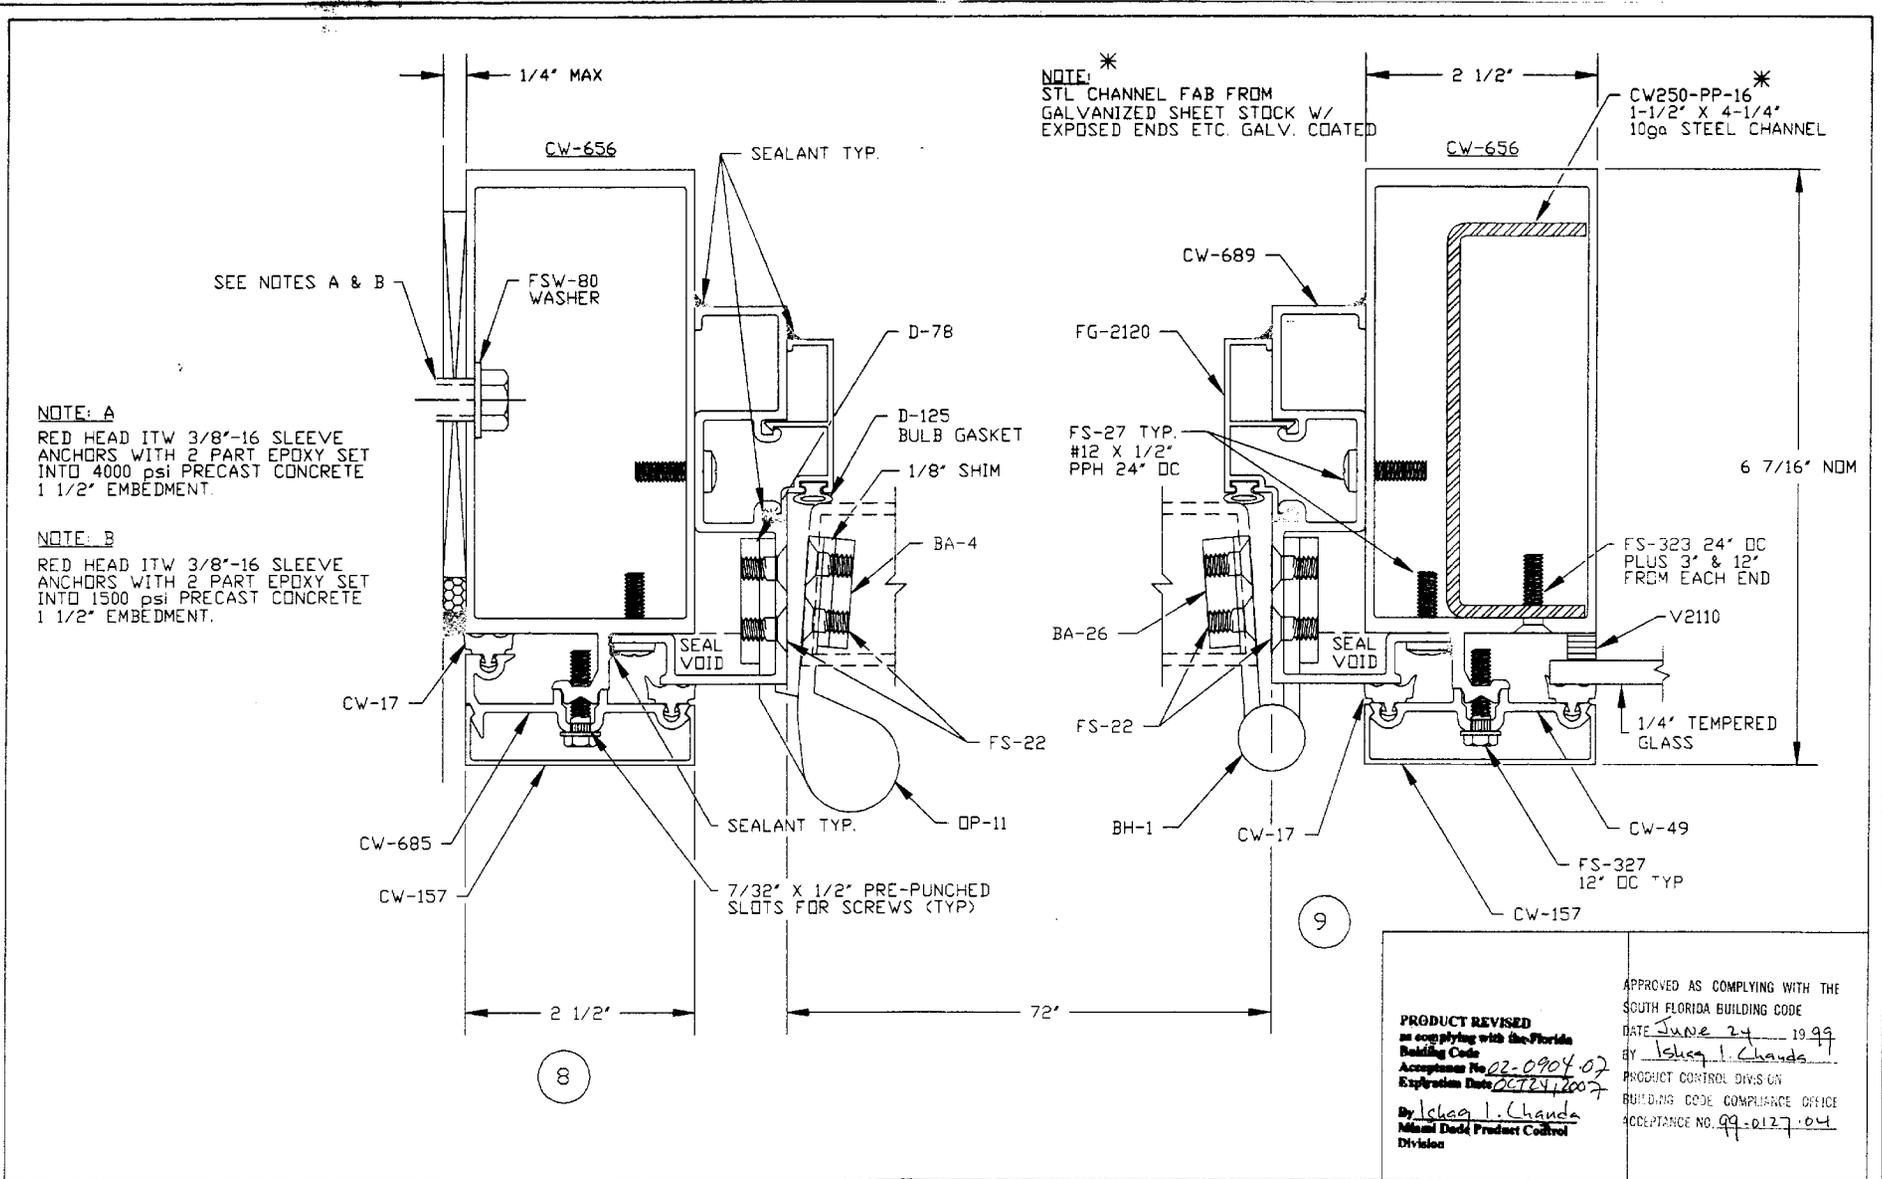

No.	REVISION	DATE	BY
A	PER DADE COUNTY	5/20/99	J.G.




VISTAWALL
ARCHITECTURAL PRODUCTS
808 AIRPORT RD. TERRELL TX 75160 (972) 351-6100

THE VISTAWALL GROUP
BUTLER MANUFACTURING COMPANY

375 ALUMINUM STOREFRONT DOOR (MS) WITH TRANSOM


DATE:	8-15-95
DRAWN BY:	L.F.B
DWG. No.:	CW250-MSD

SHEET	6
OF	7

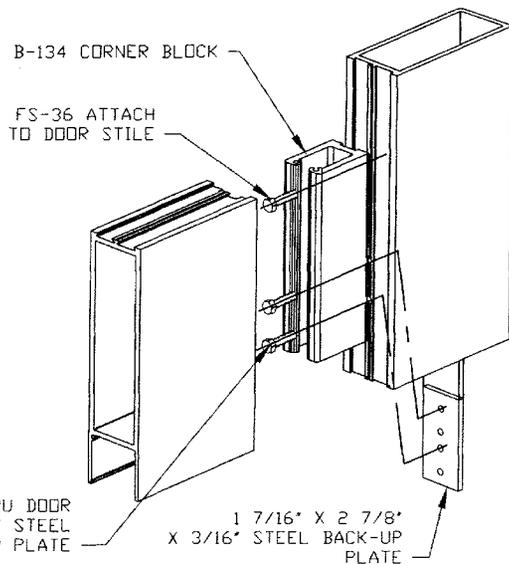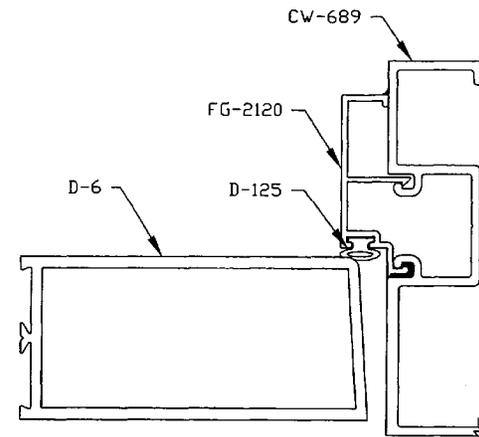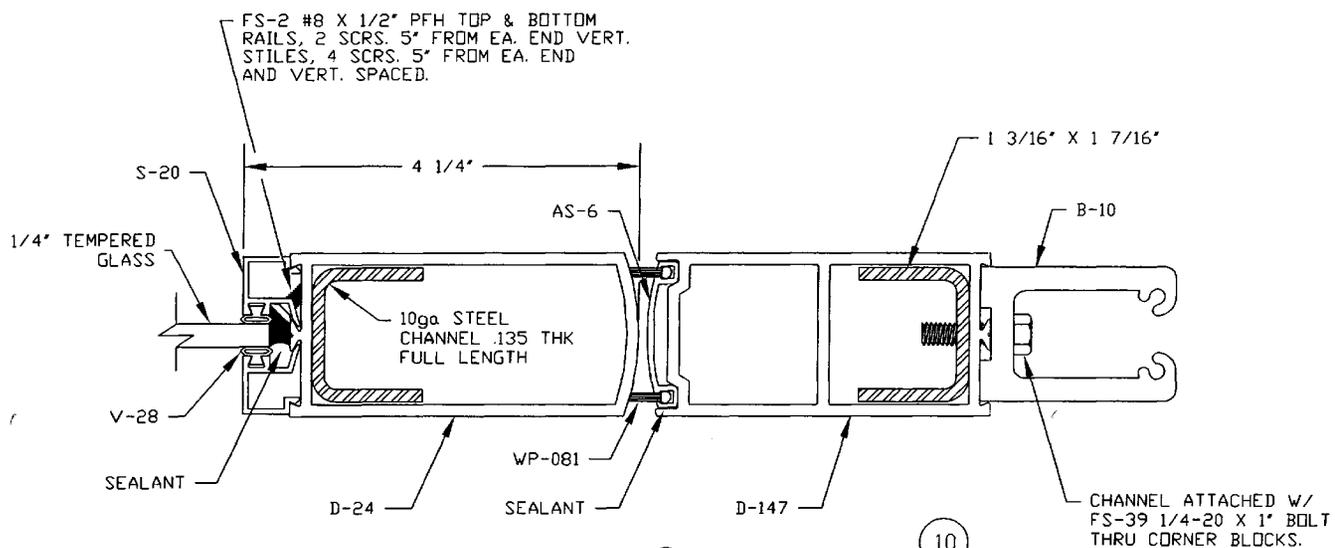

(B) TYPICAL DOOR CORNER ASSEMBLY DETAIL

WELD DOOR RAIL TO STILE AT TOP & BOTTOM OF RAIL

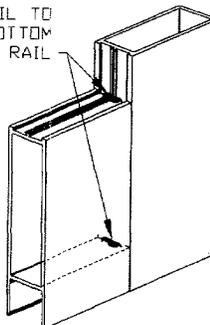

NOTE:

1. STL CHANNEL COATED W/ ZINC CHROMATE PRIMER.
2. PERIMETER SEAL GLASS TO DOOR PERIMETER IMMEDIATELY INSTALL DOOR AND ADJUST IN NORMAL MANNER.
3. APPLY THIN BEAD OF SEALANT AT INTERIOR OF ADJUSTABLE ASTRAGAL AFTER ADJUSTMENT FOR FIT AND CLOSING SPEED ARE MADE.

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 02-0904.07
 Expiration Date OCT 24, 2007
 By *Ishant K. Chouda*
 Miami Dade Product Control
 Division

B	ADD CORNER DTLS	8/21/02	P.C.
A	PER DADE COUNTY	5/20/99	J.G.
No.	REVISION	DATE	BY

VISTAWALL
 ARCHITECTURAL PRODUCTS
 803 AIRPORT RD. TERRELL TX 75160 (972) 551-6100
 THE VISTAWALL GROUP
 BUTLER MANUFACTURING COMPANY

375 ALUMINUM STOREFRONT
 DOOR (MS) WITH TRANSOM

DATE: 8-15-95
 DRAWN BY: L.F.B
 DWG. No.: CW250-MSD

SHEET 7
 OF 7