



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Super Sky Products, Inc.
10301 North Enterprise Drive
Mequon, Wisconsin 53092**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Standard Tubular Skylight System – Small Missile

APPROVAL DOCUMENT: Drawing No. 960209, titled “ Super Sky’s Standard Tubular Skylight Glazing System ”, sheets A, A1, A1A, A2, A2A, A3, and A4 of 7, prepared by David S. Barron, P.E., last revision #6 dated November 14, 2002 bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises & renews** NOA # 99-1019.08 & consists of this page 1 & approval document mentioned above. The submitted documentation was reviewed by **Helmy A. Makar, P.E.**




**NOA No 02-1009.06
Expiration Date: 12/24/2007
Approval Date: 12/12/2002
Page 1**

SUPER SKY'S STANDARD TUBULAR SKYLIGHT SYSTEM


1) **SYSTEM DESCRIPTION:** SUPER SKY'S STANDARD TUBULAR SKYLIGHT GLAZING SYSTEM CONSISTS OF AN EXTRUDED ALUMINUM STRUCTURAL FRAME (6061-T6), CUSTOM ENGINEERED TO SUIT A PARTICULAR PROJECT. THE EXTRUDED FRAME IS CONNECTED TOGETHER USING ALUMINUM CHANNEL CLIPS, ANCHOR PLATES, AND GUSSET PLATES, AS SHOWN ON DRAWINGS A1-A4. THE GLASS IS ATTACHED TO THE FRAME USING ALUMINUM RETAINERS (6063-T5), AND 1/4"-20 STAINLESS STEEL TORX HEAD SCREWS 6" O.C. THE SCREWS ENGAGE THE SERRATIONS IN THE ALUMINUM EXTRUSIONS BELOW. EPDM GASKETS ARE USED ON THE INTERIOR (1/8" X 1/2") AND EXTERIOR (1/4" X 3/8") TO CUSHION THE GLASS, AND A FULL SILICONE WEATHER SEAL AND SNAP-ON CAPS ARE APPLIED TO PREVENT AIR AND WATER INFILTRATION.

2) **SKYLIGHT TYPES:** SINCE ALMOST ALL SKYLIGHTS BUILT USING SUPER SKY'S STANDARD TUBULAR GLAZING SYSTEM ARE CUSTOM DESIGNED FOR A PARTICULAR BUILDING, VIRTUALLY NONE OF THEM ARE EXACTLY THE SAME. IN RECOGNITION OF THIS FACT, THE TEST SPECIMENS AS SHOWN ON SHEETS A1-A4 WERE DEVELOPED SO AS TO TEST THE FOUR STANDARD DETAILS USED ON MOST SKYLIGHT PROJECTS (CURB, RAFTER, CROSSBAR, AND KNEE). THE DESIGN PRESSURE, GLASS TYPE, AND GLASS SIZES WERE ALSO SELECTED TO SUIT THE MOST POSSIBLE SKYLIGHT PROJECTS.


EXAMPLES OF THESE SKYLIGHT TYPES ARE SHOWN BELOW.

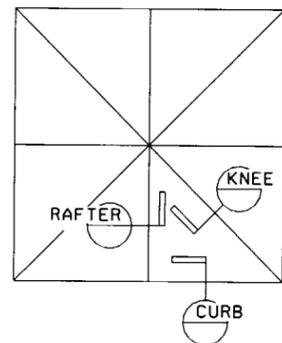


PYRAMID

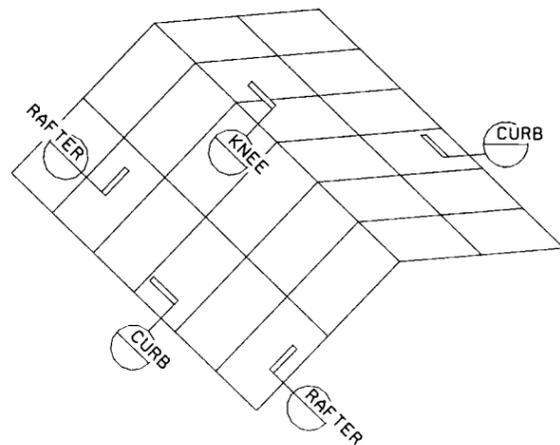


RIDGE

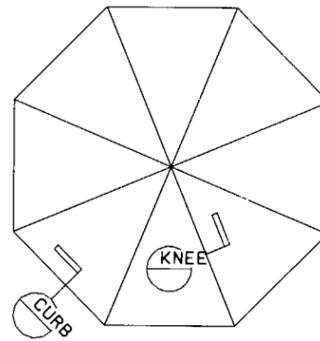

DOME

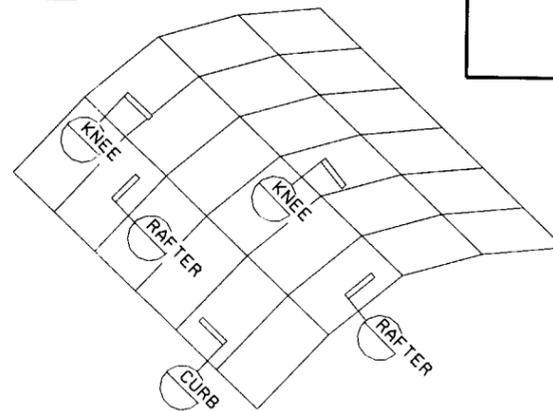

VAULT

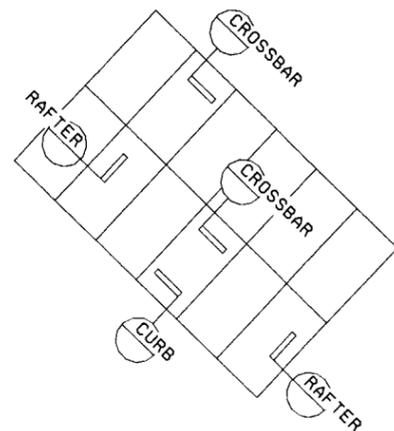

SINGLE PITCH

SUPER SKY'S STANDARD TUBULAR SKYLIGHT GLAZING SYSTEM

PRODUCT APPROVAL TESTING
 PER TAS-201, TAS-202, TAS-203

STANDARD DETAILS TESTED:

1. CURB (SEE DETAIL 1/A2)
2. RAFTER (SEE DETAIL 3/A2)
3. CROSSBAR (SEE DETAIL 2/A2)
4. KNEE [HIP] (SEE DETAIL 1/A3)

PLEASE SEE DRAWINGS A1-A4, INCLUDING A1A AND A2A FOR COMPLETE SPECIFICATIONS OF THE MOCK-UPS TESTED.

GENERAL NOTES:

- 1) THIS SYSTEM IS APPROVED FOR: DESIGN PRESSURES UP TO ± 120 PSF
- 2) GLASS TYPE TESTED:
 3/16" CLEAR LAMINATED GLASS BY VIRACON, INC. CONSISTING OF:
 1/4" CLEAR HEAT STRENGTHENED GLASS .060" BUTACITE PVB INTERLAYER, BY E.I. DUPONT DENEMOURS
 1/4" CLEAR HEAT STRENGTHENED GLASS
- 3) SMALL MISSILE IMPACT ONLY (STEEL BALL BEARINGS). THIS GLASS PRODUCT IS APPROVED FOR USE 30' ABOVE GRADE OR HIGHER.
- 4) APPROVED UP TO A MAXIMUM LITE SIZE OF 30 SQ. FT.
- 5) THE ALUMINUM EXTRUSIONS TESTED WERE SIZED PER STRUCTURAL CALCULATIONS TO SUIT THE SPANS AND DESIGN PRESSURE TESTED.
- 6) ALUMINUM CONTACTING MATERIALS NOT CONSIDERED COMPATIBLE SHALL BE PROTECTED PER SECTION 2003.8.4.2 OF THE FLORIDA BUILDING CODE, 2001 EDITION.
- 7) THIS APPROVAL IS LIMITED TO THE MAXIMUM AREA OF THE 3/16" LAMINATED GLASS, THE FULLY ASSEMBLED GLAZING DETAILS SYSTEM TO THE SUPPORTING RAFTERS AND THE MAXIMUM DESIGN PRESSURE SHOWN ON THESE DRAWINGS.
- 8) THE STRUCTURAL ADEQUACY OF THE SUPPORTING STRUCTURAL MEMBERS, (CURBS, RAFTERS, PURLINS, AND ALL OTHER FRAMING MEMBERS) IS NOT PART OF THIS APPROVAL AND IT SHALL BE REVIEWED BY THE STRUCTURAL PLANS EXAMINER OF THE CORRESPONDING BUILDING DEPARTMENT.



SUPER SKY PRODUCTS, INC.
 10301 N. ENTERPRISE DR.
 MEQUON, WISCONSIN 53092
 414-242-2000

REVISIONS

11/14/02 CH

PRODUCT CONTROL REF. NO. 96-0035

PROJECT MOCK-UP -
 DADE COUNTY
 PRODUCT APPROVAL

DADE COUNTY, FL

ENGINEER:
 DAVE BARRON
 CONSULTING ENG.

MEQUON, WI

TEST LABORATORY

HURRICANE TEST LAB.
 RIVIERA BEACH, FL

DADE COUNTY USE

ENGINEER STAMP

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 02-1009.06
 Expiration Date 12/24/2007

By *Helmut A. Meier*
 Miami Dade Product Control
 Division

David J. Baum
 11-15-02

DRAWN BY DATE
 GM 03/3/99

SCALE APPROVAL
 --- 1 (DP)

PROJECT NO.
 960209

SHEET
 A1-A4
 A1A
 A2A

A
 OF 7

THIS IS A CAD PRODUCED DRAWING;
 DO NOT MAKE MANUAL CHANGES. 19960209A.S1



SUPER SKY PRODUCTS, INC.
 10301 N. ENTERPRISE DR.
 MEQUON, WISCONSIN 53092
 414-242-2000

11/14/02 CH

- REVISIONS
- PER SSPI 02/11/98 MEB
 - PER CALCS 03/20/98 MEB
 - PER SSPI 10/12/98 JK
 - PER SSPI 11/17/98 JK
 - AS TESTED 03/3/99 RN

PRODUCT CONTROL REF. NO. 96-0035

PROJECT MOCK-UP - DADE COUNTY PRODUCT APPROVAL
 DADE COUNTY, FL
 ENGINEER: DAVE BARRON CONSULTING ENG.
 MEQUON, WI
 TEST LABORATORY


TITLE ELEVATION & THRU-SECTION

DRAWN BY JG2 DATE 02/14/97


SCALE AS NOTED APPROVAL 1 (DP)

PROJECT NO. 960209

SHEET **A1** OF 7

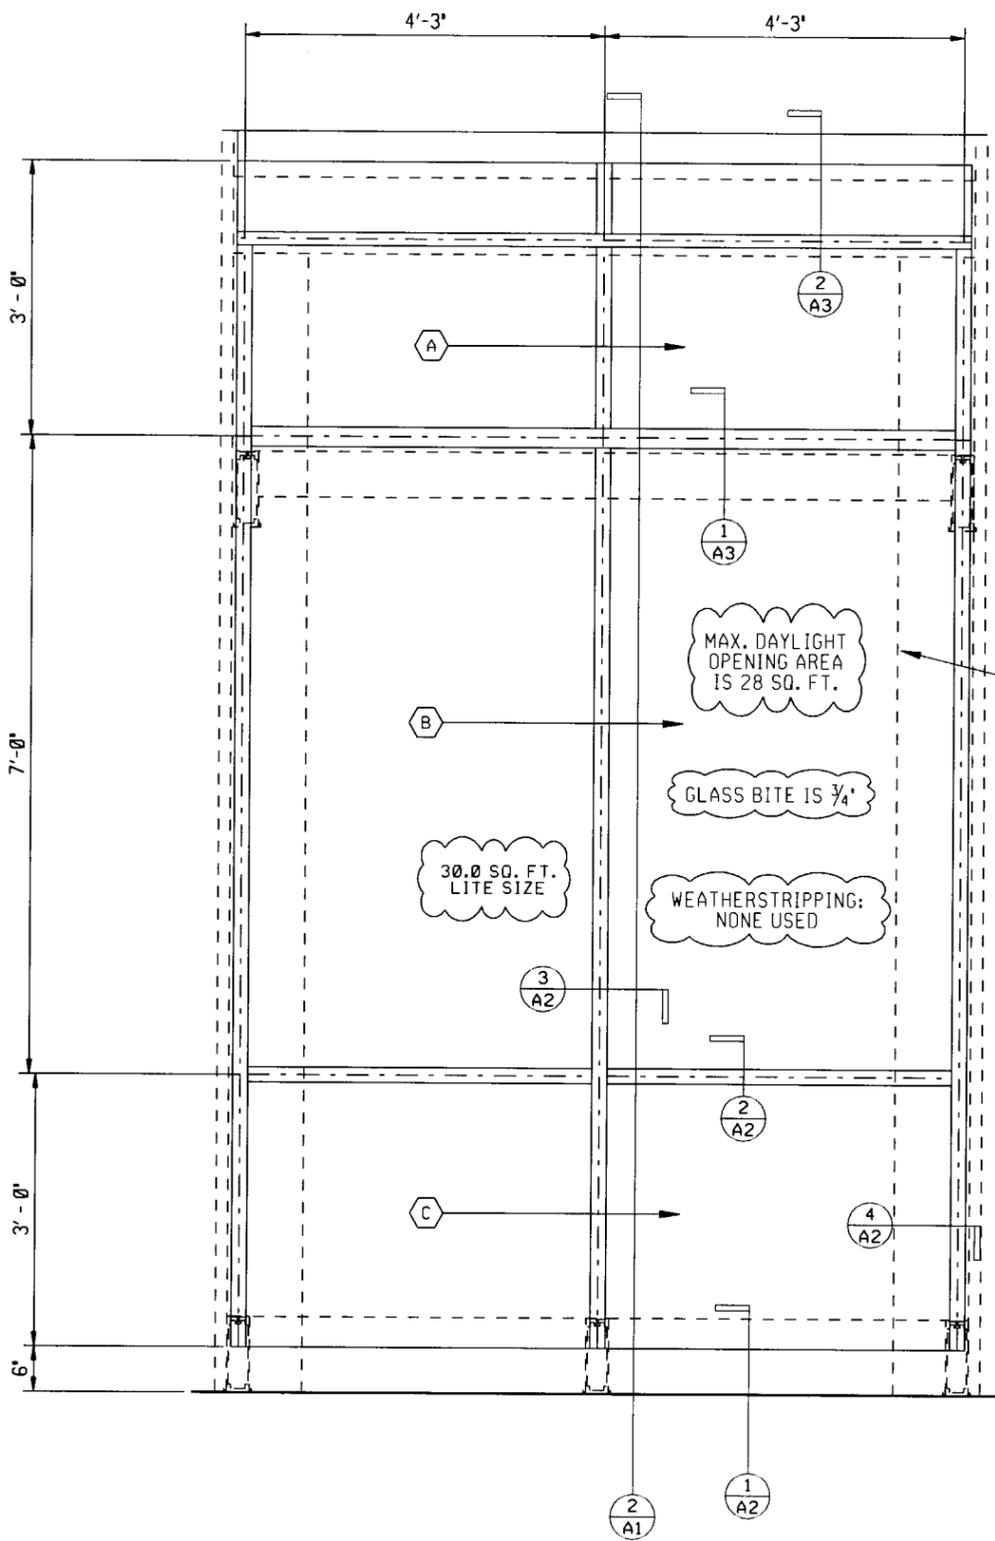

ALUMINUM SUPPORT FRAME BY SUPER SKY SEE DRAWINGS S1 & S2 FOR DETAILS (NOT PART OF PRODUCT APPROVAL)

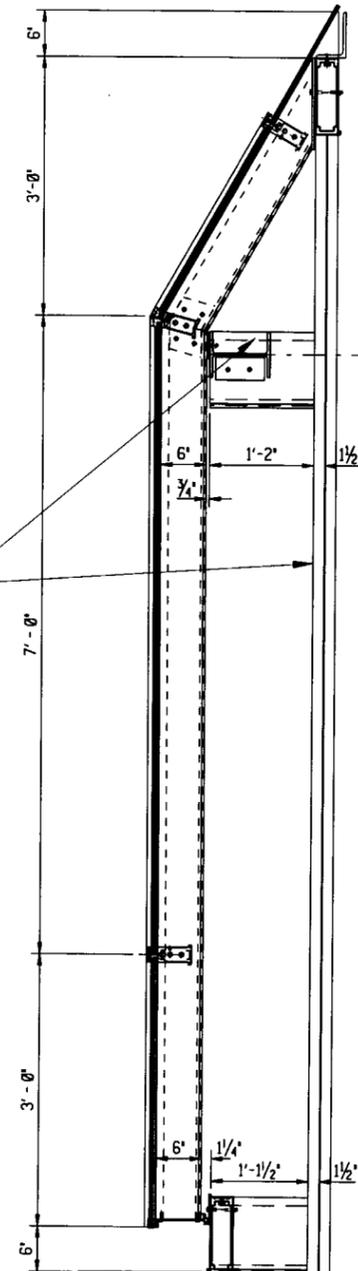

1 ELEVATION (1 REQ'D)
 A1 1'-1'-0"

2 THRU-SECTION
 A1 1'-1'-0"

DADE COUNTY USE

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No 02-1009.06
 Expiration Date 12/24/2007
 By *Helmut A. Maler*
 Miami Dade Product Control Division

ENGINEER STAMP

David D. Baum
 11-15-02

GLASS DRAWINGS:
 23735M - LAMINATED
 23736M - SENTRYGLASS

THIS IS A CAD PRODUCED DRAWING; DO NOT MAKE MANUAL CHANGES. 960209A.S1



SUPER SKY PRODUCTS, INC.
 10301 N. ENTERPRISE DR.
 MEQUON, WISCONSIN 53092
 414-242-2000

REVISIONS

- △ 11/14/02 CH
- △ PER SSPI 10/12/98 JK
- △ PER SSPI 11/17/98 JK
- △ AS TESTED 03/3/99 RN

PRODUCT CONTROL REF. NO. 96-0035

PROJECT
 MOCK-UP -
 DADE COUNTY
 PRODUCT APPROVAL
 DADE COUNTY, FL
 ENGINEER:
 DAVE BARRON
 CONSULTING ENG.
 MEQUON, WI
 TEST LABORATORY


TITLE
 ELEVATION
 &
 END RAFTER SECTION

DRAWN BY DATE
 MEB 10/02/98

SCALE APPROVAL
 AS NOTED 1 (DP)


PROJECT NO.
 960209

SHEET
A1A
 OF 7

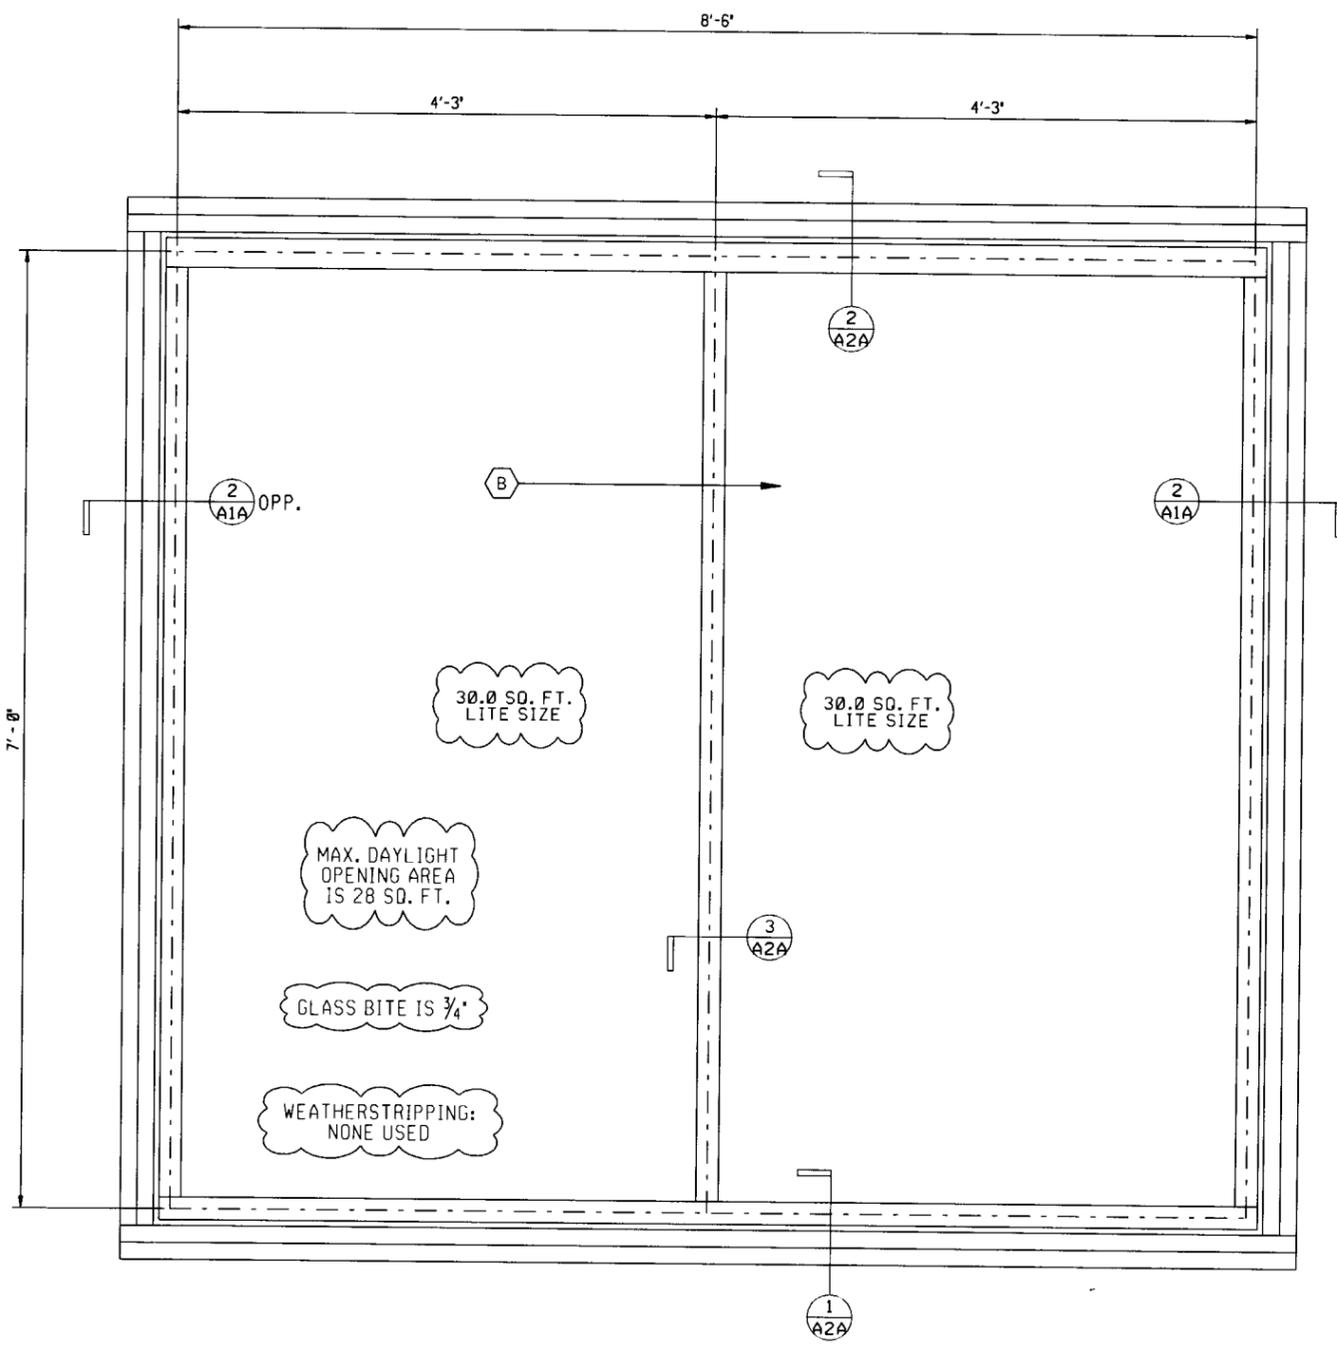

1 A1A ELEVATION (1 REQ'D)
 1/2" = 1' - 0"

3/8" ST. STL. CAPSCREW
 (2 PER MULLION, 1/8" O.C.)
 EXTRUDED ANCHOR PLATE
 W/TAPPED HOLES
 350x3" RAFTER TUBE

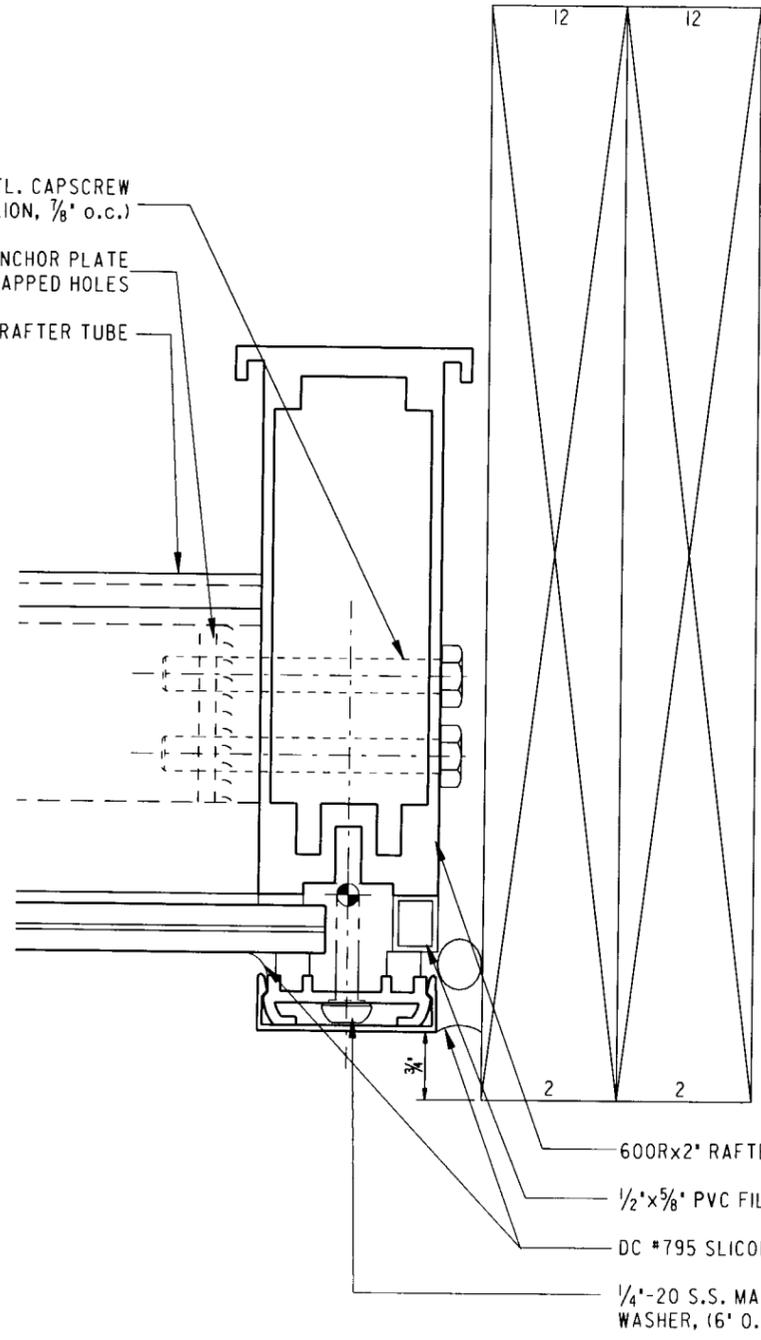


2 A1A END RAFTER SECTION
 FULL SCALE


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 02-1009.06
 Expiration Date 12/24/2007
 By Helms A. Miller
 Miami Dade Product Control
 Division

GLASS DRAWINGS:
 23735M - LAMINATED
 23736M - SENTRYGLASS


James D. Baum
 11-15-02

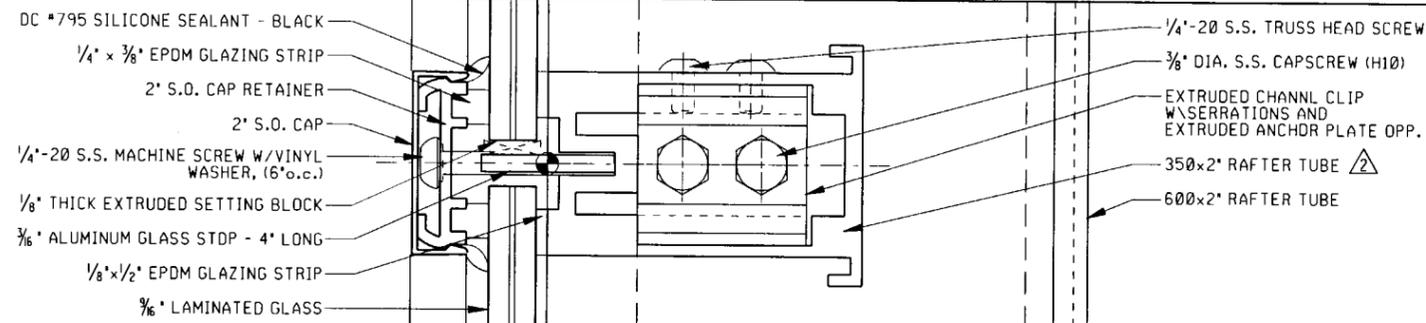


2 CROSSBAR SECTION
 A2 FULL SCALE

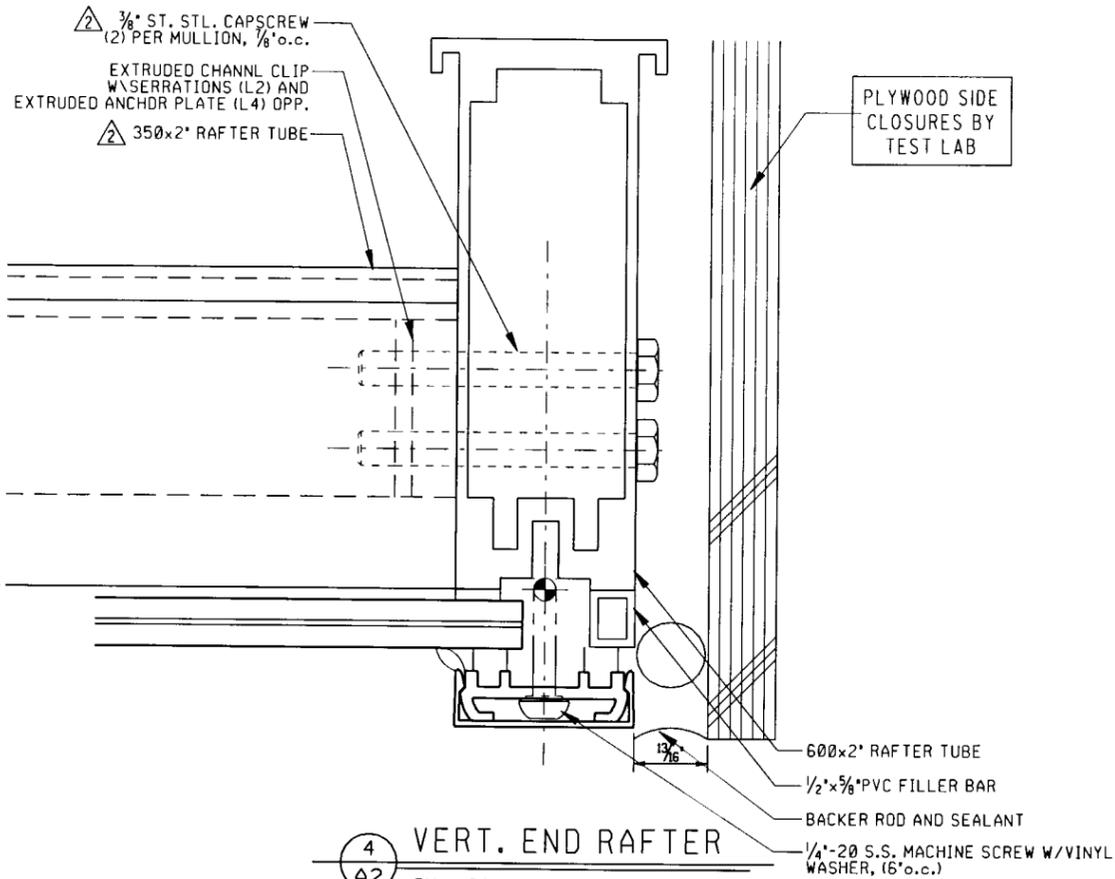

4 VERT. END RAFTER
 A2 FULL SCALE

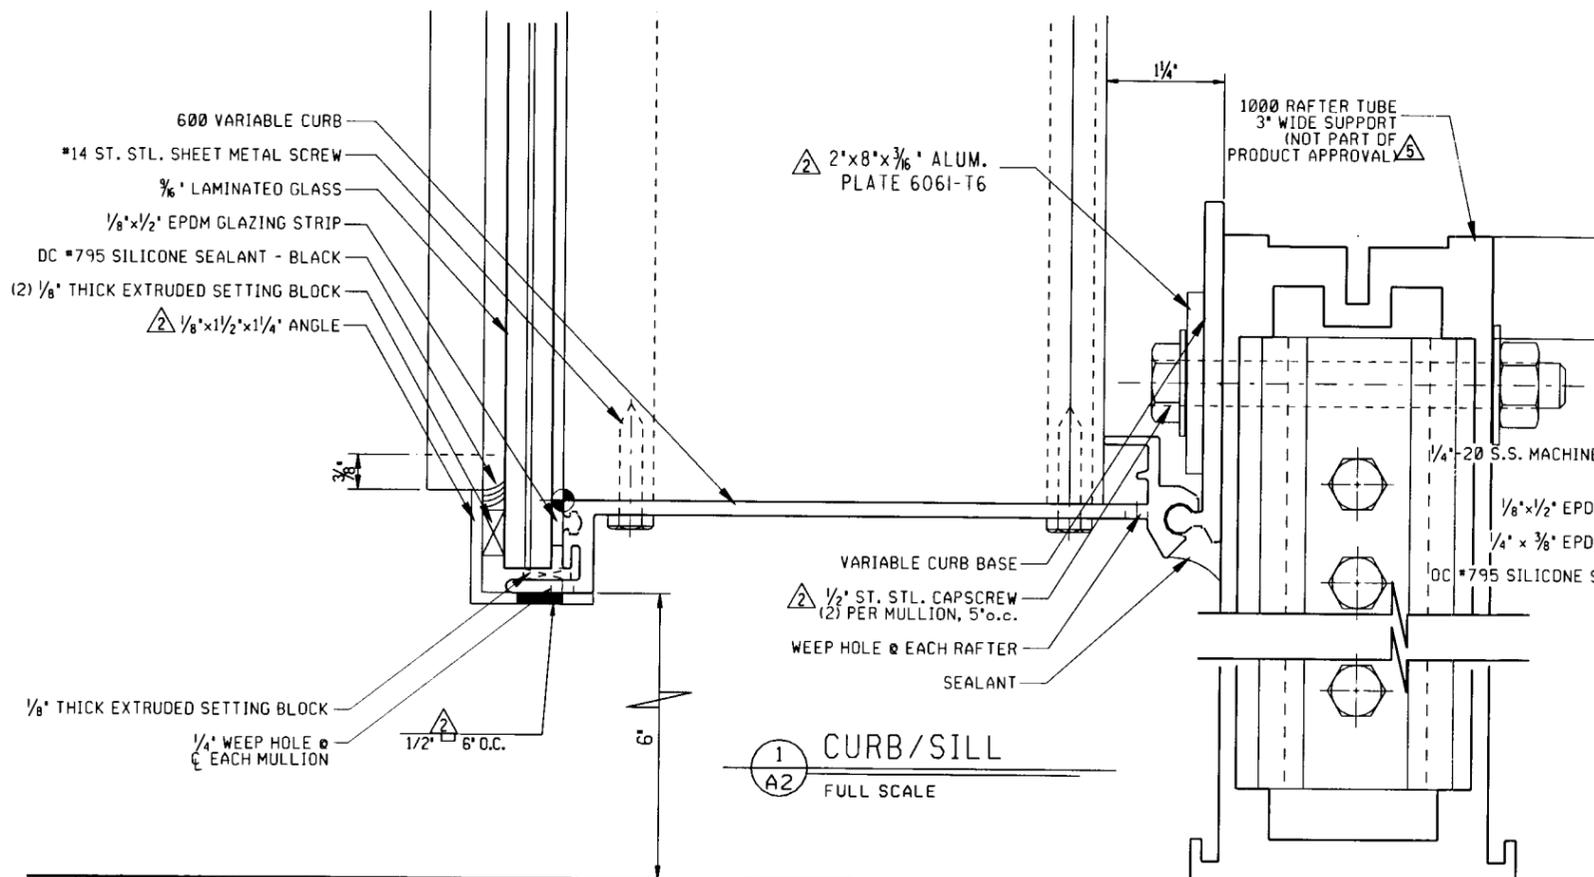

1 CURB/SILL
 A2 FULL SCALE

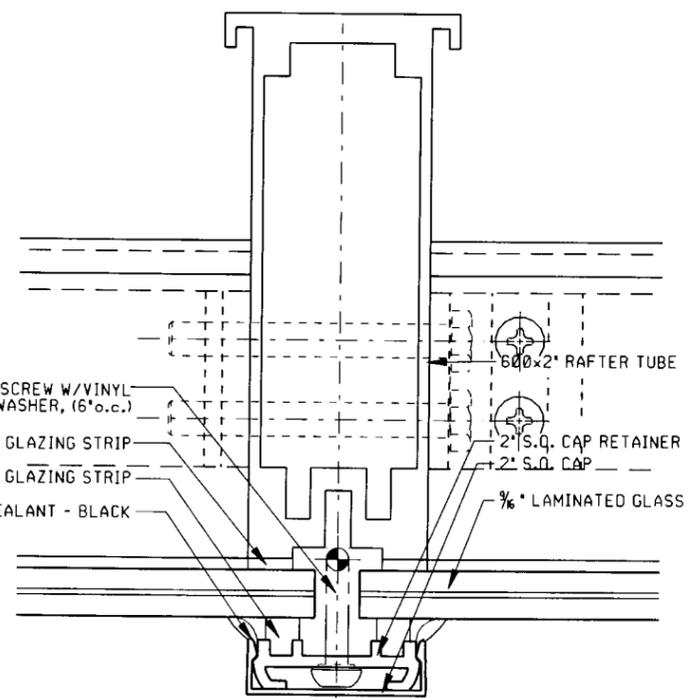

3 VERT. RAFTER
 A2 FULL SCALE



SUPER SKY PRODUCTS, INC.
 10301 N. ENTERPRISE DR.
 MEQUON, WISCONSIN 53092
 414-242-2000

11/14/02 CH

REVISIONS

PER SSPI 02/11/98	MEB
PER CALCS 03/20/98	MEB
PER SSPI 10/12/98	JK
PER SSPI 11/17/98	JK
AS TESTED 03/3/99	RN

PRODUCT CONTROL REF. NO. 96-0035

PROJECT MOCK-UP - DADE COUNTY PRODUCT APPROVAL

DADE COUNTY, FL
 ENGINEER: DAVE BARRON CONSULTING ENG.
 MEQUON, WI
 TEST LABORATORY

DADE COUNTY USE

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No 02-1009.06
 Expiration Date 12/24/2007

By *Helmut A. Mahr*
 Miami Dade Product Control Division

ENGINEER STAMP

David D Barron
 11-15-02


TITLE SECTION DETAILS

DRAWN BY	DATE
JG2	02/14/97
SCALE	APPROVAL
FULL	1 (DP)
PROJECT NO.	
960209	

SHEET A2 OF 7


SHOP NOTE:
COUNTERBORE WOOD
SO BOLT HEADS DON'T
STICK OUT

- DC #795 SILICONE SEALANT-BLACK w/BACKER ROD
- 1/4" x 3/8" EPDM GLAZING STRIP
- 1/4"-20 S.S. MACHINE SCREW W/VINYL WASHER (6" o.c.)
- 12"-55' HIP CAP
- 12"-55' HIP CAP RETAINER
- DC #795 SILICONE SEALANT - BLACK
- 350x2" 12"-55' HIP RAFTER TUBE
- 3/8" DIA. S.S. CAPSCREW
- EXTRUDED CHANNEL CLIP W/SERRATIONS AND EXTRUDED ANCHOR PLATE OPP.
- 600x2" RAFTER TUBE
- 3/8" LAMINATED GLASS

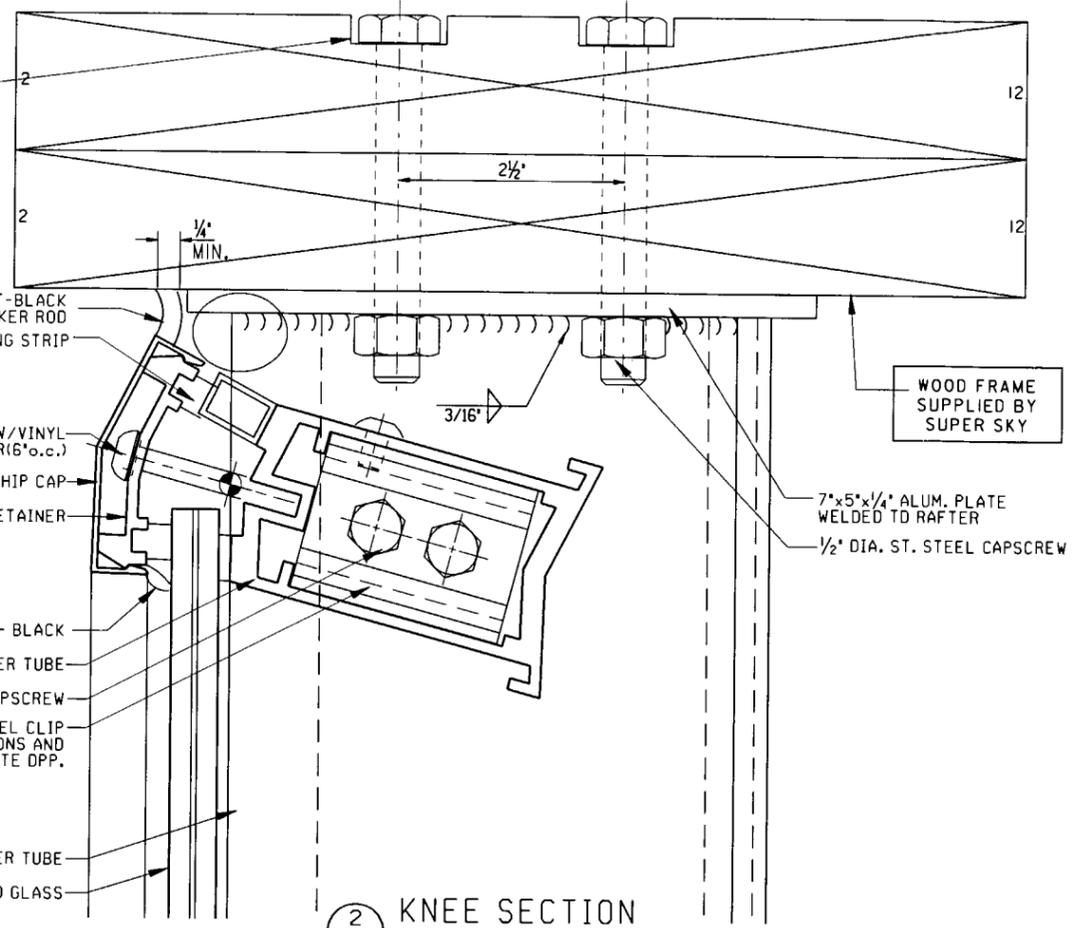


2 KNEE SECTION
A2A FULL SCALE

- 3/8" LAMINATED GLASS
- 1/8" x 1/2" EPDM GLAZING STRIP
- DC #795 SILICONE SEALANT - BLACK
- (2) 1/8" THICK EXTRUDED SETTING BLOCK
- 2" SNAP-ON CAP AND RETAINER
- 1/4"-20 S.S. MACHINE SCREW W/VINYL WASHER (6" o.c.)
- 1/2" x 3/8" PVC FILLER BAR
- DC #795 SILICONE SEALANT-BLACK w/BACKER ROD

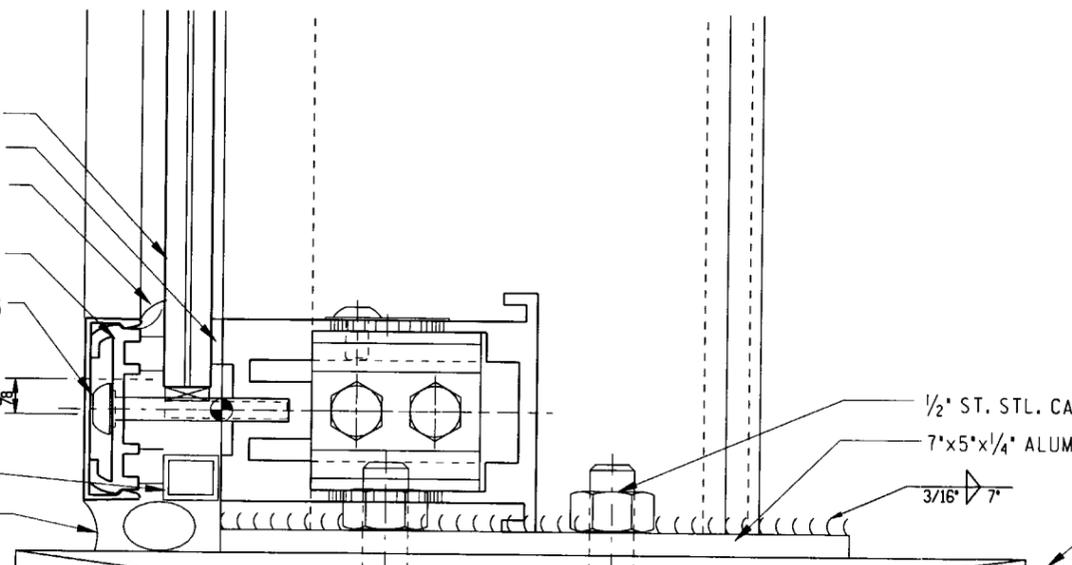


1 CURB/SILL
A2A FULL SCALE

SHOP NOTE:
COUNTERBORE WOOD
SO BOLT HEADS DON'T
STICK OUT

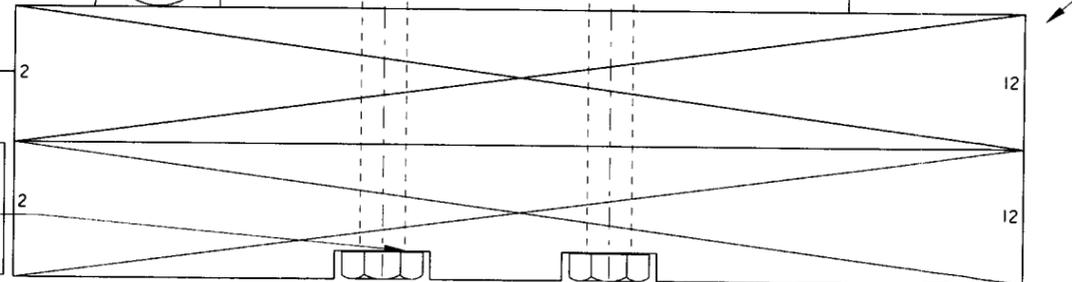

- 600x2" RAFTER TUBE
- 3/8" ST. STL. CAPSCREW (2) PER MULLION, 1/8" o.c.
- 350x2" RAFTER TUBE

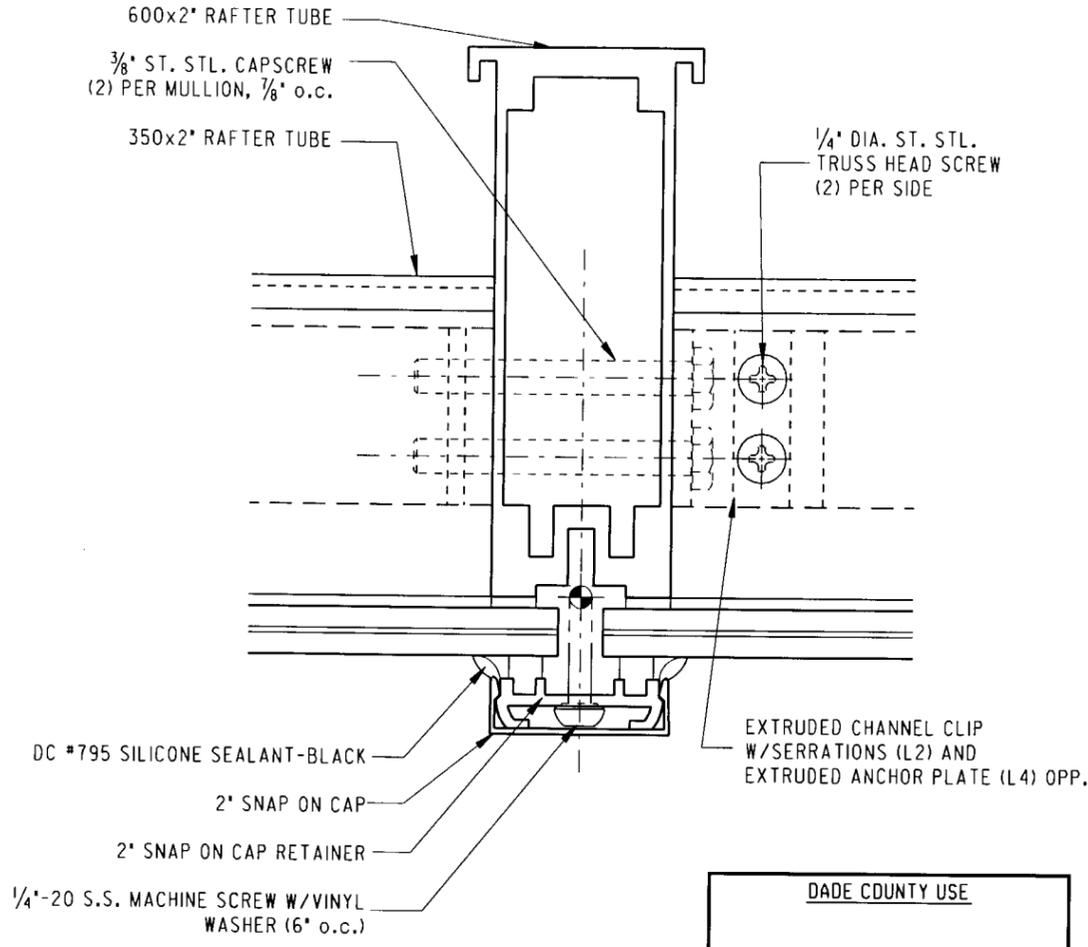

3 RAFTER SECTION
A2A FULL SCALE

WOOD FRAME
SUPPLIED BY
SUPER SKY



SUPER SKY
PRODUCTS, INC.
10301 N. ENTERPRISE DR.
MEQUON, WISCONSIN 53092
414-242-2000

REVISIONS	
△	11/14/02 CH
△	PER SSPI 10/12/98 JK
△	PER SSPI 11/17/98 JK
△	AS TESTED 03/3/99 RN

PRODUCT CONTROL REF. NO. 96-0035

PROJECT MOCK-UP -
DADE COUNTY PRODUCT APPROVAL
DADE COUNTY, FL
ENGINEER:
DAVE BARRON
CONSULTING ENG.
MEQUON, WI
TEST LABORATORY

DADE COUNTY USE
PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 02-1009.06
Expiration Date 12/24/2007
By *Helmut A. M...*
Miami Dade Product Control
Division

ENGINEER STAMP
David S. Barron
11-15-02

DRAWN BY	DATE
MEB	10/02/98
SCALE	APPROVAL
FULL	1 (DP)
PROJECT NO.	960209

SHEET
A2A
OF 7



SUPER SKY PRODUCTS, INC.
 10301 N. ENTERPRISE DR.
 MEQUON, WISCONSIN 53092
 414-242-2000

11/14/02 CH

- REVISIONS
- △ PER SSPI 02/11/98 MEB
 - △ PER CALCS 03/20/98 MEB
 - △ PER SSPI 10/12/98 JK
 - △ PER SSPI 11/17/98 JK
 - △ AS TESTED 03/03/99 RN

PRODUCT CONTROL REF. NO. 96-0035

PROJECT MOCK-UP - DADE COUNTY PRODUCT APPROVAL

DADE COUNTY, FL
 ENGINEER: DAVE BARRON CONSULTING ENG.
 MEQUON, WI
 TEST LABORTORY

TITLE SECTION DETAILS


DRAWN BY: MM DATE: 02/14/97

SCALE: 1 (DP) APPROVAL:

PROJECT NO.: 960209

SHEET:

A3
OF 7

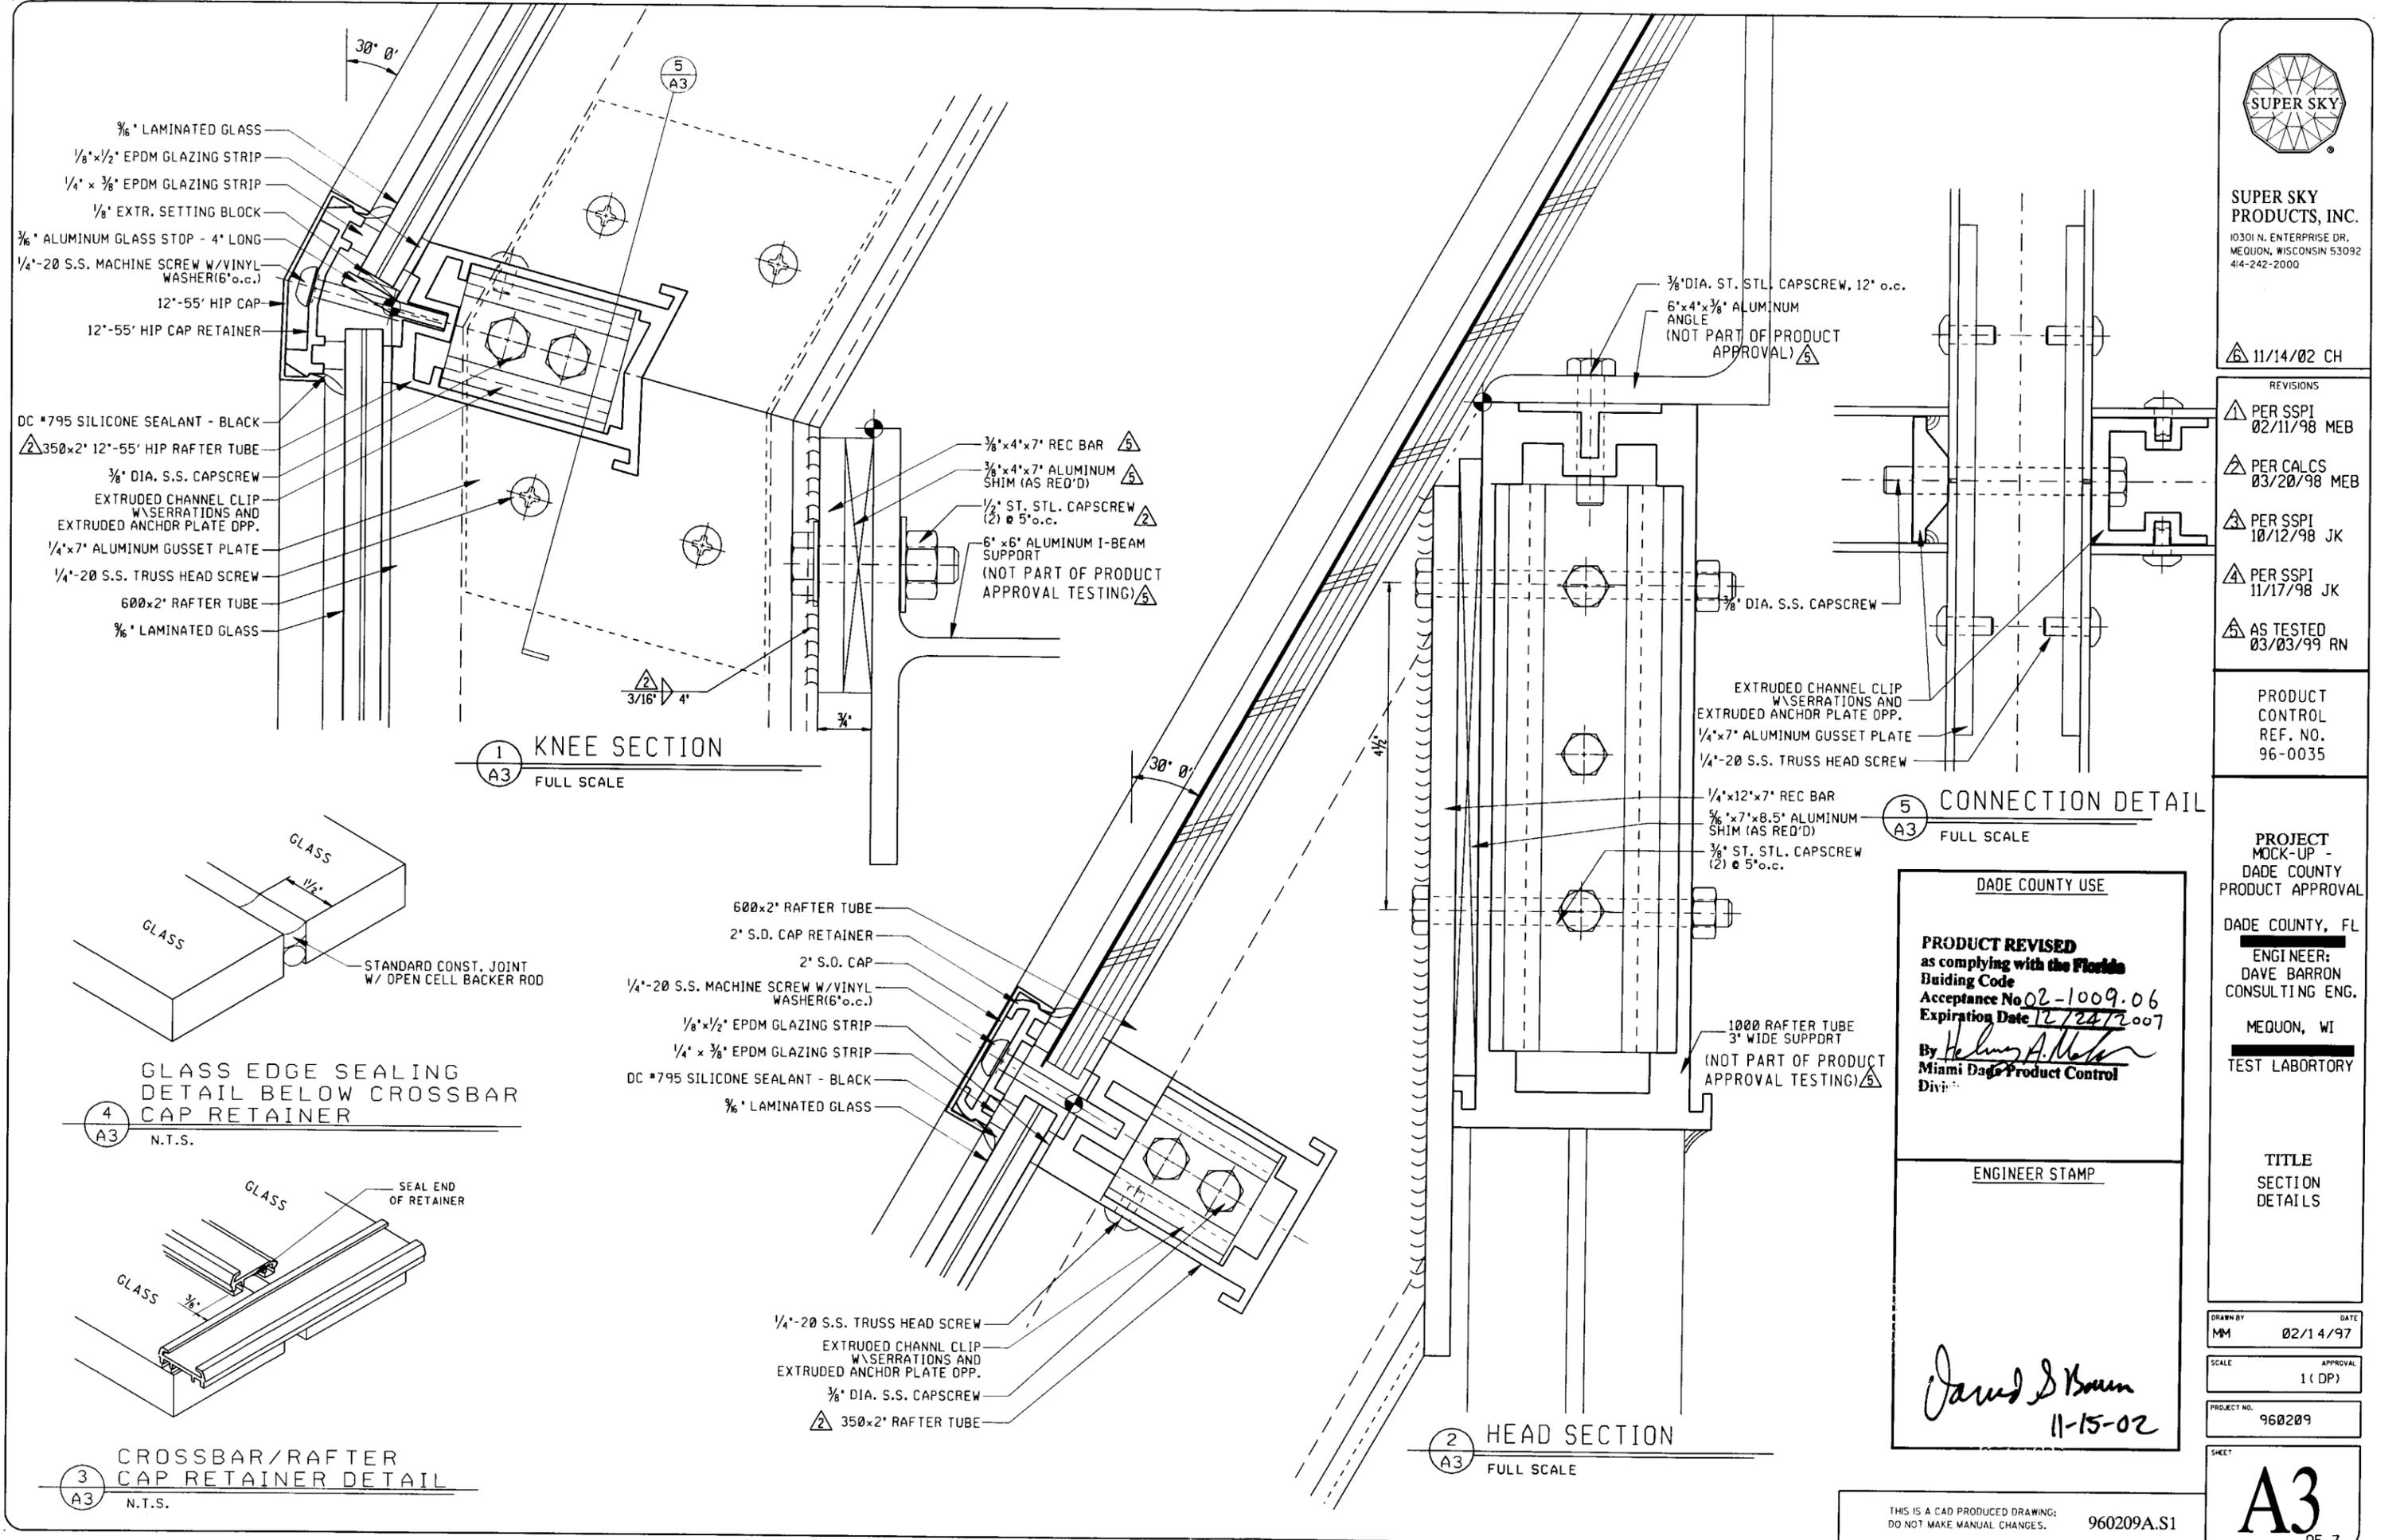


DADE COUNTY USE

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No. 02-1009.06
 Expiration Date 12/24/2007

By *Helmut A. Mohr*
 Miami Dade Product Control Division


ENGINEER STAMP

David S Barron
 11-15-02

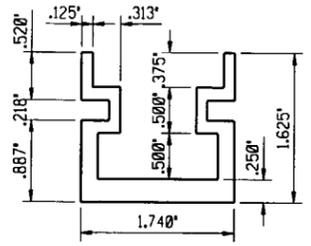


SUMMARY OF PROPERTIES
 Centre of Mass [0.87,0.574716,0]
 Surface area 1.0184 inch **2
 Moment about X axis 0.229661 inch **4
 Moment about Y axis 0.406868 inch **4
 Polar moment 0.636529 inch **4
 Principal Axes Rotation Angle = 0°-0°
 Radii of gyration:
 Polar 0.790586 inch
 X axis 0.47488 inch
 Y axis 0.632072 inch
 Weight Per Linear Foot 1.191528 lbs
 Aluminum Alloy 6061-T6

CHANNEL CLIP
 FULL SCALE




SUMMARY OF PROPERTIES
 Centre of Mass [0.866,0.206789,0]
 Surface area 0.635642 inch **2
 Moment about X axis 0.0118681 inch **4
 Moment about Y axis 0.110198 inch **4
 Polar moment 0.122066 inch **4
 Principal Axes Rotation Angle = -0°-0°
 Radii of gyration:
 Polar 0.438218 inch
 X axis 0.136642 inch
 Y axis 0.41637 inch
 Weight Per Linear Foot 0.743701 lbs
 Aluminum Alloy 6061-T6


ANCHOR PLATE
 FULL SCALE

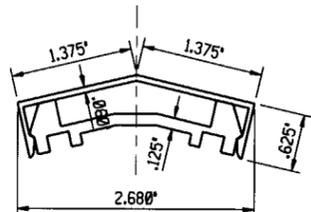


HIP CAP & RETAINER
 FULL SCALE

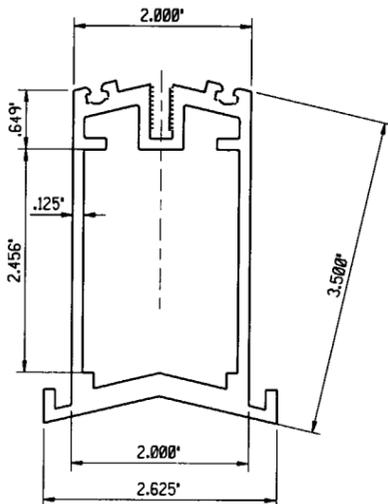


350 HIP TUBE
 FULL SCALE

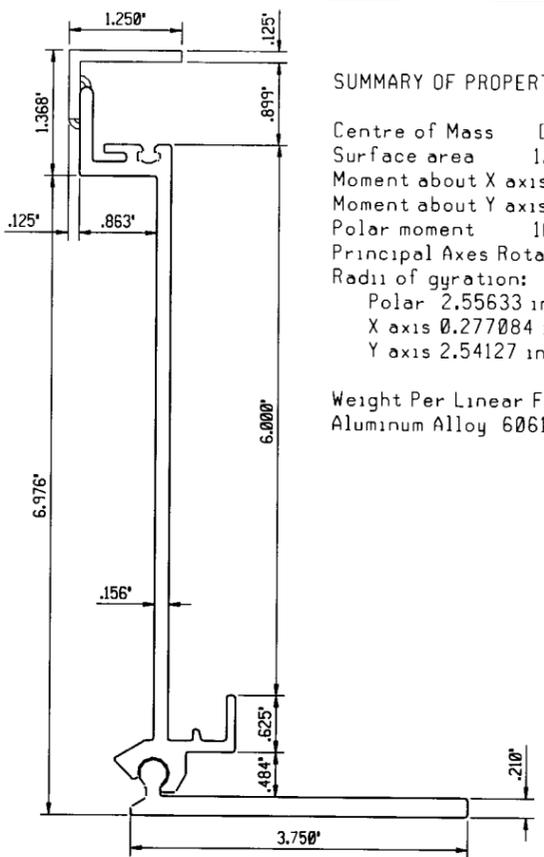

600 VARIABLE CURB
 FULL SCALE




RAFTER CAP & RETAINER
 FULL SCALE

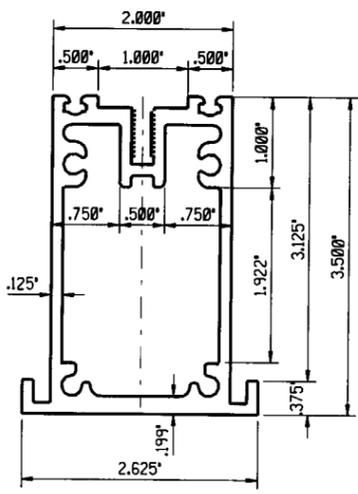


350 RAFTER TUBE
 FULL SCALE


SUMMARY OF PROPERTIES
 Centre of Mass [-1.35908,-0.607398,0]
 Surface area 1.67688 inch **2
 Moment about X axis 0.128744 inch **4
 Moment about Y axis 10.8294 inch **4
 Polar moment 10.9581 inch **4
 Principal Axes Rotation Angle = -85°-23°
 Radii of gyration:
 Polar 2.55633 inch
 X axis 0.277084 inch
 Y axis 2.54127 inch
 Weight Per Linear Foot 1.961950 lbs
 Aluminum Alloy 6061-T6

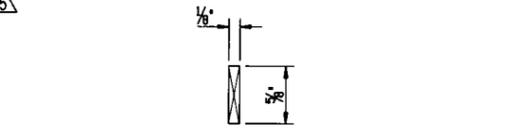

1/8" x 5/8" x 4" LONG SILICONE SETTING BLOCK
 FULL SCALE
 TYPE II SILICONE RUBBER
 HARDNESS..... (SHORE A) 80 + 5 DUROMETER
 COLOR..... BLACK

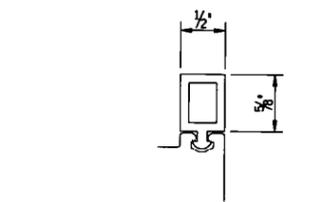


1/2" x 5/8" RIGID PVC FILLER BAR
 FULL SCALE
 RIGID PVC #820 W/ .095" (MIN) WALL

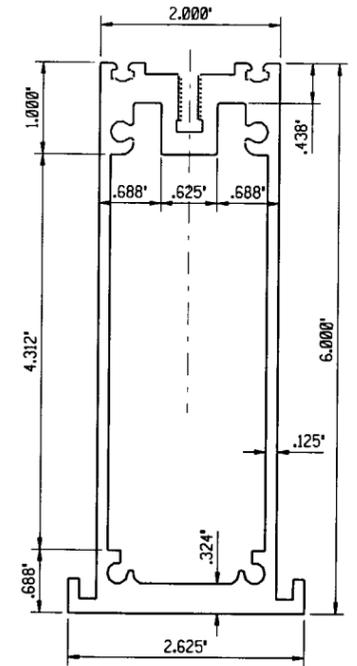


600 RAFTER TUBE
 FULL SCALE

SUMMARY OF PROPERTIES
 Centre of Mass [1.31252,3.04838,0]
 Surface area 3.25237 inch **2
 Moment about X axis 1.98402 inch **4
 Moment about Y axis 16.8859 inch **4
 Polar moment 18.8699 inch **4
 Principal Axes Rotation Angle = 90°-0°
 Radii of gyration:
 Polar 2.40871 inch
 X axis 0.781039 inch
 Y axis 2.27857 inch
 Weight Per Linear Foot 3.805273 lbs
 Aluminum Alloy 6061-T6

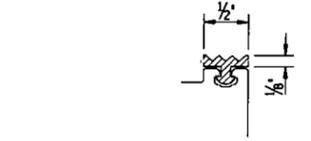

1/8" x 1/2" EPDM GLAZING STRIP
 FULL SCALE
 HARDNESS..... (SHORE A) 50 + 5 DUROMETER
 TENSILE STRENGTH..... 800 PSI (MIN)
 ELONGATION..... 300% (MIN)
 TEAR, DIE 8, PSI..... 65 (MIN)
 COLOR..... BLACK

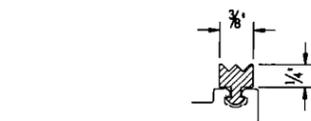

1/4" x 3/8" EPDM GLAZING STRIP
 FULL SCALE
 HARDNESS..... (SHORE A) 50 + 5 DUROMETER
 TENSILE STRENGTH..... 800 PSI (MIN)
 ELONGATION..... 300% (MIN)
 TEAR, DIE 8, PSI..... 65 (MIN)
 COLOR..... BLACK

SUMMARY OF PROPERTIES
 Centre of Mass [1.00003,2.12172,0]
 Surface area 1.20076 in **2
 Moment about X axis 0.290704 in **4
 Moment about Y axis 2.31602 in **4
 Polar moment 2.60673 in **4
 Principal Axes Rotation Angle = 90°-0°
 Radii of gyration:
 Polar 1.4734 in
 X axis 0.492037 in
 Y axis 1.38881 in
 Weight Per Linear Foot 1.404889 lbs
 Aluminum Alloy 6061-T6

SUMMARY OF PROPERTIES
 Centre of Mass [1.31246,1.7169,0]
 Surface area 2.12343 in **2
 Moment about X axis 1.2925 in **4
 Moment about Y axis 3.52933 in **4
 Polar moment 4.82184 in **4
 Principal Axes Rotation Angle = -90°-0°
 Radii of gyration:
 Polar 1.50691 in
 X axis 0.780183 in
 Y axis 1.28922 in
 Weight Per Linear Foot 2.484413 lbs
 Aluminum Alloy 6061-T6



SUPER SKY PRODUCTS, INC.
 10301 N. ENTERPRISE DR.
 MEQUON, WISCONSIN 53092
 414-242-2000

- REVISIONS
- PER SSP1 02/11/98 MEB
 - PER CALCS 03/20/98 MEB
 - PER SSP1 10/12/98 JK
 - PER SSP1 11/17/98 JK
 - AS TESTED 03/03/99 RN

PRODUCT CONTROL REF. NO. 96-0035

PROJECT MOCK-UP - DADE COUNTY PRODUCT APPROVAL
 DADE COUNTY, FL
 ENGINEER: DAVE BARRON CONSULTING ENG.
 MEQUON, WI
 TEST LABORATORY

DADE COUNTY USE
PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No 02-1009.06
 Expiration Date 12/31/2007
 By *Helmut H. Miller*
 Miami Dade Product Control Division

ENGINEER STAMP
David Barron
 11-15-02

DRAWN BY	DATE
JG2	02/14/97
SCALE	APPROVAL
FULL	1 (DP)
PROJECT NO.	
960209	

SHEET **A4** OF 7