



MIAMI-DADE
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

YKK AP America
332 Firetower Road
Dublin, GA 31021

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series "YOW-200H" Aluminum Awning Window

APPROVAL DOCUMENT: Drawing No. **W02-71**, titled "YOW-200 Alum Awning Window (L.M.I.)", sheets 1 through 5 of 5, prepared by Al Farooq Corporation, dated 8/26/02, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 as well as approval document mentioned above.

The submitted documentation was reviewed by **Theodore Berman, P.E.**



NOA No 02-1009.13
Expiration Date: December 19, 2007
Approval Date: December 19, 2002
Page 1

YKK AP America

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA)

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **W02-71**, titled "YOW-200 Alum Awning Window (L.M.I.)", sheets 1 through 5 of 5, prepared by Al Farooq Corporation, dated 8/26/02, signed and sealed by Humayoun Farooq, P.E.

B. TESTS

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 3603.2 (b) and TAS 202-94
along with installation diagram of an aluminum awning window prepared by Hurricane Test Laboratory, test report No. **HTL-0231-0118-02**, dated 5/14/02, signed and sealed by Vinu Abraham, P.E

C. CALCULATIONS

1. Anchor Calculations, dated 8/18/02, prepared by Al Farooq Corporation, signed and sealed by Al Farooq, P.E.

D. MATERIAL CERTIFICATIONS

1. Notice of Proposed Action No. **00-0822.03**, issued to Solutia, Inc. for their Saflex HP, dated 10/19/00, expiring on 4/14/03.

E. STATEMENTS

1. Statement letter of conformance, dated 8/19/02, signed and sealed by Humayoun Farooq, P.E.
2. Statement letter of no financial interest, dated 8/19/02, signed and sealed by Humayoun Farooq, P.E.
3. Laboratory compliance letter for Test Report no. **HTL-0231-0410.02, HTL-0231-0118-02**, issued by Hurricane Test Laboratory, Inc., dated 5/14/02, signed and sealed by Vinu Abraham, P.E.

F. OTHER

1. Letter from Pistorino & Alam Consulting Engineers, Inc.




Theodore Berman, P.E.

Deputy Director, Product Control Division


NOA No 02-1009.13

Expiration Date: December 19, 2007

Approval Date: December 19, 2002

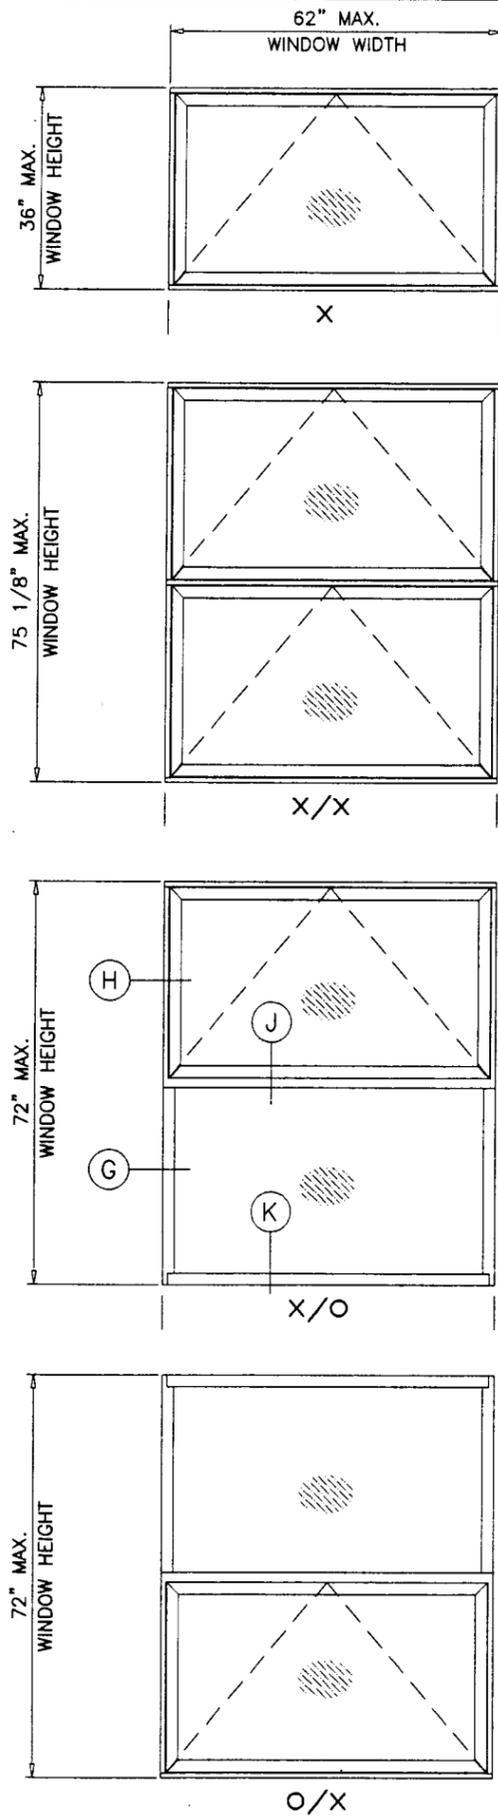

APPROVED CONFIGURATIONS

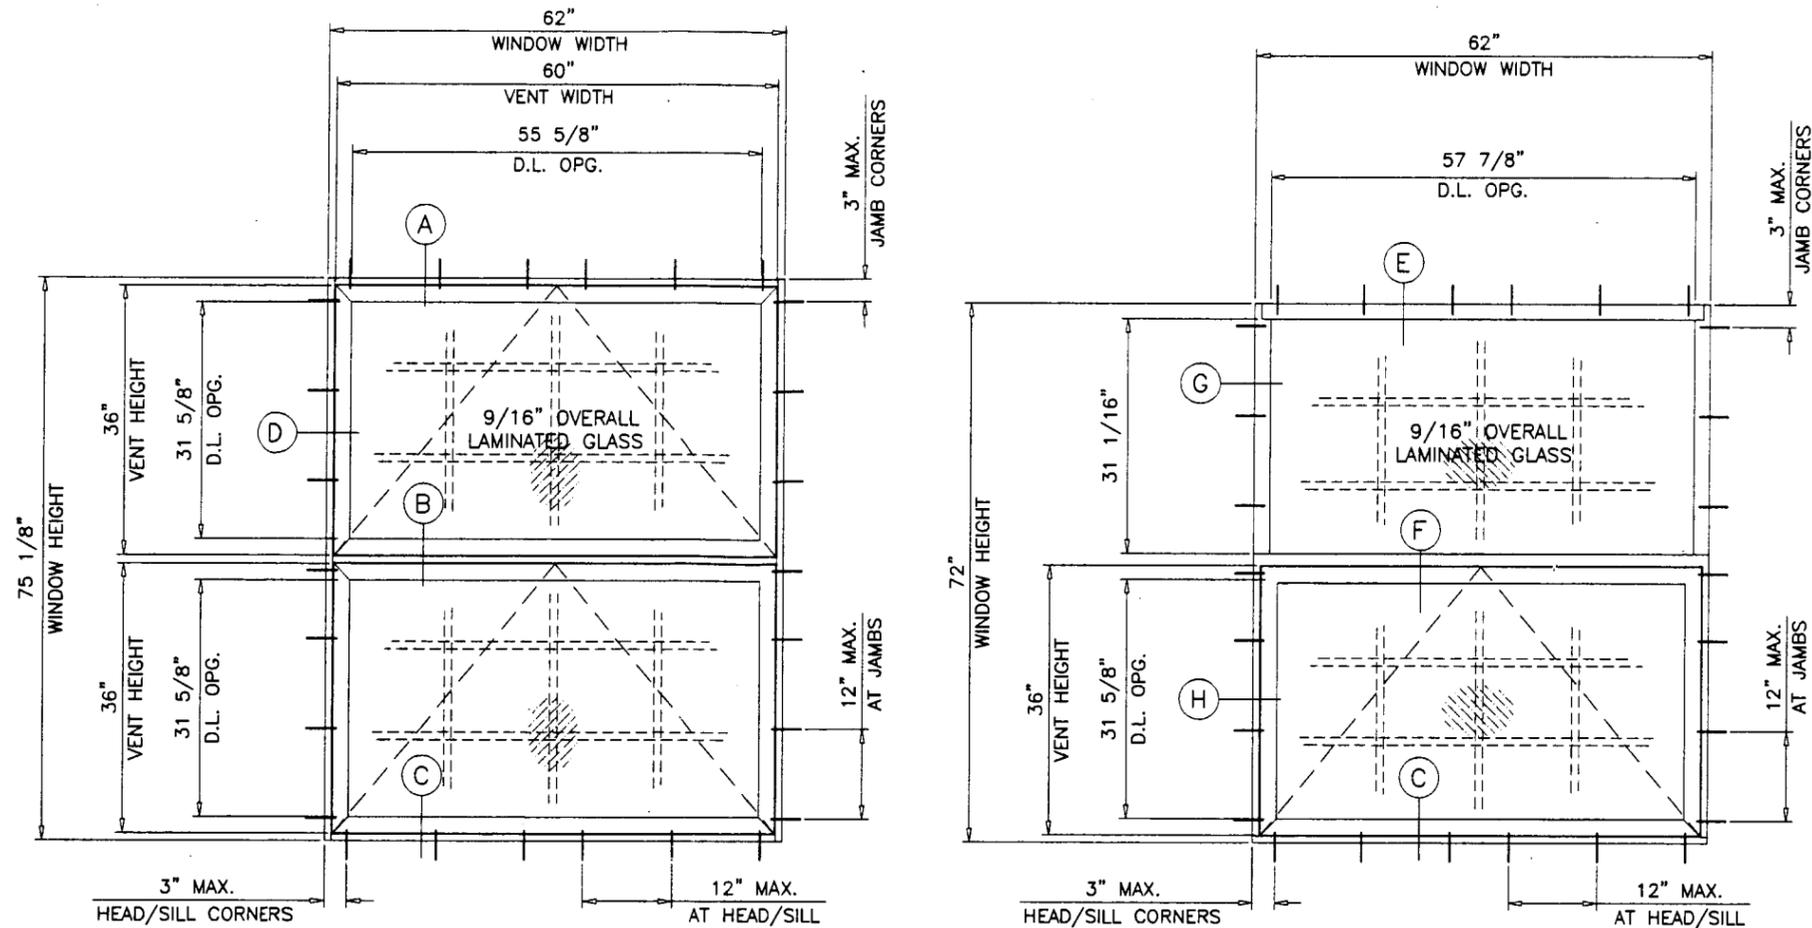

TYPICAL ELEVATION
TESTED UNITS

MAXIMUM DESIGN LOAD RATING = + 65.0 PSF
(FOR SIZES SHOWN OR SMALLER) - 65.0 PSF

WINDOWS GLAZED WITH LAMINATED GLASS RATED FOR LARGE MISSILE IMPACT AND DO NOT REQUIRE SHUTTERS.

APPROVAL APPLIES TO;
SINGLE VENT WINDOWS OF X CONFIGURATION.
DUAL VENT WINDOWS OF X/X CONFIGURATION.
AWNING/FIXED COMBINATIONS OF X/O OR O/X CONFIGURATIONS.
ALSO SIDE BY SIDE COMBINATIONS OF TWO OR MORE WINDOWS USING APPROVED MULLIONS.

THIS PRODUCT IS DESIGNED TO COMPLY WITH THE HIGH VELOCITY HURRICANE ZONE OF THE 2001 FLORIDA BUILDING CODE.
ALSO FOR WIND LOADS AS PER ASCE 7 USING CORRESPONDING LOADS.

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557

SEP 25 2002






Approved as complying with the
Florida Building Code
Date 12/19/02
NOA# 02-1009.13
Miami Dade Product Control
Div.
By: *Charles Beaman*

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

YOW-200 ALUM AWNING WINDOW (L.M.I.)
YKK AP AMERICA INC.
5630 GWALTNEY DRIVE
ATLANTA, GA. 30336
TEL.(404) 629-3800 FAX(404) 629-3810

revisions:	no	date	by	description
date:	08-26-02	scale:	1/2" = 1'-0"	
dr. by:	HAMID	chk. by:		
drawing no.	W02-71			
sheet	1 of 5			

COMP-ANL\W02-71YKK

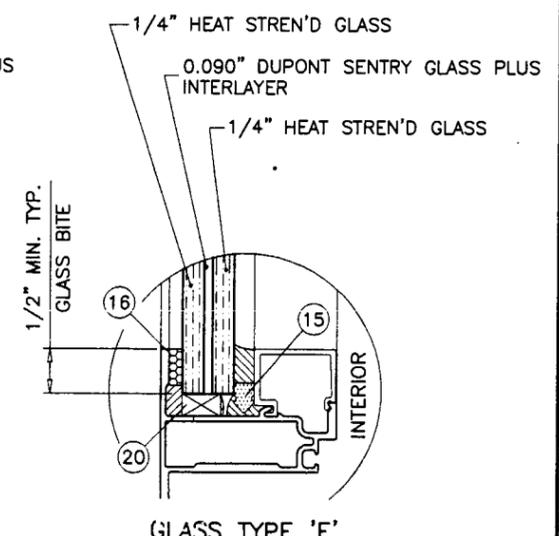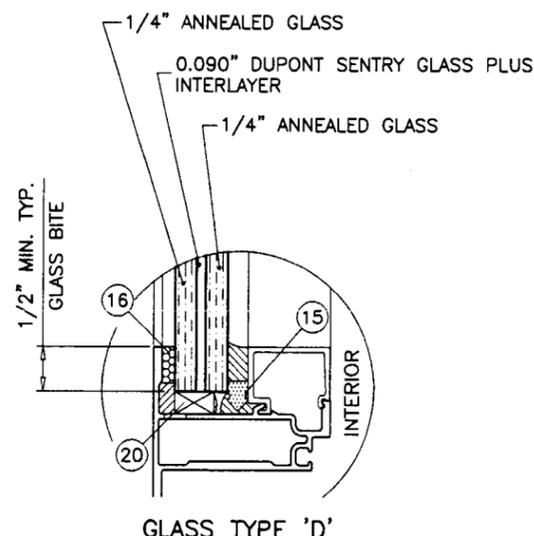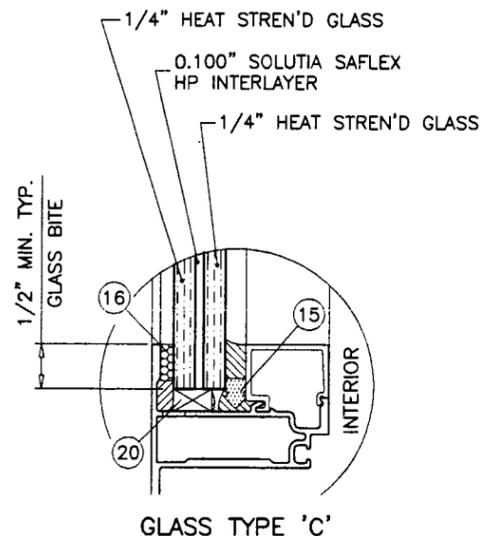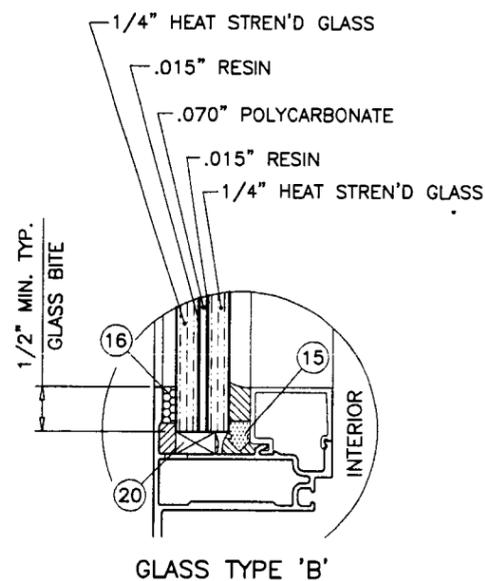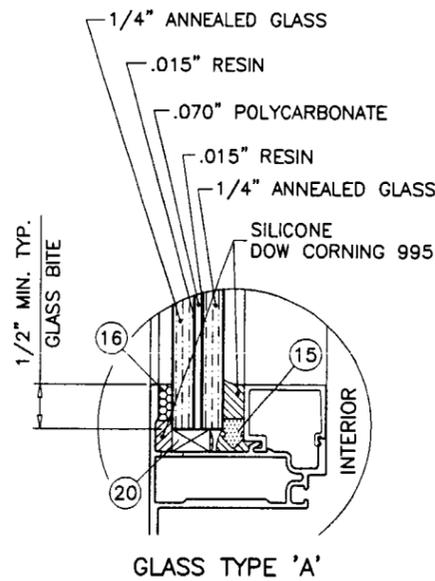

9/16" OVERALL LAMINATED GLASS
 LARGE MISSILE IMPACT RESISTANT
GLAZING OPTIONS

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" TAPCONS

INTO 2BY WOOD BUCKS OR WOOD STRUCTURE
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY WOOD BUCKS INTO MASONRY OR CONC.
 1-1/4" MIN. EMBED INTO MASONRY OR CONC.
 DIRECTLY INTO MASONRY OR CONC.
 1-1/4" MIN. EMBED INTO MASONRY OR CONC.

1/4" DIA. ELCO DRILLFLEX OR EQUIV.

INTO STEEL OR ALUMINUM MULLIONS
 (NO SHIM SPACE)
 INTO METAL STRUCTURES (1/8" MIN. THICKNESS)
 (1/4" MAX. SHIM SPACE)

SEALANTS:

FRAME CORNERS EXTERIOR SEAMS SEALED WITH SILICONE
 VENT AND FRAME CORNERS SEALED WITH SEALANT.

WEEP HOLES:

W1 = 1/4" X 1" WEEP SLOT AT CENTERLINE.
 W2 = 1/4" DIA. WEEP HOLES AT 4" FROM EACH CORNER

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557

SEP 25 2002

Approved as complying with the
 Florida Building Code
 Date 12/19/02
 NOA# 02-1009.13
 Miami Dade Product Control
 Div. By: *Glenn Berman*

afc

AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W02-71YK

YK AP AMERICA INC.
 5630 GWALTNEY DRIVE
 ATLANTA, GA. 30336
 TEL(404) 629-3800 FAX(404) 629-3810

YOW-200 ALUM AWNING WINDOW (L.M.I.)




no	date	by	description

revisions:




date: 08-26-02
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W02-71

sheet 2 of 5

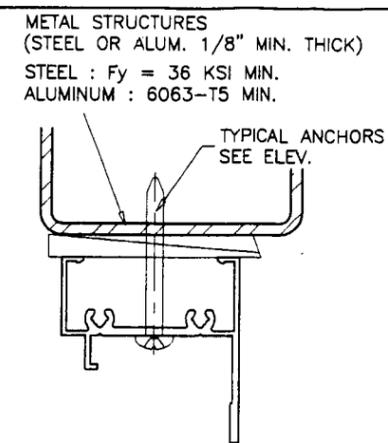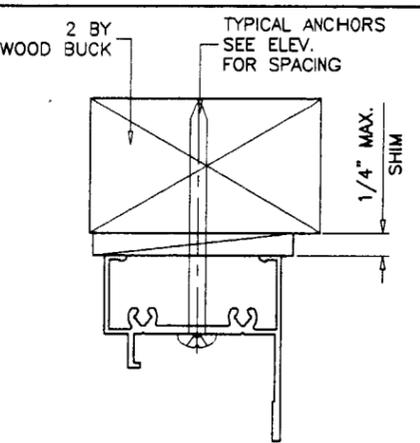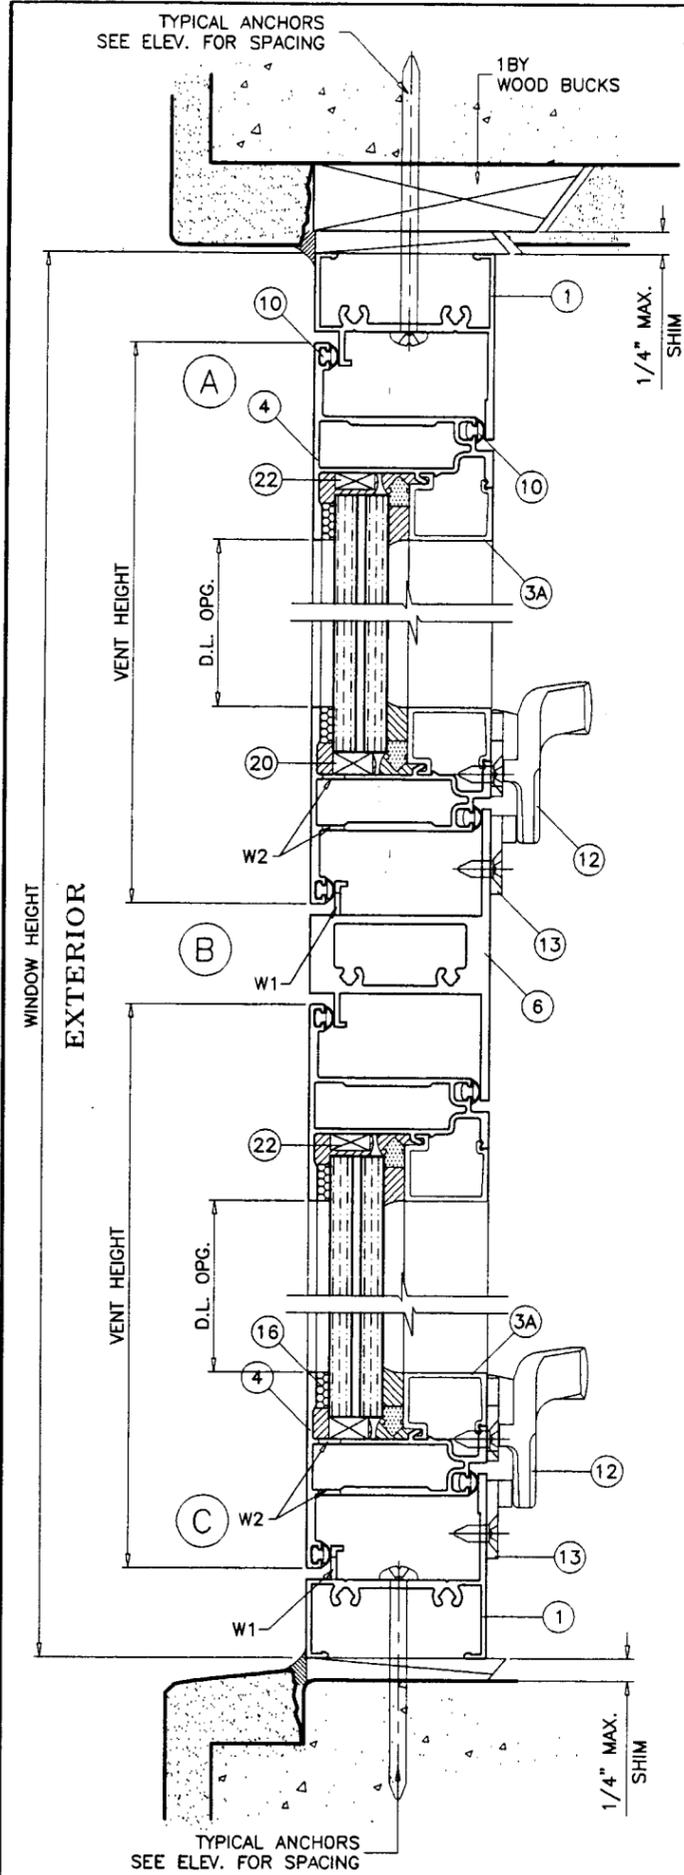

WOOD BUCKS NOT BY YKK AMERICA INC. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

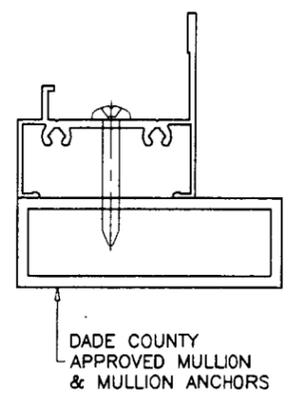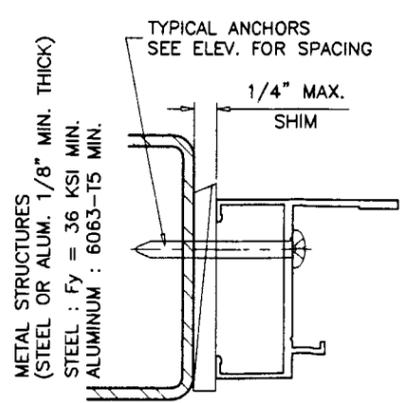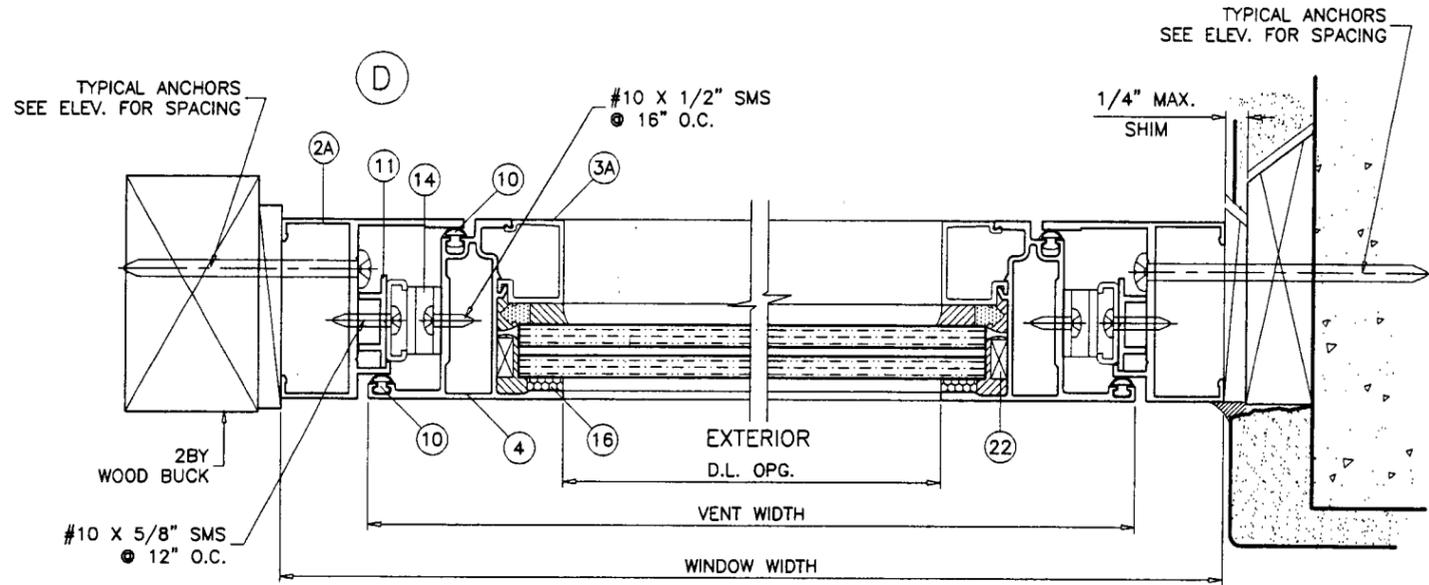

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557

SEP 25 2002






Approved as complying with the
Florida Building Code
Date 12/19/02
NOA# 02-1009.13
Miami Dade Product Control
Division
By *[Signature]*

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W02-71YKK

YOW-200 ALUM AWNING WINDOW (L.M.I.)
YKK AP AMERICA INC.
5630 GWALTNEY DRIVE
ATLANTA, GA. 30336
TEL.(404) 629-3800 FAX(404) 629-3810
YKK AP America

revisions:	no	date	by	description

date: 08-26-02
scale: 1/2" = 1"
dr. by: HAMID
chk. by:
drawing no. **W02-71**
sheet 3 of 5

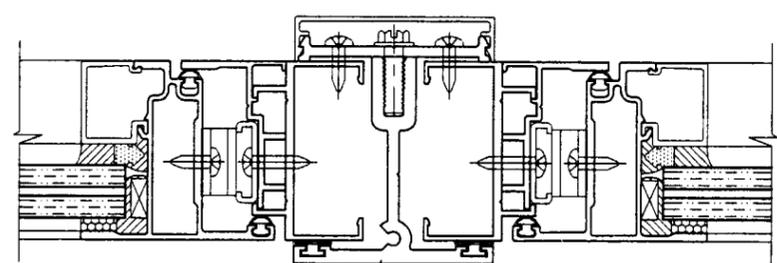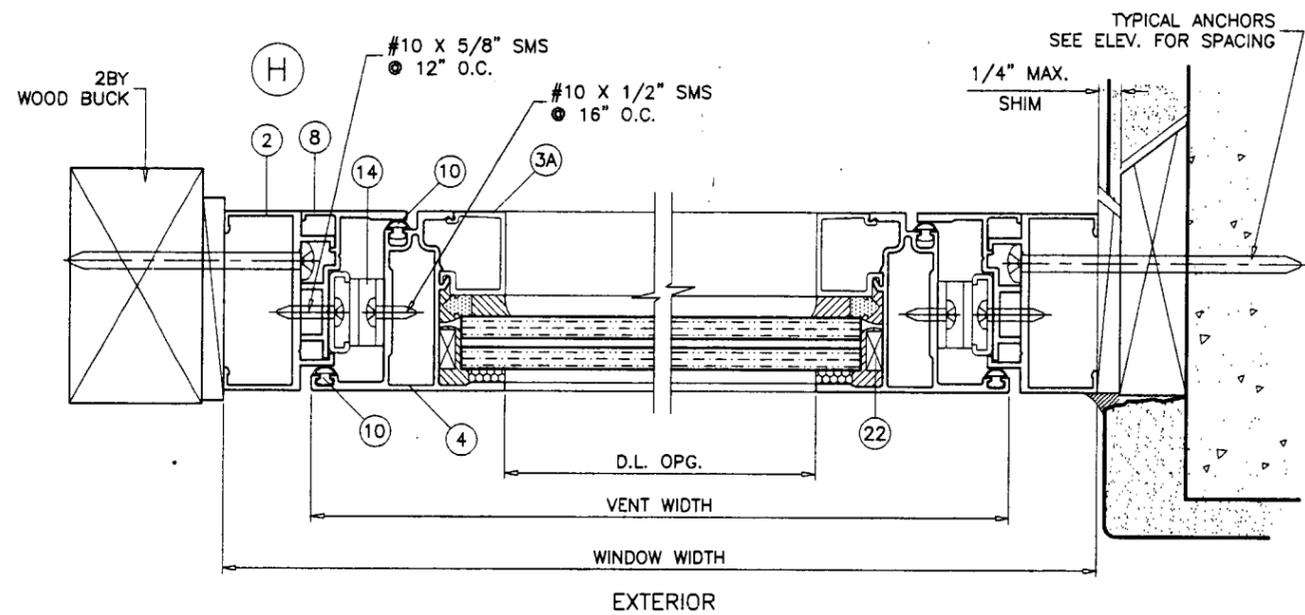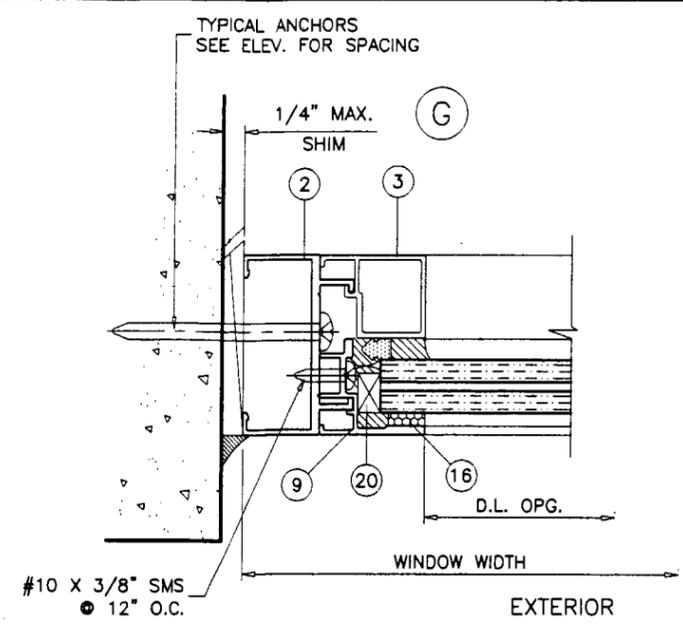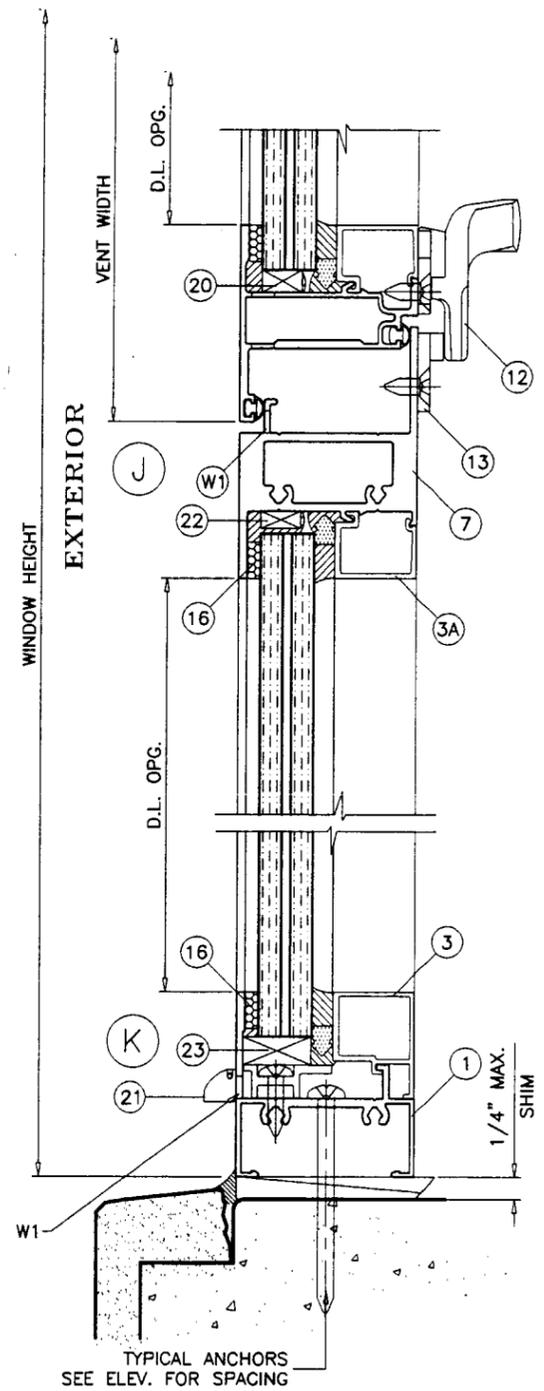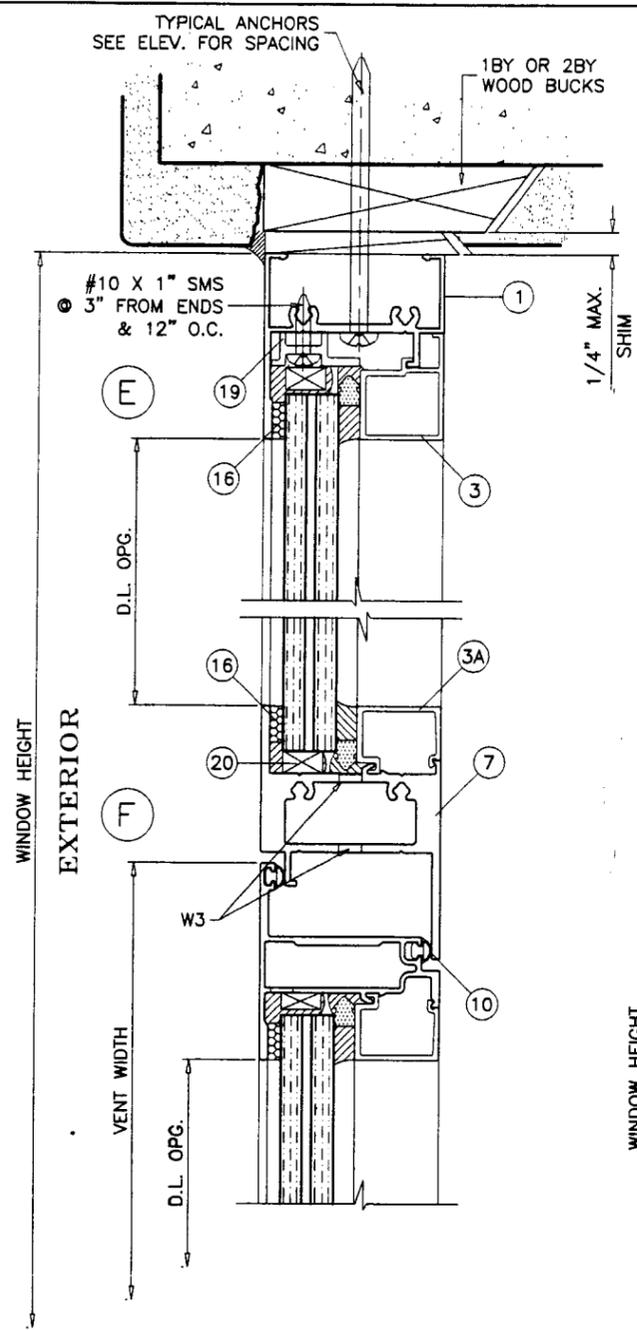

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 SEP 25 2002

Approved as complying with the
 Florida Building Code
 Date 12/19/02
 NOA# 02-1009.13
 Miami Dade Product Control
 Div. By *[Signature]*






AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W02-71YKK

YKK AP AMERICA INC.
 5630 GWALTNEY DRIVE
 ATLANTA, GA. 30336
 TEL.(404) 629-3800 FAX(404) 629-3810



revisions:	no	date	by	description

date: 08-26-02
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W02-71
 sheet 4 of 5

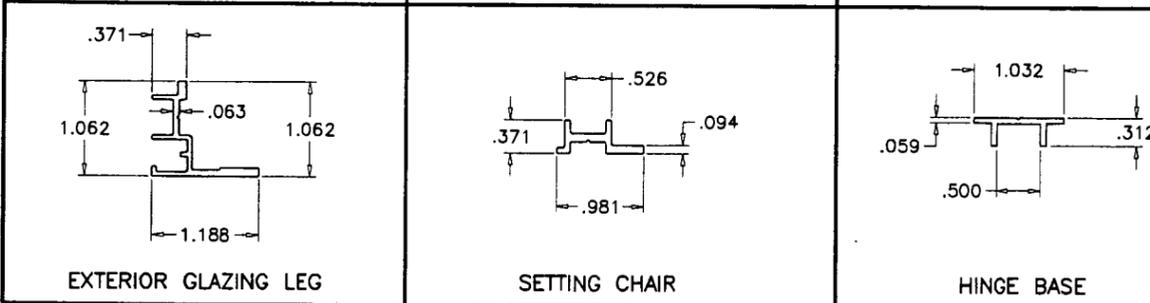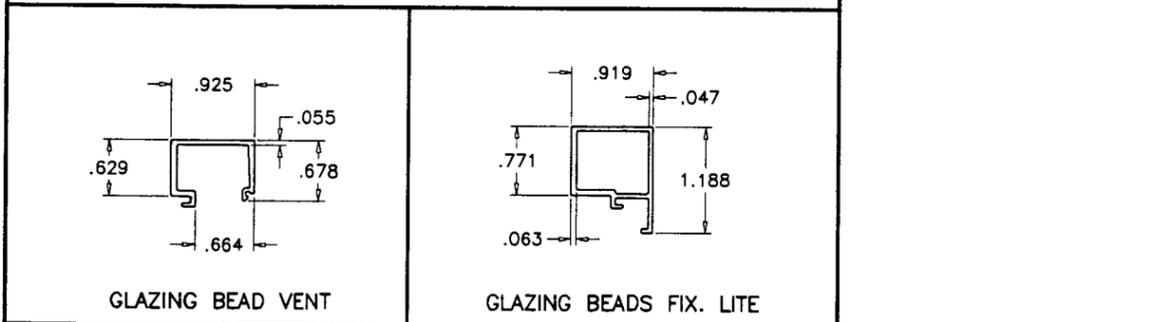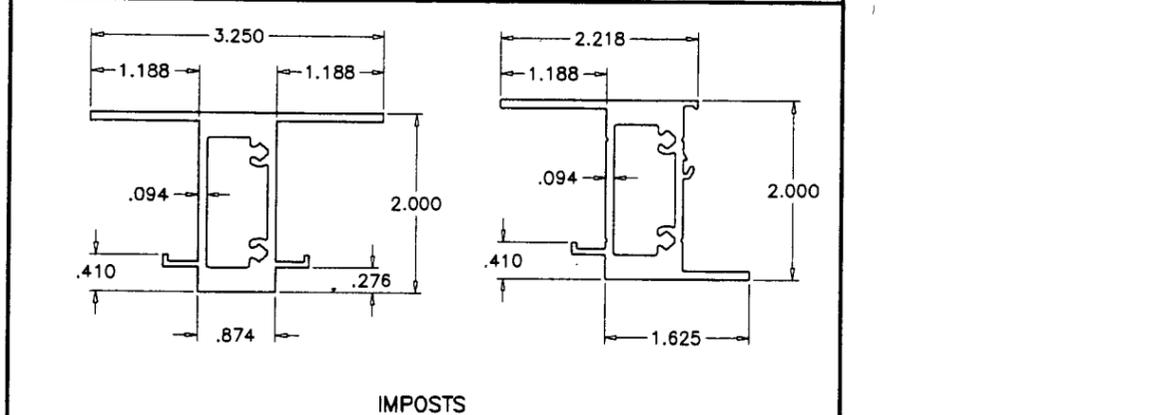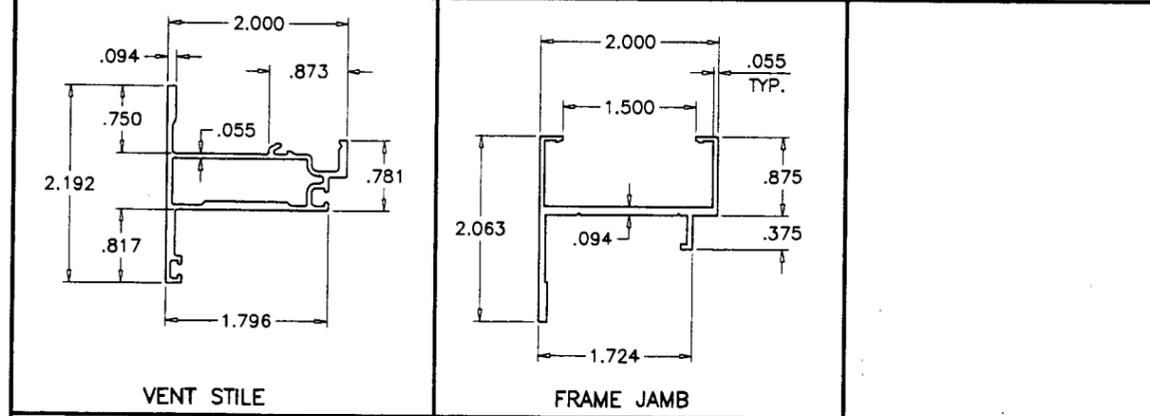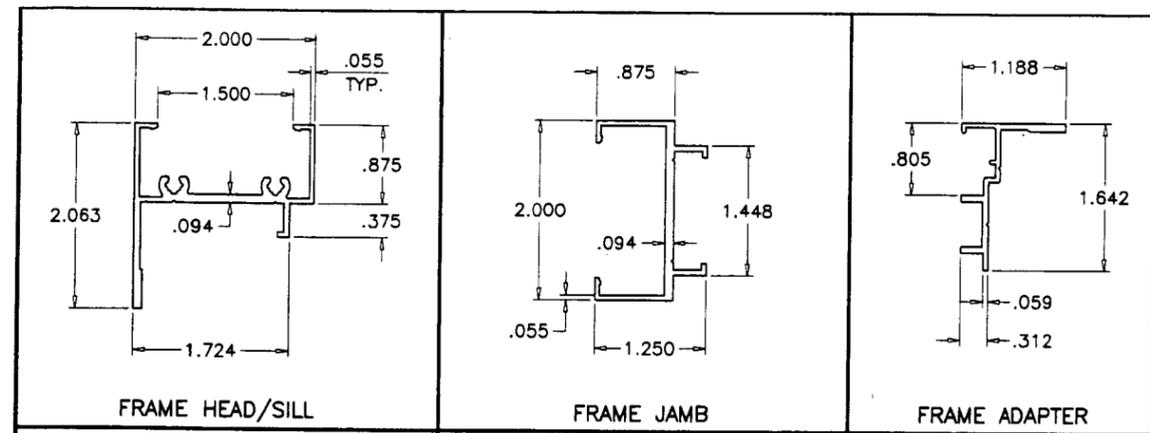

MATERIALS LIST					
ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	E9-4401	2/ WDW	FRAME HEAD/SILL	6063-T5	YKK AMERICA INC.
2	E9-4403	2/ WDW	FRAME JAMB	6063-T5	YKK AMERICA INC.
2A	E9-4402	2/ WDW	FRAME JAMB	6063-T5	YKK AMERICA INC.
3	E9-4451	4/ WDW	GLAZING STOP (FIX. LITE)	6063-T5	YKK AMERICA INC.
3A	E9-4452	4/ WDW	GLAZING STOP (VENT)	6063-T5	YKK AMERICA INC.
4	E9-4411	4/ WDW	VENT STILE	6063-T5	YKK AMERICA INC.
5	-	-	-	-	-
6	E9-4430	AS REQD.	IMPOST	6063-T5	YKK AMERICA INC.
7	E9-4431	AS REQD.	IMPOST	6063-T5	YKK AMERICA INC.
8	E9-4410	2/ WDW	FRAME ADAPTER	6063-T5	YKK AMERICA INC.
9	E9-4453	2/ WDW	EXTERIOR GLAZING LEG	6063-T5	YKK AMERICA INC.
10	E2-0625	AS REQD.	BULB WEATHERSTRIPPING	PVC	YKK AMERICA INC.
11	E1-1548	AS REQD.	HINGE BASE	6063-T5	YKK AMERICA INC.
12	E1-1541/42	2/ VENT	CAM LOCK AT 7" FROM EACH END OF VENT	-	BRONZECRAFT, ATTACHED W/ (2) #10 X 1/2" SMS
13	E1-1519	1/ LOCK	LOCK KEEPERS	-	BRONZECRAFT, ATTACHED W/ (2) #10 X 1/2" SMS
14	E1-1709	2/ VENT	4 BAR HINGES	-	BRONZECRAFT, STORM HINGE OR STERLING
15	E2-0359	AS REQD.	ARROW SPACER, 4" LONG	EPDM SPONGE	AT QUARTER POINTS
16	E2-0645	AS REQD.	GLAZING TAPE (3/8" X 3/16")	-	CLOSED CELL EPDM SPONGE
17	E1-1540	1/ CORNER	CORNER BLOCK (1.484" LONG)	6063-T5	YKK AMERICA INC.
18	#10 X 1"	2/ CORNER	FRAME ASSEMBLY SCREWS	CRS	PH SMS
19	E9-4454	AS REQD.	SETTING CHAIR	6063-T5	YKK AMERICA INC.
20	E2-0623	AS REQD.	SETTING BLOCKS	EPDM	1/4" X 7/16" X 4" LONG
21	E3-1101	2/ WDW	WEEP COVER	NYLON	AT WEEP SLOTS
22	E2-0624	AS REQD.	SIDE BLOCKS	EPDM	3/16" X 7/16" X 2" LONG
23	E2-9907	AS REQD.	SETTING BLOCKS	EPDM	5/16" X 3/4" X 4" LONG

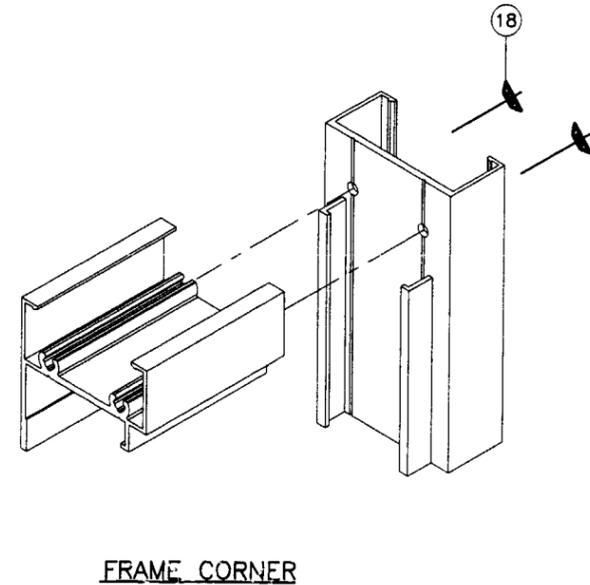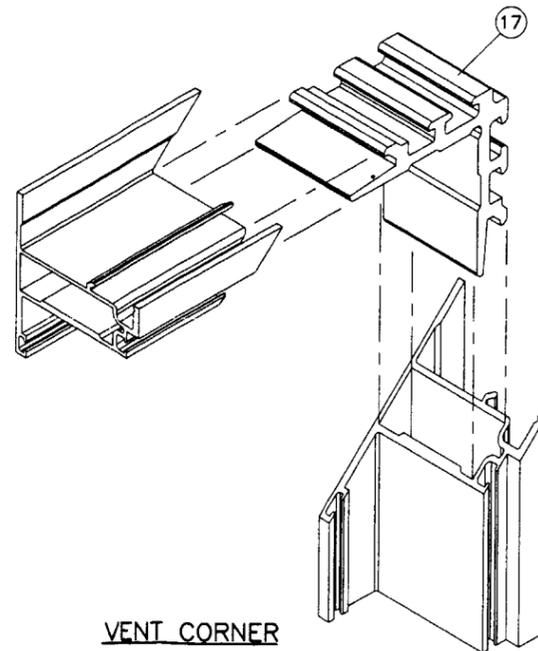

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557

SEP 25 2002

Approved as complying with the
 Florida Building Code
 Date 12/19/02
 NOA# 02-1009.13
 Miami Dade Product Control
 Division
 By: *Glenn Berra*

AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W02-71YKK

YKK AP AMERICA INC.
 5630 GWALTNEY DRIVE
 ATLANTA, GA. 30336
 TEL (404) 629-3800 FAX(404) 629-3810

YOW-200 ALUM AWNING WINDOW (L.M.I.)

revisions:
 no. date by description

date: 08-26-02
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no. **W02-71**
 sheet 5 of 5