



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**O'Hagin's Inc.
2661 Gravenstein Hwy South #107
Sebastopol, CA 95472**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: O'Hagin's Cloaked Vent Tile

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This consists of pages 1 through 6.
The submitted documentation was reviewed by Frank Zuloaga, RRC



**NOA No 02-1211.14
Expiration Date: 04/14/08
Approval Date: 01/31/03
Page 1 of 6**

ROOFING ASSEMBLY APPROVAL

Category: Roofing
Sub-Category: 07720 Static Roof Vent

Materials: Steel

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT

<u>Product</u>	<u>Dimensions</u>	<u>Test Specification</u>	<u>Product Description</u>
O'Hagin's Cloaked Vent Tile ® S-Profile	26" x 20" (66.04 x 50.8cm)	TAS 100	Metal roof vent for tile roofs
O'Hagin's Cloaked Vent Tile ® M-Profile	26" x 20" (66.04 x 50.8cm)	TAS 100	Metal roof vent for tile roofs
O'Hagin's Cloaked Vent Tile®Flat-Profile	28" x 20" (71.12 x 50.8cm)	TAS 100	Metal roof vent for tile roofs
Sub Flashing	19" x 6 1/4" x 1/2" (48.26 x 15.9 x 1.27cm)	TAS 100	Metal vent flashing for tile roofs

TRADE NAMES OF PRODUCTS MANUFACTURED BY OTHERS

<u>Product</u>	<u>Dimensions</u>	<u>Test Specification</u>	<u>Product Description</u>	<u>Manufacturer</u>
Roofing Nails	Minimum # 12	TAS 114	Corrosion resistant annular ring shank nails	generic
Flat Head Wood Screws	#8 x 2" or 50.8cm	TAS 114	Corrosion resistant wood screws	generic
Drip Edge	2" x 2" (50.8 x 50.8cm) nominal	TAS 114	AZ-55 galvanized metal drip edge.	generic
Roofing cement		TAS 121	roofing cement	generic

EVIDENCE SUBMITTED APPROVED APPLICATIONS

<u>Test Agency/Identifier</u>	<u>Name</u>	<u>Report</u>	<u>Date</u>
Center For Applied Engineering, Inc.	PA 100A	MTS No. 257732b	07/30/96



NOA No 02-1211.14
 Expiration Date: 04/14/08
 Approval Date: 01/31/03
 Page 2 of 6

APPROVED APPLICATIONS

- Deck Type:** Wood
- Deck Description:** $1\frac{9}{32}$ " (1.51cm) or greater plywood or wood plank
- System Type A:** Mechanical attachment of vent under tile
- Slot:** Mark a 19" x $6\frac{1}{4}$ " (48.26 x 15.9cm) opening centered between layout lines and aligned approximately as shown on exposure lines as seen in Detail A. Set blade to thickness of sheathing and cut opening. Brush away sawdust and debris.
- Installation:** Set primary vent in a $\frac{1}{8}$ " (2.54cm) bed of asphalt roofing cement. Secure primary vent to the roof deck with 1- $\frac{1}{4}$ " x $\frac{3}{8}$ " (3.16 x .953cm) galvanized ring shank roofing nails spaced 4" (10.16cm) o.c. Seal nails with an approved ASTM D 4586 roofing cement, sealing primary vent flange with a layer of Perma glass mesh buttered into the roof cement around the flange.
- The tile vent can now be centered over the primary vent and nailed at the head with 2 ea. 1- $\frac{1}{4}$ " x $\frac{3}{8}$ " (3.16 x .953cm) galvanized ring shank roofing nails. See Details A & C.

Ventilation Calculations: See manufacture's published literature for net free area


GENERAL LIMITATIONS:

1. Refer to applicable building code for required ventilation.
2. The installation shall be applied in compliance with the manufacturer's current published application instruction and the requirements set forth in applicable building code.
3. Wind Clip hooks shall be fully engaged under head of preceding tiles.
4. O'Hagin's Cloaked vent tile may be installed on roofs up to roof mean heights of 33 ft.




Detail "A"


MARK

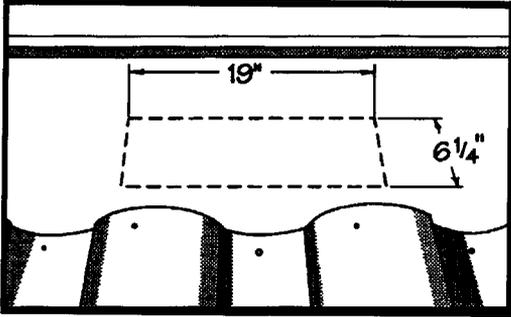


CUT

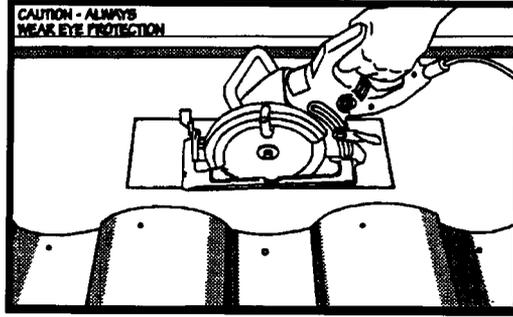


SEAL

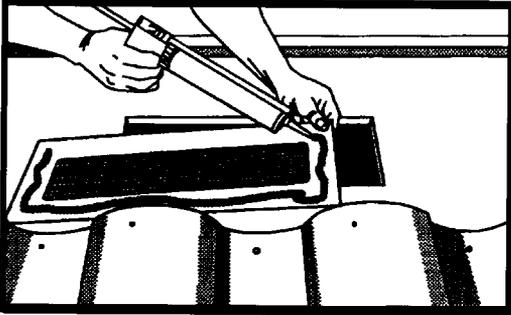


SECURE

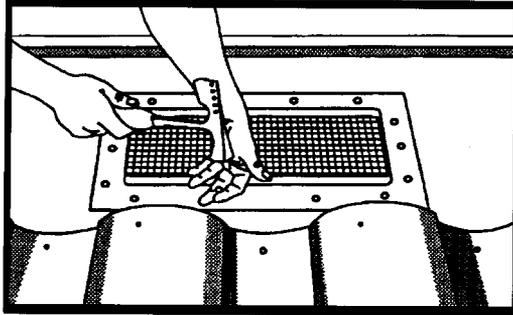

FLASH

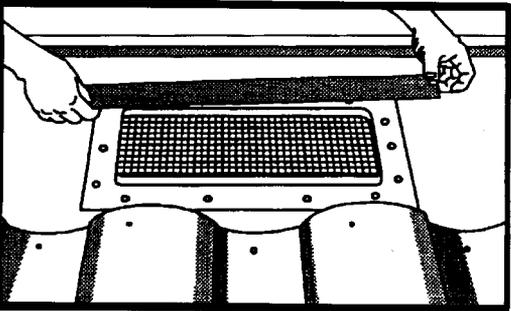


INSTALL

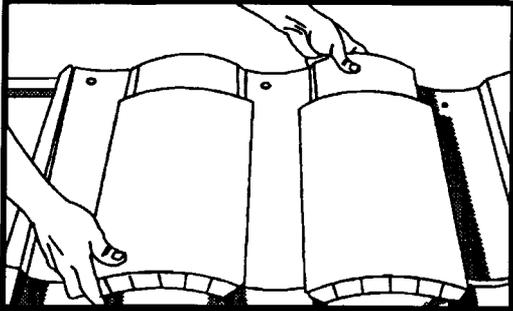


SCALE NONE



Detail "B"

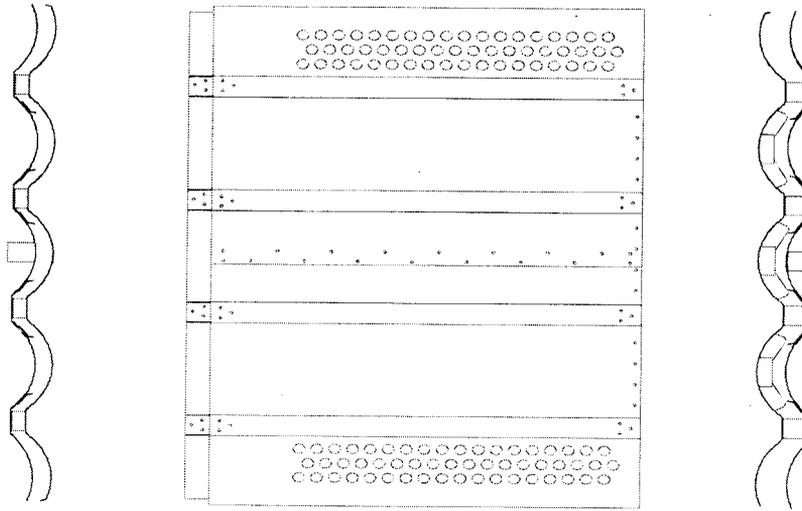


M-Profile

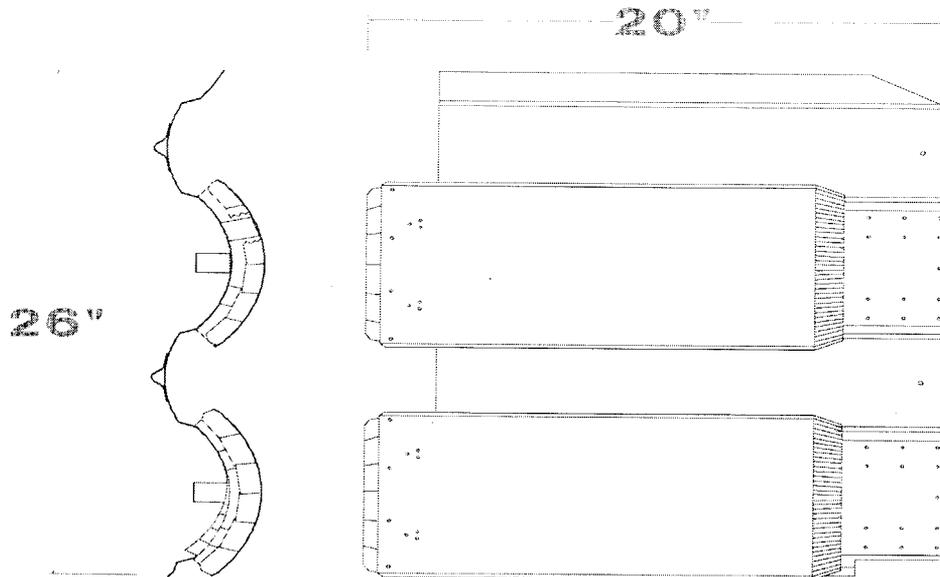


S-Profile



Detail "C"

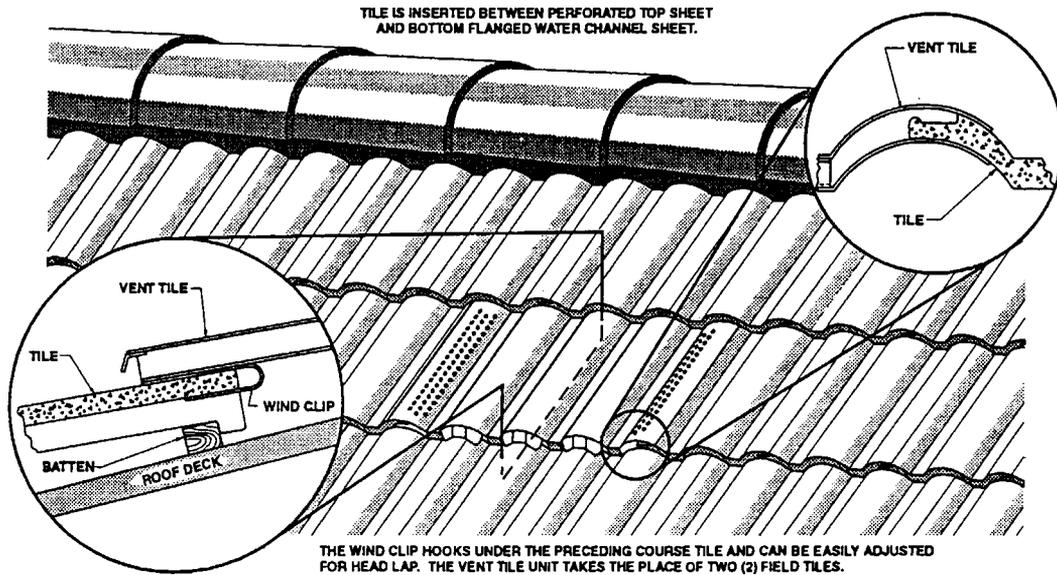

INSTALLATION INSTRUCTIONS FOR FLAT STYLE CONCRETE TILES

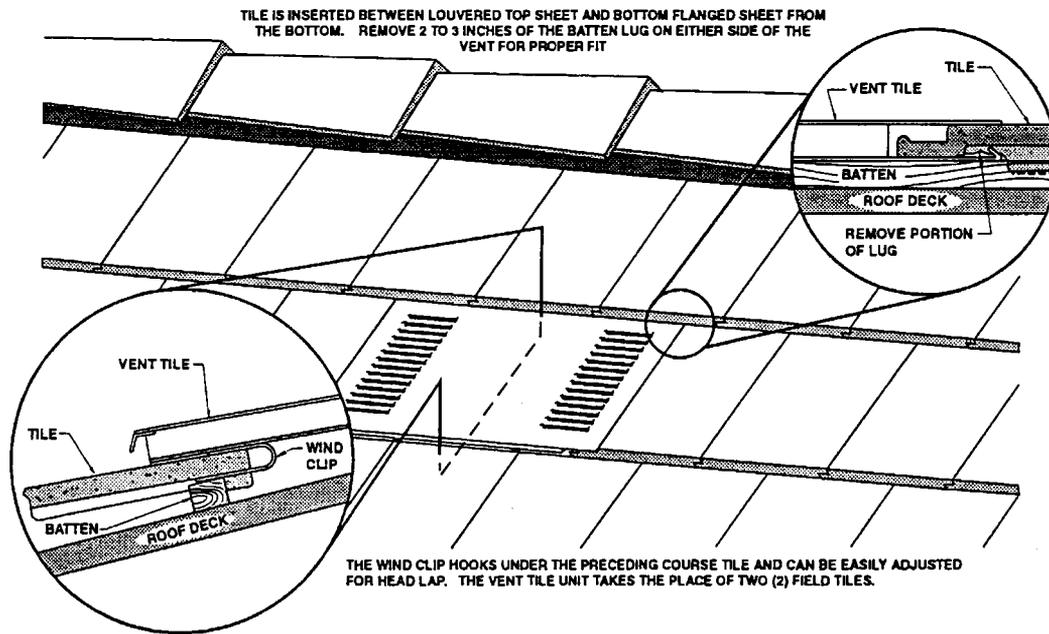

END OF THIS ACCEPTANCE



NOA No 02-1211.14
 Expiration Date: 04/14/08
 Approval Date: 01/31/03
 Page 6 of 6