



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

**Jeld-Wen, Inc.  
317525 Highway 97 N.  
Chiloquin, OR 97624**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: Series "Jeld-Wen®" 12'0" x 6'8" W/E Outswing Glazed Insulated Steel Door w/Full Glazed Panel Sidelites**

**APPROVAL DOCUMENT:** Drawing No. S-2130, titled "Wood Edge Glazed Double Door w/3-0 Sidelites Up to 12' x 6'8 Outswing", sheets 1 through 6 of 6, prepared by R.W Building Consultants, Inc., dated 12/10/01 with revision on 10/22/02, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: None**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 02-0111.01 and, consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by **Jaime Eisen, P.E.**



**NOA No 02-1211.15  
Expiration Date: August 22, 2007  
Approval Date: January 30, 2003  
Page 1**

**Jeld-Wen, Inc.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

(For File ONLY. Not part of NOA)

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No. **S-2130**, titled "Wood Edge Glazed Double Door w/3-0 Sidelites Up to 12' x 6'8 Outswing", sheets 1 through 6 of 6, prepared by R.W Building Consultants, Inc., dated 12/10/01 with revision on 10/22/02

**B. TESTS**

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Forced Entry Test, per FBC 2411.3.2.1 and TAS 202-94  
along with marked-up drawings and installation diagram of a DoorCraft series opaque wood edge steel door, prepared by Certified Testing Laboratories, Test Report No. **CTLA-961W**, dated 10/23/01, signed and sealed by Ramesh C. Patel, P.E.

***Submitted under NOA #02-0111.01***


2. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Forced Entry Test, per FBC 2411.3.2.1 and TAS 202-94  
along with marked-up drawings and installation diagram of DoorCraft series OXXO configuration outswing and inswing glazed wood edge steel door, prepared by Certified Testing Laboratories, Test Report No. **CTLA-718WB**, dated 11/16/01, with addendum letter dated April 1, 2002, all signed and sealed by Ramesh C. Patel, P.E.

**C. CALCULATIONS**

1. Anchor Calculations and structural analysis dated 12/2/02, prepared by R.W. Building Consultants, Inc., signed and sealed by Lyndon F. Schimdt, P.E.

***Submitted under NOA #02-0111.01***

2. Anchor Calculations and structural analysis dated 12/20/01, prepared, signed and sealed by Wendell Haney, P.E. with addendum letter dated April 7, 2002 also signed and sealed by Wendell Haney, P.E.



Jaime Eisen, P.E.  
Product Control Division  
NOA No 02-1211.15  
Expiration Date: August 22, 2007  
Approval Date: January 30, 2003

**Jeld-Wen, Inc.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

(For File ONLY. Not part of NOA)

**D. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **01-0718.08** issued to ODL, Inc. for "HP Propropylene Doorlight Assembly" dated 1/17/02, expiring on 1/17/06.
2. Tensile Test prepared by Certified Testing Laboratories, Test Report No. **CTLA-718WB/ DADE 01021 and 719G / DADE 01021**, dated Nov. 29, 2001 and June 4, 2001, tested per **ASTM E8/A370 or B557**, signed and sealed by Ramesh C. Patel, P.E.
3. Test reports No. J9906660-001 for "Surface burning characteristics" per ASTM E-84 and "Self ignition test" per ASTM 1929 D, for polystyrene core dated April 8, 1999, issued by Intertek Testing Services.
4. Notice of Acceptance No. **02-0429.11**, issued to Trinity Glass International, Inc. for "Trinity Lite Frame" dated 7/3/02, expiring on 7/3/07.

**E. STATEMENTS**

1. Statement letter of conformance and no financial interest, dated 12/2/02, signed and sealed by Lyndon Schmidt, P.E.
2. Statement letter of no financial interest, dated 10/10/02, signed by Steve Frey.

**F. OTHER**

1. Notice of Acceptance No. **02-0111.01** issued to Jeld-Wen, Inc. for Series "DoorCraft®" 12'0" x 6'8" W/E Outswing Glazed Insulated Steel Door w/Full Glazed Panel Sidelites" dated 10/22/02, expiring on 10/22/07.

---

  
**Jaime Eisen, P.E.**  
**Product Control Division**  
**NOA No 02-1211.15**  
**Expiration Date: August 22, 2007**  
**Approval Date: January 30, 2003**

# JELD - WEN® Steel

WOOD EDGE GLAZED INSULATED STEEL DOOR  
OUTSWING 6-8 UNITS WITH (2) 3-0 SIDELITES

## GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO COMPLY WITH THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. DESIGNED PRESSURE RATING SEE TABLE PAGE 1.
5. THIS SYSTEM MEETS THE WATER REQUIREMENTS FOR "HIGH VELOCITY HURRICANE ZONES".
5. THIS SYSTEM REQUIRES WINDBORNE DEBRIS EXTERNAL PROTECTION AS PRESCRIBED IN SECTION 1626.1 OF FLORIDA BUILDING CODE.

## RESIDENTIAL INSULATED STEEL DOOR (Common to all frame conditions)

### Door Leaf Construction:


**Face sheets:** 24 ga. (0.021") minimum thickness, Galvanized steel A-525 commercial quality - AKDQ per ASTM 620 with yield strength  $F_y(\text{ave.})=49,200$  psi.

**Core design:** Expanded polystyrene with 1.0 to 1.25 lbs. density, by Jeld-Wen, Inc.

**Panel Construction:** The active and inactive panels are constructed from 24GA. (0.021" min.) galvanized steel. The face sheet top and bottoms are bent 90° over the top and bottom rails. The top rail consists of LVL measuring 1.67" x 1.042". The bottom rail is either wood measuring 1.67" x 1.21" or roll formed 0.021" galvanized steel measuring 1.67" x 1.21" with a piece of 3/4" P.F.B. in each corner. The sides of the face sheet are roll formed into the LVL latch stile and Ponderosa Pine hinge stile which measure 1.67" x 1.21". The interior cavity is filled with polystyrene. The face sheet is glued to the polystyrene.

**Sash Construction:** The sash is constructed from 24GA. (0.021" min.) galvanized steel. The edges of the face sheet are bent 90° over the polystyrene core and glued to it. The sashes are routed to receive the ODL (HP Polypropylene Thermofil-P6-30FM0391) or Trinity lite frame. The units are glazed with .125", .50" or 1.0" tempered glass. The lite frames are wet glazed on the exterior.

**Frame Construction:** The frames are constructed from Ponderosa Pine jambs measuring 4.563" x 1.25". The head jambs are mortised and butt joined to the side jambs and attached with (3) 16GA. 2" x 7/16" crown wire staples. The units use an outswing bump face threshold, either low profile or high dam. The threshold is attached to the frame with (3) 16GA. 2" x 7/16" crown wire staples.

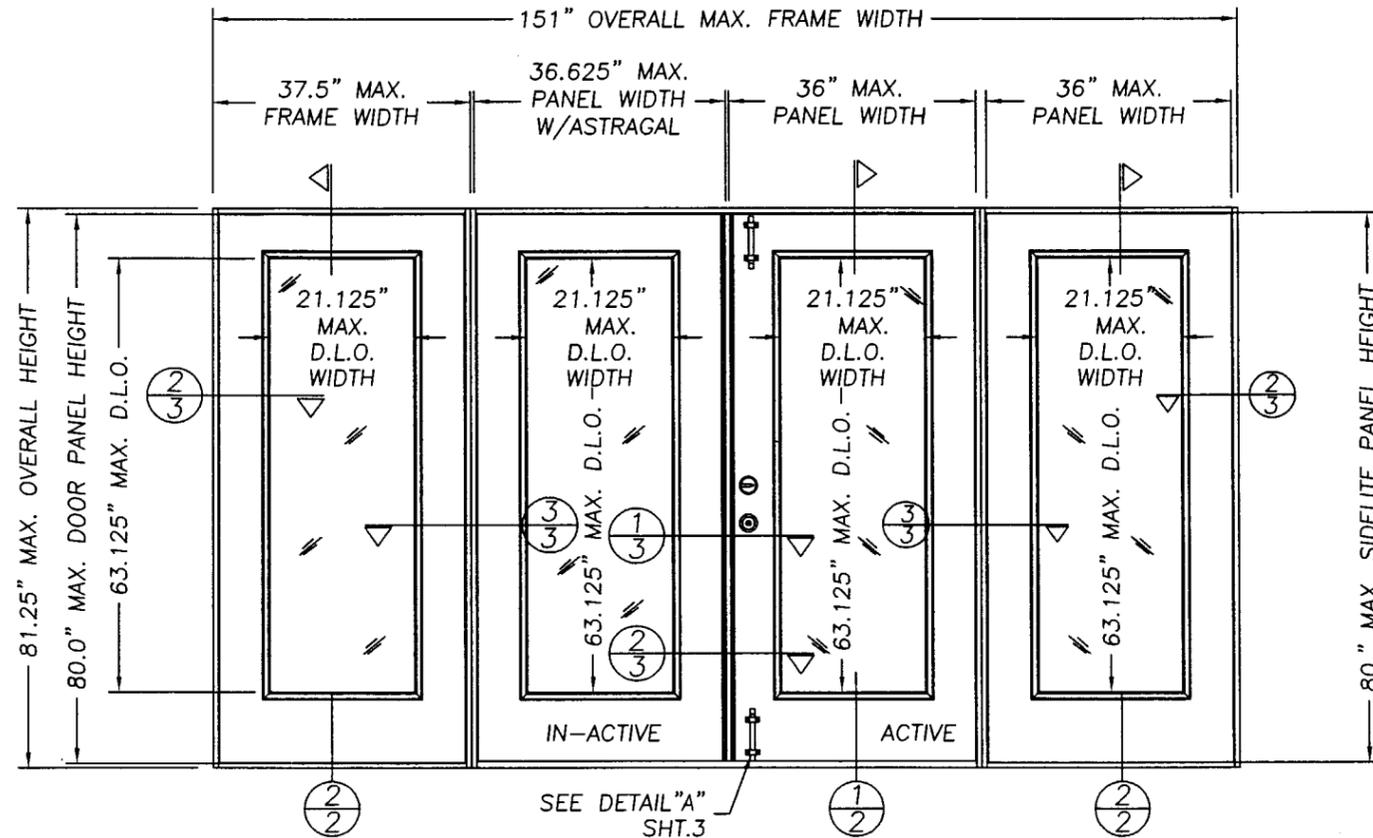

TESTED OUTSWING ELEVATION  
VIEWED FROM INTERIOR

| DESIGN PRESSURE RATING<br>WHERE WATER INFILTRATION REQUIREMENT IS NEEDED *(SEE NOTE BELOW) |                       |                                    |
|--|-----------------------|------------------------------------|
| UNIT TYPE  | WITHOUT SURFACE BOLTS | WITH SURFACE BOLTS ON ACTIVE PANEL |
| DOUBLE DOOR W/SIDELITES & WINDJAMBER II ASTRAGAL BY GENESIS                                | +50.0psf -50.0psf     | +65.0psf -65.0psf                  |
| DOUBLE DOOR W/SIDELITES & HURRICANE ASTRAGAL BY IMPERIAL                                   | NOT APPROVED          | +65.0psf -65.0psf                  |

\*NOTE: THE HIGH DAM THRESHOLD MUST BE USED TO MEET THE WATER REQUIREMENTS FOR "HIGH VELOCITY HURRICANE ZONES".

| TABLE OF CONTENTS |  |
|-------------------|--|
| SHEET #           | DESCRIPTION                                |
| 1                 | GENERAL NOTES AND TYPICAL ELEVATIONS       |
| 2                 | VERTICAL CROSS SECTIONS & BILL OF MATERIAL |
| 3                 | HORIZONTAL CROSS SECTIONS & NOTES          |
| 4                 | ANCHORING LOCATIONS & DETAILS              |
| 5                 | GLAZING DETAILS                            |
| 6                 | UNIT COMPONENTS                            |

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057


PRODUCT: WOOD EDGE GLAZED DOUBLE DOOR W/3-0 SIDELITES UP TO 12' x 6'8" OUTSWING  
PART OR ASSEMBLY: TYPICAL ELEVATION & GENERAL NOTES

| NO. | DATE     | BY  | REVISIONS          |
|-----|----------|-----|--------------------|
| 3   | 10/22/02 | ROF | ADDED TRINITY LITE |
| 2   | 06/07/02 | WLN | GENERAL REVISION   |
| 1   | 03/07/02 | TJH | GENERAL REVISION   |


RW BUILDING CONSULTANTS, INC.  
813.659.9197

PRODUCT REVISED as complying with the Florida Building Code  
Acceptance No 02-1211.15  
Expiration Date 08/22/07  
By: *[Signature]*  
Miami Back Product Control Division


DATE: 12/10/01  
SCALE: NTS  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2130  
SHEET 1 OF 6

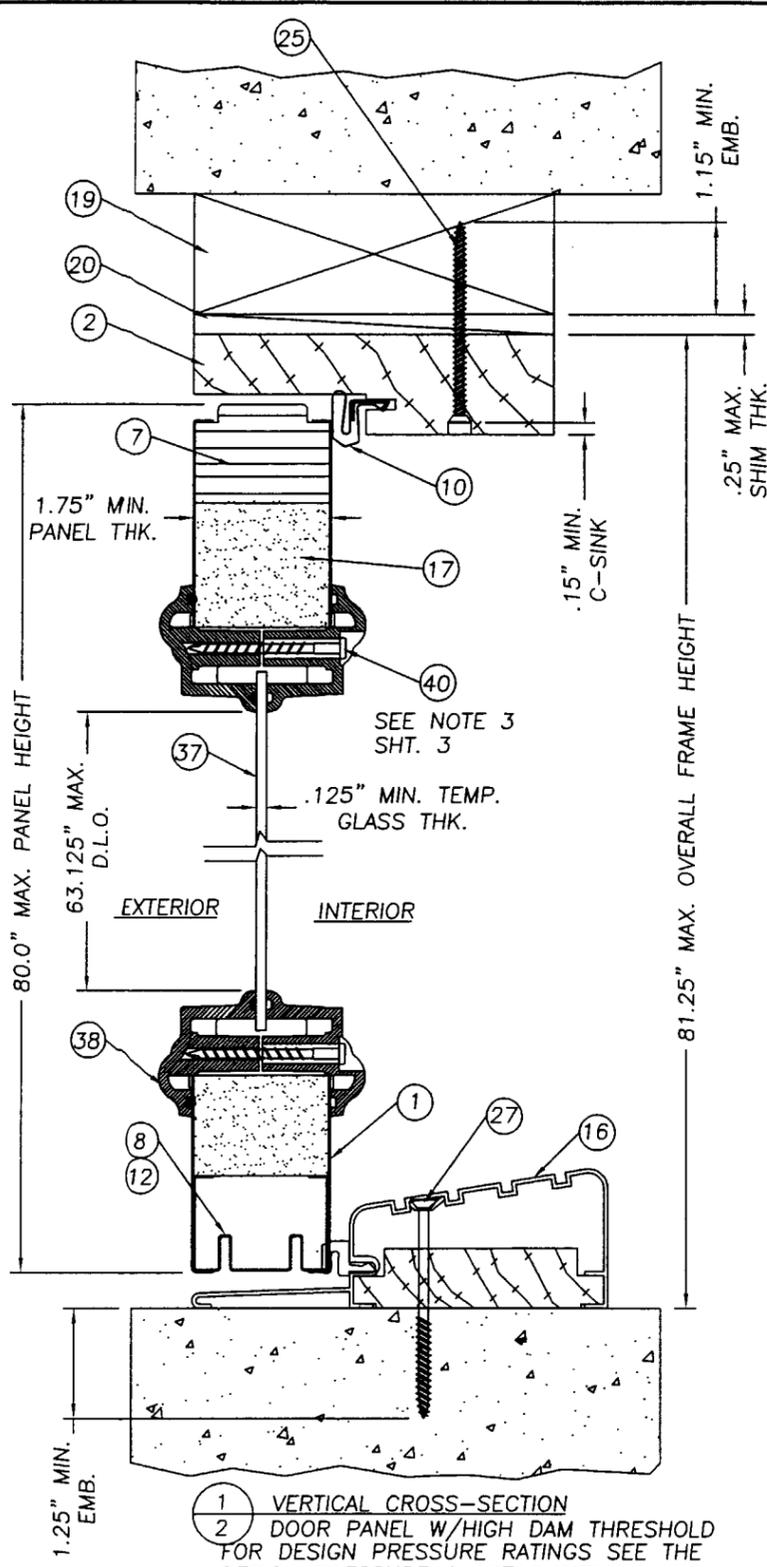

1 VERTICAL CROSS-SECTION  
2 DOOR PANEL W/HIGH DAM THRESHOLD  
FOR DESIGN PRESSURE RATINGS SEE THE  
DESIGN PRESSURE CHART SHEET 1

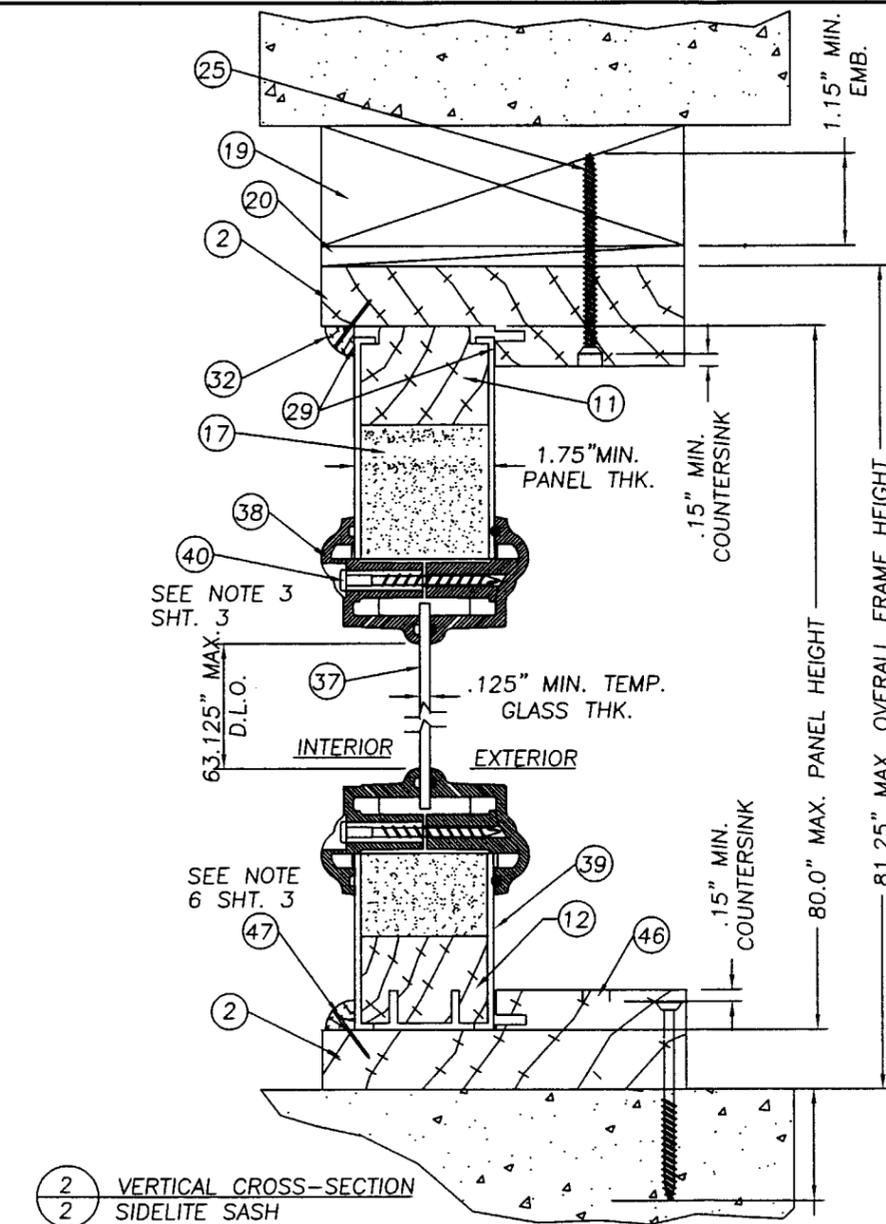

2 VERTICAL CROSS-SECTION  
2 SIDELITE SASH

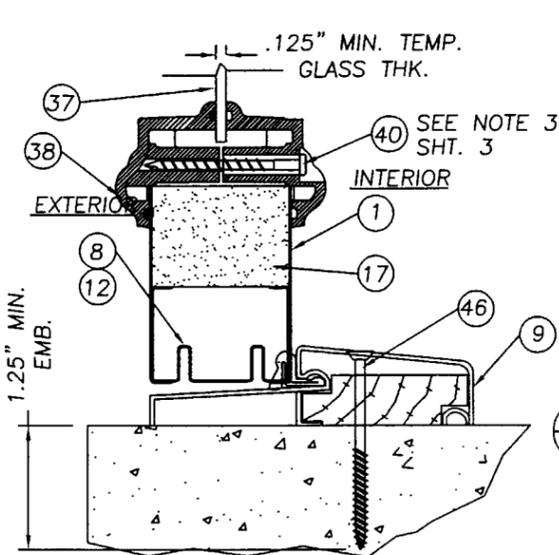

1 VERTICAL CROSS-SECTION  
2 DOOR PANEL W/LOW PROFILE THRESHOLD  
THE LOW PROFILE THRESHOLD "DOES NOT"  
MEET THE WATER REQUIREMENTS FOR  
"HIGH VELOCITY HURRICANE ZONES".

| ITEM | DESCRIPTION  | MATERIAL  |
|------|--|-----------|
| 1    | DOOR, WOOD EDGE 1.75" THK. 24GA. (.021" MIN.)                  | STEEL     |
| 2    | HEAD JAMB (1 1/4" x 4 9/16" FINGER JOINTED PINE)               | PINE      |
| 3    | HINGE JAMB (1 1/4" x 4 9/16" FINGER JOINTED PINE)              | PINE      |
| 4    | SIDELITE BLANK JAMB (1 1/4" x 4 9/16" FINGER JOINTED PINE)     | PINE      |
| 5    | 4" x 4" BUTT HINGE 12ga. (.097" HAGER)                         | STEEL     |
| 6    | #9 X 1" PFH WOOD SCREW (HINGE TO DOOR)                         | STEEL     |
| 7    | DOOR LATCH SIDE STILE & TOP RAIL LVL1.67" x 1"                 | LVL       |
| 8    | DOOR PANEL BOTTOM RAIL (1.73" x 1.21" x .021" THK. MIN. 24GA.) | STEEL     |
| 9    | OUTSWING BUMPER THRESHOLD (.050" EXTRUDED ALUM.)               | ALUM.     |
| 10   | COMPRESSION WEATHERSTRIP (SCHLEGEL Q-LON QDS 650)              | FOAM      |
| 11   | SIDELITE PANEL WOOD TOP RAIL 1.67" x 1"                        | WOOD      |
| 12   | DOOR AND SIDELITE PANEL WOOD BOTTOM RAIL 1.67" x 1"            | WOOD      |
| 13   | DOOR HINGE & SIDELITE PANEL WOOD SIDE STILE 1.67" x 1"         | WOOD      |
| 14   | #10 x 2" PFH WOOD SCREW  | STEEL     |
| 15   | WOOD LOCK BLOCK (1.71" x 4.0" x 12.0")                         | WOOD      |
| 16   | HIGH DAM BUMP THRESHOLD BY IMPERIAL .051" ALUM.                | ALUM.     |
| 17   | EXPANDED POLYSTYRENE (1.0 TO 1.25 LB. DENSITY) BY JELD-WEN     | FOAM      |
| 18   | 1/4" x 1 3/8" WOOD MULLION CAP                                 | WOOD      |
| 19   | 2x WOOD SUB BUCK   | WOOD      |
| 20   | SHIM MATERIAL (.25" MAX. THK.)                                 | -         |
| 21   | KWIKSET 400 SERIES KNOB  | -         |
| 22   | KWIKSET TITAN 700 SERIES DEADBOLT                              | -         |
| 23   | 16GA. BRAD TRIM NAIL 1" L.                                     | STEEL     |
| 24   | #8 x 2" PHILL. FLATHEAD WOOD SCREW                             | STEEL     |
| 25   | #8 x 2 1/2" PHILL. FLATHEAD WOOD SCREW                         | STEEL     |
| 26   | ASTRAGAL EXTRUDED ALUM. (WR68J W/INDJAMBER II BY GENESIS)      | ALUM.     |
| 27   | 3/16" x 2 3/4" L. TAPCON ANCHOR (ELCO)                         | STEEL     |
| 28   | IVES SURFACE BOLT #454 8.0" L. x .25" THK. STEEL               | STEEL     |
| 29   | SILICONE CAULK (CR LAWRENCE 33C)                               | SILICONE  |
| 30   | GLAZING COMPOUND (QSD BY ODL)                                  | SILICONE  |
| 31   | #8 x 1" PPH WOOD SCREW (ASTRAGAL WR68J TO DOOR)                | STEEL     |
| 32   | 3/8" x 3/8" 1/4" ROUND SIDELITE STOP                           | WOOD      |
| 33   | 1/4-20 SEX BOLT W/1/4-20 FEMALE END x 1 3/4" L                 | STEEL     |
| 34   | SCHLAGE KNOB SET #F51 (NOT RATED ABOVE +50 psf)                | -         |
| 35   | SCHLAGE DEADBOLT #B360 (NOT RATED ABOVE +50 psf)               | -         |
| 36   | GLAZING COMPOUND DOW 1199                                      | SILICONE  |
| 37   | 1/8" TEMPERED GLASS (BY PPG)                                   | GLASS     |
| 38   | LITE FRAME (ODL HP POLYPROP. THERMOFIL-P6-30FM0391)            | POLYPROP. |
| 39   | STEEL SIDELITE PANEL 24GA. (.021" MIN. STEEL)                  | STEEL     |
| 40   | #8 x 1 1/2" PLASCREW (LITE FRAME)                              | STEEL     |
| 41   | EXTRUDED ALUMINUM ASTRAGAL BY IMPERIAL                         | ALUM.     |
| 42   | YALE KNOB HERITAGE SERIES                                      | -         |
| 43   | YALE DEADBOLT HERITAGE SERIES                                  | -         |
| 44   | #10 x 1" PHILLIPS FLATHEAD WOOD SCREW                          | STEEL     |
| 45   | #8 x 2" PHILLIPS FLATHEAD WOOD SCREW                           | STEEL     |
| 46   | 3/16" x 2 1/2" L. TAPCON ANCHOR (ELCO)                         | STEEL     |
| 47   | 16GA. BRAD TRIM NAIL 3/4" L.                                   | STEEL     |
| 48   | 3/4" PRESSURE TREATED REINFORCEMENT                            | WOOD      |
| 49   | LITE FRAME BY TRINITY FOR 1/2" GLASS                           | POLYPROP. |
| 50   | 1/2" INSULATED TEMP. GLASS BY AMPAC                            | -         |
| 51   | LITE FRAME BY TRINITY FOR 1" GLASS                             | POLYPROP. |
| 52   | 1" INSULATED TEMP. GLASS BY AMPAC                              | -         |
| 53   | LITE FRAME SCREW #6 X 1 1/2" PANHEAD                           | STEEL     |

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILLOQUIN, OR. 97624  
PH. 541.783.2057






PRODUCT:  
WOOD EDGE GLAZED DOUBLE  
DOOR W/3-0 SIDELITES  
UP TO 12' x 6'8" OUTSWING  
PART OR ASSEMBLY:  
VERTICAL CROSS SECTIONS  
& BILL OF MATERIAL

| NO. | DATE     | BY                     | REVISIONS |
|-----|----------|------------------------|-----------|
| 3   | 10/22/02 | ADDED TRINITY LITE ROF |           |
| 2   | 06/07/02 | GENERAL REVISION WLN   |           |
| 1   | 03/07/02 | GENERAL REVISION TJH   |           |

RW BUILDING  
CONSULTANTS, INC.  
813.659.9197

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 02-1211-15  
Expiration Date 08/22/03  
By *[Signature]*  
Miami Product Control  
Division

DATE: 12/10/01  
SCALE: NTS  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.:  
S-2130  
SHEET 2 OF 6

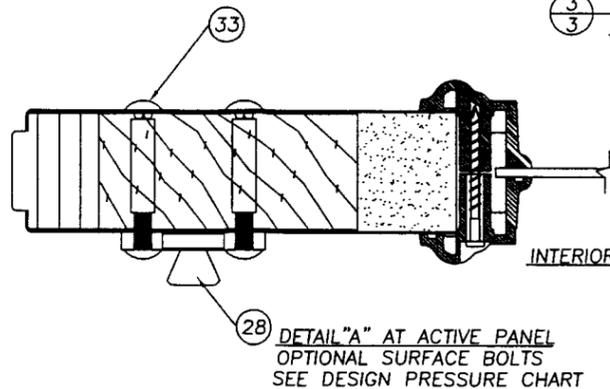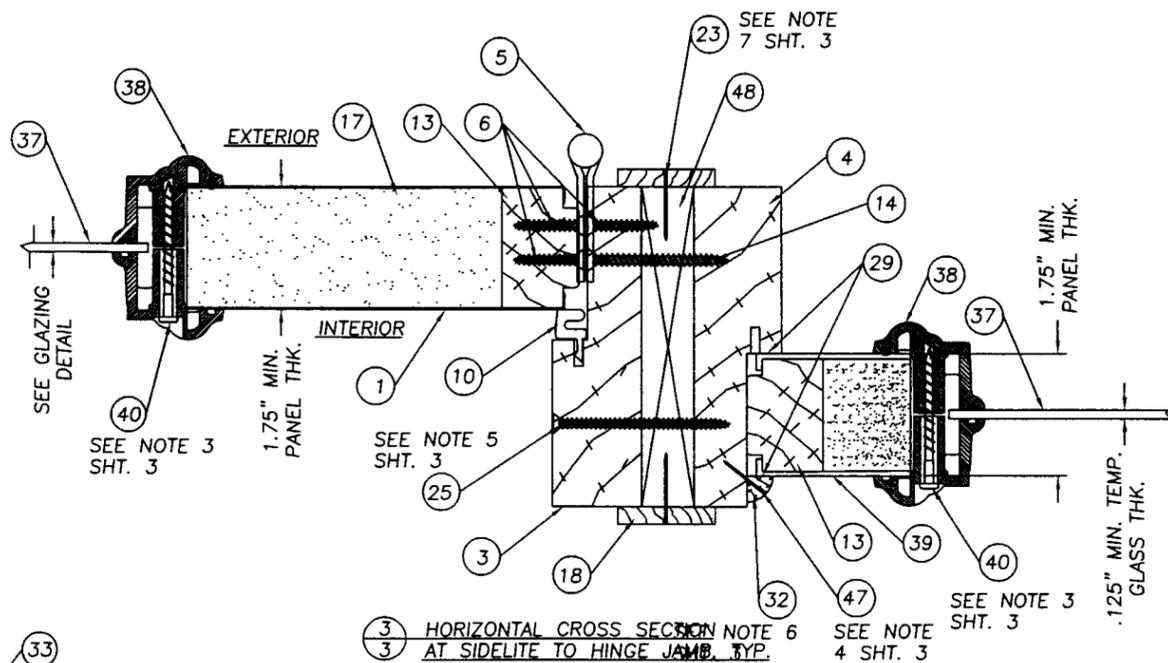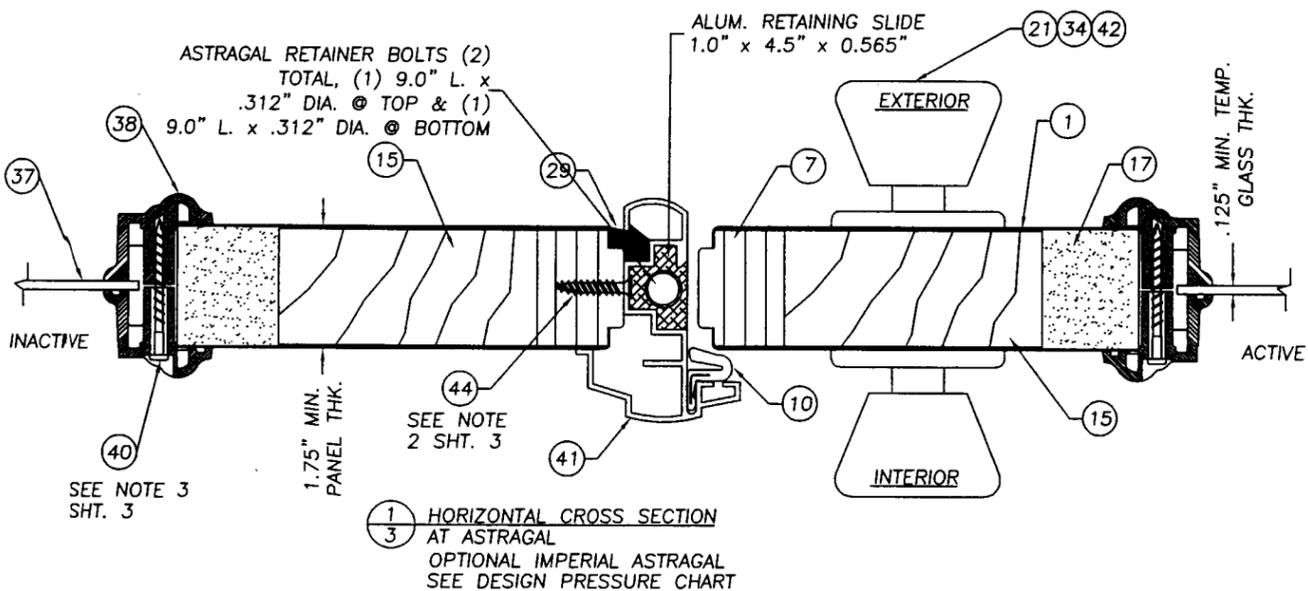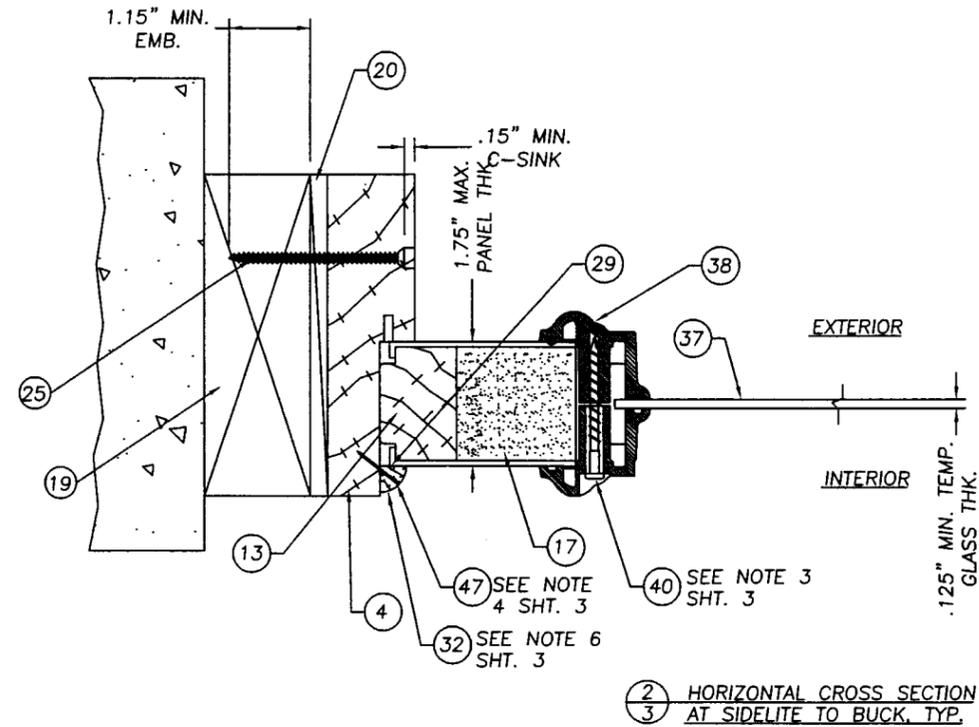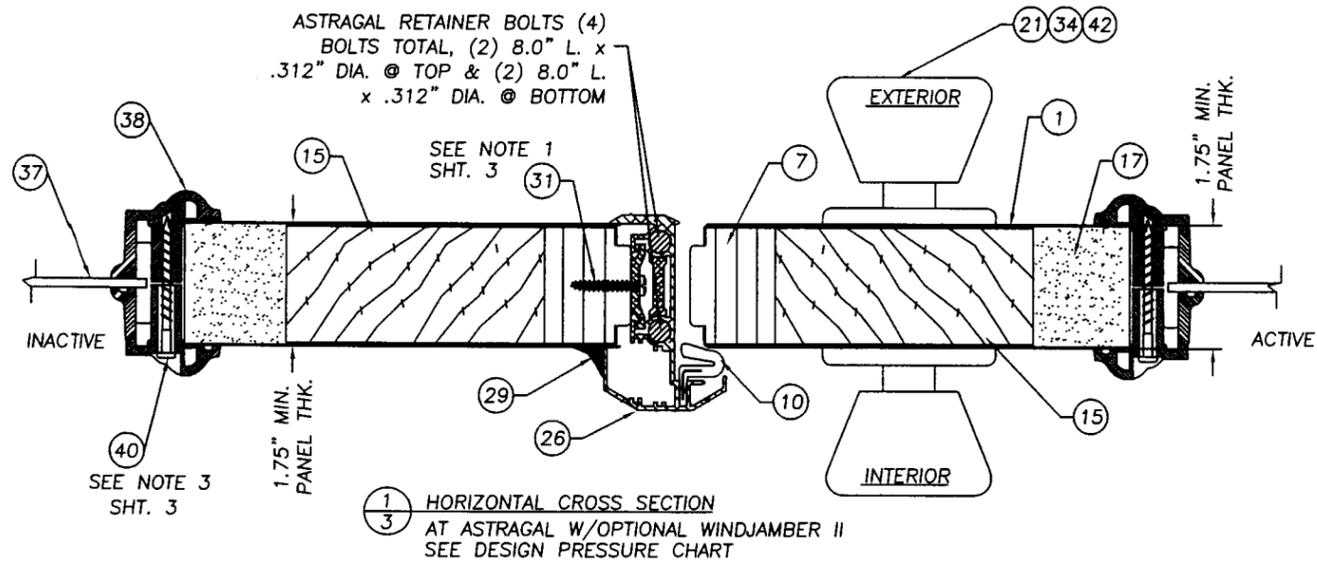

NOTES:

1. SPACING FOR THE (9) #8 x 1" PFH SCREW ATTACHING THE WINDJAMBER ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS: TOP DOWN; 1.0", 3.0", 5.0" & 19" FROM THE BOTTOM UP; 1.0", 3.0", 5.0", 19" & 38".
2. SPACING FOR THE (14) #10 x 1" PFH SCREW ATTACHING THE IMPERIAL ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS: FROM THE TOP DOWN & BOTTOM UP; 1.0", 2.5", 4.0", 5.5", 13.0", 18.0" & 26.0".
3. SPACING FOR #8 x 1 1/2" PLASCREW IS AS FOLLOWS; (3) TOP & BOTTOM; (1) SCREW 3.0" 3.0" IN FROM EACH HORIZONTAL CORNER WITH (1) MORE IN THE CENTER. (6) SCREWS FROM THE TOP OF THE FRAME DOWN ON THE SIDES; 3.0", 13.0", 26.0", 39.0", 52.0" & 63.0".
4. SPACING FOR BRAD TRIM NAIL 3/4" L. ATTACHING THE QUARTER ROUND TO THE SIDELITE IS AS FOLLOWS; TOP & BOTTOM; 1.25" IN FROM EACH HORIZONTAL CORNER WITH (1) MORE NAIL IN THE MIDDLE. SIDES; 1.25" FROM EACH END & SIX MORE EQUALLY SPACED ON THE FIELD.
5. SPACING FOR #8 x 2.5" PFH WOOD SCREW ATTACHING THE MULLIONS TOGETHER IS AS FOLLOWS; 6.0" FROM EACH VERTICAL CORNER WITH (4) MORE SCREWS EQUALLY SPACED, A TOTAL OF (6) SCREWS PER EACH VERTICAL MULLION.
6. THE SIDELITE IS SECURED INTO THE SIDELITE JAMB WITH SILICONE CAULK ON THREE SIDES & 3/8" x 3/8" 1/4 ROUND & BRAD TRIM NAIL x 3/4" L.
7. THE MULLION CAP IS ATTACHED TO THE PRESSURE TREATED REINFORCEMENT WITH ITEM #23 A 1" TRIM NAIL SPACED A MAX. OF 12" ON CENTER.
8. THE SPACING FOR ITEM #53 THE #6 1 1/2" PANHEAD SCREW IN THE TRINITY LITE FRAME IS AS FOLLOWS: FROM THE TOP DOWN ON THE SIDES (9) AT 3.25", 10.625", 18.0625", 25.4375", 32.8125", 40.1875", 47.625", 55" & 62.375". AT THE TOP AND BOTTOM FROM RIGHT TO LEFT (3) AT 3.25", 11.875" AND 20.5".

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

PRODUCT:  
WOOD EDGE GLAZED DOUBLE  
DOOR, W/3-0 SIDELITES UP TO  
12' x 6'8" OUTSWING UNIT

PART OR ASSEMBLY:  
HORIZONTAL CROSS  
SECTIONS


| NO. | DATE     | BY  | REVISIONS          |
|-----|----------|-----|--------------------|
| 3   | 10/22/02 | ROF | ADDED TRINITY LITE |
| 2   | 06/07/02 | WLN | GENERAL REVISION   |
| 1   | 03/07/02 | TJH | GENERAL REVISION   |

RW BUILDING  
CONSULTANTS, INC.  
813.659.9197


PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 02-1211.15  
Expiration Date 08/22/07

By *[Signature]*  
Miami Door Product Control  
Division


DATE: 12/10/01  
SCALE: NTS  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2130  
SHEET 3 OF 6

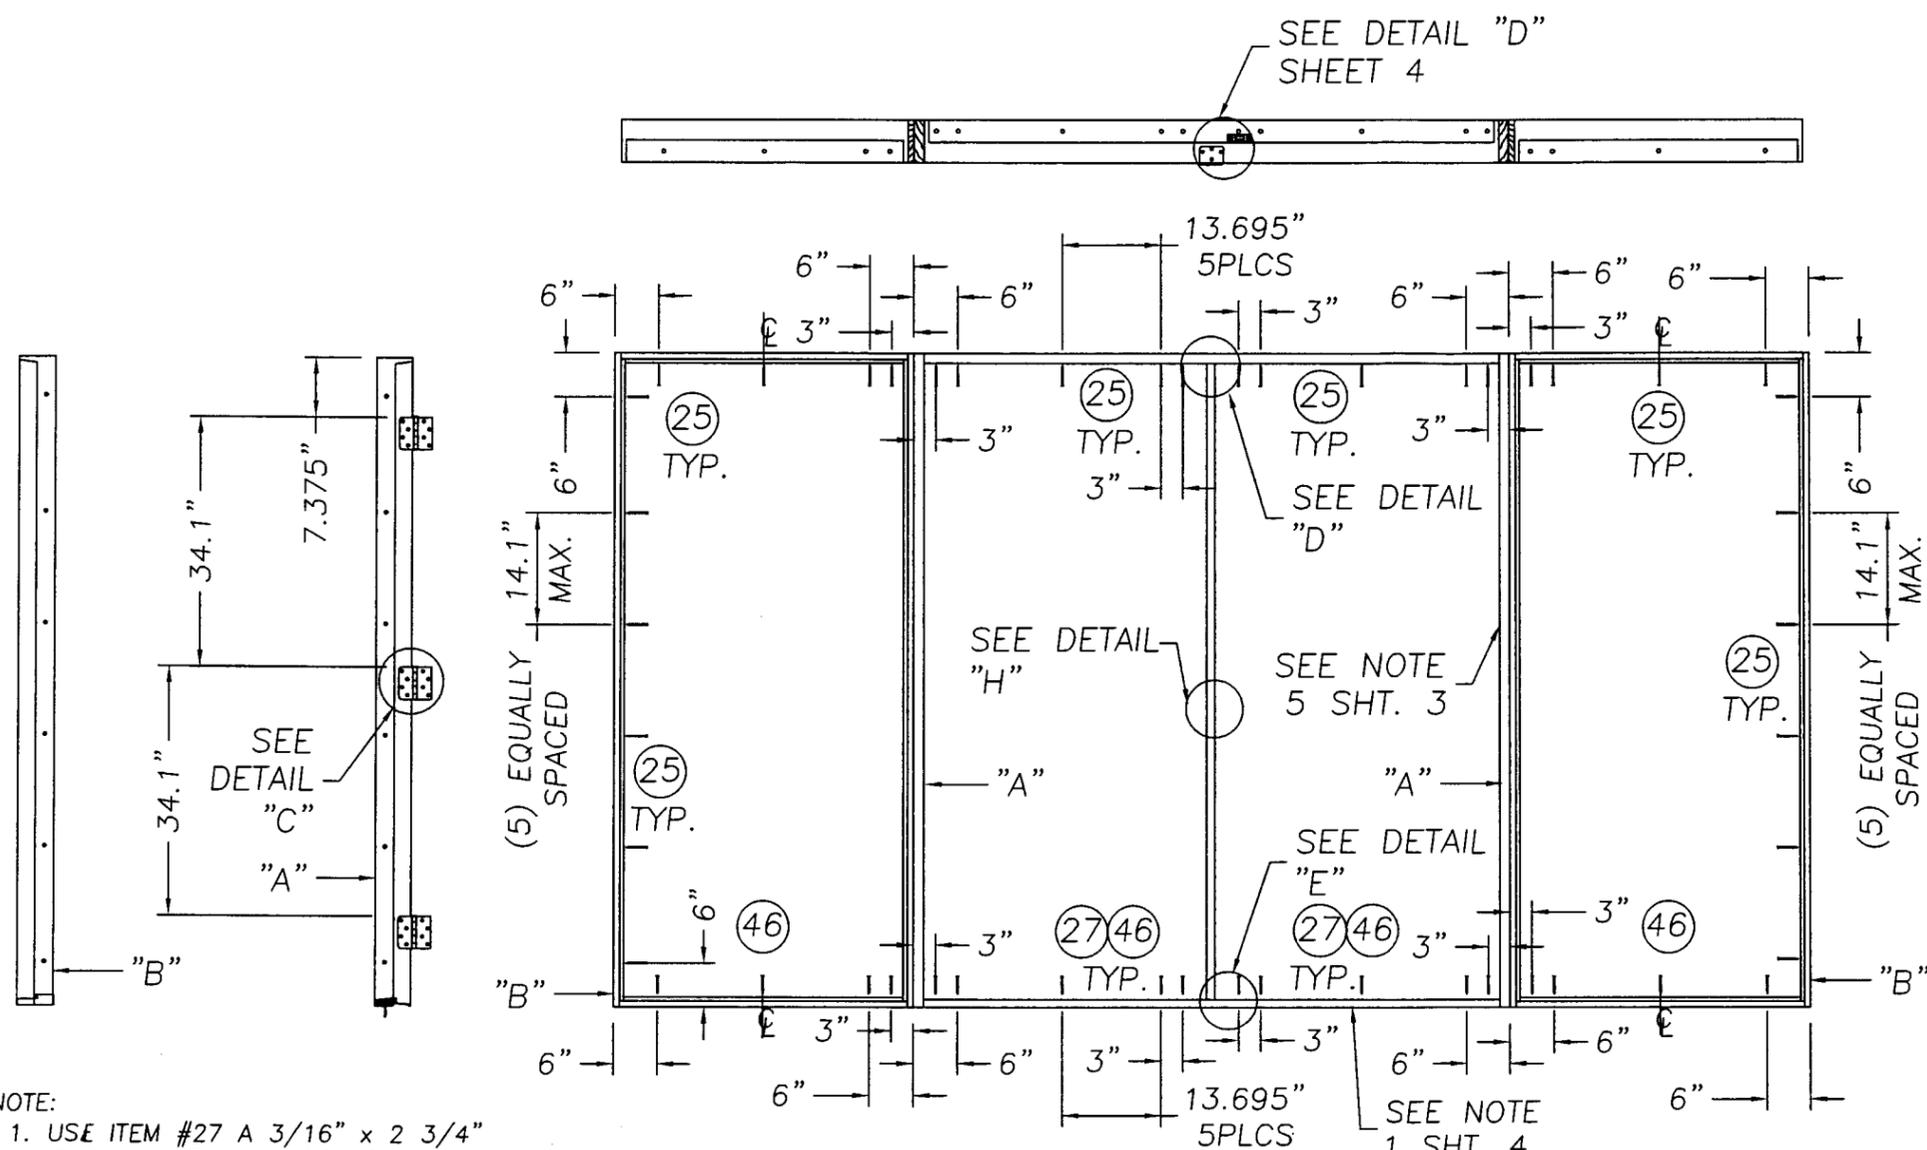


NOTE:  
 1. USE ITEM #27 A 3/16" x 2 3/4" TAPCON WITH THE HIGH DAM THRESHOLD. USE ITEM #46 A 3/16" x 2 1/2" TAPCON WITH THE LOW PROFILE THRESHOLD.

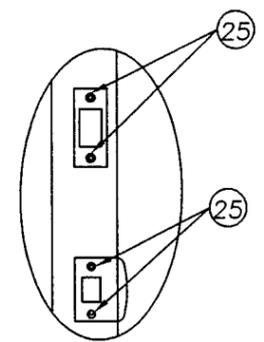


DETAIL H  
 STRIKE PLATES TO ASTRAGAL

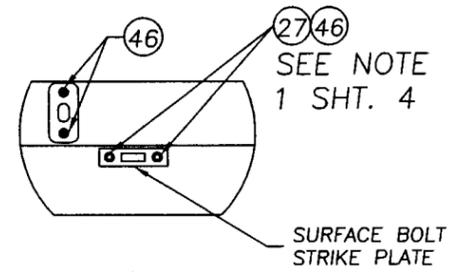


DETAIL E (IMPERIAL ASTRAGAL)  
 AT SILL

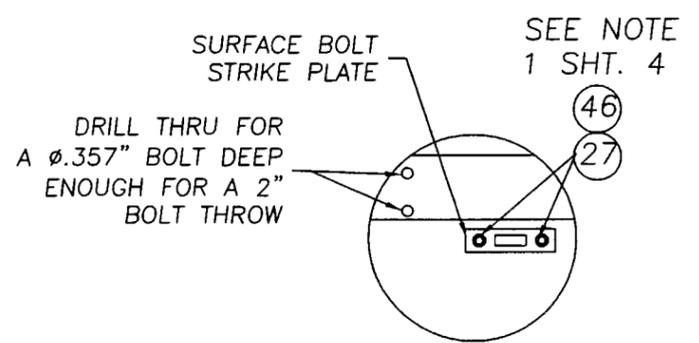


DETAIL E AT SILL  
 WINDJAMBER II ASTRAGAL BY GENESIS  
 RETAINER BOLT HOLES & OPTIONAL  
 SURFACE BOLT STRIKE PLATE

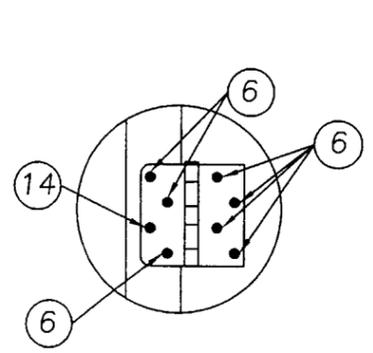

DETAIL "C"

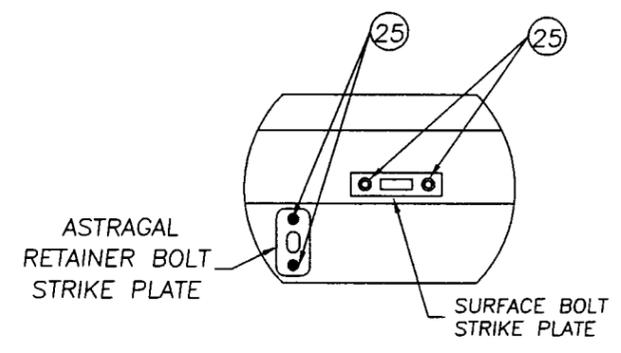

DETAIL D (IMPERIAL ASTRAGAL)  
 AT HEADER

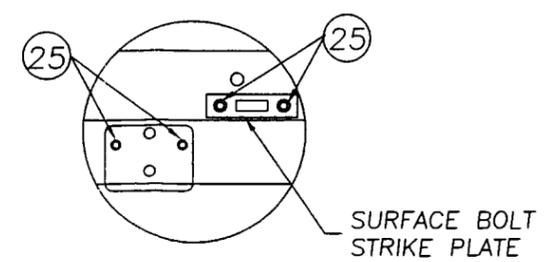

DETAIL "D" AT HEADER  
 WINDJAMBER II ASTRAGAL BY GENESIS  
 ATTACH ASTRAGAL THROW BOLT  
 STRIKE PLATE TO FRAME AS SHOWN

JELD-WEN, INC.  
 31725 HIGHWAY 97 NORTH  
 CHILOQUIN, OR. 97624  
 PH. 541.783.2057

PRODUCT: WOOD EDGE GLAZED DOUBLE  
 DOOR W/3-0 SIDELITES UP TO  
 12' x 6'8" OUTSWING  
 PART OR ASSEMBLY:  
 ANCHORING LOCATION  
 & DETAILS


| NO. | DATE     | BY  | REVISIONS          |
|-----|----------|-----|--------------------|
| 3   | 10/22/02 | ROF | ADDED TRINITY LITE |
| 2   | 06/07/02 | WLN | GENERAL REVISION   |
| 1   | 03/07/02 | TJH | GENERAL REVISION   |

**RW** BUILDING  
 CONSULTANTS, INC.  
 813.659.9197


DATE: 12/10/01  
 SCALE: NTW  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.: S-2130  
 SHEET 4 OF 6

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 Acceptance No. 02-1211.15  
 Expiration Date 08/22/10  
 By: *[Signature]*  
 Miami Code Product Control  
 Division


GLAZING DETAIL  
1/8" TEMPERED GLASS  
ODL LITE FRAME

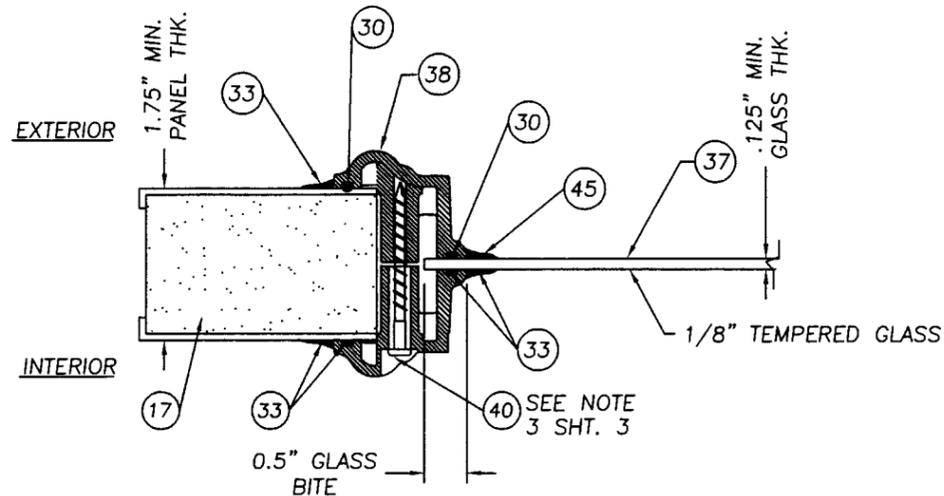


(38)  
1/8" GLASS LITE FRAME  
ODL  
HP POLYPROPYLENE  
(THERMOFIL-P6-30FM0391)

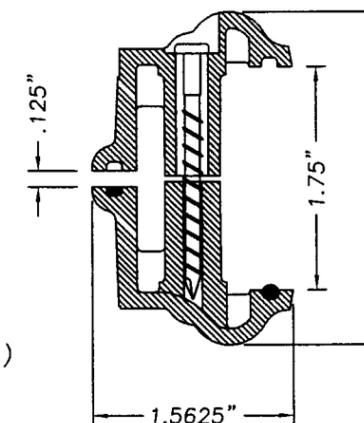


GLAZING DETAIL  
1/2" INSULATED TEMPERED GLASS  
TRINITY LITE FRAME

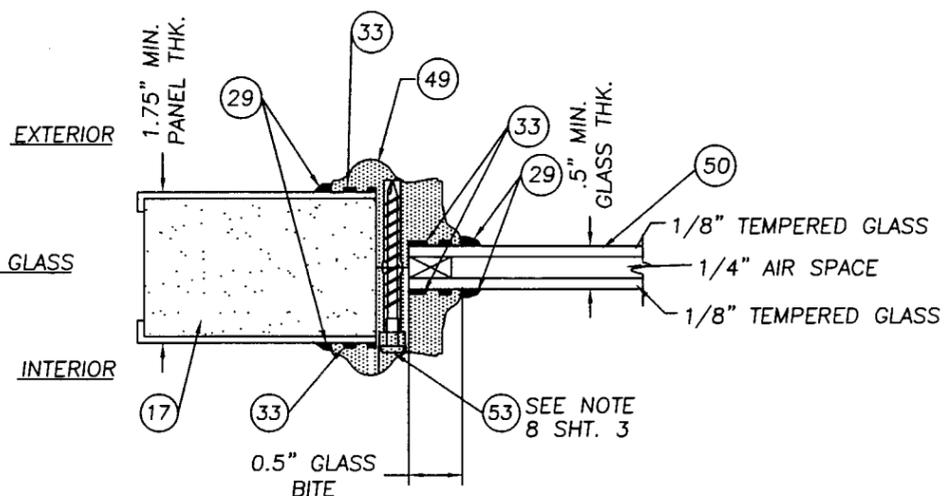


(49)  
1/2" GLASS LITE FRAME  
TRINITY  
(LUPOY EU 5007)

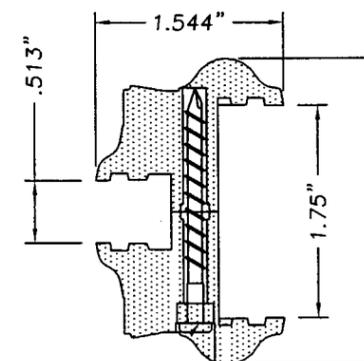

GLAZING DETAIL  
1" INSULATED TEMPERED GLASS  
TRINITY LITE FRAME

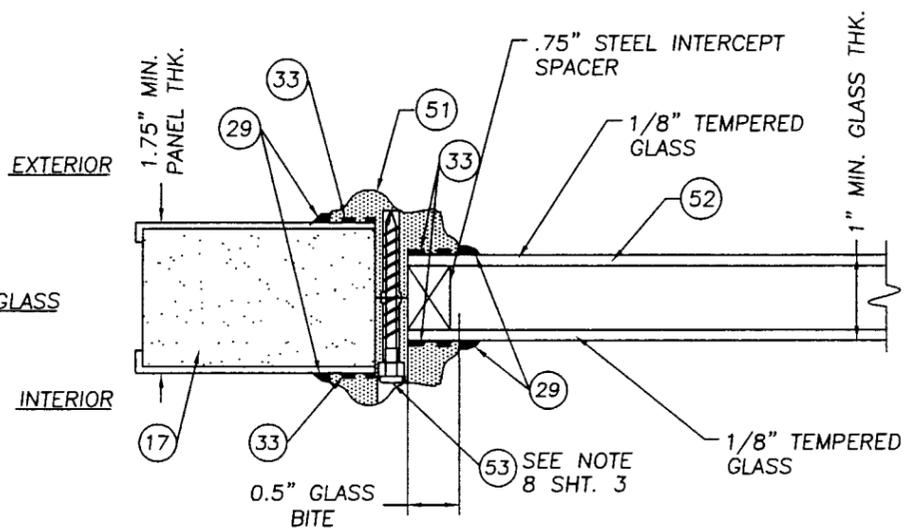

(51)  
1" GLASS LITE FRAME  
TRINITY  
(LUPOY EU 5007)

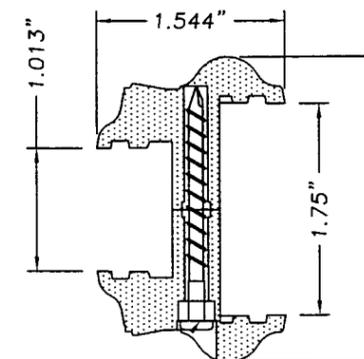

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057













PRODUCT: WOOD EDGE GLAZED DOUBLE  
DOOR W/3-0 SIDELITES  
UP TO 12' X 6'8" OUTSWING  
PART OR ASSEMBLY:  
GLAZING  
CROSS SECTIONS

| NO. | DATE     | BY  | REVISIONS           |
|-----|----------|-----|---------------------|
| 3   | 10/22/02 | ZRK | ADDED TRINITY FRAME |
| 2   | 06/07/02 | WLN | GENERAL REVISION    |
| 1   | 03/07/02 | TJH | GENERAL REVISION    |

RW BUILDING  
CONSULTANTS, INC.  
813.659.9197

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 02-1211.15  
Expiration Date 08/22/07  
By *[Signature]*  
Miami Product Control  
Division

DATE: 12/10/01  
SCALE: N.T.S.  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.:  
S-2130  
SHEET 5 OF 6

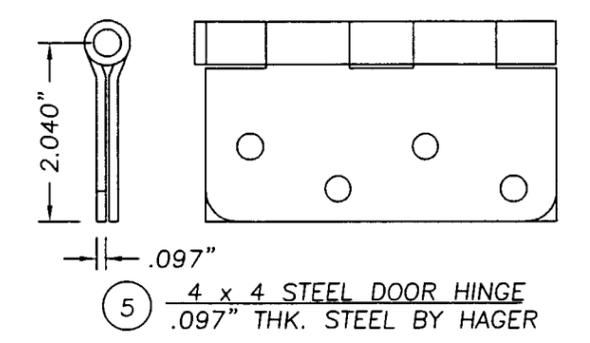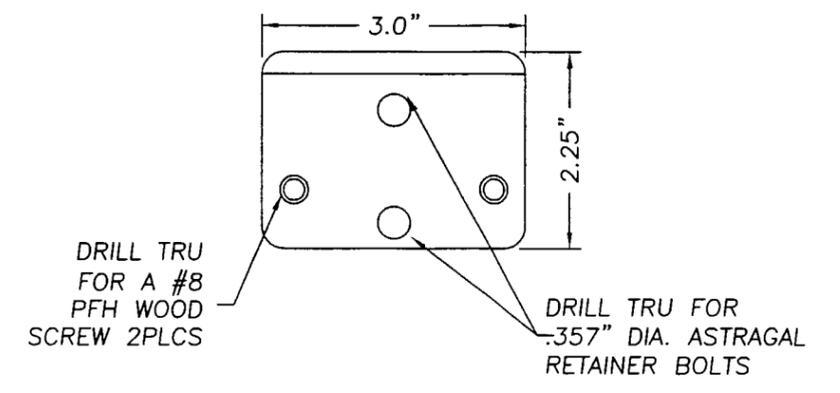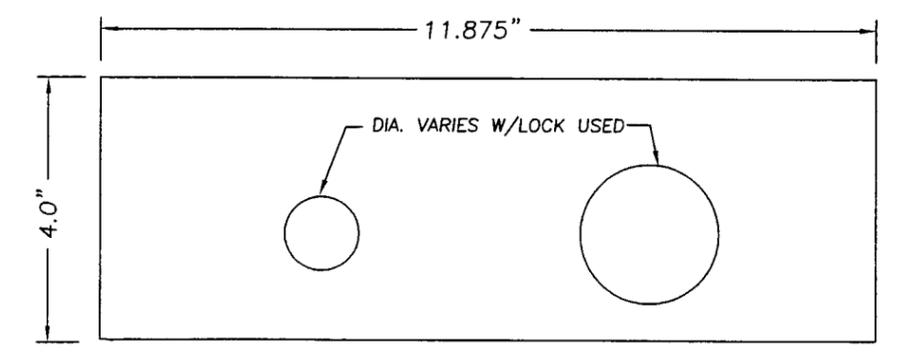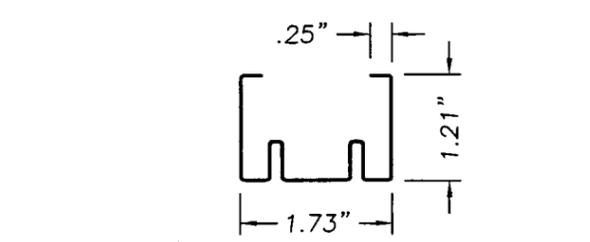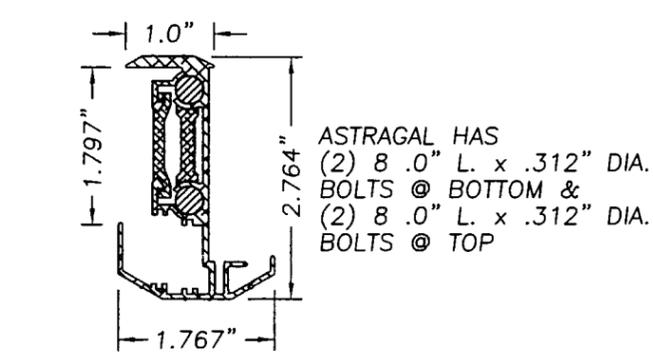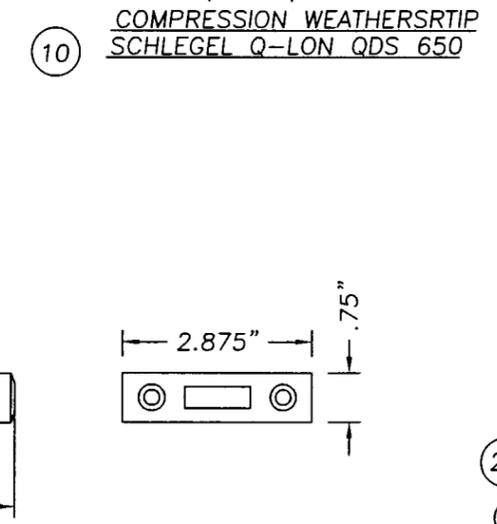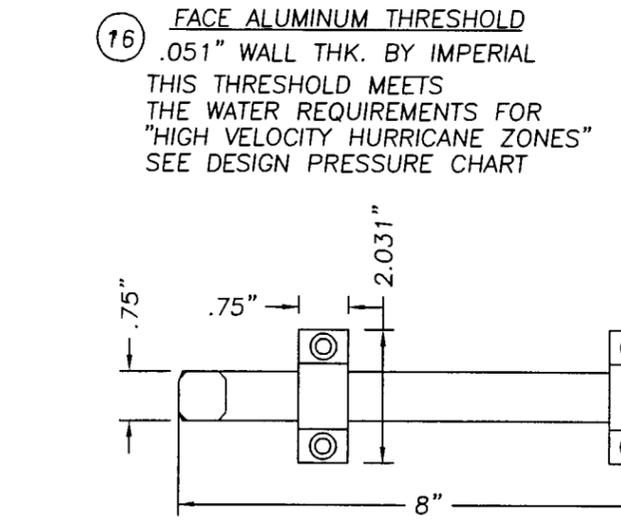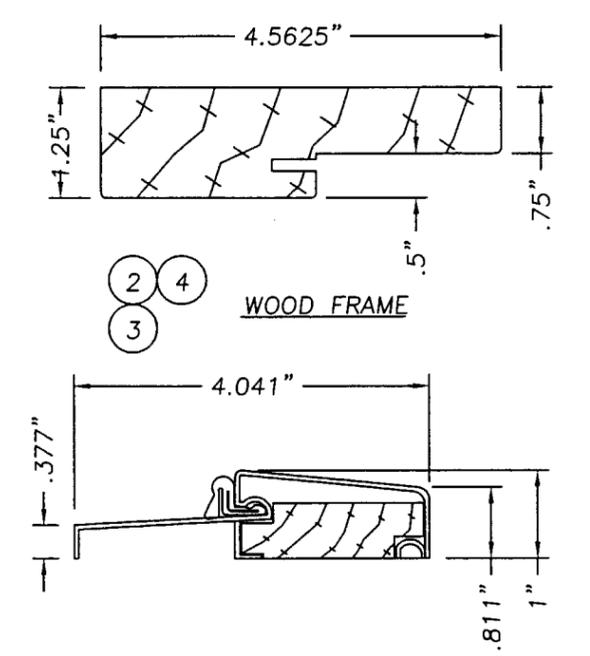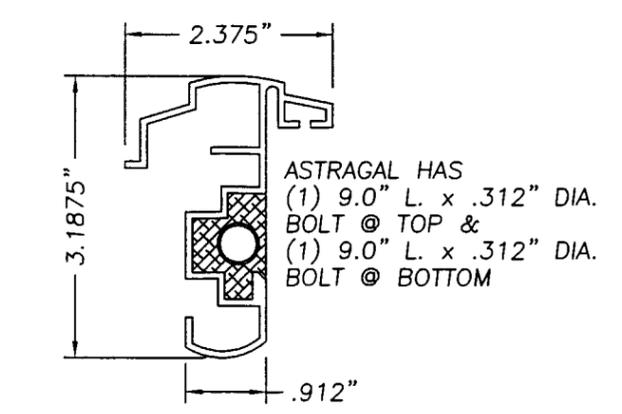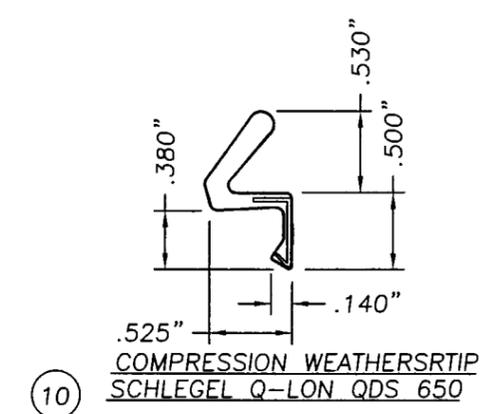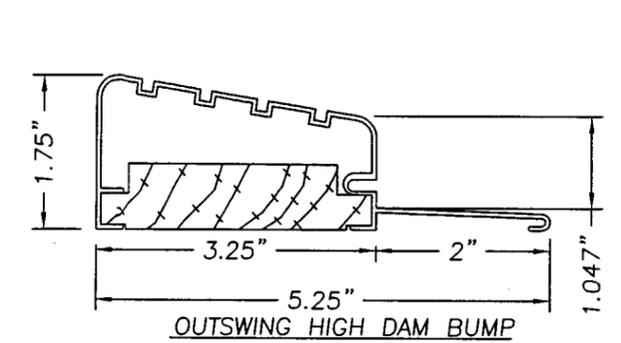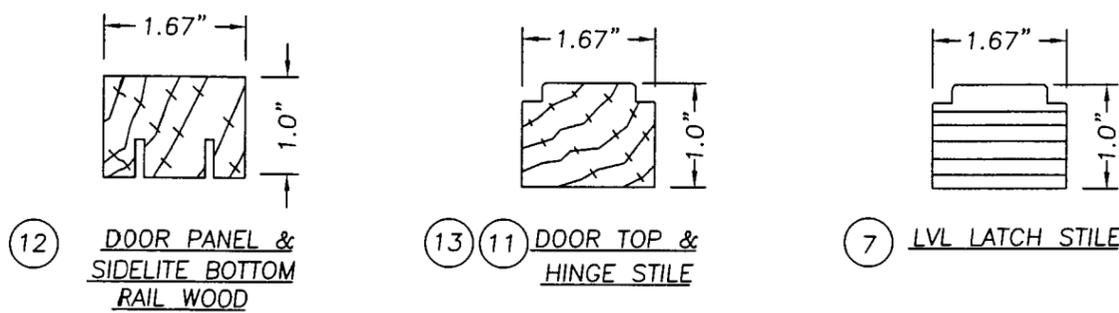

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

PRODUCT: WOOD EDGE GLAZED DOUBLE DOOR W/3-0 SIDELITES UP TO 12' x 6'8" OUTSWING PART OR ASSEMBLY: UNIT COMPONENTS

| NO. | DATE     | BY  | REVISIONS          |
|-----|----------|-----|--------------------|
| 3   | 10/22/02 | ROF | ADDED TRINITY LITE |
| 2   | 06/07/02 | WLN | GENERAL REVISION   |
| 1   | 03/07/02 | TJH | GENERAL REVISION   |

RW BUILDING CONSULTANTS, INC.  
813.659.9197

DATE: 12/11/01  
SCALE: NTS  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2130  
SHEET 6 OF 6

PRODUCT REVISED as complying with the Florida Building Code Acceptance No 02-1211.15 Expiration Date 08/22/07  
By: [Signature] Miami Product Control Division