



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Jeld-Wen, Inc.
317525 Highway 97 N.
Chiloquin, OR 97624**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series "Jeld-Wen®" 6'8" W/E Inswing Glazed Insulated Steel Door w/wo Sidelites

APPROVAL DOCUMENT: Drawing No. **S-2195**, titled "Wood Edge Glazed Door w/ & w/out Sidelites Up to 107" x 6'8 Inswing Unit", sheets 1 through 7 of 8, prepared by R.W Building Consultants, Inc., dated 12/14/01 with revision 3 dated 10/22/02, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA # 01-1224.04** and, consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by **Jaime Eisen, P.E.**



**NOA No 02-1211.16
Expiration Date: August 15, 2007
Approval Date: January 30, 2003
Page 1**

Jeld-Wen, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA)

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **S-2195**, titled "Wood Edge Glazed Door w/ & w/out Sidelites Up to 107" x 6'8 Inswing Unit", sheets 1 through 8 of 8, prepared by R.W Building Consultants, Inc., dated 12/14/01 with revision 3 dated 10/22/02.

B. TESTS

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 3603.2 (b) and TAS 202-94
along with marked-up drawings and installation diagram of a DoorCraft series opaque wood edge steel door, prepared by Certified Testing Laboratories, Test Report No. **CTLA-961W**, dated 10/23/02, signed and sealed by Ramesh C. Patel, P.E.

Submitted under NOA #01-1224.02


1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 3603.2 (b) and TAS 202-94
along with marked-up drawings and installation diagram of DoorCraft series OXXO configuration outswing and inswing glazed wood edge steel door, prepared by Certified Testing Laboratories, Test Report No. **CTLA-697W**, dated 11/11/01, signed and sealed by Ramesh C. Patel, P.E. with addendum letter dated April 11, 2002 also signed and sealed by Ramesh C. Patel, P.E.

C. CALCULATIONS

1. Anchor Calculations and structural analysis dated 12/2/02, prepared by R.W. Building Consultants, Inc., signed and sealed by Lyndon F. Schimdt, P.E.

Submitted under NOA #01-1224.02

2. Anchor Calculations and structural analysis dated 12/15/01, prepared, signed and sealed by Wendell Haney, P.E. with addendum letter dated April 7, 2002 also signed and sealed by Wendell Haney, P.E.



Jaime Eisen, P.E.
Product Control Division
NOA No 02-1211.16

Expiration Date: August 15, 2007
Approval Date: January 30, 2003

Jeld-Wen, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA)

D. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **01-0718.08** issued to ODL, Inc. for "HP Propropylene Doorlight Assembly" dated 1/17/02, expiring on 1/17/06.
2. Tensile Test prepared by Certified Testing Laboratories, Test Report No. **CTLA-697W/DADE01014**, dated June 05, 2001 and Nov. 14, 2001, tested per **ASTM E8/A370 or B557**, signed and sealed by Ramesh C. Patel, P.E.
3. Test reports No. J9906660-001 for "Surface burning characteristics" per ASTM E-84 and "Self ignition test" per ASTM 1929 D, for polystyrene core dated April 8, 1999, issued by Intertek Testing Services.
4. Notice of Acceptance No. **02-0429.11**, issued to Trinity Glass International, Inc. for "Trinity Lite Frame" dated 7/3/02, expiring on 7/3/07.

E. STATEMENTS

1. Statement letter of no financial interest, dated 10/10/02, signed by Steve Frey.

F. OTHER

1. Notice of Acceptance No. **01-1224.04**, issued to Jeld-Wen, Inc. for "Series "DoorCraft®" 6'8" W/E Inswing Glazed Insulated Steel Door w/wo Sidelites" dated 8/15/02, expiring on 8/15/07.



Jaime Eisen, P.E.
Product Control Division
NOA No 02-1211.16
Expiration Date: August 15, 2007
Approval Date: January 30, 2003

JELD-WEN® Steel

WOOD EDGE GLAZED INSULATED STEEL DOOR
INSWING 6-8 UNITS W/ & W/OUT SIDELITES

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO COMPLY WITH THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. DESIGNED PRESSURE RATING SEE TABLE PAGE 1.
5. THIS SYSTEM DOES NOT MEET THE WATER REQUIREMENTS FOR "HIGH VELOCITY HURRICANE ZONES". (SEE NOTE DESIGN PRESSURE CHART)
6. THIS SYSTEM REQUIRES WINDBORNE DEBRIS EXTERNAL PROTECTION AS PRESCRIBED IN SECTION 1626.1 OF THE FLORIDA BUILDING CODE.
7. SIDELITES ARE AN OPTION AND CAN BE USED IN A SINGLE OR DOUBLE CONFIGURATION.

RESIDENTIAL INSULATED STEEL DOOR (Common to all frame conditions)

Door Leaf Construction:

Face sheets: 24 ga. (0.021") minimum thickness,

Galvanized steel A-525 commercial quality - AKDQ per ASTM 620 with yield strength $F_y(\text{ave.})=47,575$ psi.

Core design: Expanded polystyrene with 1.0 to 1.25 lbs. density, by Jeld-Wen, Inc.


Panel Construction & glazing: The active and inactive panels are constructed from 24GA. (0.021" min.) galvanized steel. The face sheet top and bottoms are bent 90° over the top and bottom rails. The top rail consists of LVL measuring 1.67" x 1.042". The bottom rail is roll formed 0.021" galvanized steel measuring 1.67" x 1.21". The sides of the face sheet are roll formed into the LVL latch stile and Ponderosa Pine hinge stile which measure 1.67" x 1.0". The interior cavity is filled with polystyrene. The face sheet is glued to the polystyrene. The panels are routed to receive the ODL or Trinity lite frames. The units are glazed with 0.125" tempered glass or 1.0" ins. glass. The lite frames are wet glazed on the exterior.

Sash Construction & glazing: The sash is constructed from 24GA. (0.021" min.) galvanized steel. The edges of the face sheet are bent 90° over the polystyrene core and glued to it. The sashes are routed to receive the ODL or Trinity lite frame. The units are glazed with 0.125" tempered glass or 1.0" ins. tempered glass. The lite frames are wet glazed on the exterior.

Frame Construction: The frames are constructed from Ponderosa Pine jambs measuring 4.563" x 1.25". The head jambs are mortised and butt joined to the side jambs and attached with (3) 16GA. 2" x 7/16" crown wire staples. The units use a slope adjustable aluminum threshold meas. 4.562" x 1.173". The threshold is attached to the frame with (3) 16ga. 2" x 7/16" crown wire staples.

TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATIONS
2	VERTICAL CROSS SECTIONS & BILL OF MATERIAL
3	HORIZONTAL CROSS SECTIONS
4	HORIZONTAL CROSS SECTIONS & NOTES
5	ANCHORING LOCATIONS & DETAILS
6	ANCHORING LOCATIONS
7	UNIT COMPONENTS
8	GLAZING DETAILS & UNIT COMPONENTS

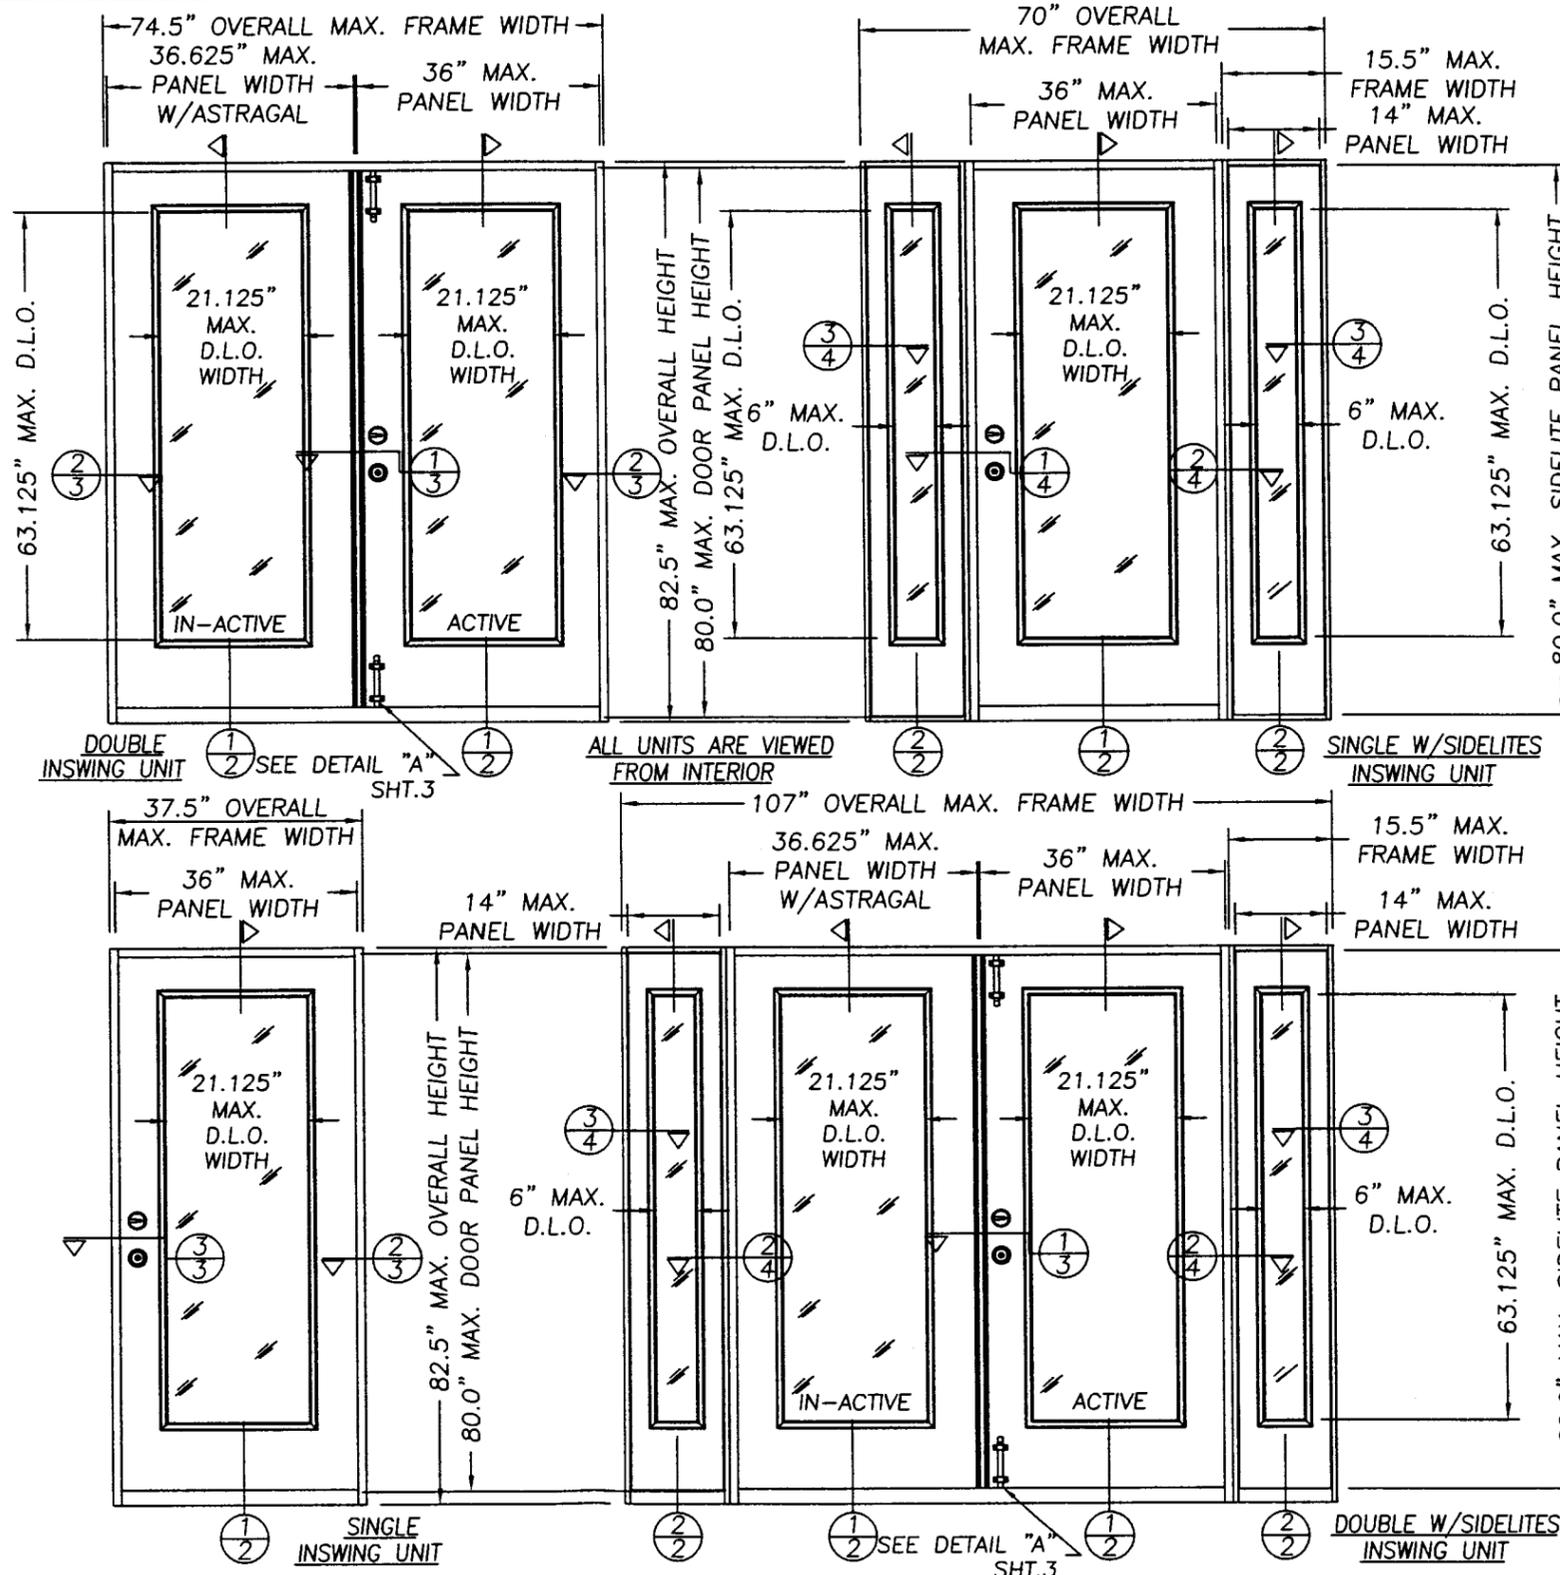

DESIGN PRESSURE RATING

NOTE: WHEN USED IN "HIGH VELOCITY HURRICANE ZONES" UNITS MUST BE INSTALLED ONLY AT LOCATIONS PROTECTED BY A CANOPY OR OVERHANG SUCH THAT THE ANGLE BETWEEN THE EDGE OF CANOPY OR OVERHANG TO THE SILL IS LESS THAN 45°. UNLESS UNIT IS INSTALLED IN NON-HABITABLE AREAS WHERE THE AREA IS DESIGNED TO ACCEPT WATER INFILTRATION.

UNIT TYPE	POSITIVE	NEGATIVE
SINGLE & DOUBLE W/OUT SURFACE BOLTS ON ACTIVE PANEL	+50.0psf	-50.0psf
SINGLE & DOUBLE WITH SURFACE BOLTS ON ACTIVE PANEL	+65.0psf	-65.0psf

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 02-1211.16
Expiration Date 08/15/02
By *[Signature]*
Miami Dade Product Control
Division

DATE: 12/14/01

SCALE: NTS

DWG. BY: WLN

CHK. BY: RW

DRAWING NO.:

S-2195


SHEET 1 OF 8

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057


PRODUCT: WOOD EDGE GLAZED DOOR
W/ & W/OUT SIDELITES UP TO
107" x 6'8" INSWING UNIT
PART OR ASSEMBLY:
TYPICAL ELEVATION &
GENERAL NOTES

NO	DATE	BY	REVISIONS
3	10/22/02	ZRK	ADDED TRINITY FRAME
2	06/07/02	RW	GENERAL REVISION
1	03/15/02	TJH	GENERAL REVISION

RW BUILDING
CONSULTANTS, INC.
813.659.9197

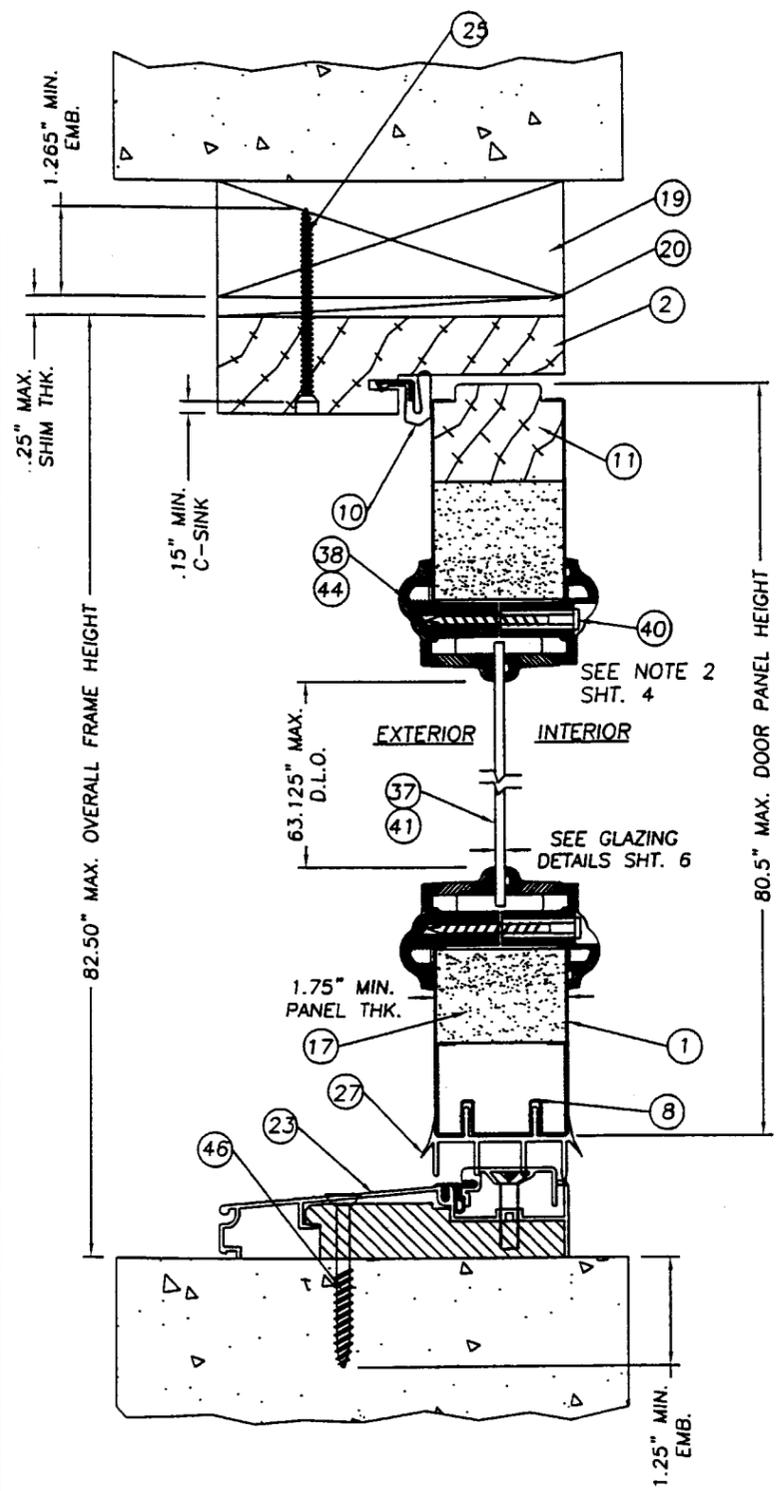

1 VERTICAL CROSS-SECTION DOOR PANEL
2 VERTICAL CROSS-SECTION SIDELITE SASH

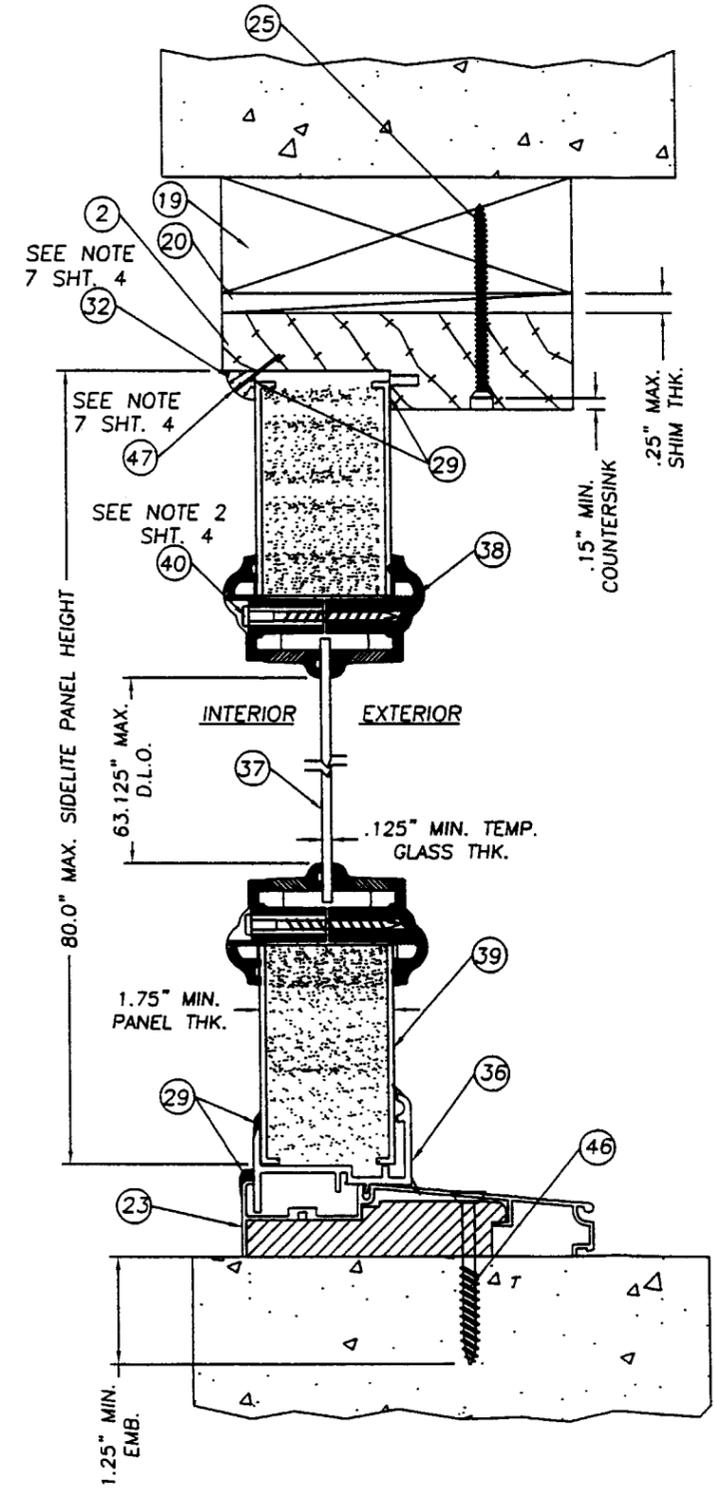

1 VERTICAL CROSS-SECTION DOOR PANEL
2 VERTICAL CROSS-SECTION SIDELITE SASH

ITEM	DESCRIPTION	MATERIAL
1	DOOR, WOOD EDGE 1.75" THK. 24GA. (.021" MIN.)	STEEL
2	HEAD JAMB (1 1/4" x 4 9/16" PONDEROSA FINGER JOINTED PINE)	PINE
3	HINGE JAMB (1 1/4" x 4 6/16" PONDEROSA FINGER JOINTED PINE)	PINE
4	SIDELITE BLANK JAMB (1 1/4" x 4 9/16" PONDEROSA FINGER JOINTED PINE)	PINE
5	4" x 4" BUTT HINGE 12ga. (.097" HAGER)	STEEL
6	#9 X 1" PFH WOOD SCREW (HINGE TO DOOR)	STEEL
7	DOOR LATCH LVL SIDE STILE 1.67" x 1"	LVL
8	DOOR PANEL BOTTOM RAIL (1.73" x 1.21" x .021" THK. MIN. 24GA.)	STEEL
9	GLAZING COMPOUND DOW 1199 SILICONE	SILICONE
10	COMPRESSION WEATHERSTRIP (SCHLEGEL Q-LON ODS 650)	FOAM
11	DOOR PANEL WOOD TOP RAIL 1.67" x 1"	LVL
12	1/4" x 1 3/8" WOOD MILLION CAP	WOOD
13	DOOR HINGE WOOD SIDE STILE 1.67" x 1"	WOOD
14	#10 x 1 3/4" PFH WOOD SCREW	STEEL
15	WOOD LOCK BLOCK (1.71" x 4.0" x 12.0")	WOOD
16	16GA. BRAD TRIM NAIL 1" L	STEEL
17	EXPANDED POLYSTYRENE (1.0 to 1.25 lb. DENSITY) BY JELD-WEN	FOAM
18	NOT USED	-
19	2x WOOD SUB BUCK	WOOD
20	SHIM MATERIAL (.25" MAX. THK.)	-
21	KWIKSET 400 SERIES KNOB	-
22	KWIKSET TITAN 700 SERIES DEADBOLT	-
23	INSWING ADJUSTABLE THRESHOLD (.051" WALL BY PEMCO)	-
24	# 8 x 2" PHILL. FLATHEAD WOOD SCREW	STEEL
25	# 8 x 2 1/2" PHILL. FLATHEAD WOOD SCREW	STEEL
26	ASTRAGAL EXTRUDED ALUM. (WR68J WINDJAMBER II)	ALUM.
27	INSWING VINYL DOOR BOTTOM SWEEP	VINYL
28	IVES SURFACE BOLT #454 8.0" L. x .25" THK. STEEL	-
29	SILICONE CAULK (CRL LAWRENCE 33C)	SILICONE
30	GLAZING COMPOUND (QSD BY ODL)	SILICONE
31	#8 x 1" PHILLIPS PANHEAD WOOD SCREW (ASTRAGAL WR68J TO DOOR)	STEEL
32	3/8" x 3/8" 1/4" ROUND SIDELITE STOP	WOOD
33	1/4"-20 SEX BOLT W/1/4"-20 FEMALE END x 1 3/4" L	STEEL
34	SCHLAGE KNOB SET #F51	-
35	SCHLAGE DEADBOLT #B360	-
36	INSWING SIDELITE BOTTOM SEAL	VINYL
37	1/8" TEMPERED GLASS (BY PPG)	GLASS
38	LITE FRAME 1/8" GLASS (ODL HP POLYPROP. THERMOFIL-P6-30FM0391)	POLYPROP.
39	STEEL SIDELITE PANEL 24GA. (.021" MIN. STEEL)	STEEL
40	#8 x 1 1/2" PLASCREW (LITE FRAME)	STEEL
41	1" INSULATED TEMPERED GLASS	-
42	YALE KNOB HERITAGE SERIES	-
43	YALE DEADBOLT HERITAGE SERIES	-
44	LITE FRAME 1" GLASS (ODL HP POLYPROP. THERMOFIL-P6-30FM0391)	-
45	#8 x 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
46	1/4" x 2 1/2" TAPCON	STEEL
47	16GA. BRAD TRIM NAIL 3/4" L	STEEL
48	3/4" THK. x 4 9/16" DEEP PRESSURE TREATED REINFORCEMENT	WOOD
49	GLAZING COMPOUND DOW 1199	SILICONE
50	LATCH JAMB (1 1/4" x 4 9/16" PONDEROSA FINGER JOINTED PINE)	PINE
51	#10 x 1" PHILLIPS FLATHEAD WOOD SCREW	STEEL
52	#10 x 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
53	LITE FRAME BY TRINITY FOR 1/2" GLASS	POLYPROP.
54	1/2" INSULATED TEMP. GLASS BY TRINITY/AMPAC	-
55	LITE FRAME BY TRINITY FOR 1" GLASS	POLYPROP.
56	1" INSULATED TEMP. GLASS BY TRINITY/AMPAC	-
57	LITE FRAME SCREW #6 X 1 1/2" PANHEAD	STEEL

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057


PRODUCT: WOOD EDGE GLAZED DOOR W/ & W/OUT SIDELITES UP TO 107" x 6.8 INSWING UNIT
PART OR ASSEMBLY:
VERTICAL CROSS SECTIONS & BILL OF MATERIAL

NO.	DATE	BY	REVISIONS
3	10/22/02	ZRK	ADDED TRINITY FRAME
2	06/07/02	RW	GENERAL REVISION
1	03/15/02	TJH	GENERAL REVISION

RW BUILDING CONSULTANTS, INC.
813.659.9197


PRODUCT REVISED as complying with the Florida Building Code Acceptance No 02-1211.16 Expiration Date 08/15/07
By *[Signature]*
Miami Division Product Control Division

DATE: 12/14/01
SCALE: NTS
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2195
SHEET 2 OF 8

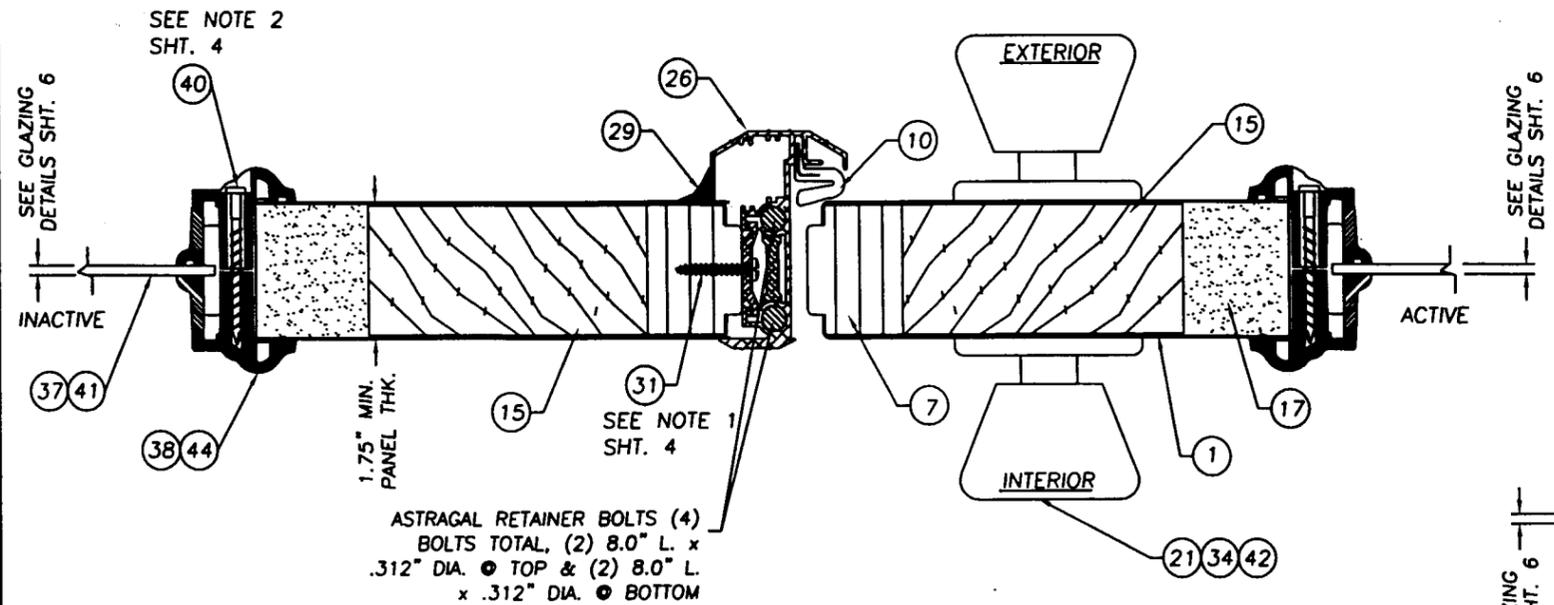


ASTRAGAL RETAINER BOLTS (4)
 BOLTS TOTAL, (2) 8.0" L. x
 .312" DIA. ● TOP & (2) 8.0" L.
 x .312" DIA. ● BOTTOM


1 HORIZONTAL CROSS SECTION
 3 AT ASTRAGAL
 SEE DESIGN PRESSURE CHART

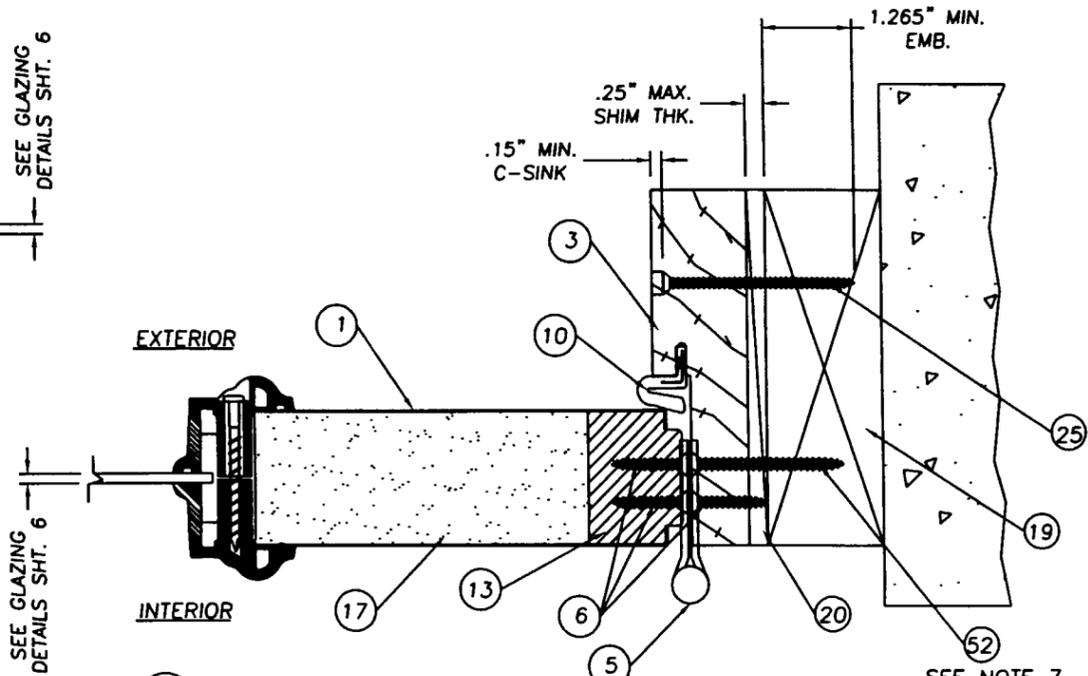

2 HORIZONTAL CROSS SECTION
 3 HINGE JAMB TO BUCK

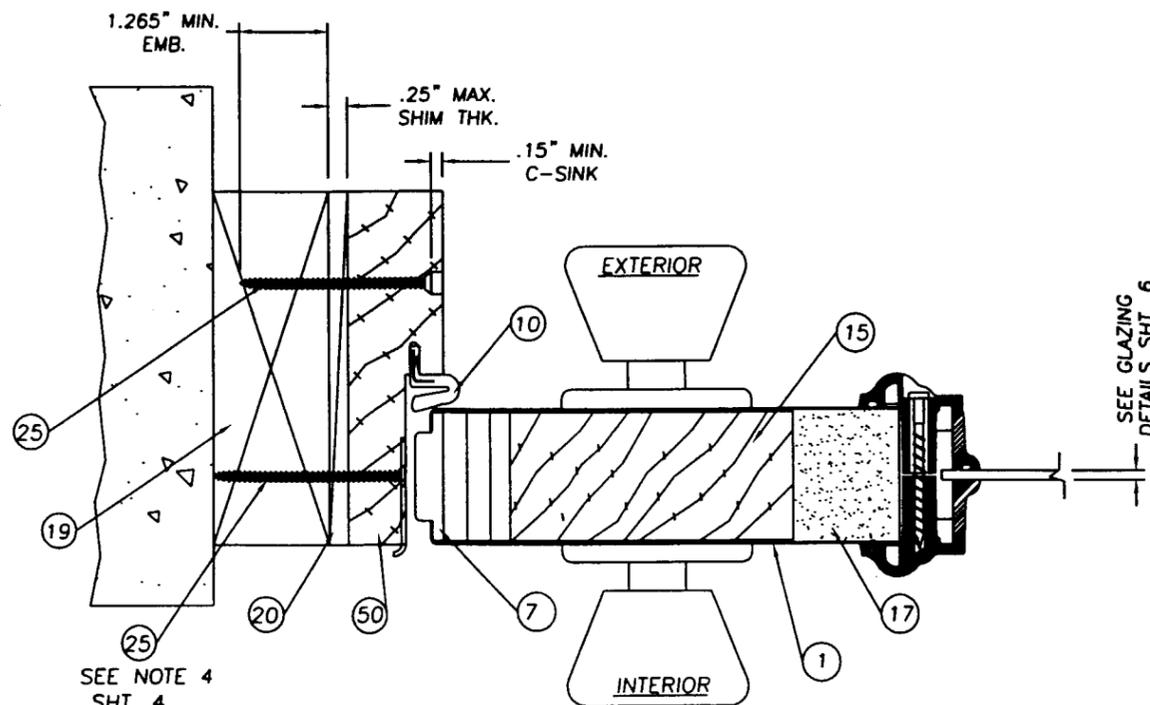

3 HORIZONTAL CROSS SECTION
 3 LATCH JAMB TO BUCK

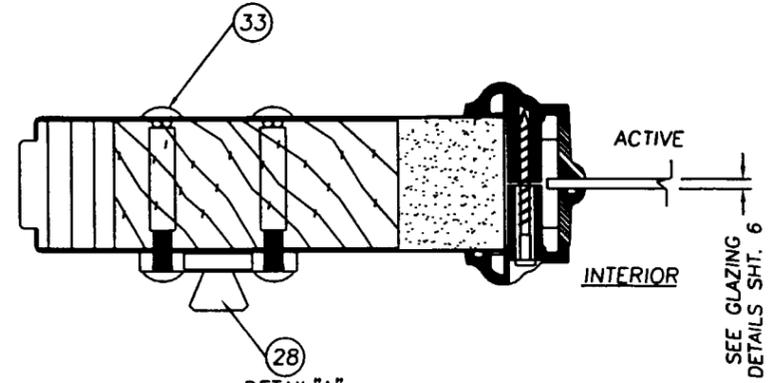

DETAIL "A"
 OPTIONAL SURFACE BOLTS
 SEE DESIGN PRESSURE CHART

JELD-WEN, INC.
 31725 HIGHWAY 97 NORTH
 CHILOQUIN, OR. 97624
 PH. 541.783.2057



PRODUCT: WOOD EDGE GLAZED DOOR
 W/ & W/OUT SIDELITES UP TO
 107" x 6'8" INSWING UNIT
 PART OR ASSEMBLY:
 HORIZONTAL CROSS
 SECTIONS

NO.	DATE	REVISIONS	BY
3	10/22/02	ADDED TRINITY FRAME	ZRK
2	06/07/02	GENERAL REVISION	RW
1	03/15/02	GENERAL REVISION	TJH

RW BUILDING
 CONSULTANTS, INC.
 813.659.9197

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 02-1211-16
 Expiration Date 08/15/07
 By *[Signature]*
 Miami Glass Product Control
 Division

DATE:	12/14/01
SCALE:	NTS
DWG. BY:	WLN
CHK. BY:	RW
DRAWING NO.:	S-2195
SHEET	3 OF 8

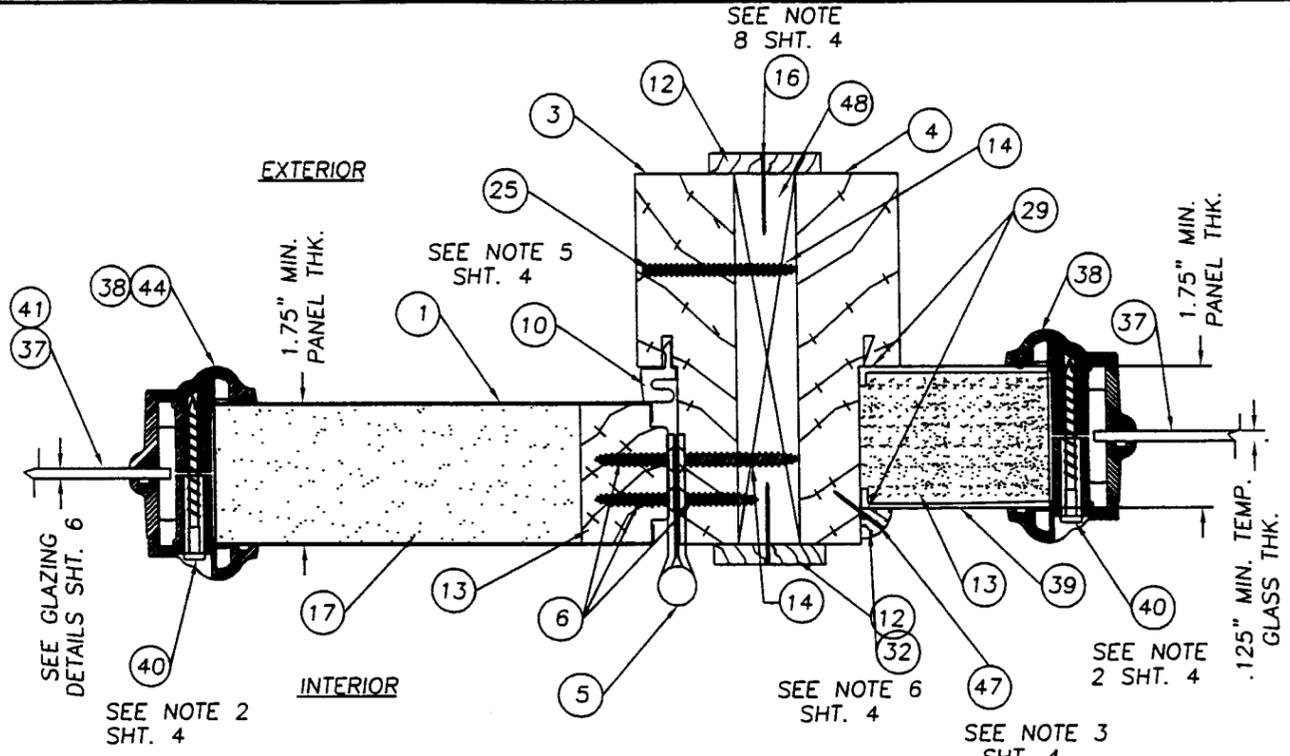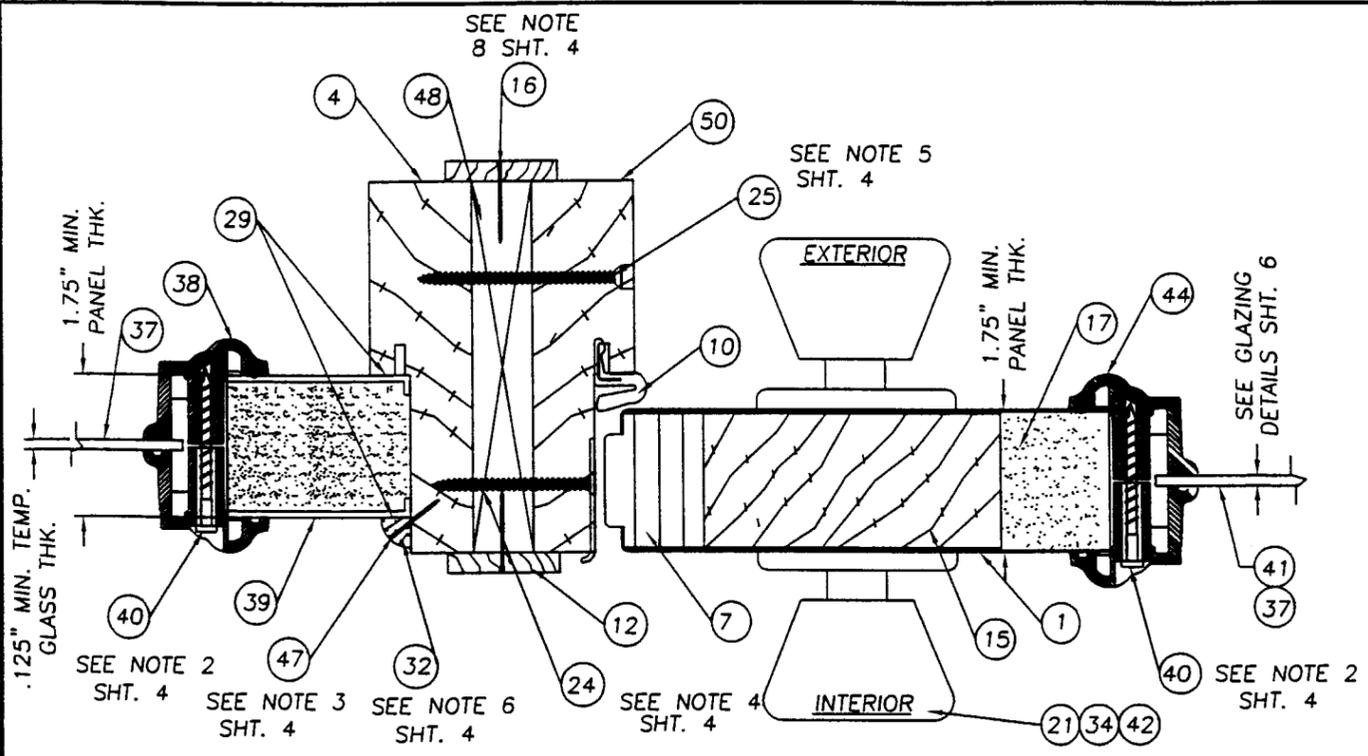


1 HORIZONTAL CROSS SECTION
4 AT SIDELITE TO LATCH JAMB, TYP.
SEE DESIGN PRESSURE CHART

2 HORIZONTAL CROSS SECTION
4 AT SIDELITE TO HINGE JAMB, TYP.
SEE DESIGN PRESSURE CHART

NOTES:

1. SPACING FOR #8 x 1" PFH SCREW ATTACHING THE WINDJAMBER ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS: TOP DOWN; 1.0", 3.0", 5.0" & 19.0". FROM THE BOTTOM UP; 1.0", 3.0", 5.0", 20.0" & 38.75".
2. SPACING FOR #8 x 1 1/2" PLASCREW IS AS FOLLOWS; TOP & BOTTOM; (2) SCREWS 3.0" IN FROM EACH HORIZONTAL CORNER. FROM THE TOP OF THE FRAME DOWN ON THE SIDES; 3.0", 13.0", 26.0", 39.0", 52.0" & 63.0".
3. SPACING FOR BRAD TRIM NAIL 3/4" L. ATTACHING THE QUARTER ROUND TO THE SIDELITE IS AS FOLLOWS; TOP & BOTTOM; 1.25" IN FROM EACH HORIZONTAL CORNER WITH (1) MORE NAIL IN THE MIDDLE. SIDES; 1.25" FROM EACH END & SIX MORE EQUALLY SPACED ON THE FIELD.
4. WHEN ATTACHING THE STRIKE PLATE TO THE JAMB AND BUCK USE #8 x 2 1/2" PFH WOOD SCREW. WHEN ATTACHING THE STRIKE PLATE TO THE JAMB AND SIDELITE JAMB AT THE MULLION USE #8 x 2." PFH WOOD SCREW.
5. SPACING FOR #8 x 2.5" PFH WOOD SCREW ATTACHING THE MULLIONS TOGETHER IS AS FOLLOWS; 6.0" FROM EACH VERTICAL CORNER WITH (4) MORE SCREWS EQUALLY SPACED, A TOTAL OF (6) SCREWS PER EACH VERTICAL MULLION.
6. THE SIDELITE IS SECURED INTO THE SIDELITE JAMB WITH SILICONE CAULK ON THREE SIDES & 3/8" x 3/8" 1/4 ROUND & BRAD TRIM NAIL x 3/4" L.
7. WHEN ATTACHING THE HINGE TO THE JAMB AND BUCK USE #10 x 2" PFH WOOD SCREW. WHEN ATTACHING THE HINGE TO THE JAMB AND SIDELITE JAMB AT THE MULLION USE #10 x 1 3/4" PFH WOOD SCREW.
8. THE MULLION CAP IS ATTACHED TO THE PRESSURE TREATED REINFORCEMENT WITH ITEM #16 A 1" TRIM NAIL SPACED A MAX. OF 12" ON CENTER.
9. SPACING FOR ITEM #57 THE #6 x 1 1/2" PANHEAD SCREW ON THE DOOR LITE FRAME IS AS FOLLOWS: FROM THE TOP DOWN ON THE SIDES (8) AT 3.25", 10.625", 18.0625", 25.4375", 32.8125", 40.1875", 47.625", 55" & 62.375". AT THE TOP & BOTTOM FROM RIGHT TO LEFT (3) AT 3.25", 11.875" & 20.5". THE SCREW SPACING FOR THE SIDELITES IS AS FOLLOWS: FROM THE TOP DOWN ON THE SIDES: (5) AT 3.25", 18.0625", 32.8125", 45.625" & 62.625". THE TOP & BOTTOM (1) SCREW AT 4.4375".

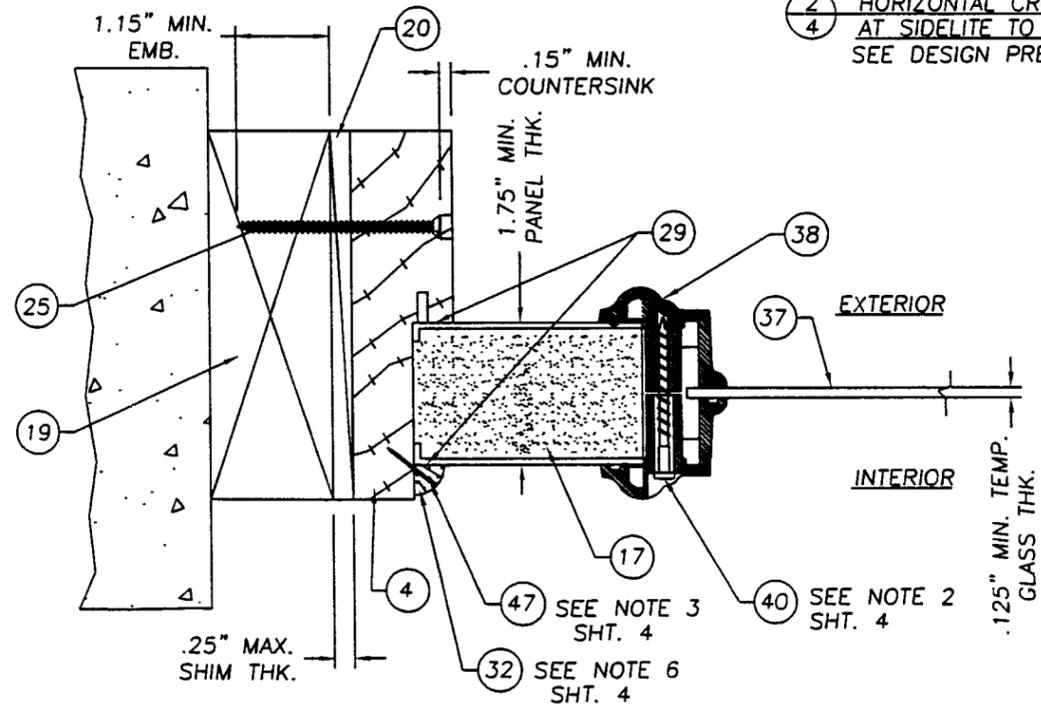

3 HORIZONTAL CROSS SECTION
4 AT SIDELITE TO BUCK, TYP.

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057


PRODUCT: WOOD EDGE GLAZED DOOR
& W/OUT SIDELITES UP TO
107" x 68 INS WING UNIT
PART OR ASSEMBLY:
HORIZONTAL CROSS
SECTIONS & NOTES

NO.	DATE	BY	REVISIONS
3	10/22/02	TRINITY	FRAME ZRK
2	06/07/02	GENERAL	REVISION RW
1	03/15/02	GENERAL	REVISION TJH


RW BUILDING
CONSULTANTS, INC.
813.659.9197

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 02-1211-16
Expiration Date 08/15/07
By: *[Signature]*
Miami Dade Product Control
Division


DATE: 12/14/01
SCALE: N.T.S.
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2195
SHEET 4 OF 8

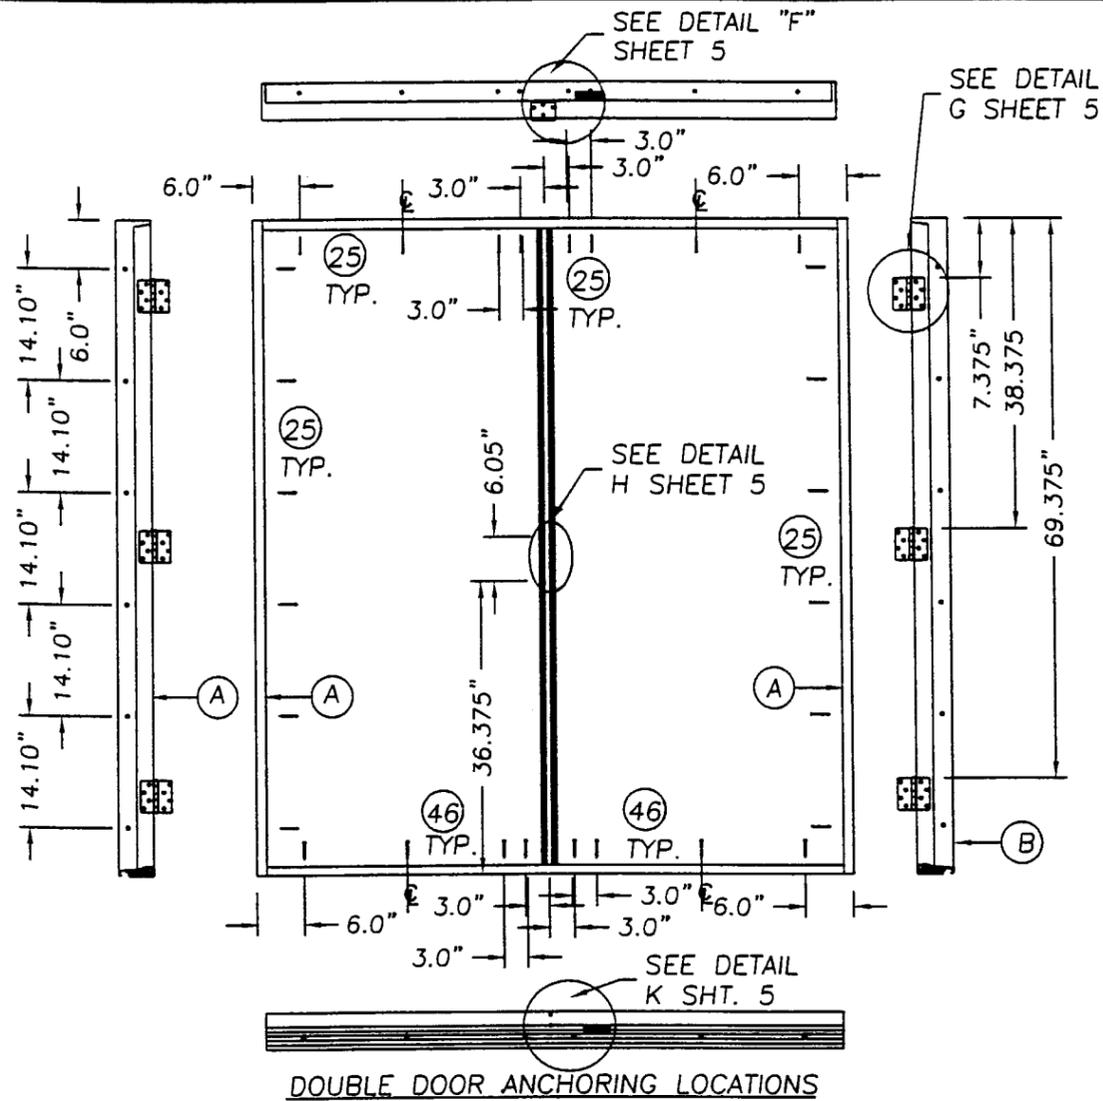


DOUBLE DOOR ANCHORING LOCATIONS

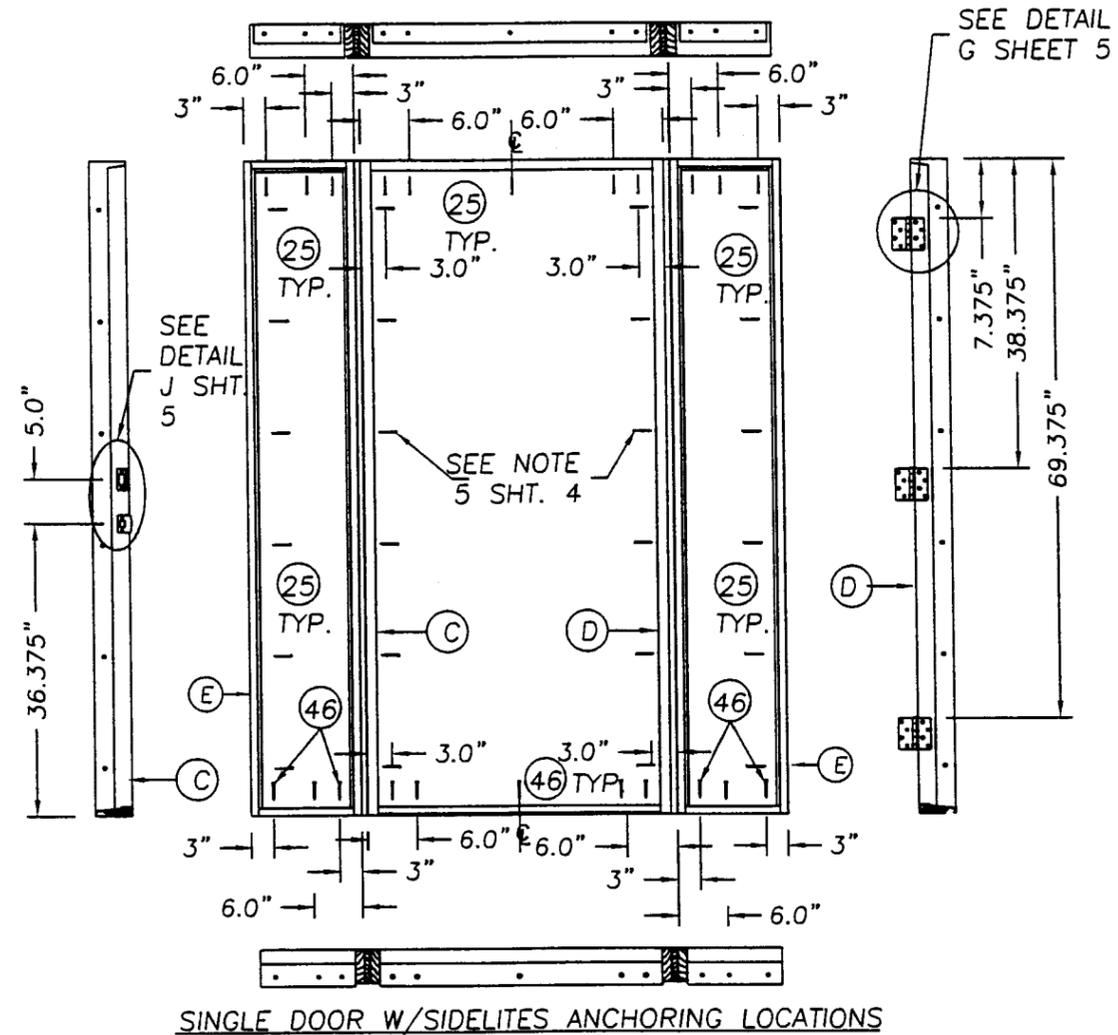


SINGLE DOOR W/SIDELITES ANCHORING LOCATIONS

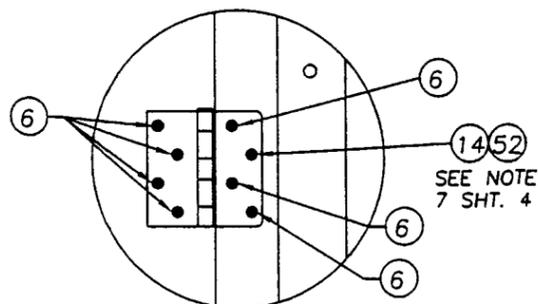


DETAIL G HINGE TO JAMBS & DOOR SEE NOTE 7 SHT. 4

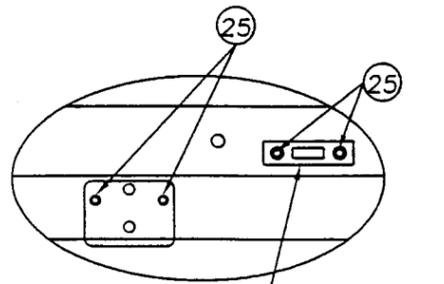


DETAIL F HEADER WINDJAMBER ASTRAGAL RETAINER BOLTS HEADER STRIKE PLATE & OPTIONAL SURFACE BOLT STRIKE PLATE

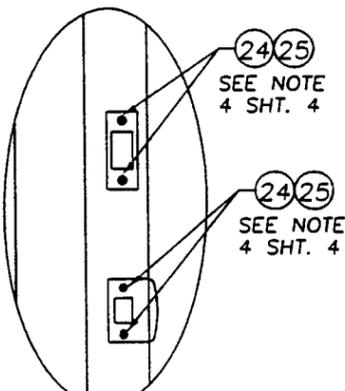

DETAIL J STRIKE PLATES TO JAMBS SEE NOTE 4 SHT. 4

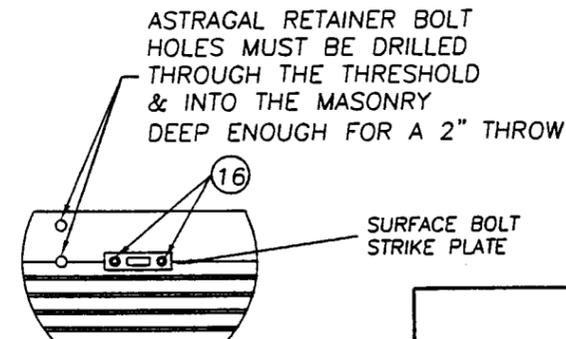

DETAIL K SILL WINDJAMBER ASTRAGAL RETAINER BOLT HOLES & OPTIONAL SURFACE BOLT STRIKE PLATE



DETAIL H STRIKE PLATE TO WINDJAMBER ASTRAGAL

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057


PRODUCT: WOOD EDGE GLAZED DOOR W/ & W/OUT SIDELITES UP TO 107" X 6'8" INSWING UNIT
PART OR ASSEMBLY: ANCHORING LOCATIONS & DETAILS

NO.	DATE	BY	REVISIONS
3	10/22/02	ZRK	ADDED TRINITY FRAME
2	06/07/02	RW	GENERAL REVISION
1	03/15/02	TJH	GENERAL REVISION


RW BUILDING CONSULTANTS, INC.
813.659.9197

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No. 02-1211.16
Expiration Date 08/15/07
By: *[Signature]*
Miami Product Control Division

DATE: 12/17/01
SCALE: N.T.S.
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2195
SHEET 5 OF 8

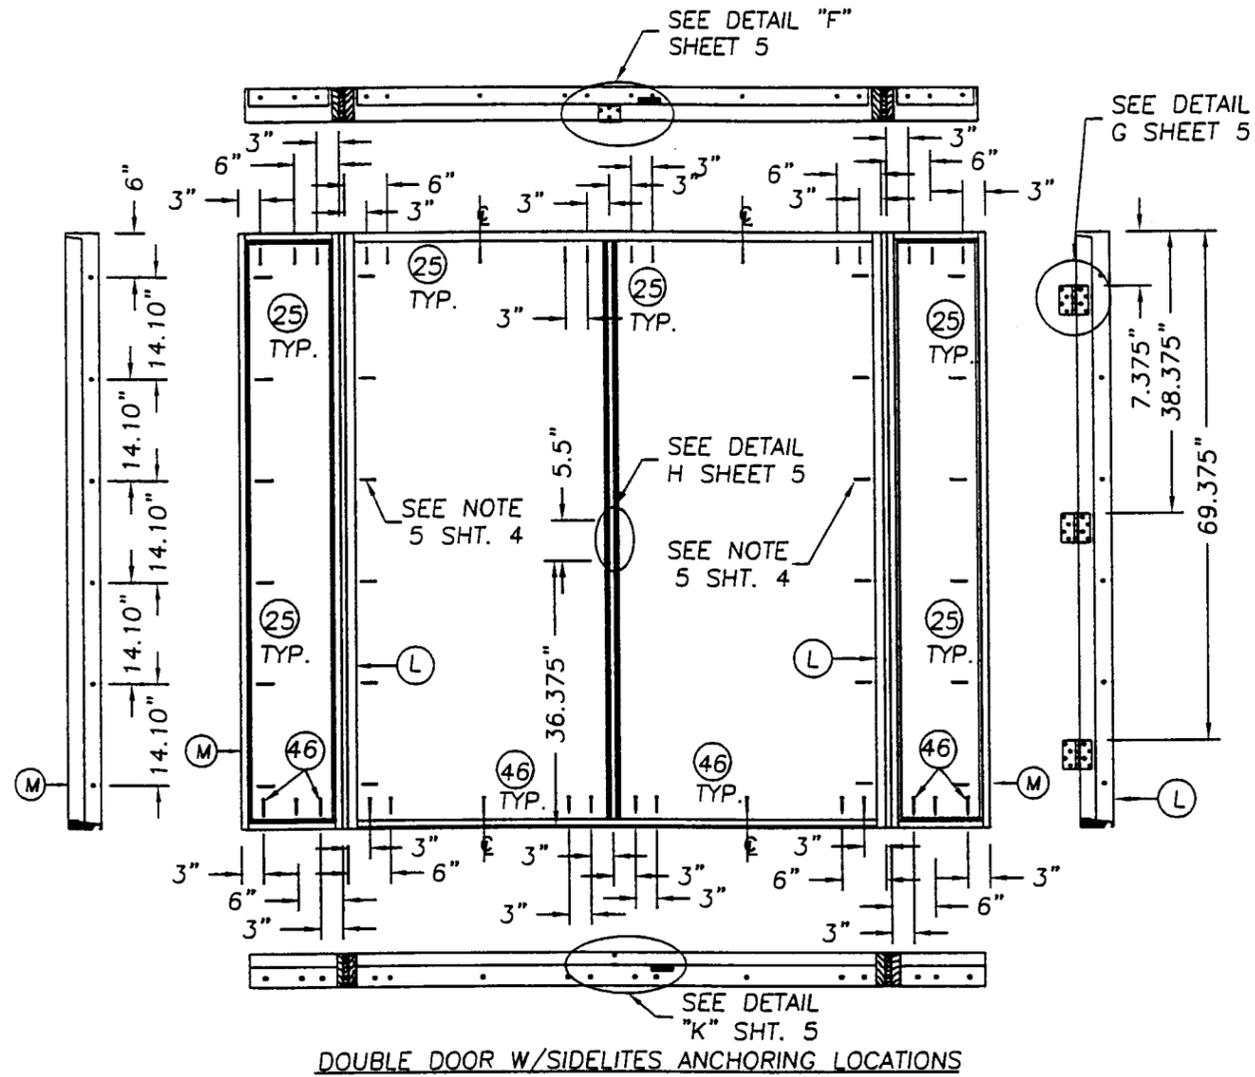

DOUBLE DOOR W/SIDELITES ANCHORING LOCATIONS

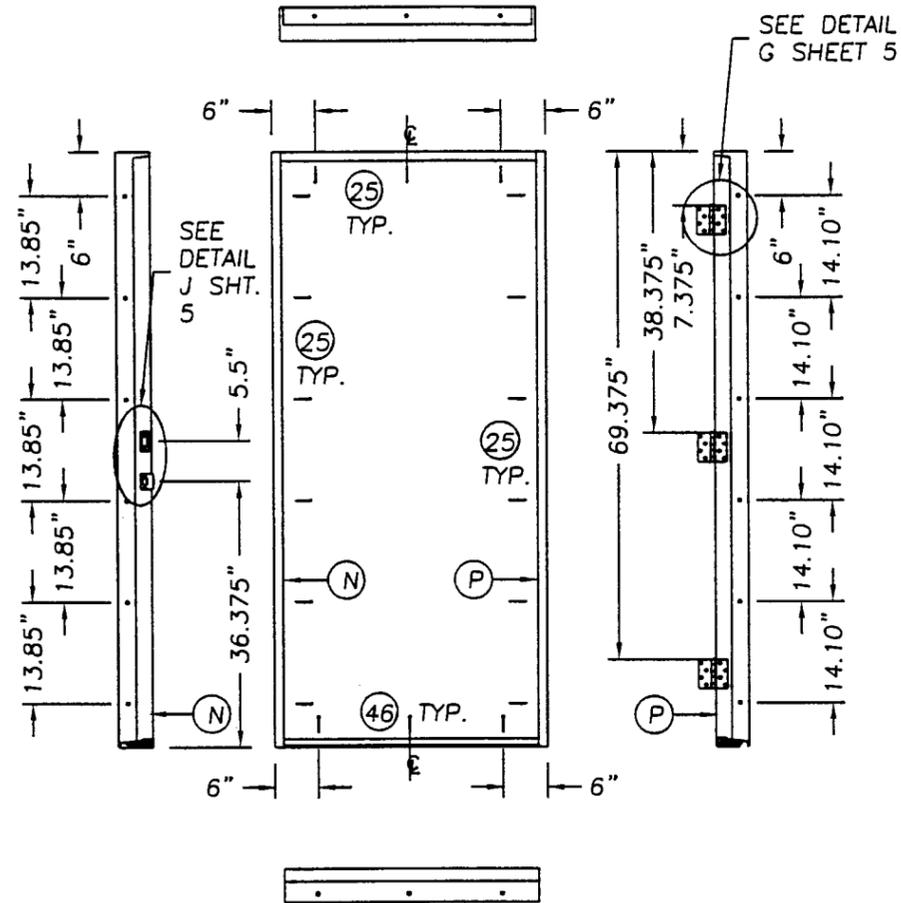

SINGLE DOOR ANCHORING LOCATIONS

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057


PRODUCT:
WOOD EDGE GLAZED DOOR
& W/OUT SIDELITES UP TO
107" x 6'8" INSWING UNIT
PART OR ASSEMBLY:
ANCHORING LOCATIONS
& GLAZING DETAILS

NO.	DATE	TJH	BY	REVISIONS
3	10/22/02	ZRK		ADDED TRINITY FRAME
2	06/07/02	RW		GENERAL REVISION
1	03/15/02	TJH		GENERAL REVISION


RW BUILDING
CONSULTANTS, INC.
813.659.9197

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 02-1211.16
Expiration Date 08/15/07
By *[Signature]*
Miami Product Control
Division


DATE:	12/17/01
SCALE:	N.T.S.
DWG. BY:	WLN
CHK. BY:	RW
DRAWING NO.:	S-2195
SHEET	6 OF 8

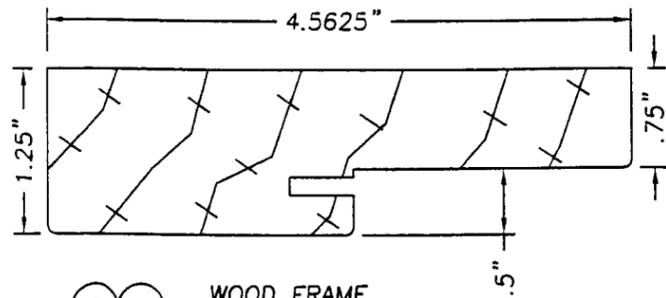

2 4 WOOD FRAME
3 50

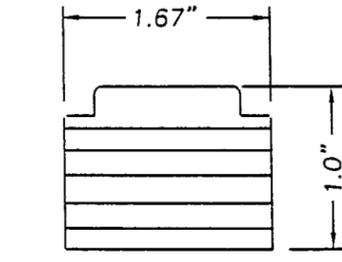


7 LVL LATCH STILE

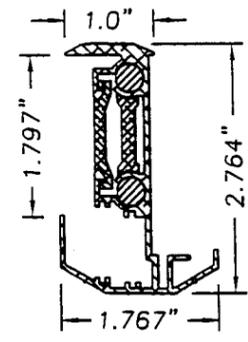


ASTRAGAL HAS
(2) 8.0" L. x .312" DIA.
BOLTS @ BOTTOM &
(2) 8.0" L. x .312" DIA.
BOLTS @ TOP


26
ASTRAGAL WINDJAMBER II
(WR68J T-6060 EXTRUDED ALUMINUM)

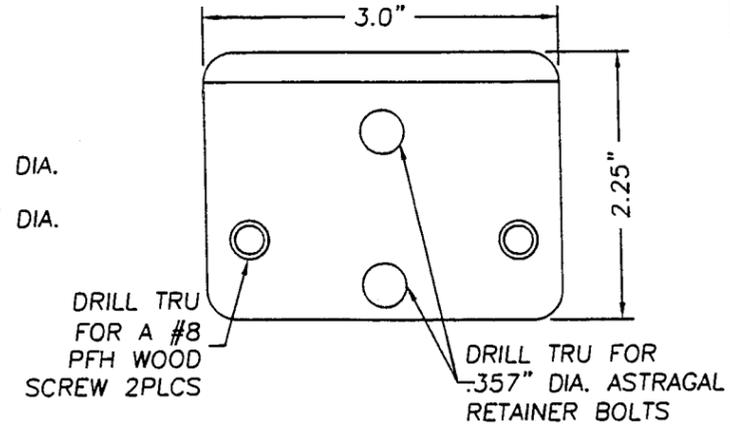


WINDJAMBER II WR68J STRIKE PLATE
STEEL PLATE

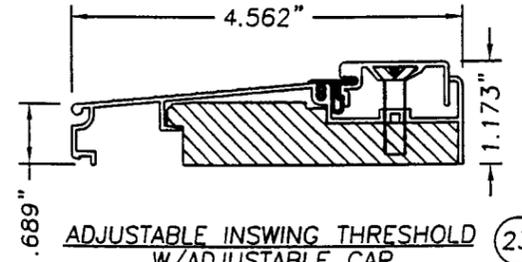


23
ADJUSTABLE INSWING THRESHOLD
W/ADJUSTABLE CAP
BY IMPERIAL .051" WALL THK.

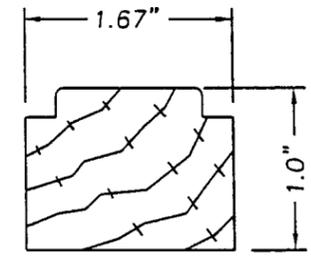


13 11 DOOR TOP &
HINGE STILE

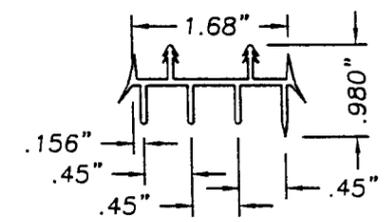


27
INSWING DOOR BOTTOM
SWEEP, EXTRUDED VINYL
.060" THK WALL TYP.

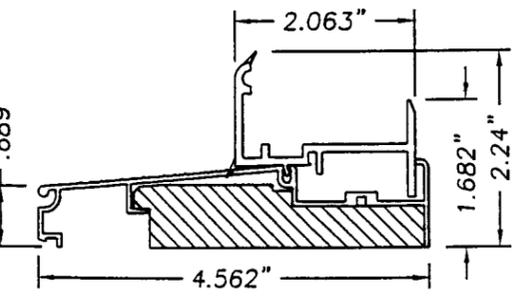


36
ADJUSTABLE INSWING THRESHOLD
W/SIDELITE BOTTOM SEAL
BY IMPERIAL .051" WALL THK.

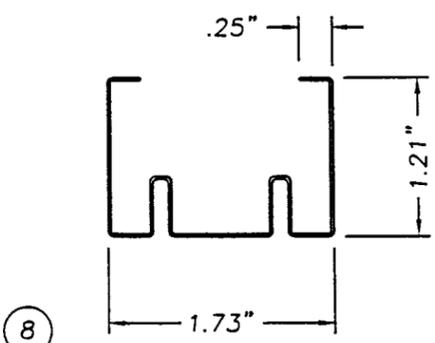


8
DOOR STEEL EDGE CAP, BOTTOM

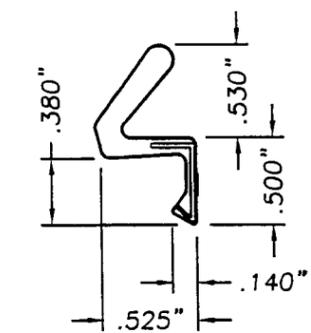


10
COMPRESSION WEATHERSRTIP
SCHLEGEL Q-LON QDS 650

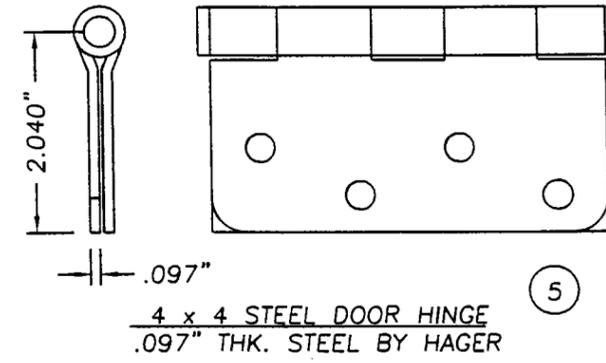

5
4 x 4 STEEL DOOR HINGE
.097" THK. STEEL BY HAGER

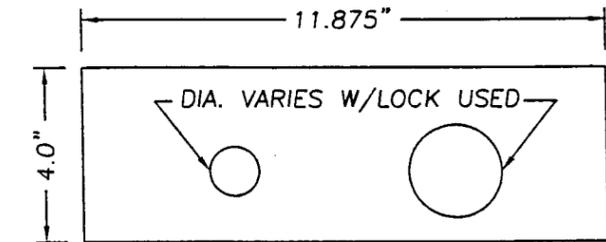

15
WOOD LOCK BLOCK, 1.71" THK.

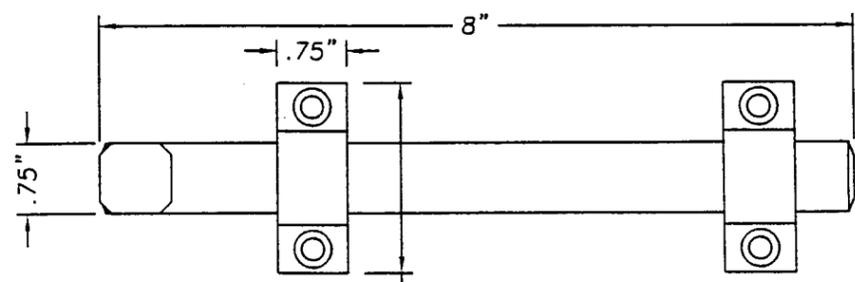

2.031"
SURFACE BOLT (IVES, .25" STEEL MODEL 454)

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT: WOOD EDGE GLAZED DOOR
W/ & W/O SIDELITES UP TO
107" x 6'8" INSWING UNIT
PART OR ASSEMBLY:
UNIT COMPONENTS


NO	DATE	REVISIONS	BY
3	10/22/02	ADDED TRINITY FRAME ZRK	ZRK
2	06/07/02	GENERAL REVISION	RW
1	03/15/02	GENERAL REVISION	TJH

RW BUILDING
CONSULTANTS, INC.
813.659.9197


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 02-1211.16
Expiration Date 08/15/07

By: *[Signature]*
Miami Product Control
Division

DATE: 12/14/01
SCALE: NTS
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2195
SHEET 7 OF 8

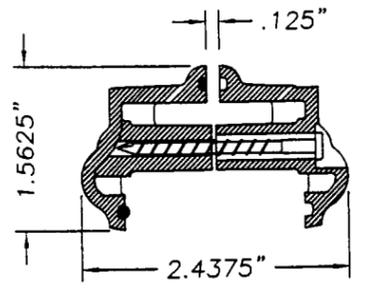


38
LITE FRAME ODL
HP POLYPROPYLENE
(THERMOFIL-P6-30FM0391)
1/8" GLASS FRAME

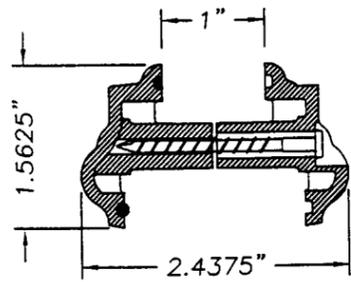


44
LITE FRAME ODL
HP POLYPROPYLENE
(THERMOFIL-P6-30FM0391)
1" GLASS FRAME

53

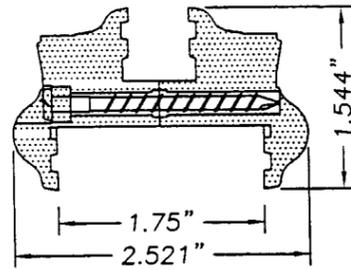


53
TRINITY LITE FRAME
LUPOY EU-5007
1/2" GLASS FRAME


55

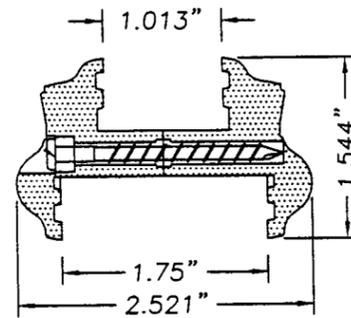

55
TRINITY LITE FRAME
LUPOY EU-5007
1" GLASS FRAME

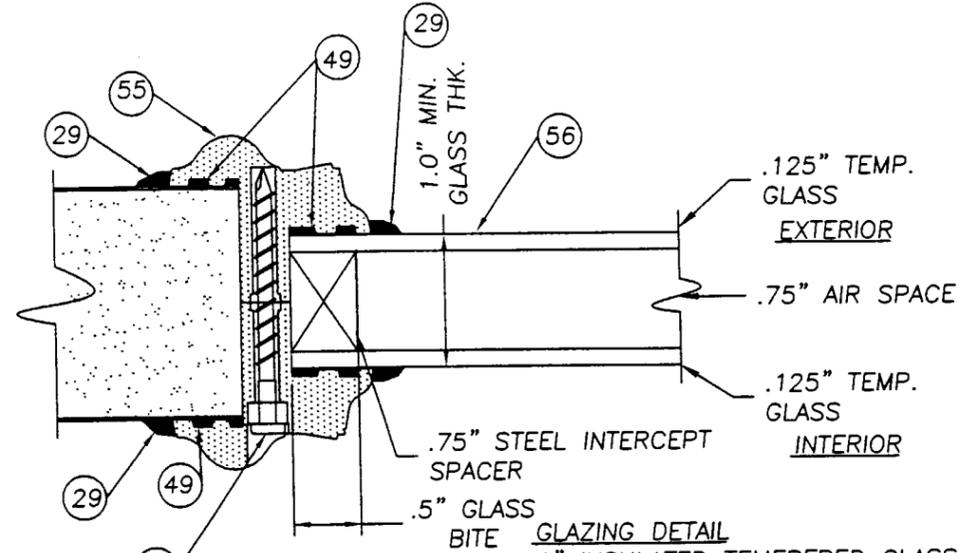


SEE NOTE 9
SHT. 4

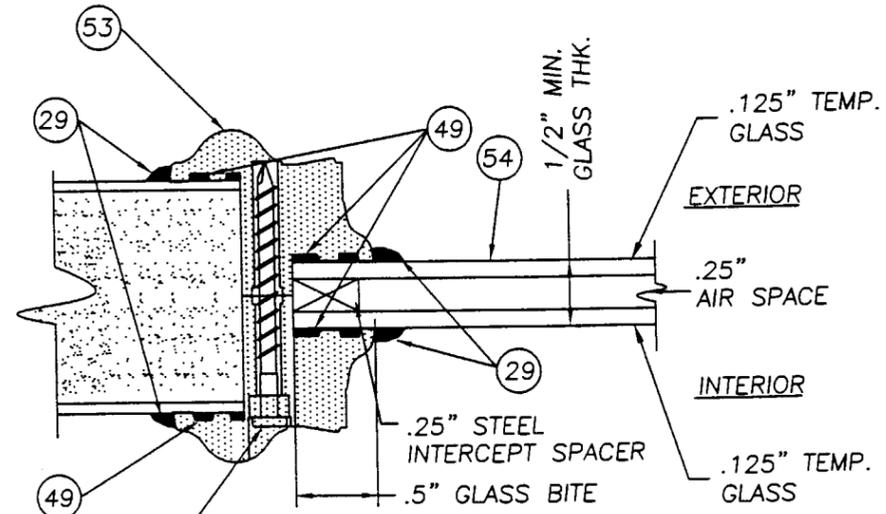


SEE NOTE 9
SHT. 4

GLAZING DETAIL
1/2" INSULATED TEMPERED GLASS
TRINITY LITE FRAME

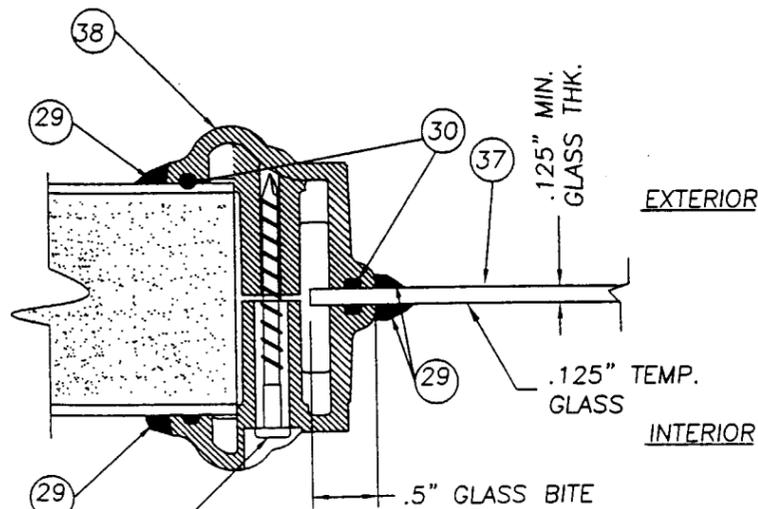

SEE NOTE 3
SHT. 4

GLAZING DETAIL FOR DOOR PANEL
& SIDELITES 1/8" TEMPERED GLASS
SEE DESIGN PRESSURE CHART

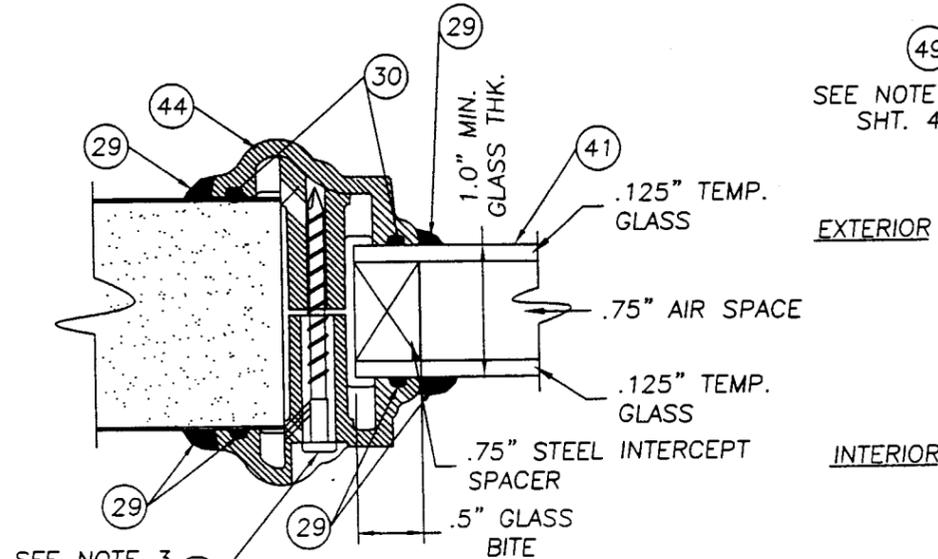

SEE NOTE 3
SHT. 4

GLAZING DETAIL DOOR PANEL
1" INSULATED TEMPERED GLASS
SEE DESIGN PRESSURE CHART
(OPTIONAL PANEL GLAZING)

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT: WOOD EDGE GLAZED DOOR
W/ & W/OUT SIDELITES UP TO
107" x 6'8" INSWING UNIT
PART OR ASSEMBLY:
ANCHORING LOCATIONS
& GLAZING DETAILS

NO	DATE	REVISIONS	BY
3	10/22/02	ADDED TRINITY FRAME	ZRK
2	06/07/02	GENERAL REVISION	RW
1	03/15/02	GENERAL REVISION	TJH

RW BUILDING
CONSULTANTS, INC.
813.659.9197

DATE: 12/17/01
SCALE: N.T.S.
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2195
SHEET 8 OF 8

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 02-1211.16
Expiration Date 02/15/07

By: *[Signature]*
Miami District Product Control
Division