



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Jeld-Wen, Inc.
31725 Highway 97 North
Chiloquin. OR 97624**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series "Jeld-Wen® Steel" W/E Outswing Glazed Insulated Steel Door w & w/o Sidelites

APPROVAL DOCUMENT: Drawing No. S-2105, titled "Wood Edge Glazed Door w/ & w/out Sidelites up to 8'4 x 6'8 Outswing", sheets 1 through 8 of 8, dated 12/13/01 with revision #2 dated 10/22/02, prepared by R.W. Building Consultants Inc, , bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 01-1224.03 and, consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No 02-1216.09
Expiration Date: August 15, 2007
Approval Date: January 30, 2003
Page 1**

Jeld-Wen, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA)

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **S-2105**, titled "Wood Edge Glazed Door w/ & w/out Sidelites up to 8'4 x 6'8 Outswing", sheets 1 through 8 of 8, dated 12/13/01 with revision #2 dated 10/22/02, prepared by R.W. Building Consultants Inc.,

B. TESTS

1. Test reports on 1) Air Infiltration Test, per SFBC, PA 202-94
2) Uniform Static Air Pressure Test, Loading per SFBC PA 202-94
3) Water Resistance Test, per SFBC, PA 202-94
4) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94
along with marked-up drawings and installation diagram of DoorCraft series OXXO configuration outswing and inswing opaque wood edge steel door, prepared by Certified Testing Laboratories, Test Report No. **CTLA-961W**, dated 10/23/02, signed and sealed by Ramesh C. Patel, P.E.
Submitted under approval No.01-1216.09
2. Test reports on 1) Air Infiltration Test, per SFBC, PA 202-94
2) Uniform Static Air Pressure Test, Loading per SFBC PA 202-94
3) Water Resistance Test, per SFBC, PA 202-94
4) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94
along with marked-up drawings and installation diagram of DoorCraft series OXXO configuration outswing and inswing glazed wood edge steel door, prepared by Certified Testing Laboratories, Test Report No. **CTLA-697W**, dated 11/11/01, signed and sealed by Ramesh C. Patel, P.E. with addendum letter dated April 11, 2002 also signed and sealed by Ramesh C. Patel, P.E.

C. CALCULATIONS

1. Anchor Calculations and structural analysis dated 12/15/01, prepared, signed and sealed by Wendell Haney, P.E. with addendum letter dated April 7, 2002 also signed and sealed by Wendell Haney, P.E. **Submitted under approval No.01-1216.09**


Manuel Perez, P.E.
Product Control Examiner
NOA No 02-1216.09

Expiration Date: August 15, 2007
Approval Date: January 30, 2003

Jeld-Wen, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA)

D. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **01-0718.08** issued to ODL, Inc. for "HP Propropylene Doorlight Assembly" dated 1/17/02, expiring on 1/17/06.
2. Tensile Test prepared by Certified Testing Laboratories, Test Report No. **CTLA-697W/DADE01014**, dated June 05, 2001 and Nov. 14, 2001, tested per **ASTM E8/A370 or B557**, signed and sealed by Ramesh C. Patel, P.E.
3. Test reports No. J9906660-001 for "Surface burning characteristics" per ASTM E-84 and "Self ignition test" per ASTM 1929 D, for polystyrene core dated April 8, 1999, issued by Intertek Testing Services.
4. Notice of Acceptance No. **02-0429.11** issued to Trinity Glass International. for "Trinity Lite Frame" dated 7/3/02, expiring on 7/3/07.

E. STATEMENTS

1. Statement letter of no financial interest, dated 10/10/02, signed by Steve Frey.

F. OTHER

1. Notice of Acceptance No. **01-1224.03**, issued to Jeld-Wen, Inc., for their Series "Doorcraft®" 6'8" W/E Outswing Glazed Insulated Steel Door w & w/o Sidelites, approved on 10/15/02 and expiring on 10/15/07.


Manuel Perez, P.E.
Product Control Examiner
NOA No 02-1216.09

Expiration Date: August 15, 2007
Approval Date: January 30, 2003

JELD-WEN® Steel

WOOD EDGE GLAZED INSULATED STEEL DOOR
OUTSWING 6-8 UNITS W/ & W/O SIDELITES

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO COMPLY WITH THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. DESIGNED PRESSURE RATING SEE TABLE PAGE 1.
5. THIS PRODUCT MEETS THE WATER REQUIREMENTS FOR "HIGH HIGH VELOCITY HURRICANE ZONES" SEE DESIGN PRESSURE CHART BELOW.
6. THIS SYSTEM REQUIRES WINDBORNE DEBRIS EXTERNAL PROTECTION PRESCRIBED IN SECTION 1626.1 OF THE FLORIDA BUILDING CODE.

RESIDENTIAL INSULATED STEEL DOOR (Common to all frame conditions)

Door Leaf Construction:

Galvanized steel A-525 commercial quality - AKDQ per ASTM 620 with yield strength $F_y(\text{ave.})=47,575$ psi.

Face sheets: 24 ga. (0.021") minimum thickness,

Core design: Expanded polystyrene with 1.0 to 1.25 lbs. density by Jeld-Wen, Inc.

Panel Construction & glazing: The active and inactive panels are constructed from 24GA. (0.021" min.) galvanized steel. The face sheet top and bottoms are bent 90° over the top and bottom rails. The top rail consists of LVL measuring 1.67" x 1.042". The bottom rail is roll formed 0.021" galvanized steel measuring 1.67" x 1.21". The sides of the face sheet are roll formed into the LVL latch stile and Ponderosa Pine hinge stile which measure 1.67" x 1.0". The interior cavity is filled with polystyrene. The face sheet is glued to the polystyrene. The panels are routed to receive the ODL or Trinity lite frames. The units are glazed with .125" tempered glass. The lite frames are wet glazed on the exterior.

Sash Construction & glazing: The sash is constructed from 24GA. (0.021" min.) galvanized steel. The edges of the face sheet are bent 90° over the polystyrene core and are glued to it. The sashes are routed to receive the ODL or Trinity lite frames. The units are glazed with .125" tempered glass. The lite frames are wet glazed on the exterior.

Frame Construction: The frames are constructed from Ponderosa Pine jambs measuring 4.563" x 1.25". The head jambs are mortised and butt joined to the side jambs and attached with (3) 16GA. 2" x 7/16" crown wire staples. The units use a bump face threshold measuring 4.041" x 1.0". The threshold is attached to the frame with (3) 16GA. 2" x 7/16" crown wire staples.

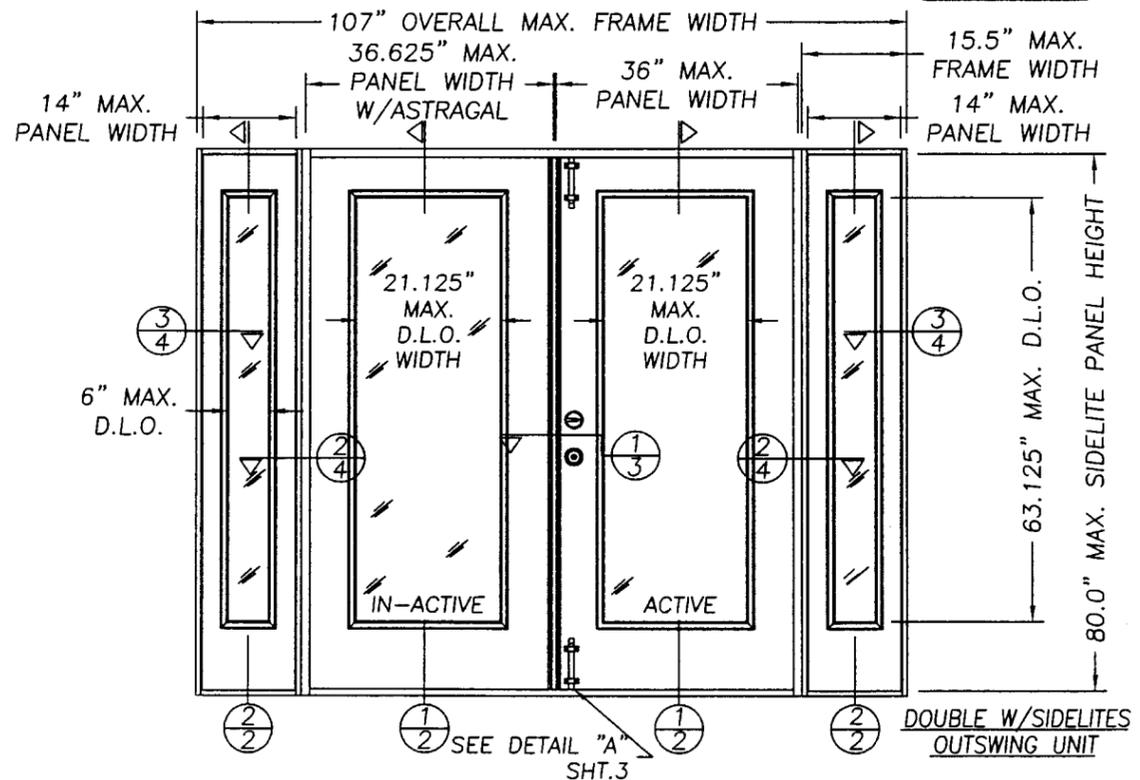
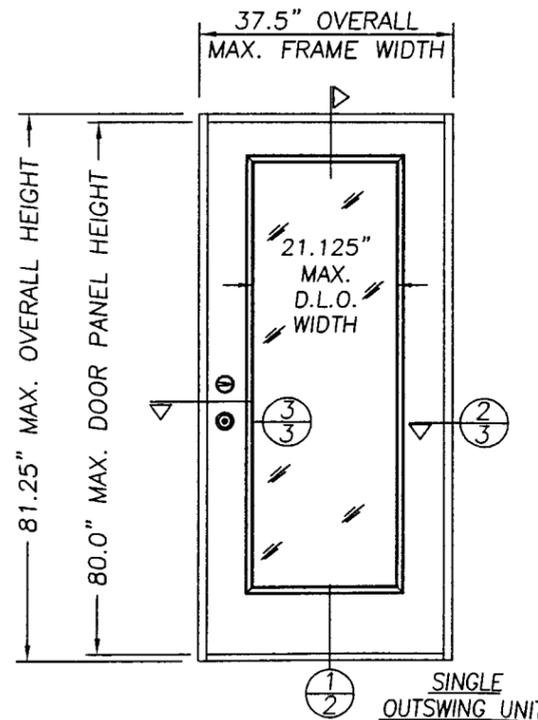
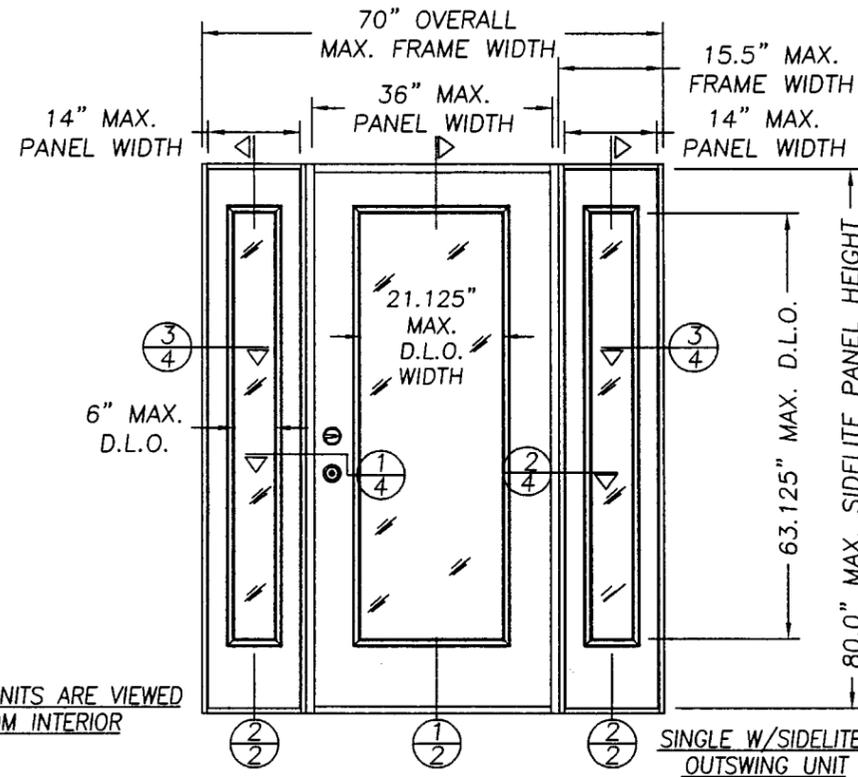
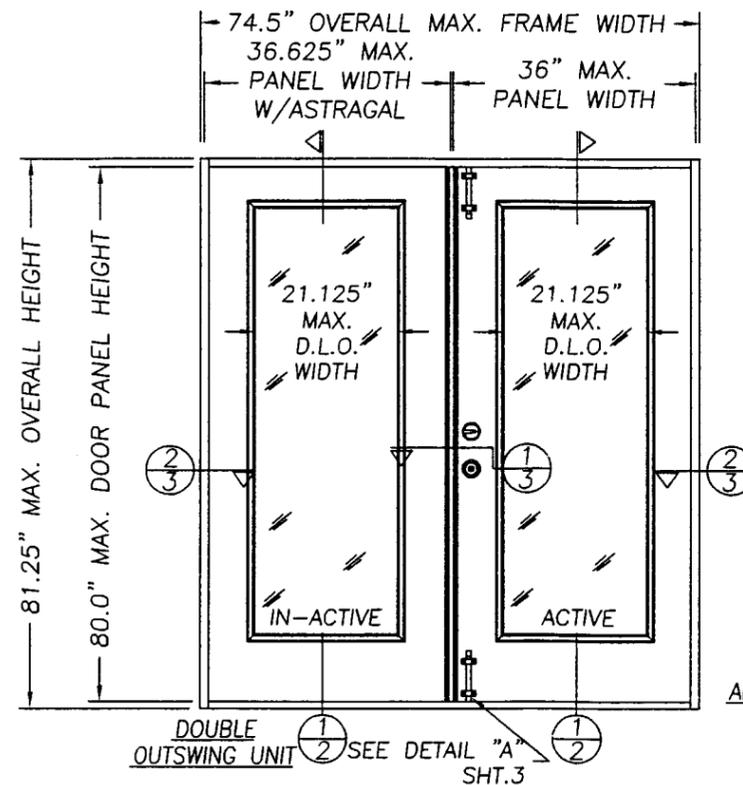


TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATIONS
2	VERTICAL CROSS SECTIONS & BILL OF MATERIAL
3 & 4	HORIZONTAL CROSS SECTIONS & NOTES
5 & 6	ANCHORING LOCATIONS & DETAILS
7	GLAZING DETAILS
8	UNIT COMPONENTS

DESIGN PRESSURE RATING WHERE WATER INFILTRATION REQUIREMENT IS NEEDED			
ALL UNITS WITH & WITHOUT SIDELITES	WITH WINDJAMBER II ASTRAGAL	WITH IMPERIAL ASTRAGAL	
SINGLE & DOUBLE WITHOUT SURFACE BOLTS	+50.0psf -50.0psf	/ / / /	
DOUBLE WITH SURFACE BOLTS ACTIVE DOOR	+65.0psf -65.0psf	+50.0psf	-50.0psf

Approved as complying with the
Florida Building Code
Date JAN. 30, 2003
NOA# 02-1216.09
Miami Dade Product Control
Division
By *[Signature]*


DATE: 12/13/01
SCALE: NTS
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2105
SHEET 1 OF 8

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILLOQUIN, OR. 97624
PH. 541.783.2057


PRODUCT: WOOD EDGE GLAZED DOOR
W/ & W/O SIDELITES
UP TO 8'4" x 6'8" OUTSWING
PART OR ASSEMBLY:
TYPICAL ELEVATION &
GENERAL NOTES

NO.	DATE	REVISIONS		
		BY	TJH	ZRK
2	10/22/02	ADD TRINITY FRAME		
1	03/15/02	GENERAL REVISION		

RW BUILDING
CONSULTANTS, INC.
813.659.9197

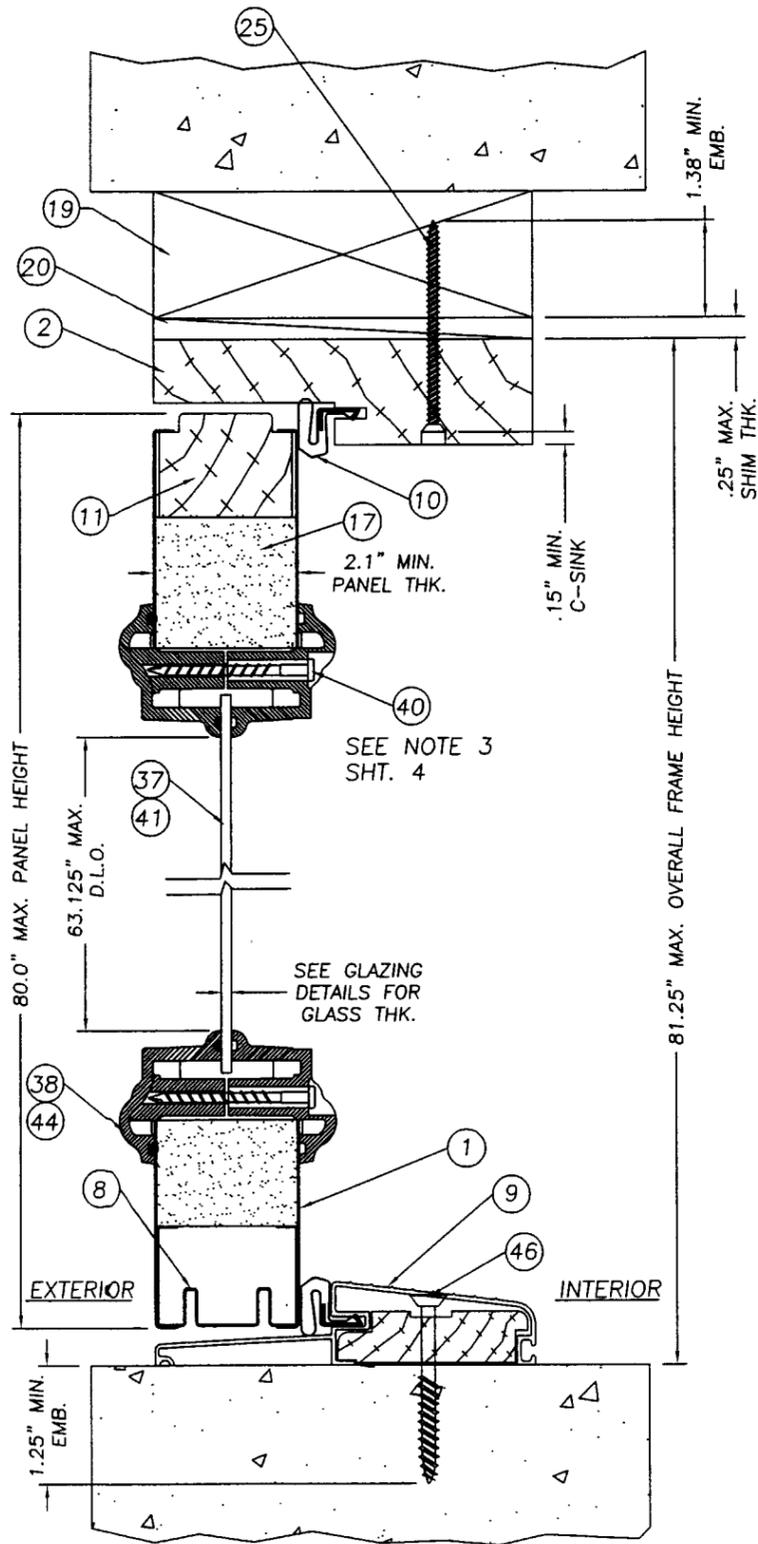

1 VERTICAL CROSS-SECTION
2 DOOR PANEL

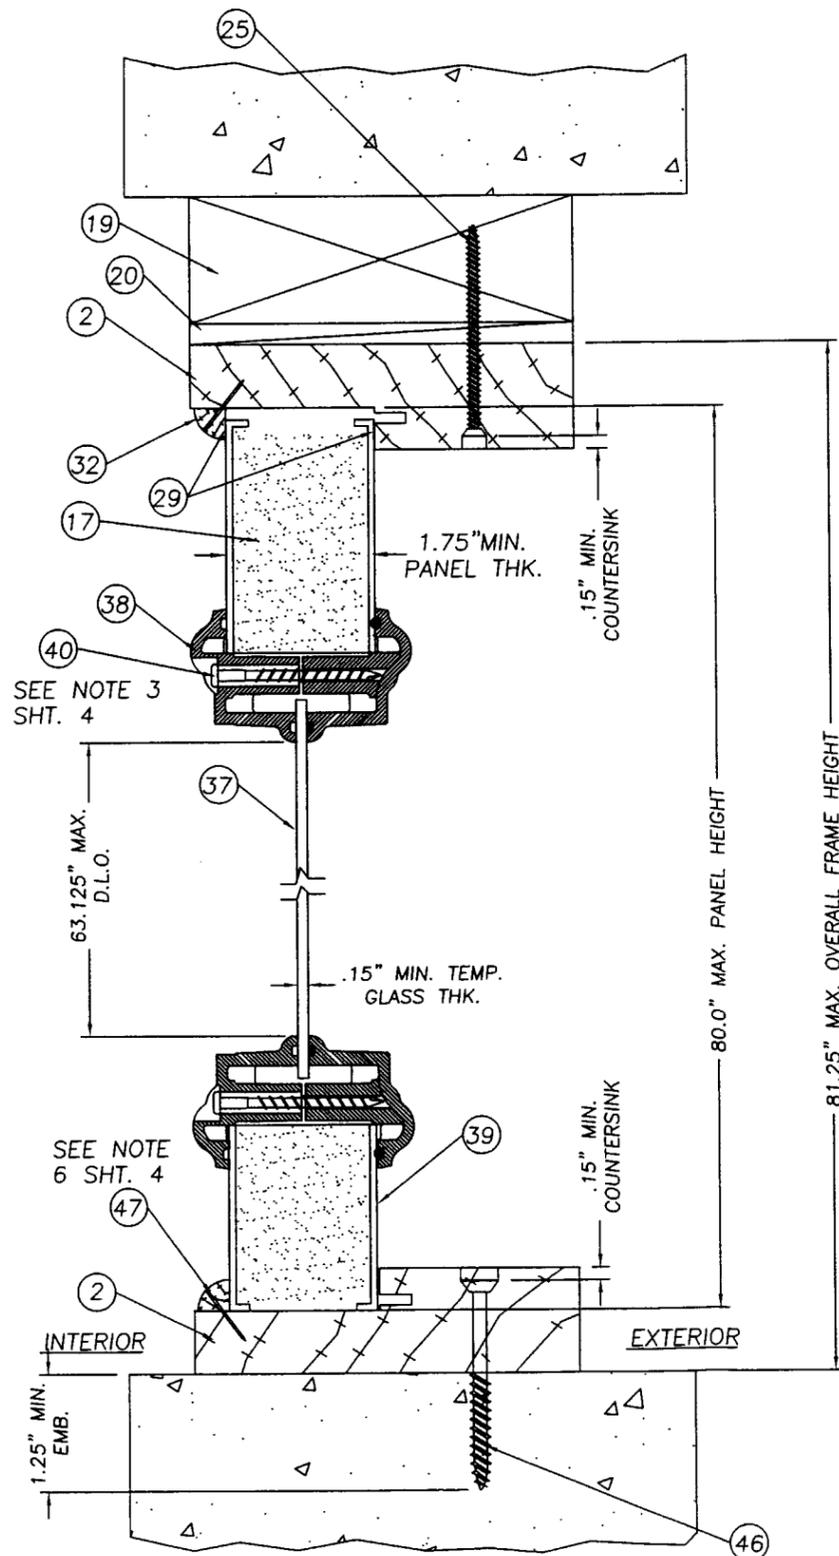

2 VERTICAL CROSS-SECTION
2 SIDELITE SASH

ITEM	DESCRIPTION	MATERIAL
1	DOOR, WOOD EDGE 1.75" THK. 24GA. (.021" MIN.)	STEEL
2	HEAD JAMB (1 1/4" x 4 9/16" PONDEROSA FINGER JOINTED PINE)	PINE
3	HINGE JAMB (1 1/4" x 4 6/16" PONDEROSA FINGER JOINTED PINE)	PINE
4	SIDELITE BLANK JAMB (1 1/4" x 4 9/16" PONDEROSA FINGER JOINTED PINE)	PINE
5	4" x 4" BUTT HINGE 12ga. (.097" HAGER)	STEEL
6	#9 x 1" PFH WOOD SCREW (HINGE TO DOOR)	STEEL
7	DOOR LATCH LVL SIDE STILE 1.67" x 1"	LVL
8	DOOR PANEL BOTTOM RAIL (1.73" x 1.21" x .021" THK. MIN. 24GA.)	STEEL
9	OUTSWING BUMPER THRESHOLD (.050" EXTRUDED ALUM.)	ALUM.
10	COMPRESSION WEATHERSTRIP (SCHLEGEL Q-LON QDS 650)	FOAM
11	DOOR PANEL WOOD TOP RAIL 1.67" x 1"	LVL
12	1/4" x 1 3/8" WOOD MULLION CAP	WOOD
13	DOOR HINGE WOOD SIDE STILE 1.67" x 1"	WOOD
14	#10 x 1 3/4" PFH WOOD SCREW	STEEL
15	WOOD LOCK BLOCK (1.71" x 4.0" x 12.0")	WOOD
16	16GA. BRAD TRIM NAIL 1" L.	STEEL
17	EXPANDED POLYSTYRENE (1.0 to 1.25 lb. DENSITY) BY JELD-WEN	FOAM
18	NOT USED	-
19	2x WOOD SUB BUCK	WOOD
20	SHIM MATERIAL (.25" MAX. THK.)	-
21	KWIKSET 400 SERIES KNOB	-
22	KWIKSET TITAN 700 SERIES DEADBOLT	-
23	GLAZING COMPOUND DOW 1199 SILICONE	SILICONE
24	# 8 x 2" PHILL. FLATHEAD WOOD SCREW	STEEL
25	# 8 x 2 1/2" PHILL. FLATHEAD WOOD SCREW	STEEL
26	ASTRAGAL EXTRUDED ALUM. (WR68J WINDJAMBER II)	ALUM.
27	NOT USED	-
28	IVES SURFACE BOLT #454 8.0" L. x .25" THK. STEEL	-
29	SILICONE CAULK (CR LAWRENCE 33C)	SILICONE
30	GLAZING COMPOUND (QSD BY ODL)	SILICONE
31	#8 x 1" PHILLIPS PANHEAD WOOD SCREW (ASTRAGAL WR68J TO DOOR)	STEEL
32	3/8" x 3/8" 1/4" ROUND SIDELITE STOP	WOOD
33	1/4-20 SEX BOLT W/1/4-20 FEMALE END x 1 3/4" L	STEEL
34	SCHLAGE KNOB SET #F51	-
35	SCHLAGE DEADBOLT #B360	-
36	NOT USED	-
37	1/8" TEMPERED GLASS (BY PPG)	GLASS
38	LITE FRAME 1/8" GLASS (ODL HP POLYPROP. THERMOFIL-P6-30FM0391)	POLYPROP.
39	STEEL SIDELITE PANEL 24GA. (.021" MIN. STEEL)	STEEL
40	#8 x 1 1/2" PLASCREW (LITE FRAME)	STEEL
41	1" INSULATED TEMPERED GLASS	-
42	YALE KNOB HERITAGE SERIES	-
43	YALE DEADBOLT HERITAGE SERIES	-
44	LITE FRAME 1" GLASS (ODL HP POLYPROP. THERMOFIL-P6-30FM0391)	POLYPROP.
45	#8 x 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
46	1/4" x 2 1/2" TAPCON	STEEL
47	16GA. BRAD TRIM NAIL 3/4" L.	STEEL
48	3/4" THK. x 4 9/16" DEEP PRESSURE TREATED REINFORCEMENT	WOOD
49	OPTIONAL EXTRUDED ALUM. ASTRAGAL (.050" WALL IMPERIAL)	ALUM.
50	LATCH JAMB (1 1/4" x 4 9/16" PONDEROSA FINGER JOINTED PINE)	PINE
51	#10 x 1" PHILLIPS FLATHEAD WOOD SCREW	STEEL
52	#10 x 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
53	LITEFRAME BY TRINITY FOR 1/2" GLASS	POLYPROP
54	1/2" INSULATED TEMP GLASS BY TRINITY/AMPAC	-
55	LITEFRAME BY TRINITY FOR 1" GLASS	POLYPROP
56	1" INSULATED TEMP GLASS BY TRINITY/AMPAC	-
57	LITEFRAME SCREW #6 x 1 1/2 PANHEAD	STEEL

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILQUIN, OR. 97624
PH. 541.783.2057

PRODUCT:
WOOD EDGE GLAZED DOOR
W/ & W/OUT SIDELITES
UP TO 8'4" x 6'8" OUTSWING


PART OR ASSEMBLY:
VERTICAL CROSS SECTIONS
& BILL OF MATERIAL

NO.	DATE	BY	REVISIONS
2	10/22/02	ZRK	ADDED TRINITY FRAME
1	03/15/02	TJH	GENERAL REVISION


RW BUILDING
CONSULTANTS, INC.
813.659.9197

DATE: 12/13/01
SCALE: NTS
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2105
SHEET 2 OF 8


Approved as complying with the
Florida Building Code
Date: JAN. 30, 2003
NOA# 02-1216.05
Miami Dade Product Control
Division
By: *Mamuly*

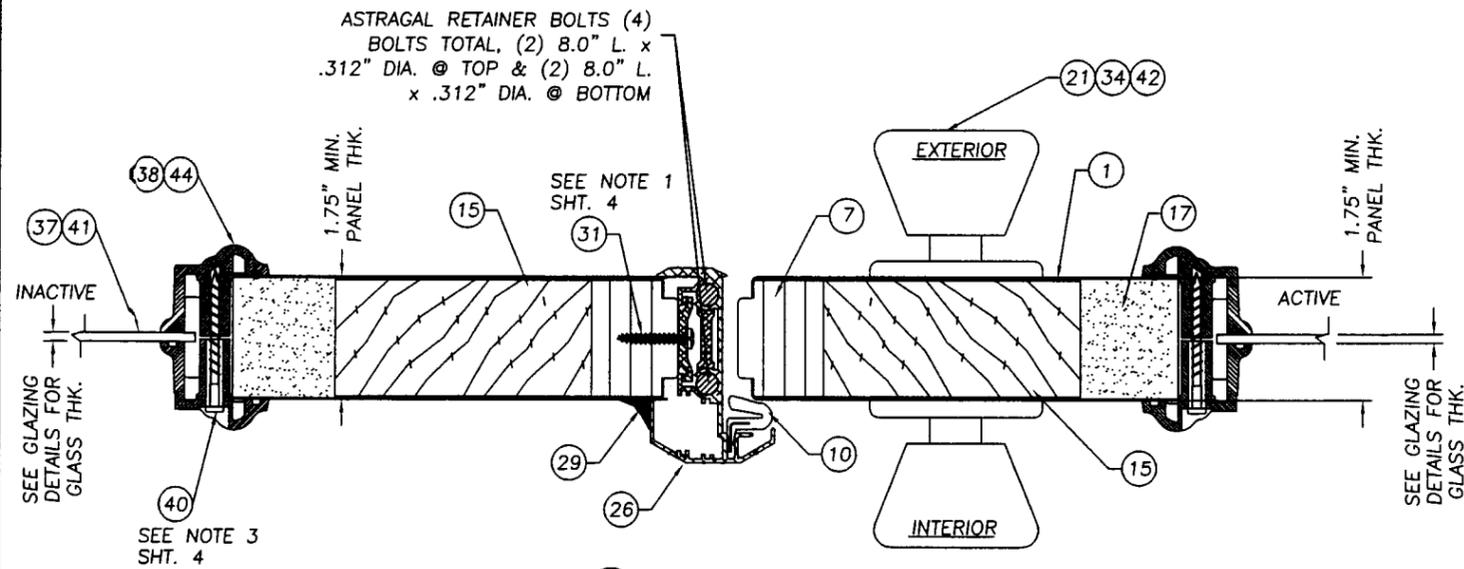


1 HORIZONTAL CROSS SECTION
3 AT ASTRAGAL
SEE DESIGN PRESSURE CHART

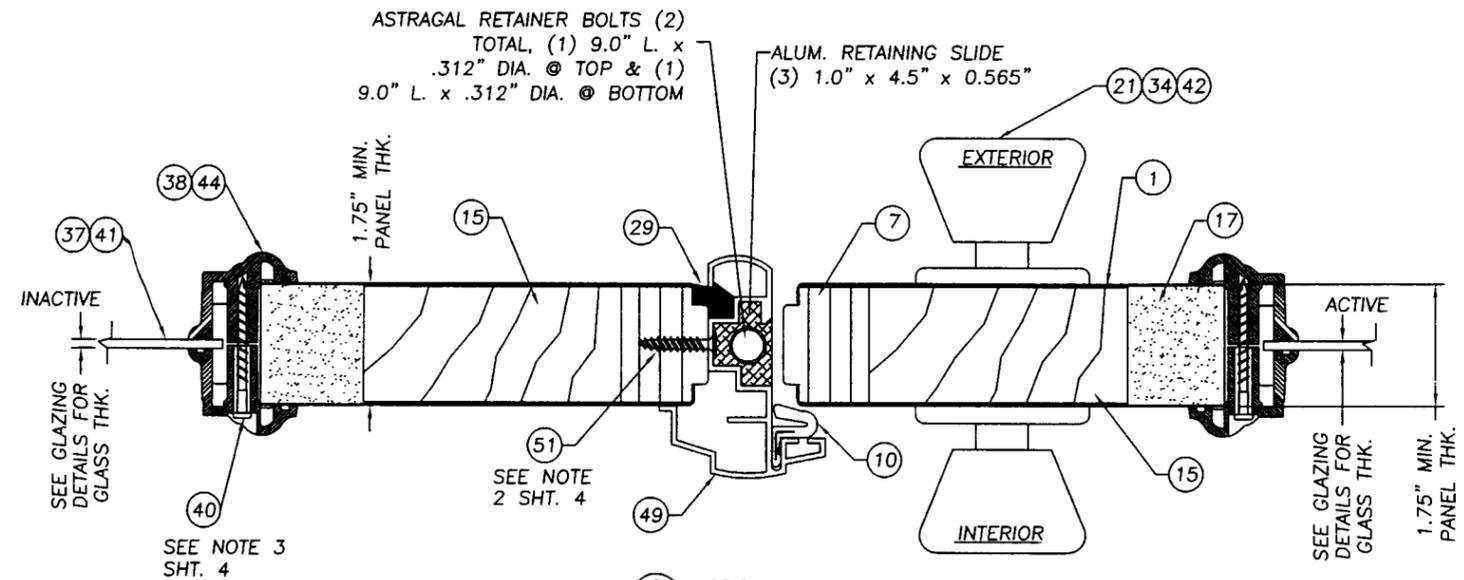


1 HORIZONTAL CROSS SECTION
3 AT ASTRAGAL
OPTIONAL IMPERIAL ASTRAGAL
SEE DESIGN PRESSURE CHART

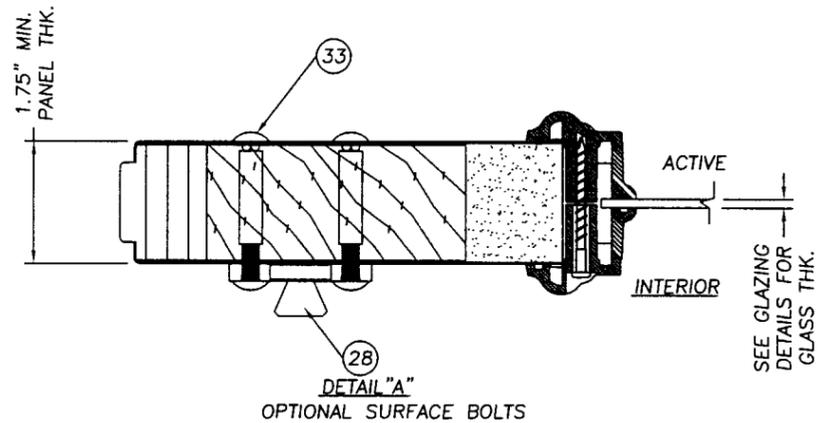

DETAIL "A"
OPTIONAL SURFACE BOLTS

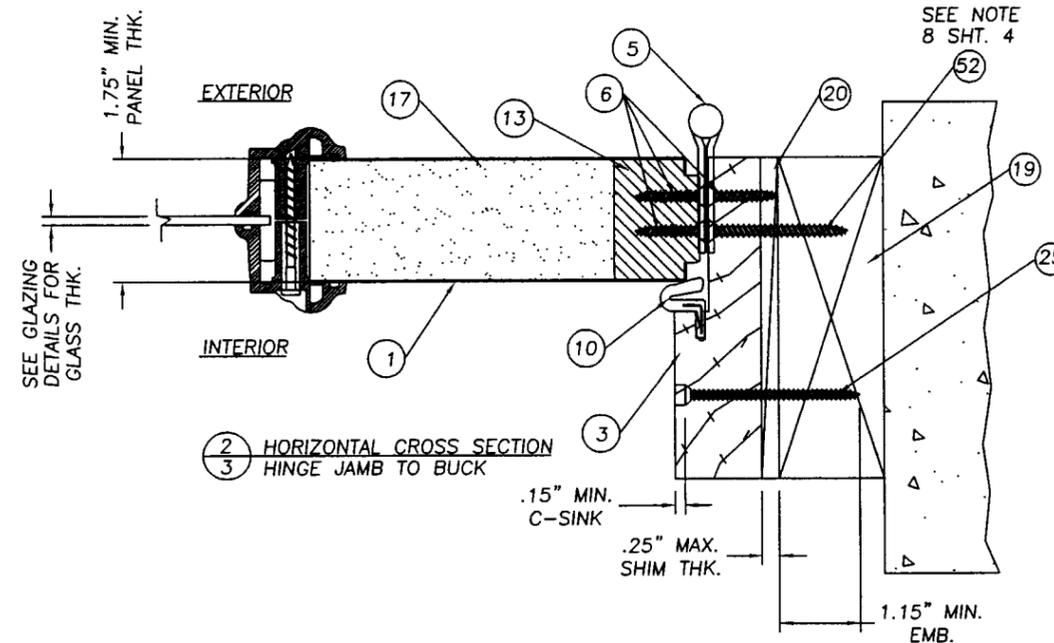

2 HORIZONTAL CROSS SECTION
3 HINGE JAMB TO BUCK

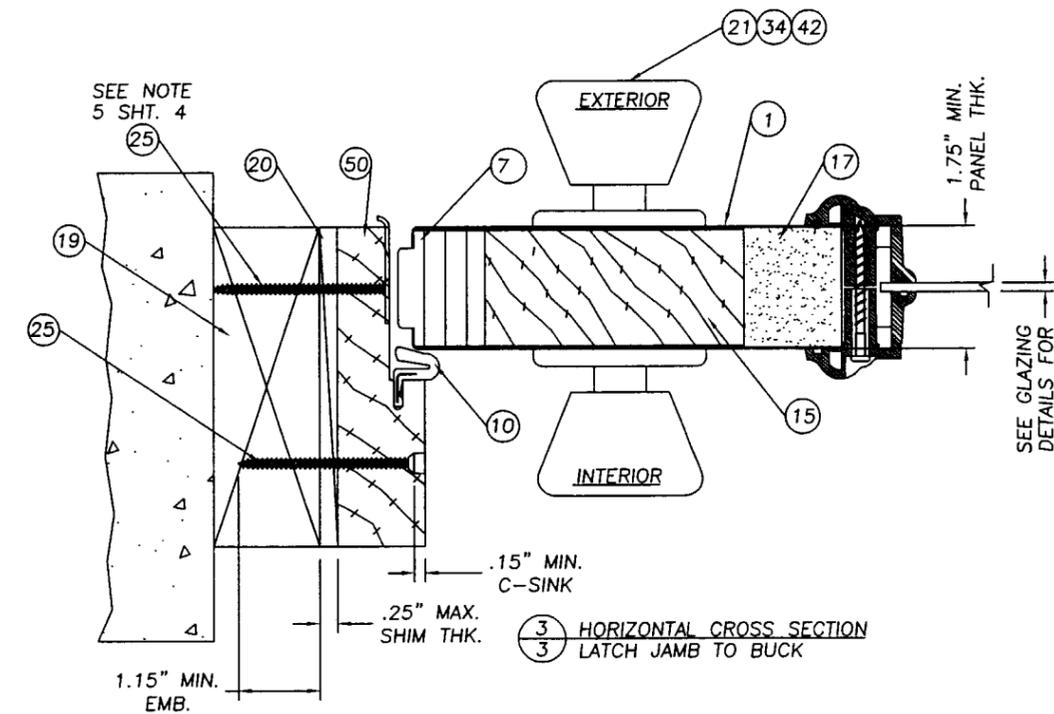

3 HORIZONTAL CROSS SECTION
3 LATCH JAMB TO BUCK

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT: WOOD EDGE GLAZED DOOR
W/ & W/OUT SIDELITES
UP TO 8'4" x 6'8" OUTSWING
PART OR ASSEMBLY:
HORIZONTAL CROSS SECTIONS

NO.	DATE	BY	REVISIONS
2	10/22/02	ZRK	ADD TRINITY FRAME
1	03/15/02	TJH	GENERAL REVISION

RW BUILDING CONSULTANTS, INC.
813.659.9197

DATE: 12/13/01

SCALE: NTS

DWG. BY: WLN




CHK. BY: RW

DRAWING NO.:


S-2105

SHEET 3 OF 8


Approved as complying with the
Florida Building Code
Date: JAN. 30 2003
NOA# 02-1216-03
Miami Dade Product Control
Division
By: *Manuel Perez*

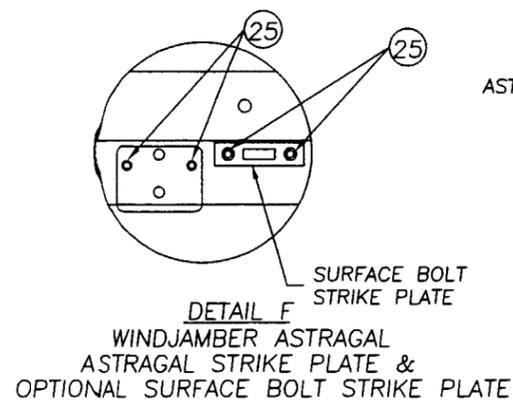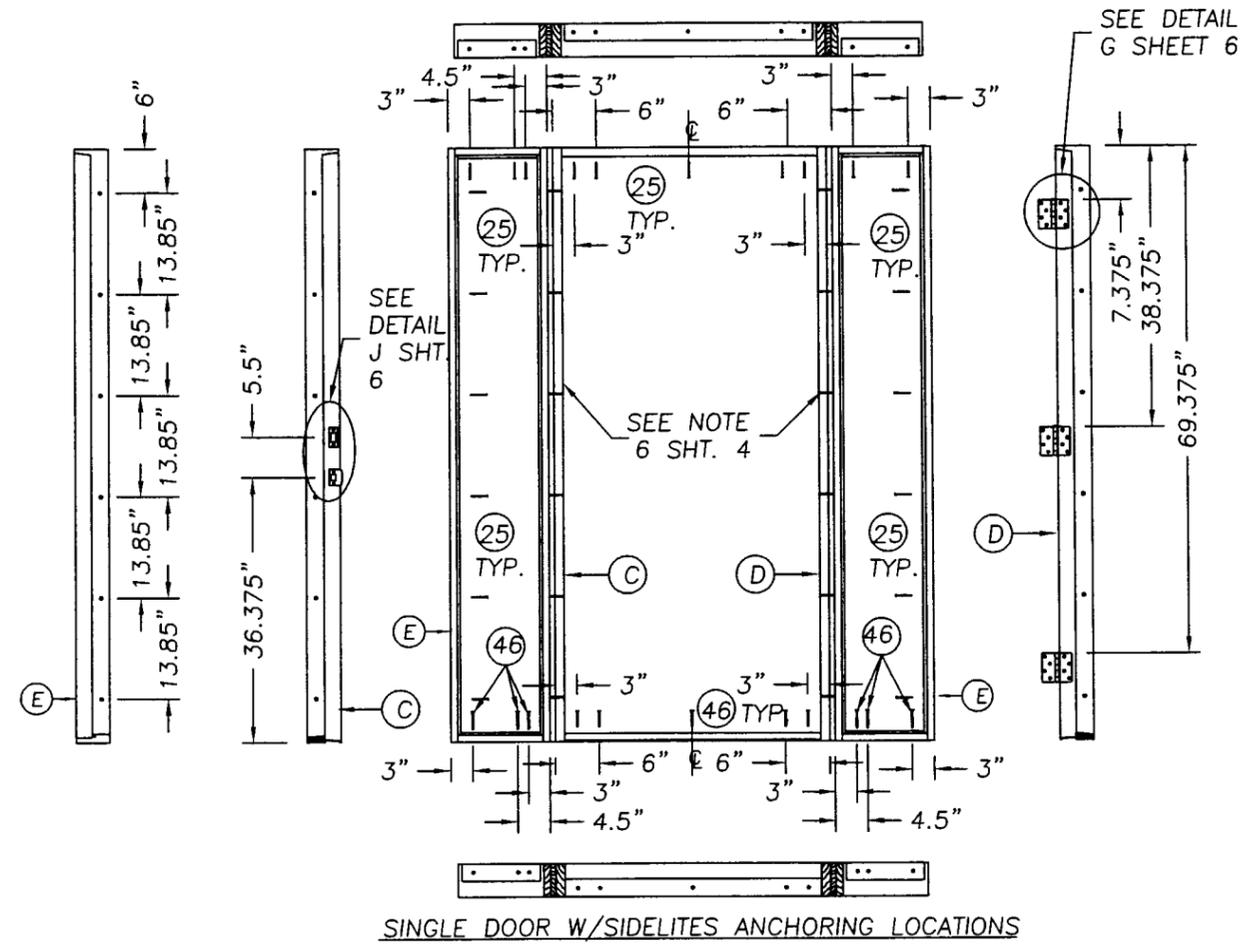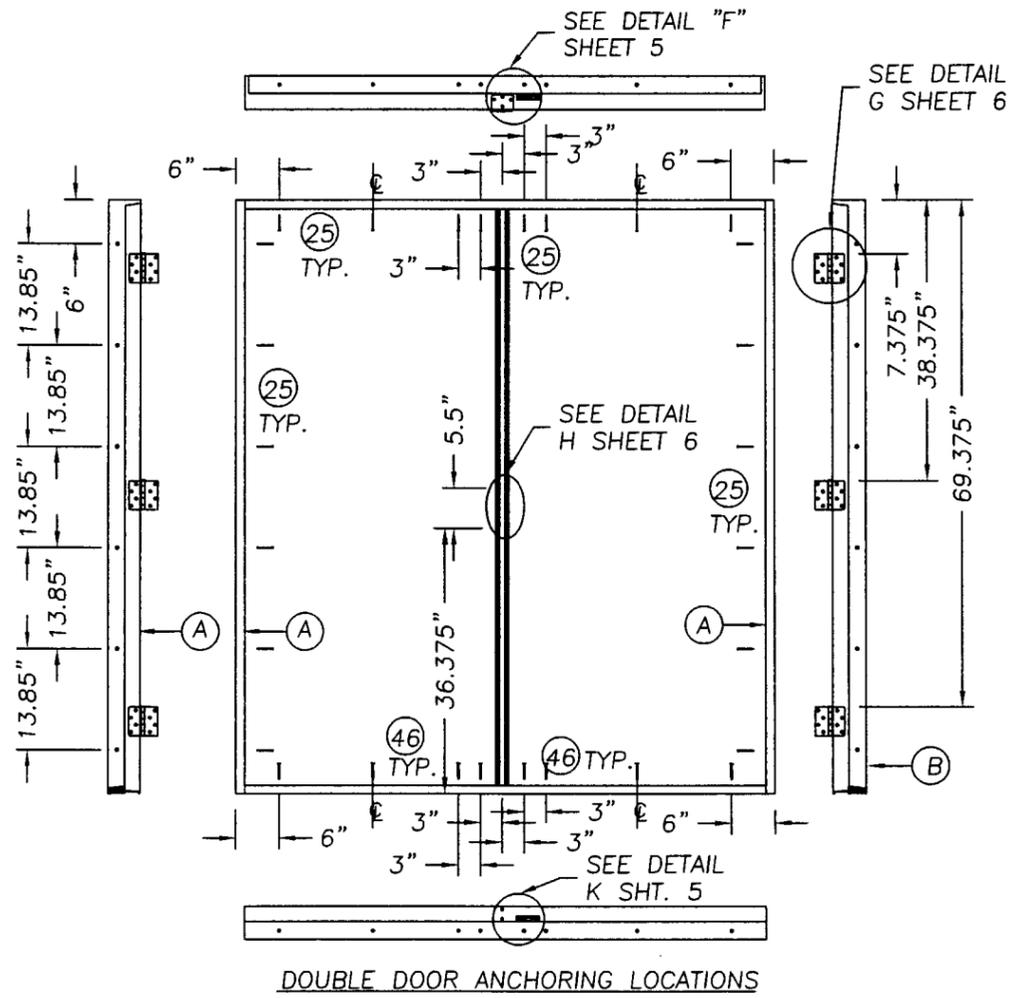


DETAIL F
WINDJAMBER ASTRAGAL
ASTRAGAL STRIKE PLATE &
OPTIONAL SURFACE BOLT STRIKE PLATE

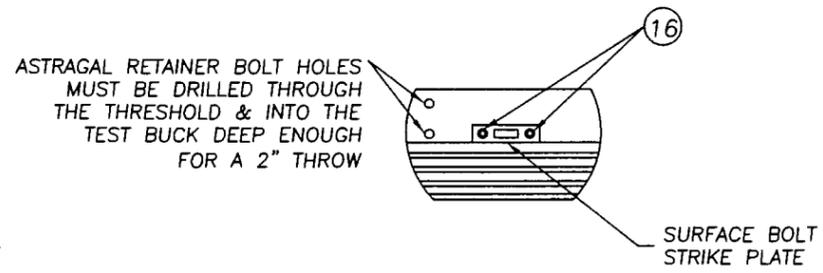

DETAIL K SILL
WINDJAMBER ASTRAGAL
ASTRAGAL RETAINER BOLT HOLES &
OPTIONAL SURFACE BOLT STRIKE PLATE

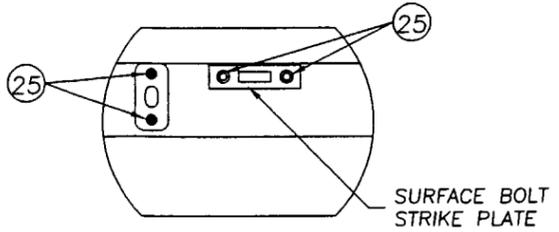

OPTIONAL DETAIL F
IMPERIAL ASTRAGAL
ASTRAGAL STRIKE PLATE &
OPTIONAL SURFACE BOLT STRIKE PLATE

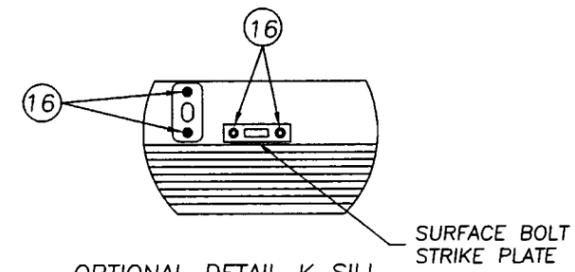

OPTIONAL DETAIL K SILL
IMPERIAL ASTRAGAL
ASTRAGAL STRIKE PLATE &
OPTIONAL SURFACE BOLT STRIKE PLATE

Approved as complying with the
Florida Building Code
Date JAN. 30. 2003
NOA# 02-1216-03
Miami Dade Product Control
Division
By [Signature]

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT:
WOOD EDGE GLAZED DOOR
W/ & W/OUT SIDELITES
UP TO 8'4" x 6'8" OUTSWING
PART OR ASSEMBLY:
ANCHORING LOCATIONS
& DETAILS

NO.	DATE	REVISIONS
2	10/22/02	ADD TRINITY FRAME
1	03/15/02	GENERAL REVISION
		ZRK
		TJH
		BY

RW BUILDING
CONSULTANTS, INC.
813.659.9197

DATE: 12/13/01
SCALE: N.T.S.
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2105
SHEET 5 OF 8


JELD-WEN, INC.
 31725 HIGHWAY 97 NORTH
 CHILOQUIN, OR. 97624
 PH. 541.783.2057

PRODUCT:
 WOOD EDGE GLAZED DOOR
 W/ & WOUT SIDELITES
 UP TO 8'4" x 6'8" OUTSWING
 PART OR ASSEMBLY:
 ANCHORING LOCATIONS
 & GLAZING DETAILS


NO.	DATE	REVISIONS
2	10/22/02	ADD TRINITY FRAME ZRK
1	03/15/02	GENERAL REVISION T/JH
		BY

RW BUILDING
 CONSULTANTS, INC.
 813.659.9197





DATE: 12/13/01
 SCALE: N.T.S.
 DWG. BY: WLN
 CHK. BY: RW
 DRAWING NO.: S-2105
 SHEET 6 OF 8

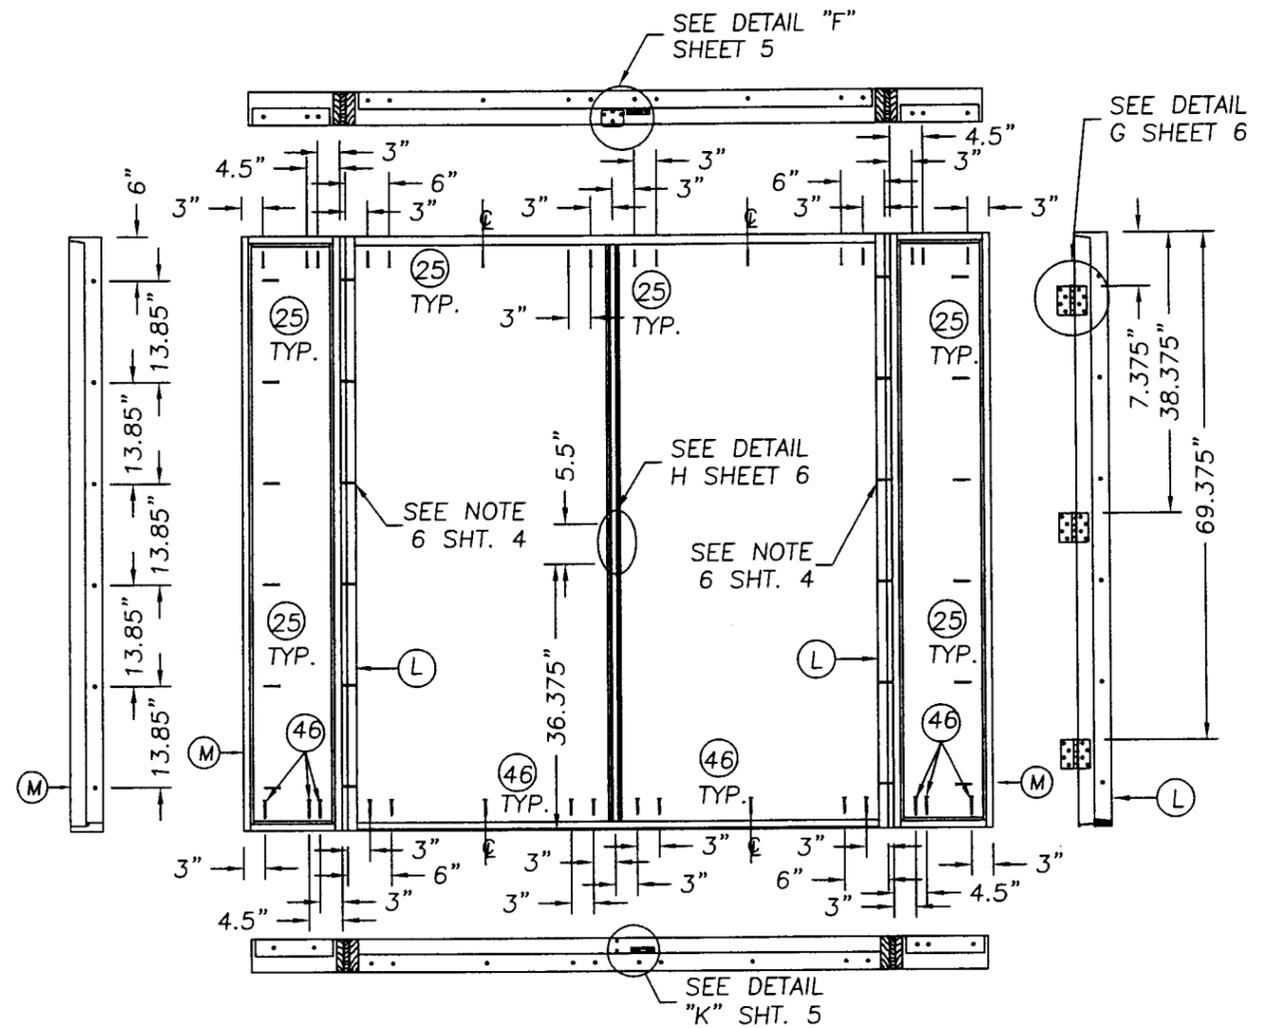

DOUBLE DOOR W/SIDELITES ANCHORING LOCATIONS

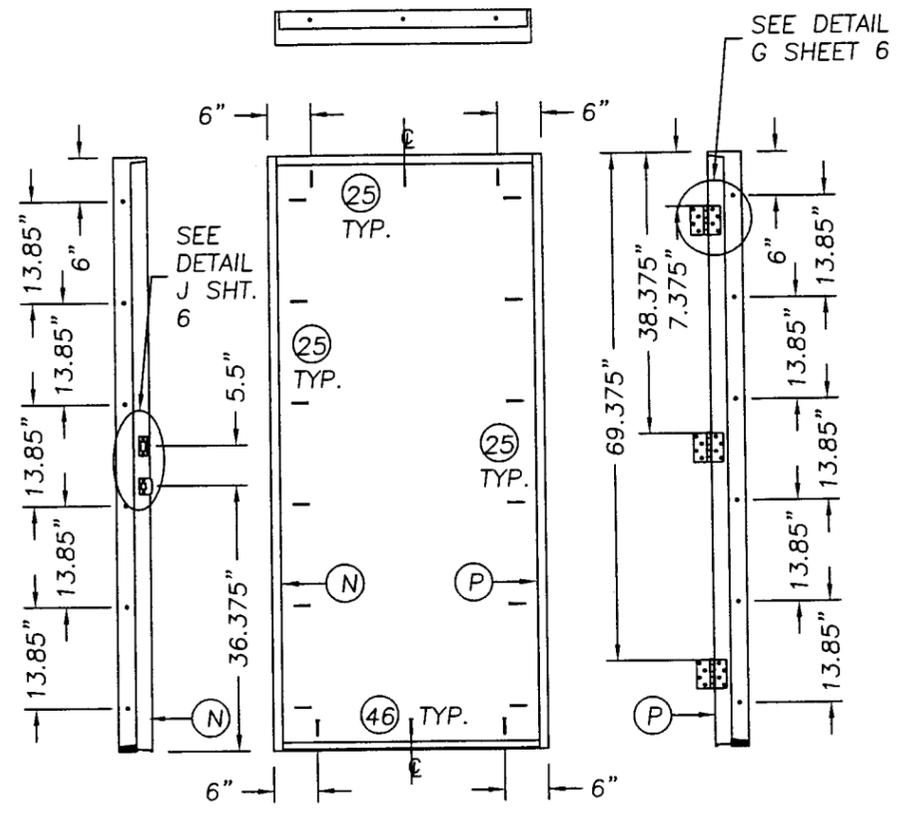


SINGLE DOOR ANCHORING LOCATIONS

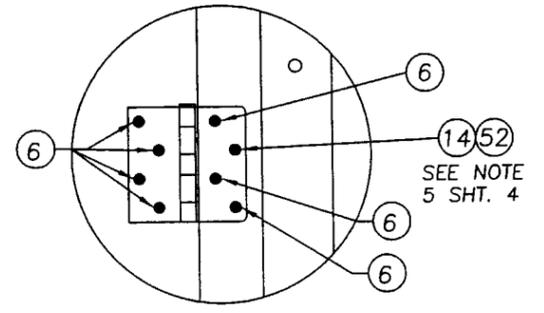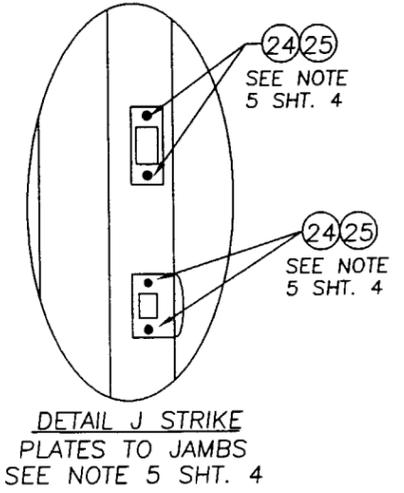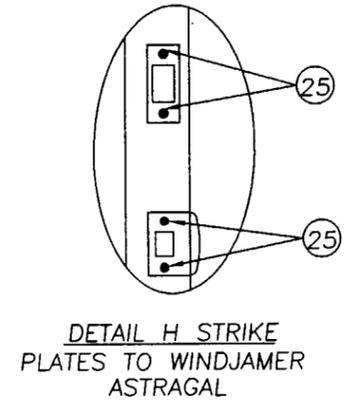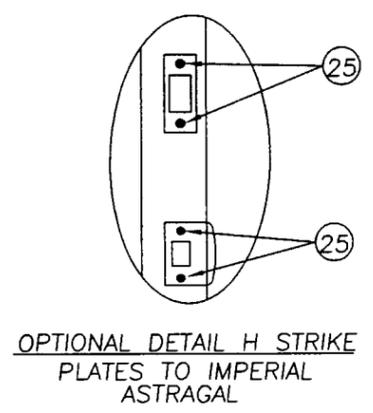


DETAIL G HINGE
 TO JAMBS & DOOR
 SEE NOTE 5 SHT. 4


Approved as complying with the
 Florida Building Code
 Date JAN. 30. 2003
 NOA# 02-1216.09
 Miami Dade Product Control
 Division
 By *Manuel Perez*

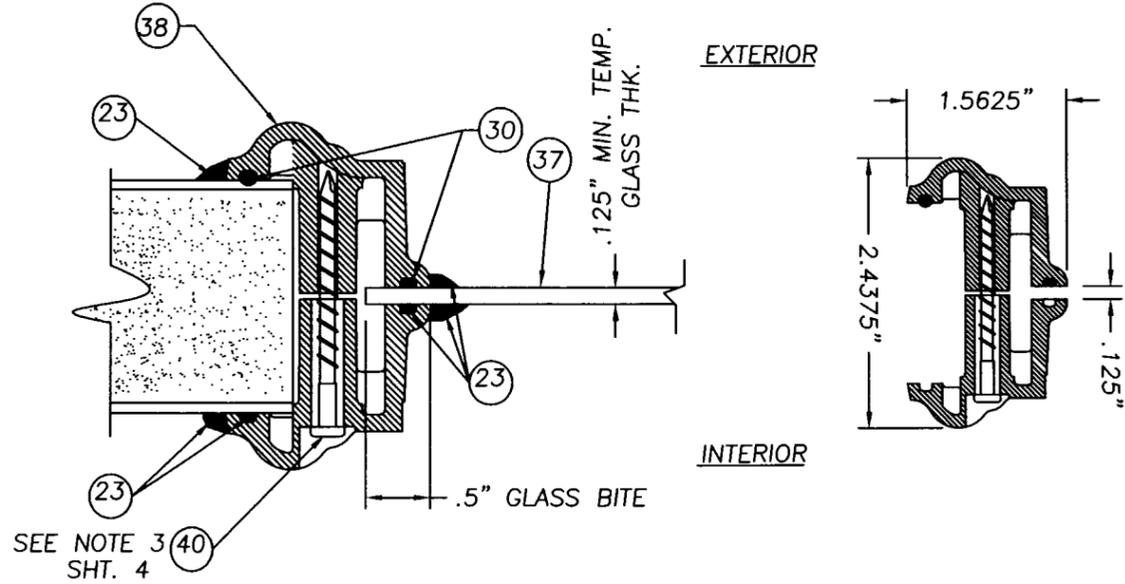


38 GLAZING DETAIL ODL
 1/8" TEMPERED GLASS
 HP POLYPROPYLENE
 (THERMOFIL-P6-30FM0391)

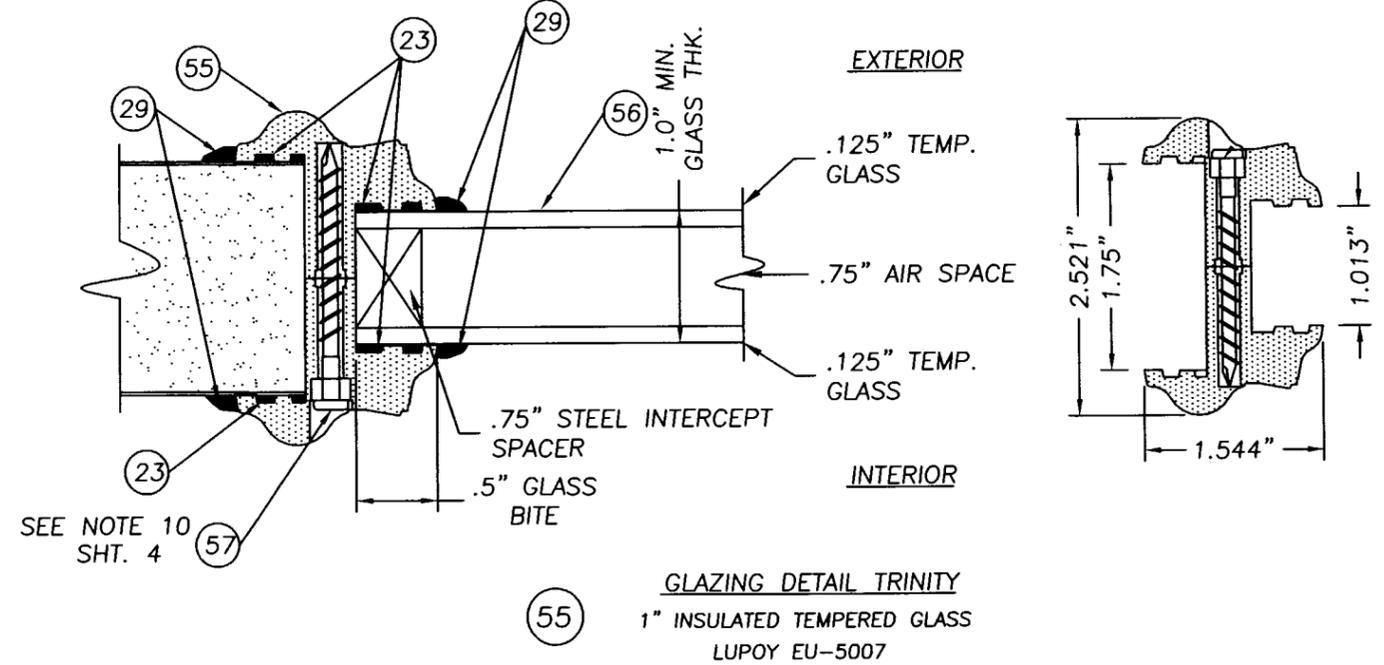

55 GLAZING DETAIL TRINITY
 1" INSULATED TEMPERED GLASS
 LUPOY EU-5007

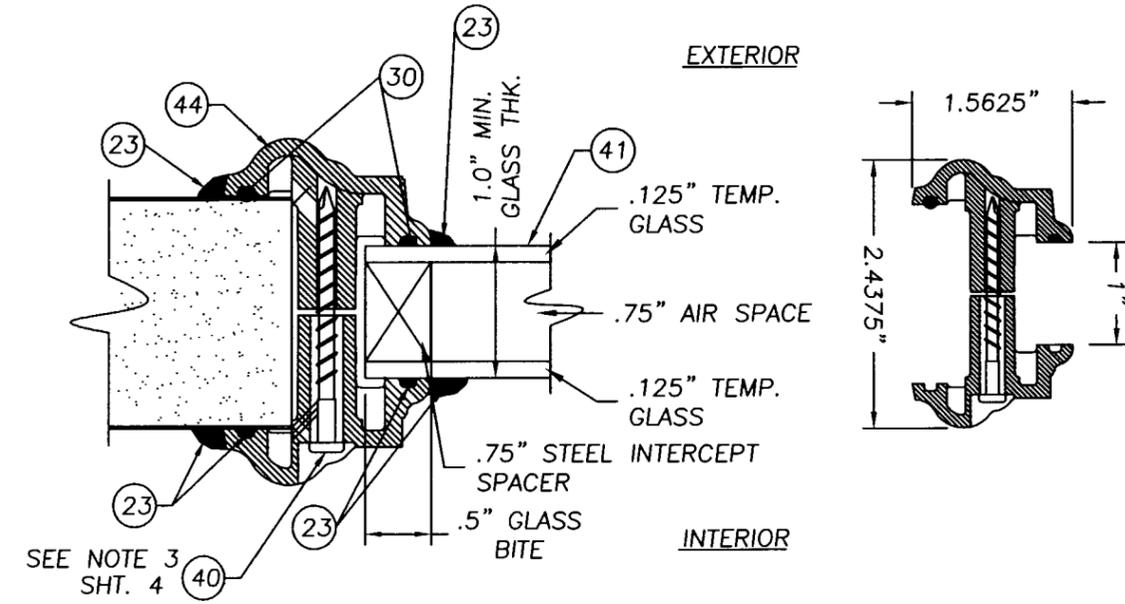

44 GLAZING DETAIL ODL
 1" TEMPERED GLASS
 HP POLYPROPYLENE
 (THERMOFIL-P6-30FM0391)

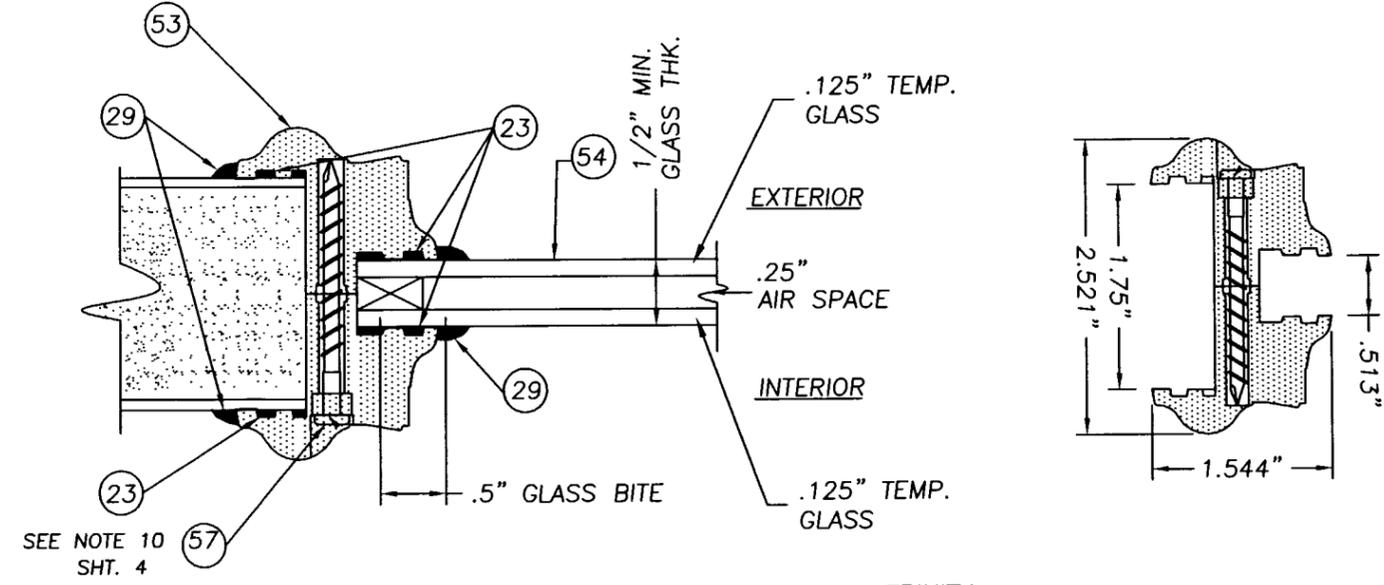

53 GLAZING DETAIL TRINITY
 1/2" INSULATED TEMPERED GLASS
 LUPOY EU-5007

JELD-WEN, INC.
 31725 HIGHWAY 97 NORTH
 CHILOQUIN, OR. 97624
 PH. 541.783.2057


PRODUCT: WOOD EDGE GLAZED DOOR
 W/ & WOUT SIDELITES
 UP TO 8'4" x 6'8" OUTSWING
 PART OR ASSEMBLY:
 GLAZING DETAILS

NO.	DATE	REVISIONS	BY
2	10/22/02	ADDED TRINITY FRAME ZRK	TJH
1	03/15/02	GENERAL REVISION	TJH


RW BUILDING
 CONSULTANTS, INC.
 813.659.9197

Approved as complying with the
 Florida Building Code
 Date JAN. 30. 2003
 NOA# 02-1216-09
 Miami Dade Product Control
 Division
 By Mmanuel Perez


DATE: 12/13/01
 SCALE: N.T.S.
 DWG. BY: WLN
 CHK. BY: RW
 DRAWING NO.: S-2105
 SHEET 7 OF 8




7 LVL LATCH STILE




13 11 DOOR TOP & HINGE STILE

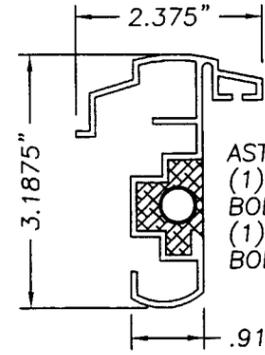


49 ASTRAGAL HAS
(1) 9.0" L. x .312" DIA. BOLT @ TOP &
(1) 9.0" L. x .312" DIA. BOLT @ BOTTOM
OPTIONAL IMPERIAL ASTRAGAL
EXTRUDED ALUMINUM .075" WALL
SEE DESIGN PRESSURE CHART

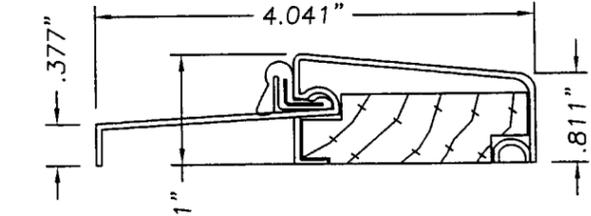


9 OUTSWING BUMPFACE THRESHOLD
LOW PROFILE
.050" EXTRUDED ALUMINUM

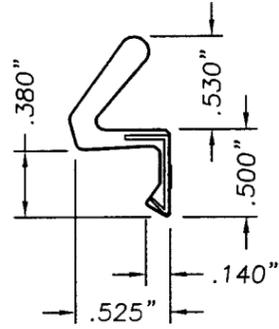


10 COMPRESSION WEATHERSR TIP
SCHLEGEL Q-LON QDS 650

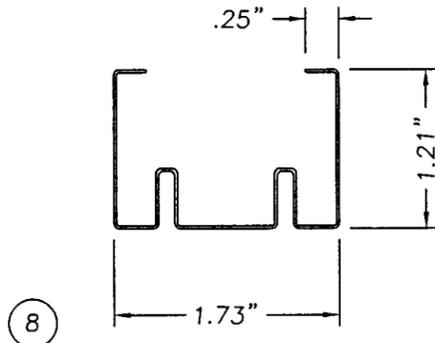


8 DOOR STEEL EDGE CAP, BOTTOM

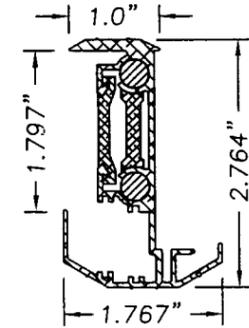


26 ASTRAGAL HAS
(2) 8.0" L. x .312" DIA. BOLTS @ BOTTOM &
(2) 8.0" L. x .312" DIA. BOLTS @ TOP
ASTRAGAL WINDJAMBER II
(WR68J T6-6060 EXTRUDED ALUMINUM)

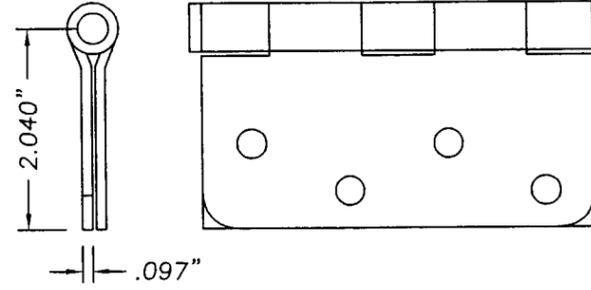


5 4 x 4 STEEL DOOR HINGE
.097" THK. STEEL BY HAGER

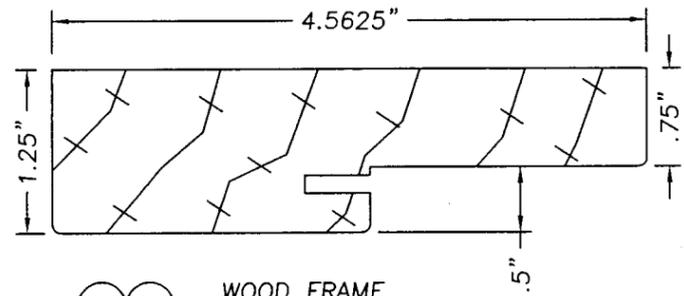


2 4 WOOD FRAME
3 50

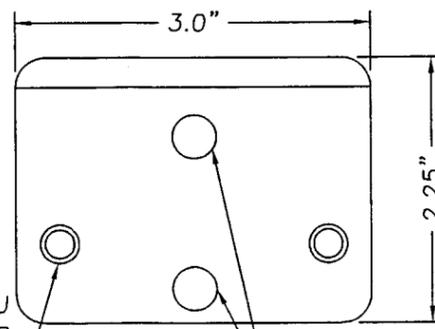


26 WINDJAMBER II WR68J STRIKE PLATE
STEEL PLATE
DRILL TRU FOR A #8 PFH WOOD SCREW 2PLCS
DRILL TRU FOR .357" DIA. ASTRAGAL RETAINER BOLTS

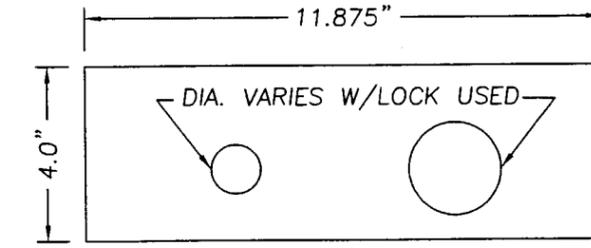

15 WOOD LOCK BLOCK, 1.71" THK.

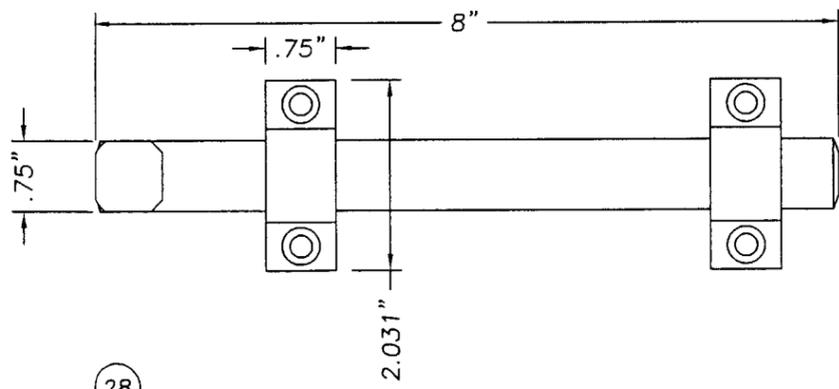

28 SURFACE BOLT (IVES .25" STEEL MODEL 454)

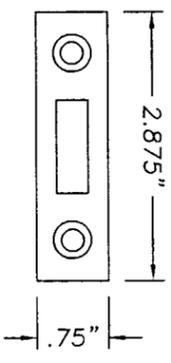

28 STRIKE (IVES .125" STEEL)

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT: WOOD EDGE GLAZED DOOR
& W/OUT SIDELITES
UP TO 8'4" x 6'8" OUTSWING
PART OR ASSEMBLY:
UNIT COMPONENTS

NO.	DATE	REVISIONS
2	10/22/02	ADDED TRINITY FRAME ZRK
1	03/15/02	GENERAL REVISION TJH

RW BUILDING CONSULTANTS, INC.
813.659.9197

Approved as complying with the Florida Building Code
Date JAN. 30, 2003
NOA# 02-1216.09
Miami Dade Product Control Division
By *Mauro Perez*

DATE: 12/13/01
SCALE: NTS
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2105
SHEET 8 OF 8