



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

---

**Jeld-Wen, Inc.  
317525 Highway 97 N.  
Chiloquin, OR 97624**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: Series "Jeld-Wen®" 8'0" W/E Outswing Glazed Insulated Steel Door w/wo Sidelites**

**APPROVAL DOCUMENT:** Drawing No. S-2109, titled "Wood Edge Glazed Door w/ & w/out Sidelites Up to 8'4 x 8'0 Outswing", sheets 1 through 8 of 8, prepared by R.W Building Consultants, Inc., dated 12/18/01 with revision on 11/18/02, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: None**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 02-0108.06 and, consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by **Jaime Eisen, P.E.**



**NOA No 02-1224.05  
Expiration Date: July 18, 2007  
Approval Date: January 30, 2003  
Page 1**

**Jeld-Wen, Inc.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

(For File ONLY. Not part of NOA)

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No. **S-2109**, titled ""Wood Edge Glazed Door w/ & w/out Sidelites Up to 8'4 x 8'0 Outswing", sheets 1 through 8 of 8-, prepared by R.W Building Consultants, Inc., dated 12/18/01 with revision on 11/18/02.

**B. TESTS**

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Forced Entry Test, per SFBC 3603.2 (b) and TAS 202-94  
along with marked-up drawings and installation diagram of a DoorCraft series opaque wood edge steel door, prepared by Certified Testing Laboratories, Test Report No. **CTLA-961W**, dated 10/23/01, signed and sealed by Ramesh C. Patel, P.E.

***Submitted under NOA #02-0108.06***

2. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Forced Entry Test, per FBC 3603.2 (b) and TAS 202-94  
along with marked-up drawings and installation diagram of wood edge outswing glazed steel door, prepared by Certified Testing Laboratories, Test Report No. **CTLA-6971A**, dated 11/12/01, signed and sealed by Ramesh C. Patel, P.E.

**C. CALCULATIONS**


1. Anchor Calculations and structural analysis dated 12/2/02, prepared by R.W. Building Consultants, Inc., signed and sealed by Lyndon F. Schimdt, P.E.

***Submitted under NOA #02-0108.06***

1. Anchor Calculations and structural analysis dated 12/2/01, prepared, signed and sealed by Wendell Haney, P.E.

**D. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **01-0718.08** issued to ODL, Inc. for "HP Propropylene Doorlight Assembly" dated 1/17/02, expiring on 1/17/06.



Jaime M. Eisen, P.E.  
Product Control Examiner  
NOA No. 02-1216.10  
Expiration Date: July 17, 2008  
Approval Date: January 30, 2003

**Jeld-Wen, Inc.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

(For File ONLY. Not part of NOA)


2. Tensile Test prepared by Internek Testing Services Inc., Project No. J99006660-001, dated 3/30/99, tested per ASTM E84-97a and ASTM D 1929-91.
3. Photocopy of test report **114884-1** dated 11/24/98 for "Standard test Method Method for Rate of Burning of Self-Supporting Plastics in Horizontal position per **ASTM D 635-97**; and test report No. **114884-2** dated 11/24/98 for "Measuring the Density of Smoke or Decomposition of Plastics" per **ASTM D 1929-96**; and test report No. **114884-2** dated 11/24/98 for "Measuring the Density Smoke from the Burning or Decomposition of Plastics" per **ASTM D 2843-93**; all the above tests reports are for **DC-1643-05 Filled Polypropylene Fiberglass & Mica**, issued by **SGS U.S. Testing Co. Inc.**
4. Photocopy **4500 Hours Xenon Arch** completed tensile report No. **PRI00034** dated December 12, 2000, issued by PRI Asphalt Technologies to **ODL** for **Spartech Polycom PP5530-C13, 4500 Hours Xenon Arch** exposed samples, Tested per **ASTM D 63896a**, signed and sealed by Charles L. Thomas, P.E.
5. Notice of Acceptance No. **02-0429.11**, issued to Trinity Glass International, Inc. for "Trinity Lite Frame" dated 7/3/02, expiring on 7/3/07.

**E. STATEMENTS**

1. Statement letter of no financial interest, dated 10/10/02, signed by Steve Frey.
2. Statement letter of no financial interest, dated 12/2/02, signed and sealed by Lyndon Schmidt, P.E.

**F. OTHER**

1. Notice of Acceptance No. **02-0108.05**, issued to Jeld-Wen, Inc. for Series "DoorCraft®" 8'0" W/E Outswing Glazed Insulated Steel Door w/wo Sidelites" dated 7/18/02, expiring 7/18/07.



Jaime M. Eisen, P.E.  
Product Control Examiner  
NOA No. 02-1224.05  
Expiration Date: July 18, 2007  
Approval Date: January 30, 2003

# JELD-WEN® Steel

WOOD EDGE GLAZED INSULATED STEEL DOOR  
OUTSWING 8-0 UNITS W/AND W/OUT SIDELITES

## GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. DESIGNED PRESSURE RATING SEE TABLE PAGE 1.
5. THIS SYSTEM MEET THE WATER REQUIREMENTS FOR "HIGH VELOCITY HURRICANE ZONES". SEE DESIGN PRESSURE CHART BELOW
6. THIS SYSTEM REQUIRES WINDBORNE DEBRIS EXTERNAL PROTECTION AS PRESCRIBED IN SECTION 1626.1 OF THE FLORIDA BUILDING CODE, AT SIDELITES ONLY.
7. SIDELITES ARE AN OPTION AND CAN BE USED IN A SINGLE OR DOUBLE CONFIGURATION.

## RESIDENTIAL INSULATED STEEL DOOR (Common to all frame conditions)

### Door Leaf Construction:

**Face sheets:** 24 ga. (0.021") minimum thickness, Galvanized steel A-525 commercial quality - AKDQ per ASTM 620 with average minimum yield strength  $F_y(\text{ave.})=30,627$  psi.

**Core design:** Expanded polystyrene with 1.0 to 1.25 lbs. density, by Jeld-Wen, Inc.


**Panel Construction:** The active and inactive panels are constructed from 24GA. (0.021" min.) galvanized steel. The face sheet top and bottoms are bent 90° over the top and bottom rails. The top rail consists of LVL measuring 1.67" x 1.0". The bottom rail measures 1.25" high x 1.67" wide. The sides of the face sheet are roll formed into the LVL latch stile and Ponderosa Pine hinge stile which measure 1.67" x 1.0". The interior cavity is filled with polystyrene. The face sheet is glued to the polystyrene.

**Sash Construction:** The sash is constructed from 24GA. (0.021" min.) galvanized steel. The edges of the face sheet are bent 90° over the polystyrene core and glued to it. The sashes are routed to receive the ODL or Trinity Lite Frames. The units are glazed with .125" tempered glass. The lite frames are wet glazed on the exterior.

**Frame Construction:** The frames are constructed from Ponderosa Pine jambs measuring 4.563" x 1.25". The head jambs are mortised and butt joined to the side jambs and attached with (3) 16GA. 2" x 7/16" crown wire staples. The units use a high dam bump face threshold measuring 5.25" x 1.75". The threshold is attached to the frame with (3) 16GA. 2" x 7/16" crown wire staples.

## TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATIONS
2	VERTICAL CROSS SECTIONS & BILL OF MATERIALS
3	HORIZONTAL CROSS SECTIONS
4	HORIZONTAL CROSS SECTIONS & NOTES
5	ANCHORING LOCATIONS & DETAILS
6	ANCHORING LOCATIONS & DETAILS
7	GLAZING DETAILS
8	UNIT COMPONENTS

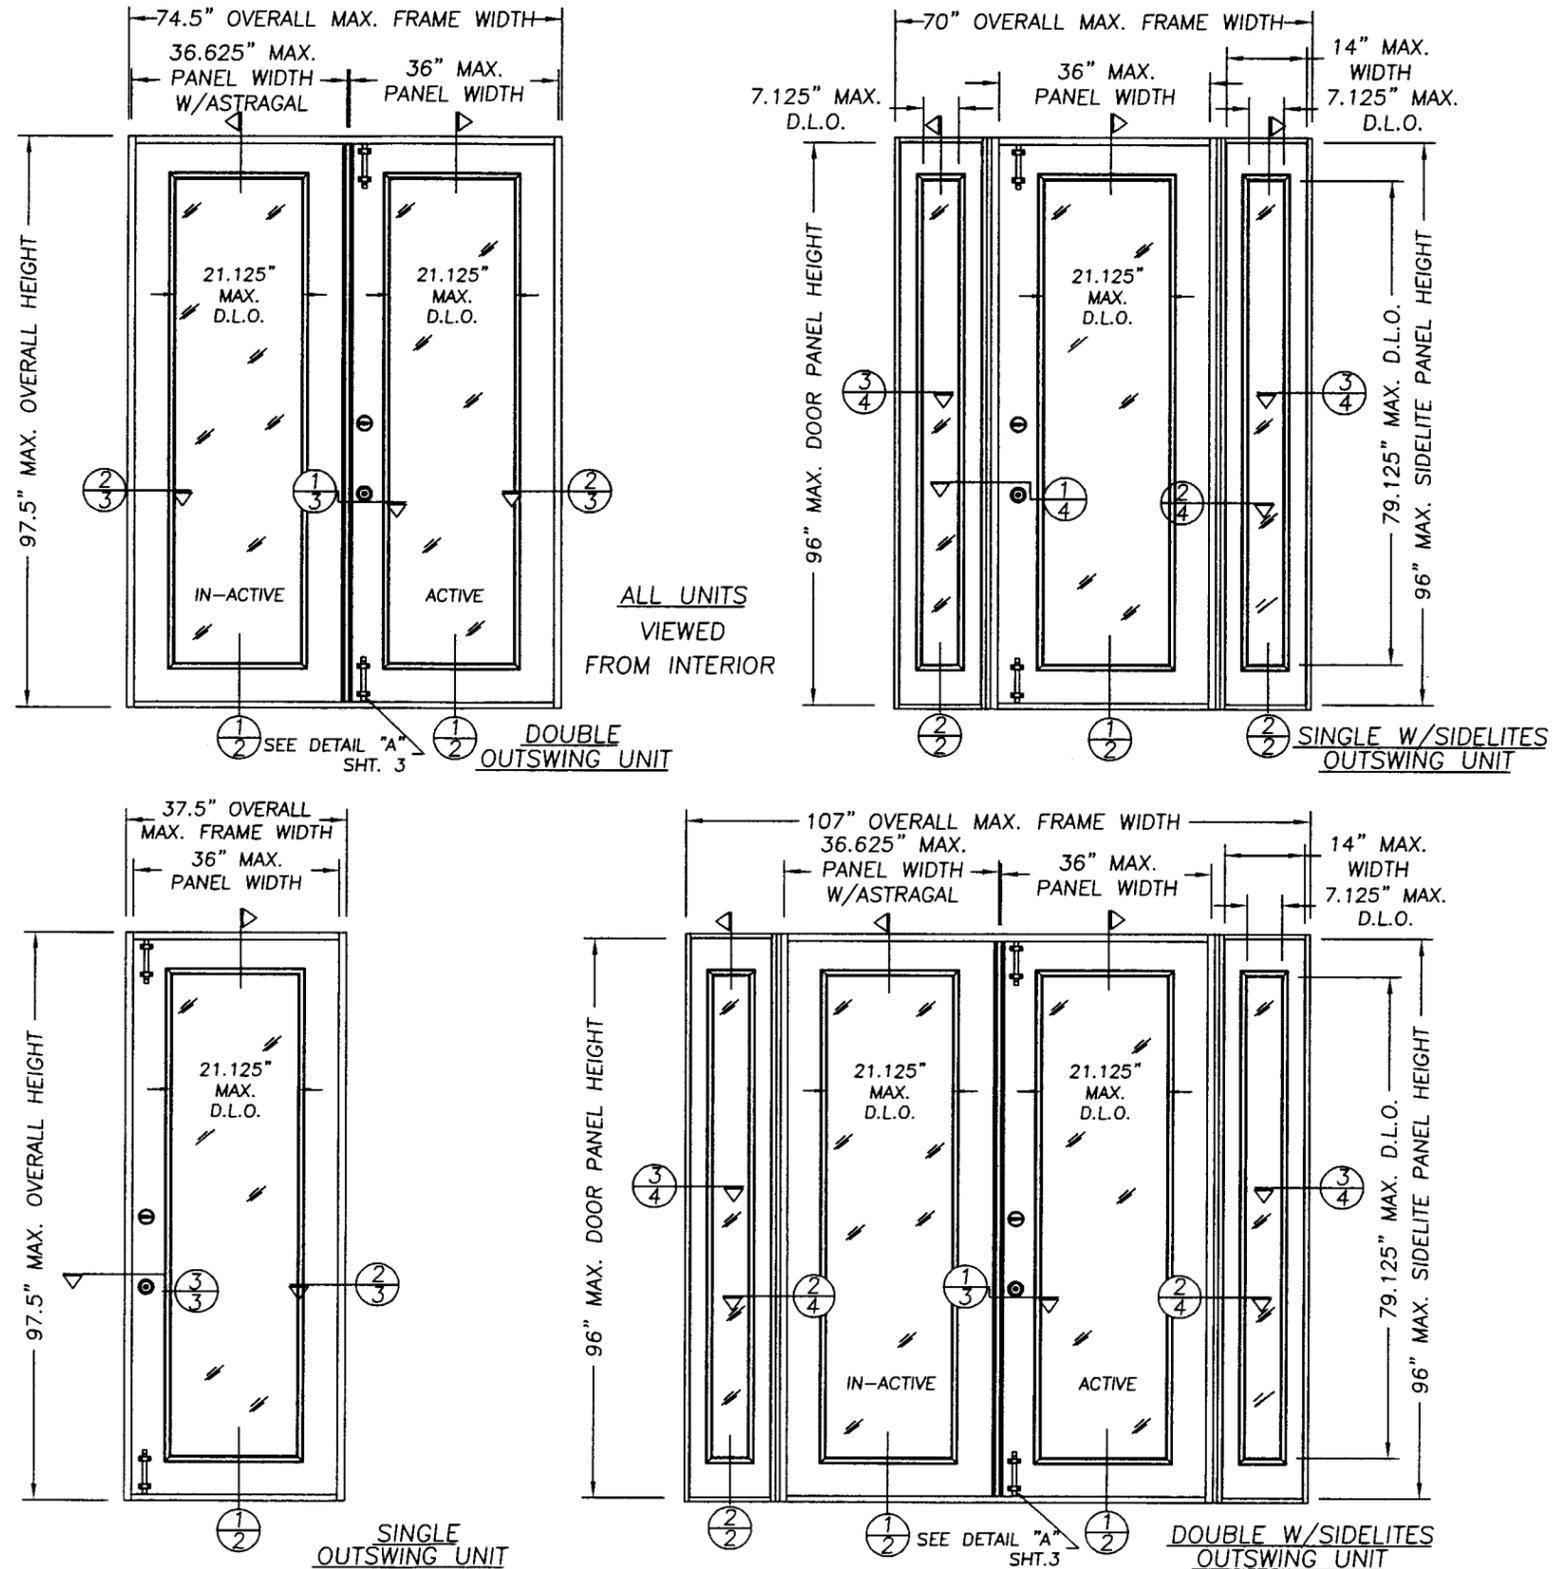

DESIGN PRESSURE RATING WHERE WATER INFILTRATION REQUIREMENT IS NEEDED	
UNIT TYPE	W/SURFACE BOLTS ACTIVE PANEL
SINGLE W/ OR W/O SIDELITES	+53.0psf -53.0psf
DOUBLE W/ OR W/O SIDELITES (WINDJAMBER II ASTRAGAL)	+53.0psf -53.0psf
DOUBLE W/ OR W/O SIDELITES (IMPERIAL ASTRAGAL)	+47.0psf -47.0psf

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No 02-1224.05  
Expiration Date 01/18/03

By: *[Signature]*  
Miami Product Control  
Division


DATE: 12/18/01  
SCALE: N.T.S.  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2109  
SHEET 1 OF 8

PRODUCT: WOOD EDGE GLAZED DOOR  
W/ & W/OUT SIDELITES  
UP TO 8'4" x 8'0" OUTSWING  
PART OR ASSEMBLY:  
GENERAL NOTES  
& TYPICAL ELEVATIONS


NO.	DATE	T/J/H	REVISIONS
3	11/18/02		ADDED TRINITY FRAME
2	06/15/02		CORRECT B.O.M.
1	03/15/02		GENERAL REVISION

**RW** BUILDING  
CONSULTANTS, INC.  
813.659.9197

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

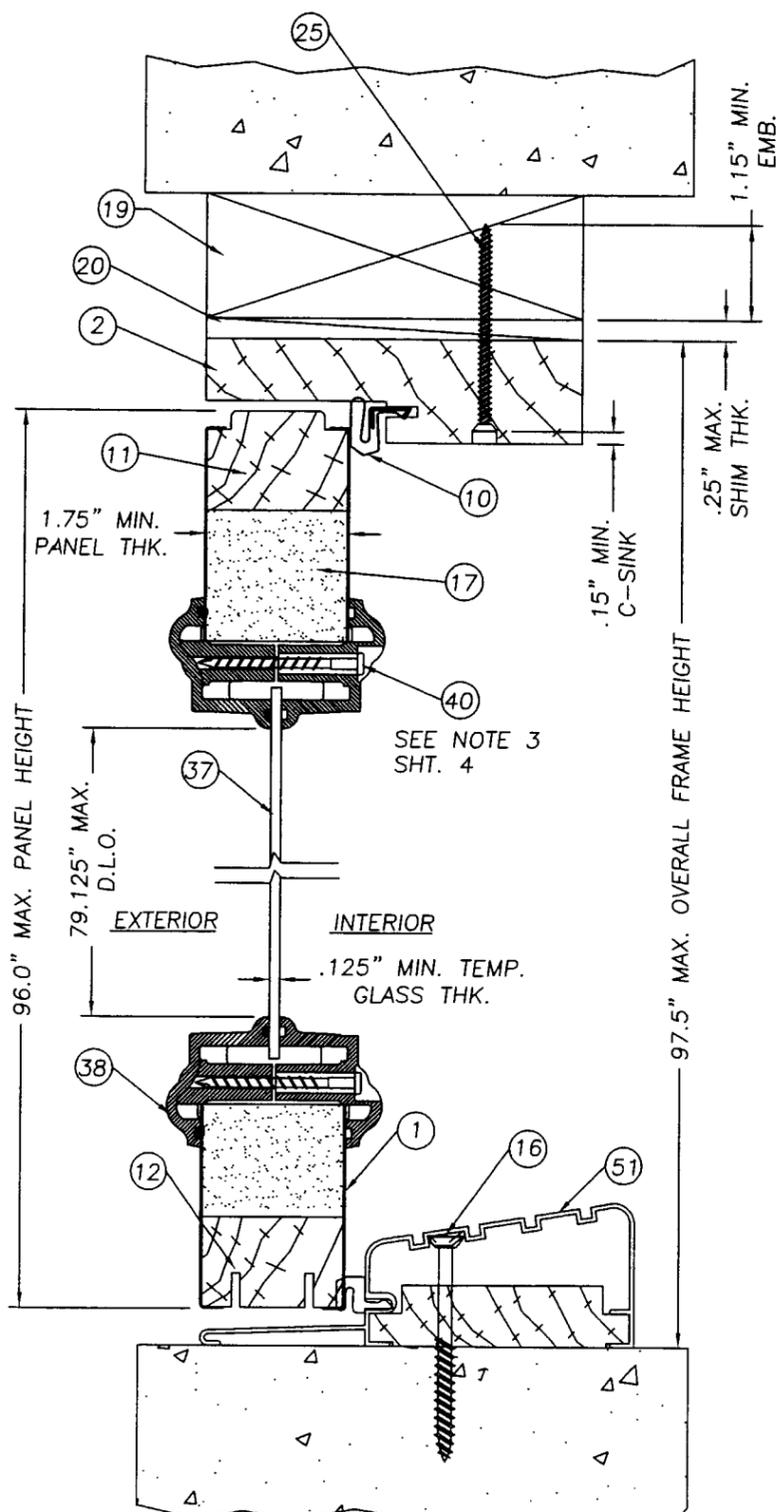

1 VERTICAL CROSS-SECTION  
 2 DOOR PANEL W/HIGH DAM THRESHOLD  
 THE HIGH DAM THRESHOLD IS USED TO  
 ACHIEVE A HIGHER WATER PRESSURE

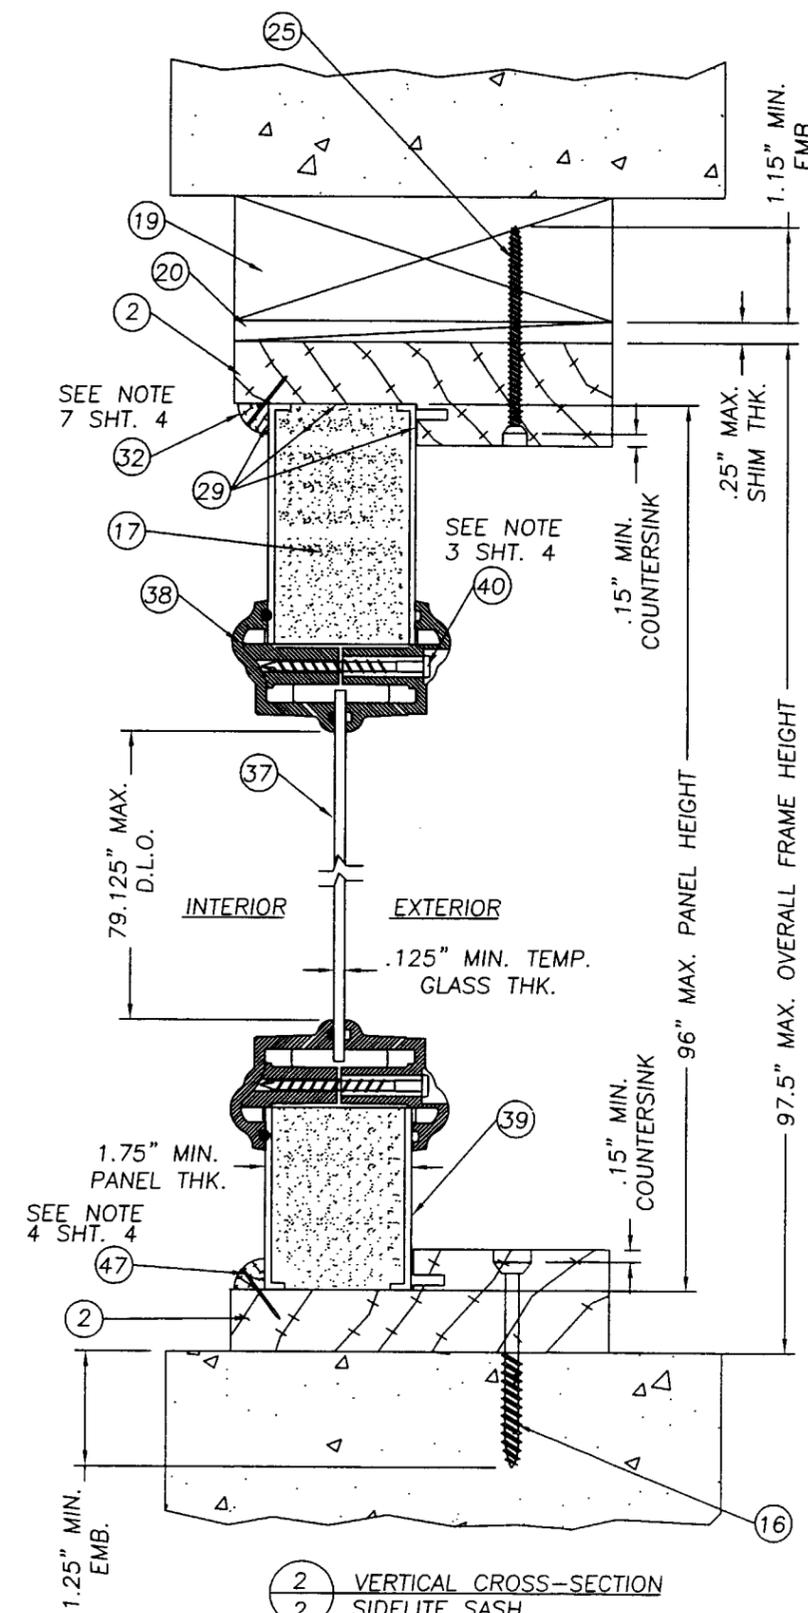

2 VERTICAL CROSS-SECTION  
 2 SIDELITE SASH

ITEM	DESCRIPTION	MATERIAL
1	DOOR, WOOD EDGE 1.75" THK. 24GA. (.021" MIN.)	STEEL
2	HEAD JAMB (1 1/4" x 4 9/16" FINGER JOINTED PINE)	PINE
3	HINGE JAMB (1 1/4" x 4 6/16" FINGER JOINTED PINE)	PINE
4	SIDELITE BLANK JAMB (1 1/4" x 4 9/16" FINGER JOINTED PINE)	PINE
5	4" x 4" BUTT HINGE 12ga. (.097" HAGER)	STEEL
6	#9 X 1" PFH WOOD SCREW (HINGE TO DOOR)	STEEL
7	DOOR LATCH LVL SIDE STILE 1.67" x 1"	LVL
8	NOT USED	-
9	NOT USED	-
10	COMPRESSION WEATHERSTRIP (SCHLEGEL Q-LON QDS 650)	FOAM
11	DOOR PANEL WOOD TOP RAIL 1.67" x 1.25"	WOOD
12	DOOR PANEL WOOD BOTTOM RAIL 1.67" x 1.25"	WOOD
13	DOOR HINGE WOOD SIDE STILE 1.67" x 1"	WOOD
14	#10 x 1 3/4" PFH WOOD SCREW	STEEL
15	LVL LOCK BLOCK (1.71" x 4.0" x 48.0")	LVL
16	3/16" TAPCON ANCHOR (ELCO)	STEEL
17	EXPANDED POLYSTYRENE (1.0 to 1.25 lb. DENSITY) BY JELD-WEN	FOAM
18	NOT USED	-
19	2x WOOD SUB BUCK	WOOD
20	SHIM MATERIAL (.25" MAX. THK.)	-
21	KWIKSET 400 SERIES KNOB	-
22	KWIKSET TITAN 700 SERIES DEADBOLT	-
23	NOT USED	-
24	#8 x 2" PHILL. FLATHEAD WOOD SCREW	STEEL
25	#8 x 2 1/2" PHILL. FLATHEAD WOOD SCREW	STEEL
26	ASTRAGAL EXTRUDED ALUM. WINDJAMBER II (BY GENESIS)	ALUM.
27	GLAZING COMPOUND DOW 1199	SILICONE
28	IVES SURFACE BOLT #454 8.0" L. x .25" THK. STEEL	-
29	SILICONE CAULK (CR LAWRENCE 33C)	SILICONE
30	GLAZING COMPOUND (OSD BY ODL)	SILICONE
31	#8 x 1" PHILLIPS PANHEAD WOOD SCREW	STEEL
32	3/8" x 3/8" 1/4" ROUND SIDELITE STOP	WOOD
33	1/4-20 SEX BOLT W/1/4-20 FEMALE END x 1 3/4" L	STEEL
34	SCHLAGE KNOB SET #F51 QUALIFIED UP TO +47 psf	-
35	SCHLAGE DEADBOLT #B360 QUALIFIED UP TO +47 psf	-
36	NOT USED	-
37	1/8" TEMPERED GLASS (BY PPG)	GLASS
38	LITE FRAME (ODL HP POLYPROP. THERMOFIL-P6-30FM0391)	POLYPROP.
39	STEEL SIDELITE PANEL 24GA. (.021" MIN. STEEL)	STEEL
40	#8 x 1 1/2" PLASCREW (LITE FRAME)	STEEL
41	NOT USED	-
42	YALE KNOB HERITAGE SERIES	-
43	YALE DEADBOLT HERITAGE SERIES	-
44	#10 x 1" PHILLIPS FLATHEAD WOOD SCREW	STEEL
45	#8 x 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
46	#10 x 2 1/2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
47	16GA. BRAD TRIM NAIL 3/4" L.	STEEL
48	3/4" THK. x 4 9/16" DEEP PRESSURE TREATED REINFORCEMENT	WOOD
49	EXTRUDED ALUMINUM ASTRAGAL (MFG. BY IMPERIAL)	ALUM.
50	LATCH JAMB (1 1/4" x 4 9/16" FINGER JOINTED PINE)	WOOD
51	HIGH DAM BUMP THRESHOLD .051" ALUM. (MFG. BY IMPERIAL)	ALUM.
52	#10 x 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
53	LITE FRAME BY TRINITY FOR 1/2" GLASS	POLYPROP.
54	1/2" INSULATED TEMP. GLASS BY TRINITY/AMPAC	-
55	LITE FRAME BY TRINITY FOR 1" GLASS	POLYPROP.
56	1" INSULATED TEMP. GLASS BY TRINITY/AMPAC	-
57	LITE FRAME SCREW #6 1 1/2" PANHEAD	STEEL

JELD-WEN, INC.  
 31725 HIGHWAY 97 NORTH  
 CHILOQUIN, OR. 97624  
 PH. 541.783.2057


PRODUCT: WOOD EDGE GLAZED DOOR  
 W/ & W/OUT SIDELITES  
 UP TO 8'4" x 8'0" OUTSWING  
 PART OR ASSEMBLY:  
 VERTICAL CROSS SECTIONS  
 & BILL OF MATERIAL

NO.	DATE	REVISIONS
3	10/23/02	ADD TRINITY FRAME
2	06/15/02	CORRECT B.O.M.
1	03/15/02	GENERAL REVISION


RW BUILDING  
 CONSULTANTS, INC.  
 813.659.9197

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No 02-1224.05  
 Expiration Date 03/18/07  
 By *[Signature]*  
 Miami Dade Product Control  
 Division


DATE:	12/18/01
SCALE:	NTS
DWG. BY:	WLN
CHK. BY:	RW
DRAWING NO.:	S-2109
SHEET	2 OF 8

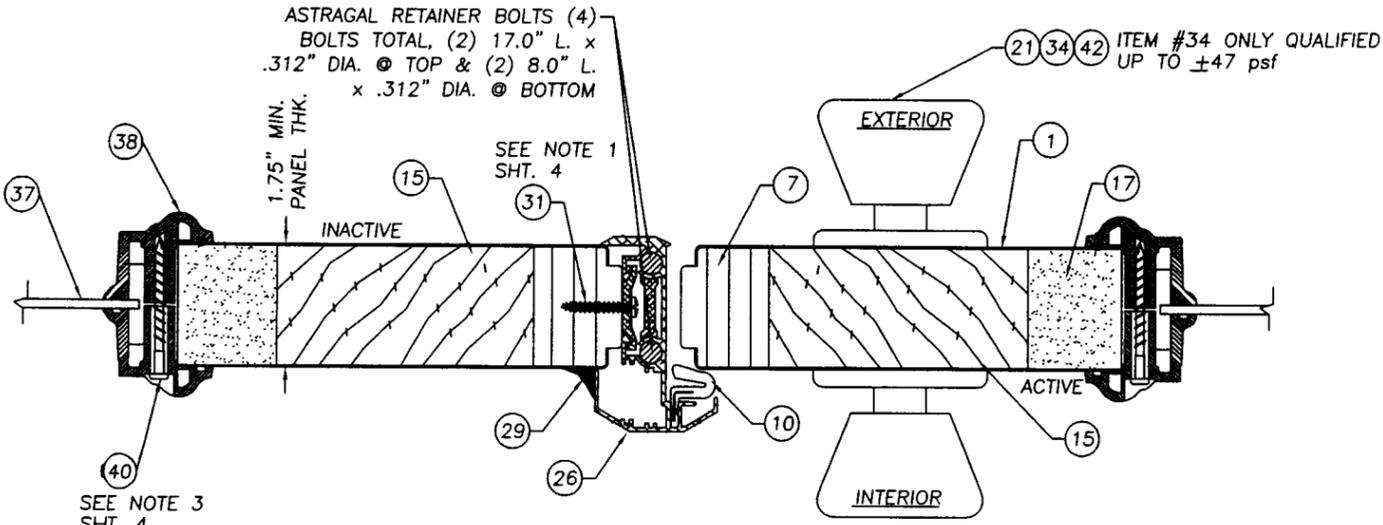


1 HORIZONTAL CROSS SECTION  
3 AT WINDJAMBER ASTRAGAL  
SEE DETAIL A SHT. 3 FOR  
SURFACE BOLT VIEW

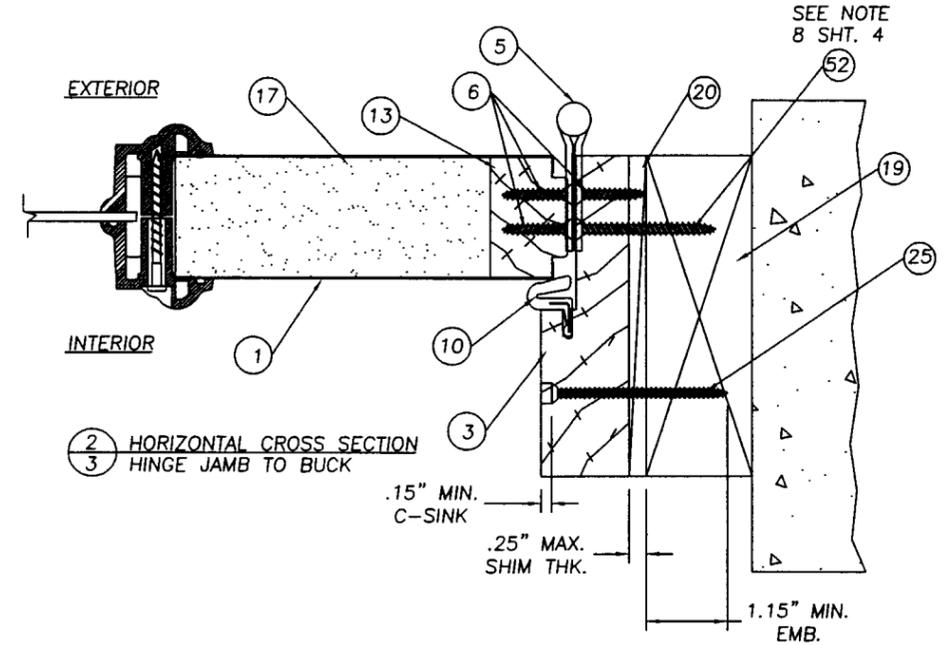


2 HORIZONTAL CROSS SECTION  
3 HINGE JAMB TO BUCK

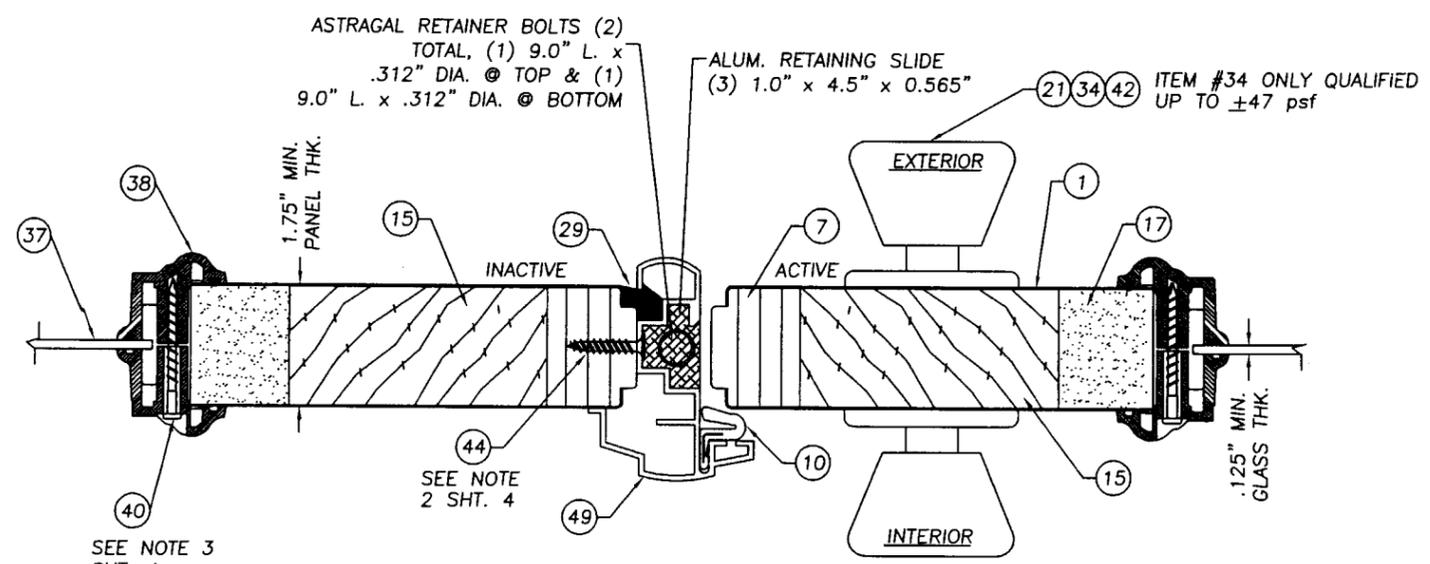

1 HORIZONTAL CROSS SECTION  
3 AT ASTRAGAL  
OPTIONAL IMPERIAL ASTRAGAL  
SEE DESIGN PRESSURE CHART  
SEE DETAIL A SHT. 3 FOR  
SURFACE BOLT VIEW

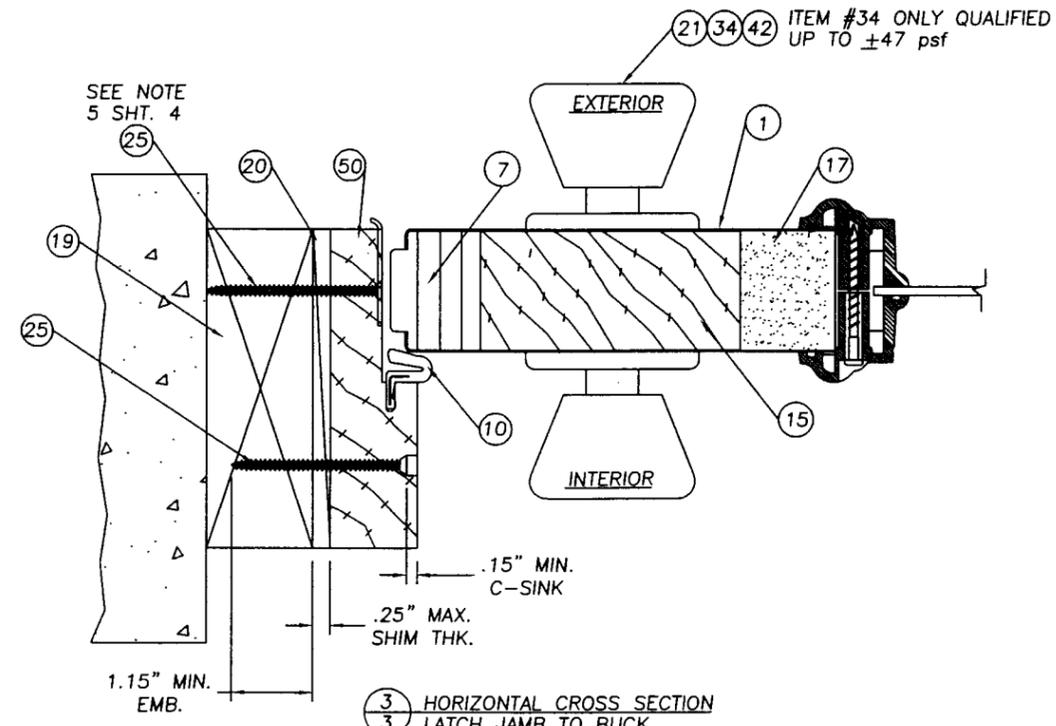

3 HORIZONTAL CROSS SECTION  
3 LATCH JAMB TO BUCK  
SEE DETAIL A SHT. 3 FOR  
SURFACE BOLT VIEW

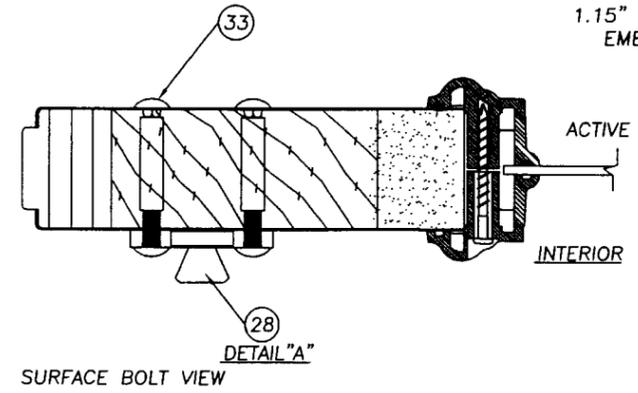

28 DETAIL "A"  
SURFACE BOLT VIEW

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILQUIN, OR. 97624  
PH. 541.783.2057

PRODUCT:  
WOOD EDGE GLAZED DOOR  
W/ & W/O SIDELITES  
UP TO 8'4" x 8'0" OUTSWING  
PART OR ASSEMBLY:  
HORIZONTAL CROSS  
SECTIONS


NO.	DATE	REVISIONS	BY
3	10/23/02	ADD TRINITY FRAME	ROF
2	06/15/02	CORRECT B.O.M.	RW
1	03/15/02	GENERAL REVISION	TJH

RW BUILDING  
CONSULTANTS, INC.  
813.659.9197



PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 02-1224.05  
Expiration Date 02/18/07  
By *[Signature]*  
Miami Building Product Control  
Division

DATE: 12/18/01  
SCALE: NTS  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.:  
S-2109  
SHEET 3 OF 8




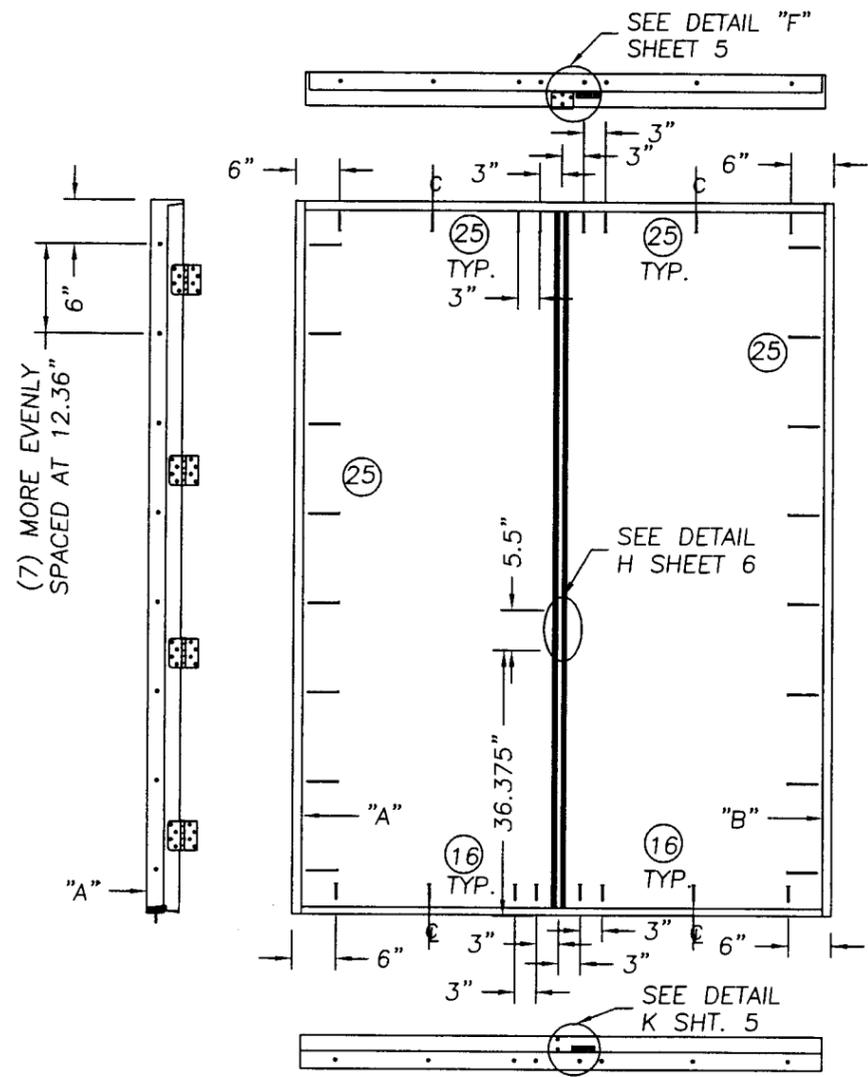


DOUBLE DOOR ANCHORING LOCATIONS

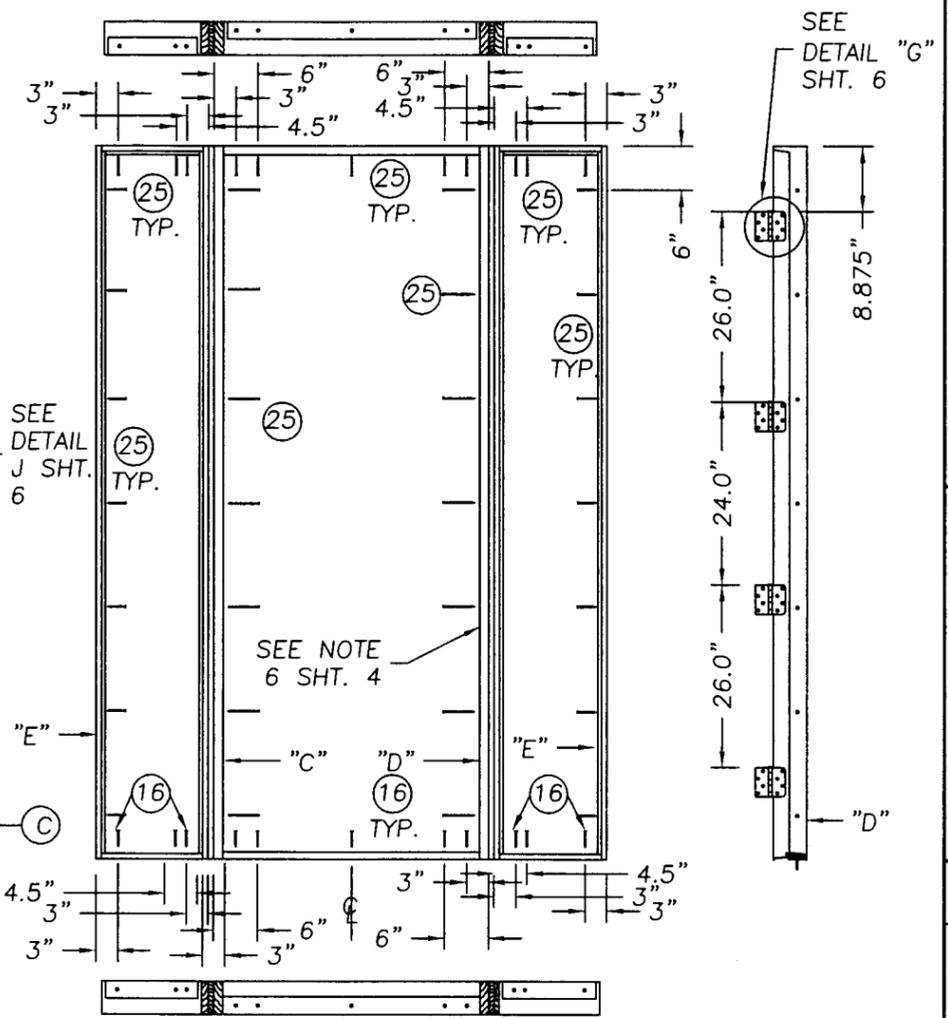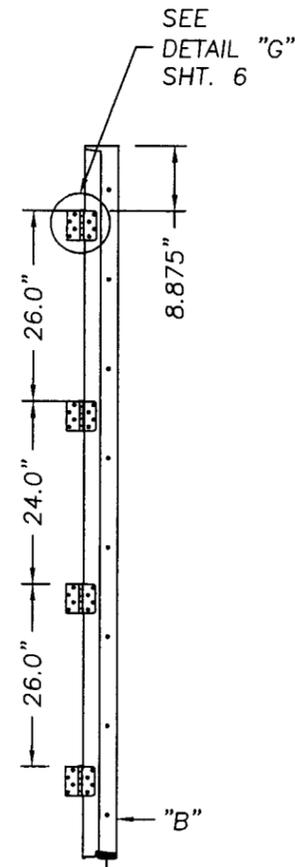


SINGLE DOOR W/SIDELITES ANCHORING LOCATIONS

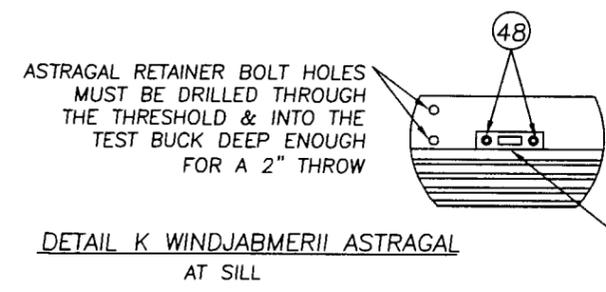


DETAIL K WINDJAMMERII ASTRAGAL AT SILL

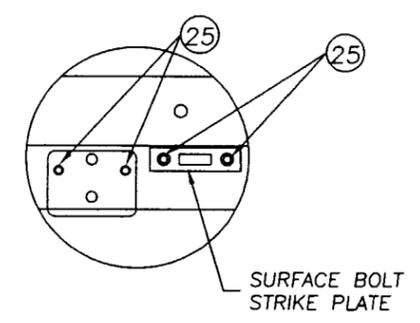

DETAIL F WINDJAMMER ASTRAGAL AT HEADER

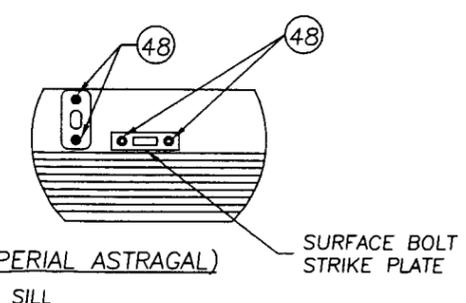

DETAIL K (IMPERIAL ASTRAGAL) AT SILL

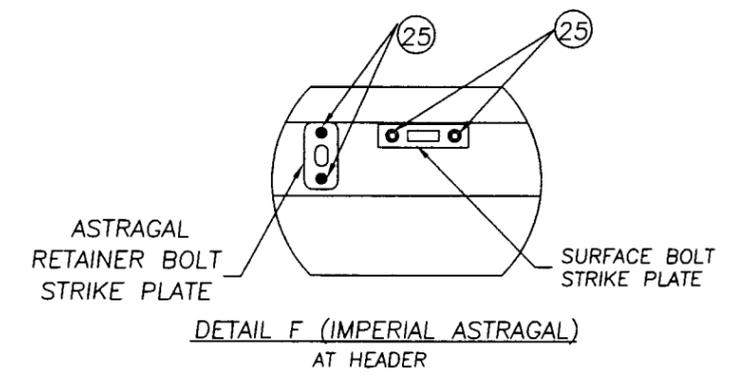

DETAIL F (IMPERIAL ASTRAGAL) AT HEADER

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057


PRODUCT: WOOD EDGE GLAZED DOOR W/ & W/OUT SIDELITES UP TO 8'4 x 8'-0 OUTSWING  
PART OR ASSEMBLY: ANCHORING LOCATIONS & DETAILS

NO.	DATE	BY	REVISIONS
3	10/23/02	ROF	ADDED TRINITY FRAME
2	06/15/02	RW	CORRECT B.O.M.
1	03/15/02	TJH	GENERAL REVISION



**RW** BUILDING CONSULTANTS, INC.  
813.659.9197

**PRODUCT REVISED**  
as complying with the Florida Building Code  
Acceptance No. 02-1224.05  
Expiration Date 02/18/07  
By *[Signature]*  
Miami Product Control Division


DATE: 12/18/01  
SCALE: N.T.S.  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2109  
SHEET 5 OF 8

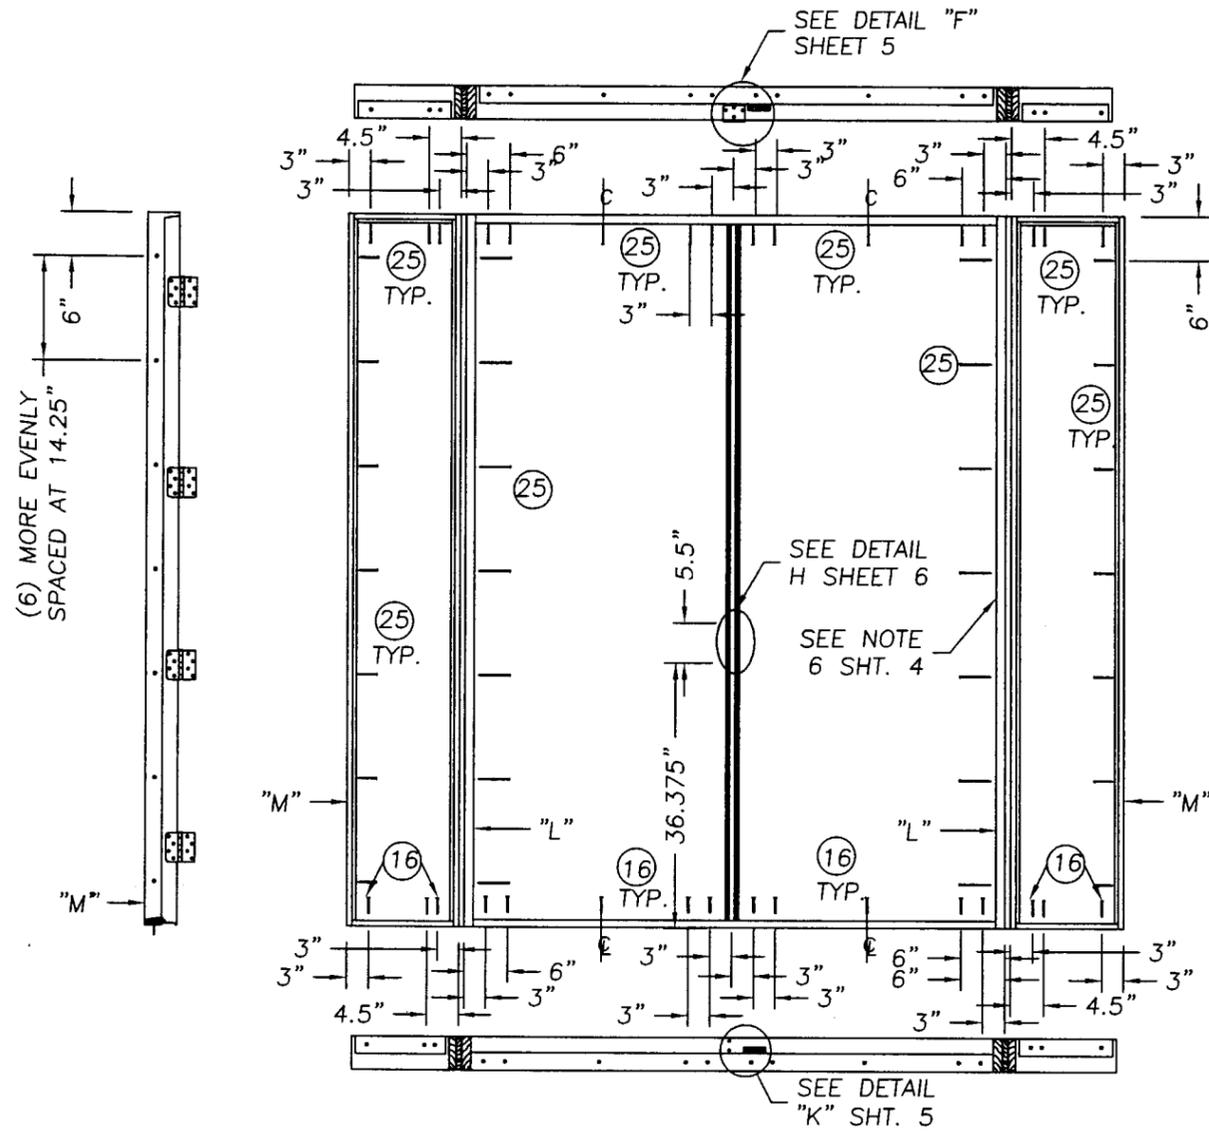


DOUBLE DOOR W/SIDELITES ANCHORING LOCATIONS

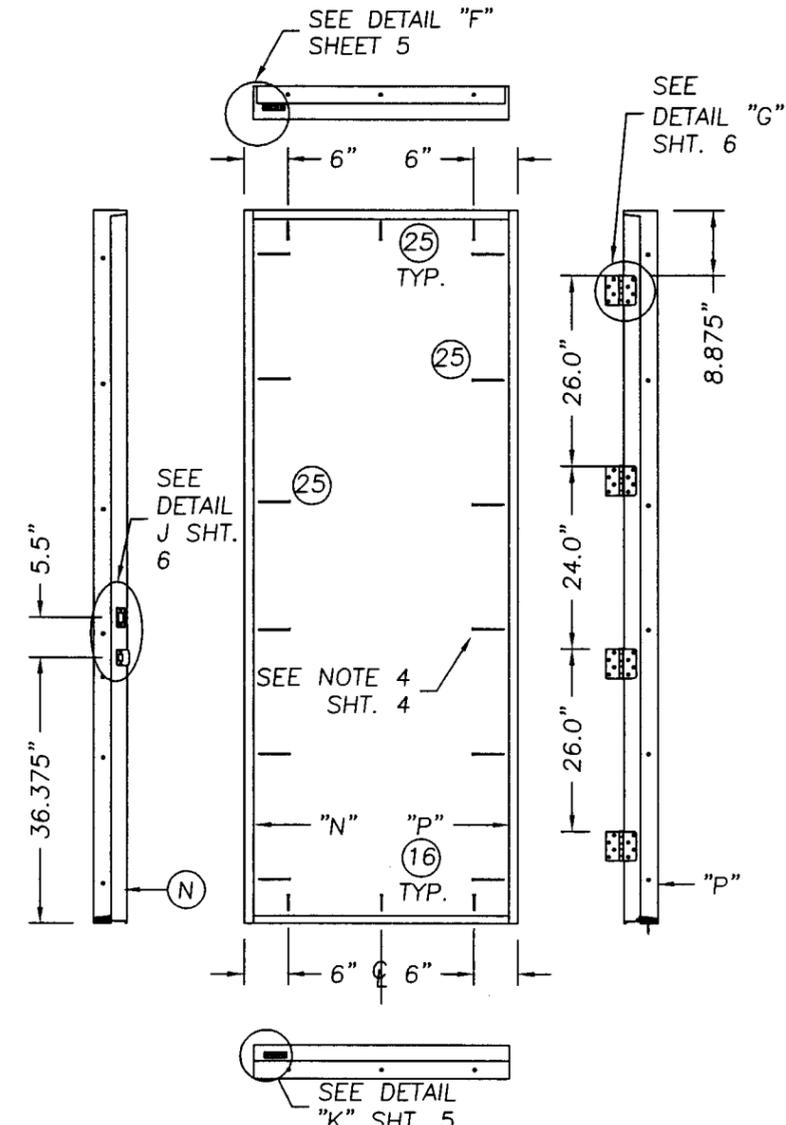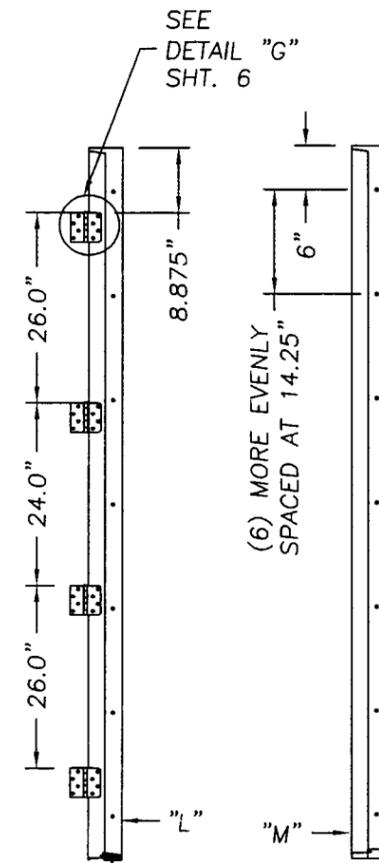


SINGLE DOOR ANCHORING LOCATIONS

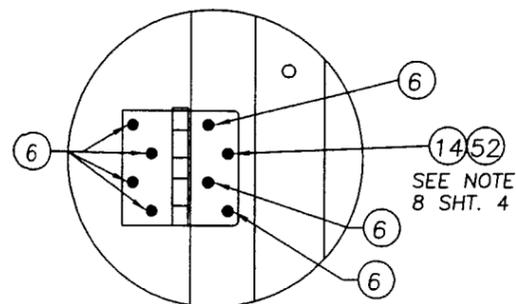

DETAIL G HINGE TO JAMBS & DOOR SEE NOTE 8 SHT. 4

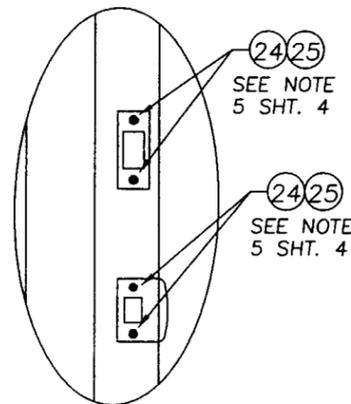

DETAIL J STRIKE PLATES TO JAMBS SEE NOTE 5 SHT. 4

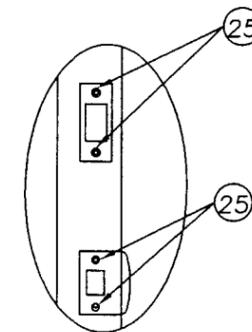

DETAIL H STRIKE PLATES TO ASTRAGAL

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057


PRODUCT: WOOD EDGE GLAZED DOOR W/ & W/OUT SIDELITES UP TO 8'4" x 8'-0" OUTSWING  
PART OR ASSEMBLY: ANCHORING LOCATIONS & DETAILS

NO.	DATE	BY	REVISIONS
3	10/23/02	ROF	ADD TRINITY FRAMES
2	06/15/02	RW	CORRECT B.O.M.
1	03/15/02	TJH	GENERAL REVISION

**RW** BUILDING CONSULTANTS, INC.  
813.659.9197


**PRODUCT REVISED**  
as complying with the Florida Building Code  
Acceptance No 02-1224.05  
Expiration Date 02/18/07  
By *[Signature]*  
Miami Product Control Division

DATE: 12/18/01  
SCALE: N.T.S.  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2109  
SHEET 6 OF 8

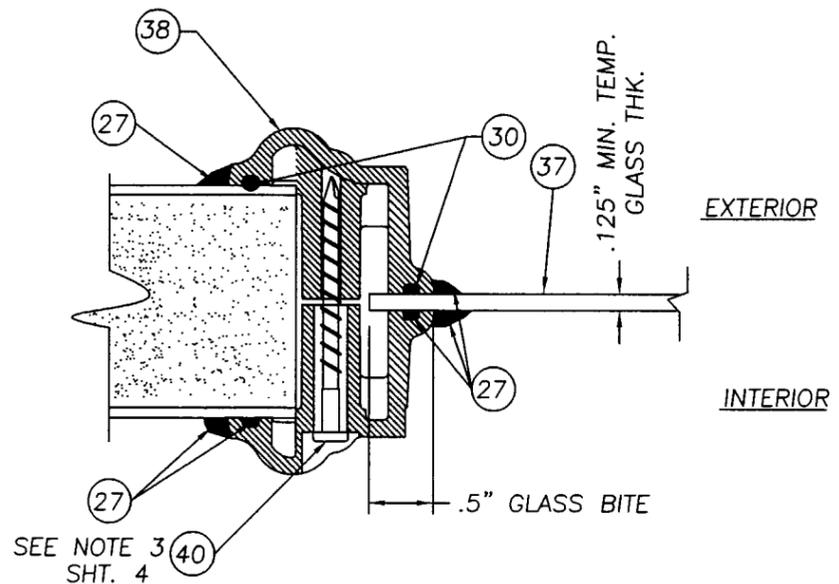


SEE NOTE 3  
SHT. 4



38 GLAZING DETAIL ODL LITE FRAME  
1/8" INSULATED TEMPERED GLASS  
HP POLYPROPYLENE  
(THERMOFIL-P6-30FM0391)

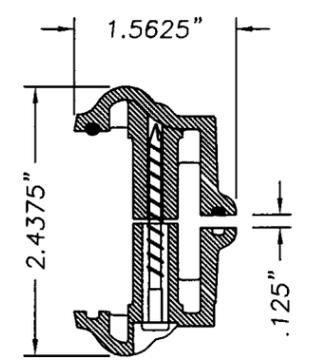

SEE NOTE 10  
SHT. 4

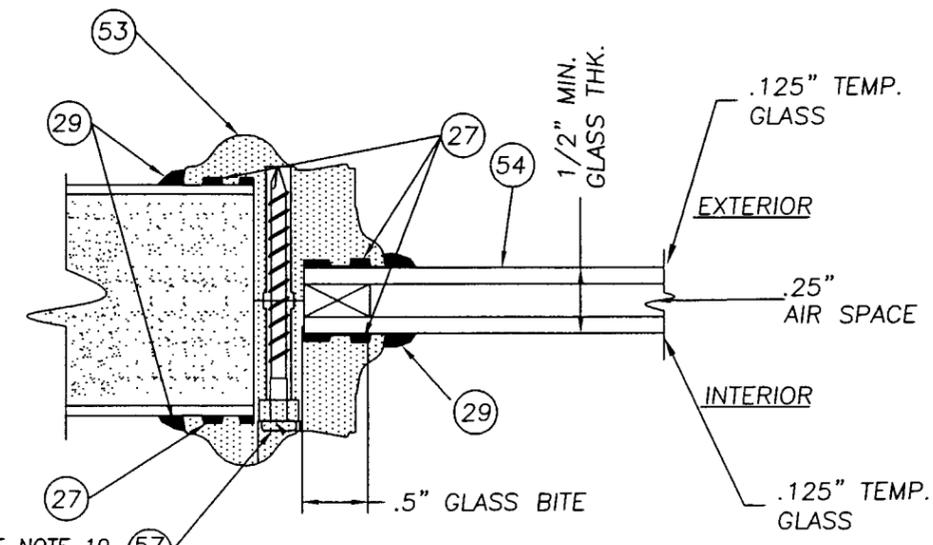


53 GLAZING DETAIL TRINITY LITE FRAME  
1/2" INSULATED TEMPERED GLASS  
LUPOY EU-5007

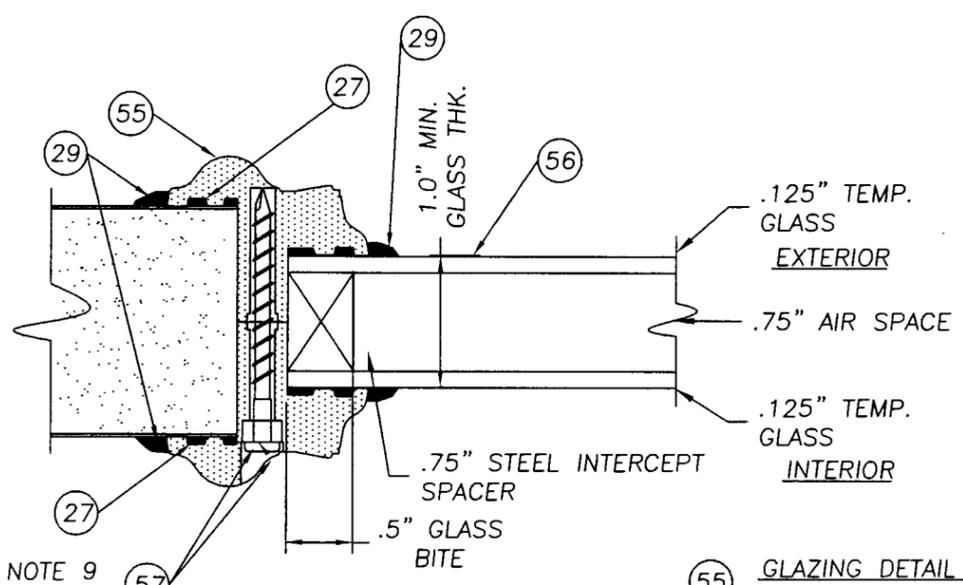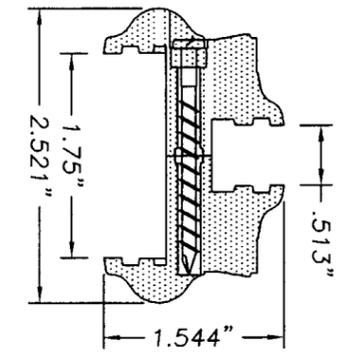

SEE NOTE 9  
SHT. 4

55 GLAZING DETAIL TRINITY LITE FRAME  
1" INSULATED TEMPERED GLASS  
LUPOY EU-5007

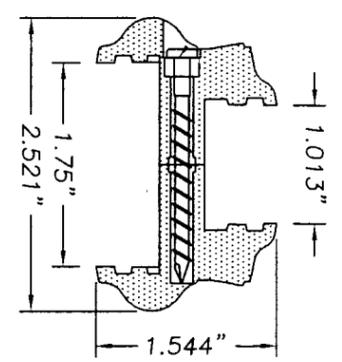

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057


PRODUCT: WOOD EDGE GLAZED DOOR  
W/ & WOUT SIDELITES  
UP TO 8'4" x 6'8" OUTSWING  
PART OR ASSEMBLY:  
GLAZING DETAILS

NO.	DATE	REVISIONS	BY
3	10/23/02	ADD TRINITY FRAME	ROF
2	06/15/02	CORRECT B.O.M.	RW
1	03/15/02	GENERAL REVISION	TJH


**RW** BUILDING  
CONSULTANTS, INC.  
813.659.9197

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No 02-1224.05  
Expiration Date 07/18/07  
By *[Signature]*  
Miami Product Control  
Division


DATE: 12/18/01  
SCALE: N.T.S.  
DWG. BY: ROF  
CHK. BY: TJH  
DRAWING NO.: S-2109  
SHEET 7 OF 8

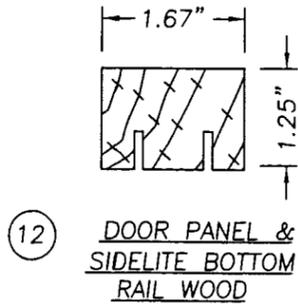


12 DOOR PANEL & SIDELITE BOTTOM RAIL WOOD




11 DOOR TOP RAIL & HINGE STILE




7 LVL LATCH STILE

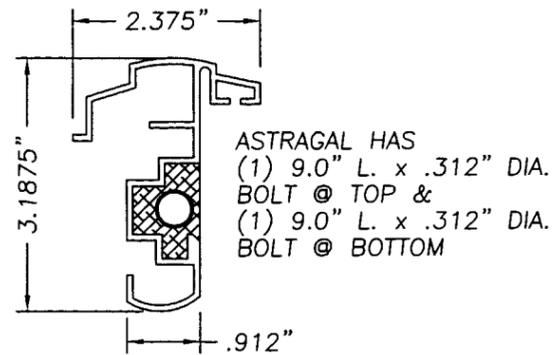


49 OPTIONAL IMPERIAL ASTRAGAL EXTRUDED ALUMINUM .075" WALL SEE DESIGN PRESSURE CHART

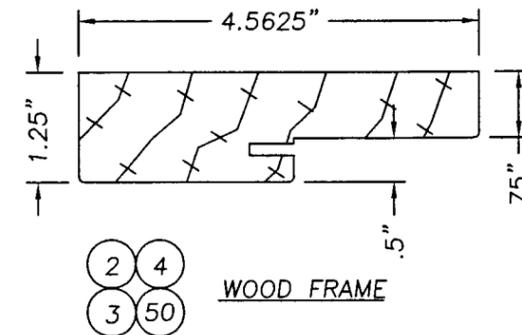


WOOD FRAME

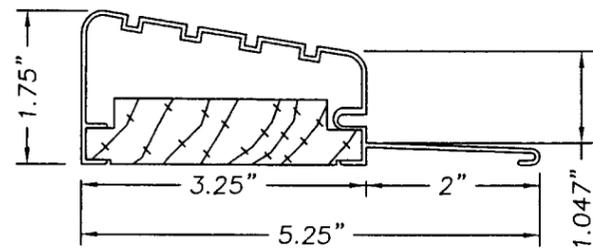


51 OUTSWING BUMP FACE ALUMINUM THRESHOLD .051" WALL THK.

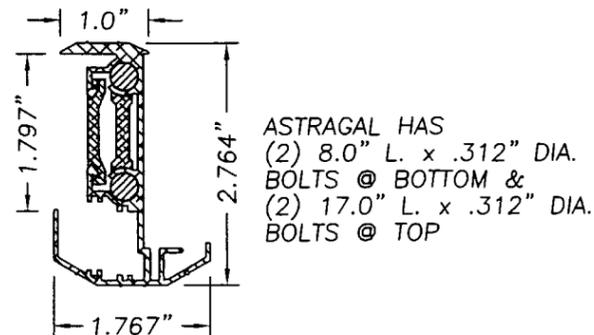

26 ASTRAGAL WINDJAMBER II (WR68J T6-6060 EXTRUDED ALUMINUM SEE DESIGN PRESSURE CHART)

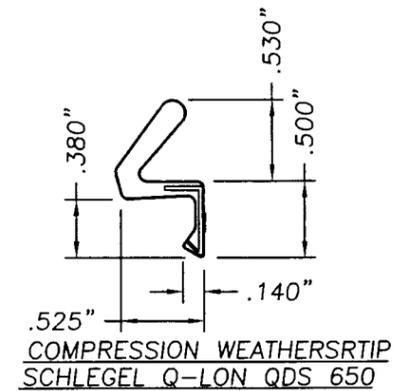


10 COMPRESSION WEATHERSR TIP SCHLEGEL Q-LON QDS 650

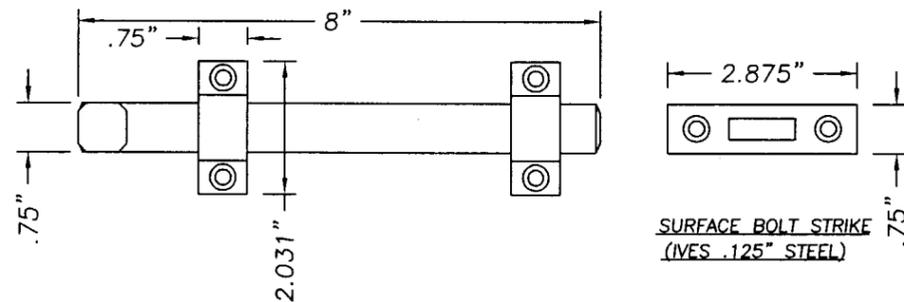


28 SURFACE BOLT (IVES .25" STEEL MODEL 454)


SURFACE BOLT STRIKE (IVES .125" STEEL)

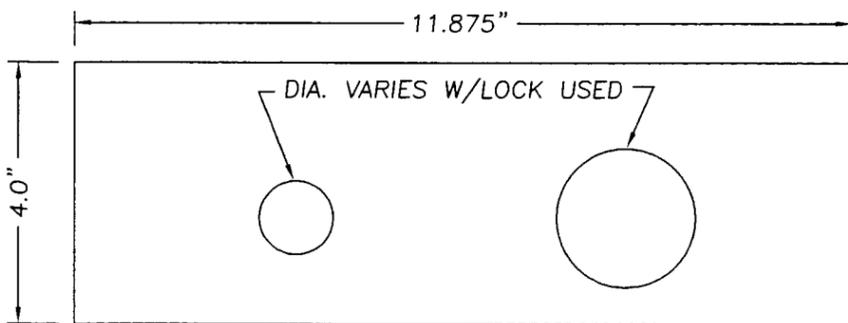

15 WOOD LOCK BLOCK, 1.71" THK.

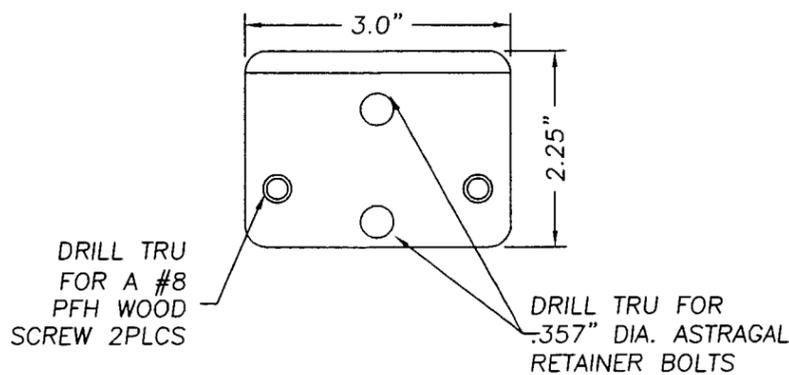

WINDJAMBER II WR68J STRIKE PLATE STEEL PLATE

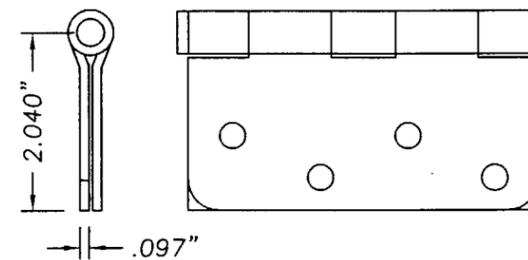

5 4 x 4 STEEL DOOR HINGE .097" THK. STEEL BY HAGER

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

PRODUCT: WOOD EDGE GLAZED DOOR W/ & W/OUT SIDELITES 8'4" x 8'0" OUTSWING

PART OR ASSEMBLY:

UNIT COMPONENTS

NO.	DATE	REVISIONS	BY
3	10/23/02	ADD TRINITY FRAME	ROF
2	06/15/02	CORRECT B.O.M.	RW
1	03/15/02	GENERAL REVISION	TJH

RW BUILDING CONSULTANTS, INC.  
813.659.9197

PRODUCT REVISED as complying with the Florida Building Code Acceptance No 02-1224.05 Expiration Date 02/15/07  
By Miami Product Control Division

DATE: 12/18/01  
SCALE: NTS  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2109  
SHEET 8 OF 8