



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Jeld-Wen, Inc.
31725 Highway 97 North
Chiloquin, OR 97624**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: "Textured/Smooth" 6'8" Inswing Opaque Insulated Fiberglass Door w/Sidelites

APPROVAL DOCUMENT: Drawing No. S-2413, dated 01/14/03, with revision #1 dated 7/2/03, titled "Textured/Smooth Fiberglass Swing Door up to 8'4 x 6'8 Inswing", sheets 1 through 8 of 8, prepared by R. W. Building Consultants, Inc., signed and sealed by Lyndon F. Schmidt, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No. 03-0130.02
Expiration Date: June 6, 2007
Approval Date: November 27, 2003
Page 1**

Jeld-Wen, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS


1. Manufacturer's die drawings and sections.
2. Drawing No. **S-2413**, dated 01/14/03, with revision #1 dated 7/2/03, titled "Textured/Smooth Fiberglass Swing Door up to 8'4 x 6'8 Inswing", sheets 1 through 8 of 8, prepared by R. W. Building Consultants, Inc., signed and sealed by Lyndon F. Schmidt, P.E.

B. TESTS

1. Test reports on 1) Air Infiltration Test, per SFBC, PA 202-94
2) Uniform Static Air Pressure Test, Loading per SFBC PA 202-94
3) Water Resistance Test, per SFBC, PA 202-94
4) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94
along with marked-up drawings and installation diagram of a "Fiber Classic" series opaque fiberglass swing door, prepared by ETC Laboratories, Test Report No. **ETC 01-741-11008.0**, dated 09/13/01, signed and sealed by Joseph L. Dolden, P.E.
2. Test reports on 1) Air Infiltration Test, per SFBC, PA 202-94
2) Uniform Static Air Pressure Test, Loading per SFBC PA 202-94
3) Water Resistance Test, per SFBC, PA 202-94
4) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94
along with marked-up drawings and installation diagram of a "Smooth Star" series opaque fiberglass swing door, prepared by ETC Laboratories, Test Report No. **ETC 01-741-10700.0**, dated 08/24/01, signed and sealed by Wendell Haney P.E.
3. Test reports on 1) Air Infiltration Test, per SFBC, PA 202-94
2) Uniform Static Air Pressure Test, Loading per SFBC PA 202-94
3) Water Resistance Test, per SFBC, PA 202-94
4) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94
along with marked-up drawings and installation diagram of a "Fiber Classic" series opaque fiberglass swing door, prepared by ETC Laboratories, Test Report No. **ETC 01-741-10702.0**, dated 08/06/01, signed and sealed by Wendell Haney, P.E.

C. CALCULATIONS

1. Anchor Calculations and structural analysis dated 11/07/01, prepared, signed and sealed by Lyndon F. Schmidt, P.E.

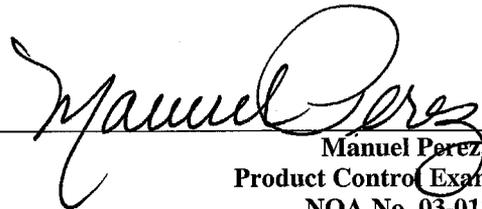

Manuel Perez P.E.
Product Control Examiner
NOA No. 03-0130.02
Expiration Date: June 6, 2007
Approval Date: November 27, 2003

Jeld-Wen, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **03-0908.02** issued to Jeld-Wen, Inc. for "Textured and Smooth Fiberglass Door Skin" dated 11/13/03, expiring on 01/18/07.
2. Notice of Acceptance No. **01-1120.08** issued to Therma-Tru Corporation for "Therma-Tru Series "BTS, TCM, PVC, SMC" Lite Frames" dated 01/18/02, expiring on 01/18/07.

F. STATEMENTS

1. Statement letter of conformance and no financial interest, dated November 7, 2001, signed and sealed by Lyndon F. Schmidt, P.E.
2. Statement letter of no financial interest, dated April 16, 2001, signed by Steven Kepler.

G. OTHER

1. None.

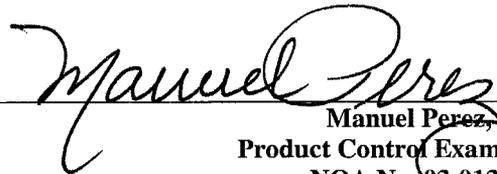

Manuel Perez, P.E.
Product Control Examiner
NOA No. 03-0130.02
Expiration Date: June 6, 2007
Approval Date: November 27, 2003

JELD-WEN® FIBERGLASS

CHILOQUIN, OR. 97624 PH. 541.783.2057

TEXTURED/SMOOTH FIBERGLASS DOOR SYSTEM 6'8 INSWING SINGLE & DOUBLE W/NO SIDELITES

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO COMPLY WITH THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. DESIGNED PRESSURE RATING SEE TABLE PAGE 1.
5. THIS PRODUCT DOES NOT MEET THE WATER REQUIREMENTS FOR "HIGH VELOCITY HURRICANE ZONES."
6. WHEN THIS PRODUCT IS USED IN AREA REQUIRING WINDBORNE DEBRIS PROTECTION, FLORIDA BUILDING CODE APPROVED IMPACT RESISTANT SHUTTERS ARE REQUIRED.
7. SIDELITES ARE AN OPTION AND CAN BE USED IN A SINGLE OR DOUBLE CONFIGURATION.

RESIDENTIAL INSULATED FIBERGLASS DOOR (Common to all frame conditions)

Door & Sidelite Leaf Construction:

Face sheets: Fiberglass avg. min. yield strength $F_y(\min) = 6,000$ psi
Smooth Series - 0.070" minimum skin thickness
Textured Series - 0.110" minimum skin thickness

Core design: Polyurethane foam core, with 1.9 lbs. density (BASF)

Panel Construction: The panel skin is constructed from Sheet Molding Compound (SMC). The interior cavity is filled with BASF polyurethane foam. The panel face sheets are glued to the wood stiles and rails. The LVL latch stiles are reinforced with a wood lock block measuring 2-3/8" x 14" long at the strike and deadbolt location. The hinge stile is Finger Jointed Pine and the top and bottom rail are of a wood composite material. In the double door application the inactive door is fitted with an extruded aluminum (6060-T6) astragal (Wind Jamber II).

Frame Construction: The frame is constructed from finger jointed pine. The header is joined to the side jambs with (3) 16ga. 1/2" crown x 2" long staples at each side. The sidelites are secured to door jambs with #8 x 2" long PFH Wood Screws (6) screws per each jamb. The units use an Inswing Saddle threshold measuring 5-3/4" x 1-1/2".

Sidelite Glazing: The sidelite panels are sandwich glazed using a two piece lip lit frame. They are dry glazed on the exterior with an 1/8" thick cellular glazing tape, (Stik-It Tape) & caulked with silicone. The lite frames are held together with #8 x 1 1/2" long Plascrews.

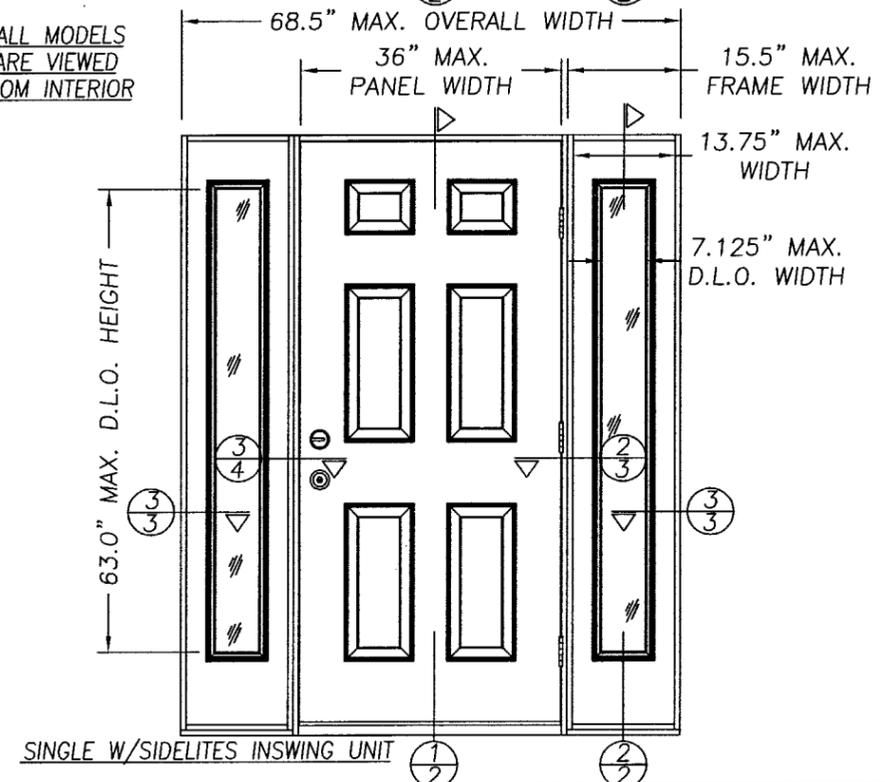
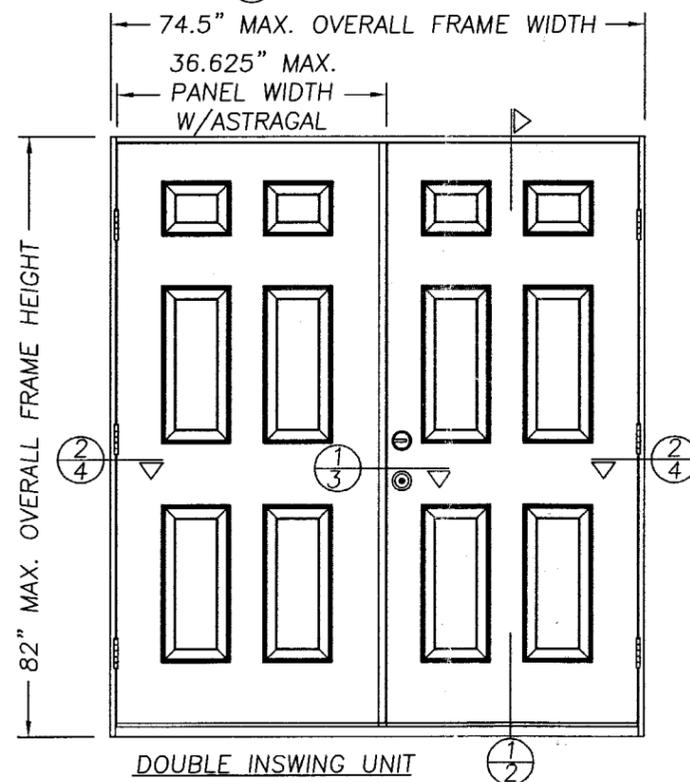
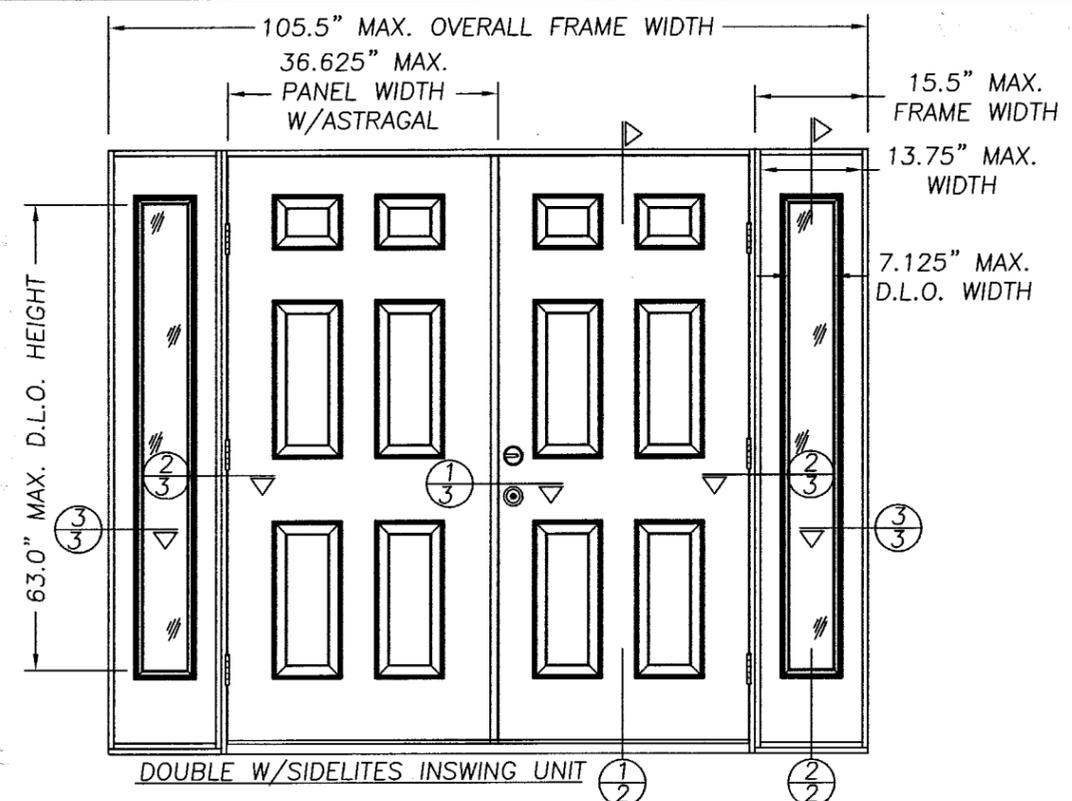
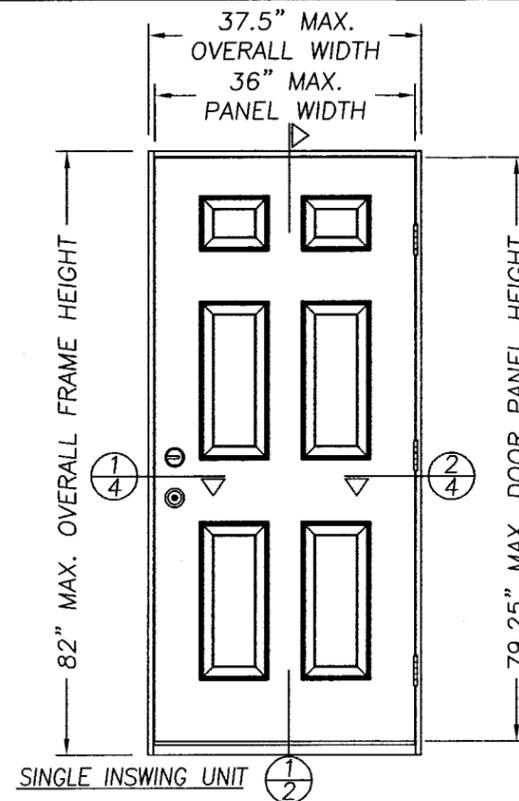


TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	TYPICAL ELEVATIONS & GENERAL NOTES
2	VERTICAL CROSS SECTIONS
3	HORIZONTAL CROSS SECTIONS
4	HORIZONTAL CROSS SECTIONS & NOTES
5	ANCHORING LOCATIONS & DETAILS
6	ANCHORING LOCATIONS & GLAZING DETAILS
7	UNIT COMPONENTS
8	BILL OF MATERIALS & UNIT COMPONENTS

DESIGN PRESSURE RATING		
UNIT TYPE	WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED	
SINGLE	+ 67.0 PSF	- 67.0 PSF
DOUBLE	+ 55.0 PSF	- 55.0 PSF
SINGLE & DOUBLE WITH SIDELITES	+ 55.0 PSF	- 55.0 PSF

Approved as complying with the Florida Building Code
Date: Nov. 27, 2003
NOA# 03-0130.02
Miami Dade Product Control
Division
By: *[Signature]*


DATE:	1/14/03
SCALE:	N.T.S.
DWG. BY:	ROF
CHK. BY:	RW
DRAWING NO.:	S-2413
SHEET	1 OF 8

Product Approval Documents Prepared By:
RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197
Florida Board of Professional Engineers
Certificate Of Authorization No. 9813
Lyndon F. Schmidt, P.E. NO. 43409 10/31/03


PRODUCT: TEXTURED/SMOOTH FIBERGLASS SWING DOOR UP TO 8'4" x 6'8" INSWING
PART OR ASSEMBLY:
TYPICAL ELEVATIONS & GENERAL NOTES

NO.	DATE	PER DATE COMMENTS	RW	BY
1	7/2/03	PER DATE COMMENTS	RW	BY

REVISIONS

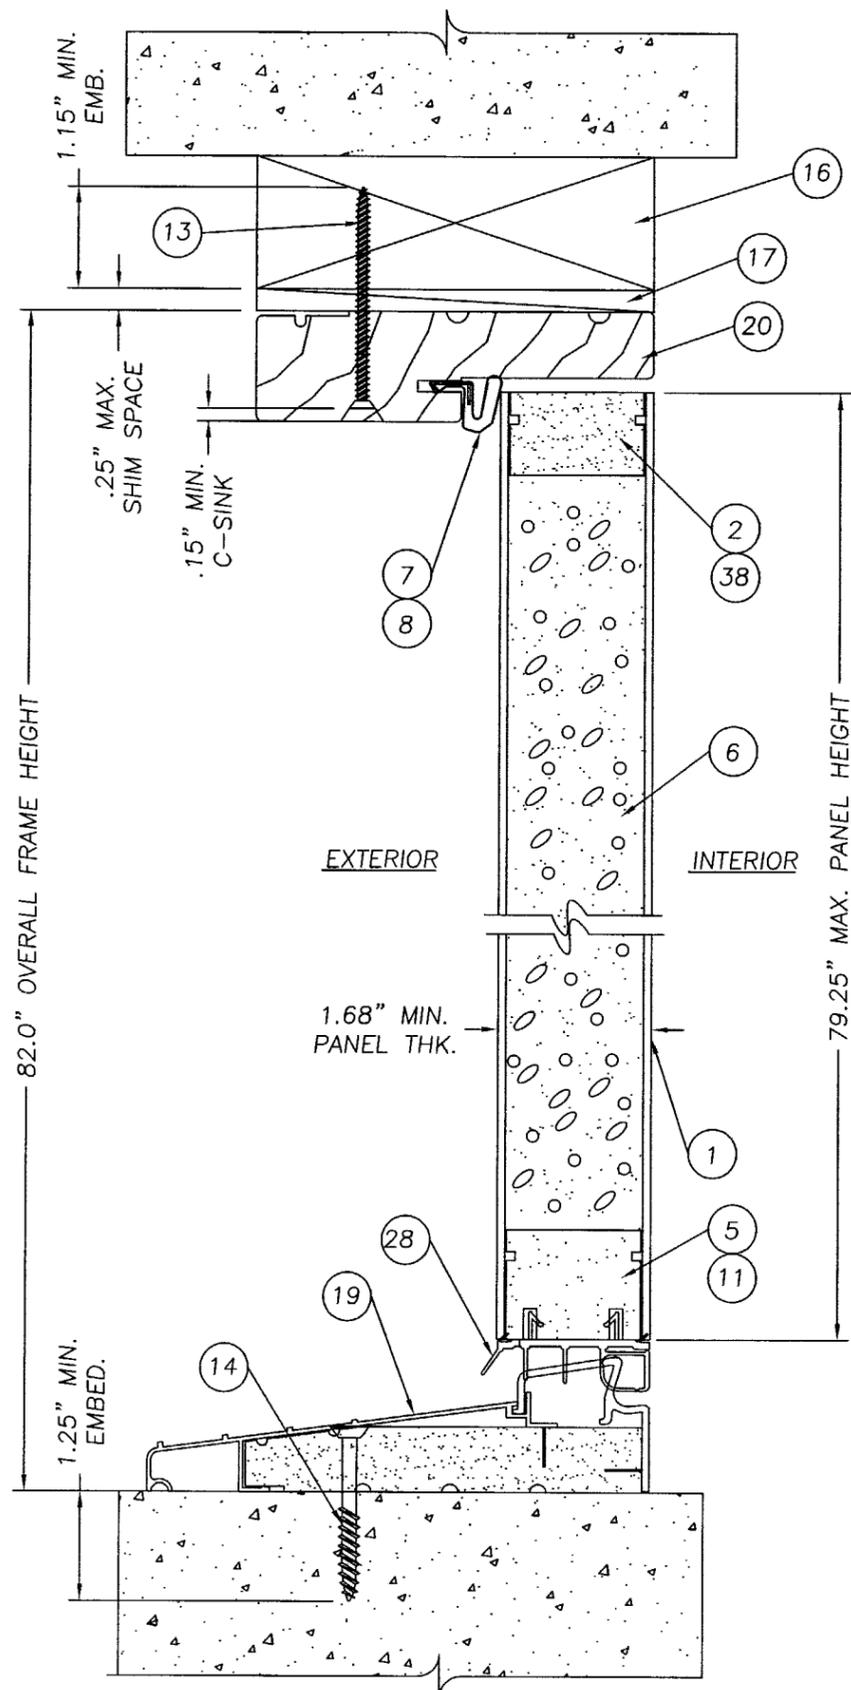

1 VERTICAL CROSS SECTION
2 DOOR PANEL

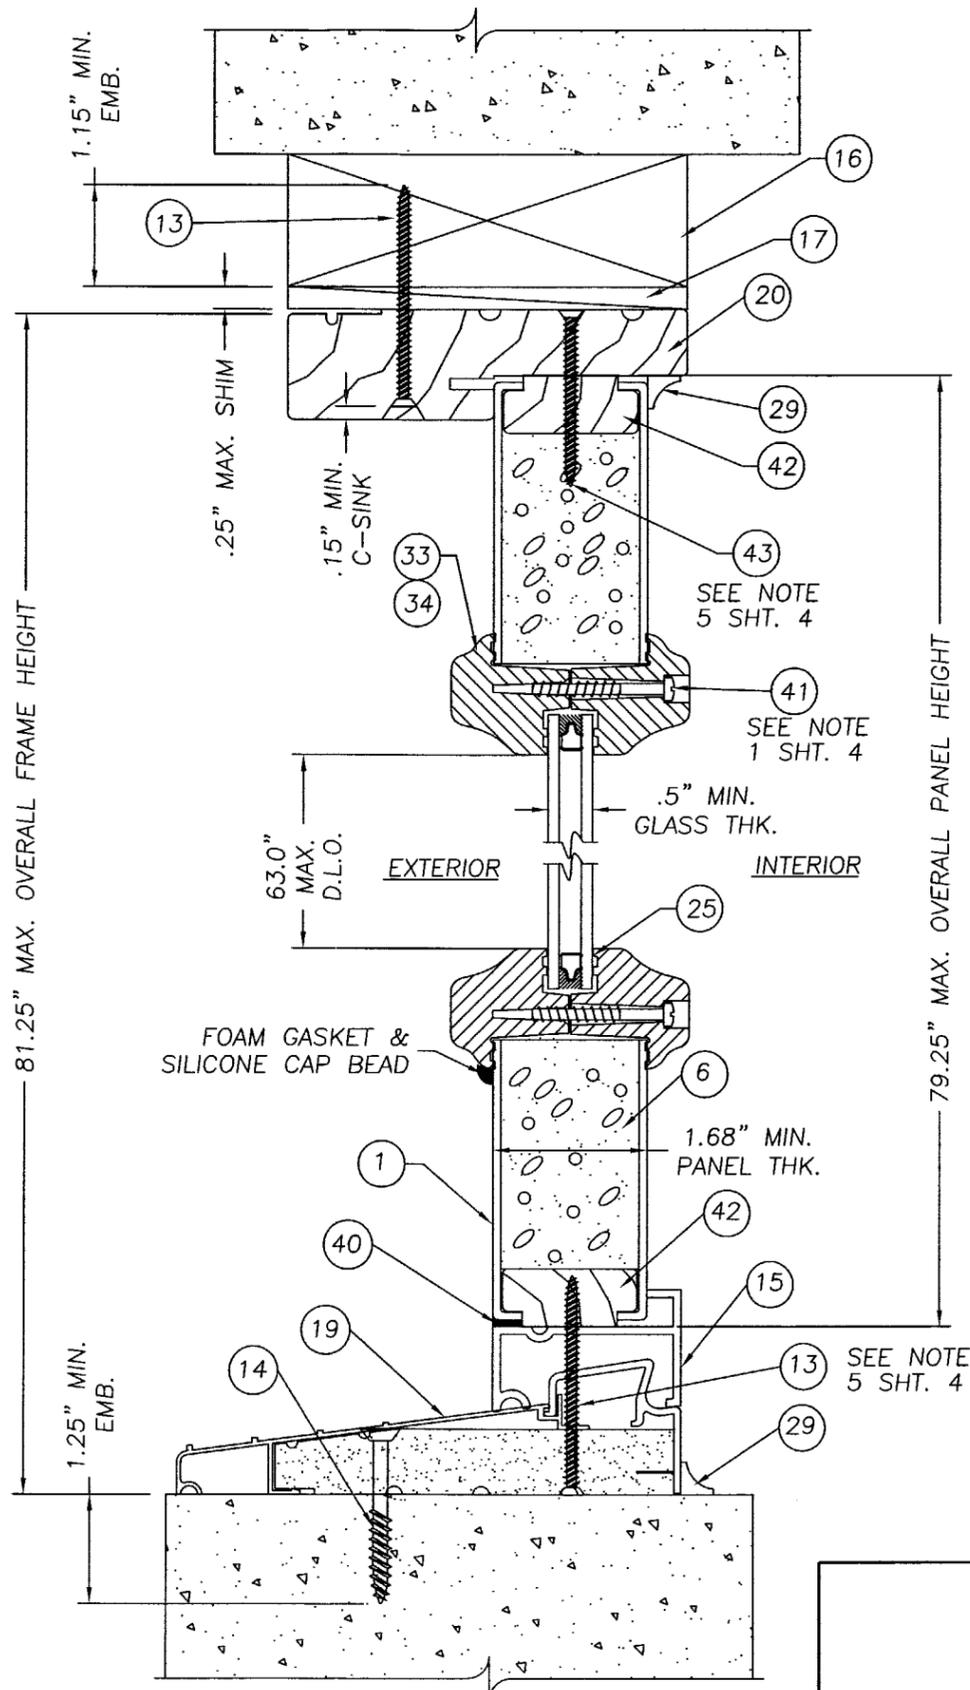

2 VERTICAL CROSS SECTION
2 SIDELITE PANEL


Approved as complying with the
Florida Building Code
Date **Nov. 27, 2003**
NOA# **03-0130.02**
Miami Dade Product Control
Division
By *Manuel Lopez*

DATE: 1/14/03
SCALE: N.T.S.
DWG. BY: ROF
CHK. BY: RW
DRAWING NO.: S-2413
SHEET 2 OF 8

PRODUCT: TEXTURED/SMOOTH
FIBERGLASS SWING DOOR
UP TO 8'4" x 6'8" IN SWING
PART OR ASSEMBLY: VERTICAL CROSS
SECTIONS

NO.	DATE	PER DADE COMMENTS	BY
1	7/2/03		RW

Product Approval Documents Prepared By:
RW
BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197
Florida Board of Professional Engineers
Certificate Of Authorization No. 9813
Lyndon F. Schmidt, P.E. NO. 43409 10/31/03

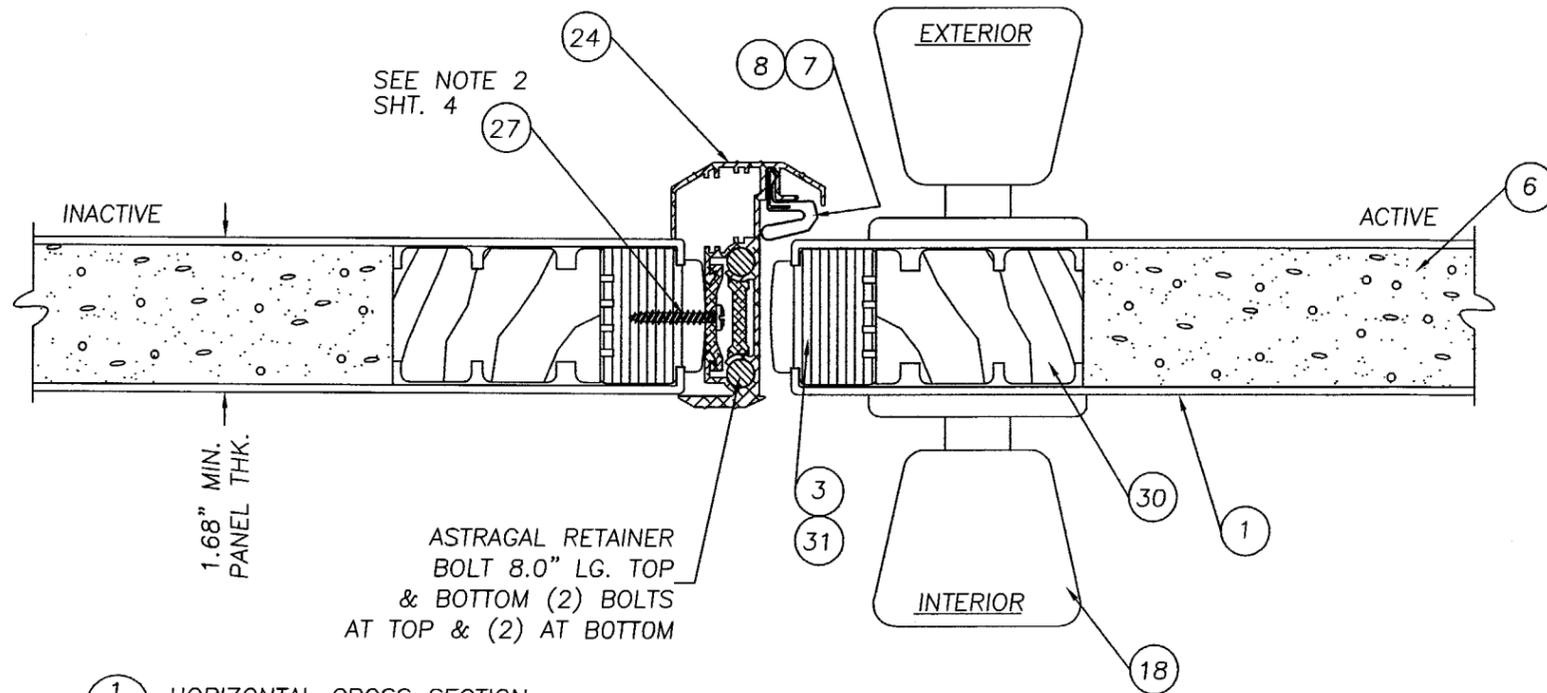


SEE NOTE 2
SHT. 4


1.68" MIN.
PANEL THK.

ASTRAGAL RETAINER
BOLT 8.0" LG. TOP
& BOTTOM (2) BOLTS
AT TOP & (2) AT BOTTOM

1 HORIZONTAL CROSS SECTION
3 @ ASTRAGAL

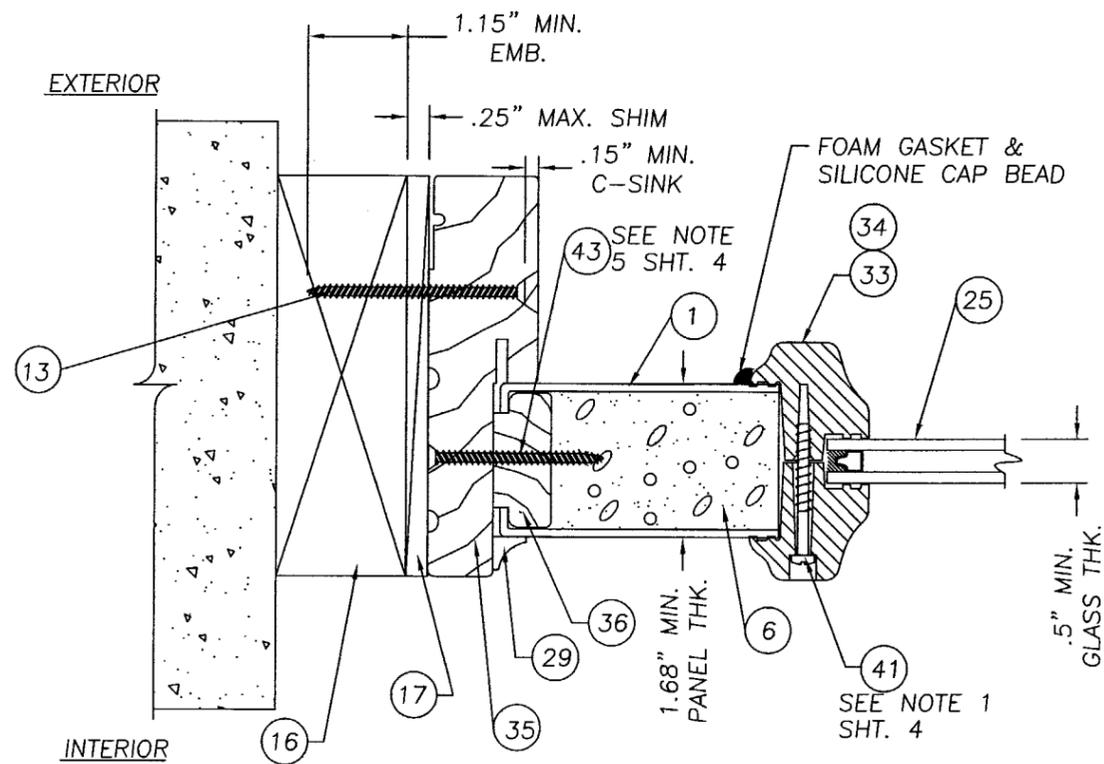

3 HORIZONTAL CROSS SECTION
3 @ SIDELITE TO BUCK

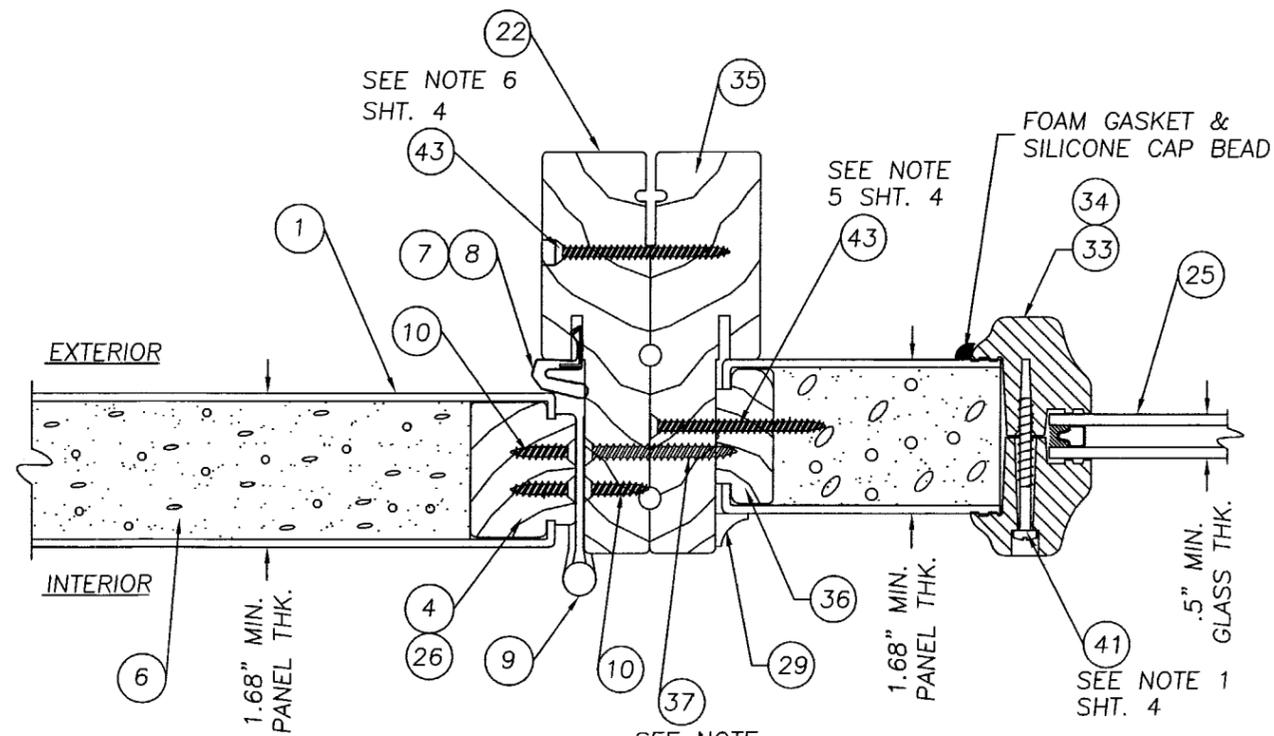

2 HORIZONTAL CROSS SECTION
3 @ HINGE JAMB TO SIDELITE


Product Approval Documents Prepared By:
RW
BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL, 33595
Phone No.: 813.659.9197
Florida Board of Professional Engineers
Certificate Of Authorization No. 9813
10/31/03
Lyndon F. Schmidt, P.E. NO. 43409

PRODUCT:
TEXTURED/SMOOTH
FIBERGLASS SWING DOOR
UP TO 8'4" x 6'8" INSWING
PART OR ASSEMBLY:
HORIZONTAL CROSS
SECTIONS


NO.	DATE	PER DATE	COMMENTS	BY	REVISIONS
1	7/2/03			RW	

Approved as complying with the
Florida Building Code
Date **Nov. 27, 2003**
NOA# **03-0130.02**
Miami Dade Product Control
Division
By *Manuel Pera*


DATE: 1/14/03
SCALE: N.T.S.
DWG. BY: ROF
CHK. BY: RW
DRAWING NO.: S-2413
SHEET 3 OF 8

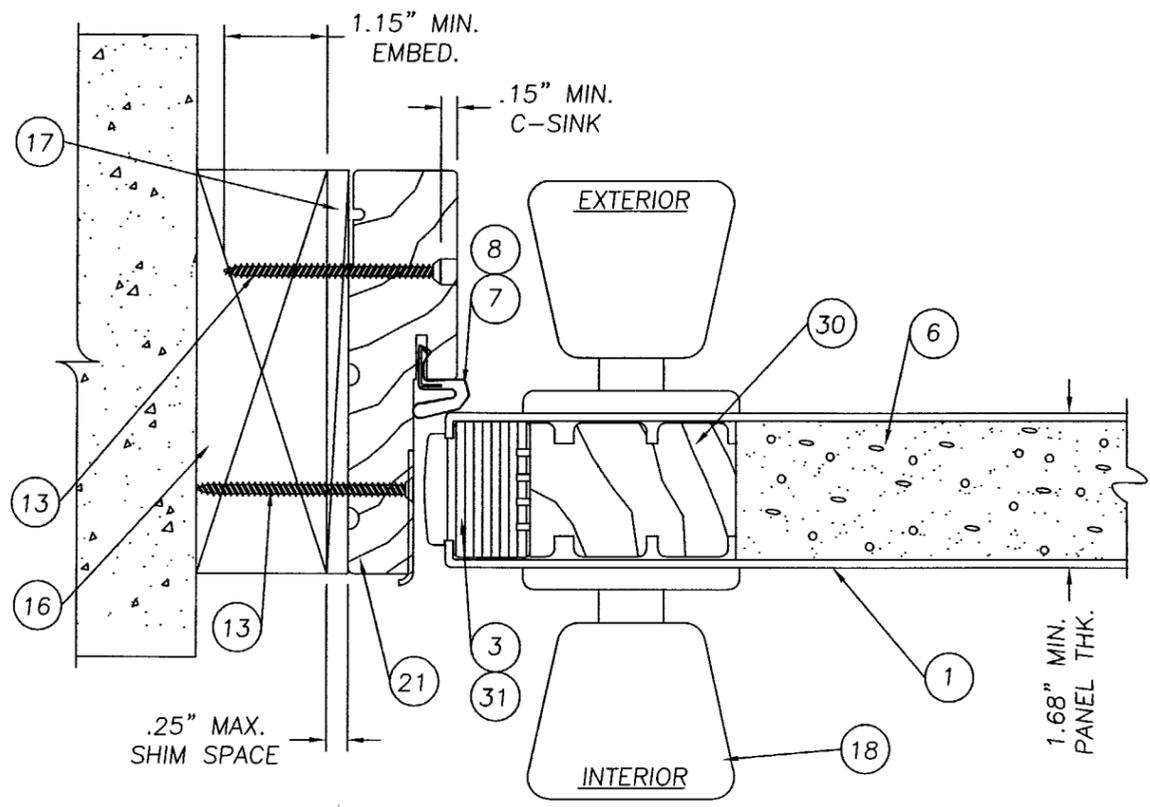

1 HORIZONTAL CROSS SECTION
4 LATCH JAMB TO BUCK,

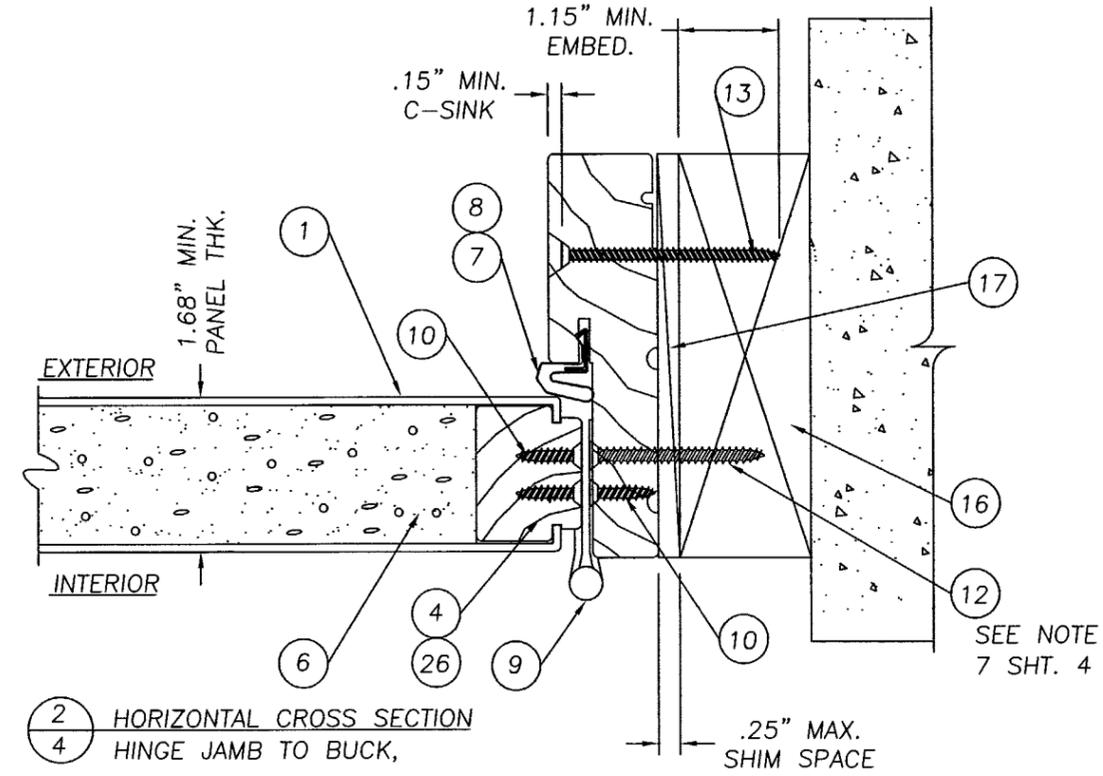

2 HORIZONTAL CROSS SECTION
4 HINGE JAMB TO BUCK,

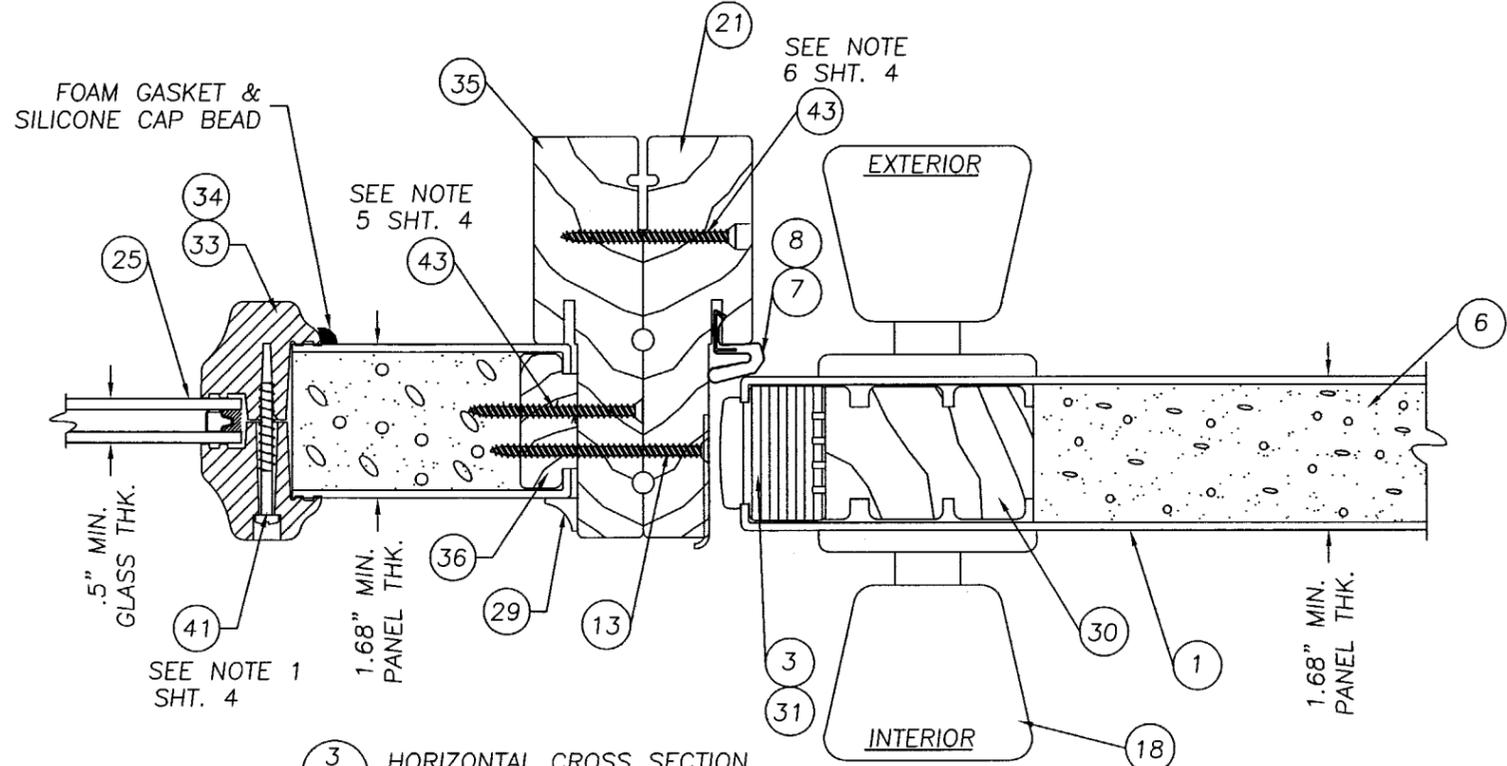

3 HORIZONTAL CROSS SECTION
4 @ STRIKE JAMB TO SIDELITE

- NOTES:
1. SPACING FOR ITEM NO. 41 (LITE FRAME SCREWS) IS AS FOLLOWS: VERTICAL FROM THE TOP DOWN ON SIDES; 5.5", 16.5", 27.5", 38.375", 49.375" & 60.375". HORIZONTAL THERE ARE (2) SCREWS TOP AND BOTTOM AT 2.125" IN FROM EACH CORNER.
 2. SPACING FOR ITEM NO. 27 (#8 x 1" PANHEAD SCREW) ATTACHING THE ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS: FROM THE TOP DOWN 1", 3", 5", 18.25", 40.5", 59.25", 74.25", 76.25" & 78.25".
 3. THE HEAD JAMB IS ATTACHED TO THE SIDE JAMBS WITH (3) 16GA. x 1/2" CROWN x 2" STAPLES AT BOTH SIDE.
 4. THE THRESHOLD IS ATTACHED TO THE SIDE JAMBS WITH (2) 16GA. x 1/2" CROWN x 2.5" STAPLES AT BOTH SIDE.
 5. THE SIDELITE IS DIRECT SET INTO THE JAMB WITH (12) ITEM NO. 43 (#8 x 2" PFH. WOOD SCREW). THERE ARE (4) AT EACH VERTICAL JAMB, FROM THE TOP DOWN AT 13.5", 31", 48.5" & 66". THERE ARE (2) AT THE HEADER AT 4" IN FROM THE OUTSIDE CORNERS OF THE FRAME. THERE ARE (2) AT THE SILL, 4" IN FROM THE OUTSIDE CORNERS.
 6. SPACING FOR ITEM NO. 43 (#8 x 2" SCREW) SECURING THE MULLIONS TOGETHER IS THE SAME AS THE PERIMETER ANCHORING SCREWS. 6" DOWN FROM THE TOP AND UP FROM THE BOTTOM WITH (4) MORE SPACED AT 13.7" O.C.
 7. WHEN ATTACHING THE HINGE TO THE JAMB AND THE BUCK USE ITEM NO. 12 (#10 x 2" SCREW). WHEN ATTACHING THE HINGE TO THE JAMB AND THE SIDELITE AT THE MULLION USE ITEM NO. 37 (#10 x 1 3/4" SCREW).


Product Approval Documents Prepared By:
RW BUILDING CONSULTANTS, INC.
 P.O. Box 230 Valrico FL 33595
 Phone No.: 813.659.9197
 Florida Board of Professional Engineers
 Certificate of Authorization No. 9813
 10/31/03
 Lyndon F. Schmidt, P.E. NO. 43409

PRODUCT: TEXTURED/SMOOTH
 FIBERGLASS SWING DOOR
 UP TO 8'4" x 6'8" INSWING
 PART OR ASSEMBLY:
 HORIZONTAL CROSS SECTIONS


NO.	DATE	PER DATE COMMENTS	RW	BY
1	7/2/03			

DATE: 1/14/03
 SCALE: N.T.S.
 DWG. BY: ROF
 CHK. BY: RW
 DRAWING NO.: S-2413
 SHEET 4 OF 8


Approved as complying with the
 Florida Building Code
 Date Nov 27, 2003
 NOA# 03-0130.02
 Miami Dade Product Control
 Division
 By Manuel Perez

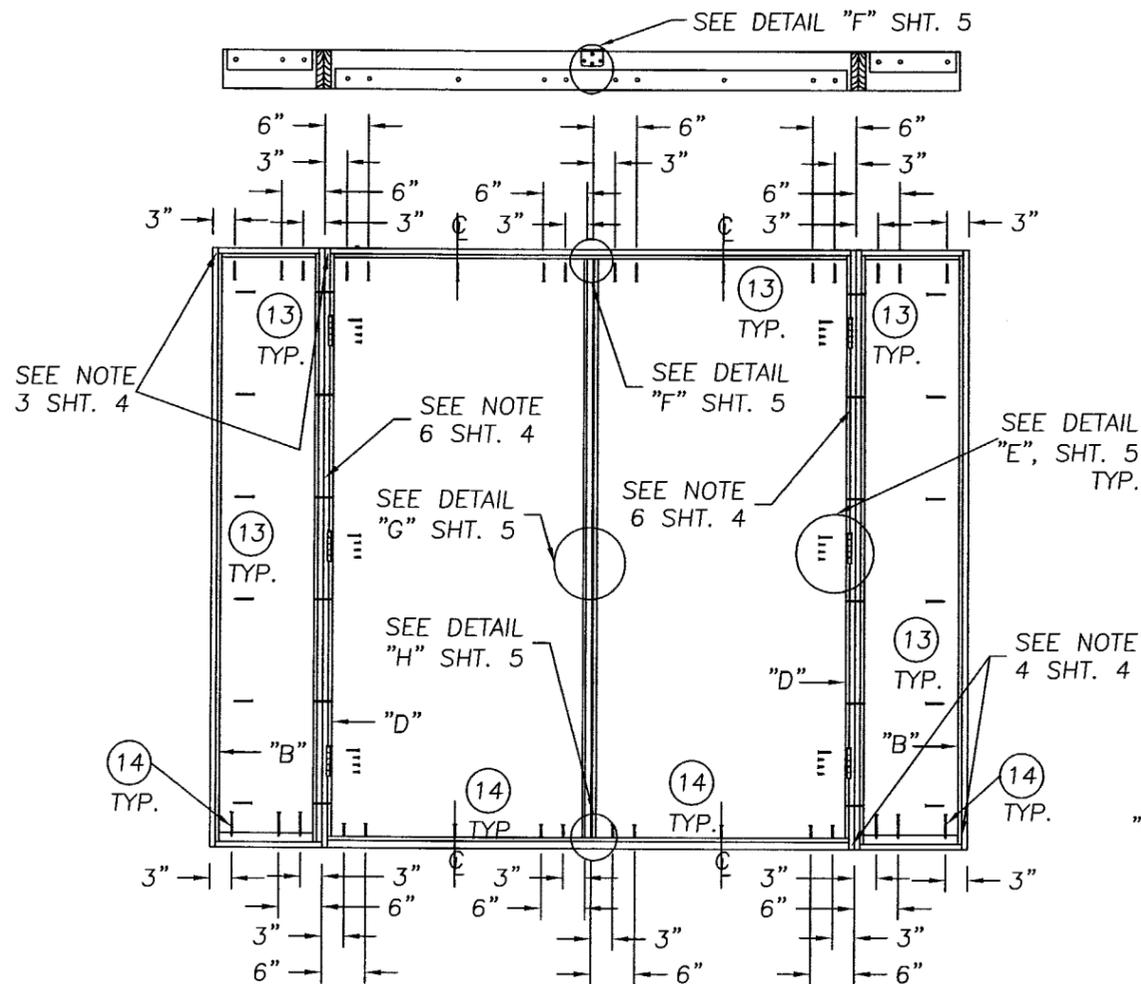



DOUBLE DOOR W/SIDELITES

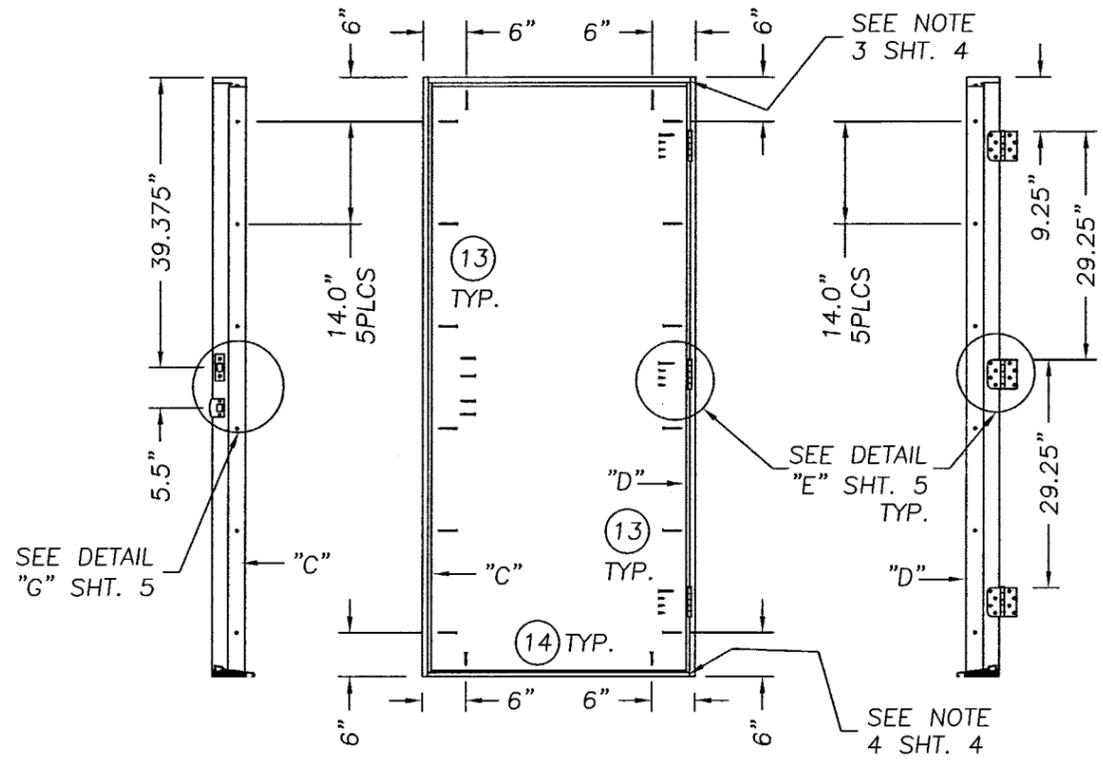

SINGLE DOOR

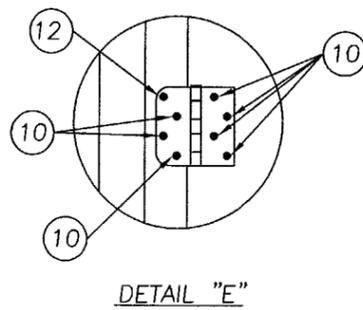


DETAIL "E"

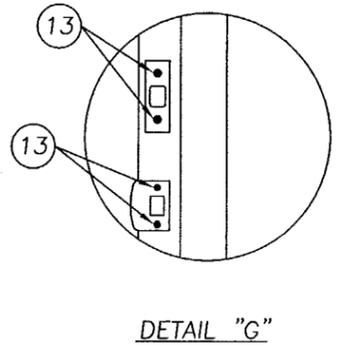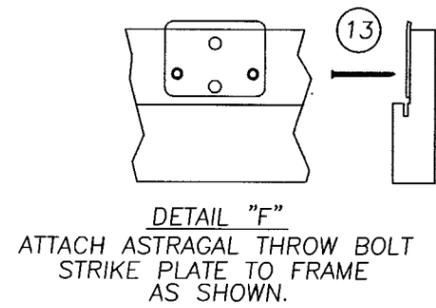

DETAIL "G"

DRILL THRU FOR A $\phi.357$ " BOLT DEEP ENOUGH FOR A 2" BOLT THROW

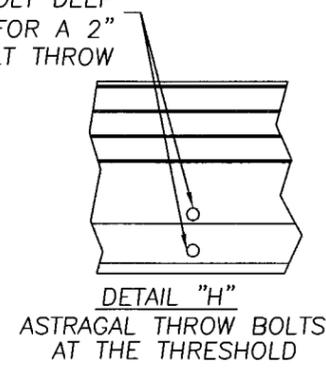

DETAIL "H" ASTRAGAL THROW BOLTS AT THE THRESHOLD


Product Approval Documents Prepared By:
RW BUILDING CONSULTANTS, INC.
 P.O. Box 230 Valrico FL 33595
 Phone No.: 813.659.9197
 Florida Board of Professional Engineers
 Certificate of Authorization No. 9813
 10/31/03
 Lyndon F. Schmidt, P.E. NO. 43409

PRODUCT: TEXTURED/SMOOTH FIBERGLASS SWING DOOR UP TO 8'4" x 6'8" INSWING
 PART OR ASSEMBLY: ANCHORING LOCATIONS & DETAILS


NO.	DATE	PER	DADE COMMENTS	RW	BY
1	7/2/03				

DATE: 1/14/03
 SCALE: N.T.S.
 DWG. BY: ROF
 CHK. BY: RW
 DRAWING NO.: S-2413
 SHEET 5 OF 8


Approved as complying with the Florida Building Code
 Date NOV. 27, 2003
 NOA# 03-0130-02
 Miami Dade Product Control Division
 By *Manuel Perez*

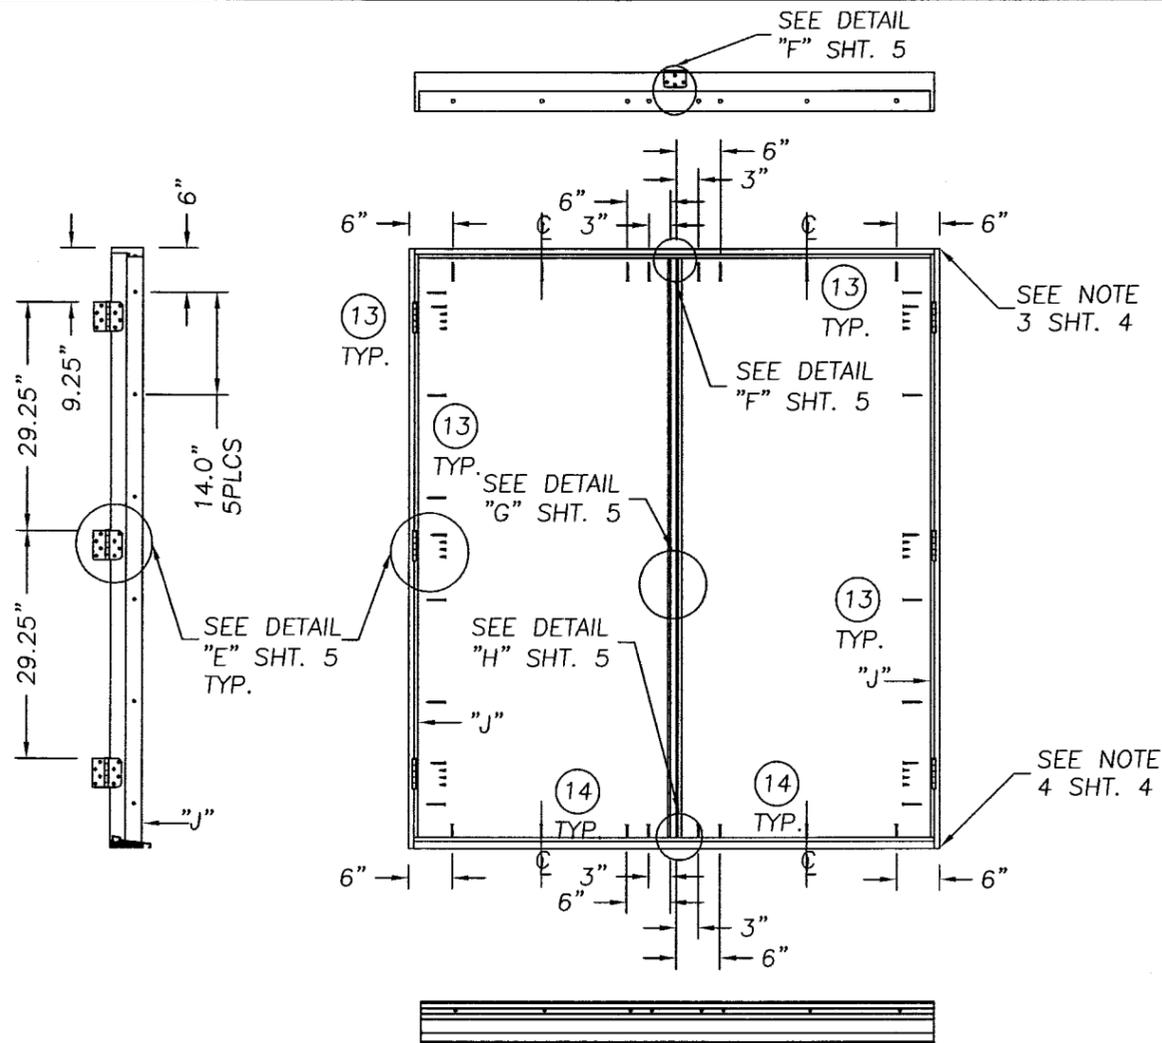


DOUBLE DOOR

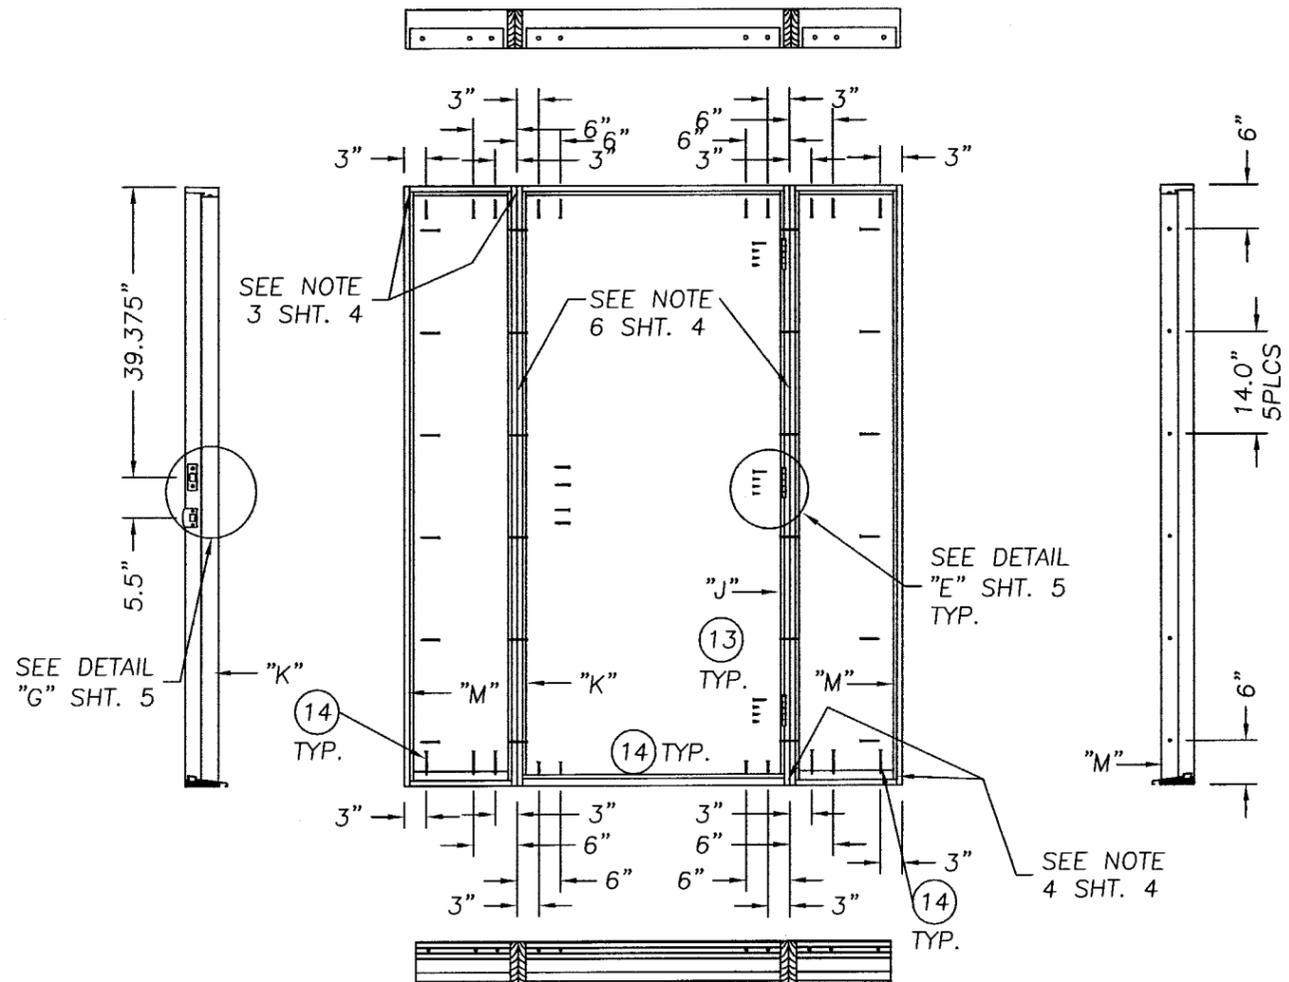

SINGLE DOOR W/SIDELITES

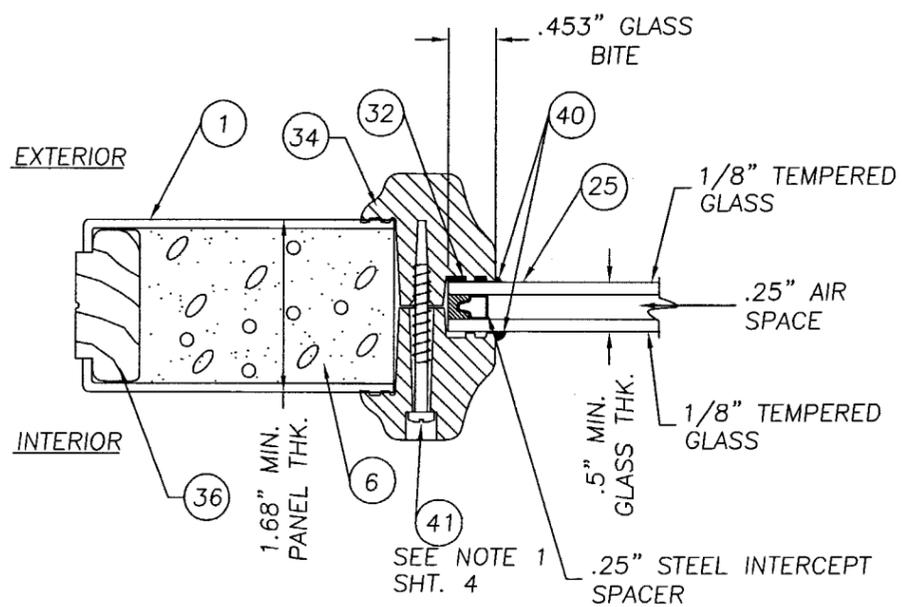


5" INSULATED GLASS W/
TCM LITE FRAME GLAZING DETAIL

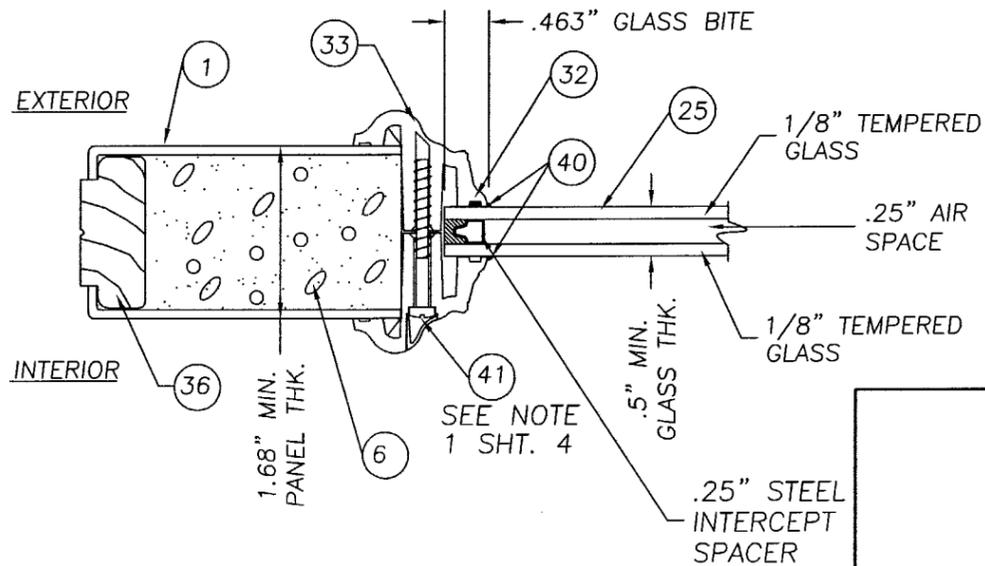


5" INSULATED GLASS W/
BTS LITE FRAME GLAZING DETAIL

Approved as complying with the
Florida Building Code
Date **Nov. 21, 2003**
NOA# **03-0130.02**
Miami Dade Product Control
Division
By *Manuel Perez*


Product Approval Documents Prepared By: RW BUILDING CONSULTANTS, INC. P.O. Box 230 Valrico FL 33595 Phone No.: 813.659.9197 Florida Board of Professional Engineers Certificate Of Authorization No. 9813 10/31/03 Lyndon F. Schmidt, P.E. NO. 43409			
PRODUCT: TEXTURED/SMOOTH FIBERGLASS SWING DOOR UP TO 8'4" x 6'8"	PART OR ASSEMBLY: ANCHORING LOCATIONS & DETAILS		
NO.	DATE	PER DATE COMMENTS	BY
1	7/2/03	PER DATE COMMENTS	RW
			BY
REVISIONS			
DATE: 1/14/03		SCALE: N.T.S.	
DWG. BY: ROF		CHK. BY: RW	
DRAWING NO.: S-2413		SHEET 6 OF 8	

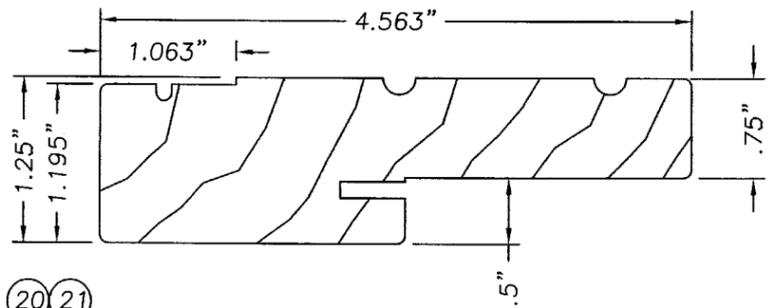


20 21
22 35
WOOD FRAME
FINGER JOINTED PONDEROSA PINE

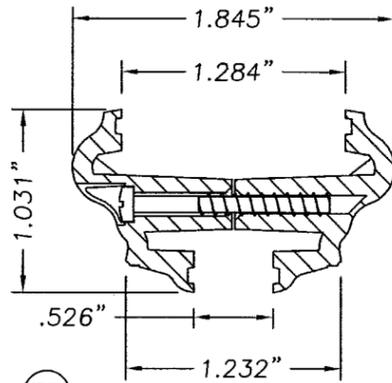


33
PLASTIC LIP LITE FRAME
EXTRUDED BTS

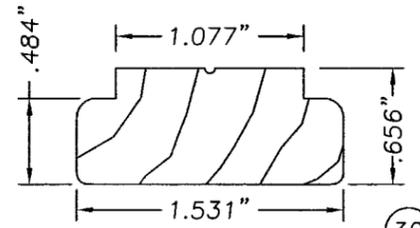


36
SIDELITE BLANK SIDE STILE
FINGER JOINTED PONDEROSA PINE

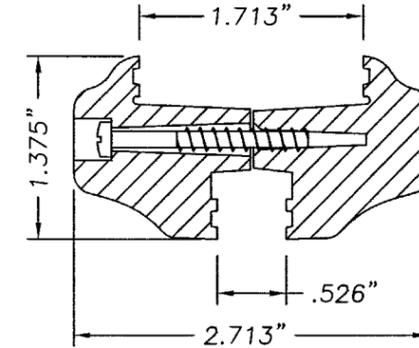


34
TCM (POLYPROPYLENE)
PLASTIC LIP LITE FRAME
EXTRUDED TCM

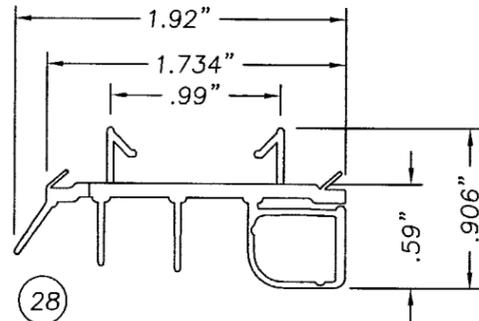


28
INSWING DOOR BOTTOM SWEEP
EXTRUDED VINYL .080"
WALL MAX. .035" WALL MIN.

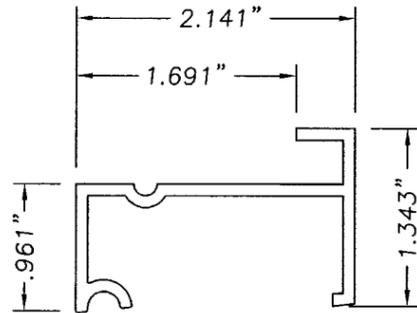


15
INSWING SIDELITE
BOTTOM BOOT
0.09" EXTRUDED VINYL WALL

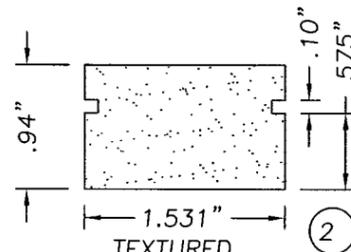


2
TEXTURED
TOP RAIL
WOOD COMPOSITE

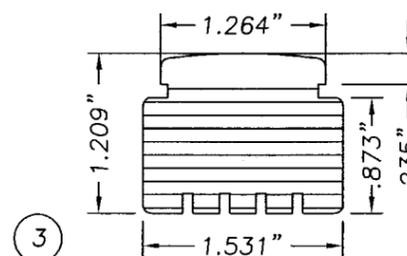


3
TEXTURED
LATCH SIDE LVL STILE

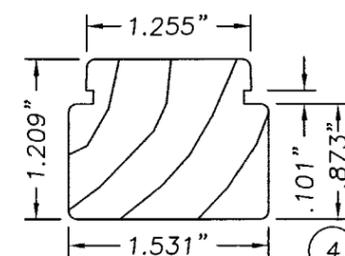


4
TEXTURED
HINGE SIDE STILE

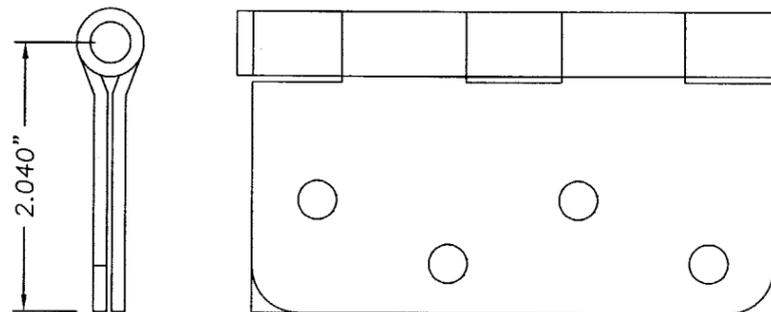


9
4 x 4 STEEL DOOR HINGE

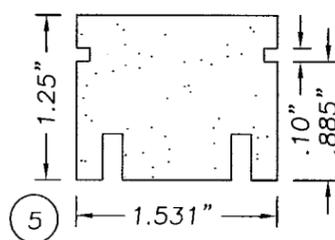


5
TEXTURED
BOTTOM RAIL
WOOD COMPOSITE

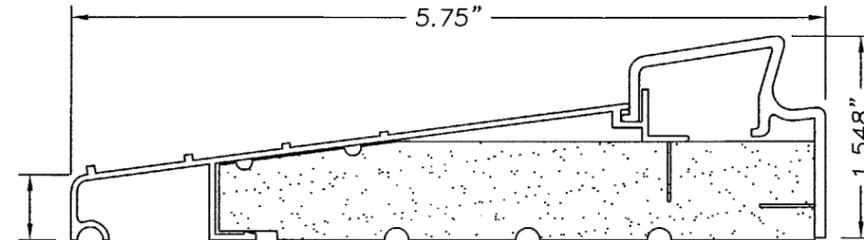


19
SELF ADJUSTING SADDLE THRESHOLD
ALUMINUM/VINYL .045" WALL ALUM.
.080" THK. WALL VINYL TYP.

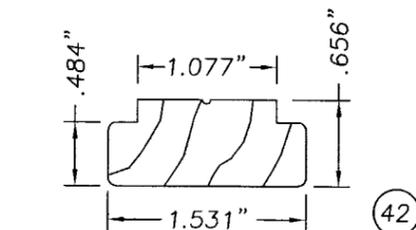

42
SIDELITE TOP & BOTTOM RAIL
FINGER JOINTED PONDEROSA PINE

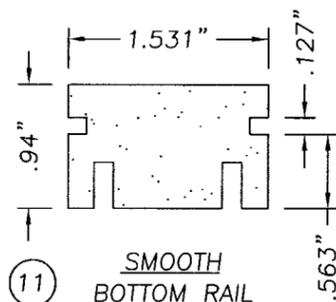

11
SMOOTH
BOTTOM RAIL
WOOD COMPOSITE

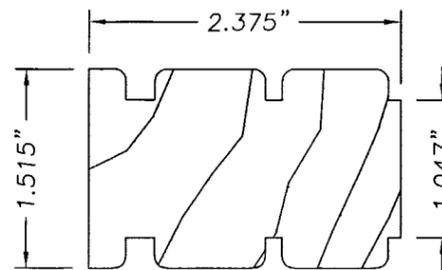

30
WOOD LOCK BLOCK
FINGER JOINTED PONDEROSA PINE

Product Approval Documents Prepared By:
RW
BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197
Florida Board of Professional Engineers
Certificate Of Authorization No. 9813
10/31/03
Lyndon F. Schmidt, P.E. NO. 43409


PRODUCT:	TEXTURED/SMOOTH FIBERGLASS SWING DOOR UP TO 8'4" x 6'8"
PART OR ASSEMBLY:	UNIT COMPONENTS

NO.	DATE	PER DATE COMMENTS	RW	BY
1	7/2/03	PER DADE COMMENTS		


DATE:	1/14/03
SCALE:	N.T.S.
DWG. BY:	ROF
CHK. BY:	RW
DRAWING NO.:	S-2413
SHEET	7 OF 8

Approved as complying with the
Florida Building Code
Date **Nov. 27, 2003**
NOA# **03-0130-02**
Miami Dade Product Control
Division
By *Manuel Perez*


Item	DESCRIPTION	Material
1	SMOOTH SERIES SKIN .070" MINIMUM THK. FIBERGLASS & TEXTURED SERIES SKIN .110" MIN. THK. FIBERGLASS WITH YIELD STRENGTH FY(MIN.)=6,000 PSI (see NOA # 03-0908.02)	FIBERGLASS
2	TEXTURED - TOP RAIL (1.531" x .94" WOOD COMPOSITE)	WOOD COMPOSITE
3	TEXTURED - LATCH STILE (WOOD COMPOSITE 1.531" x 1.209")	WOOD COMPOSITE
4	TEXTURED - HINGE STILE (PONDEROSA PINE 1.531" x 1.209")	WOOD
5	TEXTURED - BOTTOM RAIL (1.531" x 1.25" WOOD COMPOSITE)	WOOD COMPOSITE
6	POLYURETHANE FOAM (BASF, 1.9lbs. DENSITY)	FOAM
7	SHORT REACH COMPRESSION WEATHERSTRIP	FOAM
8	LONG REACH COMPRESSION WEATHERSTRIP	FOAM
9	4" x 4" HINGE .097" THK.	STEEL
10	#10 x 3/4" Lg. PFH WOOD SCREW (Hinge to Frame)	STEEL
11	SMOOTH - BOTTOM RAIL(1.531" x .94" WOOD COMPOSITE)	WOOD COMPOSITE
12	#10 x 2" LG. PFH WOOD SCREW	STEEL
13	#8 x 2 1/2" LG. PFH WOOD SCREW	STEEL
14	3/16" TAPCON ANCHOR (ELCO, 2.0" MIN. LG.)	STEEL
15	SIDELITE BOTTOM BOOT .090" EXTRUDED VINYL	VINYL
16	2x INNER WOOD BUCK	WOOD
17	MAX. 1/4" SHIM MATERIAL	WOOD
18	KWIKSET TITAN 700 SERIES PASSAGE LOCK	-
19	SELF ADJUSTING INSWING SADDLE THRESHOLD	ALUM./WOOD
20	4.563" x 1.25" HEADER (PONDEROSA PINE)	WOOD
21	4.563" x 1.25" STRIKE JAMB (PONDEROSA PINE)	WOOD
22	4.563" x 1.25" HINGE JAMB (PONDEROSA PINE)	WOOD
23	KWIKSET TITAN 700 SERIES DEADBOLT	-
24	ASTRAGAL WINDJAMBER II WR68T (.052" WALL)	ALUM. 6060-T6
25	GLAZING, 1/2" INSULATED TEMPERED GLASS	GLASS
26	SMOOTH - HINGE STILE (PONDEROSA PINE 1.183" x 1.531")	WOOD
27	#8 x 1" LG. PANHEAD SHEET METAL SCREW	STEEL
28	INSWING DOOR BOTTOM SWEEP	VINYL
29	3/8" COVE MOLDING	WOOD
30	WOOD LOCK BLOCK 2.375" x 1.515" (PONDEROSA PINE)	WOOD
31	SMOOTH - LATCH STILE (WOOD COMPOSITE 1.183" x 1.531")	WOOD COMPOSITE
32	1/8 THK. CELLULAR GLAZING TAPE (STIK-II TAPE)	-
33	PLASTIC LIP LITE FRAME (BTS)	BTS
34	PLASTIC LIP LITE FRAME (TCM)	TCM
35	4.563" x 1.25" BLANK JAMB (PONDEROSA PINE)	WOOD
36	SIDELITE SIDE STILE (1.531" x .656" PONDEROSA PINE)	WOOD
37	#10 x 1 3/4" LG. PFH WOOD SCREW	STEEL
38	SMOOTH - TOP RAIL (1.531" x .94" WOOD COMPOSITE)	WOOD COMPOSITE
39	NOT USED	-
40	SILICONE CAULK	SILICONE
41	#8-10 x 1 1/2" PLASCREW (FOR ITEM #34)	STEEL
42	SIDELITE TOP & BOTTOM RAIL (1.531"x .656" PONDEROSA PINE)	WOOD
43	#8 x 2" LG. PFH WOOD SCREW	STEEL

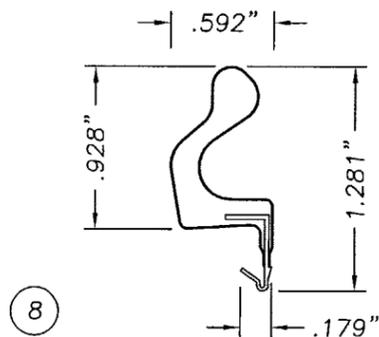


8 LONG REACH COMPRESSION WEATHERSTRIP
FOAM CELL CORE W/VINYL JACKET

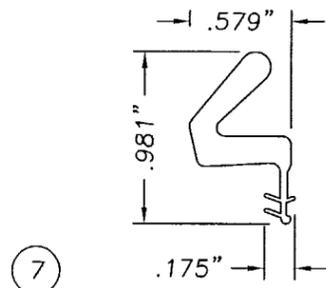


7 COMPRESSION WEATHERSTRIP
FOAM CELL CORE W/VINYL JACKET

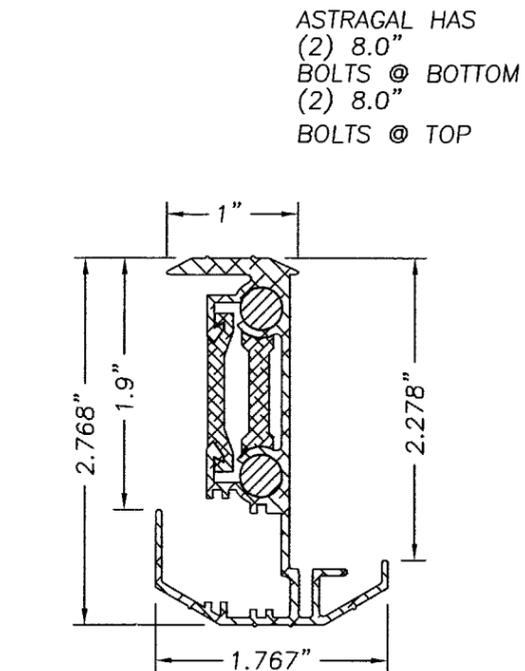

24 WINDJAMBER II WR68T
ASTRAGAL (ALUMINUM .052" WALL TYP.)

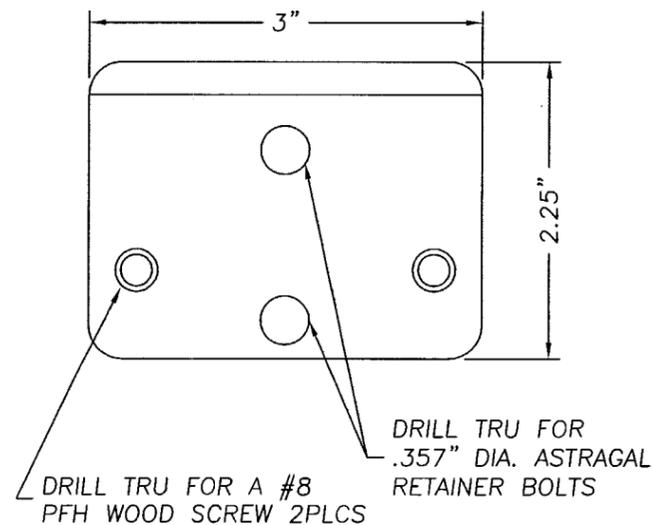


WINDJAMBER II WR68T STRIKE PLATE

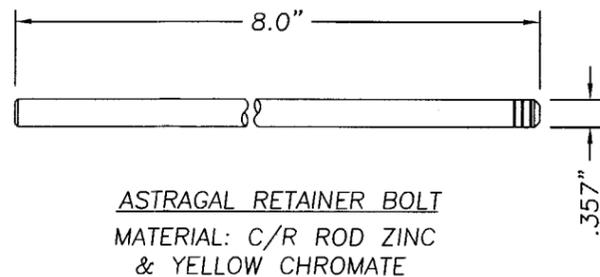


ASTRAGAL RETAINER BOLT
MATERIAL: C/R ROD ZINC
& YELLOW CHROMATE


ASTRAGAL HAS
(2) 8.0"
BOLTS @ BOTTOM
(2) 8.0"
BOLTS @ TOP

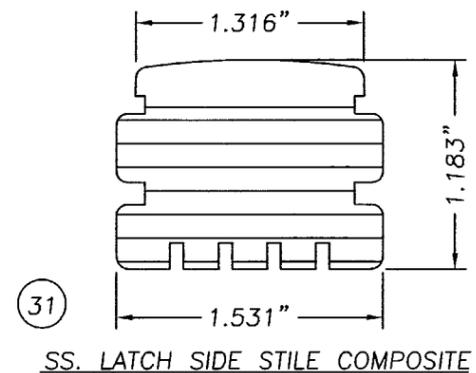

31 SS. LATCH SIDE STILE COMPOSITE

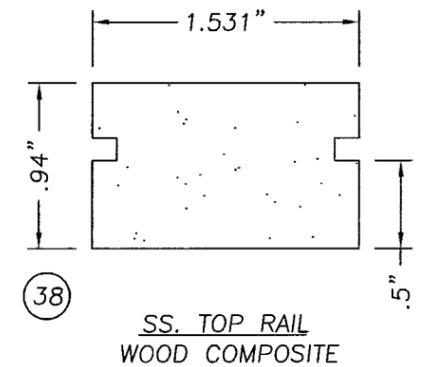

38 SS. TOP RAIL
WOOD COMPOSITE

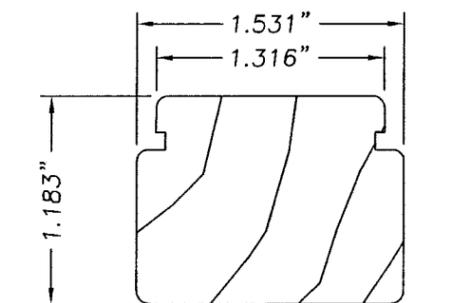

26 SS. WOOD HINGE SIDE STILE

Approved by
Florida Building Code
Date **Nov. 27, 2003**
NOA# **03-0130.02**
Miami Date Product Control
By *Manuel Perez*

DATE: 1/14/03
SCALE: N.T.S.
DWG. BY: ROF
CHK. BY: RW
DRAWING NO.: S-2413
SHEET 8 OF 8

Product Approval Documents Prepared By:
RW
BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197
Florida Board of Professional Engineers
Certificate Of Authorization No. 9813
10/31/03
Lyndon F. Schmidt, P.E. NO. 43409

PRODUCT: TEXTURED/SMOOTH
FIBERGLASS SWING DOOR
UP TO 8'4" x 6'8" INSWING
PART OR ASSEMBLY:
UNIT COMPONENTS
& BILL OF MATERIALS

NO.	DATE	PER DATE COMMENTS	RW	BY
1	7/2/03	PER DATE COMMENTS	RW	BY

REVISIONS