



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Pozzi Window Company
62845 Boyd Acres Rd.
Bend, OR 97701**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Aluminum Clad Geometric Shapes Direct Set Wood Fixed Windows

APPROVAL DOCUMENT: Drawing No.S-2329, titled "Direct Set Fixed Aluminum Clad Wood Windows", sheets 1 through 6 of 6, dated 1/14/03, with revision #1 dated 5/5/03, prepared by R W Building Consultants, Inc., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No 03-0204.08
Expiration Date: May 29, 2008
Approval Date: May 29 2003
Page 1**

Pozzi Window Company

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA)

A. DRAWINGS


1. Manufacturer's die drawings and sections.
2. Drawing No. **S-2329**, titled "Direct Set Fixed Aluminum Clad Wood Windows", sheets 1 through 6 of 6, dated 1/14/03, with revision #1 dated 5/5/03, prepared by R W Building Consultants, Inc.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94along with marked-up drawings and installation diagram of a direct set rectangular 60" x 120" aluminum clad wood fixed window, prepared by Architectural Testing, Inc. Test Report No. **ATI-03-31488.01**, dated 11/25/02, signed and sealed by Steven M. Urich, P.E.
2. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94along with marked-up drawings and installation diagram of a direct set rectangular 48" x 96" aluminum clad wood fixed window, prepared by Architectural Testing, Inc. Test Report No. **ATI-03-31488.03**, dated 11/26/02, signed and sealed by Steven M. Urich, P.E.
3. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94along with marked-up drawings and installation diagram of a direct set half round" 48" x 60" aluminum clad wood fixed window, prepared by Architectural Testing, Inc. Test Report No. **ATI-03-31488.08**, dated 11/26/02, signed and sealed by Steven M. Urich, P.E.

C. CALCULATIONS

1. Anchor Calculations, dated 1/13/03, prepared by R W Building Consultants, Inc., signed and sealed by Lyndon F. Schmidt, P.E.

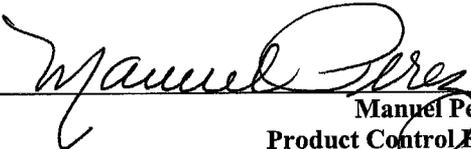

Manuel Perez, P.E.
Product Control Examiner
NOA No 03-0204.08
Expiration Date: May 29, 2008
Approval Date: May 29 2003

Pozzi Window Company

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA)

D. MATERIAL CERTIFICATIONS


1. None.

E. STATEMENTS

1. Statement letter of conformance, dated January 13, 2003, signed and sealed by Lyndon F. Schmidt, P.E.
2. Statement letter of no financial interest, dated January 13, 2003, signed and sealed by Lyndon F. Schmidt, P.E.
3. Statement letter of no financial interest, dated January 13, 2003, notarized and signed by Steve Strawn.
4. Statement letter naming Mr. Rick Wright as representative and contact person, dated December 12, 2002, notarized and signed by Steve Strawn.
5. Letter from Consultant dated April 08, 2003.

F. OTHER

1. None.

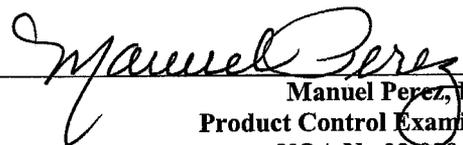

Manuel Perez, P.E.
Product Control Examiner
NOA No 03-0204.08
Expiration Date: May 29, 2008
Approval Date: May 29 2003

POZZI WINDOW COMPANY

ALUMINUM CLAD WOOD WINDOWS
FIXED FRAME DIRECT SET SERIES (NON-IMPACT)

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS (SEE SHEET 5 OF 6). ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. THIS SYSTEM REQUIRES WINDBORNE DEBRIS EXTERNAL PROTECTION AS PRESCRIBED IN SECTION 1626.1 OF THE FLORIDA BUILDING CODE.
5. FOR DESIGN PRESSURE RATING SEE CHART THIS PAGE:
6. THIS PRODUCT MEETS WATER REQUIREMENTS FOR THE "HIGH VELOCITY HURRICANE ZONES".
7. ASYMMETRIC SHAPES ALSO APPROVED FOR MIRROR IMAGE ABOUT VERTICAL AXIS.

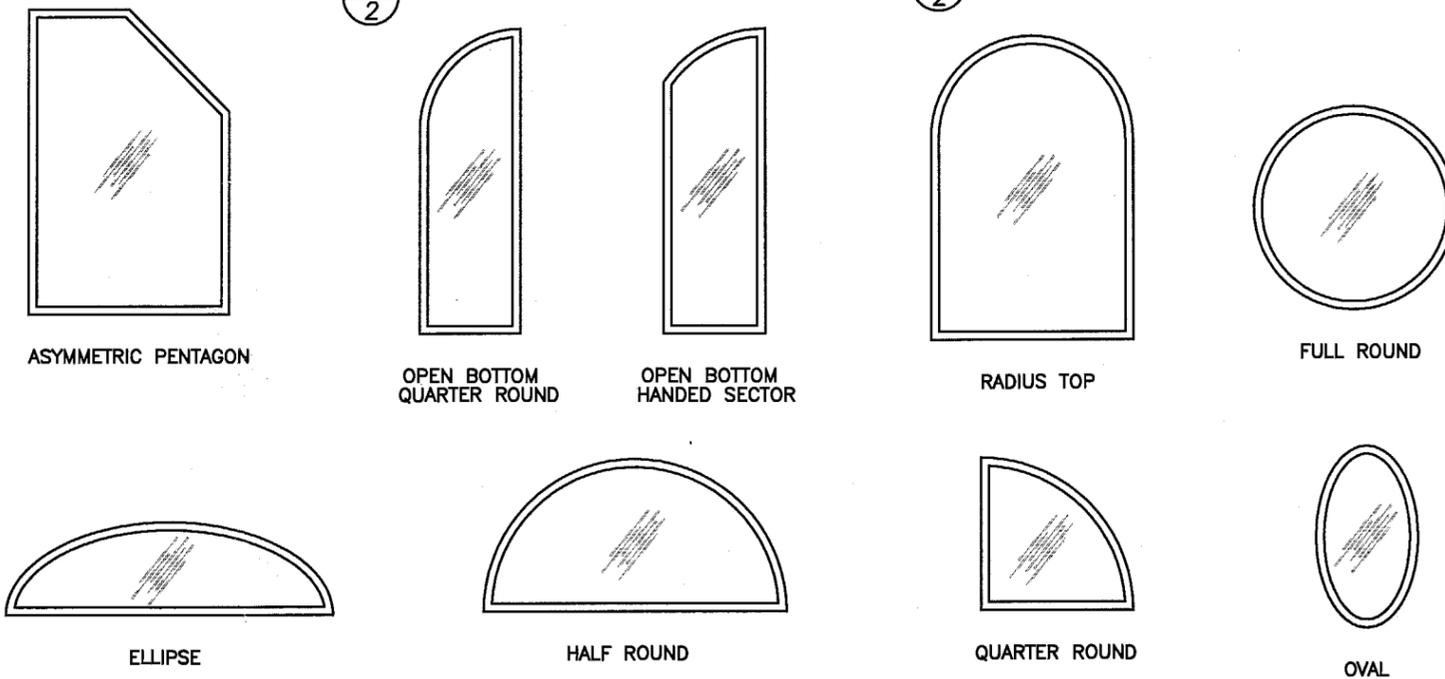
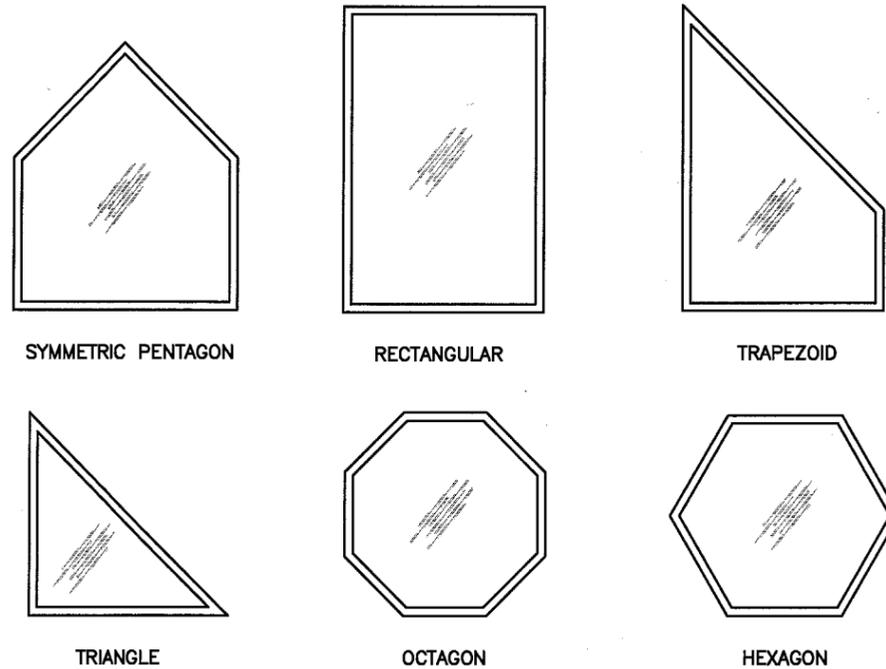
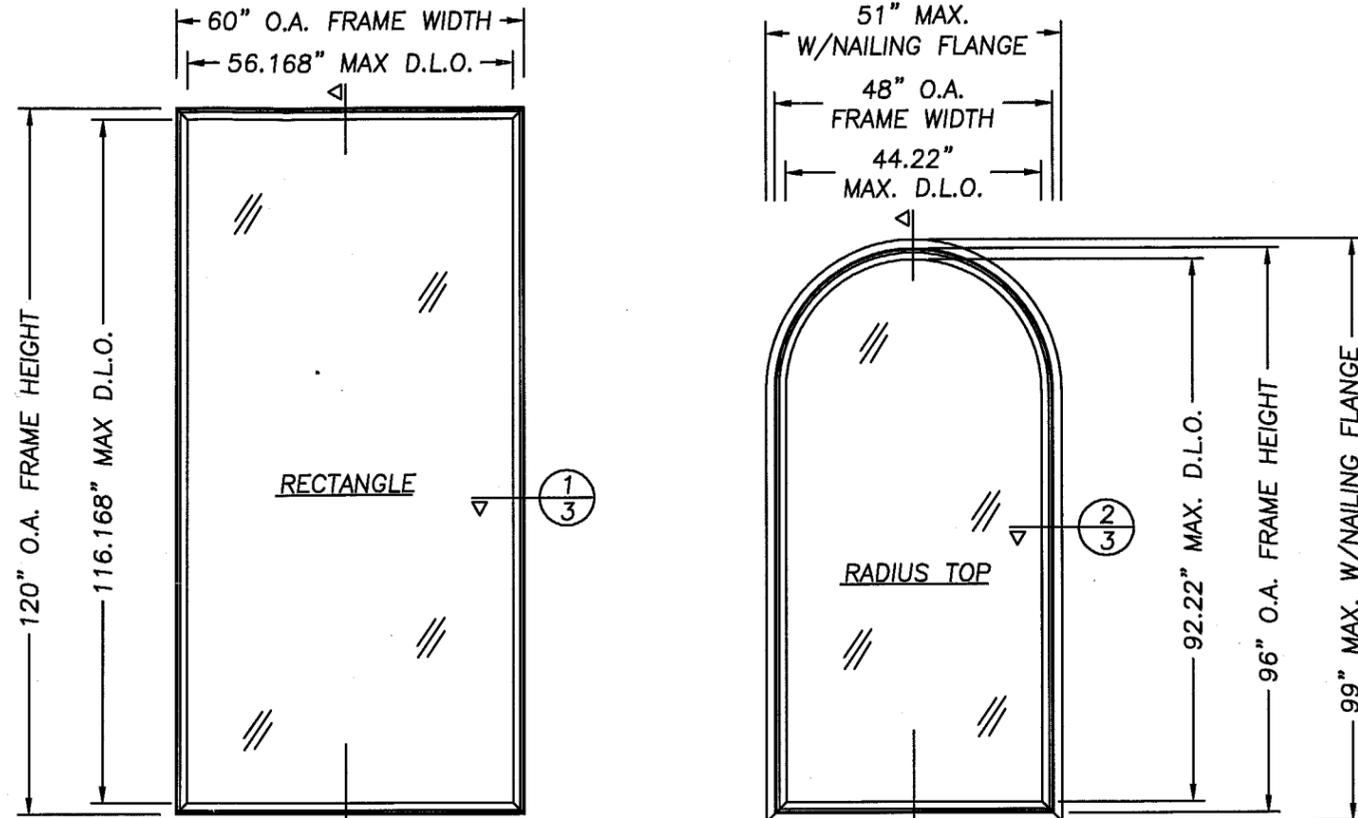


TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATION
2	VERTICAL CROSS SECTION & GLAZING DETAILS
3	HORIZONTAL CROSS SECTIONS & ANCHOR NOTES
4	FRAME CONSTRUCTION DETAILS
5	TYPICAL ANCHORING & ANCHORING NOTES
6	COMPONENTS & BILL OF MATERIALS

DESIGN PRESSURE RATING ALL MODELS SHOWN			
GLASS TYPE	MAX. LENGTH & WIDTH	MAX. SQUARE FOOTAGE	DESIGN PRESSURE
INS. TEMP.	60" X 120"	50 SQ. FT.	+ 50.0 - 50.0
INS. TEMP.	48" X 96"	32 SQ. FT.	+ 65.0 - 65.0
INS. ANN.	48" X 60"	20 SQ. FT.	+ 75.0 - 75.0


Approved as complying with the Florida Building Code Date <u>MAY 29 2003</u> NOA# <u>03-0204.08</u> Miami Dade Product Control Division By <u>Manuel Perez</u>	DATE: 1/14/03
	SCALE: N.T.S.
	DWG. BY: ZRK
	CHK. BY: RW
	DRAWING NO.: S-2329
	SHEET <u>1</u> OF <u>6</u>

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411


PRODUCT: DIRECT SET FIXED ALUMINUM CLAD WOOD WINDOWS
PART OR ASSEMBLY:
GENERAL NOTES & ELEVATIONS

NO.	DATE	ADD ANCHORING	RW	BY
1	5/5/03			


RW BUILDING CONSULTANTS, INC.
813.659.9197

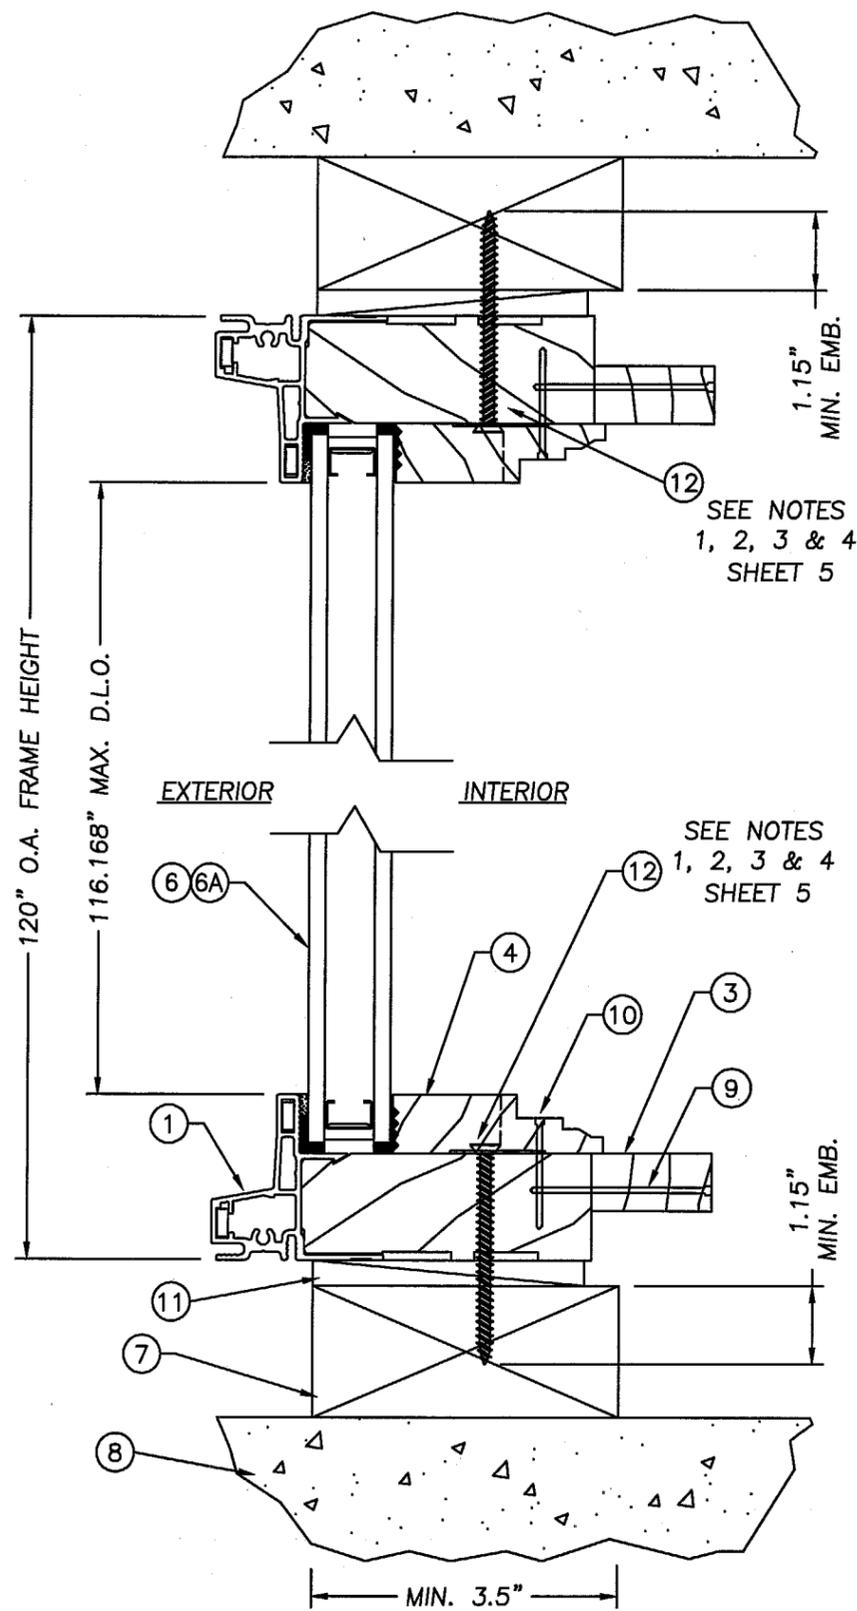


1 VERTICAL CROSS SECTION, TYP.
2 WITHOUT NAILING FLANGE

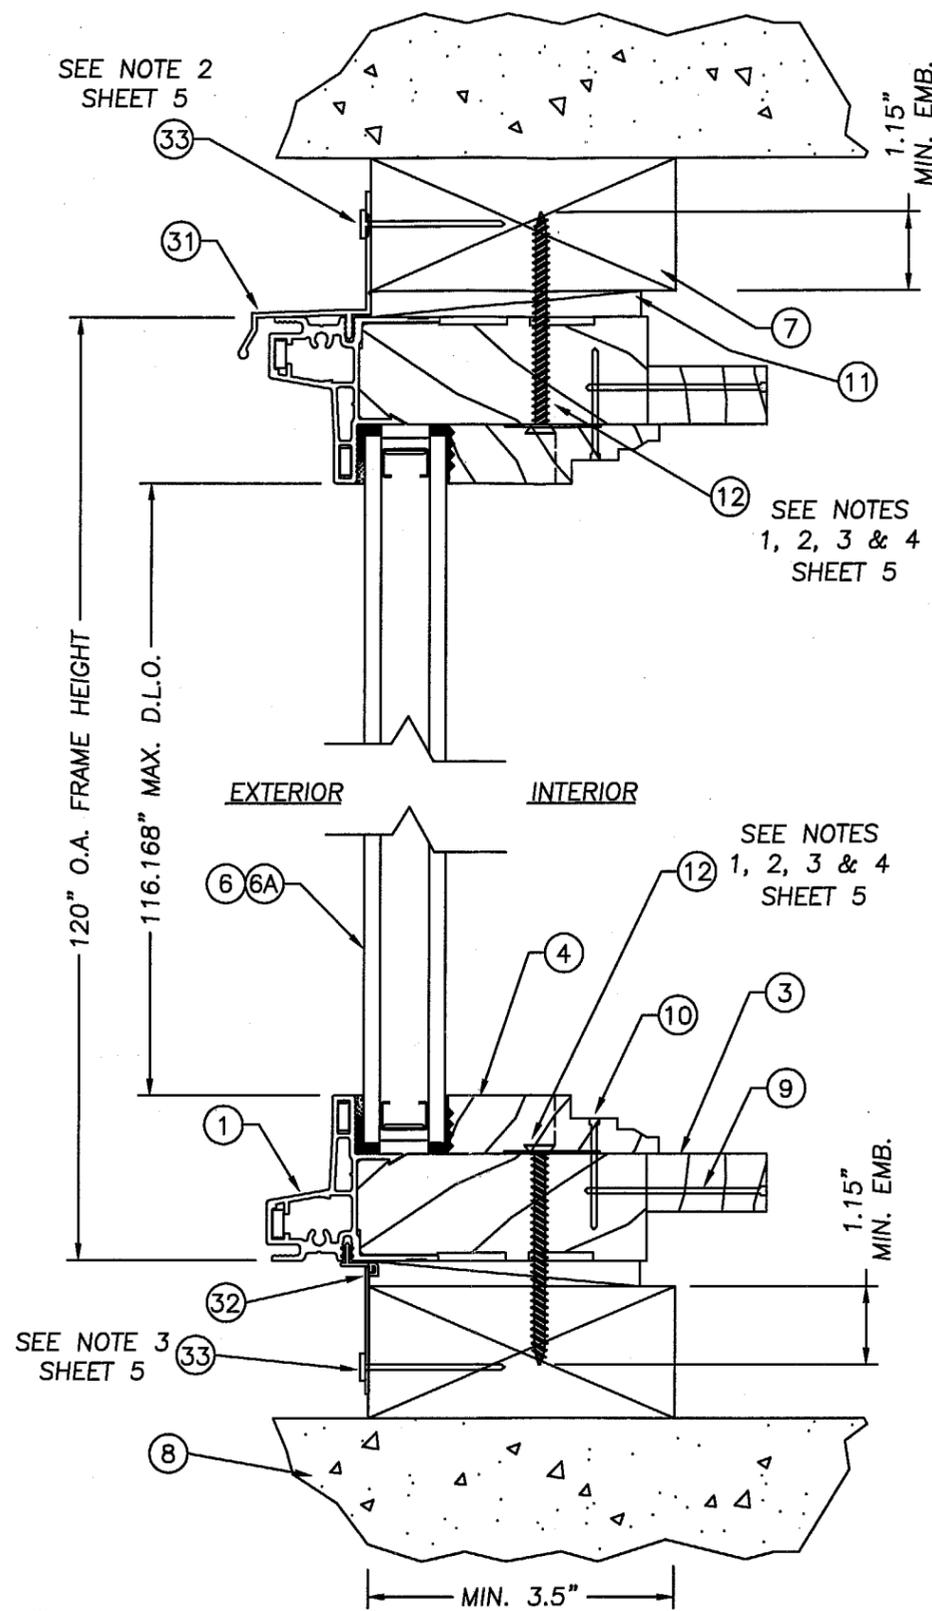

1 VERTICAL CROSS SECTION
2 WITH NAILING FLANGE
& OPTIONAL DRIP CAP

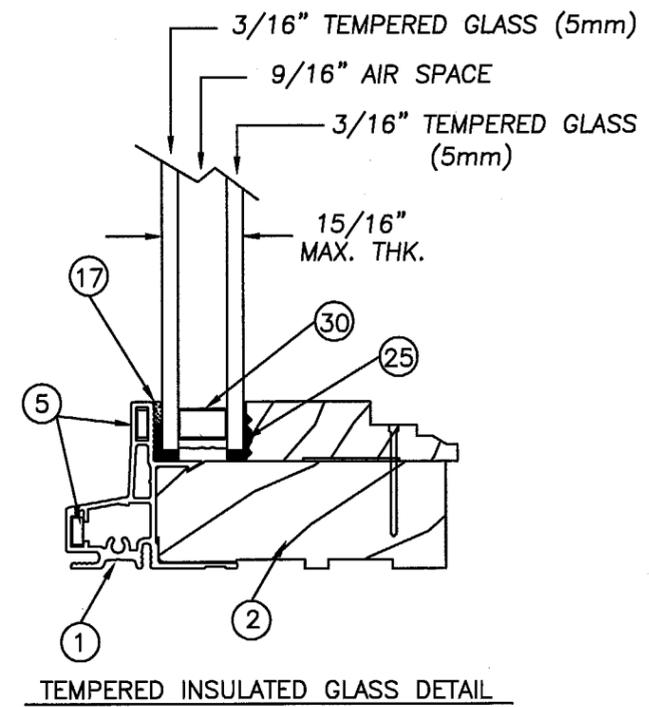

TEMPERED INSULATED GLASS DETAIL

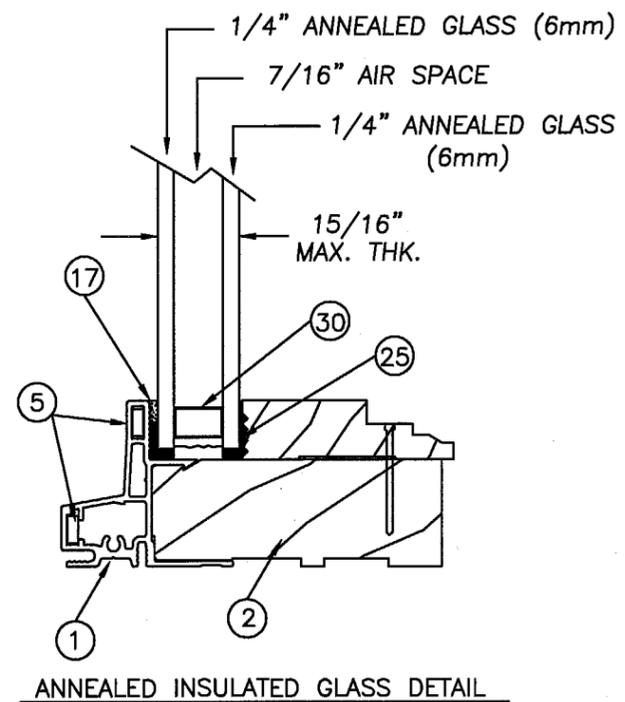

ANNEALED INSULATED GLASS DETAIL

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411


PRODUCT: DIRECT SET FIXED ALUMINUM CLAD WOOD WINDOWS
PART OR ASSEMBLY: VERTICAL CROSS SECTION & GLAZING DETAILS

NO.	DATE	ADD ANCHORING	RW	BY
1	5/5/03			


RW BUILDING CONSULTANTS, INC.
813.659.9197

DATE: 1/14/03
SCALE: N.T.S.
DWG. BY: ZRK
CHK. BY: RW
DRAWING NO.: S-2329
SHEET 2 OF 6

Approved as complying with the Florida Building Code
Date: MAY 29, 2003
NOA# 03-0204-08
Miami Dade Product Control Division
By: *Manuel Perez*

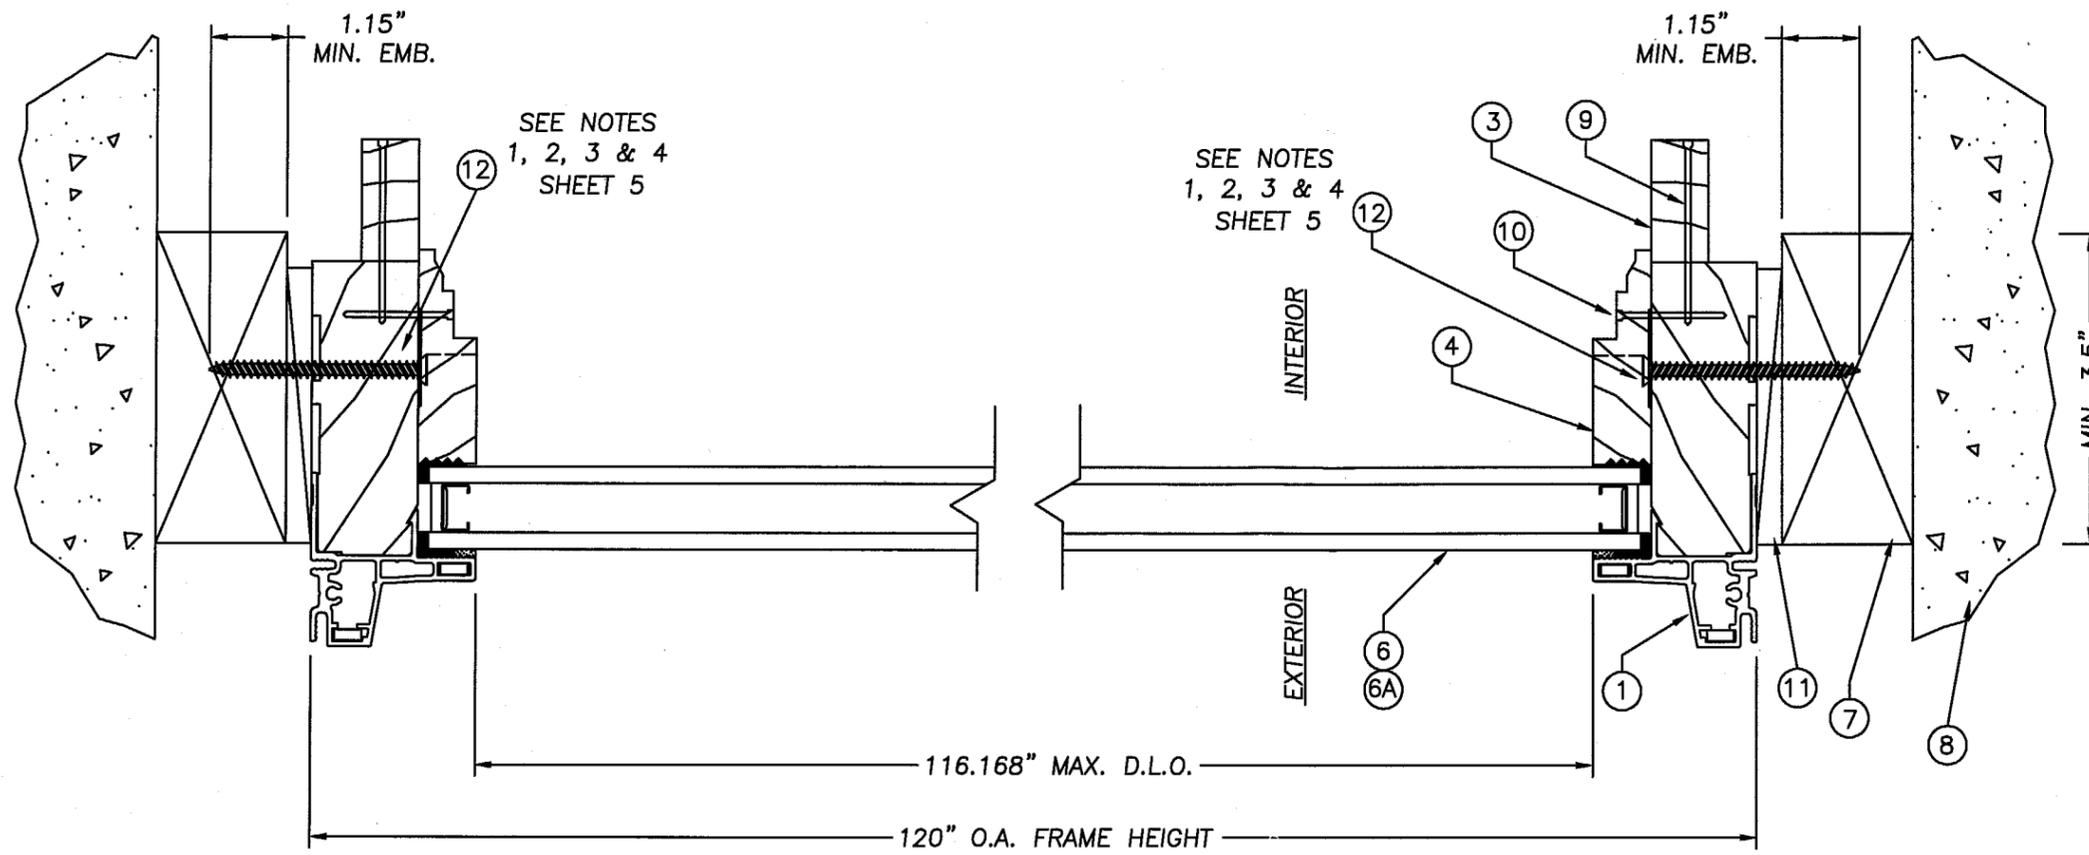

1 HORIZONTAL CROSS SECTION, TYP.
3 WITHOUT NAILING FLANGE

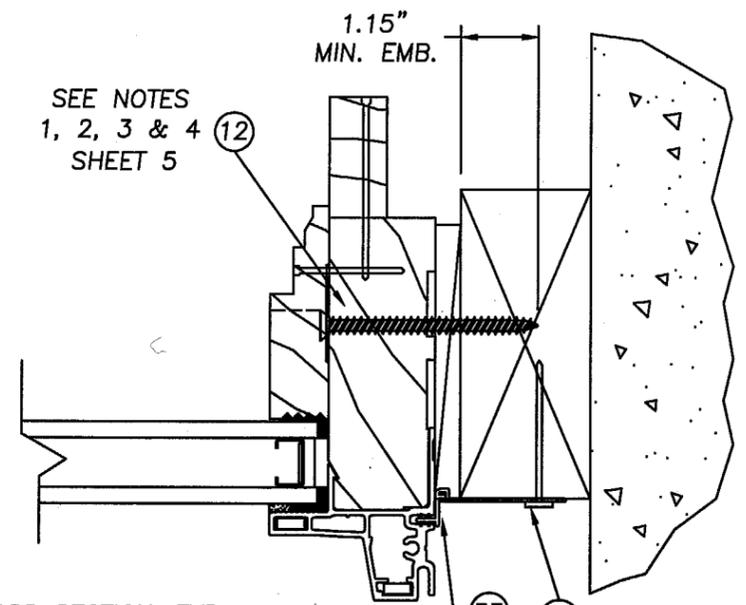

2 HORIZONTAL CROSS SECTION, TYP.
3 WITH NAILING FLANGE

32 SEE NOTE 5
SHEET 5

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411


PRODUCT: DIRECT SET FIXED ALUMINUM CLAD WOOD WINDOWS
PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS

NO.	DATE	ADD ANCHORING	RW	BY
1	5/5/03			

RW BUILDING CONSULTANTS, INC.
813.659.9197

DATE: 1/14/03
SCALE: N.T.S.
DWG. BY: ZRK
CHK. BY: RW
DRAWING NO.: S-2329
SHEET 3 OF 6


Approved as complying with the Florida Building Code
Date **MAY 29 2003**
NOA# **03-0204.08**
Miami Dade Product Control
Division
By: *[Signature]*

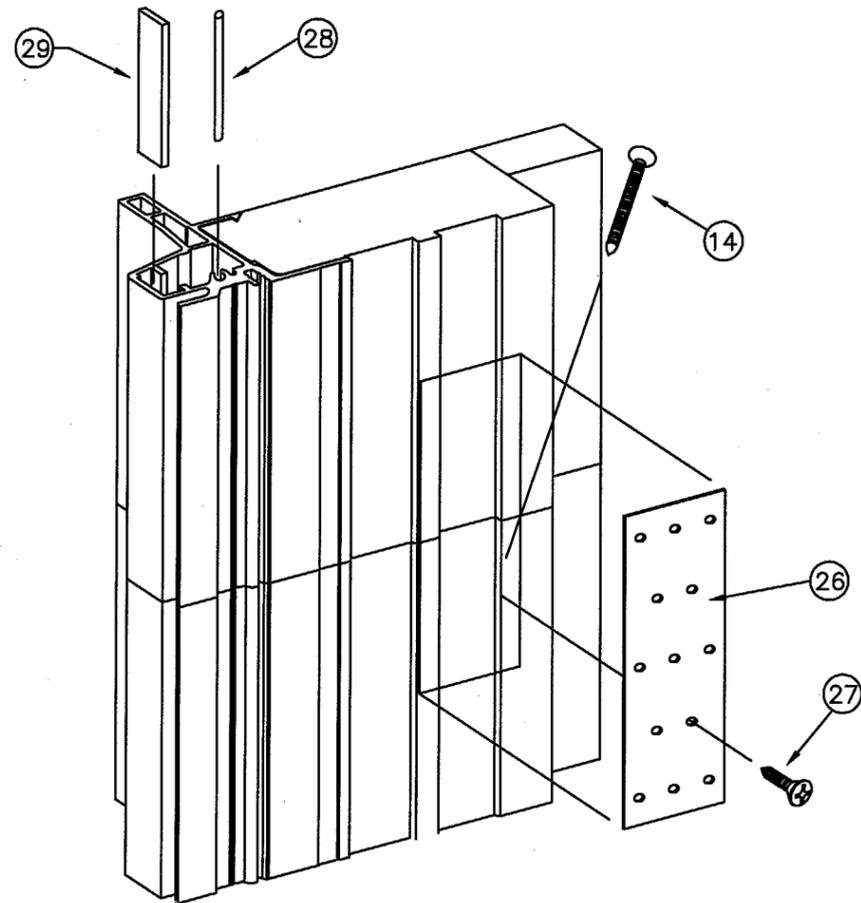

DETAIL "A"
SPRING LINE FRAME SUPPORT SYSTEM

RADIUS FRAME CONSTRUCTION:

FRAME CONSTRUCTION ON RADIUS UNITS IS CONSISTANT TO STRAIGHT LINE OTHER THAN THE JAMB IS SUPPORTED AT THE SPRING LINE OF THE SIDE JAMB WITH A SCREW PLATE WHICH IS SECURED WITH 10 - #8 x 3/4" SELF-TAPPING SCREWS (5 IN EA. JAMB). IN ADDITION, THE METAL EXTRUSION IS SUPPORTED WITH A 1/8" x 3" BRASS ROD IN THE SCREW BOSS AND A 1/8" x 11/32" x 3" STRAIGHT FRAME KEY WHICH IS POSITIONED INTO THE CORNER KEY SLOT OF THE TWO JAMBS. A #8 x 2" FLT. HD. PHL. SCREW IS FASTENED DIAGONALLY FROM THE UPPER JAMB TO THE LOWER BEFORE THE JAMB EXTENSION IS APPLIED. THIS COMPLETES THE INSTALLATION.

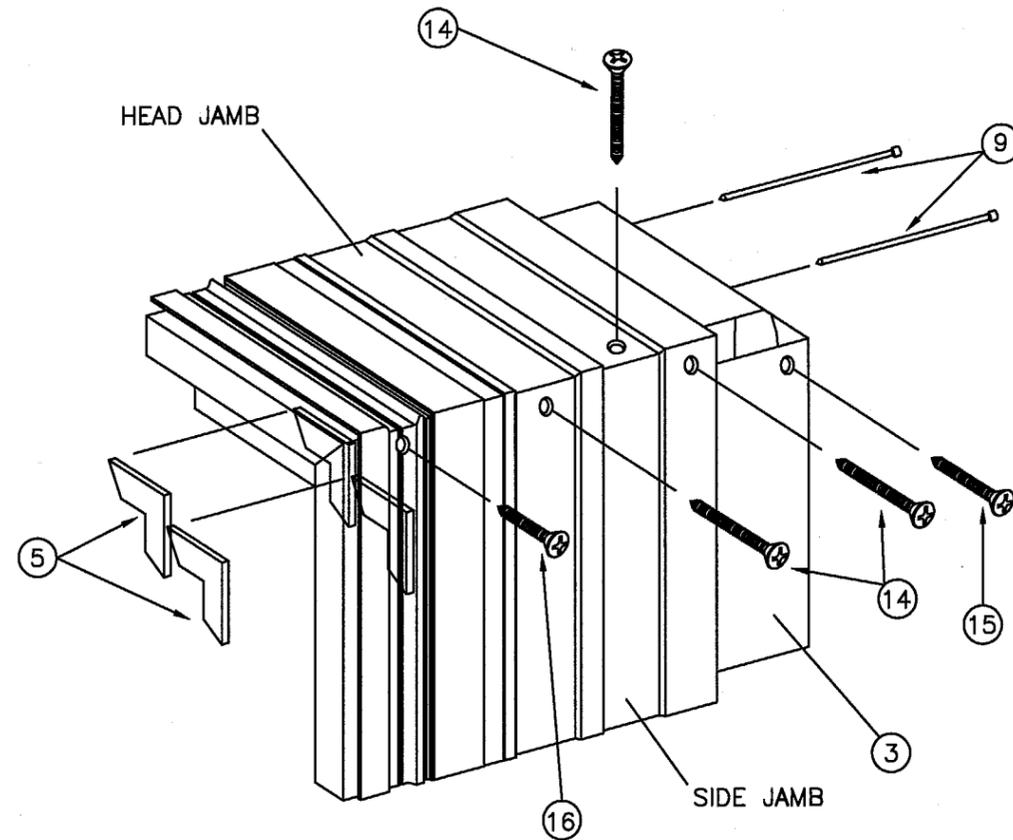

DETAIL "B"
FRAME CORNER FASTENER DETAIL

FRAME CONSTRUCTION:

THE WOOD FRAME IS 3.344" x 1.218" FINGER-JOINTED PONDEROSA PINE. THE FRAME METAL IS 1.969" x 1.875" x .060" WALL EXTRUDED ALUMINUM. THE FRAME METAL IS SNAPPED AND STAPLED ONTO THE WOOD JAMB AND MITRED AND SEALED WITH SILICONE (1199 DOW CORNING). EACH CORNER IS FASTENED WITH (3) #8 x 2" FLT. HD. PHL. SCREWS. TWO IN ONE JAMB AND ONE IN THE ADJOINING JAMB AT THE MITRE. AN ADDITIONAL #8 x 1" FLT. HD. PHL. SCREW IS APPLIED INTO THE SCREW BOSS OF THE ALUMINUM EXTRUSION AND (2) CORNER KEYS .125" x .344" INTO THE SLOTS OF THE ALUMINUM EXTRUSION TO COMPLETE THE CORNER CONSTRUCTION. THE JAMB EXTENSION IS 1.375" x .656" PONDEROSA PINE ATTACHED TO THE WOOD JAMB WITH 2" x 15 GA. NAILS 1" FROM THE END AND 8" O.C. AND SCREWED AT CORNERS WITH #8 x 1 1/2" FLT. HD. PHL. SCREWS.

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411

PRODUCT: DIRECT SET FIXED ALUMINUM CLAD WOOD WINDOWS
PART OR ASSEMBLY: FRAME CONSTRUCTION DETAILS

NO.	DATE	ADD ANCHORING	RW	BY
1	5/5/03			

RW BUILDING CONSULTANTS, INC.
813.659.9197

DATE: 1/14/03
SCALE: N.T.S.
DWG. BY: ZRK
CHK. BY: RW
DRAWING NO.: S-2329
SHEET 4 OF 6

Approved as complying with the Florida Building Code
Date: MAY 29 2003
NOA# 03-0204-08
Miami Dade Product Control
Division
By: [Signature]


POZZI WINDOW COMPANY
 62845 BOYD ACRES RD.
 BEND, OREGON 97701
 PH. 541.382.4411

PRODUCT: DIRECT SET FIXED ALUMINUM CLAD WOOD WINDOWS
 PART OR ASSEMBLY:
 TYPICAL ANCHORING & ANCHORING NOTES


NO.	DATE	ADD ANCHORING	RW BY
1	5/5/03		

RW BUILDING CONSULTANTS, INC.
 813.659.9197

DATE: 1/14/03
 SCALE: N.T.S.
 DWG. BY: ZRK
 CHK. BY: RW
 DRAWING NO.: S-2329
 SHEET 5 OF 6

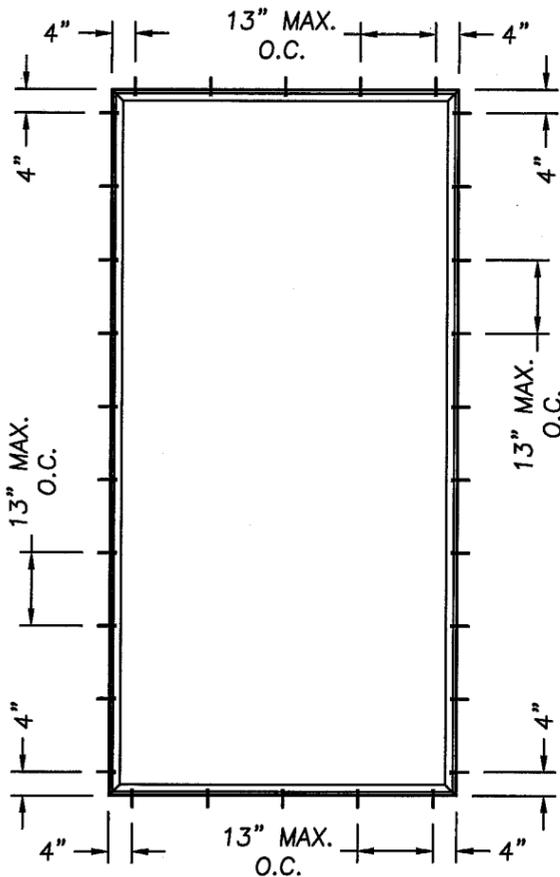


TYPICAL RECTANGULAR UNIT ANCHORING

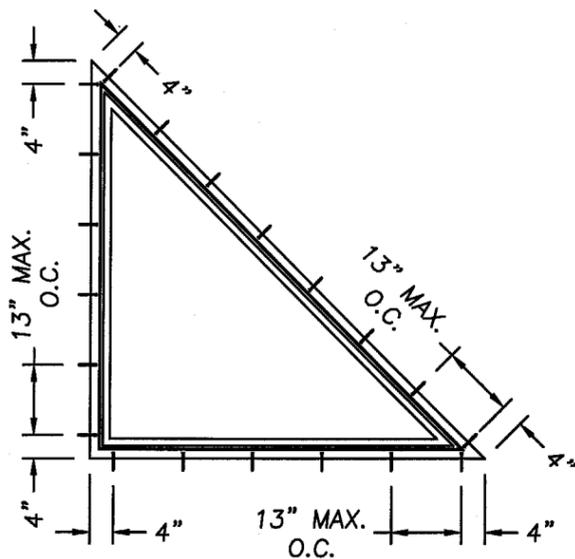


TYPICAL GEOMETRIC UNIT ANCHORING

NOTES: ANCHORING FASTENING TO WOOD SUB-BUCKS

- RECTANGULAR UNITS -
 SHORT SIDE - 4" FROM EACH CORNER AND MAX. 13" ON CENTER.
 LONG SIDE - 4" FROM EACH CORNER AND MAX. 13" ON CENTER.
- GEOMETRIC UNITS -
 ALL SIDE - 4" FROM EACH CORNER AND MAX. 13" ON CENTER.
- RADIUS UNITS -
 SILL - 4" FROM EACH CORNER AND MAX. 13" ON CENTER.
 LONG SIDE - 4" FROM EACH CORNER AND MAX. 13" ON CENTER.
 AT RADIUS - 1 FASTENER AND IF UNIT EXCEEDS 60" IN HEIGHT ADD ADDITIONAL FASTENER 4" BELOW SPRINGLINE. 1 ADDITIONAL FASTENER IS INSTALLED AT EACH INTERSECTION OF THE TANGENTS OF THE FRAME AND THE BUCK WHICH IS CUT AT A 45° ANGLE TO THE FRAME (MIN. 3 PER RADIUS).
- OVAL AND CIRCULAR UNITS -
 ALL SIDES MAX. 12" ON CENTER CONTINUOUS.
- NAILING FLANGES -
 4" FROM EACH CORNER AND A MAX 16" ON CENTER.
 (NAILING FLANGE IS NOT STRUCTURAL, ANCHORS THROUGH JAMBS MUST BE USED)

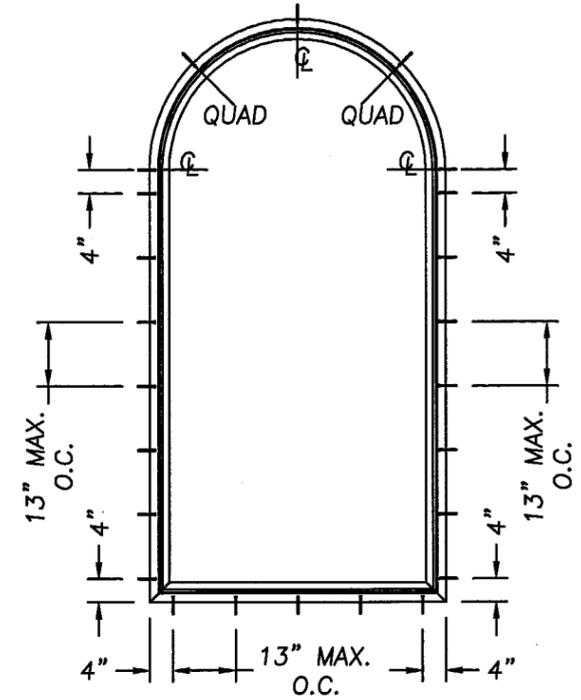


TYPICAL RADIUS UNIT ANCHORING

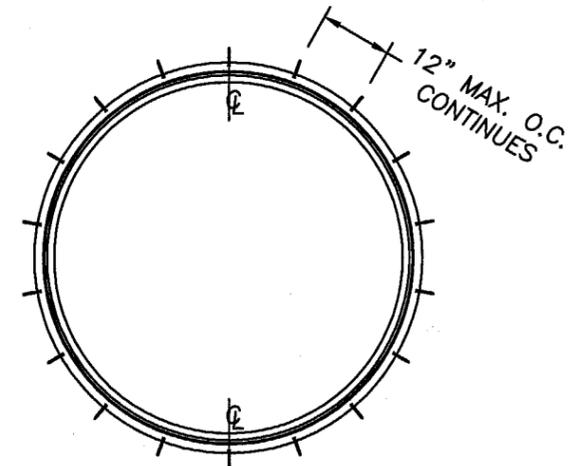


TYPICAL CIRCULAR UNIT ANCHORING


Approved as complying with the Florida Building Code
 Date MAY 29, 2003
 NOA# 03-0204.08
 Miami Dade Product Control Division
 By Manuel Perry

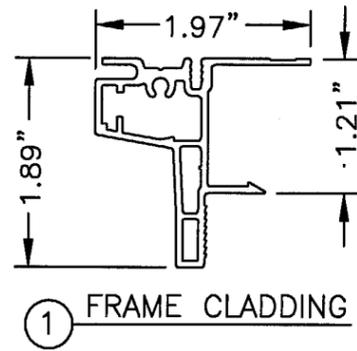


① FRAME CLADDING

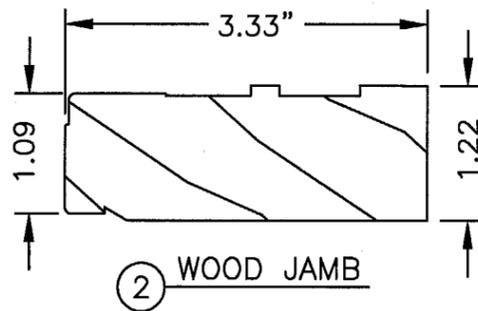


② WOOD JAMB

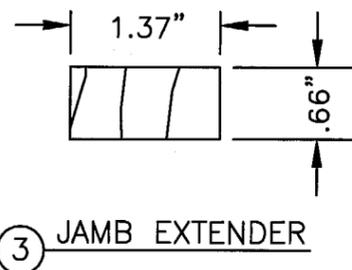


③ JAMB EXTENDER

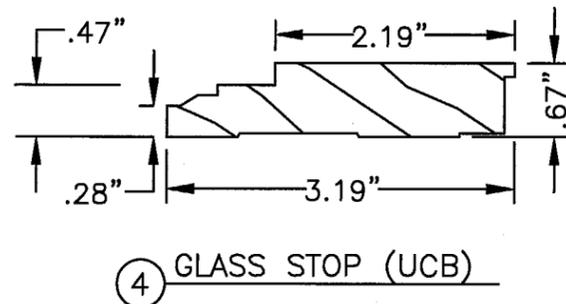


④ GLASS STOP (UCB)

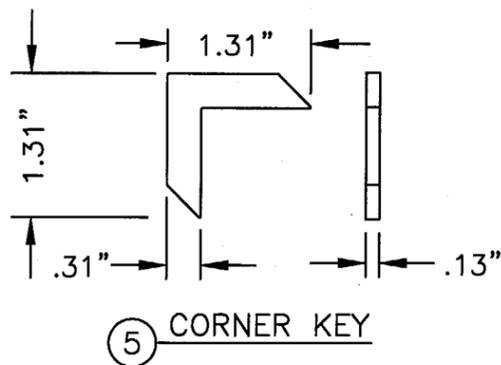


⑤ CORNER KEY

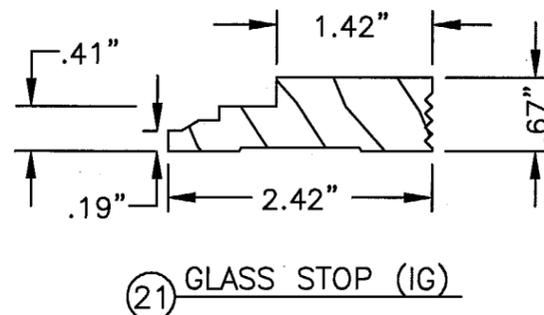

②① GLASS STOP (IG)

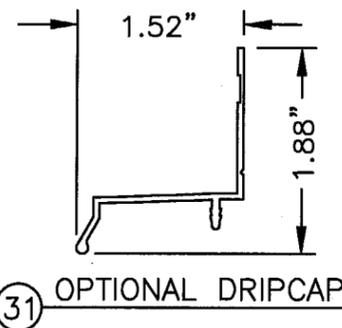

③① OPTIONAL DRIPCAP

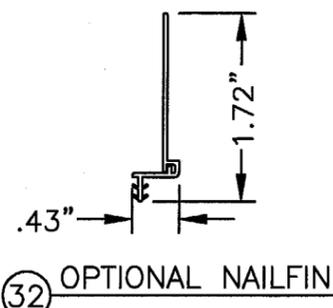

③② OPTIONAL NAILFIN

MATERIALS LIST		
ITEM	DESCRIPTION	MATERIAL
1	ALUMINUM FRAME CLADDING - .060 WALL (ANODIZING INC.)	6063-T5 ALUM.
2	WOOD JAMB F/J LINEAL - (BMC)	PONDEROSA PINE
3	WOOD 4 9/16" JAMB EXTENDER - (BMC)	CLEAR PINE
4	WOOD GLASS STOP - UCB (BMC)	CLEAR PINE
5	FRAME CORNER KEY - 2 EA. (MITCHELL METAL)	6061-T6511 ALUM.
6	15/16" INSULATED TEMPERED GLASS	
6A	15/16" INSULATED ANNEALED GLASS	
7	PRESSURE TREATED 2X BUCK	P.T. WOOD
8	NOT USED	
9	2" x 15 GA. FINISH NAIL - (STANLEY/BOSTICH)	STEEL
10	1 1/4" x 16 GA. FINISH NAIL - (STANLEY/BOSTICH)	STEEL
11	1/4" WOOD SHIM	
12	#10 x 3" P.H.F.H. WOOD SCREW (CROWN FASTENERS)	STEEL
13	NOT USED	STEEL
14	#8 x 2" P.H.F.H. WOOD SCREW (CROWN FASTENERS)	STEEL
15	#8 x 1 1/2" P.H.F.H. WOOD SCREW (CROWN FASTENERS)	STEEL
16	#8 x 1" P.H.F.H. METAL SCREW (CROWN FASTENERS)	COLOR MATCH STL.
17	.1/4" x 1/8" GLAZING TAPE (3M)	
18	#995 SEALANT (DOW CORNING)	SEALANT
19	NOT USED	
20	NOT USED	
21	WOOD GLASS STOP - IG (BMC)	CLEAR PINE
22	NOT USED	
23	NOT USED	
24	NOT USED	
25	#1199 SEALANT (DOW CORNING)	SEALANT
26	1 13/16" x 5" SCREW PLATE	SIMPSON
27	#8 x 3/4" SELF-TAPPING P.H.F.H. WOOD SCREW	STEEL
28	1/8" x 3" BRASS ROD	BRASS
29	1/8" x 11/32" x 3" STRAIGHT FRAME KEY	STEEL
30	ULTRAEDGE™ GLASS SPACER	STEEL
31	DRIPCAP - (ANODIZING INC.)	6061-T6511 ALUM.
32	FOLDING NAILING FLANGE - (AMESBURY)	POLY
33	11 GA. 1-5/8" ROOFING NAIL	GALV. STL.

POZZI WINDOW COMPANY
 62845 BOYD ACRES RD.
 BEND, OREGON 97701
 PH. 541.382.4411

PRODUCT: DIRECT SET FIXED ALUMINUM CLAD WOOD WINDOWS
 PART OR ASSEMBLY:
 COMPONENTS & BILL OF MATERIALS

NO.	DATE	ADD ANCHORING	RW	BY
1	5/5/03			

RW BUILDING CONSULTANTS, INC.
 813.659.9197

DATE: 1/14/03
 SCALE: N.T.S.
 DWG. BY: ZRK
 CHK. BY: RW
 DRAWING NO.: S-2329
 SHEET 6 OF 6

Approved as complying with the Florida Building Code
 Date: MAY 29, 2003
 NOA# 03-0204-0B
 Miami Dade Product Control Division
 By: Manuel Lopez