



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Pozzi Window Company
62845 Boyd Acres Road
Bend, OR 97701**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series "Direct Set" Aluminum Clad Wood Fixed Window

APPROVAL DOCUMENT: Drawing No.DS-1, titled "Direct Set Fixed Aluminum Clad Wood Windows", sheets 1 through 5 of 5, prepared by R.W. Building Consultants, Inc., dated 9/9/97 with revision on 3/18/03, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 00-1003.02 and, consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by **Jaime Eisen, P.E.**

Jaime Eisen
4/11/03



**NOA No 03-0210.06
Expiration Date: February 26, 2006
Approval Date: April 24 2003**

Pozzi Window Company

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA)

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No.DS-1, titled "Direct Set Fixed Aluminum Clad Wood Windows", sheets 1 through 5 of 5, prepared by R.W. Building Consultants, Inc., dated 9/9/97 with revision on 3/18/03.

B. TESTS

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum clad wood fixed window, prepared by Architectural Testing, Inc., Test Report No. **03-31488.02**, dated 8/26/02, signed and sealed by Steven Urich, P.E.
2. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum clad wood fixed window, prepared by Architectural Testing, Inc., Test Report No. **03-31488.04**, dated 8/27/02, signed and sealed by Steven Urich, P.E.
3. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum clad wood fixed window, prepared by Architectural Testing, Inc., Test Report No. **03-31488.06**, dated 8/28/02, signed and sealed by Steven Urich, P.E.
4. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum clad wood fixed window, prepared by Architectural Testing, Inc., Test Report No. **03-31488.08**, dated 8/27/02, signed and sealed by Steven Urich, P.E.


John Eisen, P.E.
Product Control Examiner
NOA No 03-0210.06

Expiration Date: February 26, 2006


Approval Date: April 24 2003

Pozzi Window Company

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA)

5. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum clad wood fixed window, prepared by Architectural Testing, Inc., Test Report No. **03-31488.10**, dated 8/26/02, signed and sealed by Steven Urich, P.E.
6. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum clad wood fixed window, prepared by Architectural Testing, Inc., Test Report No. **03-31488.11**, dated 8/27/02, signed and sealed by Steven Urich, P.E.
7. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum clad wood fixed window, prepared by Architectural Testing, Inc., Test Report No. **03-31488.12**, dated 8/27/02, signed and sealed by Steven Urich, P.E.
- Submitted under NOA#00-1003.02*
8. Test report on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with installation diagram of an aluminum clad wood fixed window, overall size 48" wide by 96" high, prepared by Hurricane Test Laboratory, Inc., report No. **HTL-0112-0412-00**, dated 04/19/00, signed and sealed by Vinu J. Abraham, P.E.

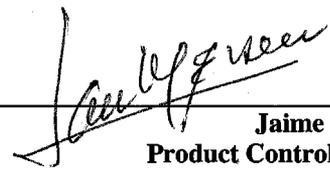

Jaime Eisen, P.E.
Product Control Examiner
NOA No 03-0210.06

Expiration Date: February 26, 2006

Approval Date: April 24 2003

Pozzi Window Company

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA)

9. Test report on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with installation diagram of aluminum clad wood fixed windows, overall sizes: 42" wide x 84" high & 48" wide by 96" high, prepared by Hurricane Test Laboratory, Inc., report No. **HTL-0112-0803-99**, dated 8/16/99, signed and sealed by Vinu J. Abraham, P.E.
10. Test report on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with installation diagram of an aluminum clad wood fixed window, overall size 60" wide x 120" high, prepared by Hurricane Test Laboratory, Inc., report No. **HTL-0112-0724-98**, dated 07/30/98, signed and sealed by Vinu J. Abraham, P.E.

Submitted under original file No. 97-0421.01

11. Test report on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with installation diagram of an aluminum clad wood fixed window, overall size 48" wide by 96" high, prepared by Hurricane Test Laboratory, Inc., report No. **HTL-0112-1007-96**, dated October 08, 1996 signed and sealed by Timothy S. Marshall, P.E.

C. CALCULATIONS


1. Anchor Calculations, dated 1/13/03, prepared by R.W. building Consultants, Inc., signed and sealed by Lyndon Schmidt, P.E.

Submitted under NOA#00-1003.02

2. Anchor calculations dated 9/25/00, prepared, signed and sealed by Mark Fetherman, P.E.

Submitted under original file No. 97-0421.01

3. Anchor calculations prepared by Tilteco Inc. dated 9/19/97, signed and sealed by Walter A. Tillit Jr., P.E.



Jaime Eisen, P.E.
Product Control Examiner
NOA No 03-0210.06
Expiration Date: February 26, 2006
Approval Date: April 24 2003

Pozzi Window Company

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA)

D. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **00-0524.06** issued to Nebula Glass International, Inc. for "Glasslam Safety-Plus Laminated Glass" dated 9/21/00, expiring on 9/9/03.

E. STATEMENTS

1. Statement letter of conformance & no financial interest, dated 1/13/03, signed and sealed by Lyndon Schmidt, P.E.
2. Statement letter of no financial interest, dated 1/13/03, signed by Steve Strawn
3. Letter from R.W Building Consultants, Inc., dated 3/18/03, responding to information requested on 3/3/03.

F. OTHER

1. Notice of Acceptance No. **00-1003.02** Pozzi Window Company, Series "Direct Set" Aluminum Clad Wood Fixed Window, approved on 2/15/01 and expiring on 2/26/06.






Jaime Eisen, P.E.
Product Control Examiner
NOA No 03-0210.06
Expiration Date: February 26, 2006
Approval Date: April 24 2003

POZZI WINDOW COMPANY

ALUMINUM CLAD WOOD WINDOWS
FIXED FRAME DIRECT SET SERIES (IMPACT)

GENERAL NOTES


1. THIS PRODUCT IS DESIGNED TO MEET THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. THIS SYSTEM MEETS THE REQUIREMENTS FOR WINDBORNE DEBRIS EXTERNAL PROTECTION AS PRESCRIBED IN SECTION 1626 OF THE FLORIDA BUILDING CODE.
5. FOR DESIGN PRESSURE RATING SEE CHART THIS PAGE:
6. THIS PRODUCT MEETS WATER REQUIREMENTS FOR THE "HIGH VELOCITY HURRICANE ZONES".
7. ASYMMETRIC SHAPES ALSO APPROVED FOR MIRROR IMAGE ABOUT VERTICAL AXIS.

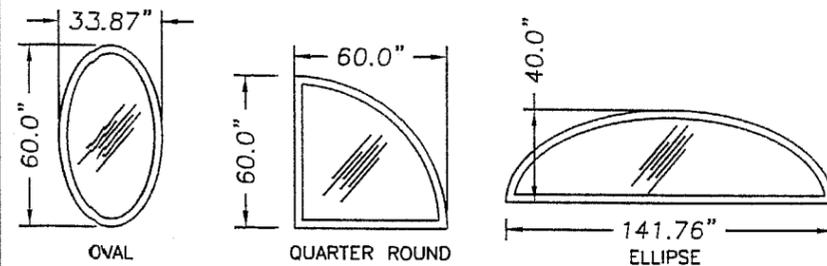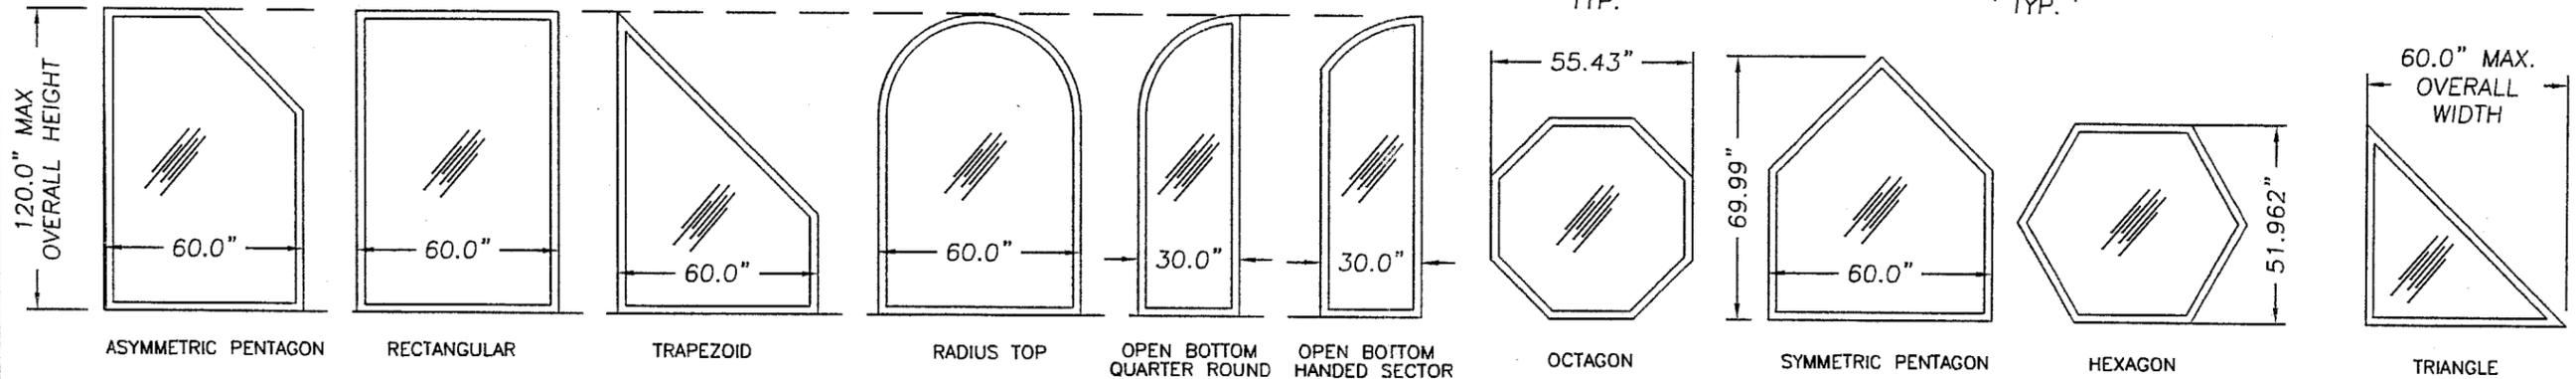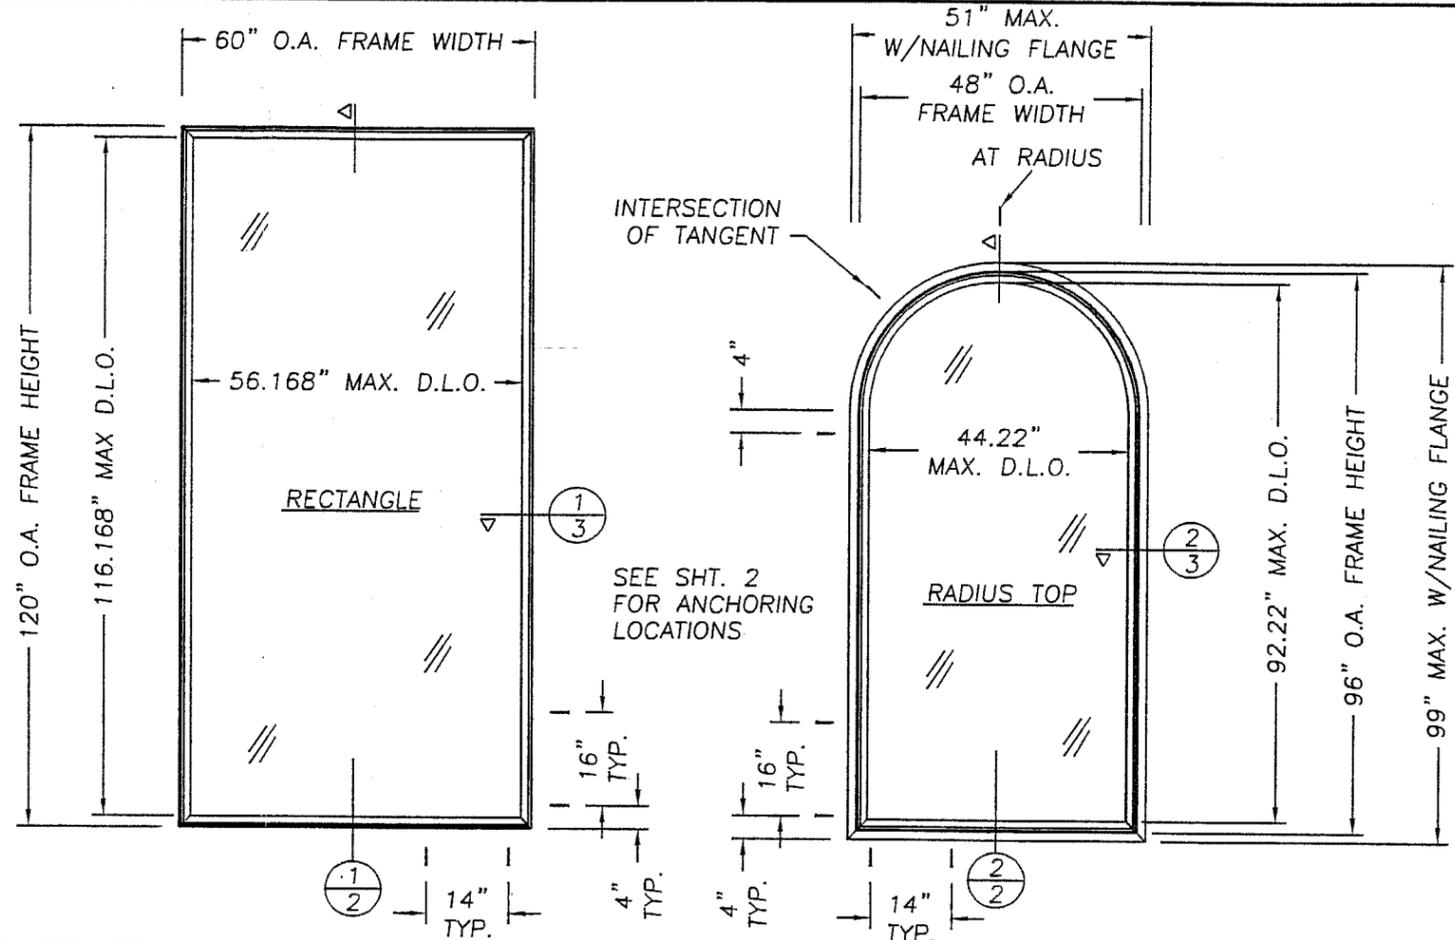

DESIGN PRESSURE RATING ALL MODELS SHOWN

GLASS TYPE	MAXIMUM LENGTH & WIDTH	MAXIMUM SQUARE FOOTAGE	DESIGN PRESSURE
1/4"-HS (LAM) 1/4"-HS	60" X 120"	50 SQ. FT.	+ 50.0 - 50.0
1/4"-ANN (LAM) 1/4"-ANN	48" X 96"	32 SQ. FT.	+ 65.0 - 65.0
1/4"-ANN (LAM) 1/4"-ANN	48" X 60"	20 SQ. FT.	+ 75.0 - 75.0
3/16"-ANN (LAM) 3/16"-ANN	36" X 60"	15 SQ. FT.	+ 75.0 - 75.0

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATION
2	VERTICAL CROSS SECTION & GLAZING DETAILS
3	HORIZONTAL CROSS SECTIONS & ANCHOR NOTES
4	FRAME CONSTRUCTION DETAILS
5	COMPONENTS & BILL OF MATERIALS

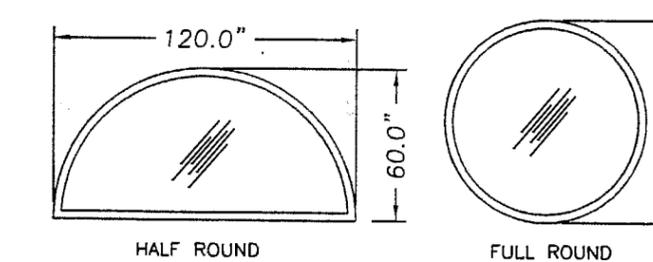

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411

PRODUCT: DIRECT SET FIXED ALUMINUM CLAD WOOD WINDOWS

PART OR ASSEMBLY: GENERAL NOTES & ELEVATIONS


REVISIONS	
NO.	DATE
1	3/18/03

GENERAL REVISIONS ZRK BY


RW BUILDING CONSULTANTS, INC.
813.659.9197

PRODUCT REVISED to comply with the Florida Building Code
Acceptance No 03-0210.06
Expiration Date 02/26/04
By Miami Division Product Control

DATE: 9/09/97
SCALE: N.T.S.
DWG. BY: ZRK
CHK. BY: RW
DRAWING NO.: DS-1
SHEET 1 OF 5

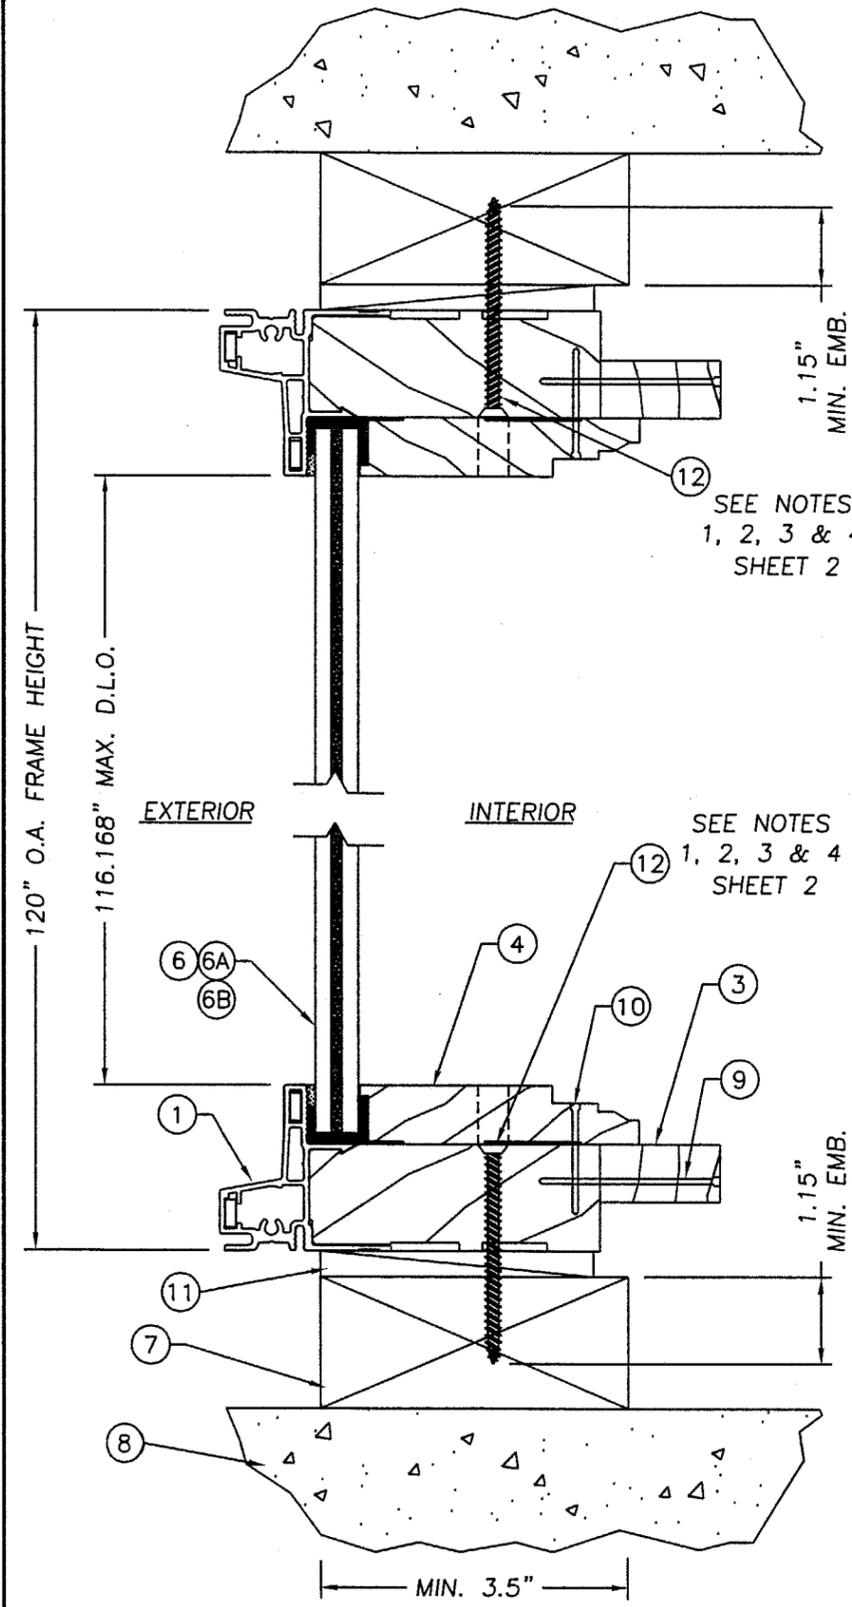

1 VERTICAL CROSS SECTION, TYP.
2 WITHOUT NAILING FLANGE

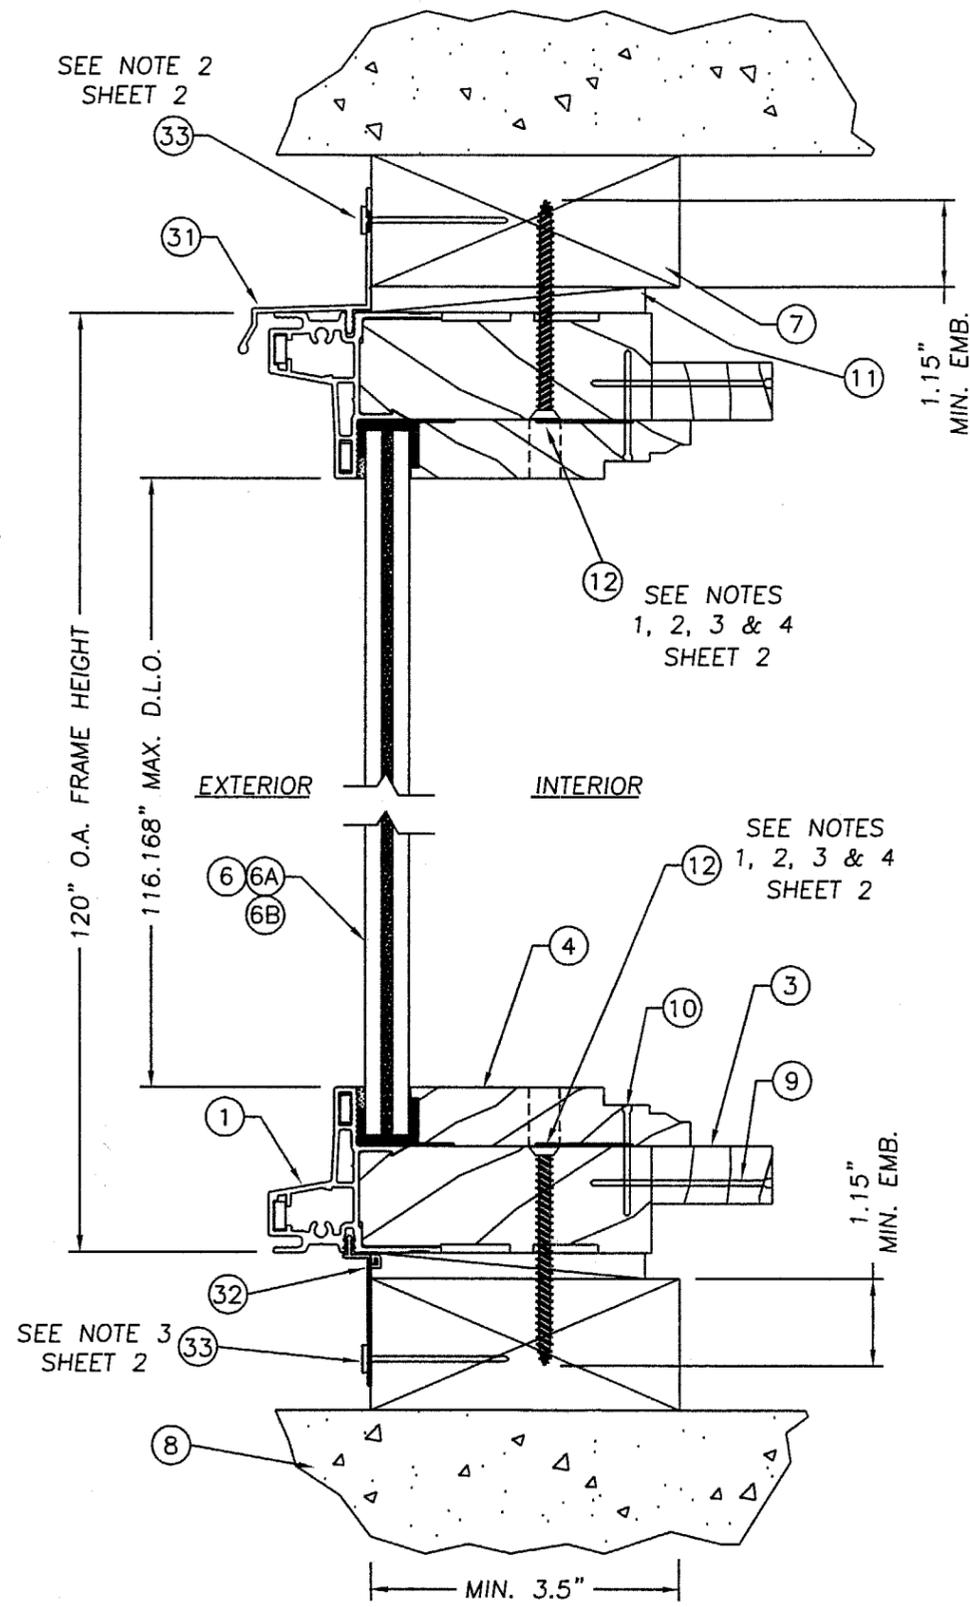

1 VERTICAL CROSS SECTION
2 WITH NAILING FLANGE & OPTIONAL DRIP CAP

NOTES: ANCHORING FASTENING TO WOOD SUB-BUCKS

1. RECTANGULAR UNITS -
SHORT SIDE - 4" FROM EACH CORNER AND MAX. 14" ON CENTER.
LONG SIDE - 4" FROM EACH CORNER AND MAX. 16" ON CENTER.
2. GEOMETRIC UNITS -
ALL SIDE - 4" FROM EACH CORNER AND MAX. 12" ON CENTER.
3. RADIUS UNITS -
SILL - 4" FROM EACH CORNER AND MAX. 14" ON CENTER.
LONG SIDE - 4" FROM EACH CORNER AND MAX. 16" ON CENTER.
AT RADIUS - 1 FASTENER AND IF UNIT EXCEEDS 60" IN HEIGHT ADD ADDITIONAL FASTENER 4" BELOW SPRINGLINE.
1 ADDITIONAL FASTENER IS INSTALLED AT EACH INTERSECTION OF THE TANGENTS OF THE FRAME AND THE BUCK WHICH IS CUT AT A 45° ANGLE TO THE FRAME (MIN. 3 PER RADIUS).
4. OVAL AND CIRCULAR UNITS -
ALL SIDES MAX. 12" ON CENTER CONTINUOUS.
5. NAILING FLANGES -
4" FROM EACH CORNER AND A MAX 16" ON CENTER.
(NAILING FLANGE IS NOT STRUCTURAL, ANCHORS THROUGH JAMBS MUST BE USED)

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411


PRODUCT: DIRECT SET FIXED ALUMINUM CLAD WOOD WINDOWS
PART OR ASSEMBLY: VERTICAL CROSS SECTIONS

NO.	DATE	GENERAL REVISIONS	ZRK	BY
1	3/18/03			


RW BUILDING CONSULTANTS, INC.
813.659.9197

DATE: 9/09/97
SCALE: N.T.S.
DWG. BY: PHG
CHK. BY: RW
DRAWING NO.: DS-1
SHEET 2 OF 5




PRODUCT REVISED as complying with the Florida Building Code
Acceptance No 03-0210.06
Expiration Date 02/24/06
By *[Signature]*
Miami Building Product Control Division

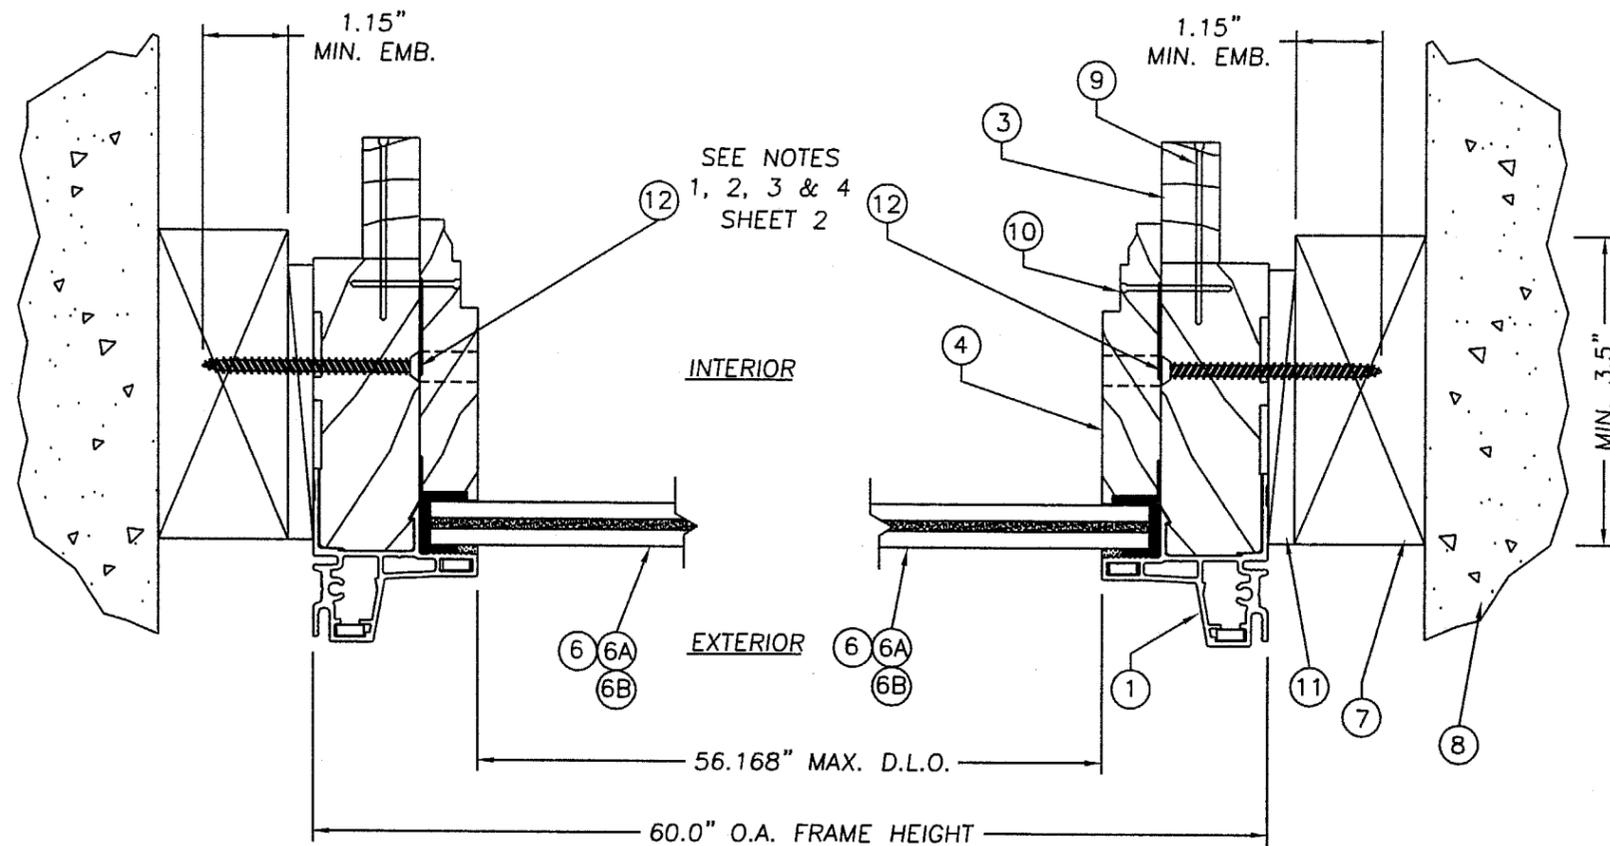

1 HORIZONTAL CROSS SECTION, TYP. WITHOUT NAILING FLANGE

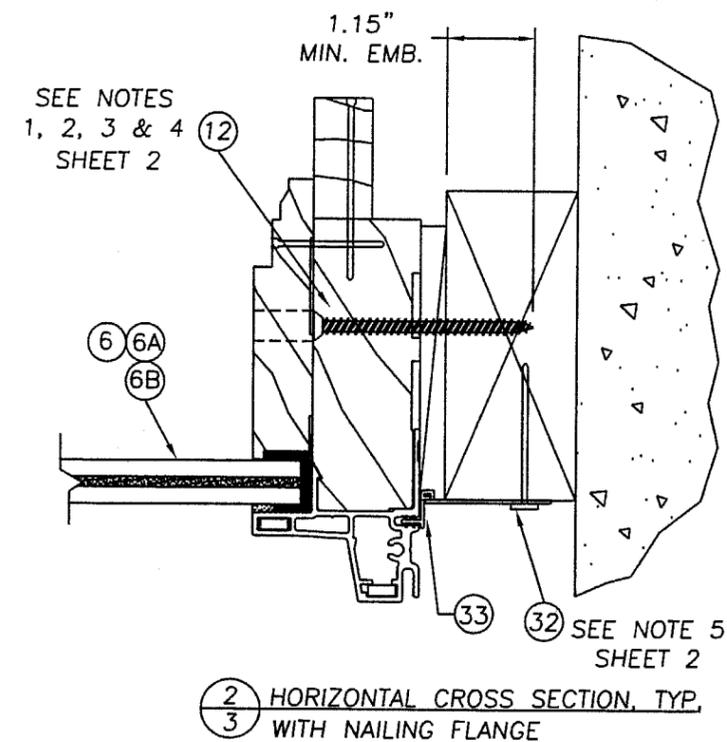

2 HORIZONTAL CROSS SECTION, TYP. WITH NAILING FLANGE

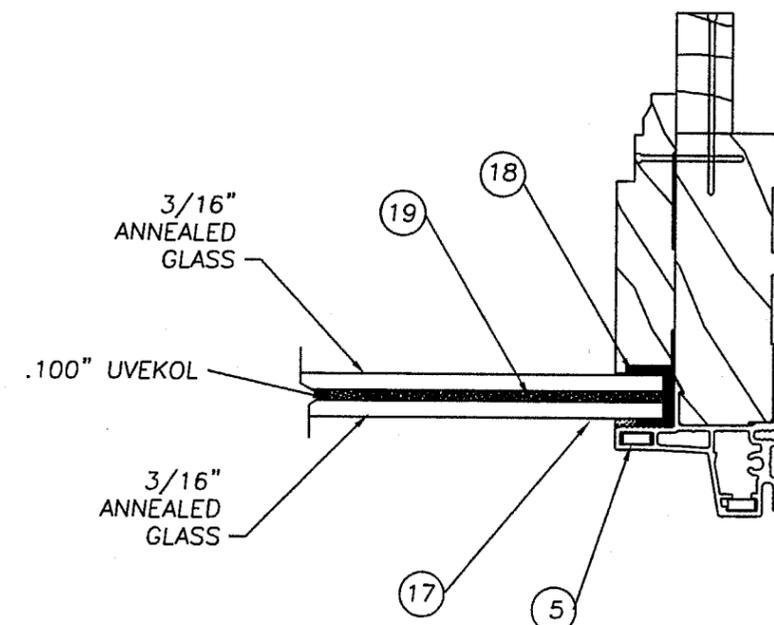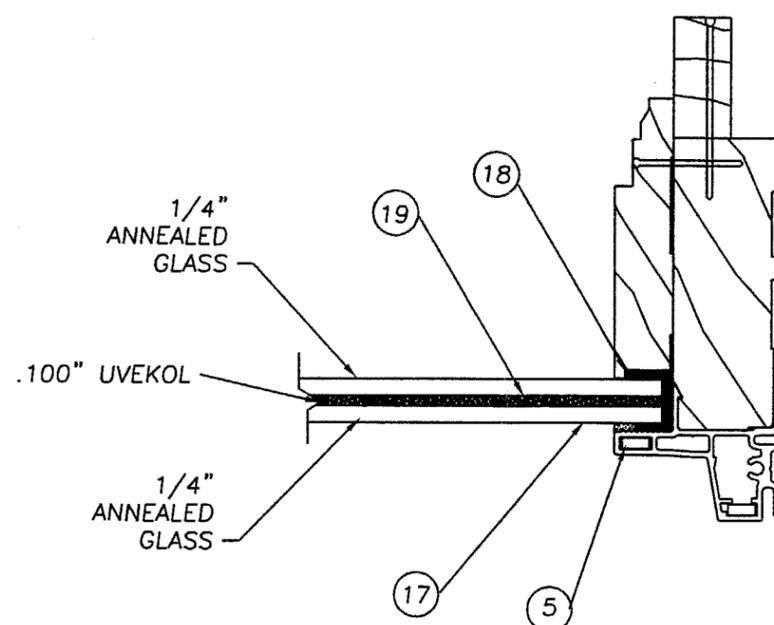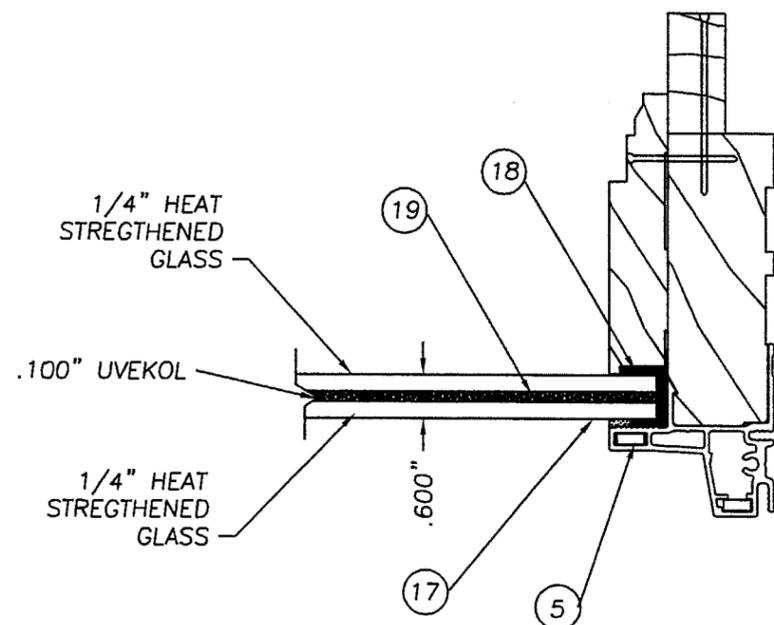

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411


PRODUCT: DIRECT SET FIXED ALUMINUM CLAD WOOD WINDOWS
PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS

NO.	DATE	GENERAL REVISIONS	ZRK	BY
1	3/18/03			

RW BUILDING CONSULTANTS, INC.
813.659.9197

PRODUCT REVISED as complying with the Florida Building Code
Acceptance No. 03-0210.06
Expiration Date 02/26/04
By: *[Signature]*
Miami Division Product Control


DATE: 9/09/97
SCALE: N.T.S.
DWG. BY: PHG
CHK. BY: RW
DRAWING NO.: DS-1
SHEET 3 OF 5

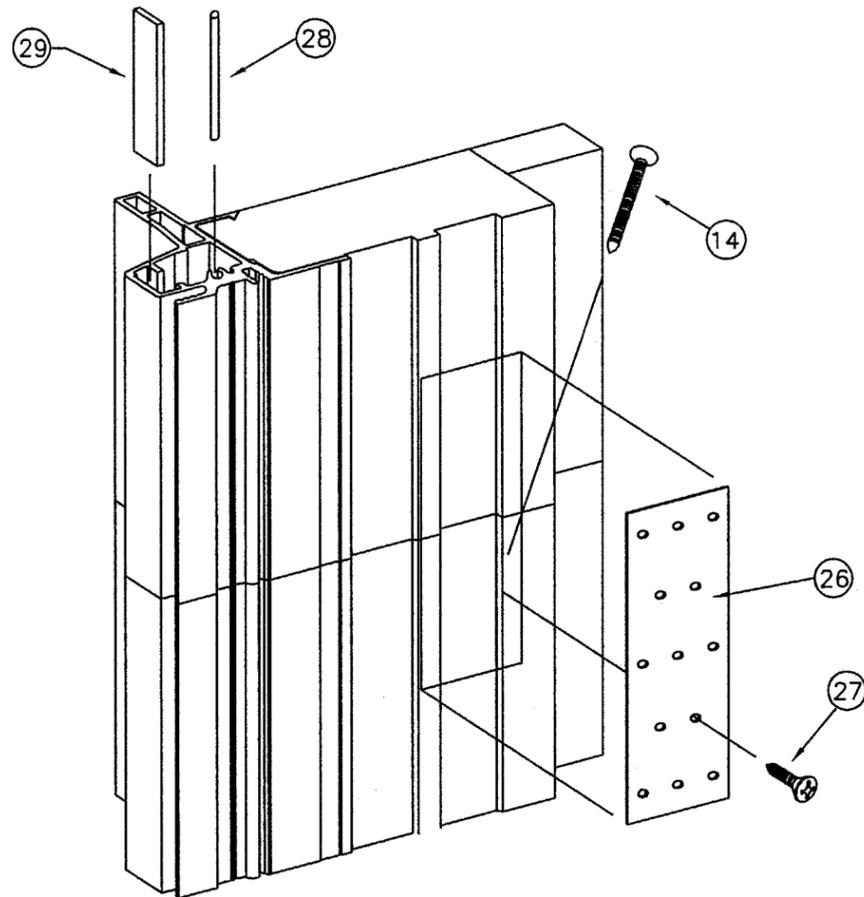

DETAIL "A"
SPRING LINE FRAME SUPPORT SYSTEM

RADIUS FRAME CONSTRUCTION:

FRAME CONSTRUCTION ON RADIUS UNITS IS CONSISTANT TO STRAIGHT LINE OTHER THAN THE JAMB IS SUPPORTED AT THE SPRING LINE OF THE SIDE JAMB WITH A SCREW PLATE WHICH IS SECURED WITH 10 - #8 x 3/4" SELF-TAPPING SCREWS (5 IN EA. JAMB). IN ADDITION, THE METAL EXTRUSION IS SUPPORTED WITH A 1/8" x 3" BRASS ROD IN THE SCREW BOSS AND A 1/8" x 11/32" x 3" STRAIGHT FRAME KEY WHICH IS POSITIONED INTO THE CORNER KEY SLOT OF THE TWO JAMBS. A #8 x 2" FLT. HD. PHL. SCREW IS FASTENED DIAGONALLY FROM THE UPPER JAMB TO THE LOWER BEFORE THE JAMB EXTENSION IS APPLIED. THIS COMPLETES THE INSTALLATION.

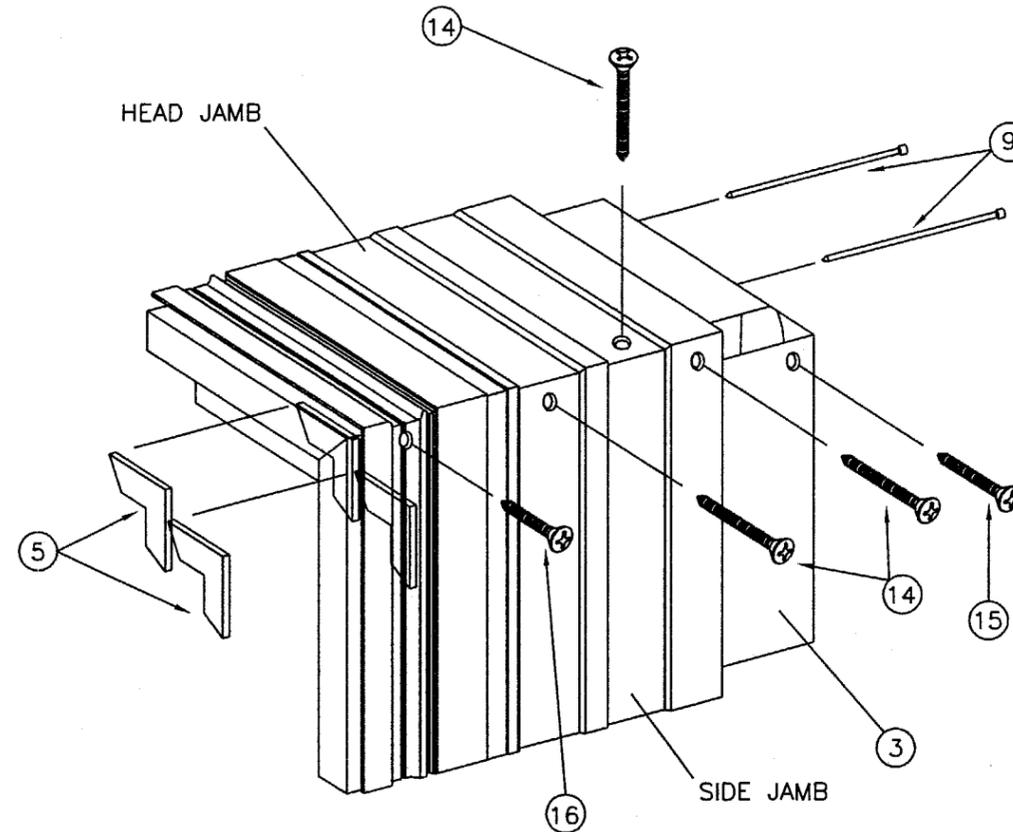

DETAIL "B"
FRAME CORNER FASTENER DETAIL

FRAME CONSTRUCTION:

THE WOOD FRAME IS 3.344" x 1.218" FINGER-JOINTED PONDEROSA PINE. THE FRAME METAL IS 1.969" x 1.875" x .060" WALL EXTRUDED ALUMINUM. THE FRAME METAL IS SNAPPED AND STAPLED ONTO THE WOOD JAMB AND MITRED AND SEALED WITH SILICONE (1199 DOW CORNING). EACH CORNER IS FASTENED WITH (3) #8 x 2" FLT. HD. PHL. SCREWS. TWO IN ONE JAMB AND ONE IN THE ADJOINING JAMB AT THE MITRE. AN ADDITIONAL #8 x 1" FLT. HD. PHL. SCREW IS APPLIED INTO THE SCREW BOSS OF THE ALUMINUM EXTRUSION AND (2) CORNER KEYS .125" x .344" INTO THE SLOTS OF THE ALUMINUM EXTRUSION TO COMPLETE THE CORNER CONSTRUCTION. THE JAMB EXTENSION IS 1.375" x .656" PONDEROSA PINE ATTACHED TO THE WOOD JAMB WITH 2" x 15 GA. NAILS 1" FROM THE END AND 8" O.C. AND SCREWED AT CORNERS WITH #8 x 1 1/2" FLT. HD. PHL. SCREWS.

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411

PRODUCT: DIRECT SET FIXED ALUMINUM CLAD WOOD WINDOWS
PART OR ASSEMBLY: FRAME CONSTRUCTION DETAILS


NO.	DATE	GENERAL REVISIONS	ZRK	BY
1	3/18/03			

RW BUILDING CONSULTANTS, INC.
813.659.9197


DATE: 9/09/97
SCALE: N.T.S.
DWG. BY: P.H.G.
CHK. BY: RW
DRAWING NO.: DS-1
SHEET 4 OF 5

PRODUCT REVISED as complying with the Florida Building Code
Acceptance No. 03-0210.06
Expiration Date 02/26/06
By: *[Signature]*
Miami Product Control Division


REVISIONS

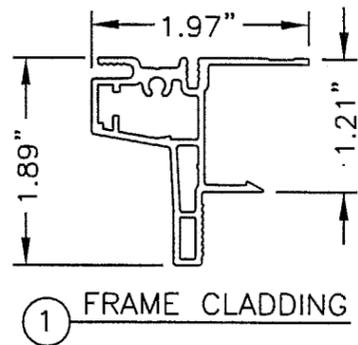


① FRAME CLADDING

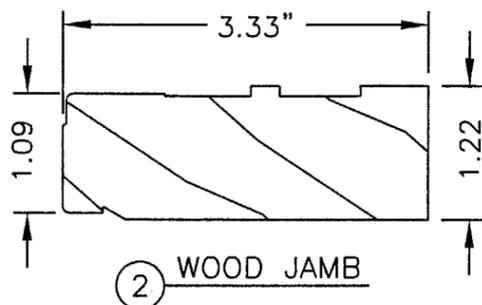


② WOOD JAMB

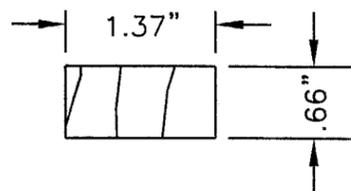


③ JAMB EXTENDER

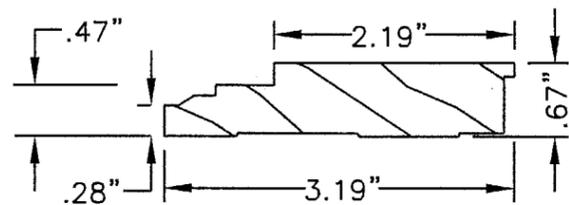


④ GLASS STOP (UCB)

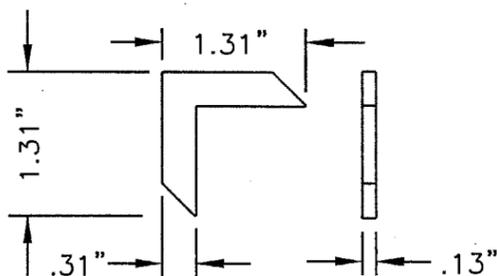


⑤ CORNER KEY

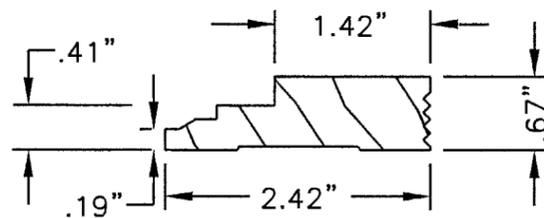

②① GLASS STOP (IG)

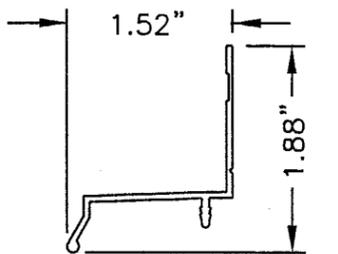

③① OPTIONAL DRIPCAP

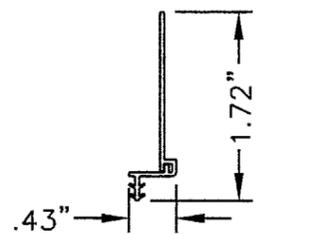

③② OPTIONAL NAILFIN

MATERIALS LIST

ITEM	PART#	DESCRIPTION	MATERIAL
1	AC-90R1	ALUMINUM FRAME CLADDING - .060 WALL (ANODIZING INC.)	6063-T5 ALUM.
2	AC-151	WOOD JAMB F/J LINEAL - (BMC)	PONDEROSA PINE
3	AC-11	WOOD 4 9/16" JAMB EXTENDER - (BMC)	CLEAR PINE
4	AC-173	WOOD GLASS STOP - UCB (BMC)	CLEAR PINE
5	AC-74	FRAME CORNER KEY - 2 EA. (MITCHELL METAL)	6061-T6511 ALUM.
6	N/A	1/2" HEAT STRENGTHENED LAMINATED GLASS - IMPACT RESISTANT	
6A	N/A	1/2" ANNEALED LAMINATED GLASS	
6B	N/A	3/8" ANNEALED LAMINATED GLASS	
7	N/A	PRESSURE TREATED 2X BUCK	P.T. WOOD
8	N/A	NOT USED	
9	N/A	2" x 15 GA. FINISH NAIL - (STANLEY/BOSTICH)	STEEL
10	N/A	1 1/4" x 16 GA. FINISH NAIL - (STANLEY/BOSTICH)	STEEL
11	N/A	1/4" WOOD SHIM	
12	N/A	#10 x 3" P.H.F.H. WOOD SCREW (CROWN FASTENERS)	STEEL
13	N/A	NOT USED	STEEL
14	N/A	#8 x 2" P.H.F.H. WOOD SCREW (CROWN FASTENERS)	STEEL
15	N/A	#8 x 1 1/2" P.H.F.H. WOOD SCREW (CROWN FASTENERS)	STEEL
16	N/A	#8 x 1" P.H.F.H. METAL SCREW (CROWN FASTENERS)	COLOR MATCH STL.
17	N/A	1/4" x 1/8" GLAZING TAPE (3M)	
18	N/A	#995 SEALANT (DOW CORNING)	SEALANT
19	N/A	UVEKOL S RESIN INTERLAYER (UCB CHEMICAL CORP.)	
20	N/A	NOT USED	
21	AC-147	WOOD GLASS STOP - IG (BMC)	CLEAR PINE
22	N/A	NOT USED	
23	N/A	NOT USED	
24	N/A	NOT USED	
25	N/A	#1199 SEALANT (DOW CORNING)	SEALANT
26	N/A	1 13/16" x 5" SCREW PLATE	SIMPSON
27	N/A	#8 x 3/4" SELF-TAPPING P.H.F.H. WOOD SCREW	STEEL
28	N/A	1/8" x 3" BRASS ROD	BRASS
29	N/A	1/8" x 11 3/32" x 3" STRAIGHT FRAME KEY	STEEL
30	N/A	ULTRAEDGE GLASS SPACER	STEEL
31	N/A	DRIPCAP - (ANODIZING INC.)	6061-T6511 ALUM.
32	N/A	FOLDING NAILING FLANGE - (AMESBURY)	POLY
33	N/A	11 GA. 1-5/8" ROOFING NAIL	GALV. STL.

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411

PRODUCT: DIRECT SET FIXED ALUMINUM CLAD WOOD WINDOWS
PART OR ASSEMBLY: COMPONENTS & BILL OF MATERIALS

NO.	DATE	GENERAL REVISIONS	ZRK	BY
1	3/18/03			

RW BUILDING CONSULTANTS, INC.
813.659.9197

PRODUCT REVISED as complying with the Florida Building Code
Acceptance No. 03-0210.06
Expiration Date 02/26/06
By: *[Signature]*
Division: Product Control

DATE: 1/14/03
SCALE: N.T.S.
DWG. BY: ZRK
CHK. BY: RW
DRAWING NO.: DS-1
SHEET 5 OF 5