



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Pozzi Window Company
62845 Boyd Acres Road
Bend, OR 97701**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series "GPD" Aluminum Clad Wood Gliding Patio Door

APPROVAL DOCUMENT: Drawing No. S-2334, titled "Aluminum Clad Wood Gliding Patio Door", sheets 1 through 7 of 7, prepared by R.W. Building Consultants, Inc., dated 1/20/03 with revision on 5/7/03, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 as well as approval document mentioned above.

The submitted documentation was reviewed by **Theodore Berman, P.E.**

TMB
6/4/2003



**NOA No 03-0213.12
Expiration Date: June 26, 2008
Approval Date: June 26, 2003**

Pozzi Window Company

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA)

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **S-2334**, titled "Aluminum Clad Wood Gliding Patio Door", sheets 1 through 7 of 7, prepared by R.W. Building Consultants, Inc., dated 1/20/03 with revision on 5/7/03.

B. TESTS

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
along with marked-up drawings and installation diagram of a gliding patio door, prepared by Architectural Testing, Inc., Test Report No. ATI 03-31490.02 dated 12/11/02, signed and sealed by Steven Urich, P.E.

C. CALCULATIONS

1. Anchor Calculations and structural analysis, prepared by R.W. Building Consultants, Inc., dated 4/16/03, signed and sealed by Lyndon Schmidt, P.E.

D. MATERIAL CERTIFICATIONS

1. None

E. STATEMENTS

1. Statement letter of conformance, dated 1/30/03, signed and sealed by Lyndon Schmidt, P.E.
2. Statement letter of no financial interest, dated 12/12/02, signed by Steve Strawn, P.E.
3. Letter from R.W Building Consultants, Inc., dated 4/17/03, responding to information requested on 2/25/03.

F. OTHER

1. Letter from the consultant that the product is in compliance with the Florida Building Code (FBC).




Theodore Berman, P.E.
Deputy Director, Product Control Division
NOA No 03-0213.12
Expiration Date: June 26, 2008
Approval Date: June 26, 2003

POZZI WINDOW COMPANY

ALUMINUM CLAD WOOD GLIDING PATIO DOOR


GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. THIS SYSTEM REQUIRES WINDBORNE DEBRIS EXTERNAL PROTECTION AS PRESCRIBED IN SECTION 1626.1 OF THE FLORIDA BUILDING CODE.
5. DESIGN PRESSURE RATING SHOWN THIS PAGE:
FOR DETAILED DESIGN PRESSURES WITH APPROPRIATE GLASS SPECIFICATIONS SEE TABLE 1 SHEET 2.
6. THIS PRODUCT MEETS WATER REQUIREMENTS FOR THE "HIGH VELOCITY HURRICANE ZONES".

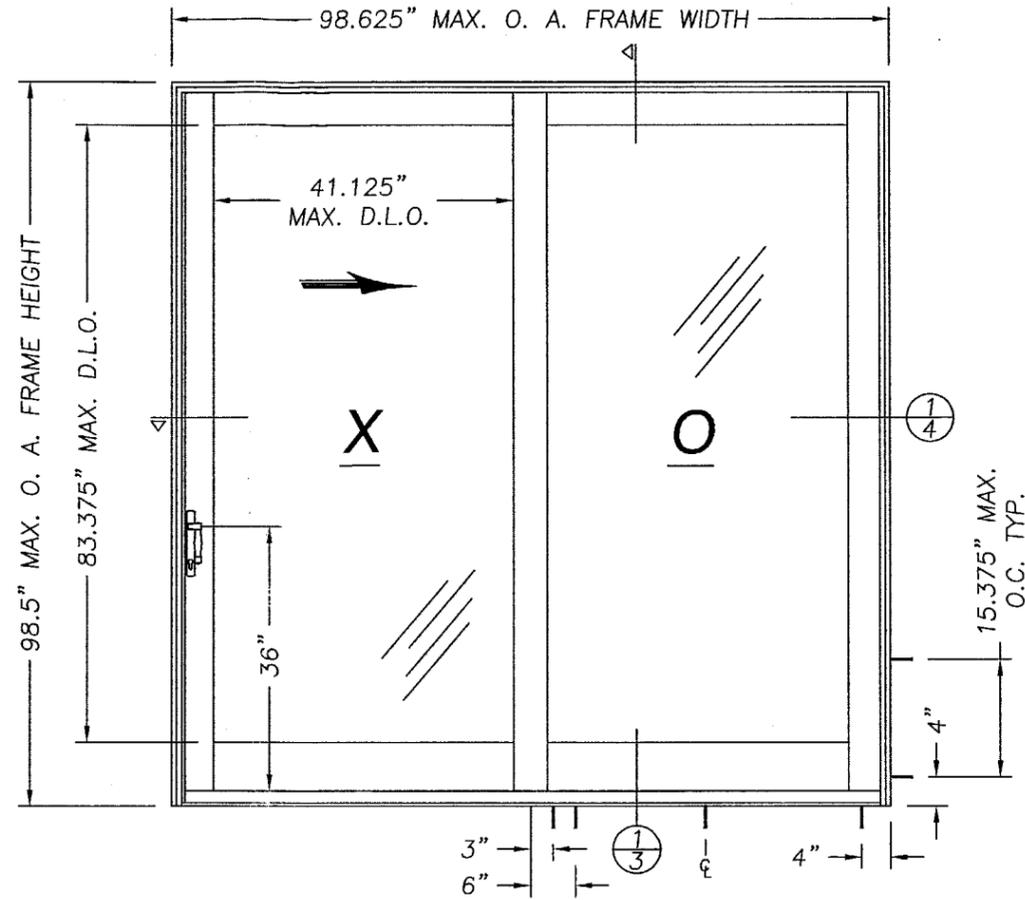


SEE ANCHORING NOTES
SHTS. 3 & 4


CLAD GLIDING PATIO DOOR

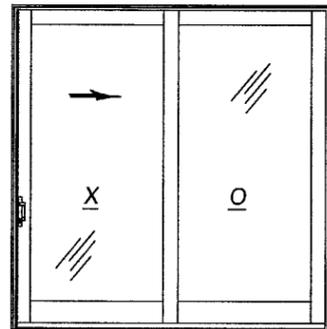


98.625" x 98.5"
DESIGN PRESSURE
POSITIVE +50.0
NEGATIVE -50.0

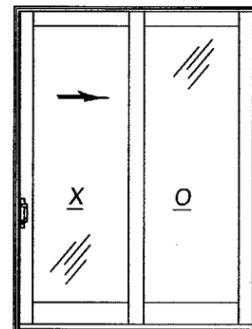


74.625" x 98.5"
DESIGN PRESSURE
POSITIVE +60.0
NEGATIVE -65.0

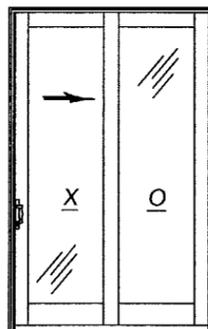


62.625" x 98.5"
DESIGN PRESSURE
POSITIVE +60.0
NEGATIVE -70.0

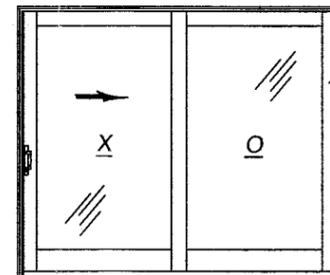

98.625" x 82.5"
DESIGN PRESSURE
POSITIVE +60.0
NEGATIVE -60.0



74.625" x 82.5"
DESIGN PRESSURE
POSITIVE +60.0
NEGATIVE -70.0



62.625" x 82.5"
DESIGN PRESSURE
POSITIVE +60.0
NEGATIVE -70.0

TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATIONS
2	GLAZING DETAILS
3	VERTICAL CROSS SECTION & FRAME CONSTRUCTION
4	HORIZONTAL CROSS SECTION
5	DOOR PANEL CONSTRUCTION
6	BILL OF MATERIALS & UNIT COMPONENTS
7	BILL OF MATERIALS & UNIT COMPONENTS

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411

PRODUCT: POZZI
ALUMINUM CLAD WOOD
GLIDING PATIO DOOR
PART OR ASSEMBLY:
GENERAL NOTES &
TYPICAL ELEVATIONS


NO.	DATE	REVISIONS	BY
2	5/07/03	REVISE ANCHORING	RW
1	3/04/03	PER DADE COMMENTS	TJH

RW BUILDING
CONSULTANTS, INC.
813.659.9197

Approved as complying with the
Florida Building Code
Date 06/26/03
NOA# 03-0213.12
Miami Dade Product Control
By *Cherelle Keema*

DATE: 1/20/03
SCALE: N.T.S.
DWG. BY: ZRK
CHK. BY: RW
DRAWING NO.:
S-2334
SHEET 1 OF 7

TABLE 1 - GLAZING SPECIFICATIONS					
OPENING	GLAZING DESCRIPTION	D.L.O.	MAX. SQ. FEET GLASS	DP POS.	DP NEG.
UP TO 8'0" X 8'0"	3/4" INSULATED GLASS 3/16" TEMP. - AIR - 3/16" TEMP.	41.175" X 83.926"	24.00 SQ. FEET	+ 50.0 PSF	- 50.0 PSF
UP TO 6'0" X 8'0"	3/4" INSULATED GLASS 3/16" TEMP. - AIR - 3/16" TEMP.	29.175" X 83.926"	17.00 SQ. FEET	+ 60.0 PSF	- 65.0 PSF
UP TO 5'0" X 8'0"	3/4" INSULATED GLASS 3/16" TEMP. - AIR - 3/16" TEMP.	23.175" X 83.926"	13.50 SQ. FEET	+ 60.0 PSF	- 70.0 PSF
UP TO 8'0" X 6'8"	3/4" INSULATED GLASS 3/16" TEMP. - AIR - 3/16" TEMP.	41.175" X 67.926"	19.42 SQ. FEET	+ 60.0 PSF	- 60.0 PSF
UP TO 6'0" X 6'8"	3/4" INSULATED GLASS 3/16" TEMP. - AIR - 3/16" TEMP.	29.175" X 67.926"	13.76 SQ. FEET	+ 60.0 PSF	- 70.0 PSF
UP TO 5'0" X 6'8"	3/4" INSULATED GLASS 3/16" TEMP. - AIR - 3/16" TEMP.	23.175" X 67.926"	10.93 SQ. FEET	+ 60.0 PSF	- 70.0 PSF

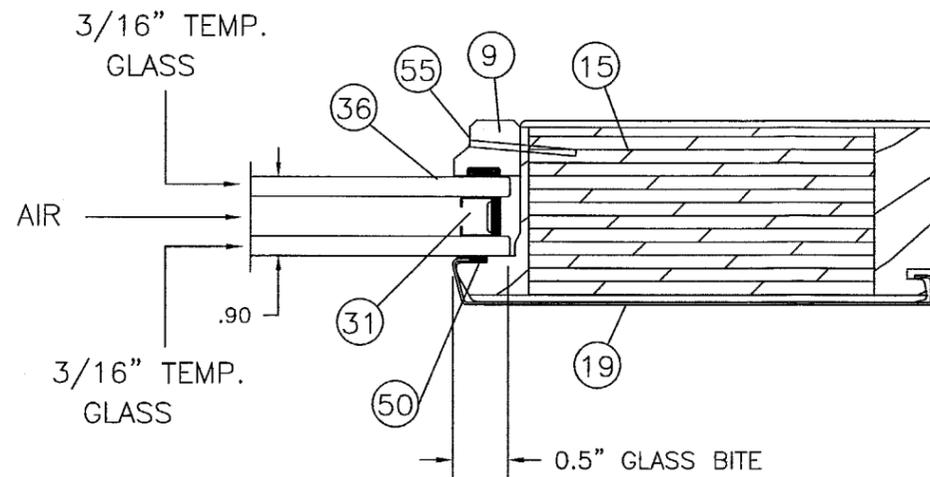

INSULATED GLASS DETAIL
ULTRAEDGE™ GLASS SPACER

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411


PRODUCT: POZZI
ALUMINUM CLAD WOOD
GLIDING PATIO DOOR
PART OR ASSEMBLY:
GLAZING DETAILS

NO.	DATE	REVISIONS
2	5/07/03	REVISE ANCHORING
1	3/04/03	PER DADE COMMENTS
		BY
		TJH
		RW

RW BUILDING
CONSULTANTS, INC.
813.659.9197

Approved as complying with the
Florida Building Code
Date 06/26/03
NOA# 03-0213.12
Miami Dade Product Control
Division
By: Cleopatra Berman

DATE: 1/20/03
SCALE: N.T.S.
DWG. BY: ZRK
CHK. BY: RW
DRAWING NO.:
S-2334
SHEET 2 OF 7

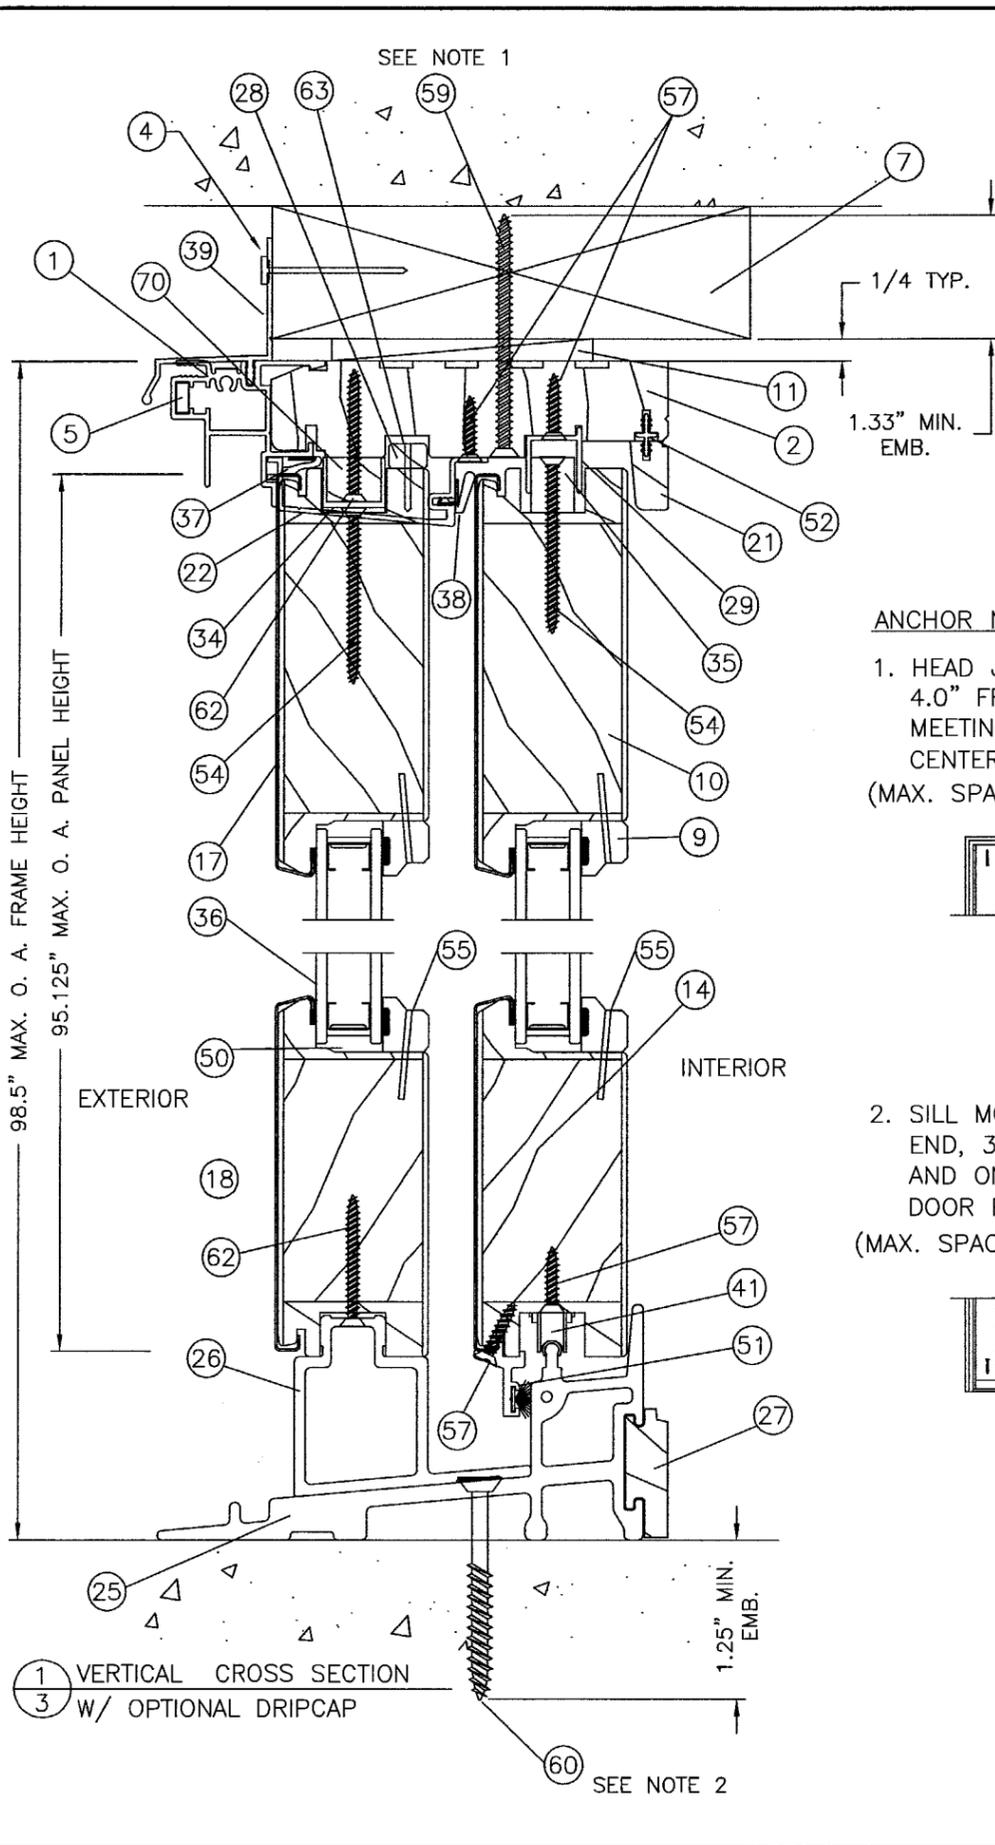


1 VERTICAL CROSS SECTION
3 W/ OPTIONAL DRIPCAP


SEE NOTE 2

ANCHOR NOTES:


1. HEAD JAMB MOUNTING SCREWS ARE LOCATED; 4.0" FROM EACH END, 3.0" AND 6.0" EACH SIDE OF MEETING STILES AND ONE ADDITIONAL ABOVE THE CENTER OF EACH DOOR PANEL. (MAX. SPACING BETWEEN ANCHORS CANNOT EXCEED 15.375")



2. SILL MOUNTING SCREWS ARE LOCATED 4.0" FROM EACH END, 3.0" AND 6.0" EACH SIDE OF MEETING STILES AND ONE ADDITIONAL BELOW THE CENTER OF EACH DOOR PANEL. (MAX. SPACING BETWEEN ANCHORS CANNOT EXCEED 15.375")

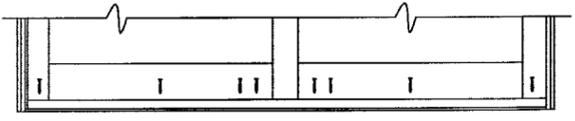

NOTE:
HEAD BUMPER IS ATTACHED INTO SILL TRACK AND UP AGAINST THE SIDE JAMB. (68)

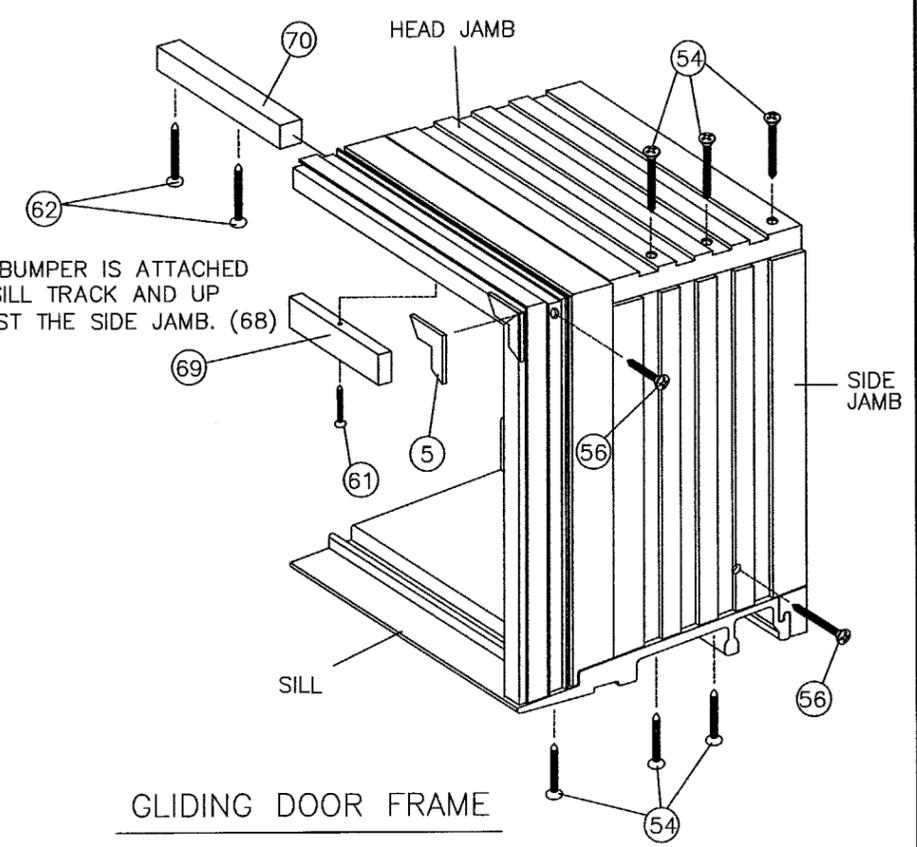

GLIDING DOOR FRAME

FRAME CONSTRUCTION:

THE WOOD FRAME, ITEM NUMBERS 2 & 3, IS 4.5625" x 1.0938" PONDEROSA PINE. THE FRAME METAL, ITEM NUMBERS 1 & 16, IS 1.800" x 1.660" x .060" WALL EXTRUDED ALUMINUM. THE FRAME METAL IS SNAPPED ONTO THE WOOD JAMB WITH A LAP JOINT AT THE HEAD CORNERS AND SEALED WITH SILICONE 1199 DOW CORNING, ITEM NUMBER 50. EACH HEAD CORNER IS FASTENED WITH (3) #8 x 2" FLT. HD. PHL. SCREWS, ITEM NUMBER 54. AN ADDITIONAL #8 x 1" FLT. HD. PHL. SCREW, ITEM NUMBER 56, IS APPLIED INTO THE SCREW BOSS OF THE ALUMINUM EXTRUSION AND A CORNER KEY .125" x 11/32", ITEM NUMBER 5, INTO THE SLOT OF THE ALUMINUM EXTRUSION TO COMPLETE THE CORNER. THE SILL, ITEM NUMBER 25, IS ATTACHED WITH (3) #8 x 2" FLT. HD. PHL. SCREWS, ITEM NUMBER 54, UP THROUGH THE SILL INTO THE SIDE JAMB. AN ADDITIONAL #8 x 1" FLT. HD. PHL. SCREW, ITEM NUMBER 56, IS APPLIED UP THROUGH THE SIDE JAMB INTO THE SILL BASE AND A GASKET IS APPLIED BETWEEN THEM TO COMPLETE THE INSTALLATION.

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411


PRODUCT: POZZI ALUMINUM CLAD WOOD GLIDING PATIO DOOR
PART OR ASSEMBLY: VERTICAL CROSS SECTION & FRAME CONSTRUCTION

REVISIONS	
NO.	DATE
2	5/07/03 REVISE ANCHORING
1	3/04/03 PER DADE COMMENTS
	TJH
	BY

RW BUILDING CONSULTANTS, INC.
813.659.9197


Approved as complying with the Florida Building Code
Date 06/26/03
NOA# 03-0213.12
Miami Dade Product Control
By *Clayton Beaman*

DATE: 1/20/03
SCALE: N.T.S.
DWG. BY: ZRK
CHK. BY: RW
DRAWING NO.: S-2334
SHEET 3 OF 7

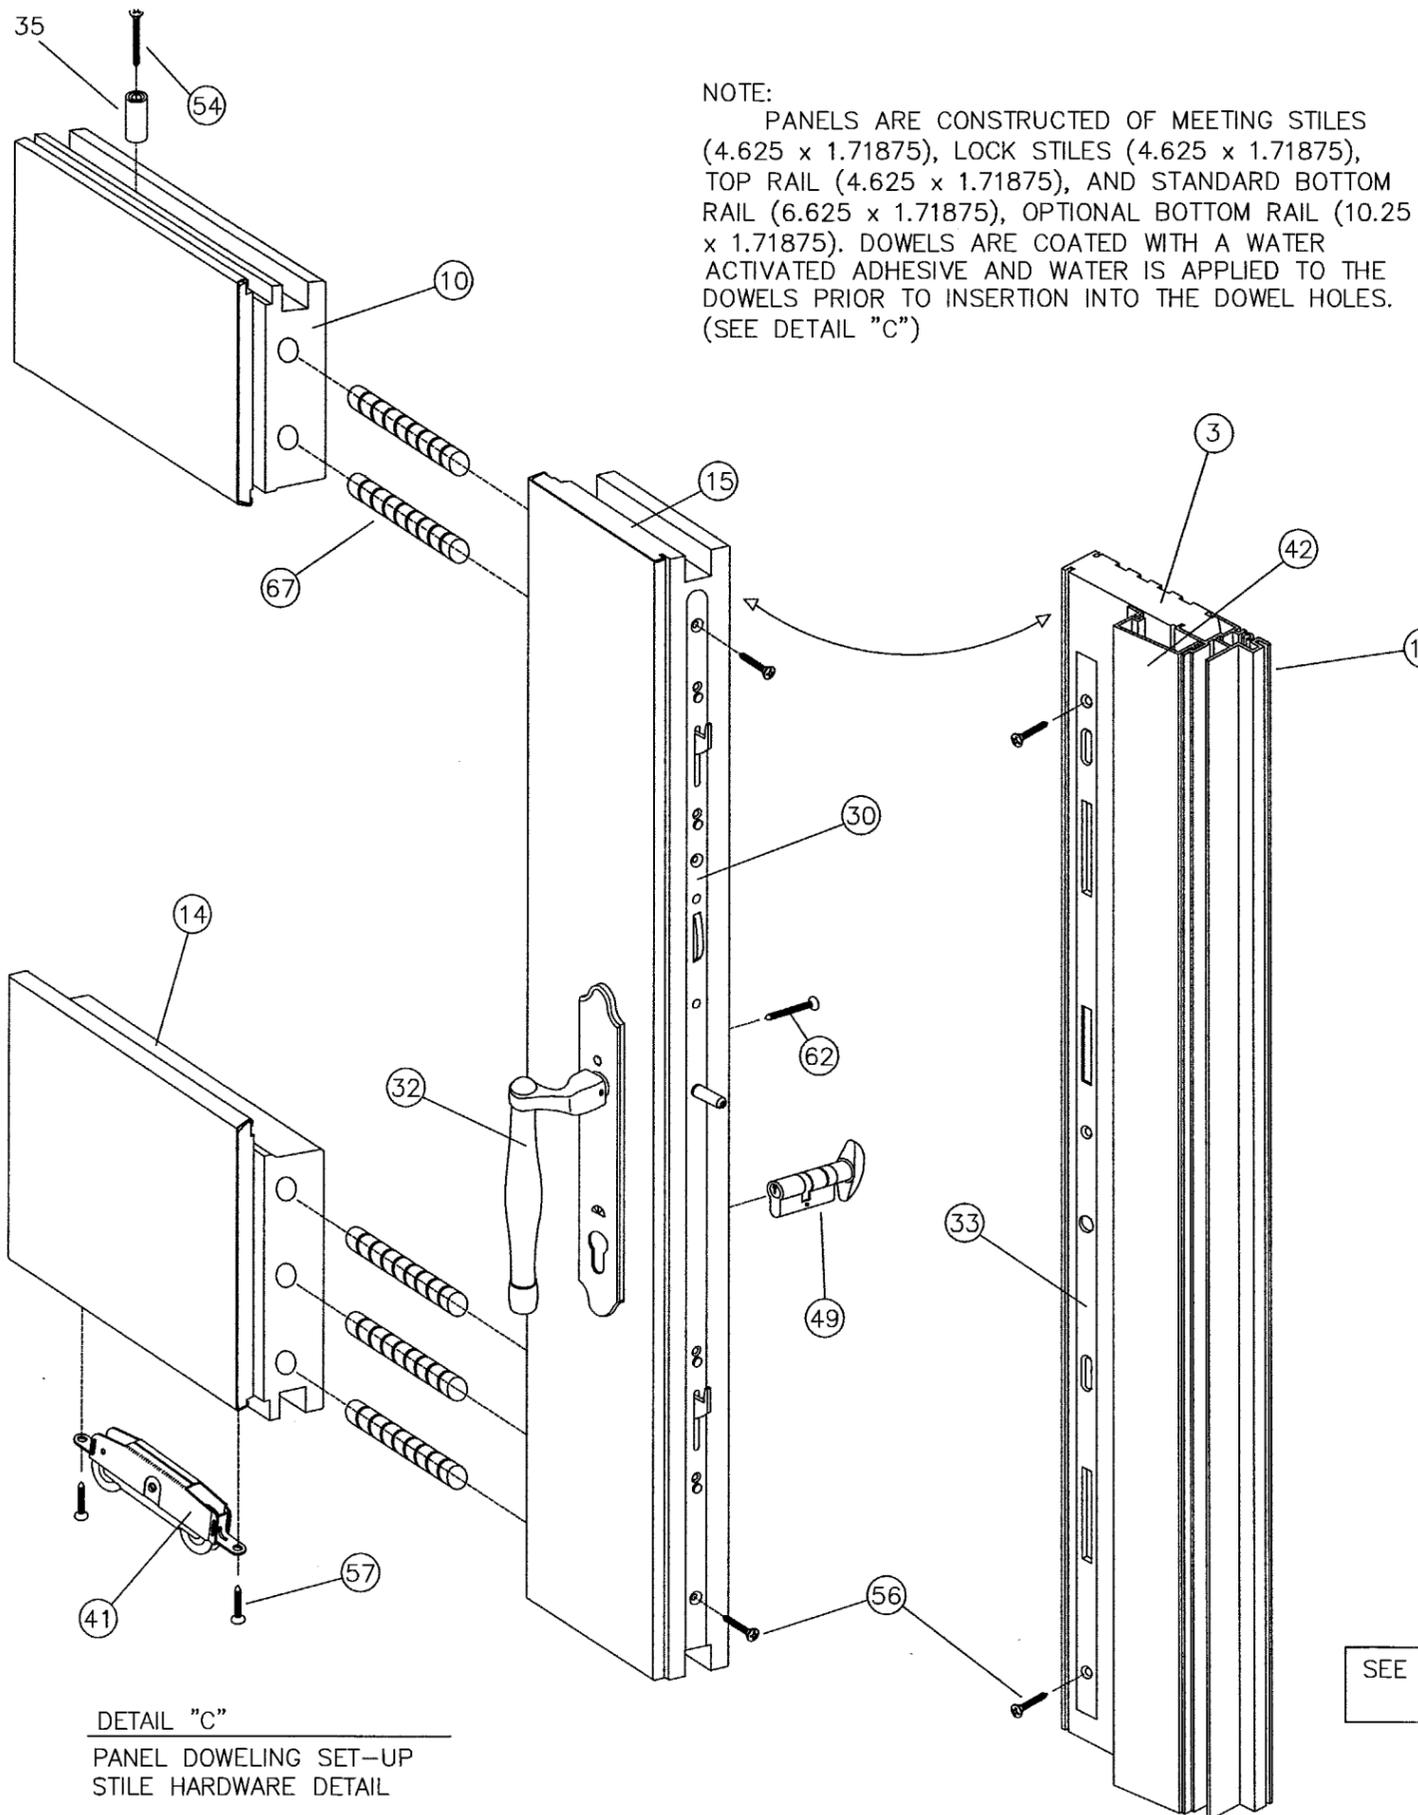

NOTE:
 PANELS ARE CONSTRUCTED OF MEETING STILES (4.625 x 1.71875), LOCK STILES (4.625 x 1.71875), TOP RAIL (4.625 x 1.71875), AND STANDARD BOTTOM RAIL (6.625 x 1.71875), OPTIONAL BOTTOM RAIL (10.25 x 1.71875). DOWELS ARE COATED WITH A WATER ACTIVATED ADHESIVE AND WATER IS APPLIED TO THE DOWELS PRIOR TO INSERTION INTO THE DOWEL HOLES. (SEE DETAIL "C")

DETAIL "C"
 PANEL DOWELING SET-UP
 STILE HARDWARE DETAIL

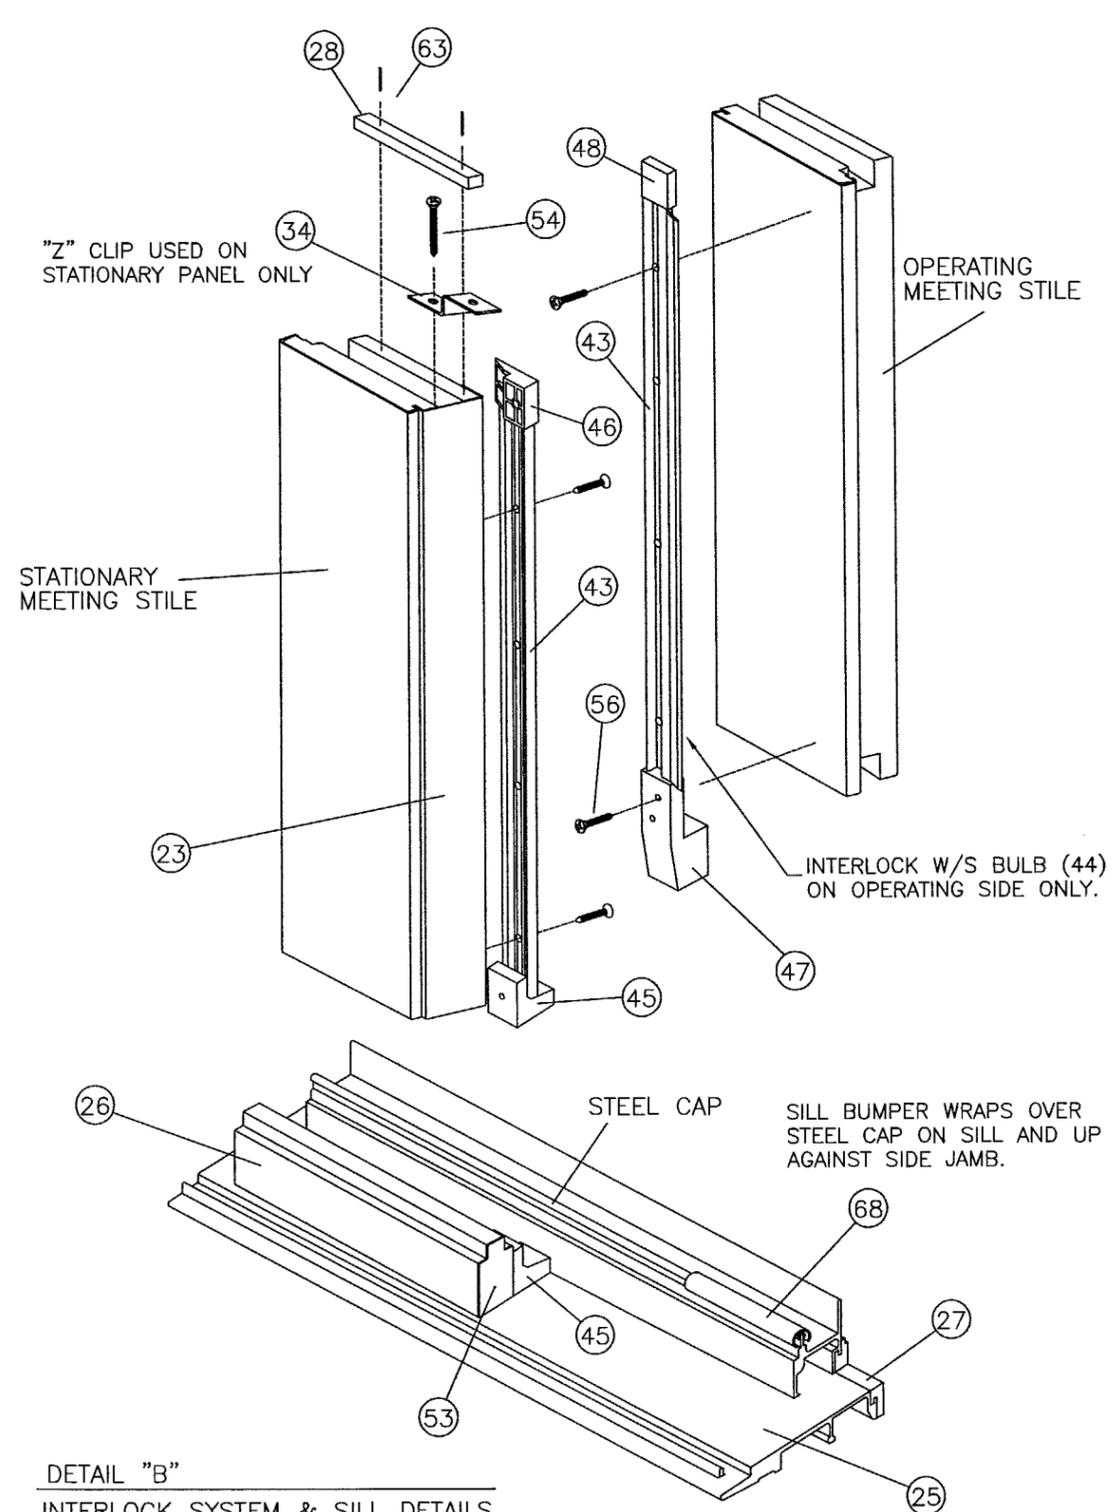

DETAIL "B"
 INTERLOCK SYSTEM & SILL DETAILS

SEE SHEET 2 FOR DESIGN LOADS AND GLASS THICKNESS

Approved as complying with the Florida Building Code
 Date 06/26/03
 NOA# 03-0213.12
 Miami Dade Product Control
 By Guadalupe Bermejo

POZZI WINDOW COMPANY
 62845 BOYD ACRES RD.
 BEND, OREGON 97701
 PH. 541.382.4411


PRODUCT:
 POZZI ALUM. CLAD WOOD GLIDING PATIO DOOR UP TO 8.0 x 8.0
 PART OR ASSEMBLY:
 DOOR PANEL CONSTRUCTION

NO.	DATE	REVISIONS	BY
2	5/07/03	REVISE ANCHORING	RW
1	3/04/03	PER DADE COMMENTS	TJH


RW BUILDING CONSULTANTS, INC.
 813.659.9197

DATE: 1/20/03
 SCALE: N.T.S.
 DWG. BY: ZRK
 CHK. BY: RW
 DRAWING NO.: S-2334
 SHEET 5 OF 7


MATERIAL LIST			
ITEM	PART #	DESCRIPTION	MATERIAL
1	GPD-208	HEAD JAMB CLADDING - .060 WALL (ANODIZING INC.)	6063-T5 ALUM.
2	GPD-108	WOOD HEAD JAMB - (BMC)	WESTERN PINE
3	GPD-107	WOOD SIDE JAMB - (BMC)	WESTERN PINE
4	N/A	1-5/8" ROOFING NAIL (11 GA.)	STEEL
5	AC-74	FRAME CORNER KEY - 2 EA. (MITCHELL METALS)	WESTERN PINE
6	N/A	NOT USED	-
7	N/A	PRESSURE TREATED 2X BUCK	P.T. WOOD
8	N/A	NOT USED	-
9	SPD-324	WOOD GLASS STOP (IG) - (BMC)	WESTERN PINE
10	GPD-134	WOOD TOP RAIL - (BMC)	WESTERN PINE
11	N/A	1/4" FRAME SHIM	WOOD
12	GPD-104	WOOD 10 1/4" BOTTOM RAIL - (BMC)	WESTERN PINE
13	GPD-204	10 1/4" BOTTOM RAIL CLADDING - (HOMESHIELD)	6063-T5 ALUM.
14	GPD-103	WOOD BOTTOM RAIL - (BMC)	WESTERN PINE
15	GPD-106	WOOD STILE - (BMC)	WESTERN PINE
16	GPD-207	SIDE JAMB CLADDING - .060 WALL (ANODIZING INC.)	6063-T5 ALUM.
17	GPD-202	TOP RAIL CLADDING - (HOMESHIELD)	6063-T5 ALUM.
18	GPD-203	BOTTOM RAIL CLADDING - (HOMESHIELD)	6063-T5 ALUM.
19	GPD-206	STILE CLADDING - (HOMESHIELD)	6063-T5 ALUM.
20	GPD-119	INTERIOR SIDE FILLER - (BMC)	WESTERN PINE
21	GPD-114	INTERIOR HEAD STOP - (BMC)	WESTERN PINE
22	GPD-212	EXTERIOR HEAD FILLER - .060 WALL (ANODIZING INC.)	6063-T5 ALUM.
23	GPD-217	STILE EDGE CLADDING - (HOMESHIELD)	6063-T5 ALUM.
24	GPD-118	INTERIOR SIDE STOP - (BMC)	WESTERN PINE
25	GPD-300D	PULTRUDED SILL BASE - (ADVANCED FIBER PRODUCTS)	PVC
26	GPD-301	STATIONARY PANEL RISER - (AFP)	PVC
27	GPD-111	SILL INSERT - (CONNOLLY)	OAK
28	GPD-116	FIXED PANEL FILLER - (BMC)	WESTERN PINE
29	GPD-211R1	HEAD TRACK - .060 WALL (ANODIZING INC.)	6063-T5 ALUM.
30	HLS-9000	ACTIVE MULTI-POINT HARDWARE - (HOPPE)	STAINLESS STEEL
31	N/A	ULTRAEDGE™ GLASS SPACER	STEEL
32	N/A	ACTIVE HANDLE SET & ESCUTCHEON PLATE - (HOPPE)	COATED STEEL
33	N/A	STRIKE PLATE - (HOPPE)	COATED STEEL
34	N/A	STATIONARY PANEL CLIP	6063-T5 ALUM.
35	N/A	HEAD TRACK GUIDE POST - (BRANDT)	6063-T5 ALUM.




① FRAME CLADDING

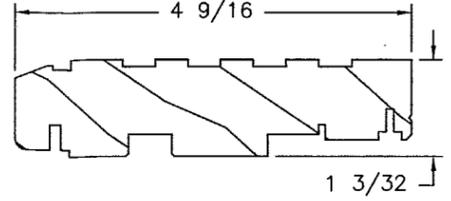


② WOOD JAMB (HEAD)

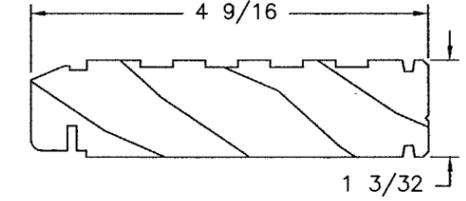


③ WOOD JAMB (SIDE)




⑤ CORNER KEY




⑨ GLASS STOP (IG)

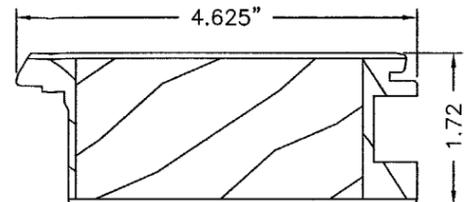


⑩ TOP RAIL

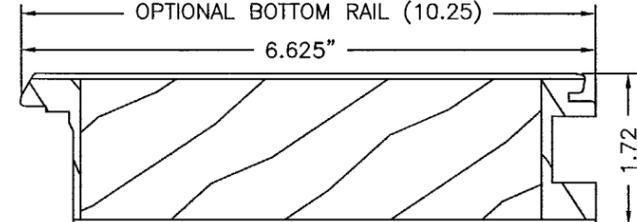


⑭ BOTTOM RAIL

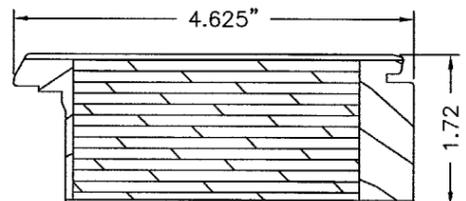


⑮ WOOD STILE

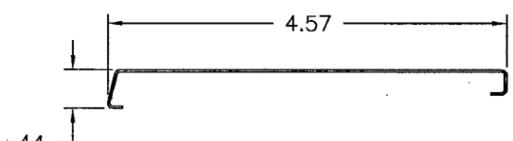


⑰ TOP RAIL/STILE CLADDING

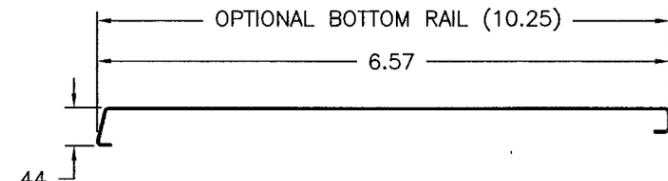


⑱ BOTTOM RAIL CLADDING

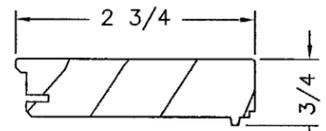


⑳ INTERIOR SIDE FILLER




㉑ INTERIOR HEAD STOP

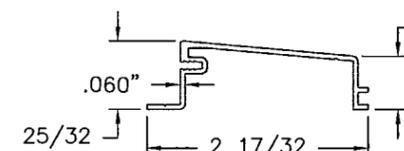


㉒ EXTERIOR HEAD FILLER




㉓ EDGE CLADDING




㉔ INTERIOR SIDE STOP




㉙ HEAD TRACK




㉚ SILL INSERT




㉝ DOOR GUIDE

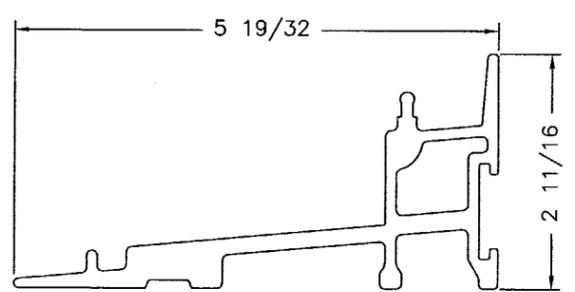

㉞ SILL BASE

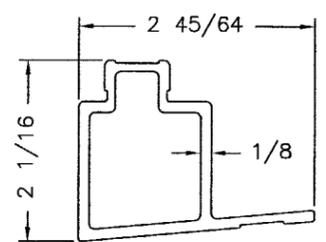

㉟ STATIONARY PANEL BLOCK

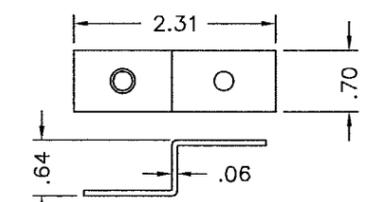

㉞ STATIONARY PANEL CLIP

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411

PRODUCT: POZZI ALUMINUM CLAD WOOD GLIDING PATIO DOOR
PART OR ASSEMBLY: BILL OF MATERIALS & COMPONENTS


NO.	DATE	BY	REVISIONS
2	5/07/03	RW	REVISE ANCHORING
1	3/04/03	TJH	PER DADE COMMENTS

RW BUILDING CONSULTANTS, INC.
813.659.9197


Approved as complying with the Florida Building Code
Date 06/26/03
NOA# 03-0213-12
Miami Dade Product Control
By: *Alvaro Bermejo*

DATE: 1/20/03
SCALE: N.T.S.
DWG. BY: ZRK
CHK. BY: RW
DRAWING NO.: S-2334
SHEET 6 OF 7



MATERIAL LIST			
ITEM	PART #	DESCRIPTION	MATERIAL
36	N/A	INSULATED GLASS UNIT (MFG. POZZI WINDOW CO.)	SEE SHEET 2
37	N/A	Q-LON ADHEASIVE WEATHERSTRIP (HEAD) - (SCHLEGEL)	POLY
38	N/A	Q-LON WEATHERSTRIP (SIDE) - (SCHLEGEL)	POLY
39	AC-172	DRIPCAP - (ANODIZING INC.)	6063-T5 ALUM.
40	N/A	FOLDING NAILING FLANGE - (AMESBURY)	POLY
41	N/A	DOOR ROLLER SYSTEM - (TRUTH)	STEEL
42	GPD-212	EXTERIOR SIDE FILLER - .060 WALL (ANODIZING INC.)	6063-T5 ALUM.
43	GPD-302	INTERLOCK - (INTEK)	PVC
44	N/A	INTERLOCK WEATHERSTRIP - (SCHLEGEL)	POLY
45	GPD-312	STATIONARY PANEL INTERLOCK BLOCK - (BRANDT)	PVC
46	GPD-315	STATIONARY PANEL INTERLOCK TOP BLOCK - (BRANDT)	PVC
47	GPD-309	OPERATING PANEL INTERLOCK BLOCK - (BRANDT)	PVC
48	GPD-320	OPERATING PANEL INTERLOCK TOP PAD - (DERBY)	PVC
49	N/A	THUMBTURN (HOPPE)	COATED STEEL
50	N/A	#1199 SEALANT (DOW CORNING)	SEALANT
51	N/A	WEATHERSTRIP ANGLE - W/WOOL PILE (ANODIZING INC.)	6063-T5 ALUM.
52	GPD-301	HEAD STOP ATTACHMENT STRIP - (INTEK)	PVC
53	N/A	STATIONARY PANEL RISER CAP - (BRANDT)	NYLON
54	N/A	#8 x 2" P.H.F.H. WOOD SCREW (CROWN FASTENERS)	STEEL
55	N/A	1" x 7/32" CROWN 18 GA. STAPLE - (STANLEY/BOSTICH)	STEEL
56	N/A	#8 x 1" P.H.F.H. S/STL (CROWN FASTENERS)	STEEL
57	N/A	#7 x 3/4" P.H.F.H. WOOD SCREW (CROWN FASTENERS)	COATED STEEL
58	N/A	#10 x 2 1/2" P.H.F.H. WOOD SCREW (CROWN FASTENERS)	STEEL
59	N/A	#10 x 2 3/4" P.H.F.H. WOOD SCREW (CROWN FASTENERS)	STEEL
60	N/A	3/16" x 2-1/2" TAPCON ANCHOR	STEEL
61	N/A	#6 x 1 1/2" P.H.F.H. MTL. (CROWN FASTENERS)	STEEL
62	N/A	#8 x 1 1/2" P.H.F.H. WOOD SCREW (CROWN FASTENERS)	STEEL
63	N/A	18 GA. x 3/4" PIN NAIL - (STANLEY/BOSTICH)	STEEL
64	N/A	1 1/4" x 1/8" CRN 18 GA. STAPLE - (STANLEY/BOSTICH)	STEEL
65	N/A	1 1/4" x 1/8" CRN 15 GA. STAPLE - (STANLEY/BOSTICH)	STEEL
66	N/A	#8 x 1" P.H.P.H. S/STL (CROWN FASTENERS)	STEEL
67	N/A	1/2" x 4" DOWEL (CHICAGO DOWEL)	WOOD
68	N/A	4" SILL BUMPER	NYLON
69	N/A	4" HEAD BUMPER	NYLON
70	N/A	STATIONARY HEAD SUPPORT BLOCK	WESTERN PINE




38 WEATHERSTRIP (SIDE)

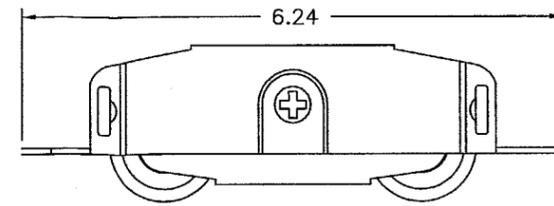


41 DOOR ROLLER




44 INTERLOCK W/S




39 OPTIONAL DRIPCAP




40 OPTIONAL NAILFIN




37 ADHESIVE W/S (HEAD)

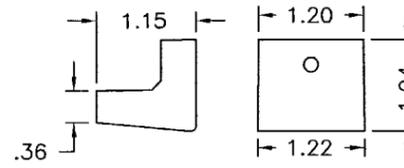


45 INTERLOCK BLOCK (STA)

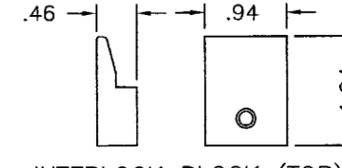


46 INTERLOCK BLOCK (TOP)(STA)



43 INTERLOCK

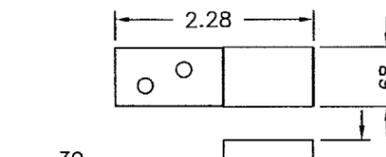


47 INTERLOCK BLOCK (OPR)

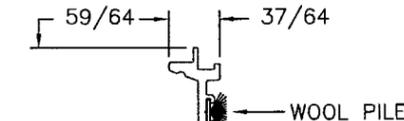


51 WEATHERSTRIP ANGLE


30 HARDWARE

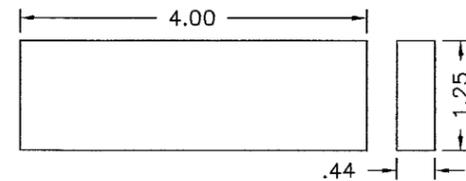


69 HEAD BUMPER

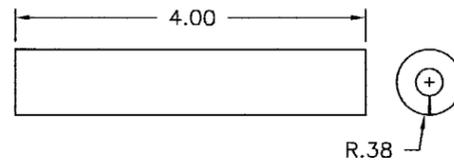

68 SILL BUMPER



52 ATTACHMENT STRIP

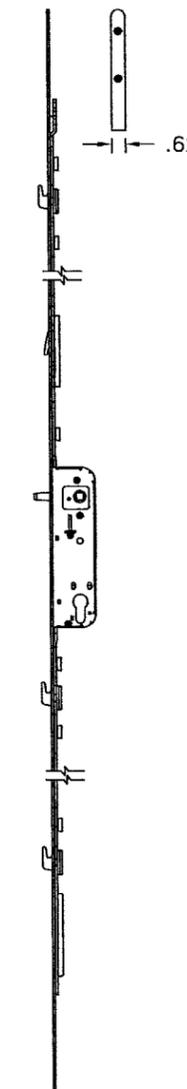

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411

PRODUCT: POZZI ALUMINUM CLAD WOOD GLIDING PATIO DOOR
PART OR ASSEMBLY: BILL OF MATERIALS & COMPONENTS

NO.	DATE	REVISIONS
2	5/07/03	REVISE ANCHORING
1	3/04/03	PER DADE COMMENTS
		TJH
		BY

RW BUILDING CONSULTANTS, INC.
813.659.9197

Approved as complying with the Florida Building Code
Date: 06/26/03
NOA# 03-0213-12
Miami Dade Product Control
By: *Cherndre Beeman*

DATE: 1/20/03
SCALE: N.T.S.
DWG. BY: ZRK
CHK. BY: RW
DRAWING NO.: S-2334
SHEET 7 OF 7