



MIAMI-DADE
BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

Taylor Building Products, Inc.
631 N. First Street
West Branch, MI 48661

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Out-Swing Glazed Insulated Steel Door W/WO Sidelites – Non-Impact

APPROVAL DOCUMENT: Drawing No. **S-2338**, titled "Glazed Steel Edge Door W/WO Sidelites", Sheets 1 through 8 of 8, prepared by R.W. Building Consultants, Inc., dated 1/13/03, with revision "2", dated 3/23/04, signed and sealed by Wendell W. Haney, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Theodore Berman, P.E.**

TJB
 3/31/04


NOA No 03-0224.03
Expiration Date: April 22, 2009
Approval Date: April 22, 2004
Page 1

Taylor Building Products, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **S-2338**, titled "Glazed Steel Edge Door W/WO Sidelites", Sheets 1 through 8 of 8, dated 1/13/03, with revision No. "2", dated 3/23/04, prepared by R.W. Building Consultant, Inc., signed and sealed by Wendell W. Haney, P.E.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Forced Entry Test, per FBC 2411.3.2.1 (b) and TAS 202-94along with marked-up drawings and installation diagram of out-swing glazed insulated steel door w/wo sidelites, dated January 25, 2003, prepared by Certified Testing Laboratory, Architectural Division, Test Report No. **CTLA-816W**, signed and sealed by Ramesh Patel, P.E.
2. Tensile Test prepared by Certified Testing Laboratory, Architectural Division Test No. **CTLA-816W**, dated 2/6/02, tested per ASTM E8/A370 or B557, signed and sealed by Ramesh Patel P.E.

C. CALCULATIONS

1. Anchor Calculations, ASTM-E1300, and structural analysis dated 1/13/03, prepared, signed and sealed by Lyndon F. Schmidt, P.E.

D. QUALITY ASSURANCE


1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. None

F. STATEMENTS

1. Statement letter of conformance and no financial interest, dated August 2, 2002, issued by Taylor Building Products, Inc., signed and sealed by John Swanick.
2. Letter from Taylor Building Products, Inc. dated August 2, 2002, designating Rick Wright of R.W. Building Consultant Inc., as the contact person for this file.
3. Statement letter of no financial interest in the test laboratory performing the test dated January 13, 2003, issued, signed and sealed by Lyndon F. Schmidt, P.E.

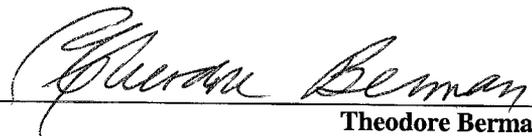

Theodore Berman, P.E.
Deputy Director, Product Control Division
NOA No 03-0224.03
Expiration Date: April 22, 2009
Approval Date: April 22, 2004









TAYLOR BUILDING PRODUCTS, INC.
631 North First Street, West Branch, MI 48661

**GLAZED STEEL EDGE STEEL DOOR OUT-SWING
UP TO 8'4 x 8'0 WITH OR WITHOUT SIDELITES**


GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO COMPLY WITH THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. DESIGNED PRESSURE RATING SEE TABLE PAGE 1.
5. THIS PRODUCT DOES MEET THE WATER REQUIREMENTS FOR "HIGH VELOCITY HURRICANE ZONES" WITH HIGH DAM THRESHOLD.
6. THIS SYSTEM REQUIRES WINDBORNE DEBRIS EXTERNAL PROTECTION AS PRESCRIBED IN SECTION 1626 OF THE FLORIDA BUILDING CODE.

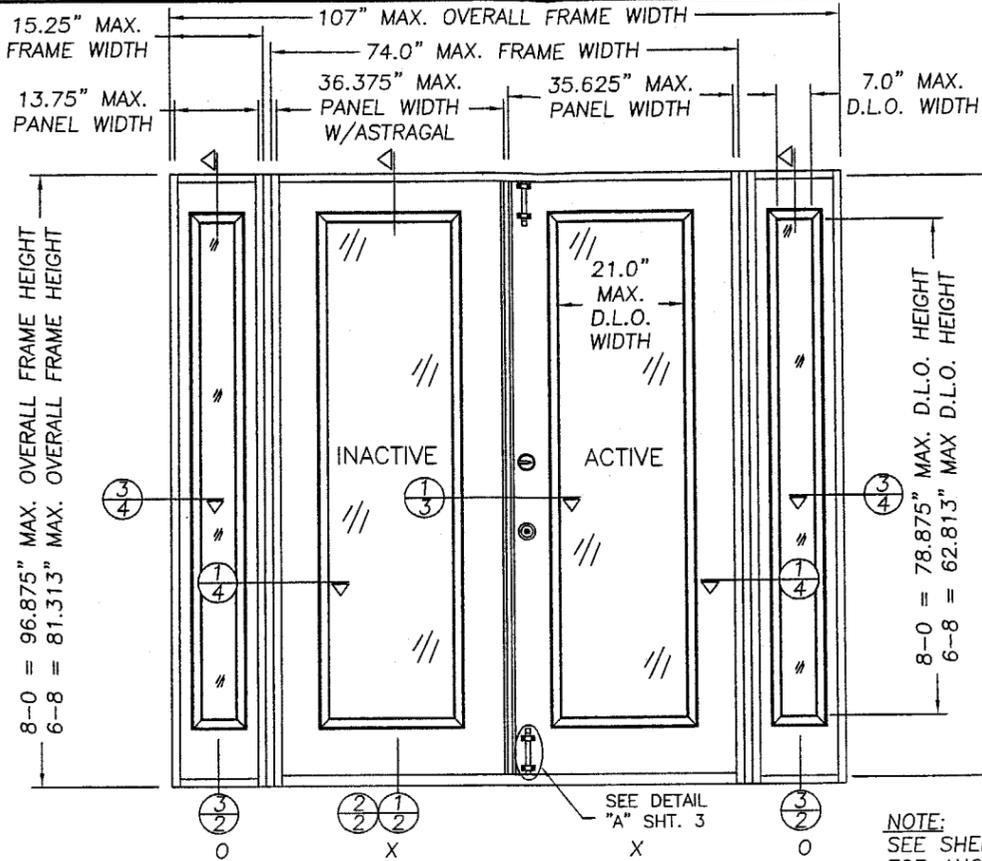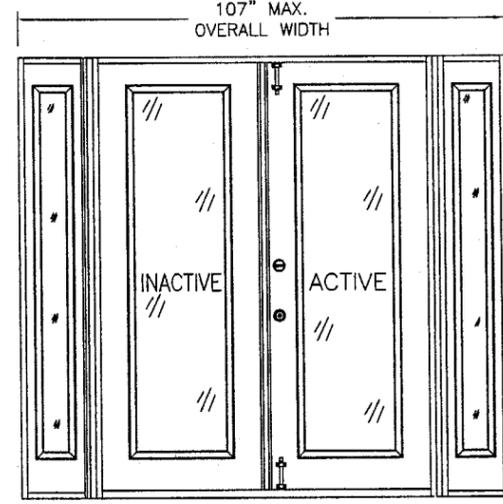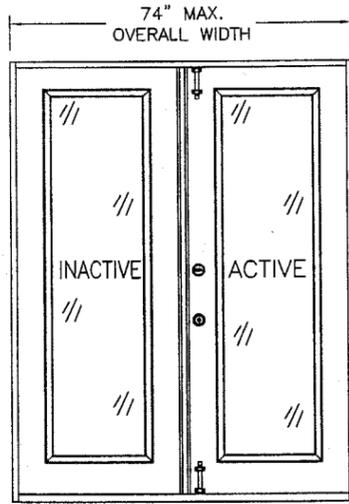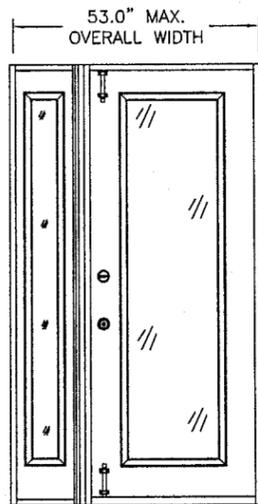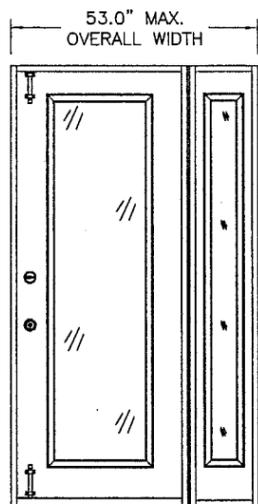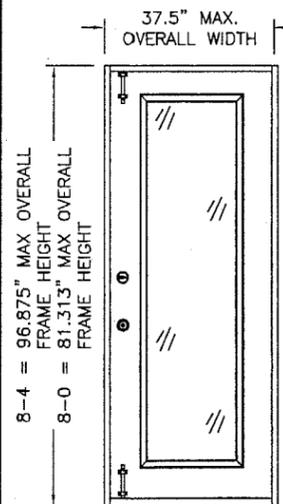

DOUBLE W/SIDELITES OUT-SWING UNIT VIEWED FROM THE INTERIOR

NOTE:
SEE SHEETS 5 AND 6
FOR ANCHOR LOCATIONS

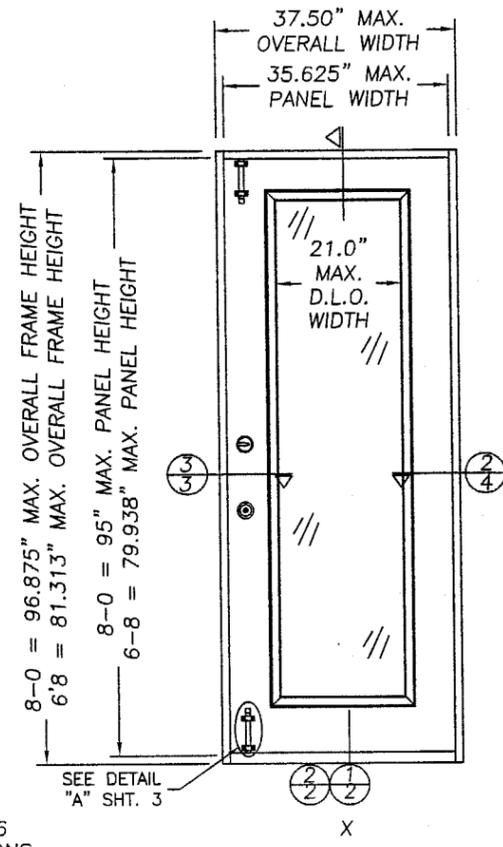

SINGLE OUT-SWING UNIT

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	TYPICAL ELEVATIONS & GENERAL NOTES
2	VERTICAL CROSS SECTIONS
3	HORIZONTAL CROSS SECTIONS
4	HORIZONTAL CROSS SECTIONS & NOTES
5	ANCHORING LOCATIONS & DETAILS
6	ANCHORING LOCATIONS
7	UNIT COMPONENTS & BILL OF MATERIALS
8	GLAZING DETAILS

DESIGN PRESSURE RATING WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED	
UNIT TYPE	WITH SURFACE BOLTS
SINGLE	+ 60.0 PSF - 60.0 PSF
SINGLE WITH SIDELITES	+ 60.0 PSF - 60.0 PSF
DOUBLE W/WO SIDELITES W/ WIND JAMBER	+ 60.0 PSF - 60.0 PSF
W/ IMPERIAL DOUB. W/WO SIDELITES	+ 45.0 PSF - 45.0 PSF

Approved as complying with the Florida Building Code
Date 01/22/04
N/A 03-0224.00
Miami Building Product Control
By *[Signature]*

DATE: 1/13/03
SCALE: N.T.S.
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2338
SHEET 1 OF 8


Product Approval Documents Prepared By:
RW
BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197
Florida Board of Professional Engineers
Certificate of Authorization No. 9813
[Signature]
Wendell W. Honey P.E. No. 54158

PRODUCT: GLAZED STEEL STEEL EDGE DOOR W/WO SIDELITES


PART OR ASSEMBLY: TYPICAL ELEVATIONS & GENERAL NOTES

NO.	DATE	REVISIONS
2	3/23/04	CLARIFY GLAZING COMPOUND
1	3/20/03	PER DADE COMMENTS


RAH
ROF
BY

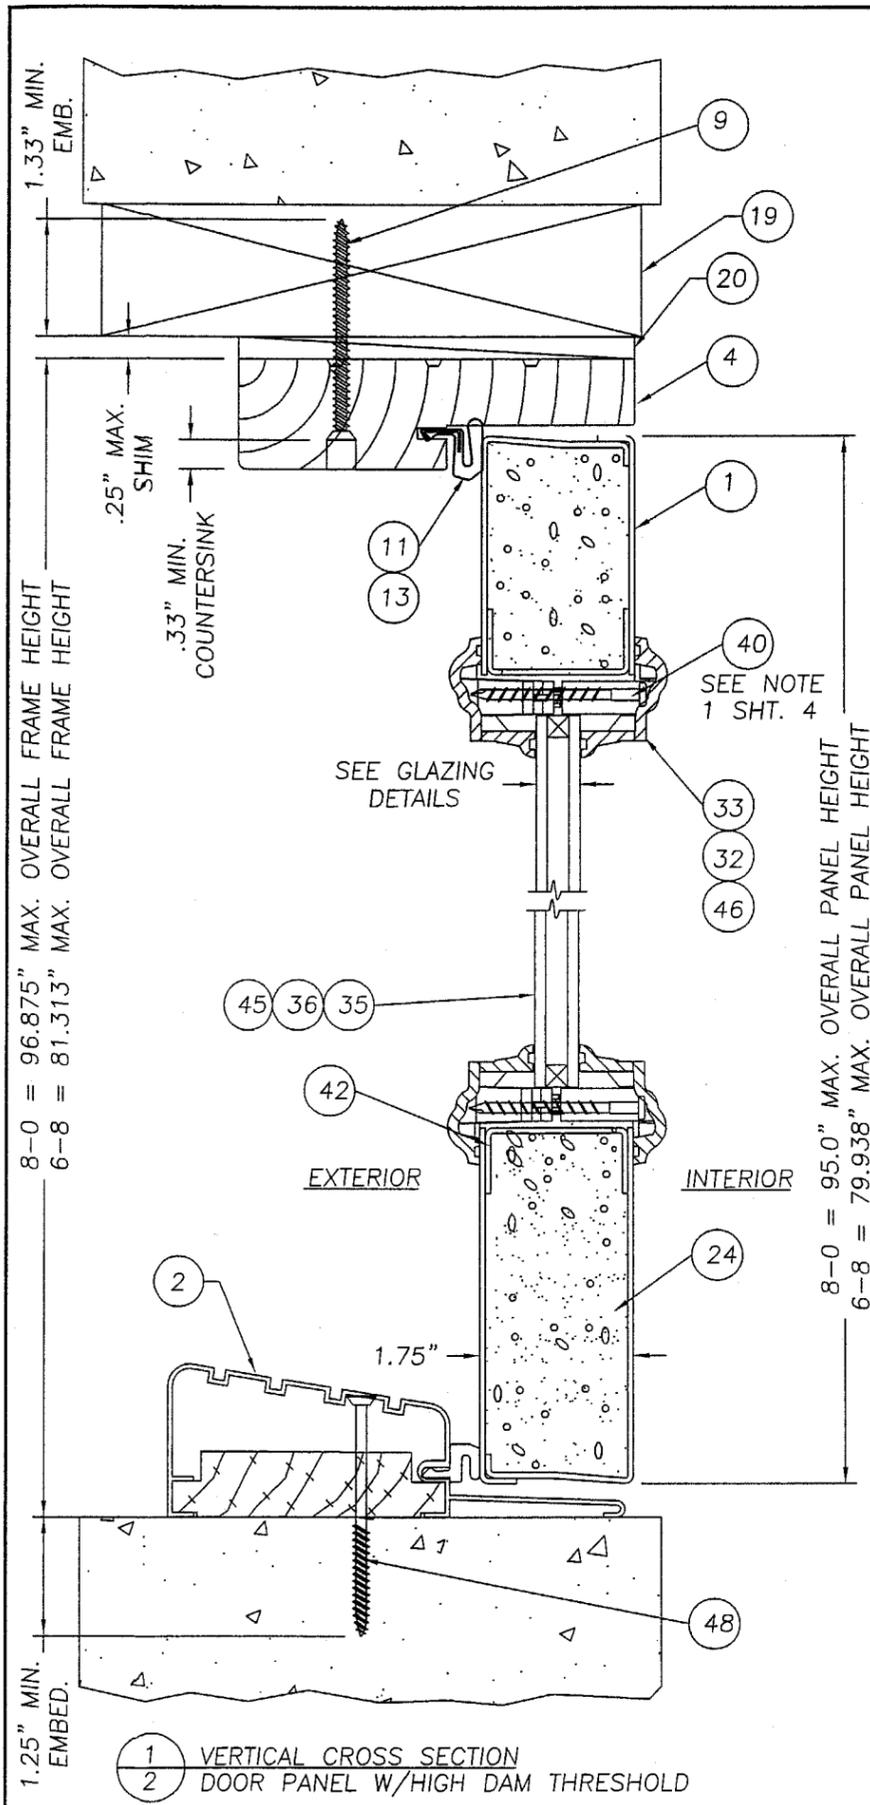

1 VERTICAL CROSS SECTION
2 DOOR PANEL W/HIGH DAM THRESHOLD

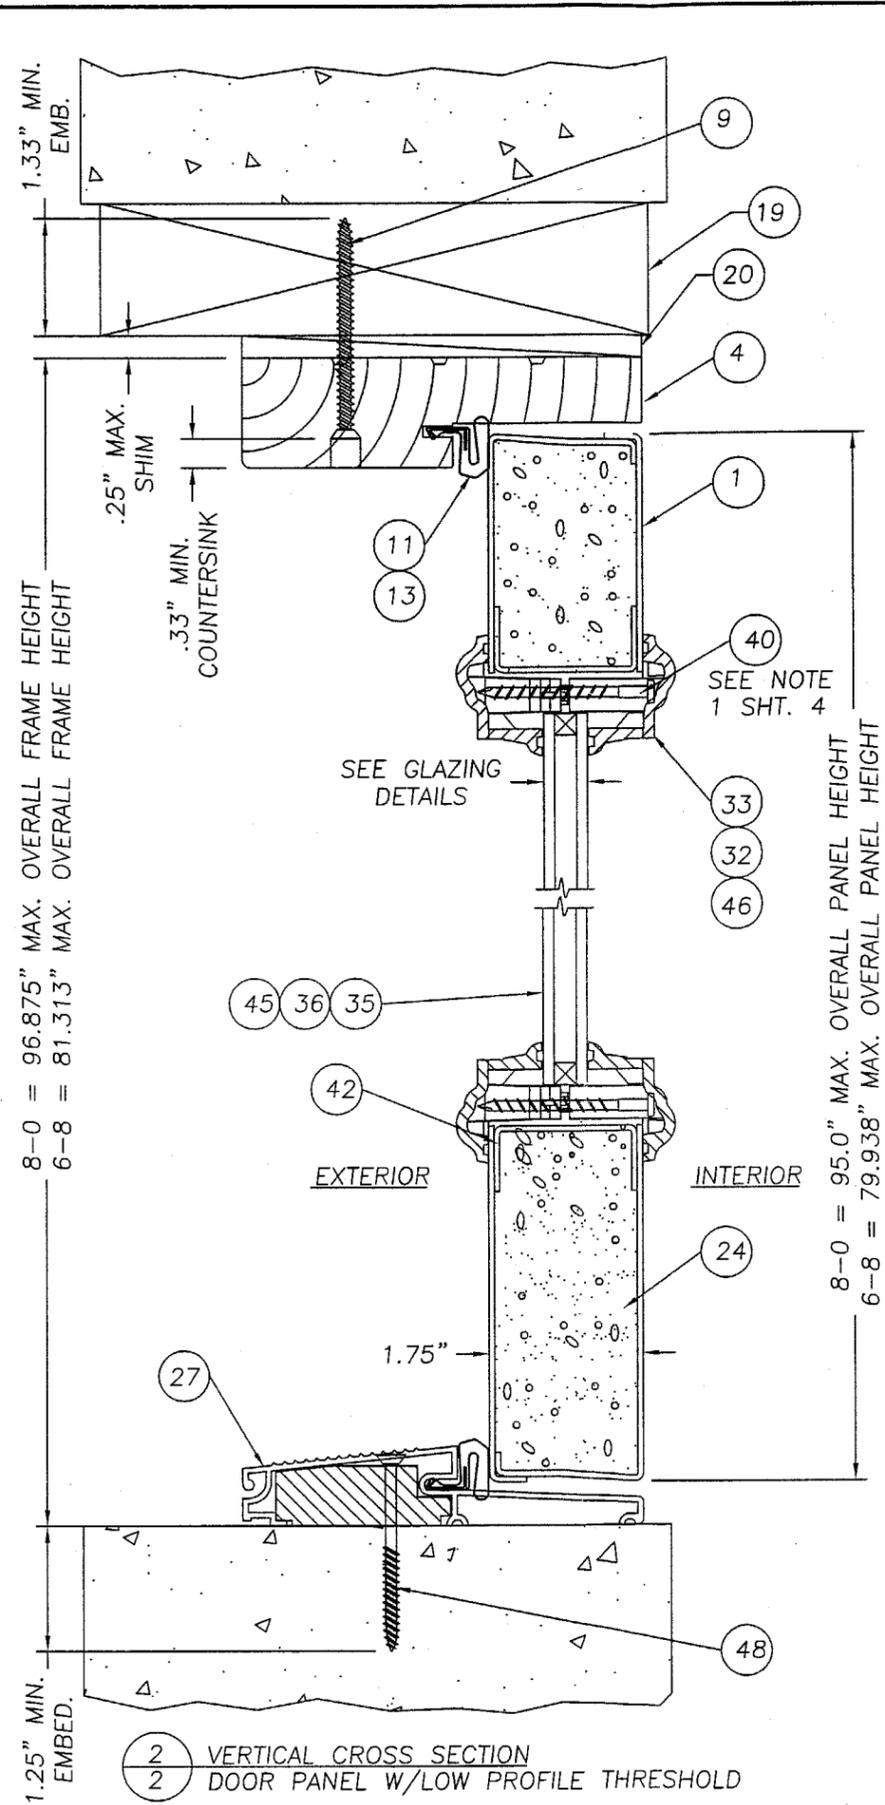


2 VERTICAL CROSS SECTION
2 DOOR PANEL W/LOW PROFILE THRESHOLD

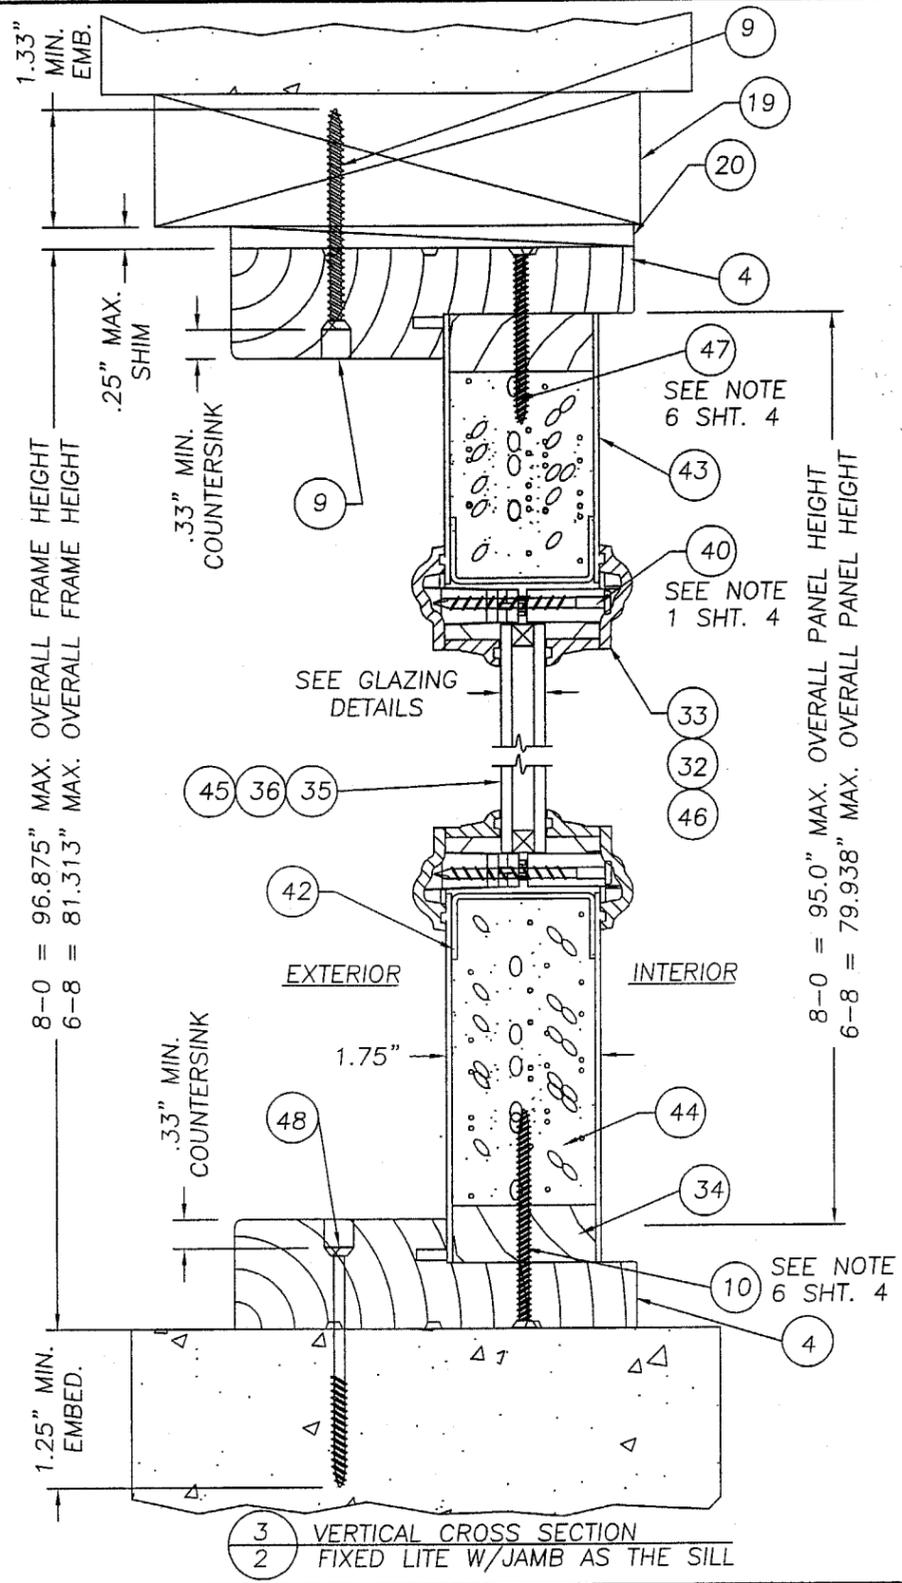


3 VERTICAL CROSS SECTION
2 FIXED LITE W/JAMB AS THE SILL

Approved as complying with the
Florida Building Code
Date 04/22/04
NO# 03-0224.03
Miami Dade Product Control
Division
By *[Signature]*


Product Approval Documents Prepared By: RW BUILDING CONSULTANTS, INC. P.O. Box 230 Valrico FL 33595 Phone No.: 813.659.9197 Florida Board of Professional Engineers Certificate Of Authorization No. 9813 Wendell W. Hines, P.E. No. 54158	
PRODUCT:	GLAZED STEEL STEEL EDGE DOOR W/WO SIDELITES
PART OR ASSEMBLY:	RAH ROF BY
CLARIFY GLAZING COMPOUND PER DADE COMMENTS	NO. DATE
REVISIONS	
DATE: 1/13/03	SCALE: N.T.S.
DWG. BY: WLN	CHK. BY: RW
DRAWING NO.: S-2338	SHEET 2 OF 8

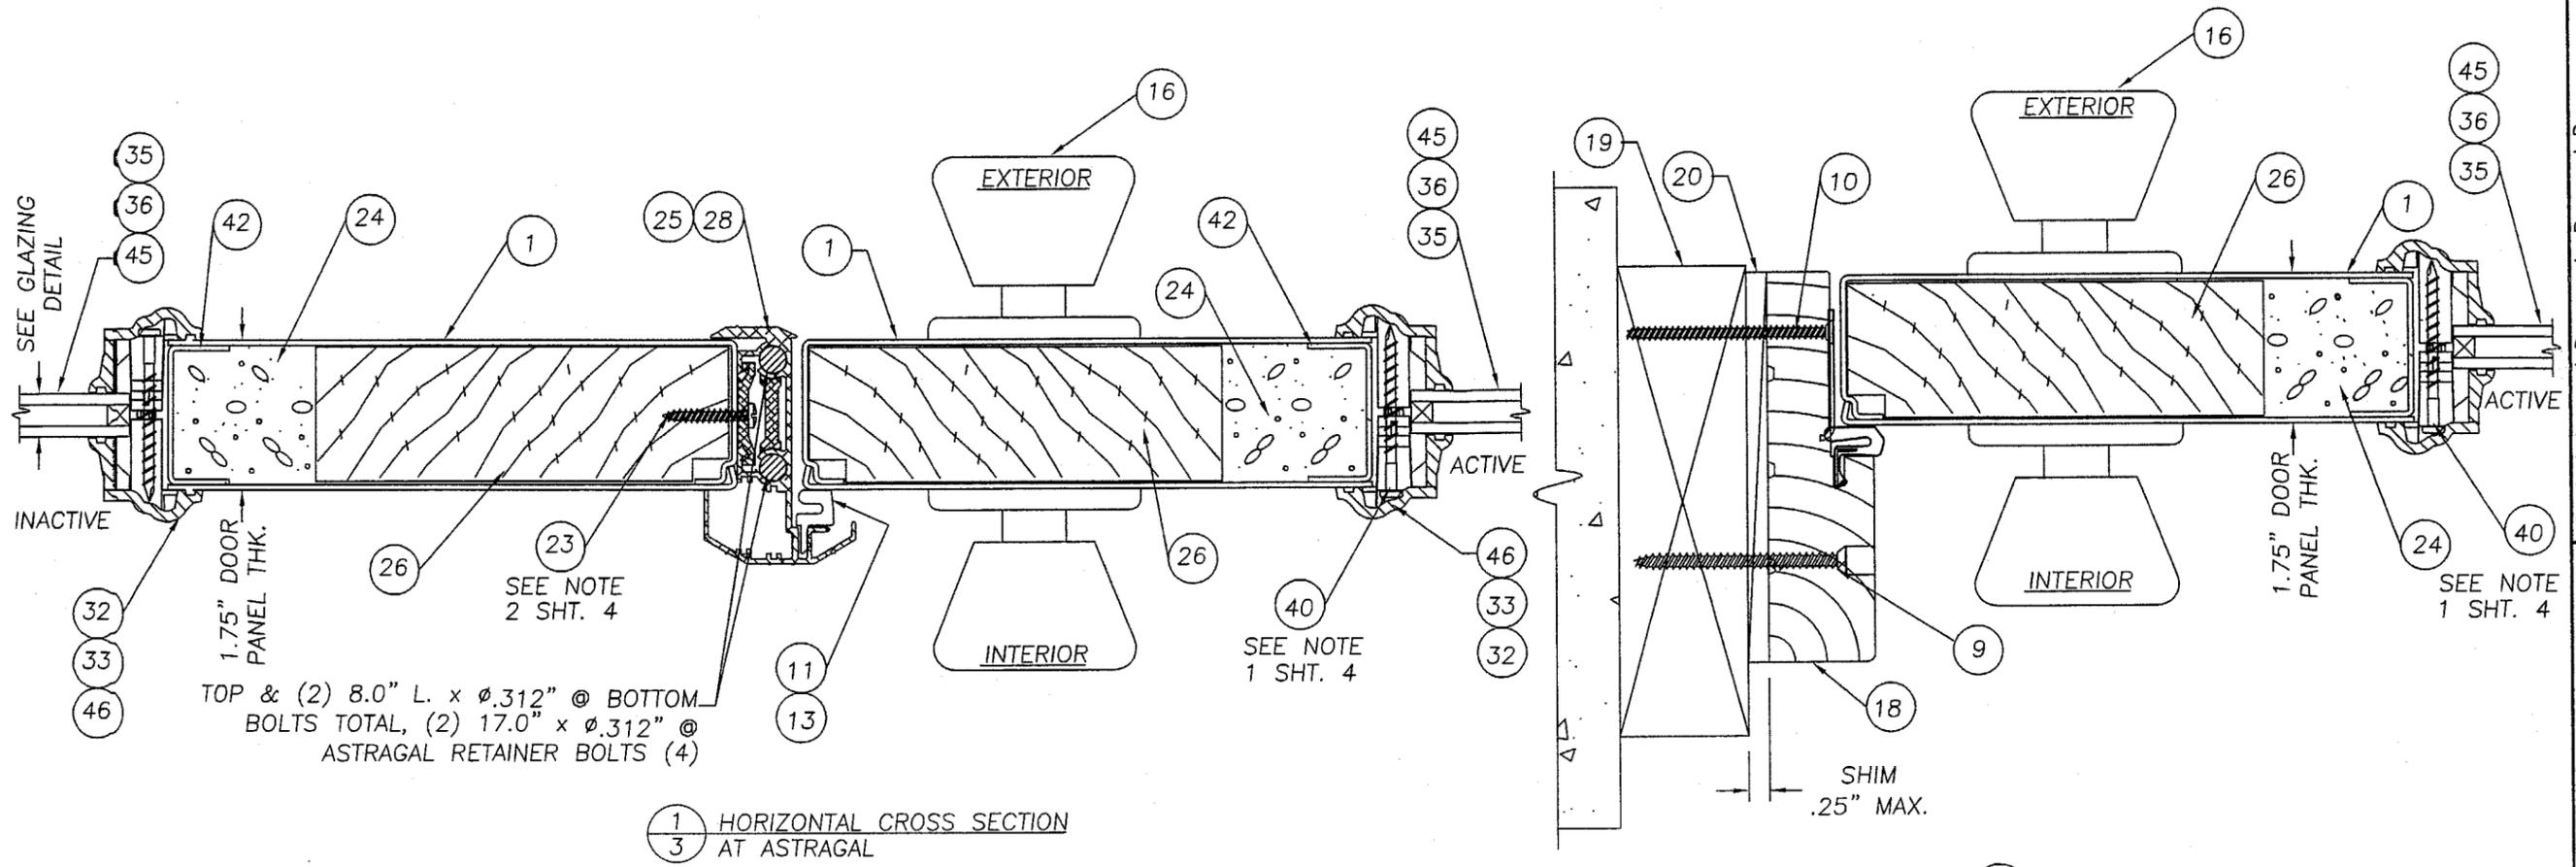

1 HORIZONTAL CROSS SECTION AT ASTRAGAL

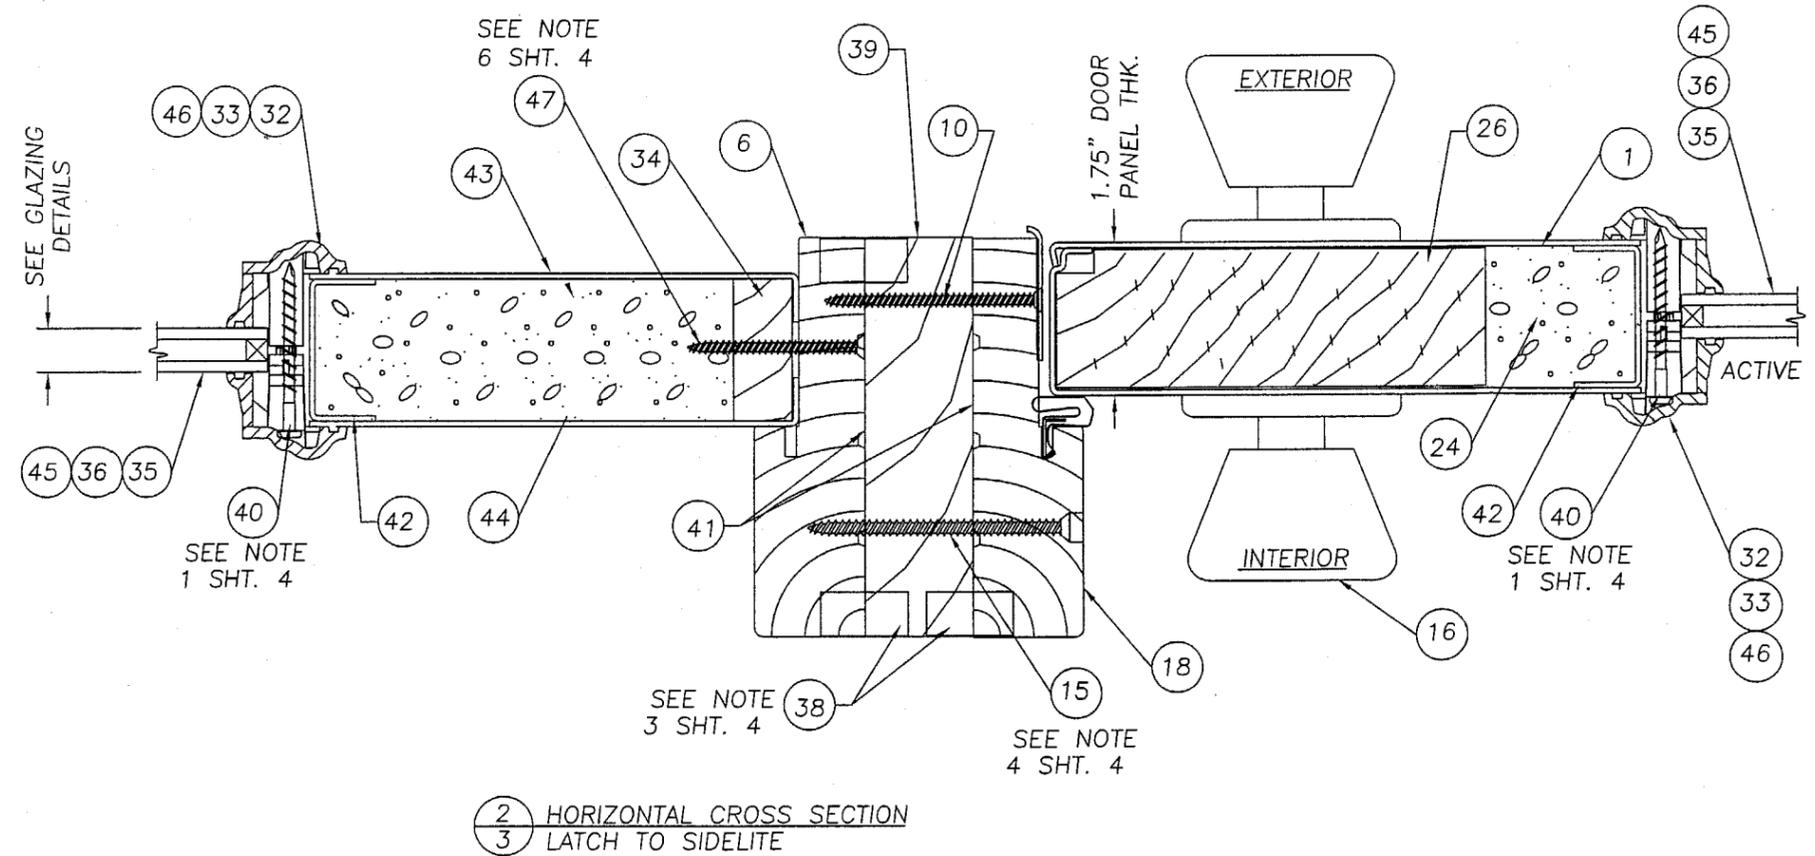

2 HORIZONTAL CROSS SECTION LATCH TO SIDELITE

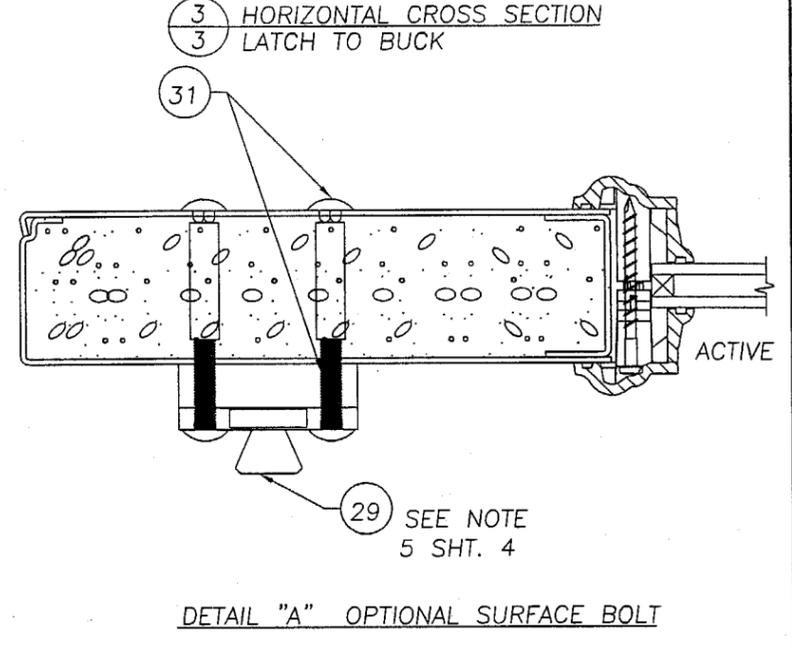


3 HORIZONTAL CROSS SECTION LATCH TO BUCK


DETAIL "A" OPTIONAL SURFACE BOLT

Approved as complying with the Florida Building Code
 Date 04/22/04
 NOA# 03-0224-03
 Miami Dade Product Control
 Division
 By *[Signature]*

Product Approval Documents Prepared By: BUILDING CONSULTANTS, INC. P.O. Box 230 Valrico FL 33595 Phone No.: 813.659.9197 Florida Board of Professional Engineers Certificate of Authorization No. 9813 <i>[Signature]</i> Wendell W. Finney P.E. No. 4158		RAH ROF BY	
PRODUCT: GLAZED STEEL STEEL EDGE DOOR W/TWO SIDELITES	PART OR ASSEMBLY: HORIZONTAL CROSS SECTION	NO.	DATE
		2	3/23/04
		1	3/20/03
			PER DADE COMMENTS
			CLARIFY GLAZING COMPOUND
			REVISIONS
			DATE
			1/13/03
			N.T.S.
			WLN
			RW
			S-2338
			3 OF 8

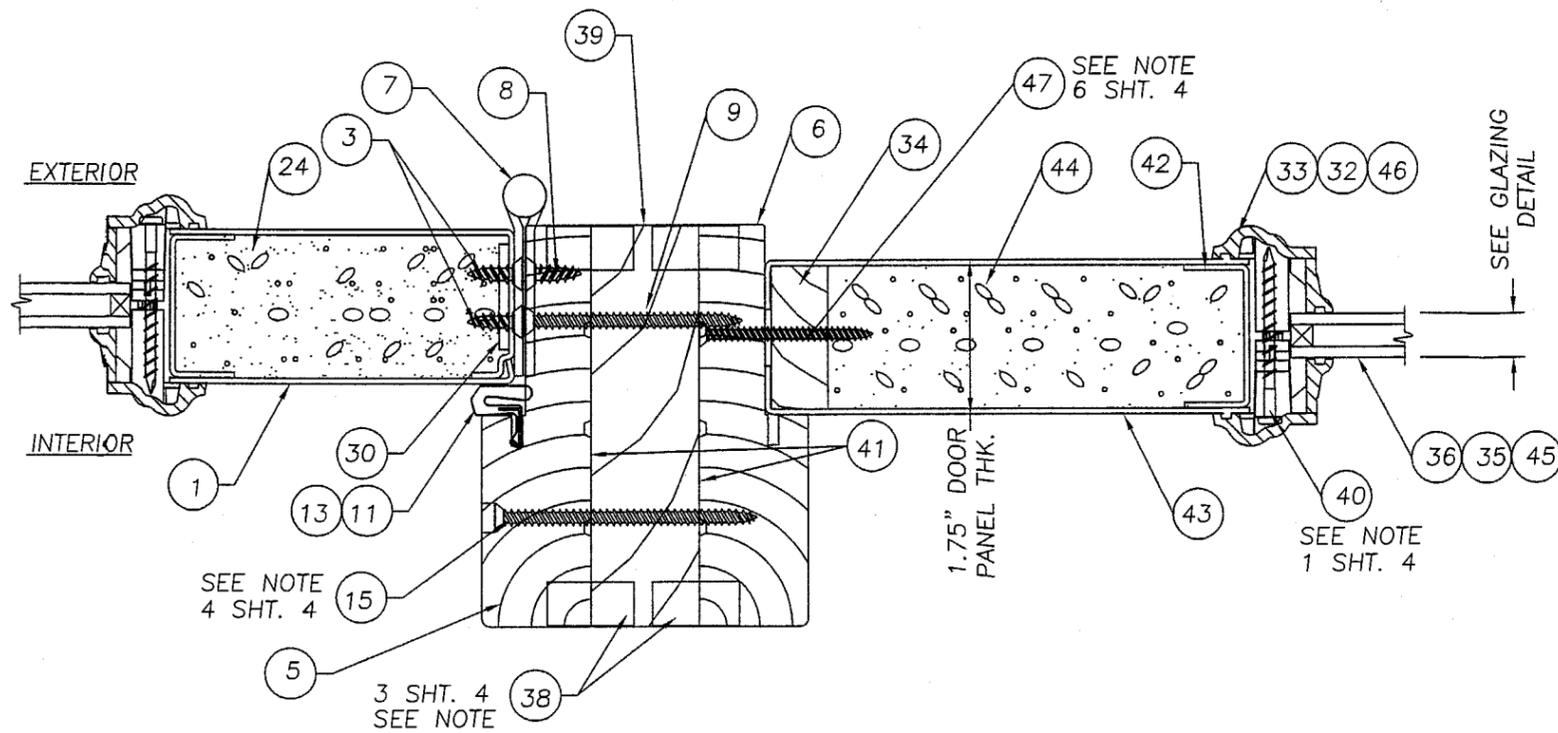


1 HORIZONTAL CROSS SECTION
4 HINGE TO SIDELITE

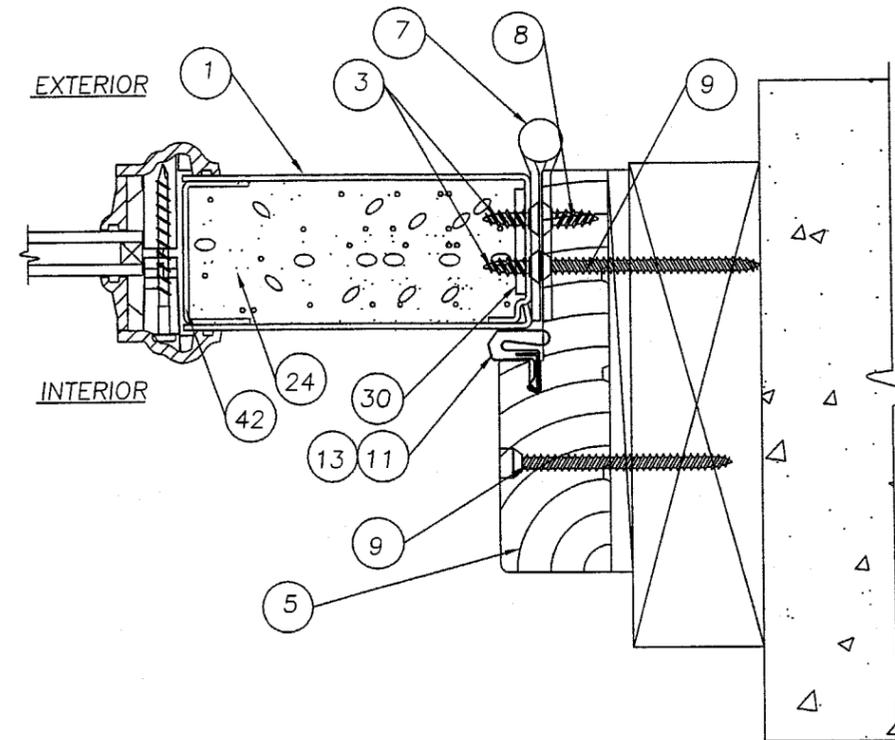

2 HORIZONTAL CROSS SECTION
4 HINGE TO BUCK

NOTES:




- SPACING FOR ITEM #40, THE LITE FRAME SCREW, IS AS FOLLOWS; SIDELITE PANEL: (20) SCREWS, (2) SCREWS TOP & BOTTOM, (1) SCREW AT 2.5" FROM EACH HORIZONTAL CORNER. SIDES (8) SCREWS AT 4.5", 14.75", 25.0", 35.5", 46.25", 56.75", 67.0" AND 77.25" DOWN FROM THE TOP DOWN.
- THE SPACING FOR ITEM #23, THE #8 x 1" PPH WOOD SCREW ATTACHING THE WINDJAMBER II ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS FOR 8-0; (9) SCREWS AT 1.0", 3.0" & 5.0" FROM THE TOP OF THE PANEL DOWN, AND 1.0", 3.0", 5.0", 24.0", 44.5" AND 65.0" FROM THE BOTTOM OF THE PANEL UP AND IS AS FOLLOWS FOR 6-8; FROM THE BOTTOM UP; 1.0", 3.0" & 5.0", 20.0", 38.75", & 57.75" FROM THE TOP DOWN; 1.0", 3.0" & 5.0".
- SPACING FOR ITEM #38, THE CORRUGATED FASTENER SECURING THE HINGE JAMB AND SIDELITE JAMB TO THE PRESSURE TREATED FRAME REINFORCEMENT IS AS FOLLOWS; THERE IS (1) ROW OF (6) FASTENERS PER EACH JAMB TO THE REINFORCEMENT. ONE ROW IS SPACED 3.5", 21.0", 40.0", 57.5", 75.5" & 93.5". THE SECOND ROW IS SPACED 4.0", 21.5", 40.5", 58.0", 76.0" & 94.0" FROM THE TOP DOWN.
- SPACING FOR ITEM #15 GOING FROM THE DOOR FRAME INTO THE FRAME REINFORCEMENT AND SIDELITE JAMB IS AS FOLLOWS; 6.0" DOWN FROM THE TOP AND 6.0" UP FROM THE BOTTOM WITH (4) MORE EQUALLY SPACED ON THE FIELD.
- ITEM #29, THE IVES SURFACE BOLT IS USED ON THE ACTIVE DOOR ONLY TO ACHIEVE A HIGHER DESIGN PRESSURE. THERE IS ONE BOLT AT THE TOP AND ONE BOLT AT THE BOTTOM. THE INSWING USES THE "L" SHAPED STRIKE PLATES.
- THE SIDELITE IS HELD INTO THE FRAME WITH ITEM #47 AND #10 SPACED AS FOLLOWS: (2) #47 (#8 x 2") IN THE HEADER, AND HEAD JAMB AS THE SILL 3.0" IN FROM BOTH HORIZONTAL CORNERS. INSWING THRESHOLD AND THE OAK/ALUM. IN THE SIDELITE BLANK SIDE JAMBS, (6) #47 (8 x 2") 6.0" FROM BOTH VERTICAL CORNERS WITH (4) EQUALLY SPACED ON THE FIELD.

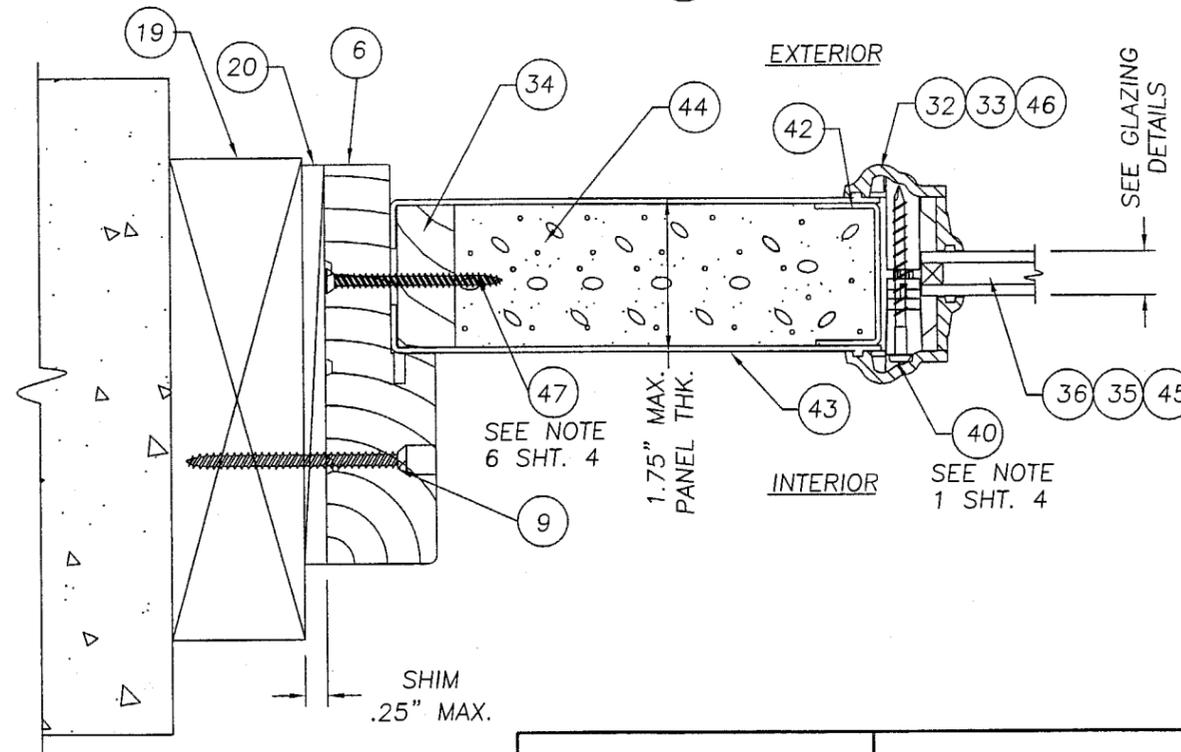

3 HORIZONTAL CROSS SECTION
4 SIDELITE TO BUCK

Approved as complying with the
Florida Building Code
Date: 04/22/04
NOAH 03-0274-03
Miami Code Product Control
Division
By: *[Signature]*





Product Approval Documents Prepared By:		BUILDING CONSULTANTS, INC. P.O. Box 230 Vairico FL 33595 Phone No.: 813.659.9197	
RW		Florida Board of Professional Engineers Certificate of Authorization No. 9813 Wendell W. Money P.E. No. 54158	
PRODUCT:	GLAZED STEEL STEEL EDGE DOOR W/WO SIDELITES	PART OR ASSEMBLY:	HORIZONTAL CROSS SECTION
NO.	DATE	RAH	BY
2	3/23/04	CLARIFY GLAZING COMPOUND	RAH
1	3/20/03	PER DATE COMMENTS	ROF
REVISIONS			
DATE: 1/13/03		SCALE: N.T.S.	
DWG. BY: WLN		CHK. BY: RW	
DRAWING NO.: S-2338		SHEET 4 OF 8	

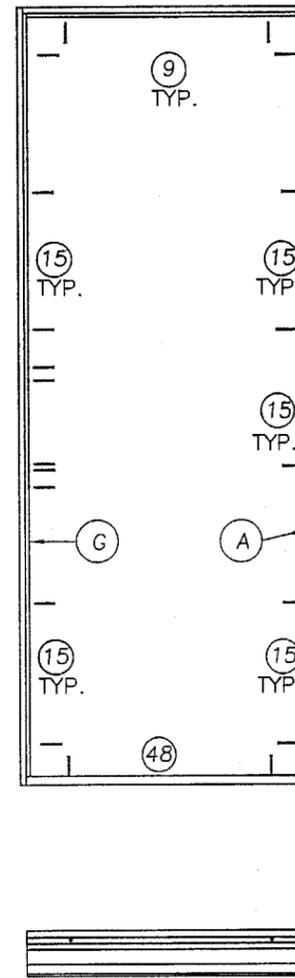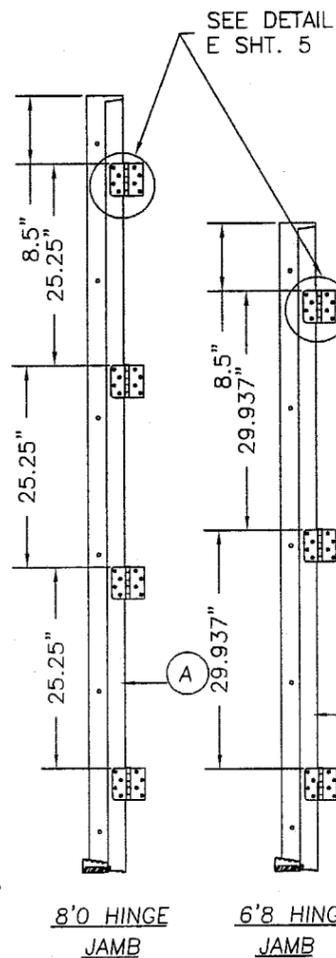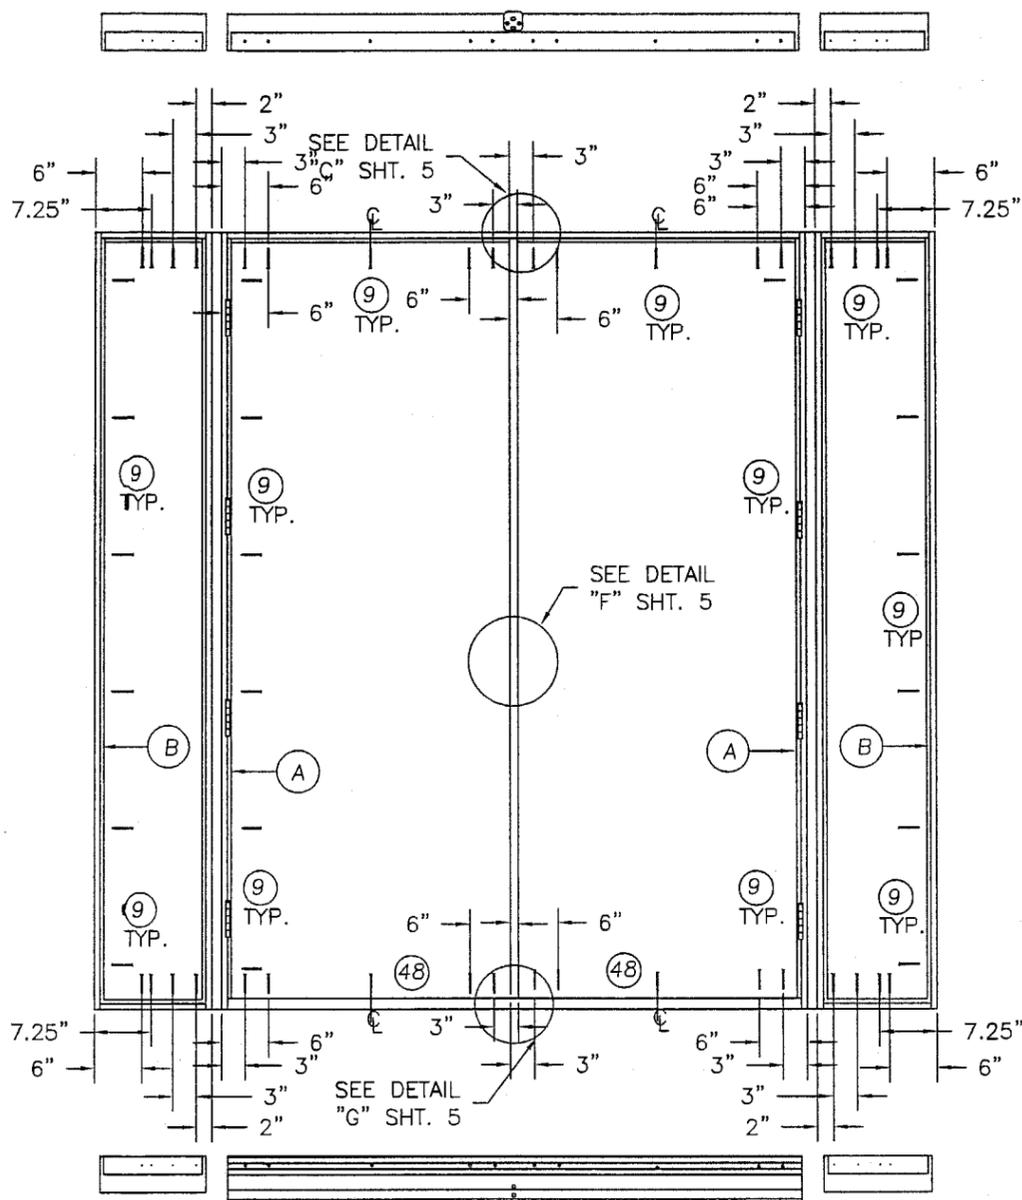

DOUBLE DOOR W/SIDELITES

SINGLE DOOR

DRILL THRU FOR
A ϕ .312" BOLT DEEP
ENOUGH FOR A 2"
BOLT THROW

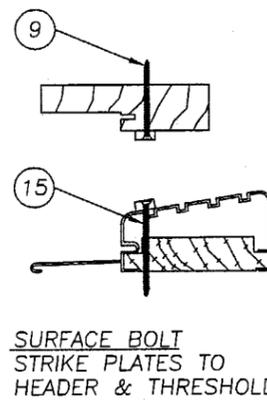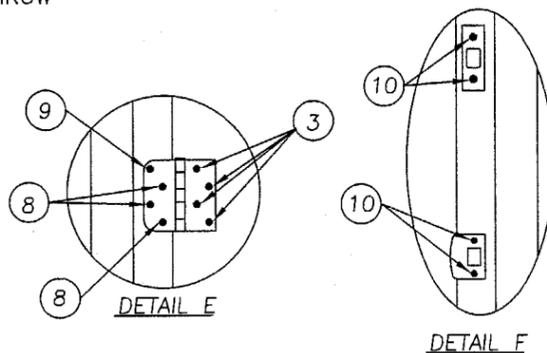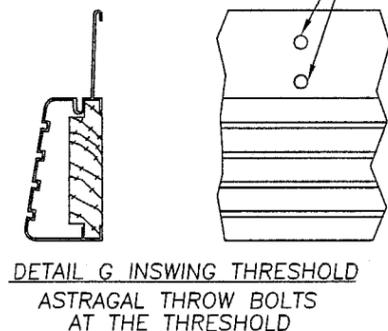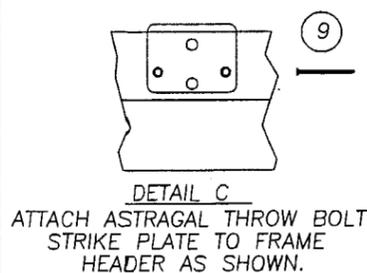

Product Approval Documents Prepared By:

RW BUILDING CONSULTANTS, INC.

P.O. Box 230 Vero Beach, FL 33595

Phone No.: 813.659.9197

Florida Board of Professional Engineers

Certificate of Authorization No. 9813

2/03/2004

Wendell W. Hurley P.E. No. 54158

PRODUCT: GLAZED STEEL
STEEL EDGE DOOR
W/WO SIDELITES

PART OR ASSEMBLY:
ANCHORING LOCATIONS
& DETAILS

NO.	DATE	REVISIONS
2	3/23/04	CLARIFY GLAZING COMPOUND
1	3/20/03	PER DAD COMMENTS
		BY
		RAH
		ROF

DATE: 1/13/03

SCALE: N.T.S.

DWG. BY: WLN


CHK. BY: RW

DRAWING NO.:



S-2338

SHEET 5 OF 8

Approved as complying with the
Florida Building Code
Date 04/22/04
NOAH 03.0224.03
Miami Dade Product Control
Division
By *Wendell Hurley*

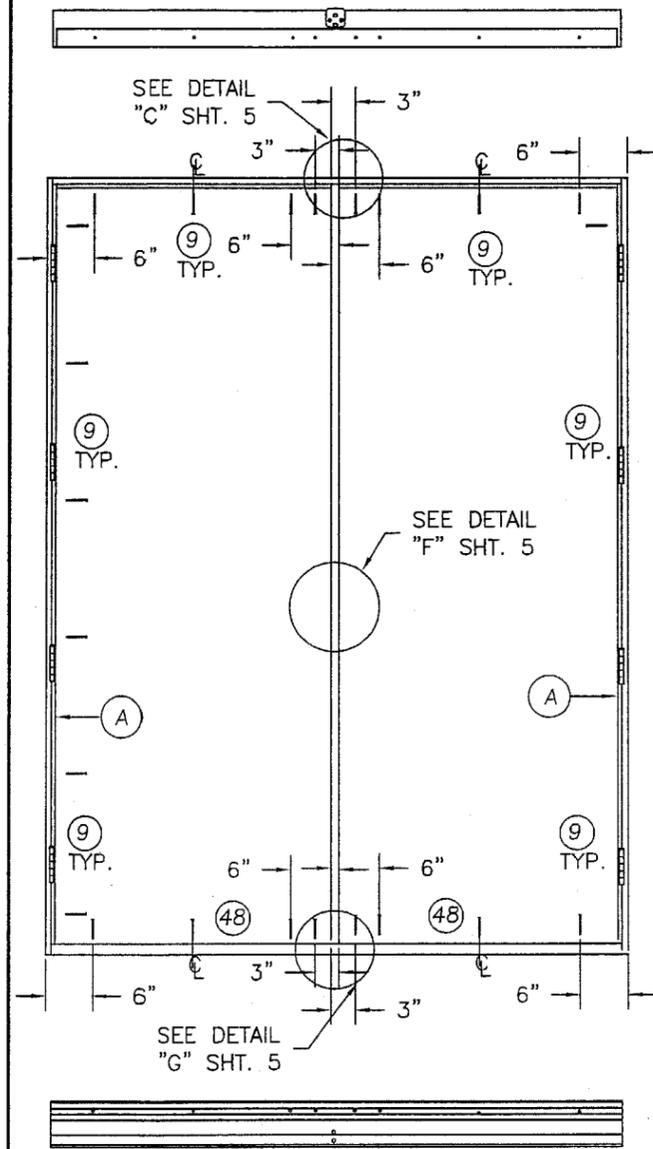

DOUBLE DOOR

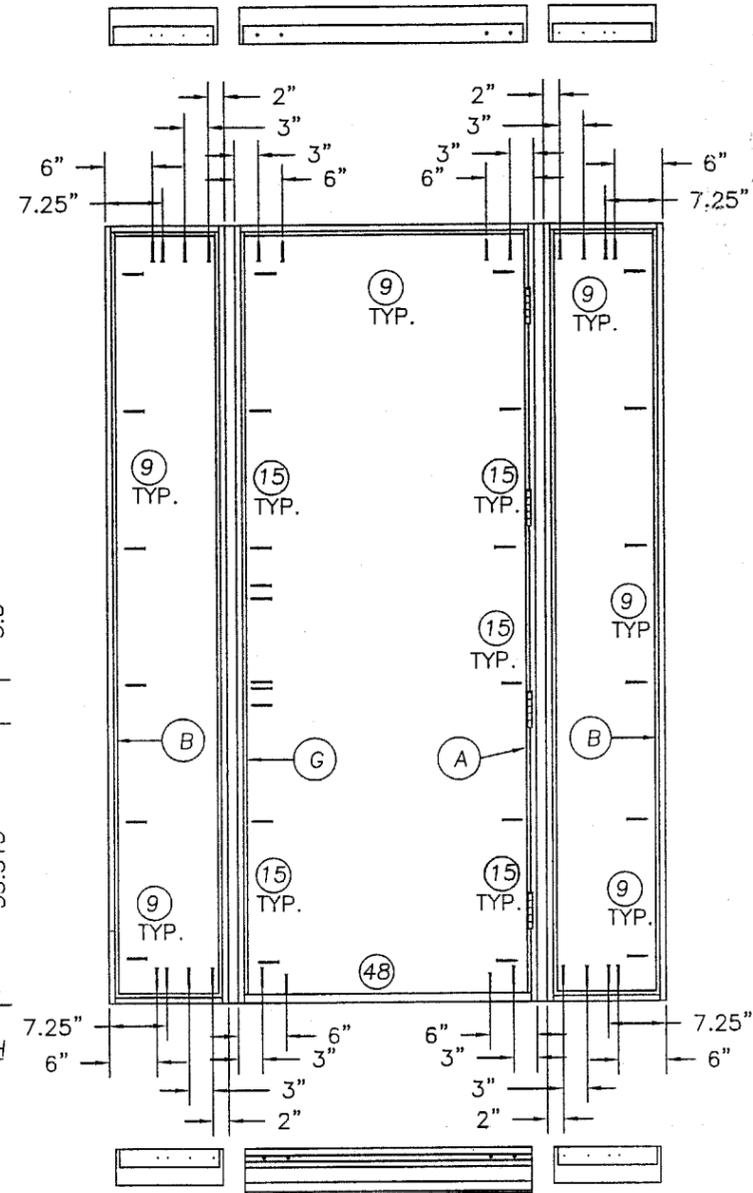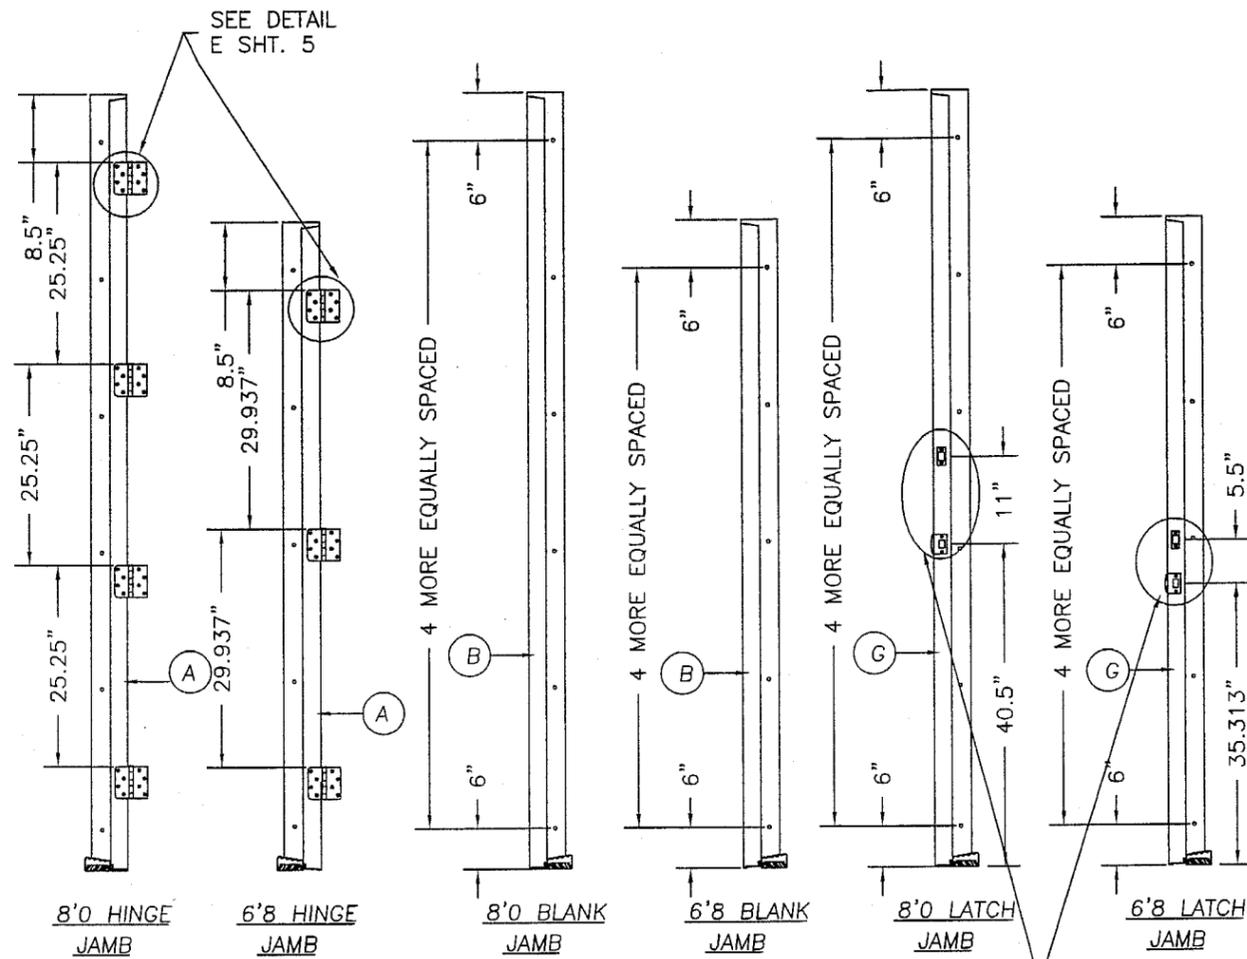

SINGLE DOOR W/SIDELITES


Product Approval Documents Prepared By:
RW BUILDING CONSULTANTS, INC.
 P.O. Box 230 Valrico FL 33595
 Phone No.: 813.659.9197
 Florida Board of Professional Engineers
 Certificate of Authorization No. 9813
Wendell W. Haney
 Wendell W. Haney P.E. No. 54158

PRODUCT: GLAZED STEEL STEEL EDGE DOOR W/WO SIDELITES
 PART OR ASSEMBLY: ANCHORING LOCATIONS


NO.	DATE	REVISIONS
2	3/23/04	CLARIFY GLAZING COMPOUND
1	3/20/03	PER DADE COMMENTS
		RAH
		ROF
		BY

Approved as complying with the Florida Building Code
 Date 04/22/04
 NOA# 03-0224-03
 Miami Dade Product Control
 By: *Quadrone*


DATE: 1/13/03
 SCALE: N.T.S.
 DWG. BY: WLN
 CHK. BY: RW
 DRAWING NO.: S-2338
 SHEET 6 OF 8

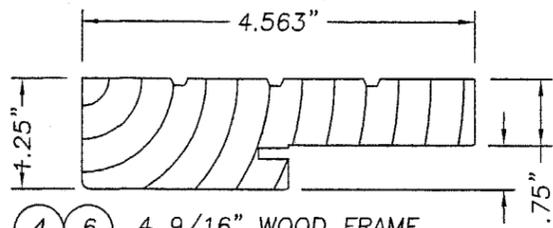


4 6
5 18
4 9/16" WOOD FRAME
FINGER JOINTED PINE




34
SIDELITE TOP & BOTTOM RAIL
SIDELITE SIDE STILE
WOOD, TAYLOR DOOR

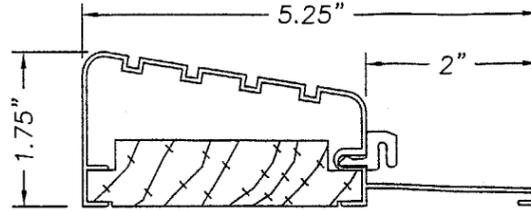


2
HIGH DAM BUMPFACE THRESHOLD
ALUMINUM 0.051"
BY IMPERIAL

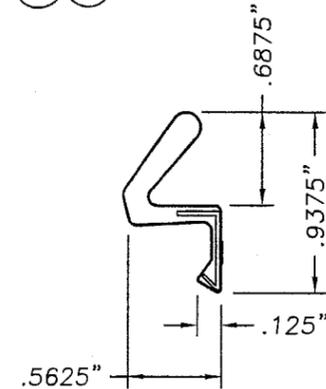


13
HOLM INDUSTRIES JF65

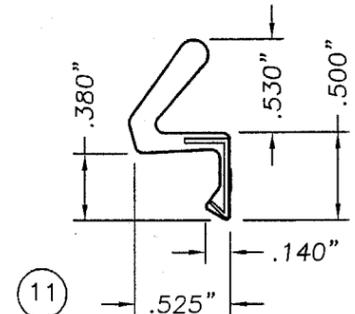


11
SCHLEGEL Q-LON QDS-650

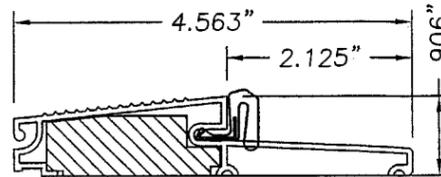


27
LOW PROFILE BUMPFACE THRESHOLD
ALUMINUM 0.051"
OAK/ALUM. BY IMPERIAL

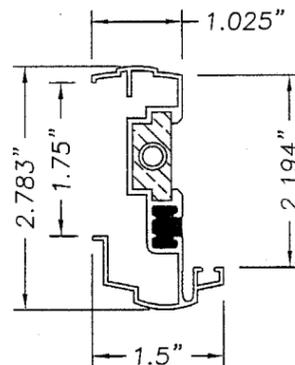


28
IMPERIAL HURRICANE
ASTRAGAL ANH SERIES
EXTRUDED ALUMINUM
0.05" MIN. WALL

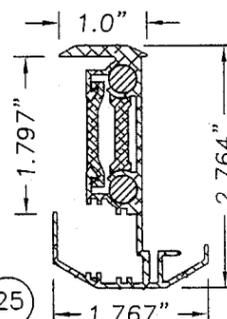


25
ASTRAGAL HAS
(2) 8.0" L. x ϕ .312"
BOLTS @ BOTTOM &
(2) 17.0" L. x ϕ .312"
BOLTS @ TOP
ASTRAGAL WINDJAMBER II
(WR80T) T-6063
EXTRUDED ALUMINUM

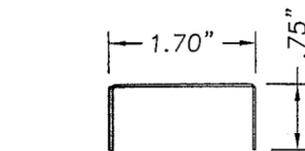

42
DOOR PANEL LITE
OPENING REINFORCEMENT
0.032" STEEL
TAYLOR DOOR

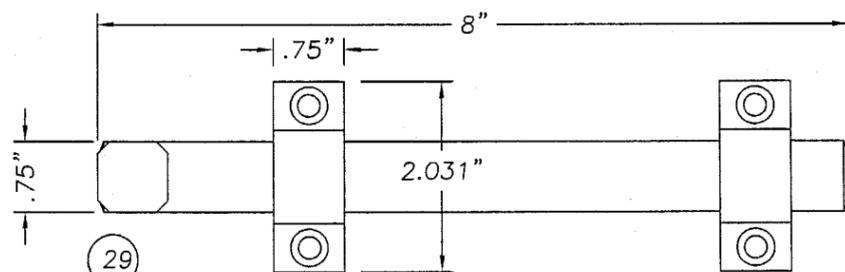

29
SURFACE BOLT (IVES .25" STEEL MODEL #454 & #453)

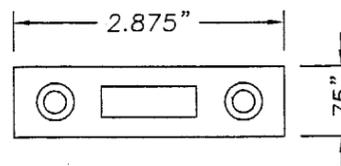

SURFACE BOLT STRIKE (IVES .125" STEEL)
OUTSWING UNIT

Item	DESCRIPTION	Material
1	DOOR FACE SHEET 24GA.(Fy 28,520 psi MIN.) .021" MINIMUM THICKNESS	STEEL
2	OUTSWING BUMPFACE HIGH DAM SILL BY IMPERIAL .051" ALUM.	ALUM.
3	10-24 x 5/8" TAPTITE PFH SCREW (HINGE TO DOOR)	STEEL
4	HEADER 4 9/16" x 1 1/4" FINGER JOINTED PINE	PINE
5	HINGE JAMB 4 9/16" x 1 1/4" FINGER JOINTED PINE	PINE
6	SIDELITE BLANK JAMB 4 9/16" X 1 1/4" F.J.PINE	PINE
7	4" x 4" HINGE .097" THK.	STEEL
8	#9 x 5/8" PFH WOOD SCREW (Hinge to Frame)	STEEL
9	#10 X 2 1/2" PFH WOOD SCREW	STEEL
10	#8 x 2 1/2" PFH WOOD SCREW	STEEL
11	COMPRESSION WEATHERSTRIP SCHLEGEL Q-LON QDS-650	FOAM
12	SCHLAGE F50 SERIES PASSAGE KNOB	-
13	COMPRESSION WEATHERSTRIP HOLM INDUSTRIES JF65	FOAM
14	GLAZING COMPOUND DOW #1199	SILICONE
15	#10 x 3" PFH WOOD SCREW	STEEL
16	KWIKSET TITAN 700 SERIES PASSAGE	-
17	KWIKSET 700 SERIES DEADBOLT	-
18	LATCH JAMB 4 9/16" x 1 1/4" FINGER JOINTED PINE	PINE
19	2x INNER TEST BUCK	WOOD
20	MAX. 1/4" SHIM MATERIAL	-
21	#8 x 1 1/2" LONG LITE FRAME SCREW	STEEL
22	INSWING SIDELITE THRESHOLD W/VINYL BOOT BY IMPERIAL	OAK/ALUM.
23	#8 x 1" PPH WOOD SCREW	STEEL
24	POLYURETHANE FOAM CORE BY BAYTHERM 2.1lbs DENSITY	FOAM
25	ASTRAGAL EXTRUDED ALUM. (WR80T WINDJAMBER II)	ALUMINUM
26	LOCK BLOCK 1.70" x 4.0" x 16.5" SOLID PINE	WOOD
27	OUTSWING LOW PROFILE BUMPFACE SILL BY IMPERIAL .051" ALUM.	ALUM.
28	ALUMINUM HURRICANE ASTRAGAL ANH SERIES BY IMPERIAL .050"	ALUM.
29	IVES 454 SURFACE BOLT 1/4" THK. x 8" LONG	STEEL
30	DOOR HINGE PLATE ADJUSTABLE (12GA.)	STEEL
31	3/16" SEXBOLT W/ 3/16" x 1 1/2" SCREW	STEEL
32	EXTRUDED PVC LIP LITE FRAME FOR 1/8" GLASS BY RSL	PVC
33	EXTRUDED PVC LIP LITE FRAME FOR 1/2" GLASS BY RSL	PVC
34	SIDELITE TOP & BOTTOM RAIL & SIDE STILE WOOD	WOOD
35	1/8" TEMPERED GLASS	-
36	1/2" INSULATED TEMPERED GLASS	-
37	SCHLAGE B360 SERIES DEADBOLT	-
38	1" x 1/2" CORRUGATED FASTENER	STEEL
39	1 1/4" HK. x 4 9/16" WIDE PRESSURE TREATED FRAME REINFORCEMENT	WOOD
40	#10 x 2" PANHEAD LITE FRAME SCREW	STEEL
41	GE SILGAZE II 2800 SILICONE SEALANT	SILICONE
42	LITE OPENING REINFORCEMENT 1.7" x .75" x .032" THK. STEEL	STEEL
43	SIDELITE PANEL FACE SHEET 24GA 0.021" MIN.	STEEL
44	POLYSTYRENE FOAM CORE 1.0lbs DENSITY	STYROFOAM
45	1" INSULATED TEMPERED GLASS	-
46	EXTRUDED PVC LIP LITE FRAME FOR 1" GLASS BY RSL	PVC
47	#8 x 2" PFH WOOD SCREW	STEEL
48	3/16" TAPCON ANCHOR (ELCO)	STEEL
49	GLAZING COMPOUND DOW #995	SILICONE
50	IVES #453 SURFACE BOLT 1/4" THK. X 8" LONG	STEEL
51	EXTRUDED PVC LIP LITE FRAME FOR 1" GLASS BY THORTON INDUSTRIES	PVC
52	EXTRUDED PVC LIP LITE FRAME FOR 1/2" GLASS BY THORTON INDUSTRIES	PVC
53	EXTRUDED POLYPROP. LIP LITE FRAME FOR 1" GLASS BY ODL	POLYPRO/ NOVAPL.
54	EXTRUDED POLYPROP. LIP LITE FRAME FOR 1/8" GLASS BY ODL	POLYPRO/ NOVAPL.


Approved as complying with the
Florida Building Code
Date 04/22/04
NOA# 03-0224.03
Miami Dade Product Control
Division
By *Cherise Beem*

DATE: 1/13/03
SCALE: N.T.S.
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2338
SHEET 7 OF 8


Product Approval Documents Prepared By:
RW
BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197
Florida Board of Professional Engineers
Certificate Of Authorization No. 9813
Wendell W. Heneke P.E. No. 54158

PRODUCT: GLAZED STEEL
STEEL EDGE DOOR
W/WO SIDELITES
PART OR ASSEMBLY:
UNIT COMPONENTS &
BILL OF MATERIAL


NO.	DATE	REVISIONS
2	3/23/04	CLARIFY GLAZING COMPOUND
1	3/20/03	PER DADE COMMENTS
		RAH
		ROF
		BY

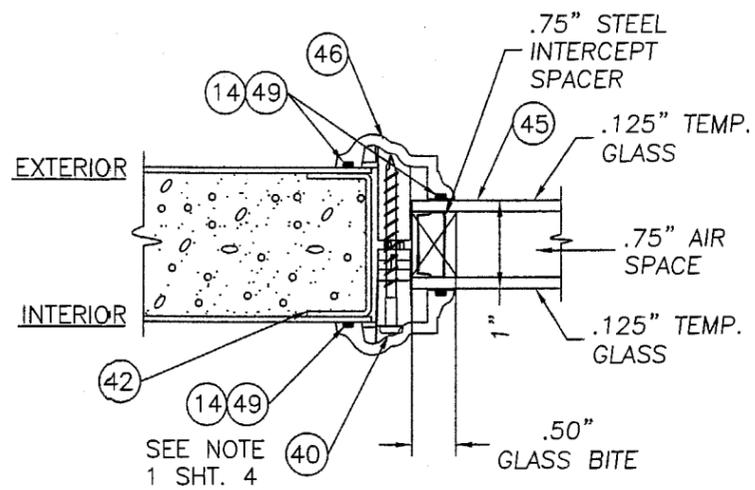


1" INSULATED TEMPERED GLASS
W/ITEMS #45 & #46

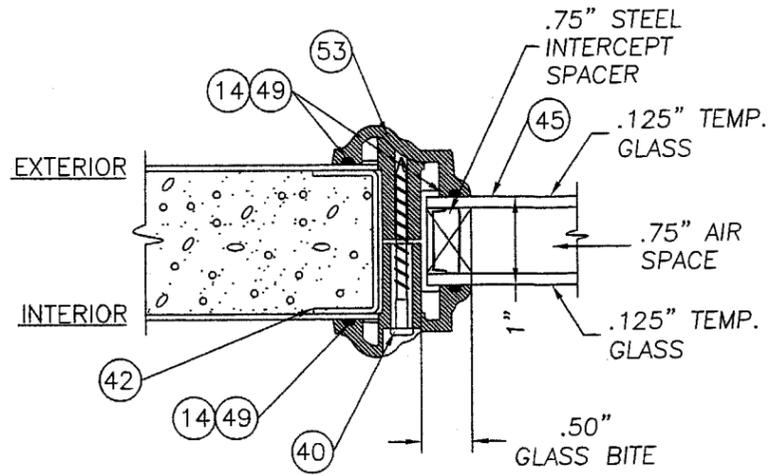


1" INSULATED TEMPERED GLASS
W/THE ODL LITE FRAME (#53)

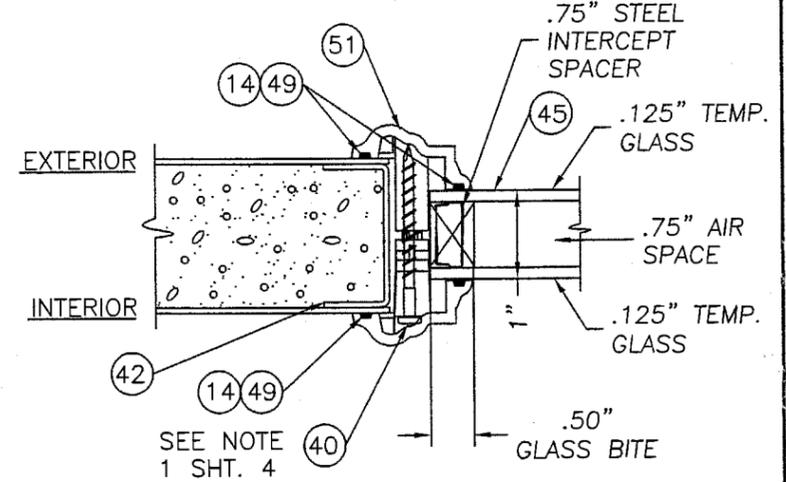


1" INSULATED TEMPERED GLASS
W/THE THORNTON LITE FRAME (#51)

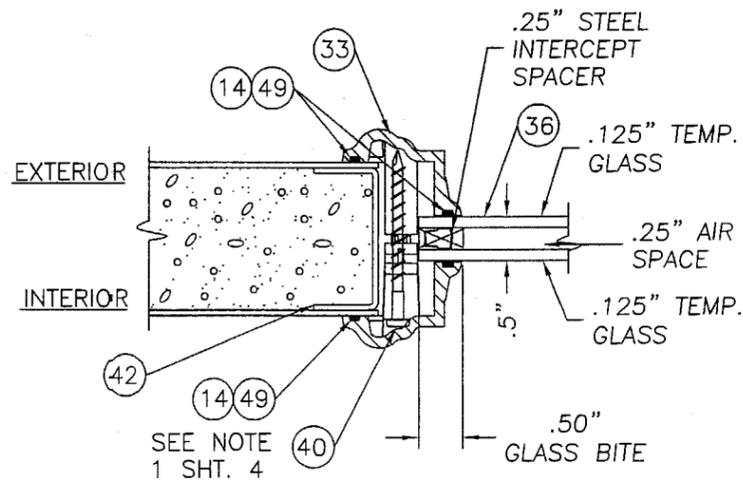


1/2" INSULATED TEMPERED GLASS
W/ITEMS #33 & #36

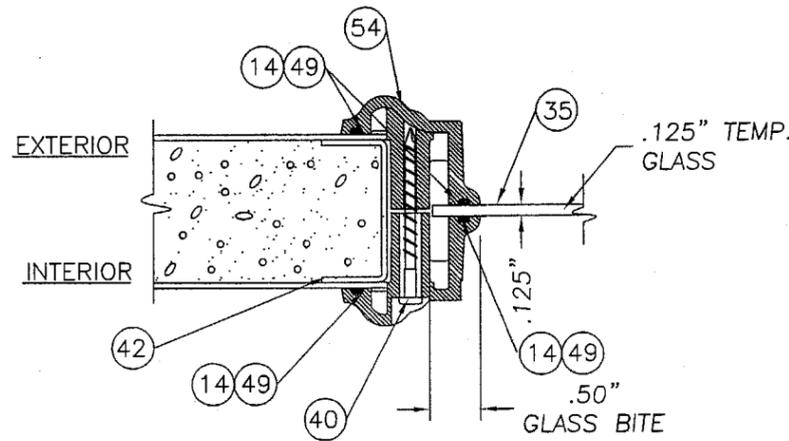

1/8" TEMPERED GLASS
W/THE ODL LITE FRAME (#51)

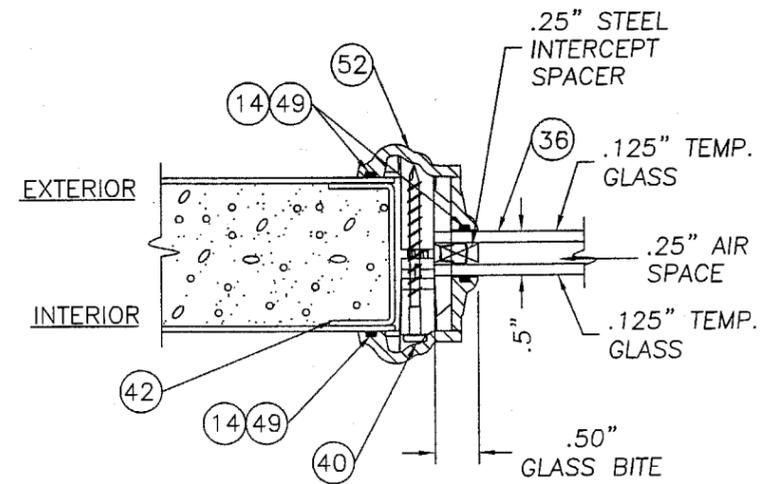

1/2" INSULATED TEMPERED GLASS
W/THE THORNTON LITE FRAME (#52)

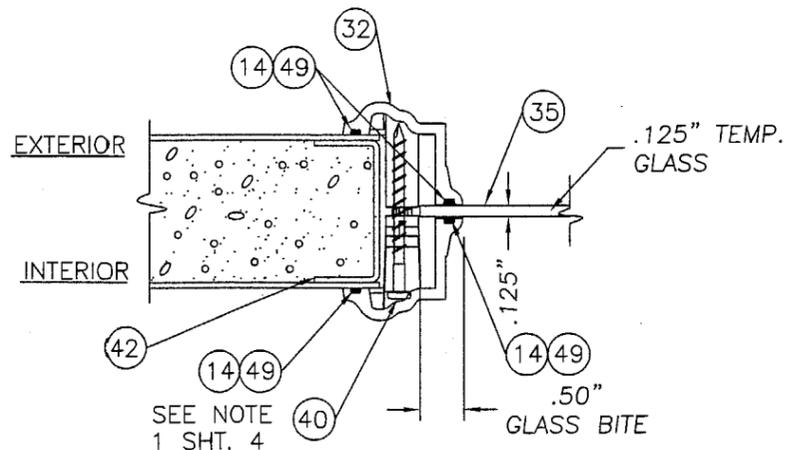

1/8" TEMPERED GLASS
W/ITEMS #32 & #35

Product Approval Documents Prepared By:

RW BUILDING CONSULTANTS, INC.

P.O. Box 230 Valrico FL 33595

Phone No.: 813.659.9197

Florida Board of Professional Engineers

Certificate of Authorization No. 9813

Wendell W. Henney P.E. No. 54158

2/03/2004

PRODUCT:	GLAZED STEEL STEEL EDGE DOOR W/WO SIDELITES
PART OR ASSEMBLY:	GLAZING DETAILS

NO	DATE	BY	REVISIONS
2	3/23/04	RAH	CLARIFY GLAZING COMPOUND
1	3/20/03	ROF	PER DADE COMMENTS
NO			

DATE:	1/13/03
SCALE:	N.T.S.
DWG. BY:	WLN
CHK. BY:	RW
DRAWING NO.:	S-2338
SHEET	8 OF 8

Approved as complying with the
Florida Building Code
Date: 04/22/04
NOA# 03-0274.03
Miami Dade Product Control
Division
By: *[Signature]*