



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Pozzi Window Company
62845 Boyd Acres Rd.
Bend, OR 97701**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Aluminum Clad Wood Outswing Patio Door

APPROVAL DOCUMENT: Drawing No. S-2337, titled "Pozzi Aluminum Clad Wood Outswing Patio Door", sheets 1 through 6 of 6, prepared by R.W. Building Consultants, Inc., dated 1/20/03 with revision on 3/18/03, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 as well as approval document mentioned above.

The submitted documentation was reviewed by **Theodore Berman, P.E.**



**NOA No 03-0224.05
Expiration Date: April 24, 2008
Approval Date: April 24, 2003
Page 1**

Pozzi Window Company

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA)

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **S-2337**, titled "Pozzi Aluminum Clad Wood Outswing Patio Door", sheets 1 through 6 of 6, prepared by R.W. Building Consultants, Inc., dated 1/20/03 with revision on 3/18/03.

B. TESTS

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
along with marked-up drawings and installation diagram of an aluminum clad wood outswing patio door, prepared by Architectural Testing, Inc., Test Report No. 03-31367.02 dated 11/28/01, signed and sealed by Allen N. Reeves, P.E.

C. CALCULATIONS

1. Anchor Calculations and structural analysis, prepared by R.W. Building Consultants, Inc., dated 2/10/03, signed and sealed by Lyndon F. Schmidt, P.E.

D. MATERIAL CERTIFICATIONS

1. None

E. STATEMENTS

1. Statement letter of conformance, dated 2/12/03, signed and sealed by Lyndon F. Schmidt, P.E.
2. Statement letter of no financial interest, dated 12/12/02, signed and sealed by Janet Gerard.
3. Letter from R.W. Building Consultants, dated 03/18/03, responding to the information requested on 03/05/03.

F. OTHER

1. Letter from the consultant stating that the product is in compliance with the Florida Building Code (FBC).



Theodore Berman, P.E.

Deputy Director, Product Control Division

NOA No 03-0224.05

Expiration Date: April 24, 2008


Approval Date: April 24, 2003

POZZI WINDOW COMPANY


ALUMINUM CLAD WOOD OUTSWING PATIO DOOR

GENERAL NOTES


1. THIS PRODUCT IS DESIGNED TO MEET THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. THIS SYSTEM REQUIRES WINDBORNE DEBRIS EXTERNAL PROTECTION AS PRESCRIBED IN SECTION 1626.1 OF THE FLORIDA BUILDING CODE.
5. DESIGN PRESSURE RATING SHOWN THIS PAGE:
6. THIS PRODUCT MEETS WATER REQUIREMENTS FOR THE "HIGH VELOCITY HURRICANE ZONES".

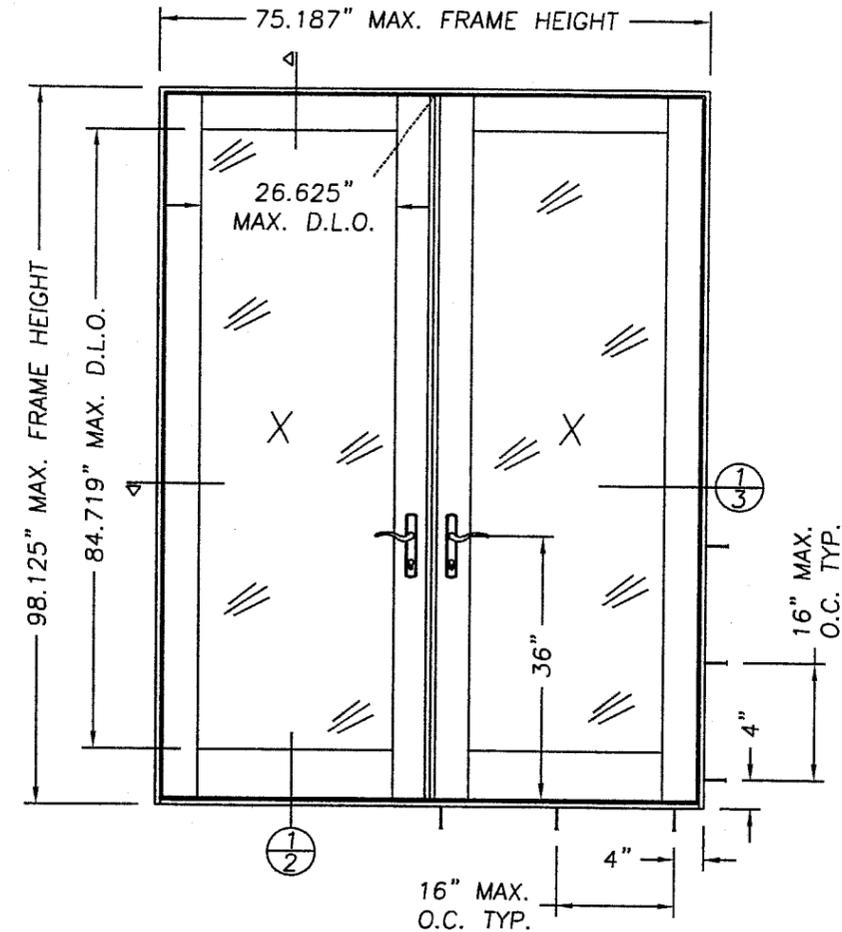


SEE ANCHORING NOTE
SHT. 2

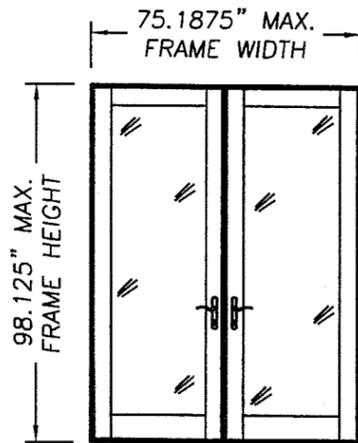


75.1875" x 98.125"
DESIGN PRESSURE
POSITIVE +60.0
NEGATIVE -62.0

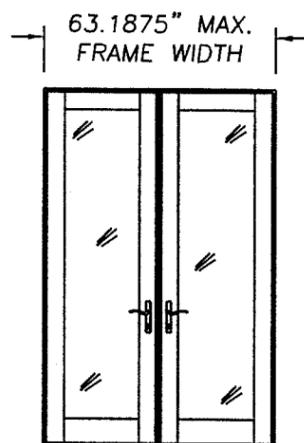


63.1875" x 98.125"
DESIGN PRESSURE
POSITIVE +60.0
NEGATIVE -62.0

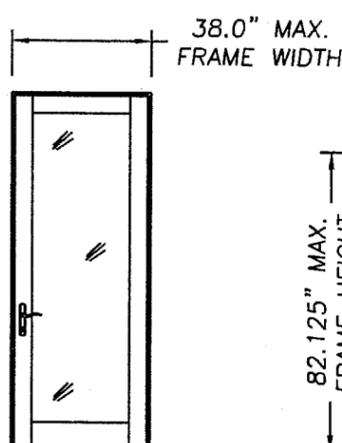


38.0" x 98.125"
DESIGN PRESSURE
POSITIVE +60.0
NEGATIVE -62.0

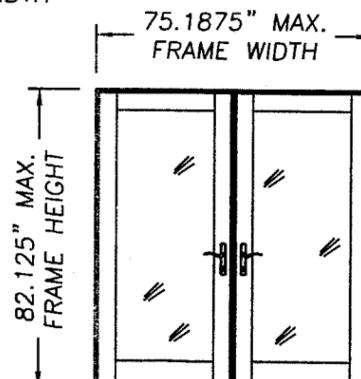

75.1875" x 82.125"
DESIGN PRESSURE
POSITIVE +60.0
NEGATIVE -62.0

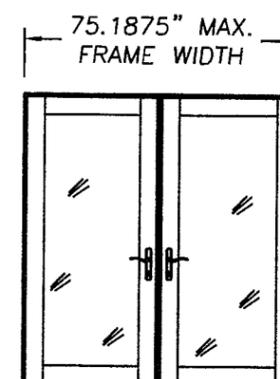

75.1875" x 82.125"
DESIGN PRESSURE
POSITIVE +60.0
NEGATIVE -62.0

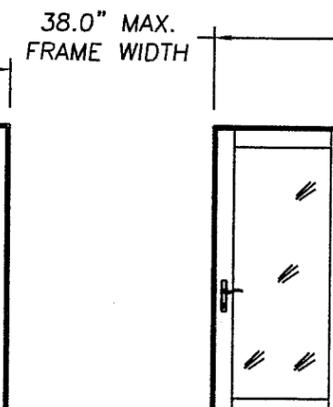

38.0" x 82.125"
DESIGN PRESSURE
POSITIVE +60.0
NEGATIVE -62.0

TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATIONS
2	VERTICAL CROSS SECTION & FRAME CONSTRUCTION
3	HORIZONTAL CROSS SECTION
4	DOOR PANEL CONSTRUCTION & GLAZING DETAIL
5	BILL OF MATERIALS & UNIT COMPONENTS
6	BILL OF MATERIALS & UNIT COMPONENTS

DESIGN PRESSURE RATING

SIZE	DAYLIGHT OPENING	POSITIVE	NEGATIVE
MAX. 6'0" X 8'0" (2) 3'0" X 8'0" PANELS	UP TO 15.66 SQ. FT.	+60 PSF	-62 PSF

Approved as complying with the
Florida Building Code
Date 04/24/03
NOA# 03-0224-05
Miami Dade Product Control
Division
By: *Gerard Gorman*



DATE: 1/20/03
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2337
SHEET 1 OF 6

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411

PRODUCT: POZZI ALUMINUM CLAD WOOD OUTSWING PATIO DOOR
PART OR ASSEMBLY: GENERAL NOTES & TYPICAL ELEVATIONS

NO.	DATE	GENERAL REVISION	ZRK	BY
1	3/18/03	GENERAL REVISION	ZRK	BY

RW BUILDING CONSULTANTS, INC.
813.659.9197

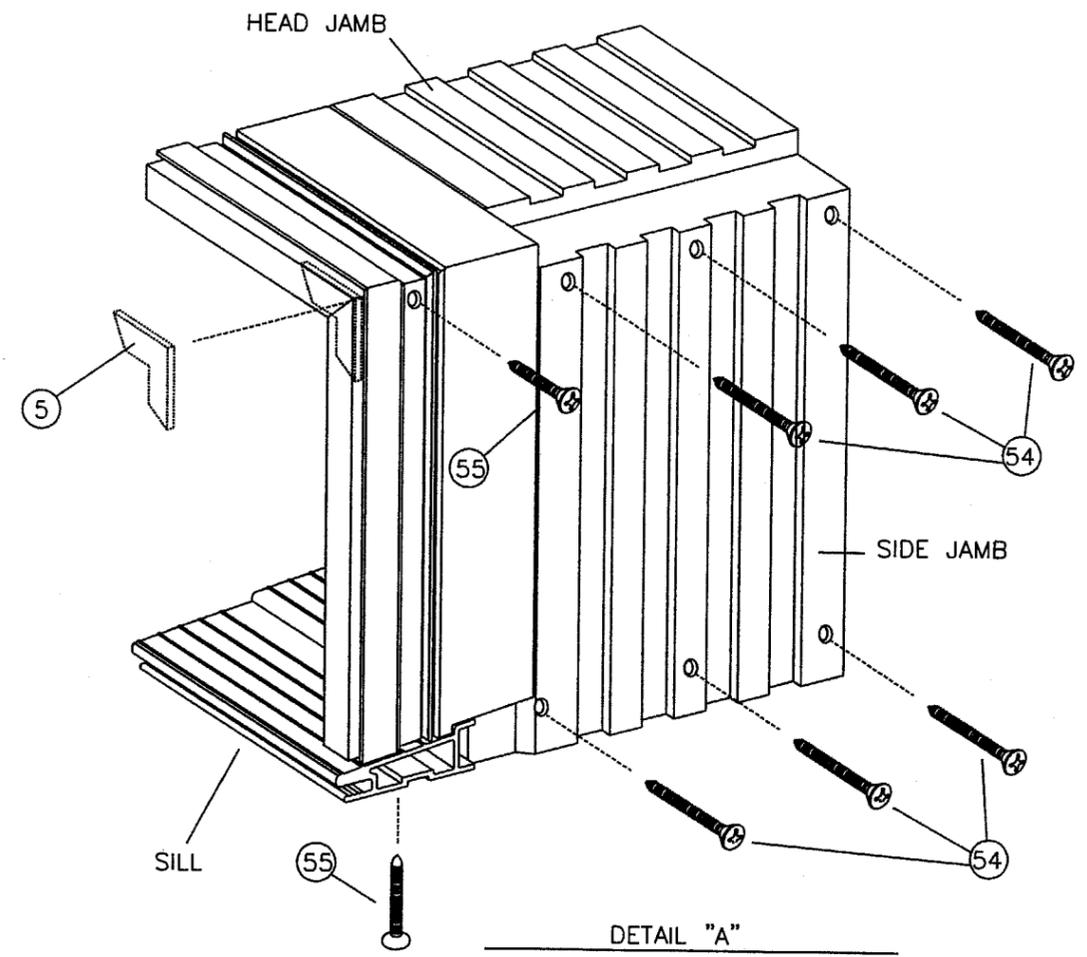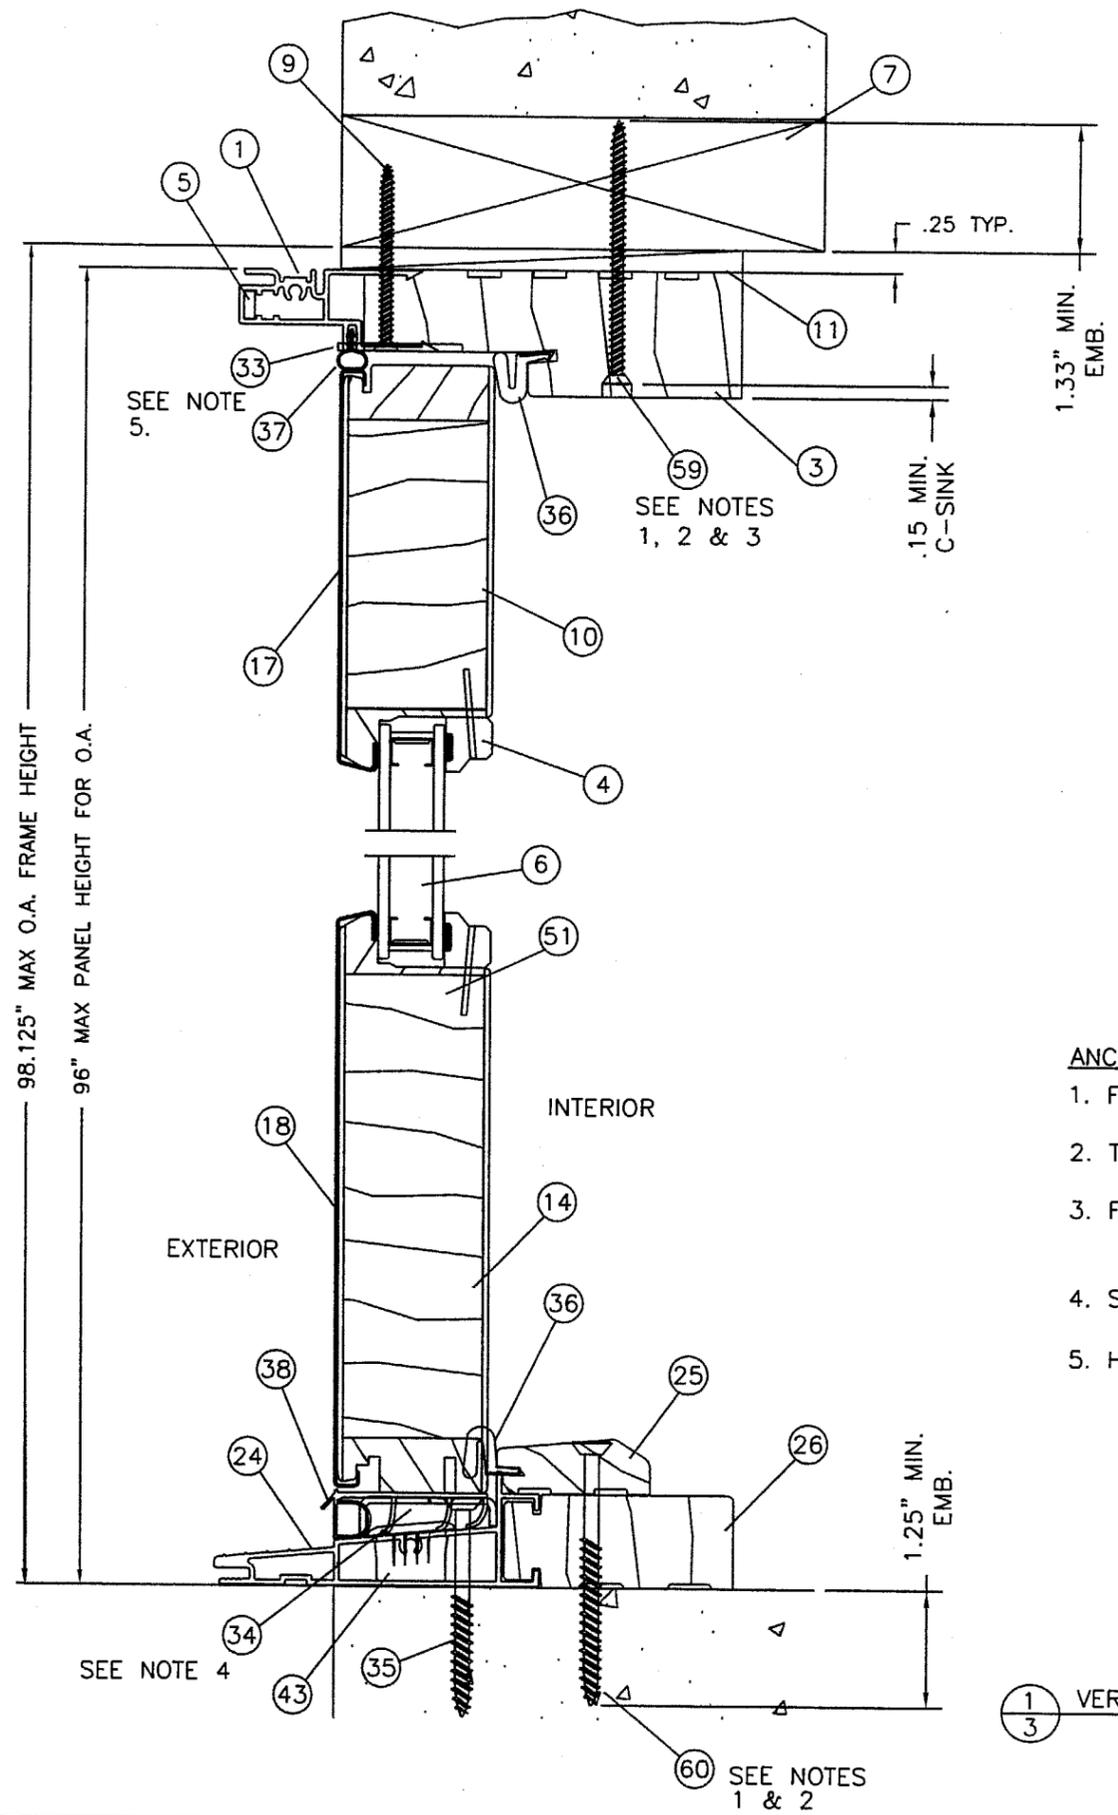

DETAIL "A"
FRAME CORNER FASTENER DETAIL
SEE FRAME CONSTRUCTION NOTES SHEET 4

ANCHORING NOTES:

1. FASTENERS ARE LOCATED 4" FROM END OF FRAME AND MAX. 16" O.C. TYP.
2. THE FASTENER SPACING AT THE BOTTOM IS CONSISTANT WITH THE TOP.
3. FASTENERS ARE COUNTER SUNK A MINIMUM .15" THROUGH THE JAMB AND PENETRATE INTO THE BUCK WITH A MINIMUM EMBEDMENT OF 1.33".
4. SILL SHOOT BOLT STRIKE ATTACHED THROUGH SILL WITH (3) 3/16" X 2 1/2" TAPCON TYPE ANCHOR.
5. HEAD SHOOT BOLT STRIKE ATTACHED WITH (2) #8 X 2 1/2" PFH W.S.

1 VERTICAL CROSS SECTION
3

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411


PRODUCT: POZZI
ALUMINUM CLAD WOOD
OUTSWING PATIO DOOR
PART OR ASSEMBLY:
VERTICAL CROSS SECTION
& FRAME CONSTRUCTION

NO.	DATE	GENERAL REVISIONS	ZRK	BY
1	3/18/03			

RW BUILDING
CONSULTANTS, INC.
813.659.9197

DATE: 1/20/03
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2336
SHEET 2 OF 6

Approved as complying with the
Florida Building Code
Date 04/24/03
NOA# 03-0224.05
Miami Dade Product Control
Division
Chester German

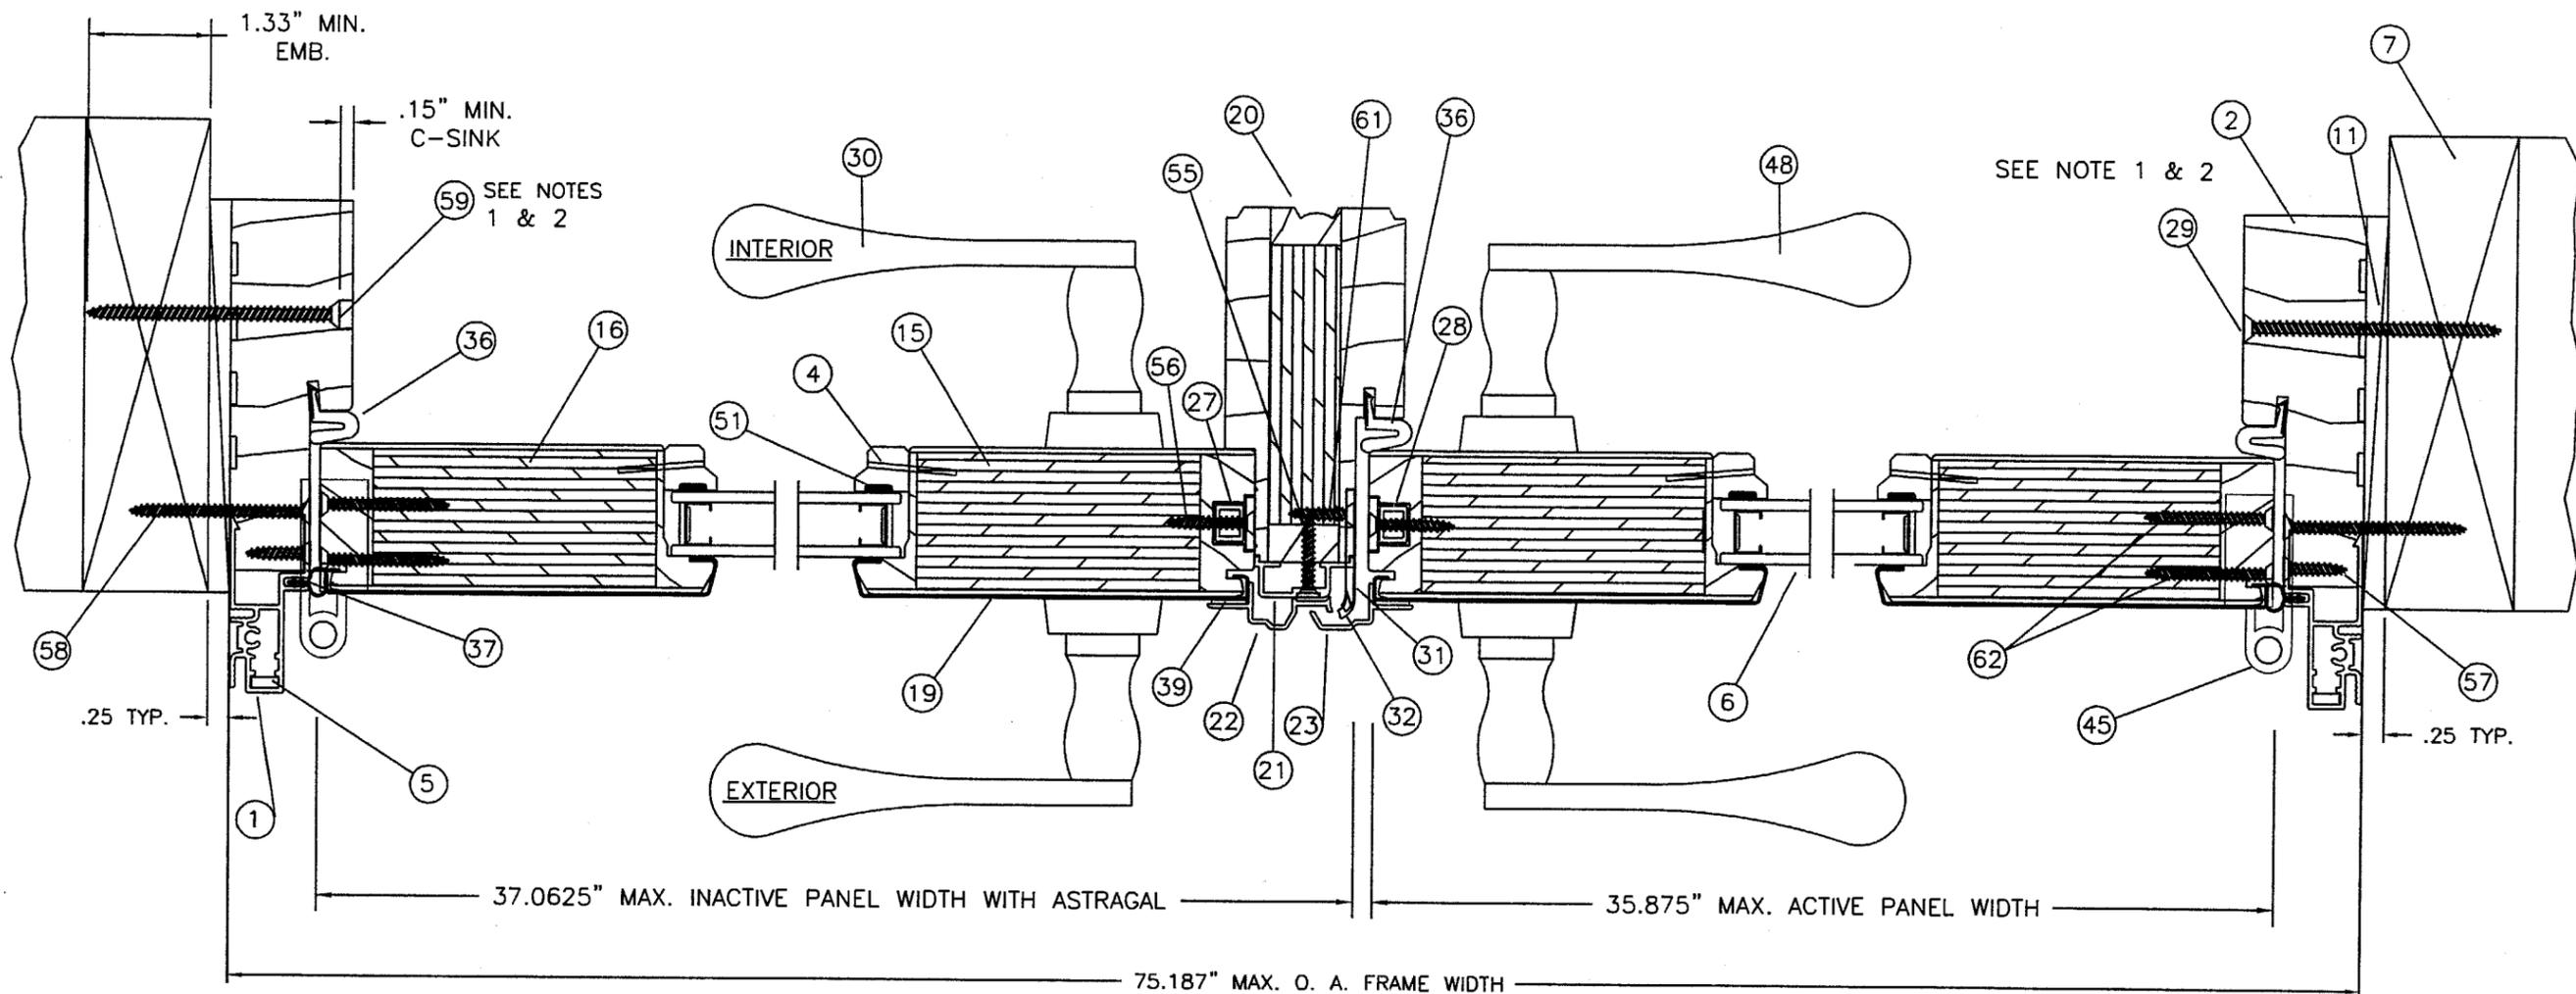

1 HORIZONTAL CROSS SECTION
4

FRAME CONSTRUCTION:

THE WOOD FRAME IS 4.3125" x 1.4375" PONDEROSA PINE. THE FRAME METAL IS 2.26091" x .921875" x .060" WALL EXTRUDED ALUMINUM. THE FRAME METAL IS SNAPPED ONTO THE WOOD JAMB WITH A LAP JOINT AT THE HEAD CORNERS AND SEALED WITH SILICONE (1199 DOW CORNING). EACH HEAD CORNER IS FASTENED WITH (3) #8 x 2" FLT. HD. PHL. SCREWS. AN ADDITIONAL #8 x 1" FLT. HD. PHL. SCREW IS APPLIED INTO THE SCREW BOSS OF THE ALUMINUM EXTRUSION AND A CORNER KEY .125" x 11/32" INTO THE SLOT OF THE ALUMINUM EXTRUSION TO COMPLETE THE CORNER. THE SILL IS ATTACHED THROUGH THE SIDE JAMB INTO THE SILL BASE WITH (3) #8 x 2" FLT. HD. PHL. SCREWS. AN ADDITIONAL #8 x 1" FLT. HD. PHL. SCREW IS APPLIED UP THROUGH THE SILL METAL INTO THE SCREW BOSE OF THE ALUMINUM SIDE JAMB EXTRUSION TO COMPLETE THE INSTALLATION.

ANCHORING NOTES

1. FASTENER ARE LOCATED 4" FROM END OF FRAME AND MAX. 16" O.C. TYP.
2. FASTENERS ARE COUNTER SUNK A MINIMUM .15" THROUGH THE JAMB AND PENETRATE INTO THE BUCK WITH A MINIMUM EMBEDMENT OF 1.33".

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411

PRODUCT: POZZI
ALUMINUM CLAD WOOD
OUTSWING PATIO DOOR
PART OR ASSEMBLY:
HORIZONTAL CROSS SECTION

NO.	DATE	GENERAL REVISIONS	ZRK	BY
1	3/18/03			

RW BUILDING
CONSULTANTS, INC.
813.659.9197

Approved as complying with the
Florida Building Code
Date 04/24/03
NOA# 03-0224.05
Miami Dade Product Control
Div.
By Cherise Beaman

DATE: 1/20/03
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.:
S-2337
SHEET 3 OF 6


POZZI WINDOW COMPANY
 62845 BOYD ACRES RD.
 BEND, OREGON 97701
 PH. 541.382.4411

PRODUCT: POZZI
 ALUMINUM CLAD WOOD
 OUTSWING PATIO DOOR
 PART OR ASSEMBLY:
 DOOR PANEL CONSTRUCTION
 & GLAZING DETAIL

NO.	DATE	GENERAL REVISIONS	ZRK	BY
1	3/18/03			

RW BUILDING
 CONSULTANTS, INC.
 813.659.9197


DATE: 1/20/03
 SCALE: N.T.S.
 DWG. BY: TJH
 CHK. BY: RW
 DRAWING NO.: S-2337
 SHEET 4 OF 6

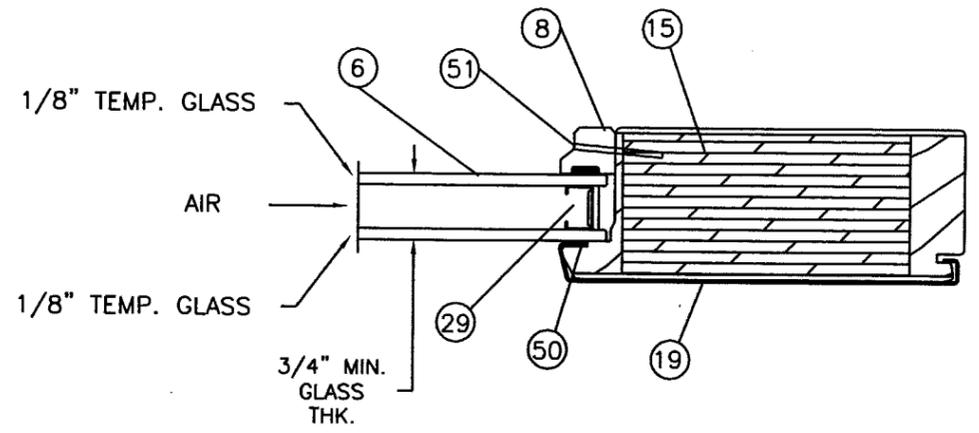

INSULATED GLASS DETAIL
 ULTRAEDGE™ GLASS SPACER

PANEL CONSTRUCTION NOTE:


PANELS ARE CONSTRUCTED OF HINGE STILES (4.625" x 1.71875"), LOCK STILES (4.625" x 1.71875"), TOP RAIL (4.625" x 1.71875"), AND STANDARD BOTTOM RAIL (6.625" x 1.71875"), OPTIONAL BOTTOM RAIL (10.25" x 1.71875"). LOCK AND HINGE STILES SHALL BE SOLID WESTERN PINE VENEER LAMINATED TO A TIMBERSTRAND CORE. TOP RAIL AND BOTTOM RAIL ARE COMPOSED OF SOLID WESTERN PINE VENEER LAMINATED TO A KILN DRIED EDGE-AND-END GLUED CORE. THE ROLLFORMED ALUMINUM CLAD SURFACE IS .024" WALL THICKNESS. THE DOWELS ARE COATED WITH A WATER ACTIVATED ADHESIVE AND WATER IS APPLIED TO THE DOWELS PRIOR TO INSERTION INTO THE DOWEL HOLES. (SEE DETAIL "C") THE ASTRAGAL IS APPLIED TO THE INACTIVE STILE AFTER THE INACTIVE HARDWARE IS INSTALLED INTO THE INACTIVE STILE.

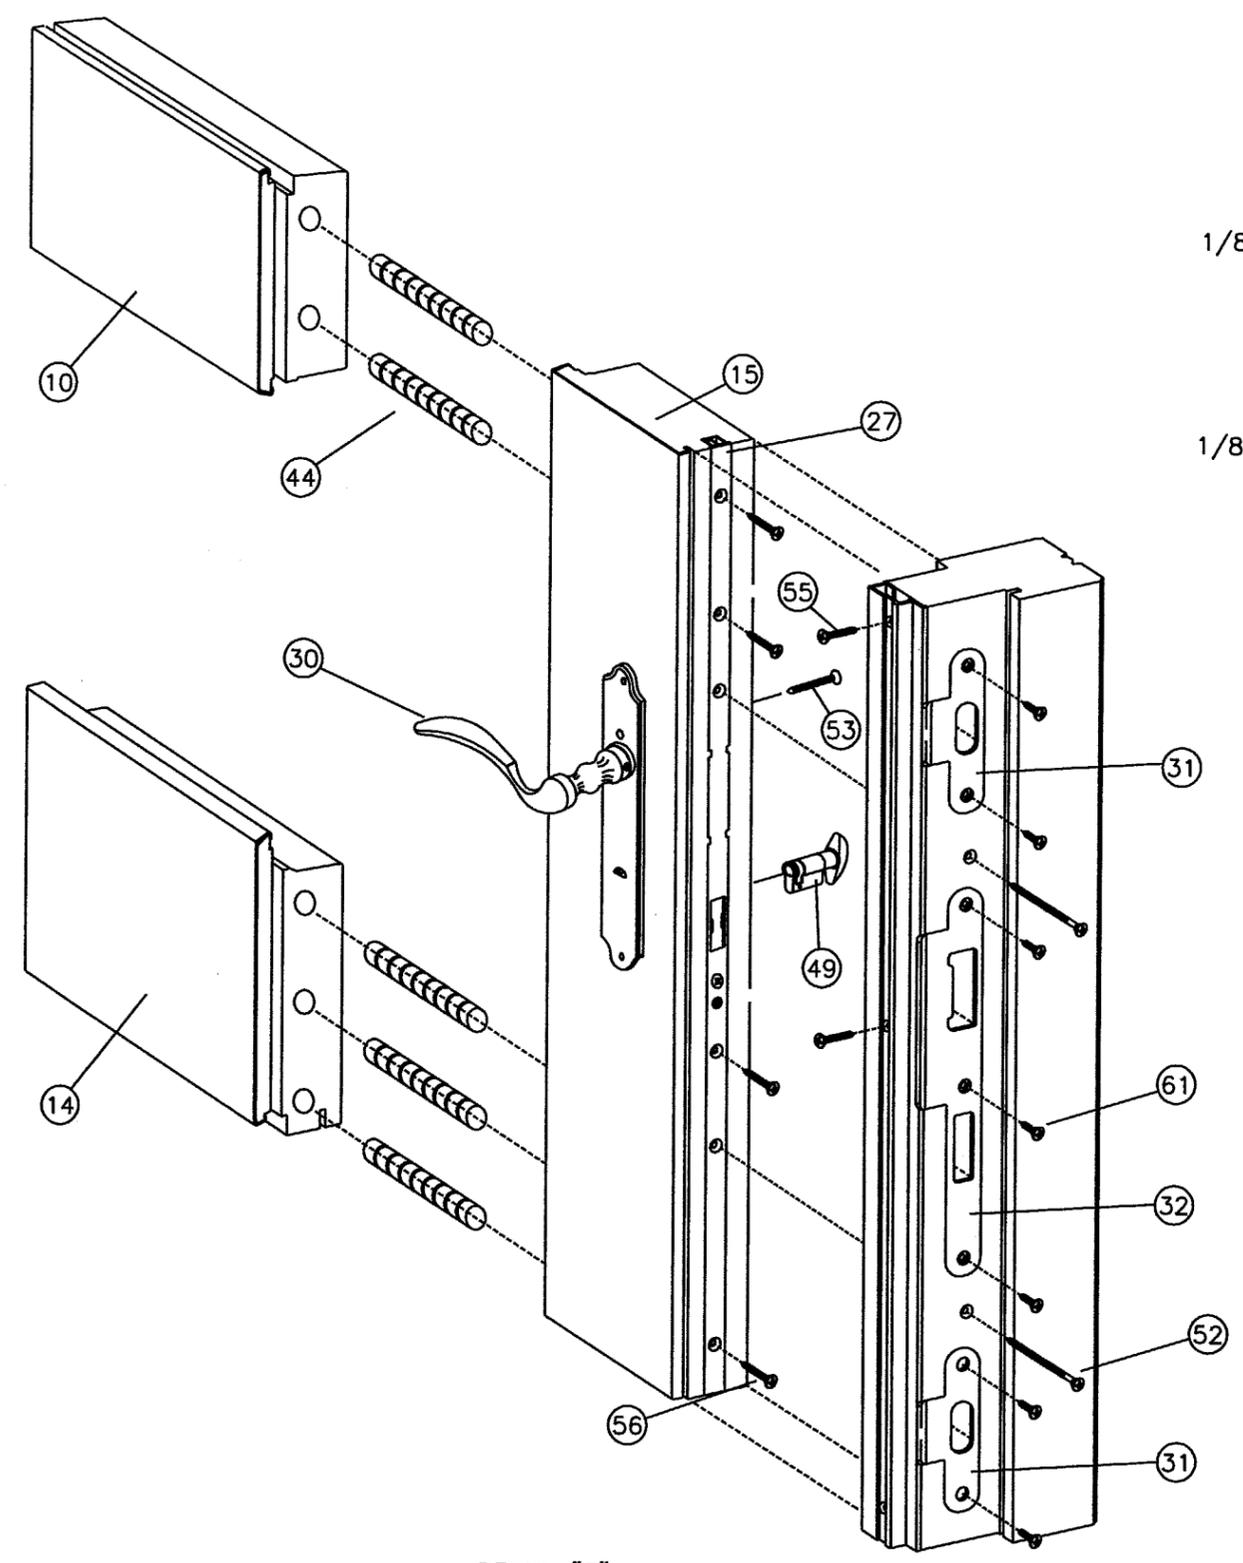


DETAIL "C"
 PANEL DOWELING SET-UP
 INACTIVE STILE HARDWARE DETAIL

Approved as complying with the
 Florida Building Code
 Date 04/24/03
 NOA# 03-0224.05
 Miami Dade Product Control
 Division
 By: *Gleddie Keenan*


MATERIAL LIST			
ITEM	PART #	DESCRIPTION	MATERIAL
1	SPD-161	ALUMINUM FRAME CLADDING - .060 WALL (ANODIZING INC.)	6063-T5 ALUM.
2	SPD-159	WOOD SIDE JAMB - (BMC)	WESTERN PINE
3	SPD-164	WOOD HEAD JAMB - (BMC)	WESTERN PINE
4	N/A	NOT USED	-
5	AC-74	FRAME CORNER KEY - 2 EA. (MITCHELL METALS)	WESTERN PINE
6	N/A	INSULATED GLASS UNIT (MFG POZZI)	SEE SHEET 4
7	N/A	PRESSURE TREATED 2X BUCK	P.T. WOOD
8	SPD-324	WOOD GLASS STOP	WESTERN PINE
9	N/A	#8 x 2 1/2" PFH WS	STEEL
10	SPD-224	WOOD TOP RAIL - (BMC)	WESTERN PINE
11	N/A	1/4" FRAME SHIM	WOOD
12	SPD-226	WOOD 10 1/4" BOTTOM RAIL - (BMC)	WESTERN PINE
13	SPD-302	10 1/4" BOTTOM RAIL CLADDING - (HOMESHIELD)	ALUMINUM
14	SPD-225	WOOD BOTTOM RAIL - (BMC)	WESTERN PINE
15	SPD-228	WOOD LOCK STILE - (BMC)	WESTERN PINE
16	SPD-228	WOOD HINGE STILE - (BMC)	WESTERN PINE
17	SPD-300	TOP RAIL CLADDING - (HOMESHIELD)	ALUMINUM
18	SPD-301	BOTTOM RAIL CLADDING - (HOMESHIELD)	ALUMINUM
19	SPD-304	STILE CLADDING - (HOMESHIELD)	ALUMINUM
20	SPD-232	WOOD ASTRAGAL - (BEND MILLWORKS)	WESTERN PINE
21	SPD-162	ASTRAGAL MULLION CAP - (ANODIZING)	ALUMINUM
22	SPD-321	INACTIVE ASTRAGAL COVER - (ANODIZING)	ALUMINUM
23	SPD-320	ACTIVE ASTRAGAL COVER - (ANODIZING)	ALUMINUM
24	SPD-306	OUTSWING SILL METAL - (ANODIZING)	ALUMINUM
25	SPD-212	SILL CAP - (CONNOLY)	OAK
26	SPD-213	SILL BASE - (CONNOLY)	OAK
27	HLS-9000	INACTIVE MULTI-POINT HARDWARE - (HOPPE)	STAINLESS STEEL
28	HLS-9000	ACTIVE MULTI-POINT HARDWARE - (HOPPE)	STAINLESS STEEL
29	N/A	ULTRAEDGE™ GLASS SPACER	STEEL
30	N/A	INACTIVE HANDLE SET & ESCUTCHEON PLATE - (HOPPE)	COATED STEEL
31	N/A	ROUNDBOLT STRIKE PLATE - (HOPPE)	COATED STEEL

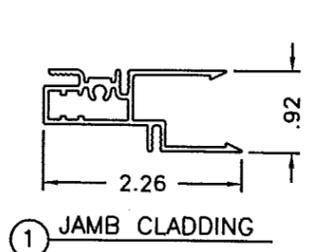


1 JAMB CLADDING

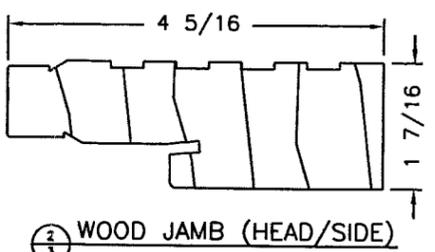


2 WOOD JAMB (HEAD/SIDE)




8 GLASS STOP (IG)

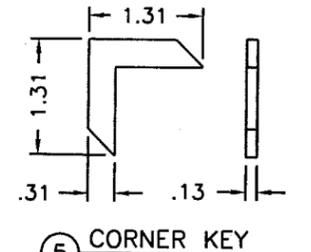


5 CORNER KEY

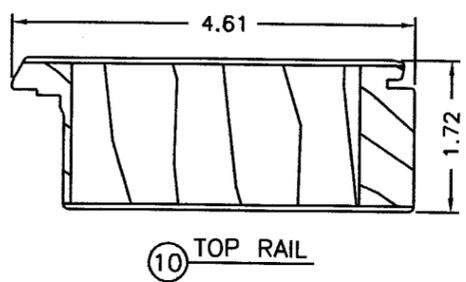


10 TOP RAIL

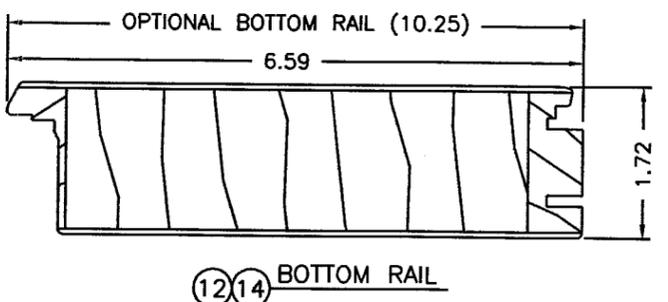


12, 14 BOTTOM RAIL

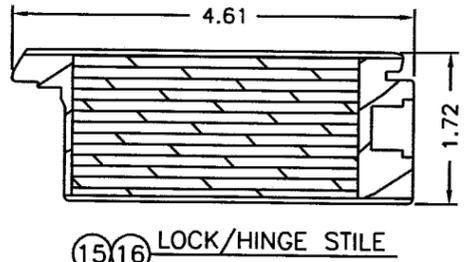


15, 16 LOCK/HINGE STILE

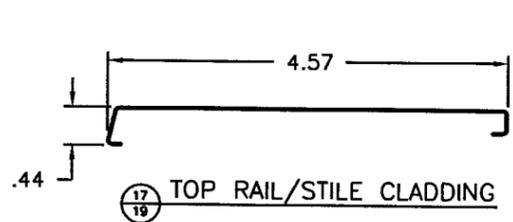


17 TOP RAIL/STILE CLADDING

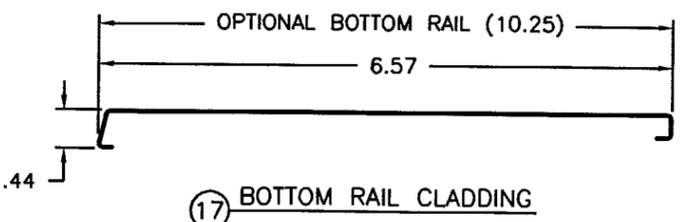


17 BOTTOM RAIL CLADDING

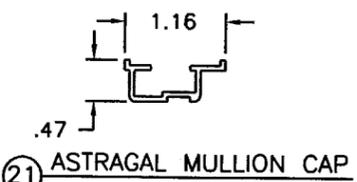


21 ASTRAGAL MULLION CAP

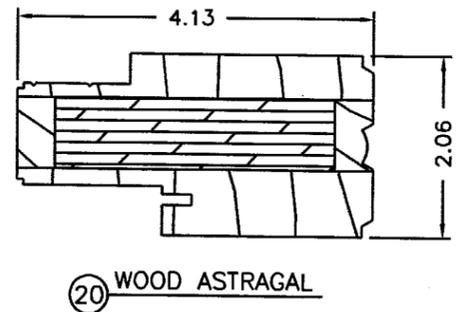


20 WOOD ASTRAGAL

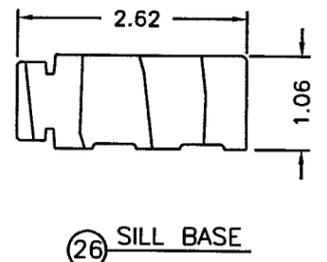


26 SILL BASE




22 INACTIVE ASTRAGAL COVER

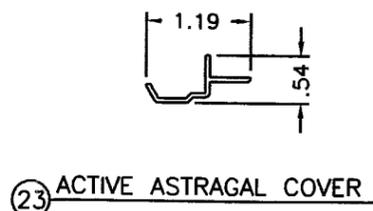

23 ACTIVE ASTRAGAL COVER

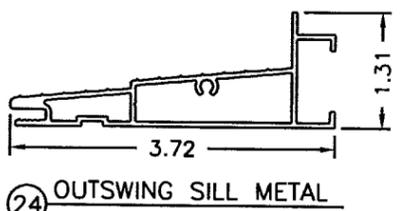

24 OUTSWING SILL METAL



25 SILL CAP

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411

PRODUCT: POZZI
ALUMINUM CLAD WOOD
OUTSWING PATIO DOOR
PART OR ASSEMBLY:
BILL OF MATERIALS
& UNIT COMPONENTS


NO.	DATE	GENERAL REVISIONS	ZRK	BY
1	3/18/03			

RW BUILDING
CONSULTANTS, INC.
813.659.9197


Approved as complying with the
Florida Building Code
Date 04/24/03
NOAH 03-0224.05
Miami Dade Product Control
Division
By *Christine Korman*

DATE: 1/20/03
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2337
SHEET 5 OF 6


MATERIAL LIST CONTINUED			
ITEM	PART #	DESCRIPTION	MATERIAL
32	N/A	DUAL STRIKE AND DEADBOLT PLATE - (HOPPE)	COATED STEEL
33	N/A	HEAD JAMB SHOOTBOLT STRIKE PLATE - (HOPPE)	STAINLESS STEEL
34	N/A	SILL SHOOTBOLT STRIKE PLATE - (HOPPE)	STAINLESS STEEL
35	N/A	3/16" x 2 1/2" TAPCON ANCHOR	STEEL
36	N/A	Q-LON 650 WEATHERSTRIP - (SCHLEGEL)	POLY
37	N/A	ARLOC WEATHERSTRIP BULB - (INTEK)	POLY
38	N/A	DS602 DOOR SWEEP - (INTEK)	POLY
39	N/A	3/8" x 1/8" VHB TAPE	3M
40	N/A	RECTANGLE GLASS SPACER	STEEL
41	N/A	1/8" x 3" BRASS ROD	BRASS
42	N/A	1/8" x 11/32" x 3" STRAIGHT FRAME KEY	STEEL
43	N/A	SILL SHOOTBOLT GROMMET - (BRANDT)	POLY
44	N/A	1/2" x 4" DOWEL (CHICAGO DOWEL)	WOOD
45	N/A	ADJUSTABLE HINGE (SEE HINGE TABLE SH. 1) (HOPPE)	COATED STEEL
46	N/A	3 1/8" x 5" SCREW PLATE (SIMPSON)	STEEL
47	N/A	STANDARD HINGE - (SEE HINGE TABLE SH. 1) (HOPPE)	COATED STEEL
48	N/A	ACTIVE HANDLE SET & ESCUTCHEON PLATE (HOPPE)	COATED STEEL
49	N/A	THUMBTURN (HOPPE)	COATED STEEL
50	N/A	#1199 SEALANT (DOW CORNING)	SEALANT
51	N/A	1" x 7/32" CROWN 18 GA. STAPLE - (STANLEY/BOSTICH)	STEEL
52	N/A	#8 x 3" P.H.F.H. MTL. S/STL. SCREW (CROWN FASTENERS)	STEEL
53	N/A	#8 x 2" P.H.F.H. MTL. SCREW (HOPPE)	COATED STEEL
54	N/A	#8 x 2" P.H.F.H. WOOD SCREW (CROWN FASTENERS)	STEEL
55	N/A	#8 x 1" P.H.F.H. WOOD SCREW (CROWN FASTENERS)	COLOR MATCH STL.
56	N/A	#8 x 1" P.H.F.H. S/STL (CROWN FASTENERS)	STEEL
57	N/A	#8 x 3/4" P.H.F.H. WOOD SCREW (CROWN FASTENERS)	COATED STEEL
58	N/A	#8 x 2 1/4" P.H.F.H. WOOD SCREW (CROWN FASTENERS)	COATED STEEL
59	N/A	#10 x 3" P.H.F.H. WOOD SCREW (CROWN FASTENERS)	STEEL
60	N/A	3/16" x 3" TAPCON ANCHOR	STEEL
61	N/A	#8 x 5/8" P.H.F.H. WOOD SCREW (CROWN FASTENERS)	COATED STEEL
62	N/A	#8 x 1 1/2" P.H.F.H. WOOD SCREW (CROWN FASTENERS)	COATED STEEL

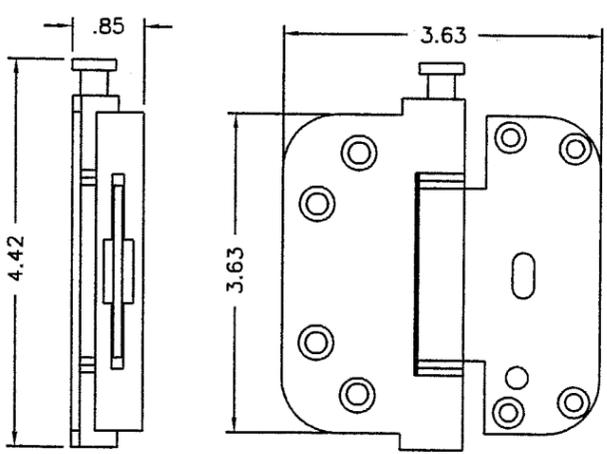


45 ADJUSTABLE HINGE




38 DOOR SWEEP



37 WEATHERSTRIP




36 WEATHERSTRIP

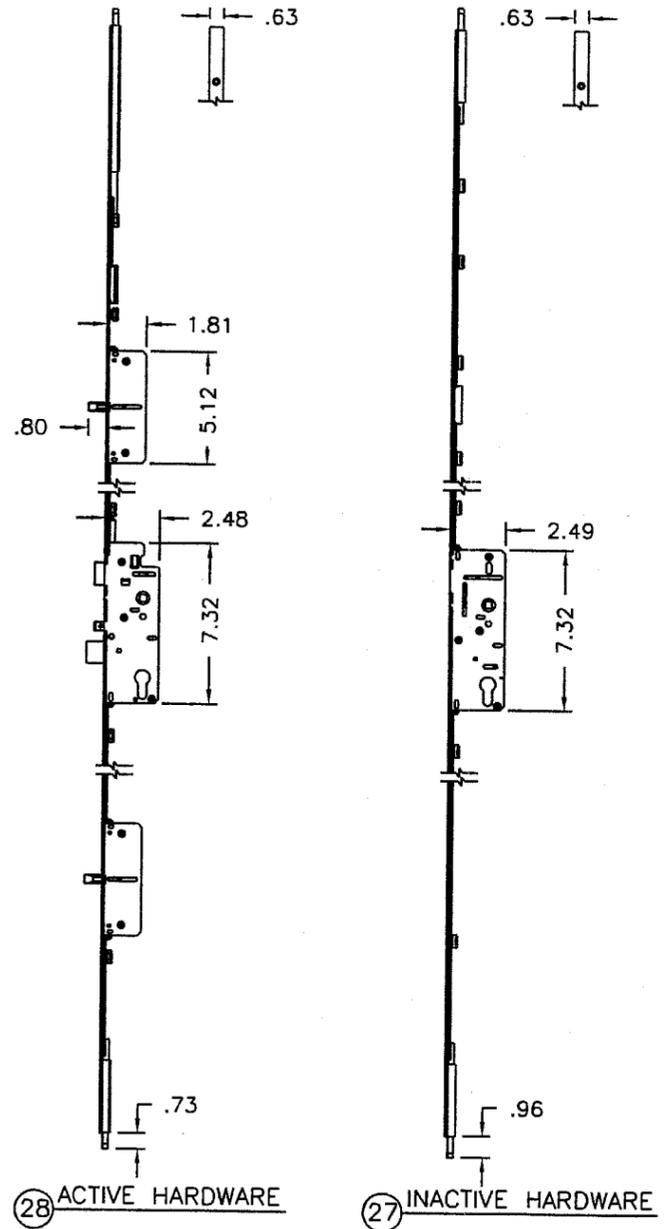


28 ACTIVE HARDWARE


27 INACTIVE HARDWARE

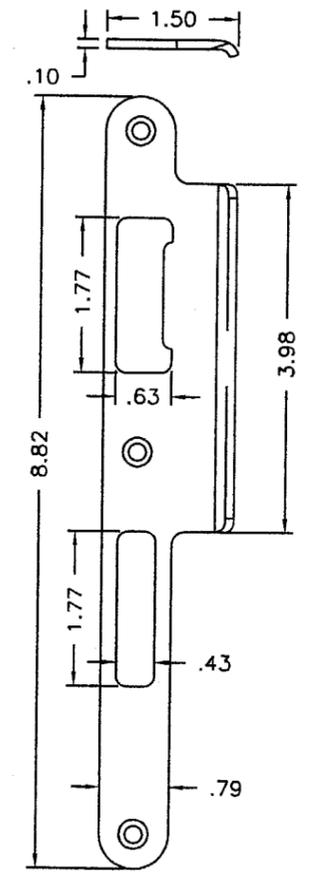


32 DUAL STRIKE PLATE

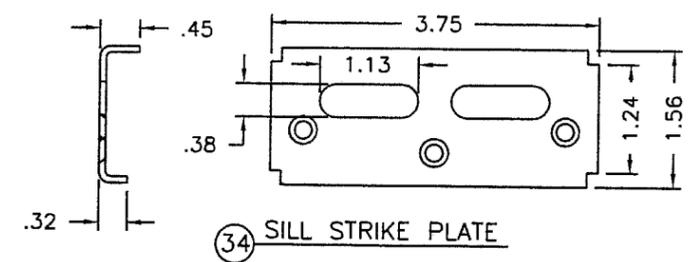


34 SILL STRIKE PLATE

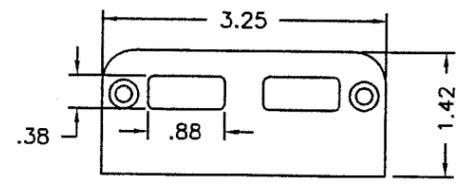

33 HEAD STRIKE PLATE

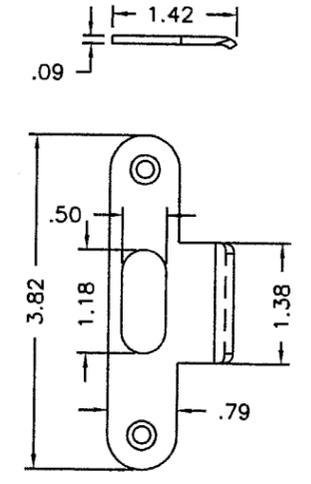

31 ROUND BOLT STRIKE



44 SILL GROMMET

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411

PRODUCT: POZZI ALUMINUM CLAD WOOD OUTSWING PATIO DOOR
PART OR ASSEMBLY: BILL OF MATERIALS & UNIT COMPONENTS

NO.	DATE	GENERAL REVISIONS	ZRK	BY
1	3/18/03			

RW BUILDING CONSULTANTS, INC.
813.659.9197

Approved as complying with the Florida Building Code
Date: 04/24/03
NOA# 03-0224.05
Miami Dade Product Control
By: *Allen Lee Bowman*

DATE:	1/20/03
SCALE:	N.T.S.
DWG. BY:	TJH
CHK. BY:	RW
DRAWING NO.:	S-2337
SHEET	6 OF 6