



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Union Corrugating Company
701 South King Street
Fayetteville, NC 23802-0229**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Advantage-Lok® Metal Roof Panel

LABELING: Each panel shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 4.

The submitted documentation was reviewed by Frank Zuloaga, RRC



**NOA No.: 03-0303.17
Expiration Date: 07/10/08
Approval Date: 07/10/03
Page 1 of 4**

ROOFING SYSTEM APPROVAL:

Category: Roofing
Sub-Category: Metal, Panels(Non-Structural)
Material: Steel

Deck Type: Wood
Maximum Design Pressure -59.8 psf

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
Advantage-Lok Standing Seam	l = various w = 16" min. 0.0190" thick	TAS 110 & TAS 125	Metal Roof panel coated with various approved coatings of Ceram-A-Star® 900.
Trim Pieces	l = varies w = varies min. 0.0190" thick	TAS 110	Standard flashing and trim pieces. Manufactured for each panel width.

EVIDENCE SUBMITTED

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
Hurricane Test Laboratories, Inc.	0293-1216-02	TAS 125	01/02/03
PRI Asphalt Technologies, Inc.	UCC-003-02-01	TAS 100	12/18/02
W.W. Schaefer Engineering & Consulting, P.A.	N/A	Fastener Calculations	02/17/03



NOA No.: 03-0303.17
Expiration Date: 07/10/08
Approval Date: 07/10/03
Page 2 of 4

APPROVED ASSEMBLIES


- SYSTEM A-1S:** "Advantage-Lok Standing Seam" 26 ga. Metal Panels
- Deck Type:** Wood, Non-insulated
- Deck Description:** $1\frac{9}{32}$ " or greater plywood or wood plank.
- Slope Range:** 2":12" or greater
- Maximum Uplift Pressure:** The maximum allowable design pressure for the 16" wide panel shall be **-59.8 psf.**
- Deck Attachment:** In accordance with applicable Building Code, but in no case shall it be less than #8 x 2" wood screws spaced 6" o.c around the perimeter and 12" o.c. in the field.. In reroofing, where the deck is less than $1\frac{9}{32}$ " thick (Minimum $1\frac{5}{32}$ "") The above attachment method must be in addition to existing attachment. **Wood sheathing shall be sealed at all joints with a continuous bead of urethane sealant.**
- Underlayment:** Minimum underlayment shall be an ASTM D 226 Type II installed with a minimum 4" side-lap and 6" end-laps. Underlayment shall be fastened with corrosion resistant tin-caps and 12 gauge $1\frac{1}{4}$ " annular ring-shank nails, spaced 6" o.c. at all laps and two staggered rows 12" o.c. in the field of the roll. Or, any approved underlayment having a current NOA.
- Valleys:** Valley construction shall be in compliance with Roofing Application Standard RAS 133 and with Union Corrugating Company's current published installation instructions.
- Fire Barrier Board:** Any approved fire barrier having a current NOA. Or for class A or B fire rating, install minimum $\frac{1}{4}$ " thick Georgia Pacific "Dens Deck" (with current NOA) or minimum 4mm thick of Tritex, RockRoof (with current NOA) or $\frac{5}{8}$ " water resistant type X gypsum sheathing with treated core and facer.
- Metal Panels and Accessories:** Install the " Advantage-Lok Panels " and accessories in compliance with Union Corrugating Company's current, published installation instructions and details. Flashing, penetrations, valley construction and other details shall be constructed in compliance with the minimum requirements provided in Roofing Application Standards RAS 133.
1. At the eave, rake, and ridge, fasteners shall be located not more than 2" away from the panel end.
 2. Panels shall be fastened to substrate at the male end with one corrosion resistant #10 screw of sufficient length (but not less than 1") to penetrate through the sheathing a minimum of $\frac{3}{16}$ ", at a spacing not exceed 12" o.c. parallel to the slope of the roof. (See detail herein)
 3. The panels male/female overlapping seam shall be riveted with a $\frac{1}{8}$ " stainless steel rivet at a spacing no to exceed 30" o.c. (See detail herein)



SYSTEM LIMITATIONS

1. Increased design pressures for at perimeter and corner areas, in compliance with applicable building code may be met through rational analysis by increasing the number of attachment points in this areas. The maximum fastener spacing noted in the "Systems Description" section of this approval shall not be exceeded. All rational analysis computation shall be prepared, signed and sealed by a Florida Registered Professional Engineer, Registered Architect, or Registered Roof Consultant.
2. Panel shall be roll formed in continuous lengths from eave to ridge. Maximum lengths shall be described in the Roofing Application Protocol RAS 133.
3. All panels shall be permanently labeled with the manufacturer's name and/or logo, and the following statement: "Miami-Dade County Product Control Approved."

PROFILE DRAWINGS

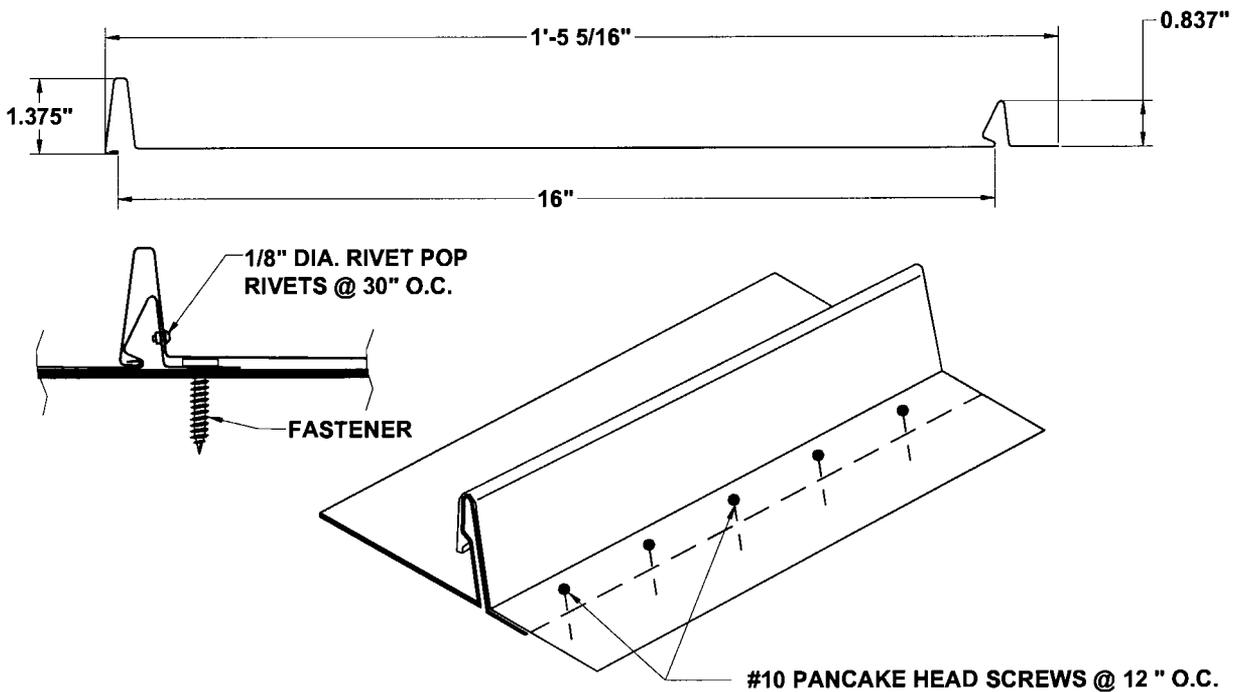

"ADVANTAGE-LOK®" METAL ROOF PANELS

END OF THIS ACCEPTANCE



NOA No.: 03-0303.17
Expiration Date: 07/10/08
Approval Date: 07/10/03
Page 4 of 4