



**MIAMI-DADE COUNTY**  
**BUILDING CODE COMPLIANCE OFFICE (BCCO)**  
**PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA**  
**METRO-DADE FLAGLER BUILDING**  
**140 WEST FLAGLER STREET, SUITE 1603**  
**MIAMI, FLORIDA 33130-1563**  
**(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

**Clopay Building Products Co.**  
**8585 Duke Blvd.**  
**Mason, OH 45040**

**SCOPE:** This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: Sectional Garage Door 9'- 0" Wide.**

**APPROVAL DOCUMENT:** Drawing No. 101703, titled "HDG/HDGL, 66/68, 4300/01, 4310/67/HDGL, 4400/01, H MODELS", dated 11/19/96 with last revision on April 2003, sheets 1 of 1, prepared by Clopay Building Products, signed and sealed by M.W. Westerfield, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.


**LIMITATION:** This approval requires the manufacturer to do testing of all coils used to fabricate door panels under this Notice of Acceptance. A minimum of 2 specimens shall be cut from each coil and tensile tested according to ASTM E-8 by a Dade County approved laboratory selected and paid by the manufacturer. Every 3 months, four times a year, the manufacturer shall mail to this office: a copy of the tested reports with confirmation that the specimen were selected from coils at the manufacturer production facilities. And a notarized statement from the manufacturer that only coils with yield strength of 28000 psi or more shall be used to make door panels for Dade County under this Notice of Acceptance

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA renews NOA # 01-0427.01 consists of this page 1 as well as the approval document mentioned above.

The submitted documentation was reviewed by **Candido F. Font PE.**

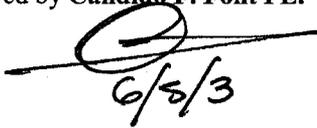  
6/5/3



**NOA No 03-0430.04**  
**Expiration Date: August 21, 2008**  
**Approval Date: June 5, 2003**  
**Page 1**

**Clopay Building Products Co.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**(For File ONLY. Not part of NOA)**

**A. DRAWINGS**

1. *Drawing prepared by Clopay Building Products Company, titled "HDG/HDGL, 66/68, 4300/01, 4310/67/HDGL, 4400/01, H MODELS", Drawing No.101703, dated 11/19/96, with latest revision on April 2003, sheets 1 of 1, signed and sealed by M. W. Westerfield, PE.*

**B. TESTS**

1. *Test report of large missile impact test per PA 201, cyclic wind pressure test per PA 203 and uniform static air pressure test per PA 202 on "9' x 8' door model 4300, prepared by American Test Lab of South Florida, report No. ATL 95-0522.01, dated 11/14/96, signed and sealed by W. Mehner, PE.*

**C. CALCULATIONS**

1. *Calculations dated 01/10/97; pages 1 through 2, prepared by M. W. Westerfield, signed and sealed by M. W. Westerfield, PE.*

**D. MATERIAL CERTIFICATIONS**

1. *Tensile test report No. CTL986B, prepared by Certified Testing Laboratories, dated 12/16/96, signed and sealed by R. Patel, PE.*
2. *Salt Spray Exposure test report No. 29198, prepared by Applied Research Laboratories, dated 12/15/93, signed and sealed by C. A. Hamon, PE.*
3. *Ignition Properties test report No. 118052, prepared by SGS U.S. Testing Company, Inc., dated 05/17/96, signed and sealed by D. H. Mangnall, PE.*
4. *Surface Burning Characteristics letter reference No. R6705, 96NK12530, prepared by Underwriters Laboratories, Inc., dated 05/24/96, signed by J. D. Marzullo.*





**E. STATEMENTS.**

1. *Affidavit of minimum yield strength compliance prepared by Mark Westerfield employed by Clopay Building Products Company, signed by M. Westerfield and notarized by S. E. Rodenhauser on 05/05/03.*
2. *Letter of no change prepared by Clopay Building Products on 03/27/00, signed and sealed by M. Westerfield, PE.*
3. *Affidavit of no financial interest prepared by Mark W. Westerfield, PE. with no date, signed by M. W. Westerfield PE. and notarized by M. E. Knisley on 01/10/97*
4. *Letter of code compliance prepared by Clopay Building Products Co. on 01/10/97, signed and sealed by M. W. Westerfield PE.*
5. *No change letter issued by Clopay Building Products on 04/28/03 signed and sealed by M. Westerfield PE.*

  
Candido F. Font, PE.  
Senior Product Control Division  
NOA No 03-0430.04  
Expiration Date: August 21, 2008  
Approval Date: June 5, 2003

CLOPAY MODELS 4300, 4301, 4310, 4400, 4401, HDG, HDGL  
 CLOPAY MODELS H400, H401, H300, H301, H310 (UP TO 12'0" HIGH)  $\Delta$   
 HOLMES MODELS 66, 67, 68  $\Delta$

REV	DATE	DESCRIPTION
1	7-8-97	ADDED MAXIMUM VENT OPENING
2	4/2001	ADD HOLMES MODELS & HDGL; DELETE MODELS 2200, 2201, 2300, 2301, 4200; G-40 MIN. WAS G-60
3	4/2003	ADD "H" MODELS; DELETE M/N 2400/01; 27 GA. ON 4310/HDGL

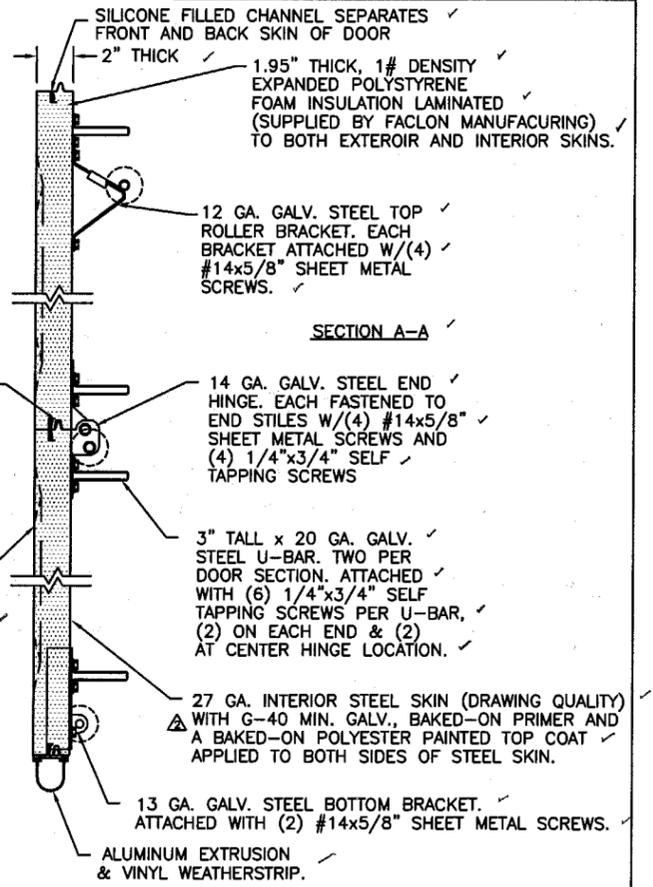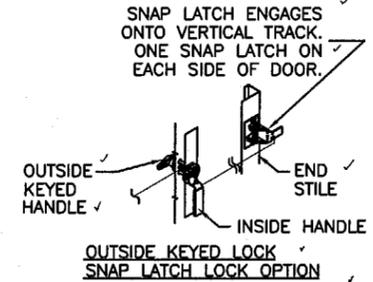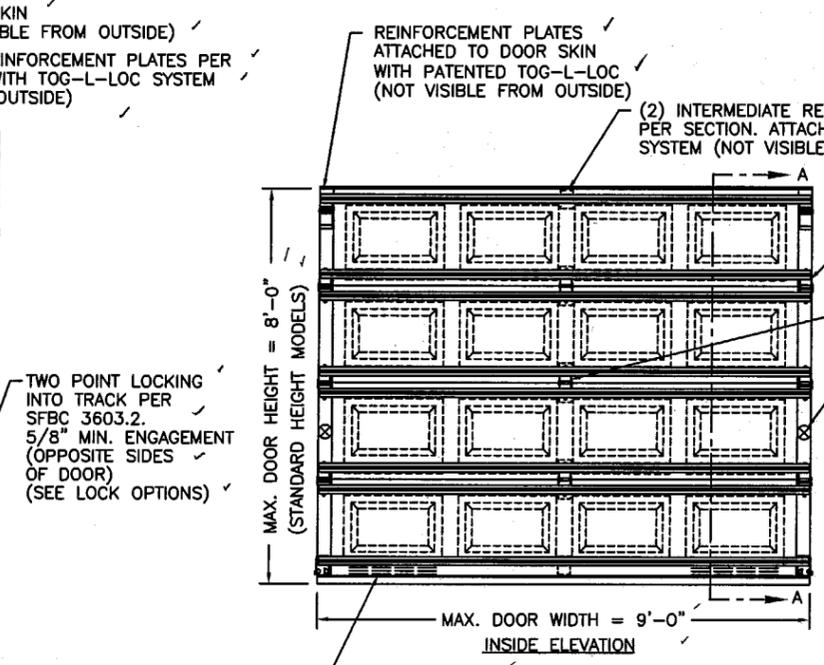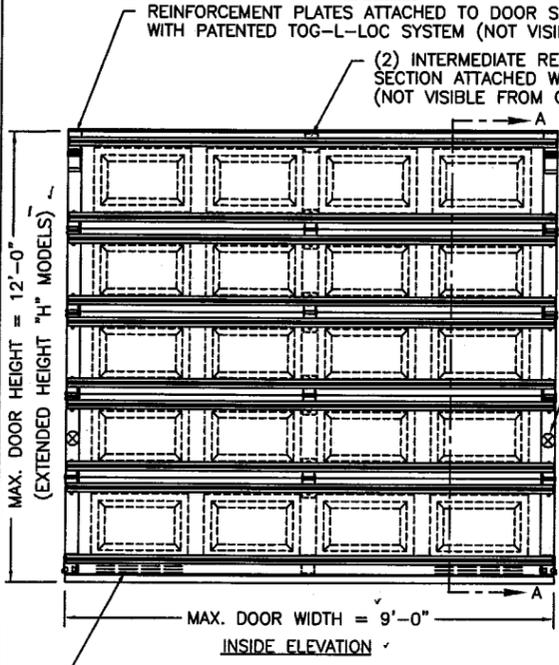



LOCATION OF OPTIONAL VENTS  
 MAXIMUM VENT OPENING: 60 IN<sup>2</sup>

LOCATION OF OPTIONAL VENTS  
 MAXIMUM VENT OPENING: 60 IN<sup>2</sup>

TABLE 1


DOOR HEIGHT	NUMBER OF SECTIONS *
6'0" TO 7'0"	4
7'6" TO 8'9"	5
9'0" TO 10'6"	6
10'9" TO 12'0"	7

\* SECTIONS ARE EITHER 18" OR 21" HIGH

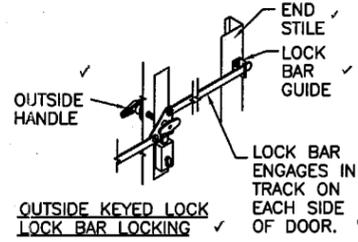



PRODUCT RENEWED  
 as complying with the Florida Building Code  
 Acceptance No. 03-0430-04  
 Expiration Date 03/2/08  
 By Miami Dade Product Control Division

INSTALLER MODEL	RETAIL MODEL	DESCRIPTION
4300, H300	HDG, 66	27 GA. MIN. EXTERIOR SKIN; SHORT RAISED PANEL
4400, H400	N/A	24 GA. MIN. EXTERIOR SKIN; SHORT RAISED PANEL
4401, H401	N/A	24 GA. MIN. EXTERIOR SKIN; FLUSH PANEL
4301, H301	68	27 GA. MIN. EXTERIOR SKIN; FLUSH PANEL
4310, H310	HDGL, 67	27 GA. MIN. EXTERIOR SKIN; WIDE RAISED PANEL

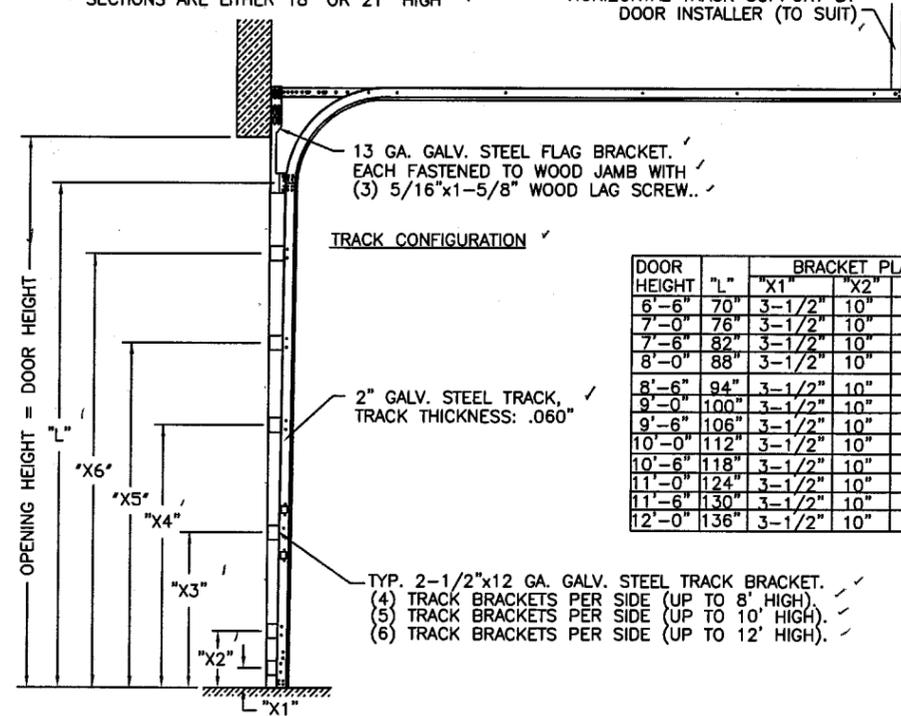

DOOR HEIGHT	"L"	BRACKET PLACEMENTS					
		"X1"	"X2"	"X3"	"X4"	"X5"	"X6"
6'-6"	70"	3-1/2"	10"	35"	60"	-	-
7'-0"	76"	3-1/2"	10"	38"	66"	-	-
7'-6"	82"	3-1/2"	10"	34"	58"	-	-
8'-0"	88"	3-1/2"	10"	34"	58"	-	-
8'-6"	94"	3-1/2"	10"	34"	58"	82"	-
9'-0"	100"	3-1/2"	10"	34"	58"	82"	-
9'-6"	106"	3-1/2"	10"	34"	58"	82"	-
10'-0"	112"	3-1/2"	10"	34"	58"	82"	-
10'-6"	118"	3-1/2"	10"	34"	58"	82"	106"
11'-0"	124"	3-1/2"	10"	34"	58"	82"	106"
11'-6"	130"	3-1/2"	10"	34"	58"	82"	106"
12'-0"	136"	3-1/2"	10"	34"	58"	82"	106"

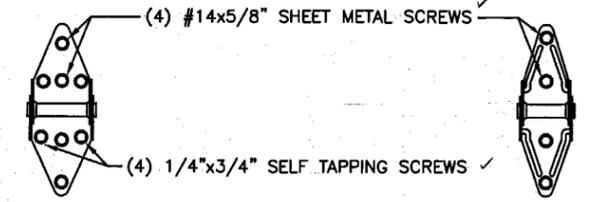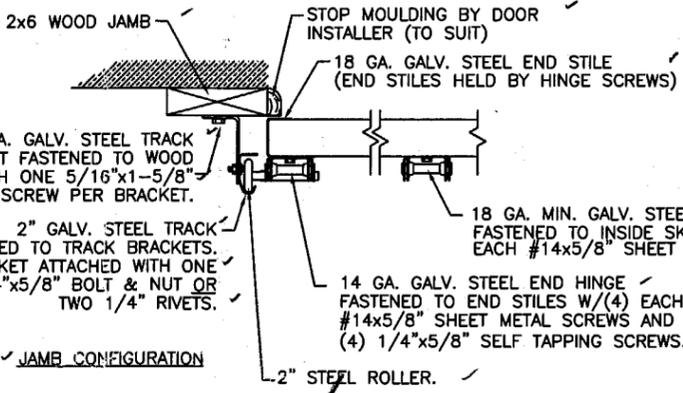

THE 2x6 VERTICAL WOOD JAMBS ARE TO BE GRADE 2 OR BETTER YELLOW PINE. NO LOAD IS TRANSFERRED TO THE HORIZONTAL (TOP) JAMB. ALL JAMB FASTENERS MAY BE (BUT NOT REQUIRED) COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE.

2x6 WOOD JAMB CAN BE ANCHORED TO GROUT REINFORCED BLOCK WALL OR CONCRETE COLUMN. BLOCK CELLS SHALL BE FILLED WITH CONCRETE AND REINFORCED WITH CONTINUOUS #5 BAR EXTENDING INTO THE FOOTING AND INTO TIE BEAMS. ANCHORS CAN BE 1/4"x1-3/4" EMBED TAPCON CONCRETE ANCHORS STARTING AT NO MORE THAN 8" FROM BOTTOM AND 16" O.C., OR WITH 3/8"x4" (1-3/4" EMBED) RAWL LOK/BOLT ANCHOR STARTING AT NO MORE THAN 8" FROM BOTTOM AND 24" O.C.

DESIGN ENGINEER:  
 MARK W. WESTERFIELD  
 FLORIDA REGISTRATION No. 48495  
 MECHANICAL ENGINEERING  
 4/23/03

NOTE: SUPPORTING STRUCTURAL ELEMENTS SHALL BE DESIGNED BY A REGISTERED PROFESSIONAL ENGINEER FOR WIND LOADS SHOWN ON THIS DRAWING.



CLOPAY BUILDING PRODUCTS COMPANY  
 8585 DUKE BLVD.  
 MASON, OH 45040  
 (513) 770-4800

SCALE	CLASSIFICATION	MAXIMUM DOOR SIZE
PLOT 1=42	HDG/HDGL, 66/68, 4300/01, 4310/67/HDGL, 4400/01, H MODELS	9'0"W x 12'0"H
DATE: 11/19/96	DRAWING NUMBER: B	REV: 3
DRAWN BY: MWW	CHECKED BY: B	101703