



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Stanley Access Technologies
65 Scott Swamp Road
Farmington, CT 06032**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series "3000 Dura Glide" Aluminum (MS) Automatic Sliding Glass Door w/ Breakout
APPROVAL DOCUMENT: Drawing No. 413834, sheets 1 through 4 of 4, prepared by manufacturer, dated 08/04/99 revised on 03/29/00, signed and sealed by William D. Cook, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None; HVHZ Hurricane Protection (Shutters) will be required.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA renews NOA # 99-1203.06 and, consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by Ishaq I. Chanda, P.E.

6/21/3



**NOA No 03-0527.11
Expiration Date: April 21, 2008
Approval Date: July 3, 2003
Page 1**

Stanley Access Technologies

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA)

- A. DRAWINGS (transferred from file 99-1203.06)**
1. Manufacturer's die drawings and sections.
 2. Drawing No. **413834**, sheets 1 through 4 of 4, prepared by manufacturer, dated 08/04/99 revised on 03/29/00, signed and sealed by William D. Cook, P.E.
- B. TESTS (transferred from file 99-1203.06)**
Originally Submitted under File # 96-1008.01, note the test conducted per PA202-94, now called TAS-94.
1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
along with installation diagram of an automatic aluminum sliding glass door with fixed panels, prepared by Fenestration Testing Laboratory Test Report No. FTL2243 (99098) dated October 12, 1999 signed and sealed by Aldo P. Gonzales, P.E. revised with addendum letter dated 02-29-00 signed and sealed by Aldo P. Gonzales, P.E.
- C. CALCULATIONS (transferred from file 99-1203.06)**
1. Anchor verification calculations, prepared by A.L. Bromily P. E. dated 08/04/99, revised 03-21-00, signed and sealed by William D. Cook, P.E.
- D. MATERIAL CERTIFICATIONS**
1. None
 2. Notice of Acceptance No. **00-0524.06** issued to Nebula Glass international Inc., for "Glasslam Safety plus laminated glass", approved 9/21/00 expiring on 09/09/03. (Note: This a non-Impact application)
 3. Notice of Acceptance No. **97-0527.05** issued to Nebula Glass international Inc., for "Glasslam Safety plus laminated glass", expired on 09-09-00(NO # 99-1203.06)
- E. STATEMENTS (transferred from file 99-1203.06)**
1. Statement letter of no change, issued by Stanley Access Technologies, signed by Dean Negrelli, dated 5/22/03.
 2. Statement letter of conformance, dated 10-15-1999, signed by William D. Cook, P.E.
 3. Statement letter of no financial interest, dated 10-15-1999, signed by William D. Cook, P.E.
 4. Statement letter of compliance dated 10-26-99 issued by Fenestration testing laboratory, signed and sealed by William D. Cook, P.E.
 5. Addendum letter dated 02-29-00 for test report FTL 2243 (99098) issued by Fenestration testing laboratory, signed and sealed by Aldo P. Gonzales, P.E.
- F. OTHER**
1. NOA# **99-1203.06** issued to Stanley Access expired on 4/21/03.
 2. Complies w/ASTM E1300-98.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No 03-0527.11
Expiration Date: April 21, 2008
Approval Date: July 3, 2003

DWG NO. 413834

ANCHOR TYPE

IN CONCRETE: #1/4" CONCRETE SCREW EMBEDDED 1 1/2" MIN.
 IN STEEL: 1/4-20 SMS SAE GRADE 2 OR BETTER (NOTE 3/16" STEEL MIN.)
 IN WOOD: #14 WOOD SCREW EMBEDDED 1 1/2" MIN.
 (NOTE: MINIMUM 2X4 WOODBUCK FOR WOOD SCREWS)


ANCHOR SPACING

SILL: STAGGERED ROW, 3" FROM EACH CORNER WITH REMAINDER SPACED AT 18" O.C.
 HEAD: SINGLE ROW, 4" FROM EACH CORNER WITH REMAINDER SPACED AT 10" O.C.
 JAMBS: SINGLE ROW, 2" FROM BOTTOM CORNER WITH REMAINDER SPACED AT 10" O.C.


A. L. BROMLEY P.E., INC.
STRUCTURAL ENGINEER
 2004 N.E. 49th Street
 Ft. Lauderdale, FL 33308
 (954) 772-4624

REVISIONS					
REV	ECN NO.	DATE	DESCRIPTION	DRAWN	APPROVED
A		8/4/99	INITIAL SUBMISSION TO METRO DADE	RWH	MJB
B	00-32	3/29/00	INITIAL INTERNAL RELEASE	RWH	MJB

William D. Cook, P.E.
 # 43904
 Structural Engineer

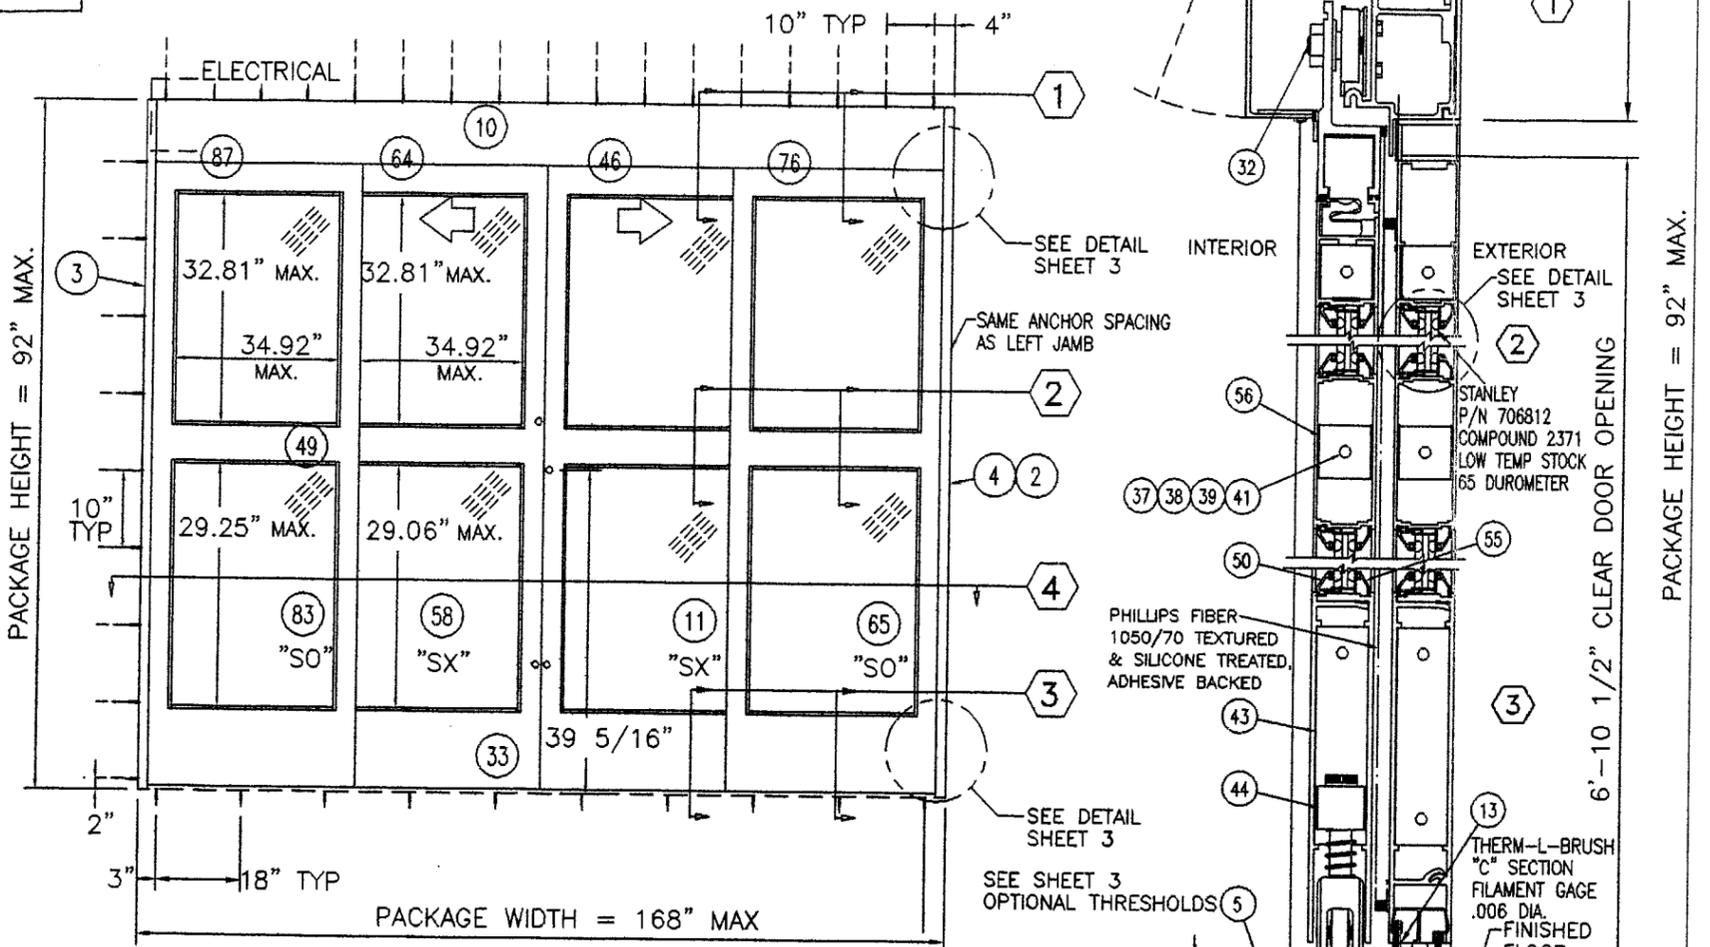


EXTERIOR ELEVATION (OXXO)

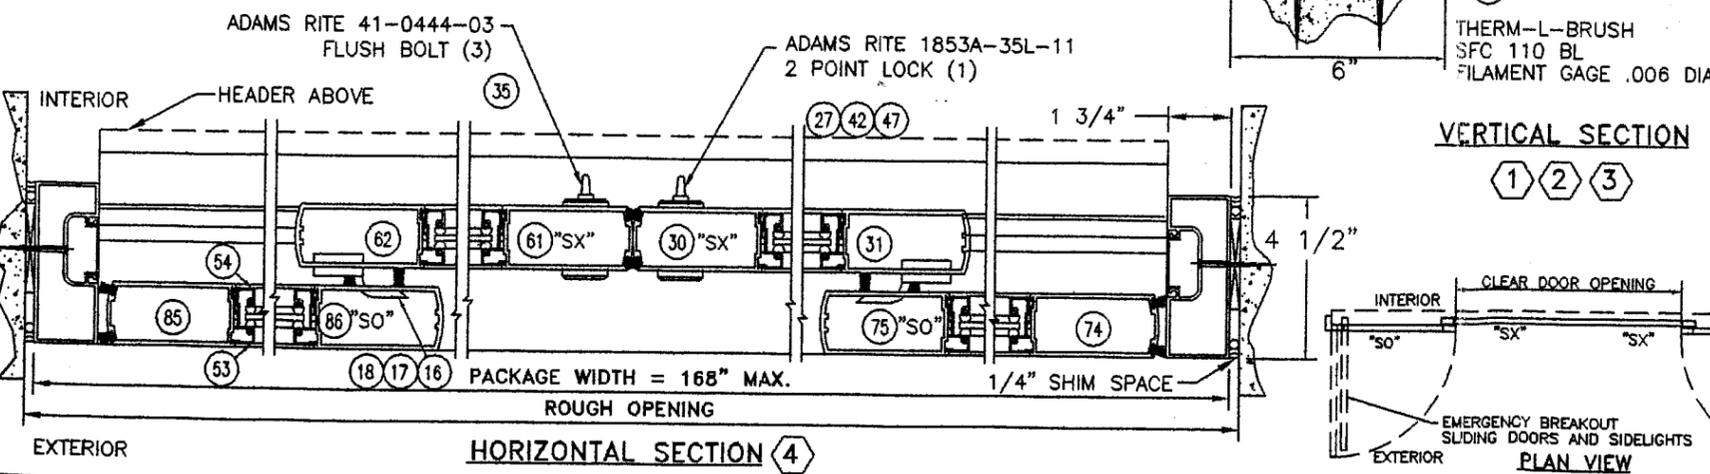

HORIZONTAL SECTION 4

VERTICAL SECTION

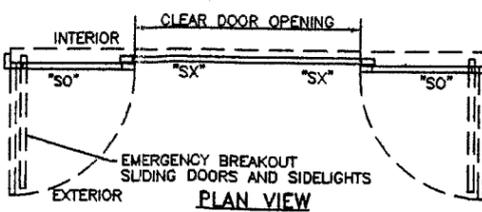

PACKAGE HEIGHT INFORMATION FOR SURFACE APPLICATIONS

PACKAGE HEIGHT	MASONRY OPENING	CAULKING ALLOWANCE	ACTUAL CLEAR OPG UNDER HEADER
7'-8"	7'-8 1/4"	1/4"	6'-10 1/2"

PACKAGE WIDTH INFORMATION

PKG WIDTH	SLIDING DOOR OPENING	(SX) DOOR WIDTH	(SO) DOOR WIDTH	DOOR TRAVEL	MASONRY OPENING	CAULKING ALLOWANCE
14'-0"	68"	43 1/8"	43 1/8"	34"	14'-1/2"	1/4" / SIDE

NOTES:

- 1) ALL ALUMINUM PARTS ARE 6063-T5 ALUMINUM
- 2) GLAZING: 1/4" TEMPERED GLASS OR .575" GLASSLAM SAFETY PLUS BY NEBULA INTERNATIONAL, INC. (NOA 97-0527.04) (SYSTEM TESTED AS NON-IMPACT RESISTANT) SEE SHEET 3 FOR DETAILS
- 3) CORNER PANEL CONSTRUCTION: PANEL CORNERS ARE BUTT JOINTED, SECURED WITH (4) FULL WIDTH 5/16" THREADED TIE RODS AT TOP RAIL, INTERMEDIATE HORIZONTAL MUNTIN BAR AND BOTTOM RAIL. ALL JOINTS ARE ALSO WELDED
- 4) THE GLAZING MATERIAL IN BOTH FIXED AND SLIDING PANELS OF ALL GLAZED DOORS SHALL COMPLY WITH THE REQUIREMENTS IN THE PERFORMANCE SPECIFICATIONS AND METHODS OF TEST FOR SAFETY GLAZING MATERIALS USED IN BUILDINGS.
- 5) MIAMI-DADE COUNTY APPROVED SHUTTERS ARE REQUIRED FOR INSTALATION OF THESE UNITS.
- 6) REFERENCE TEST REPORT FTL #2443

DESIGN PRESSURE RATING		
	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED.	WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED.
POSITIVE	NOT APPROVED	+ 56 PSF
NEGATIVE	NOT APPROVED	- 56 PSF

PRODUCT REVIEWED
 as complying with the Florida Building Code
 Acceptance No. 03-0527-11
 Expiration Date APRIL 21, 2008

By **Miami Dade Product Control Division**
 APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE **April 21, 2000**
 BY **Isaac L. Chanda**
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. **99-1203.06**

DRAWNR. HABERERN 8/4/99	STANLEY ACCESS TECHNOLOGIES A DIVISION OF THE STANLEY WORKS 65 SCOTT SWAMP ROAD, FARMINGTON, CT, 06032	
CHECKED: <i>MJB</i>	TITLE ANCHORING FOR DURA-GLIDE 3000 BIPART	
APPROVED: <i>MJB</i>	PRODUCT LINE DURA-GLIDE	
MATERIAL: N/A	SIZE B	DWG NO. 413834
FINISH: N/A	REV B	SCALE NONE SHEET 1 OF 4




DWG NO. 413834

DWG NO. 413834


ANCHOR TYPE
 IN CONCRETE: $\phi 1/4"$ CONCRETE SCREW EMBEDDED 1 1/2" MIN.
 IN STEEL: 1/4-20 SMS SAE GRADE 2 OR BETTER (NOTE 3/16" STEEL MIN.)
 IN WOOD: #14 WOOD SCREW EMBEDDED 1 1/2" MIN.
 (NOTE: MINIMUM 2X4 WOODBUCK FOR WOOD SCREWS)

ANCHOR SPACING
 SILL: STAGGERED ROW, 3" FROM EACH CORNER WITH REMAINDER SPACED AT 18" O.C.
 HEAD: SINGLE ROW, 3" FROM EACH CORNER WITH REMAINDER SPACED AT 10" O.C.
 JAMBS: SINGLE ROW, 2" FROM BOTTOM CORNER WITH REMAINDER SPACED AT 10" O.C.

A. L. BROMLEY P.E., INC.
 STRUCTURAL ENGINEER
 2004 N.E. 49th Street
 Ft. Lauderdale, FL 33308
 (954) 772-4624

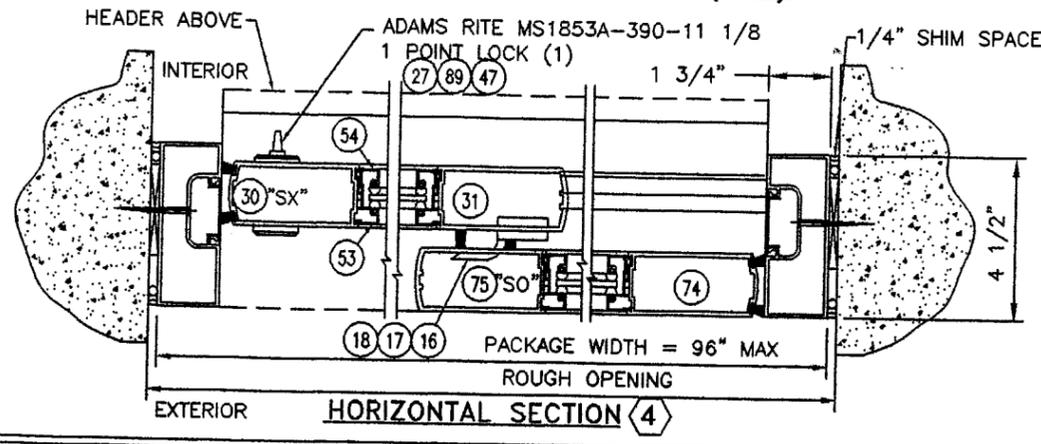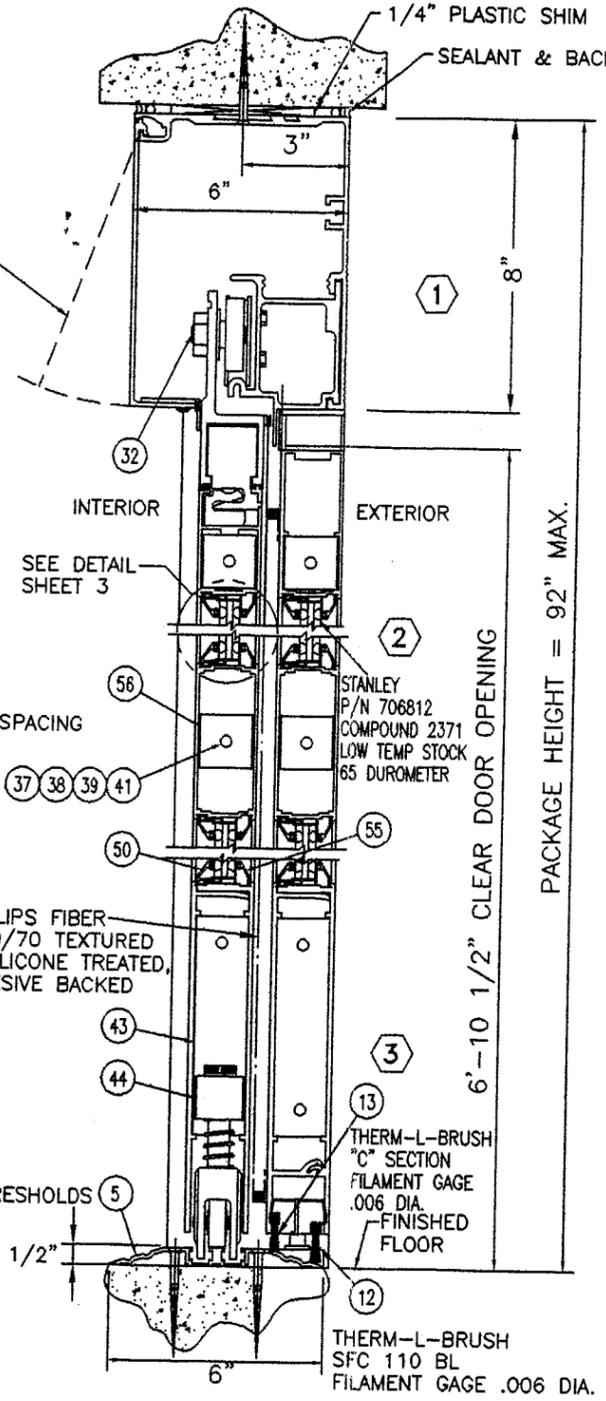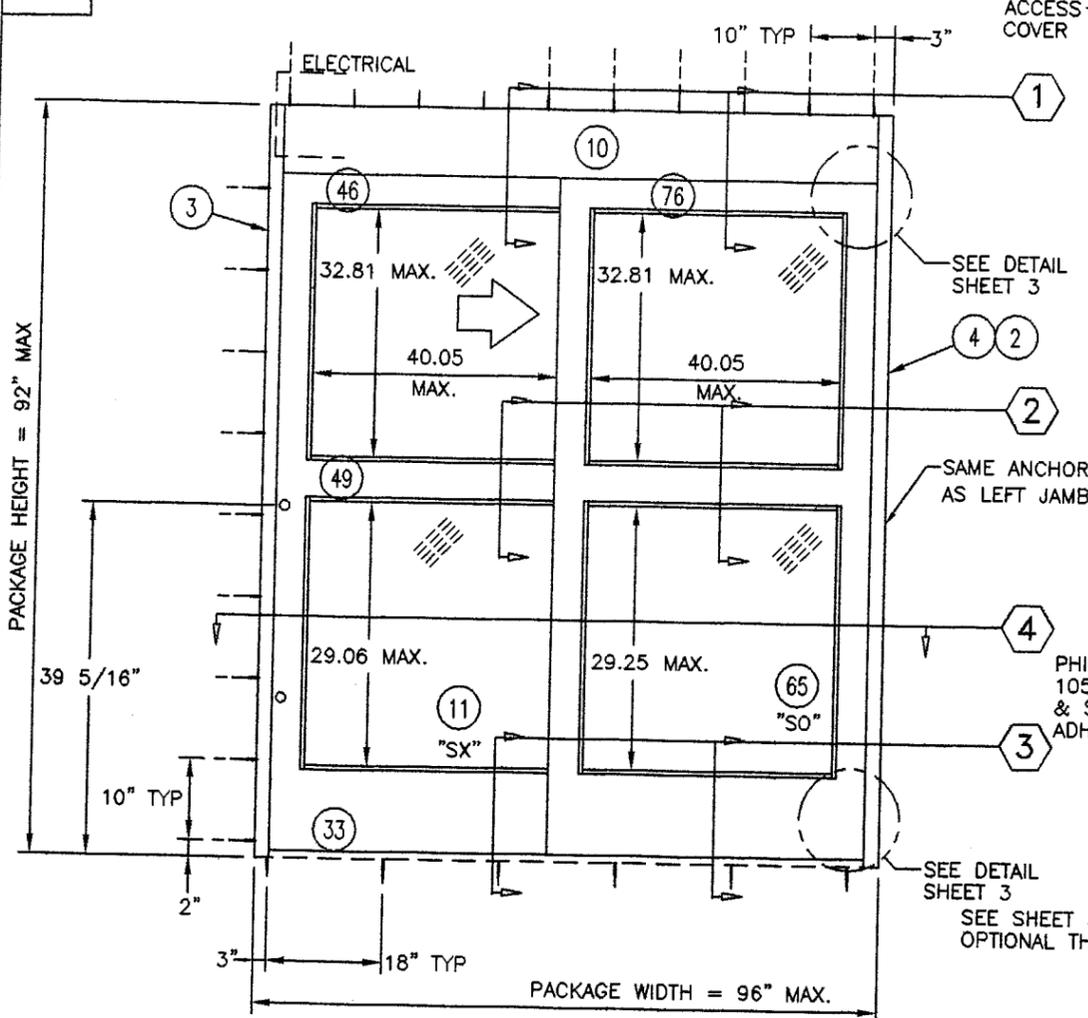

PRODUCT RENEWED
 as complying with the Florida Building Code
 Acceptance No. 03-0527-11
 Expiration Date APRIL 21, 2008
 By Ishaq I. Chanda
 Miami Dade Product Control Division

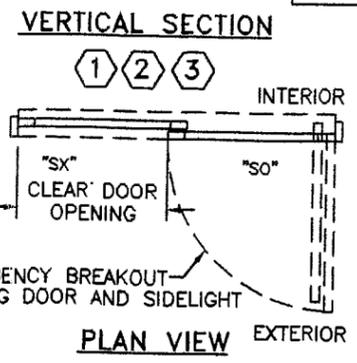

PACKAGE HEIGHT INFORMATION FOR SURFACE APPLICATIONS

PACKAGE HEIGHT	MASONRY OPENING	CAULKING ALLOWANCE	ACTUAL CLEAR OPG UNDER HEADER
7'-8"	7'-8 1/4"	1/4"	6'-10 1/2"

PACKAGE WIDTH INFORMATION

PKG WIDTH	SLIDING DOOR OPENING	(SX) DOOR WIDTH	(SO) DOOR WIDTH	DOOR TRAVEL	MASONRY OPENING	CAULKING ALLOWANCE
8'-0"	39 1/4"	48 1/4"	48 1/4"	39 1/4"	8'-1/2"	1/4" / SIDE

NOTES:

- 1) ALL ALUMINUM PARTS ARE 6063-T5 ALUMINUM
- 2) GLAZING: 1/4" TEMPERED GLASS OR .575" GLASSLAM SAFETY PLUS BY NEBULA INTERNATIONAL, INC. (NOA 97-0527.04) (SYSTEM TESTED AS NON-IMPACT RESISTANT) SEE SHEET 3 FOR DETAILS
- 3) CORNER PANEL CONSTRUCTION: PANEL CORNERS ARE BUTT JOINTED, SECURED WITH (4) FULL WIDTH 5/16" THREADED TIE RODS AT TOP RAIL, INTERMEDIATE HORIZONTAL MUNTIN BAR AND BOTTOM RAIL. ALL JOINTS ARE ALSO WELDED.
- 4) THE GLAZING MATERIAL IN BOTH FIXED AND SLIDING PANELS OF ALL SLIDING DOORS SHALL COMPLY WITH THE REQUIREMENTS IN THE PERFORMANCE SPECIFICATIONS AND METHODS OF TEST FOR SAFETY GLAZING MATERIALS USED IN BUILDINGS.
- 5) MIAMI-DADE COUNTY APPROVED SHUTTERS ARE REQUIRED FOR INSTALATION OF THESE UNITS.
- 6) REFERENCE TEST REPORT FTL #2443

DESIGN PRESSURE RATING

	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED.	WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED.
POSITIVE	NOT APPROVED	+ 56 PSF
NEGATIVE	NOT APPROVED	- 56 PSF


APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE April 21, 2000
 BY Ishaq I. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 99-1203.06

DRAWNR. HABERERN 8/16/99
 CHECKED: MJB
 APPROVED: MJB
 MATERIAL: N/A
 FINISH: N/A

STANLEY ACCESS TECHNOLOGIES
 A DIVISION OF THE STANLEY WORKS
 65 SCOTT SWAMP ROAD, FARMINGTON, CT, 06032
 TITLE
 ANCHORING FOR D/G 3000 SINGLE SLIDE
 PRODUCT LINE
 DURA-GLIDE
 SIZE DWG NO. REV
 B 413834 B
 SCALE NONE SHEET 2 OF 4


DWG NO. 413834

DWG NO. 413834

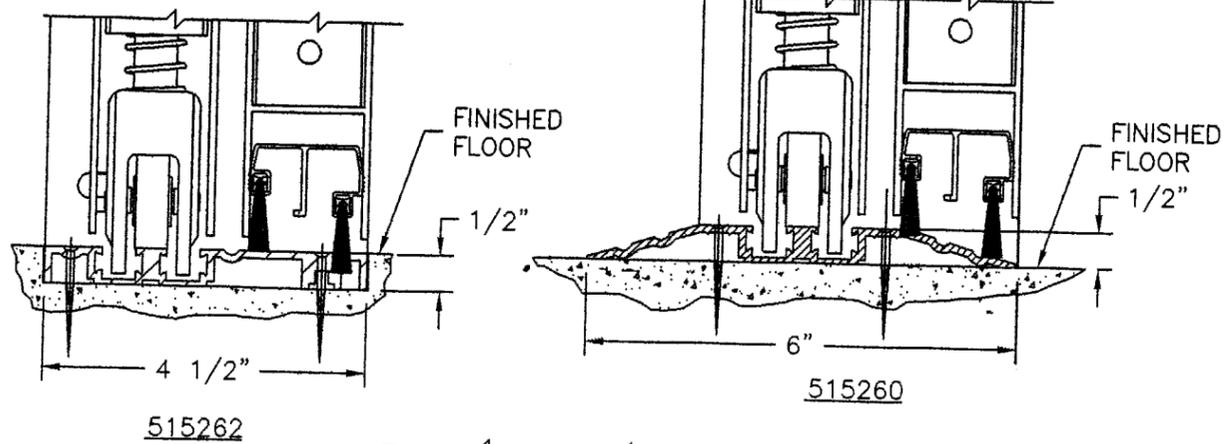

515262


515260

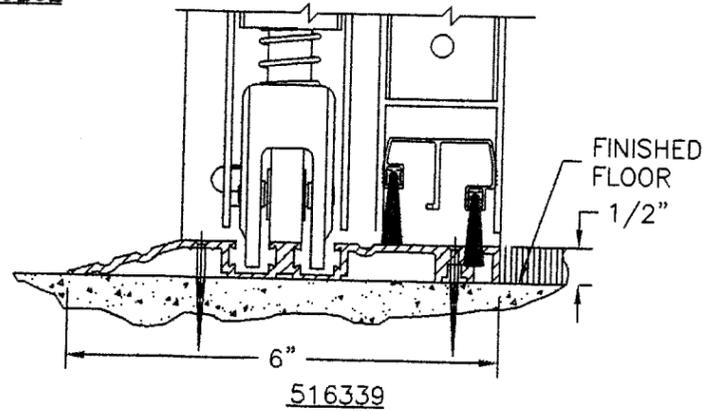

516339


⑤ THRESHOLD OPTIONS

GLAZING DETAILS

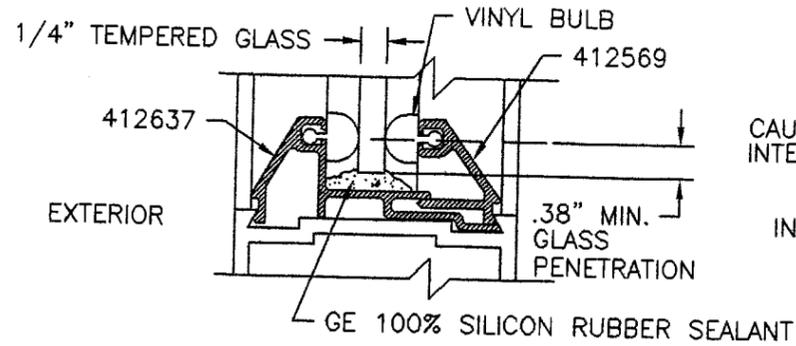


OPTION 1: 1/4" TEMPERED GLASS

CAULK BEFORE INSTALLING INTERIOR GLASS STOP





A. L. BROMLEY P.E., INC.
STRUCTURAL ENGINEER
2004 N.E. 49th Street
Ft. Lauderdale, FL 33308
(954) 772-4624

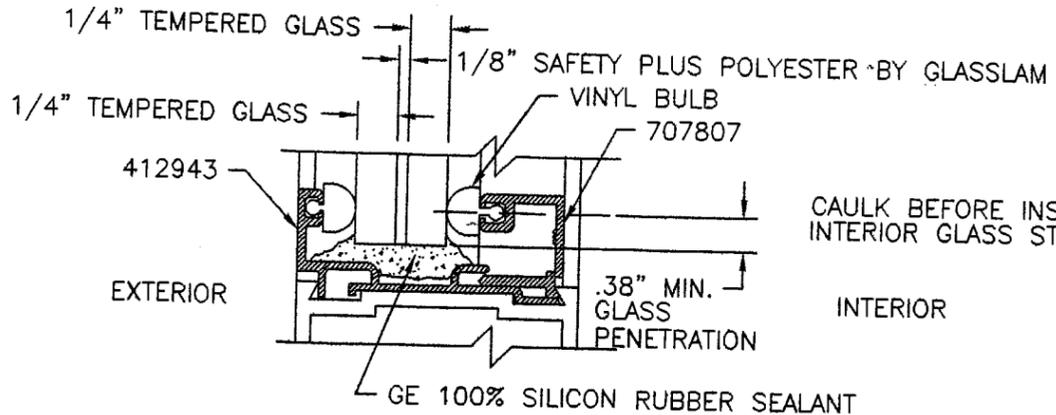

OPTION 2: GLASSLAM SAFETY PLUS BY NEBULA INTERNATIONAL, INC. (NOA 97-0527.04)

CAULK BEFORE INSTALLING INTERIOR GLASS STOP

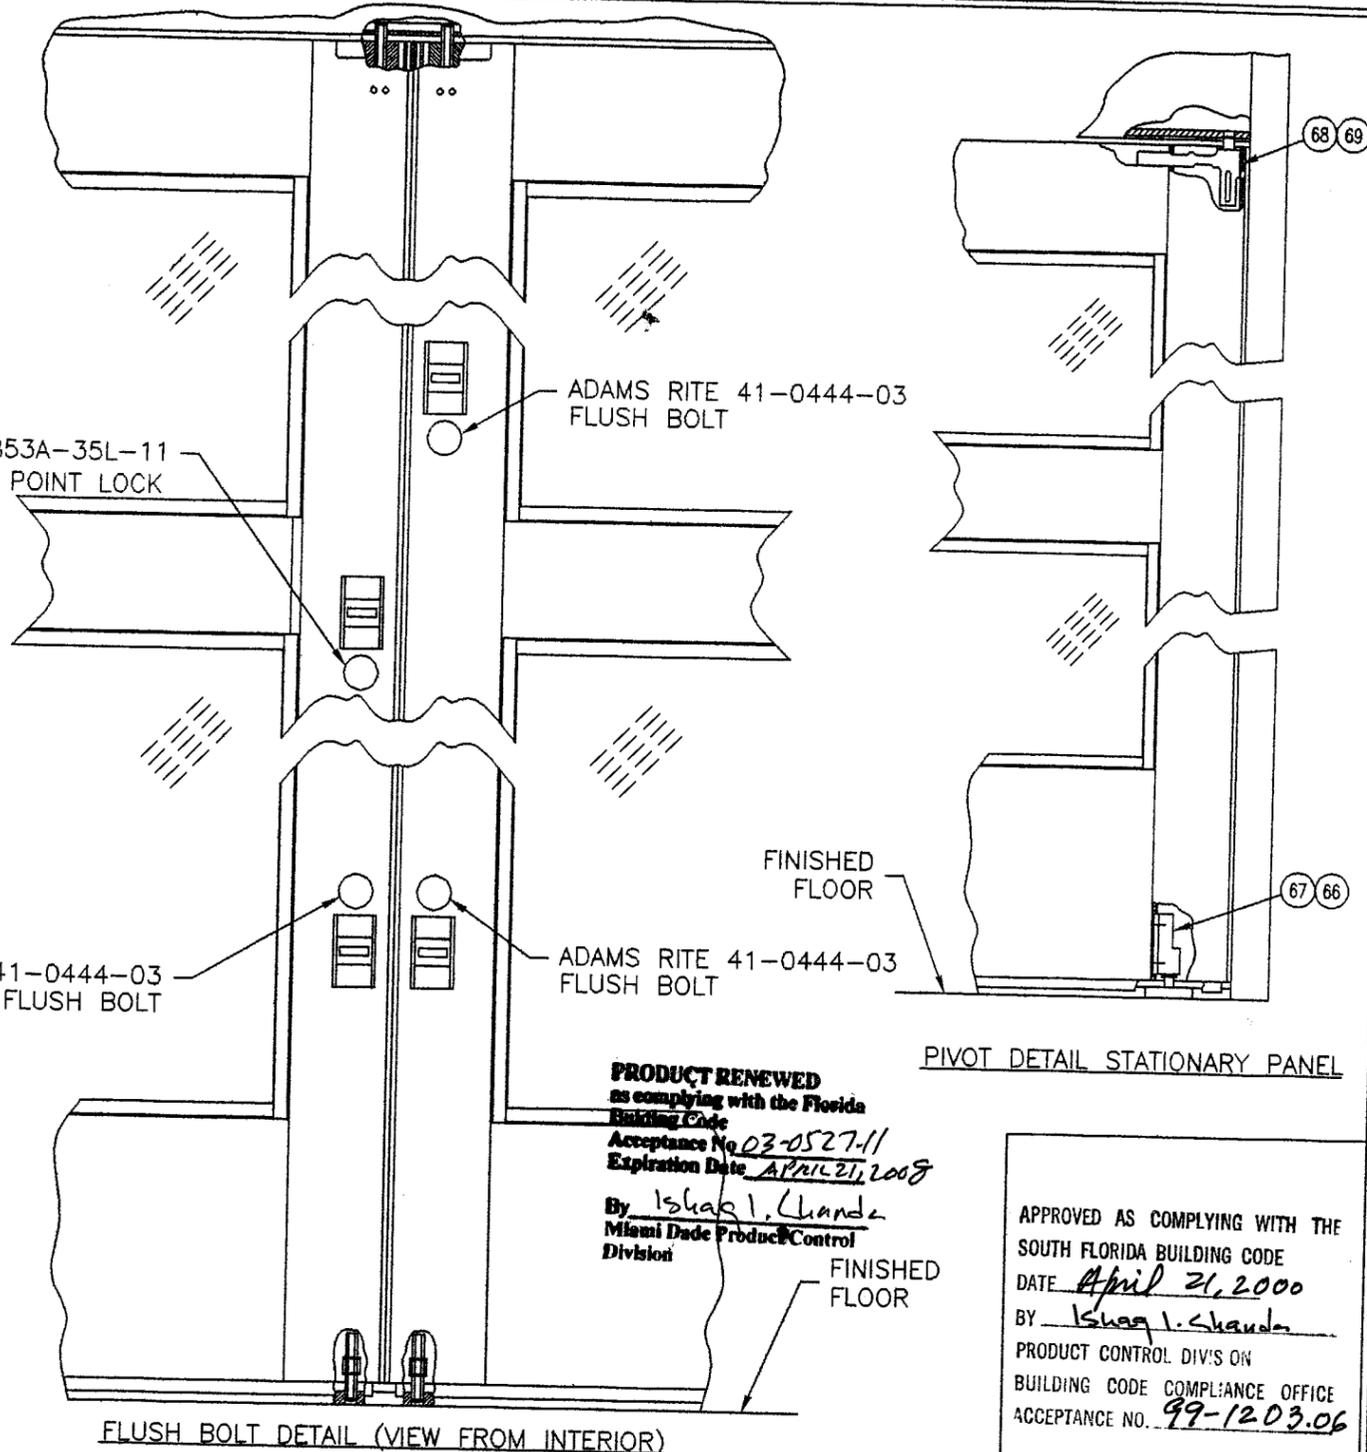

FLUSH BOLT DETAIL (VIEW FROM INTERIOR)

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 03-0527-11
Expiration Date APRIL 21, 2008
By Ishag I. Chanda
Miami Dade Product Control
Division

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE April 21, 2000
BY Ishag I. Chanda
PRODUCT CONTROL DIV'S ON
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 99-1203.06

DRAWN: R. HABERERN 8/16/99		STANLEY ACCESS TECHNOLOGIES A DIVISION OF THE STANLEY WORKS 65 SCOTT SWAMP ROAD, FARMINGTON, CT, 06032	
CHECKED: <i>MB</i>		TITLE THRESHOLD, GLAZING, FLUSH BOLT, PIVOT DETAILS	
APPROVED: <i>MB</i>		PRODUCT LINE DURA-GLIDE, 3000	
MATERIAL: N/A		SIZE B	DWG NO. 413834
FINISH: N/A		REV B	
SCALE NONE	SHEET 3 OF 4		

MB
8/13/00

DWG NO. 413834

DWG NO. 413834

ITEM	QTY	PART NO.	DESCRIPTION
1	1		DURA-GLIDE 3000 BI-PART
2	2	413089-1	JAMB INSERT
3	1	157541	JAMB ASSEMBLY, 4.500 X 1.750 X .100
4	1	157542	JAMB ASSEMBLY, 4.500 X 1.750 X .100
5	1	515260	THRESHOLD
	1	516339	THRESHOLD
	1	515262	THRESHOLD
10A	1	515686	HEADER COVER, 8.468 X 1.968 X .109
10B	1	110755	HEADER, 8.000 X 6.000 X .140
10C	1	515056	HEADERTRACK TUBE, 4.624 X 3.110 X .125
11	1	157508	DOOR PANEL, SX - RH
12	1	713241	THERM-L-BRUSH
13	1	710739	THERM-L-BRUSH
14	2	713416	FLUSH BOLT GUIDE
15	12	312063499	SCREW, FHM-PH 1/4-20 X 1/2 LG
16	2	713823	REINFORCEMENT, SECURITY HOOK, OUTSIDE
17	2	713822	REINFORCEMENT, SECURITY HOOK, INSIDE
18	2	713821	HOOK, SECURITY, MEDIUM STILE
19	1	380901499	NUT, HEX JAM, 5/16-18
20	1	353367000	SCREW, SHC-SK, 5/16-18 X 2.0 LG
21	1	412638	LABEL, CAUTION
22	2	413162	EXIT INDICATOR
23	1	412571	BLOCK-ANCHOR
24	1	412572	SPACER-PILLOW BLOCK
25	2	353349000	SCREW, SHM-SK, 1/4-20 X 1.0 LG
26	2	312073499	SCREW, FHM-PH, 1/4-20 X 2.0 LG
27	2	709221	LOCK, THUMBTURN
28	2	351801499	SCREW, SHC-SK, 1/4-20 X 3/8 LG
29	4	713321	SCREW, FHC-SK, #10-32 X 3/8 LG
30	1	157523	STILE, LOCK-SX, RH, 3.531 X 1.750 X .125
31	1	157517	STILE, PIVOT-SX, RH, 3.531 X 1.750 X .125
32	1	111879-2	HANGER ASSEMBLY-SX, RH
33A	1	516329	RAIL, BOTTOM-SX, 9.625 X 1.595 X .140
33B	1	516630	RAIL, BOTTOM-SX, 9.625 X 1.530 X .140
34	4	312008960	SCREW, FHM-PH, #8-32 X 5/8LG
35	1	413821	FLUSH BOLT, ADAMS RITE 41-0444-03
36	2	413811	ROD ASSY, THROWBOLT ADAMS RITE 31-0278
37	6	711475	WASHER, TIE ROD
38	4	711474	NUT, TIE ROD
39	4	711483	ROD, TIE, 5/16-18 UNC-1A, STEEL, FULL LENGTH OF RAIL
40	16	706812	SEAL, WEATHER-LENGTH AS REQUIRED
41	8	706233	NUT, FLANGED
42	1	413810	LOCK, 2 POINT ADAMS RITE 1853A-38L-11, A1-0464-03
43	2	516338	CLIP, GUIDE
44	1	515265	BOTTOM GUIDE ASSEMBLY
45	1	516224	DETENT-DOOR PORTION
46	1	516643-1	RAIL, TOP-SX, RH, 2.875 X 1.735 X .093
47	2	706668	LOCK, CYLINDER
48	1	413805	SWEEP HOLDER
49	1	413741	BAR, MUNTIN, 4.250 X 1.735 X .093
50	4	412911-3	STOP, GLASS-HORIZONTAL, .625 X .462 X .051
51	2	412909-10	STOP, GLASS-VERTICAL, .625 X .519 X .051
52	2	412908-7	STOP, GLASS-VERTICAL, 1.551 X .649 X .041
53	2	412908-6	STOP, GLASS-VERTICAL, 1.551 X .649 X .041
54	2	412909-9	STOP, GLASS-VERTICAL, .625 X .519 X .051
55	4	412910-3	STOP, GLASS-HORIZONTAL, 1.551 X .649 X .041
56	4	412479	CLIP, GUIDE
57	1	411624	PILE, ADHESIVE BACKED

ITEM	QTY	PART NO.	DESCRIPTION
58	1	157509	DOOR PANEL, SX - LH
			SAME AS 157508 EXCEPT AS NOTED
59	2	312251960	SCREW, FHM-PH, #10-32 X 1/2 LG
60	1	516552	STRIKE PLATE ASSEMBLY
61	1	157502	STILE, STRIKE-SX, LH, 3.531 X 1.750 X .125
62	1	157520	STILE, PIVOT-SX, LH, 3.531 X 1.750 X .125
63	1	111879-1	HANGER ASSEMBLY-SX, LH
64	1	516643-2	RAIL, TOP-SX, LH, 2.875 X 1.735 X .093
65	1	157510	DOOR PANEL, SO - RH
			SAME AS 157508 EXCEPT AS NOTED
66	2	312066499	SCREW, FHM-PH, 1/4-20 X 3/4 LG
67	1	410100	BOTTOM PIVOT-RH
68	5	713844	PIVOT-SELF TAPPING SCREW
69	1	413829	PIVOT ASSEMBLY (UPPER)-SO
70	2	711598	WIRE CLIP
71	1	712175	LOGO, STANLEY
72	1	711463-A	BREAK OUT SWITCH (MAGNET)
73	4	312024960	SCREW, FHM-PH, #10-24 X 3/8 LG
74	1	157521-1	STILE, TRAILING, SO-RH, 3.531 X 1.750 X .125
75	1	157503	STILE, LEAD, SO-RH, 3.531 X 1.750 X .125
76	1	516693-1	RAIL, TOP, SO-RH, 5.000 X 1.735 X .093
77	2	708867	BALL DETENT ASSEMBLY
79	1	411709	DOOR HOLDER ASSEMBLY
80	2	312068499	SCREW, FHM-PH, 1/4-20 X 1.0 LG
81	2	713223	RIVNUT
82	1	413830	DAMPER ASSEMBLY
83	1	157511	DOOR PANEL, SO - LH
			SAME AS 157510 EXCEPT AS NOTED
84	1	410101	BOTTOM PIVOT-LH
85	1	157521	STILE, TRAILING, SO-LH, 3.531 X 1.750 X .125
86	1	157504	STILE, LEAD, SO-LH, 3.530 X 1.750 X .125
87	1	516693-2	RAIL, TOP, SO-LH, 5.000 X 1.735 X .093
88	1		DURA-GLIDE 3000 SINGLE SLIDE
			SAME AS BI-PART EXCEPT AS NOTED
89	1	515193	LOCK, 2 POINT ADAMS RITE 1853A-390
90	2	312004960	SCREW, FHM-PH, #8-32 X 3/8 LG

A. L. BROMLEY P.E., INC.
 STRUCTURAL ENGINEER
 2004 N.E. 49th Street
 Ft. Lauderdale, FL 33308
 (954) 772-4624

W
 4/13/00

DRAWN: R. HABERERN 8/16/99		STANLEY ACCESS TECHNOLOGIES A DIVISION OF THE STANLEY WORKS 65 SCOTT SWAMP ROAD, FARMINGTON, CT, 06032	
CHECKED: <i>MJB</i>		TITLE BILL OF MATERIALS	
APPROVED: <i>MJB</i>		PRODUCT LINE DURA-GLIDE, 3000	
MATERIAL: N/A		SIZE B	DWG NO. 413834
FINISH: N/A		REV B	SCALE 1:1
		SHEET 4 OF 4	

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 03-0527-11
 Expiration Date APRIL 21, 2008
 By Ishaq I. Chanda
 Miami Dade Product Control
 Division

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE April 21, 2000
 BY Ishaq I. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 99-1203.06

DWG NO. 413834