



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Stanley Door Systems
7300 Reames Rd.
Charlotte, NC 28216**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: O/S Opaque Insulated Steel Door-Impact w/wo Sidelites (Non-Impact)

APPROVAL DOCUMENT: Drawing No.43967, titled "Stanley Outswing Opaque 11-4 x 6-8 Steel Edge Door w/& w/o Sidelites", sheets 1 through 7 of 7, prepared by R.W. Building Consultants, Inc., dated 12/26/00 with revision on 7/21/03, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 01-0928.05 and, consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by **Theodore Berman, P.E.**

8/13/2003 

**NOA No 03-0611.08
Expiration Date: November 01, 2006
Approval Date: September 04, 2003
Page 1**

Stanley Door Systems

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **43967**, titled "Stanley Outswing Opaque 11-4 x 6-8 Steel Edge Door w/& w/o Sidelites", sheets 1 through 7 of 7, prepared by R.W. Building Consultants, Inc., dated 12/26/00 with revision on 7/21/03.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94

along with marked-up drawings and installation diagram of an out/in-swinging steel edge opaque residential insulated steel doors, prepared by Certified Testing Laboratories, Test Report No. **CTLA 1022W** dated 1/27/03, signed and sealed by Ramesh C. Patel, P. E.


2. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94

along with marked-up drawings and installation diagram of an out/in-swinging steel edge opaque residential insulated steel doors, prepared by Certified Testing Laboratories, Test Report No. **CTLA 803W** dated 1/26/02, signed and sealed by Ramesh C. Patel, P. E.

Submitted under NOA# 01-0129.21

3. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94

along with marked-up drawings and installation diagram of an out/in-swinging steel edge opaque residential insulated steel doors, prepared by Certified Testing Laboratories, Test Report No. **CTLA 592W** dated 09-08-00, signed and sealed by Ramesh C. Patel, P. E.



Theodore Berman, P.E.
Product Control Division
Deputy Director, NOA No 03-0611.08
Expiration Date: November 01, 006
Approval Date: September 04, 2003

Stanley Door Systems

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

4. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94along with marked-up drawings and installation diagram of an out/in-swinging wood edge glazed residential insulated steel doors with and without sidelites, prepared by Certified Testing Laboratories, Test Report No. **CTL 545W** dated 05-30-00, all signed and sealed by Ramesh C. Patel, P. E.
(Submitted for reference only)

C. CALCULATIONS


1. Anchor Calculations, dated 2/21/03, prepared by R.W. Building Consultants, Inc., signed and sealed by Lyndon Schmidt, P.E.
Submitted under NOA# 01-0129.21
2. Anchor Calculations and structural analysis dated 07/21/00 and 09/03/00, prepared, signed and sealed by Mark C. Fetherman, P.E.

D. MATERIAL CERTIFICATIONS

Submitted under NOA# 01-0129.21

Plastic lite frame material

1. Photocopy of **4500 Hours Xenon Arch** tensile test report No. **ETC-00-417-10343.0** dated 09-11-01, issued by ETC laboratories Inc. for **GE ASA Polycarbonate plastic**, controlled & **4500 Hours xenon Arch** exposed samples to Stanley Doors, tested per ASTM D-63896a, signed and sealed by Joseph L. Donald. **(original test report in file #01-0928.07)**
2. Photo copy Test report No. **ETC-00-417-10343.0** dated 03-07-01, issued by ETC laboratories Inc. for **GE ASA Polycarbonate plastic** to Stanley Doord for "self ignition" per ASTM 1929D, and for" Rate of Burning" per ASTM D635-97 and for "Smoke density" per ASTMD-2843-93, all the test reports for **GE ASA Polycarbonate plastic** (original test report pending from manufacturer)
3. Photocopy **4500 Hours Xenon Arch** completed tensile test report No. **PRI00034** dated December 14, 2000, issued by PRI Asphalt Technologies to **ODL** for **Spartech Polycom PP5530-C13, 4500 Hours Xenon Arch** exposed samples, tested per ASTM D-63896a, signed and sealed by Charles L. Thomas, P. E. (original test report pending from Tensile Test report No. **CTLA-545W** (REF:DADE 00007), dated May 18, 2000, issued by Certified Testing Laboratories, for steel skin samples tested per ASTM A370/E8, signed and sealed by Ramesh Patel, P.E.



Theodore Berman, P.E.
Product Control Division
Deputy Director, NOA No 03-0611.08
Expiration Date: November 01, 006
Approval Date: September 04, 2003

Stanley Door Systems

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

4. Test Report No. **114884-3** "Measuring the Density of Smoke from the Burning or Decomposition of Plastics" per ASTM D-2843-93", dated 11/24/98, all the test reports for ODL Spartech 1643.05 Filled Polypropylene Fiberglass & Mica samples (ODLI-2), issued by *SGS U.S. Testing Co. Inc.* signed and sealed by Joseph G. Cappetta, P.E.

Polyurethane foam core

5. Photo copy Test reports No. 15977-104313 (**Infinity**) & 15977-104314 (**Retro**) for "Surface burning characteristics" per ASTM E-84, both dated 12-23,1998, for BASF polyurethane cores, issued by Omega Point Laboratories (original in file #98-1104.03).
6. Photo copy Test report No. ETC-98-417-7209.O (**Infinity**) & test report No. ETC-98-417-7208.O (**Retro**) "self ignition temperature" per ASTM D1929-96 both dated 1-11-99 for BASF polyurethane cores, issued by ETC Laboratories (original in file #98-1104.03).

E. QUALITY ASSURANCE


1. *Miami-Dade County Building Code Compliance Office*

F. STATEMENTS

1. Statement letter of no financial interest & conformance, dated 5/19/03, signed by Lyndon Schmidt, P.E.
2. Statement letter of no financial interest, dated 4/4/03, signed by Daniel Carlson.

H. OTHER

1. Notice of Acceptance No. **01-0928.06**, issued to Stanley Door Systems, Series "Sta-Tru" S/E 6'8 Inswing Opaque Res. Ins. Steel Door w/wo Sidelites, approved on 11/1/01 and expiring on 11/1/06.
2. Letter from consultant stating that the product is in compliance with the Florida Building Code (FBC).



Theodore Berman, P.E.
Product Control Division
Deputy Director, NOA No 03-0611.08
Expiration Date: November 01, 006
Approval Date: September 04, 2003

STANLEY DOOR SYSTEMS

STEEL EDGE OUTSWING 6-8 OPAQUE STEEL DOOR
W/AND W/OUT SIDELITES IN A WOOD FRAME

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. FLORIDA BUILDING CODE APPROVED IMPACT RESISTANT SHUTTERS ARE REQUIRED FOR SIDELITES AS PRESCRIBED IN "HIGH VELOCITY HURRICANE ZONE" OF THE FLORIDA BUILDING CODE.
5. DESIGNED PRESSURE RATING SEE TABLES PAGE 1.
6. SIDELITES ARE AN OPTION AND CAN BE IN A SINGLE OR DOUBLE DOOR CONFIGURATION.

RESIDENTIAL INSULATED STEEL DOOR (Common to all frame conditions)

Door Panel & Sidelite Construction:

Face sheets: 26 GA.(0.018") minimum thickness, Galvanized steel A-525 commercial quality - AKDQ per ASTM 620 with yield strength $F_y(\text{min.})=45,270$ psi

Core design: Polyurethane foam core, with 1.7 pcf lbs. density by BASF.

Door Panel Construction: Flush or embossed type. The perimeter stiles are a roll formed steel edge from .028" thk. galvanized steel. The vertical edges of the face sheet are crimped to form a mechanical lock with the hinge and latch steel edge stiles. The top and bottom edges of the face sheets are bent 90° over the steel edge top and bottom.

Sidelite Panel Construction: The vertical edges of the skin are flush and glued to the top and bottom finger jointed pine stiles. The horizontal edges of the panel skin are roll formed over the finger jointed side stiles to form a mechanical lock. Panels are sandwich glazed using a two piece plastic lite frame with mitered & welded corners.



TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	COMMON (GENERAL NOTES & TYPICAL ELEVATION)
2	VERTICAL CROSS SECTIONS & BILL OF MATERIALS
3	HORIZONTAL CROSS SECTIONS
4	HORIZONTAL CROSS SECTIONS
5	ANCHORING LAYOUTS & DETAILS
6	ANCHORING LAYOUTS, DOOR MODELS & GLAZING DETAILS
7	UNIT COMPONENTS

DESIGN PRESSURE RATING

UNIT TYPE	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED	
SINGLE	+65.0 PSF	-80.0 PSF **
SINGLE W/SIDELITES	+50.0 PSF	-50.0 PSF
DOUBLE	+50.0 -44.0 PSF W/IMPERIAL AST.	+55.0 -60.0 PSF W/WINDJAMBER II AST.
DOUBLE W/SIDELITES	+50.0 -44.0 PSF W/IMPERIAL AST.	+50.0 -50.0 PSF W/WINDJAMBER II AST.

** (REQUIRES HIGH DAM THRESHOLD WHEN PRESSURE REQUIREMENT EXCEEDS 40 PSF POSITIVE)

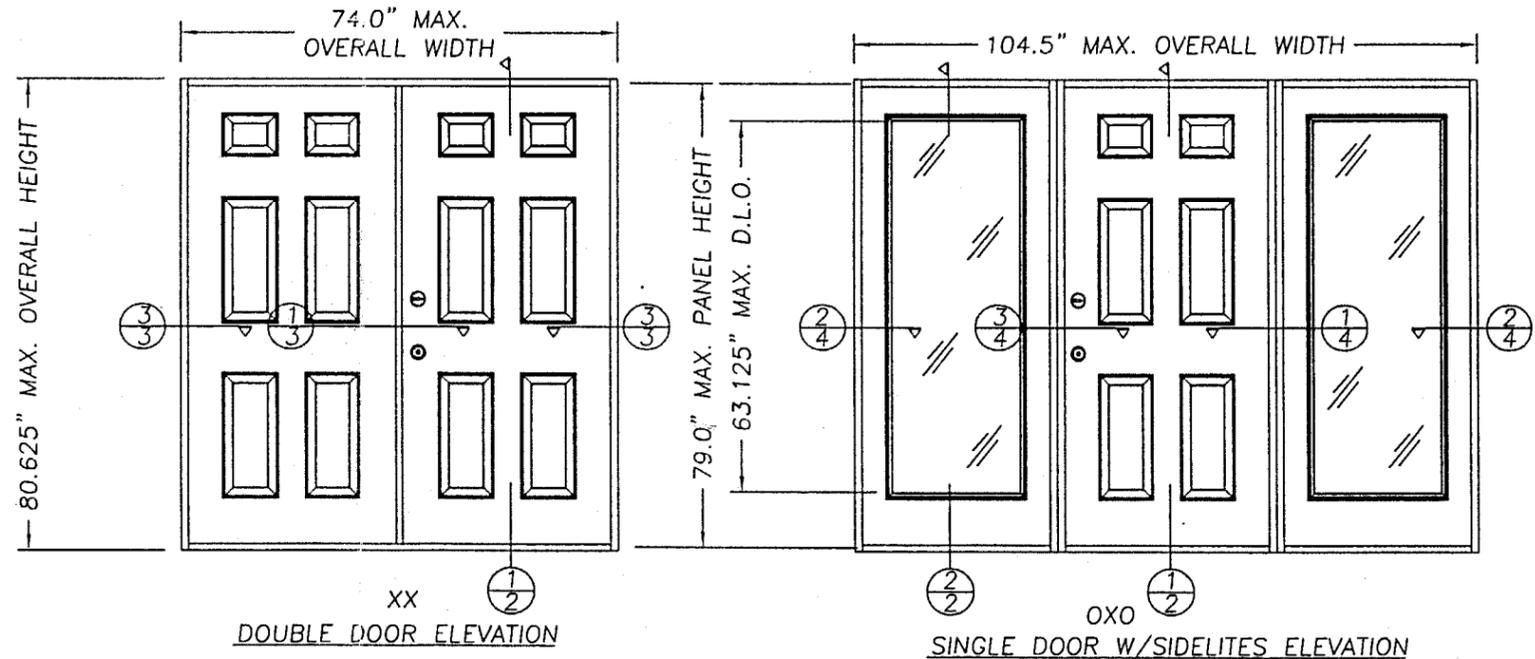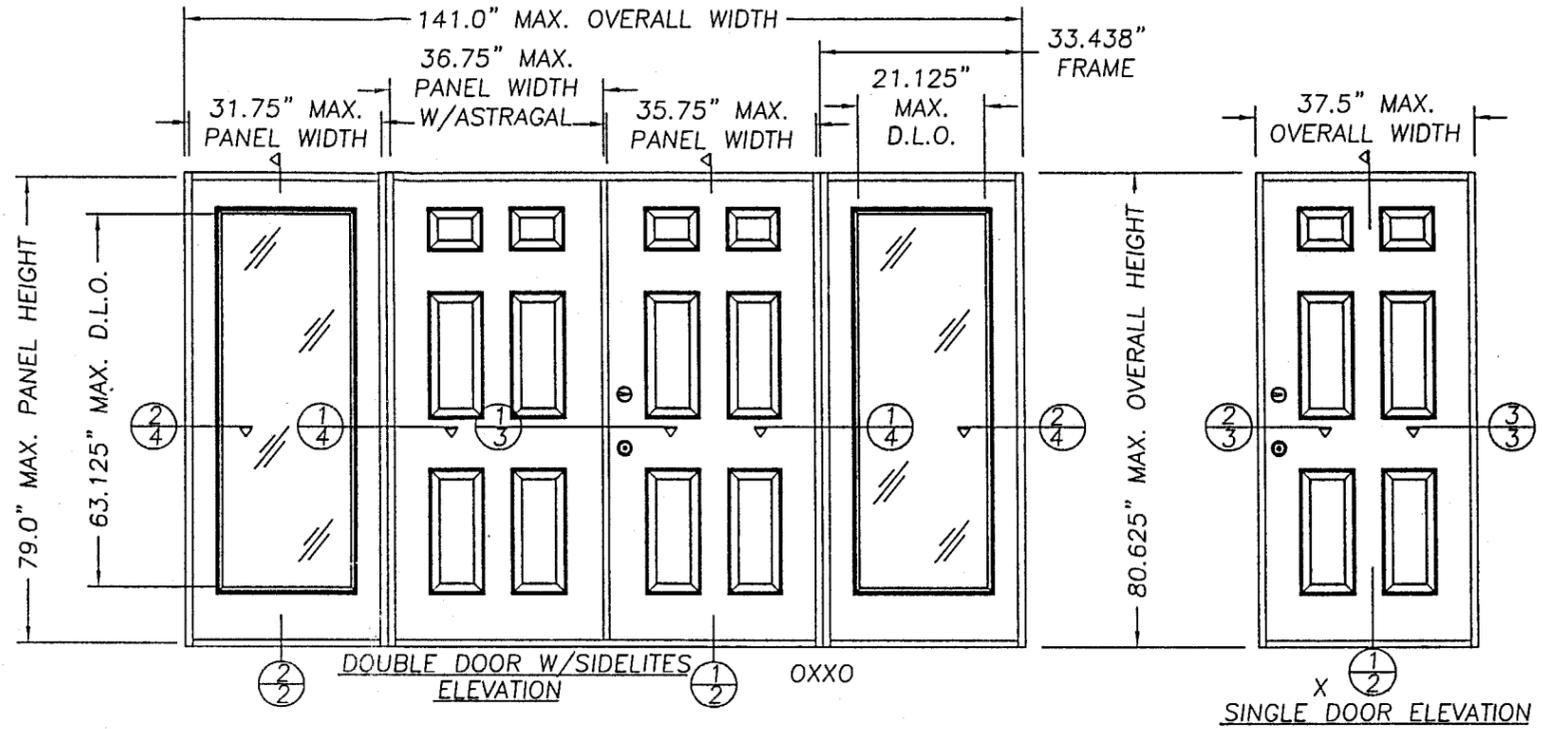

ALL DOOR MODELS ARE VIEWED FROM THE INTERIOR SIDE (OUTSWING DOORS)

PRODUCT REVISED as complying with the Florida Building Code
Acceptance No 09-0011.08
Expiration Date 11/01/10
By *Cleaveland Korman*
Miami Dade Product Control Division

STANLEY
STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470


PRODUCT: STANLEY OUTSWING OPAQUE 11-4 x 6-8 STEEL EDGE DOOR W/& W/O SIDELITES
PART OR ASSEMBLY:
GENERAL NOTES AND TYPICAL ELEVATIONS

NO.	DATE	REVISIONS	BY
2	7/21/03	REVISED GENERAL NOTES	RW
1	5/28/03	REVISED BILL OF MATERIALS	TJH


RW BUILDING CONSULTANTS, INC.
813.659.9197

DATE: 12/26/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: 43967
SHEET 1 OF 7

ITEM	DESCRIPTION	MATERIAL
1	DOOR SKIN (0.018" MIN. 26ga. STEEL)	STEEL
2	STEEL EDGE CAP, HINGE STILE (.028" THK.)	STEEL
3	STEEL EDGE CAP, LATCH STILE (.028" THK.)	STEEL
4	STEEL EDGE CAP, TOP (.028" THK.)	STEEL
5	STEEL EDGE CAP, BOTTOM (.028" THK.)	STEEL
6	WOOD LOCK BLOCK, DOOR PANEL 4" x 12" x 1.75"	WOOD
7	HINGES 4" x 4" x .088 WT. (STANLEY)	STEEL
8	#10 x 1/2" SHEET METAL SCREW	STEEL
9	COMPRESSION WEATHERSTRIP (SCHLEGAL QDS 650)	FOAM
10	MAGNETIC WEATHERSTRIP (HOLMES)	FOAM
11	SIDELITE TOP & BOTTOM RAIL (PONDEROSA PINE)	PINE
12	SIDELITE BLANK JAMB (PONDEROSA PINE)	PINE
13	HEAD JAMB (PONDEROSA PINE)	PINE
14	HINGE JAMB (PONDEROSA PINE)	PINE
15	LATCH JAMB (PONDEROSA PINE)	PINE
16	POLYURETHANE FOAM CORE (BASF) TYPE A. INFINITY: RESIN (P14120R) ISOCYANATE (P1001), CYCLOPENTANE. TYPE B. RETRO: RESIN (P12430R), ISOCYANATE (P1036).	
17	#8 x 2 1/2" PFH WS	STEEL
18	1/4" SHIM MATERIAL	-
19	LITE FRAME (ODL Spartech Polycor PP5530 C13) LITE FRAME (Trinity GE ASA Polycarbonate) (SEE GLAZING DETAILS SHEET 6 OF 7)	POLYPROP. ASA
20	GLAZING COMPOUNDS - SILICONE CAULK (GE WINDOW DOOR, NOVAGUARD) - LATEX SEALANT LIQUID NAIL	SILICONE LATEX
21	GLASS (1/2" BY ODL SEE GLAZING DETAIL) GLASS (1" BY ODL SEE GLAZING DETAIL)	
22	KWIKSET TITAN 700 SERIES DEADBOLT	-
23	KWIKSET TITAN 700 SERIES KNOB	-
24	#10 x 2" PFH WOOD SCREW	STEEL
25	#8 x 2" PFH WOOD SCREW	STEEL
26	MASONRY	CONCRETE
27	GLAZING TAPE (VENTURE TAPE .30" W. x .037" THK.) GLAZING COMPOUND LIQUID NAIL LATEX SEALANT GLAZING COMPOUND SILICONE CAULK (NOVAGARD)	FOAM LATEX SILICONE
28	#9 x 1.00 F.H. WD SCREWS	STEEL
29	#8 x 2" PANH WD SCREWS	STEEL
30	BUMP THRESHOLD	ALUMINUM
31	3/16" TAPCON (ITW) OR 3/16" (ELCO) 2 1/2" LG.	STEEL
32	3/16" TAPCON (ITW) OR 3/16" (ELCO) 2 1/4" LG.	STEEL
33	#8-1 1/4" TEK SCREW (LITE FRAME SCREW)	STEEL
34	GLAZING STOP QUARTER ROUND (1/2" x 1/2")	PINE
35	BRAD TRIM NAIL 2" LG.	STEEL
36	2X BUCK	WOOD
37	OPTIONAL EXTRUDED ALUMINUM ASTRAGAL (IMPERIAL)	ALUM.
38	1.68"x1.22" BLANK STILE (PONDEROSA PINE)	PINE
39	ASTRAGAL EXTRUDED ALUM. (WR68S WINDJAMBER II)	ALUM.
40	COMPRESSION WEATHERSTRIP (HOLMS, SEE NOTE 3 SHT. 3)	FOAM
41	COMPRESSION WEATHERSTRIP (HOLM IND. JF65)	FOAM
42	HIGH DAM BUMP THRESHOLD BY IMPERIAL (.051" MIN.)	ALUM.
43	SCHLAGE B260 E-BOLT DEADBOLT	-
44	SCHLAGE B360 DEADBOLT	-
45	SCHLAGE F-10 HALL /CLOSET KNOB	-
46	1/2" & 1" TRINITY/AMPAC GLASS	-

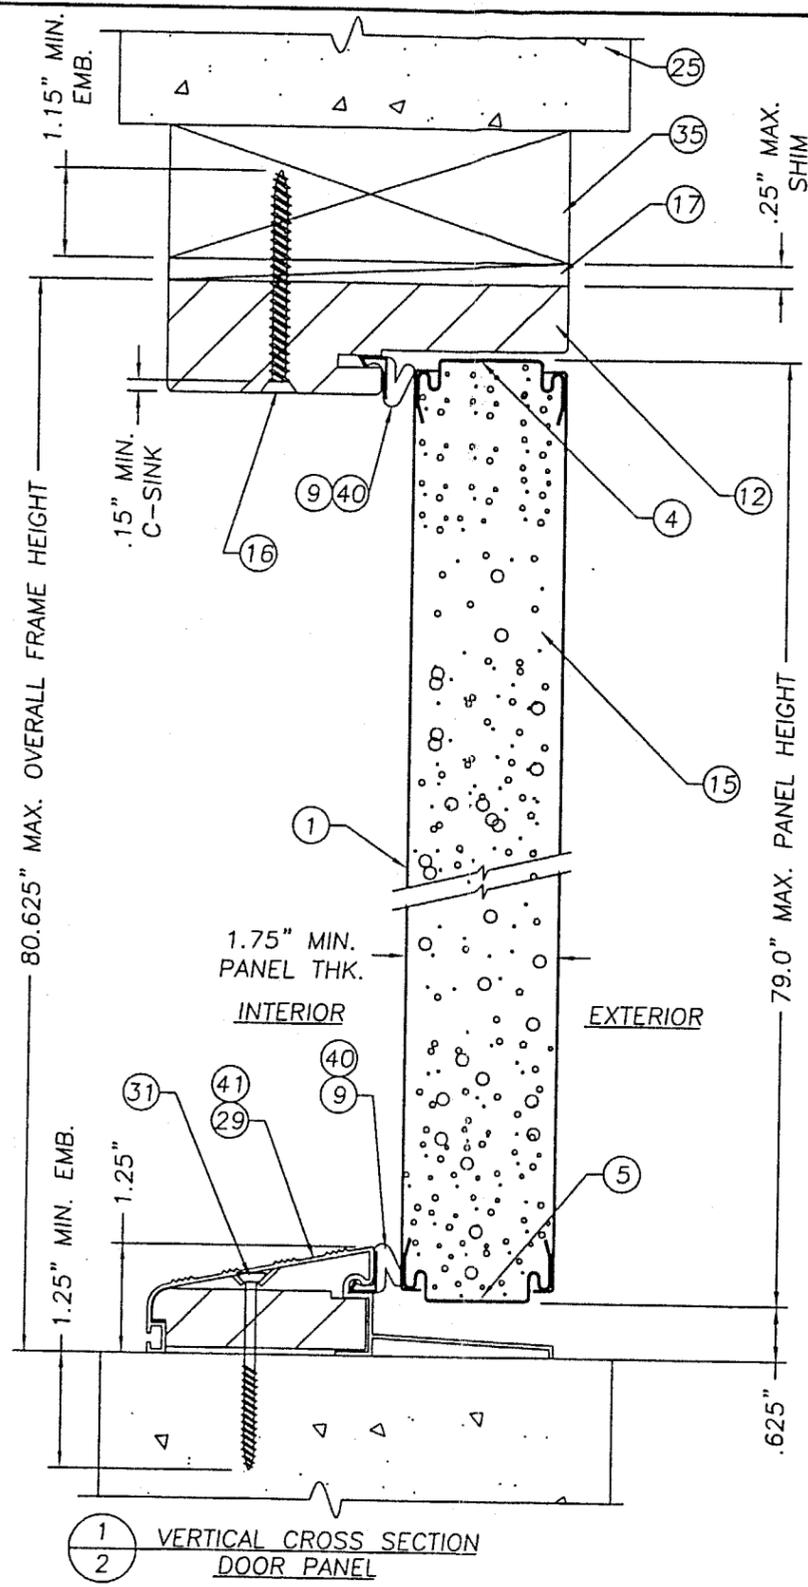

1 VERTICAL CROSS SECTION DOOR PANEL
2

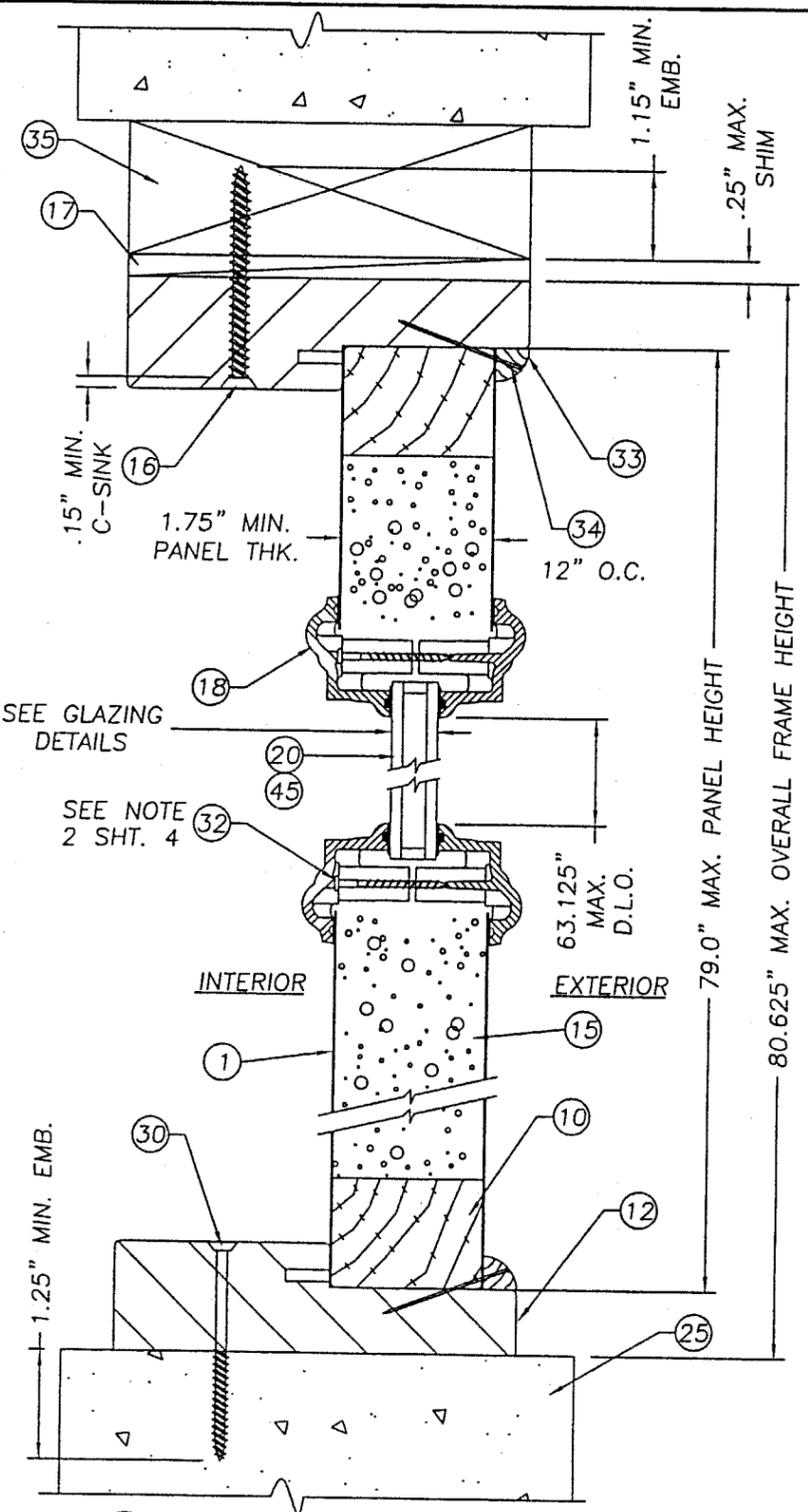

2 VERTICAL CROSS SECTION SIDELITE
2

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 03-0611-08
Expiration Date 11/01/06
By: *Michael Dade*
Miami Dade Product Control
Division




STANLEY
STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470

PRODUCT:
STANLEY OUTSWING OPAQUE
11-4 x 6-8 STEEL EDGE
DOOR W/ & W/O SIDELITES
PART OR ASSEMBLY:
VERTICAL CROSS SECTIONS
& BILL OF MATERIALS

NO.	DATE	REVISIONS	BY
2	7/21/03	REVISED GENERAL NOTES	RW
1	5/28/03	REVISED BILL OF MATERIALS	TJH

RW BUILDING
CONSULTANTS, INC.
813.659.9197

DATE: 12/26/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: 43967
SHEET 2 OF 7

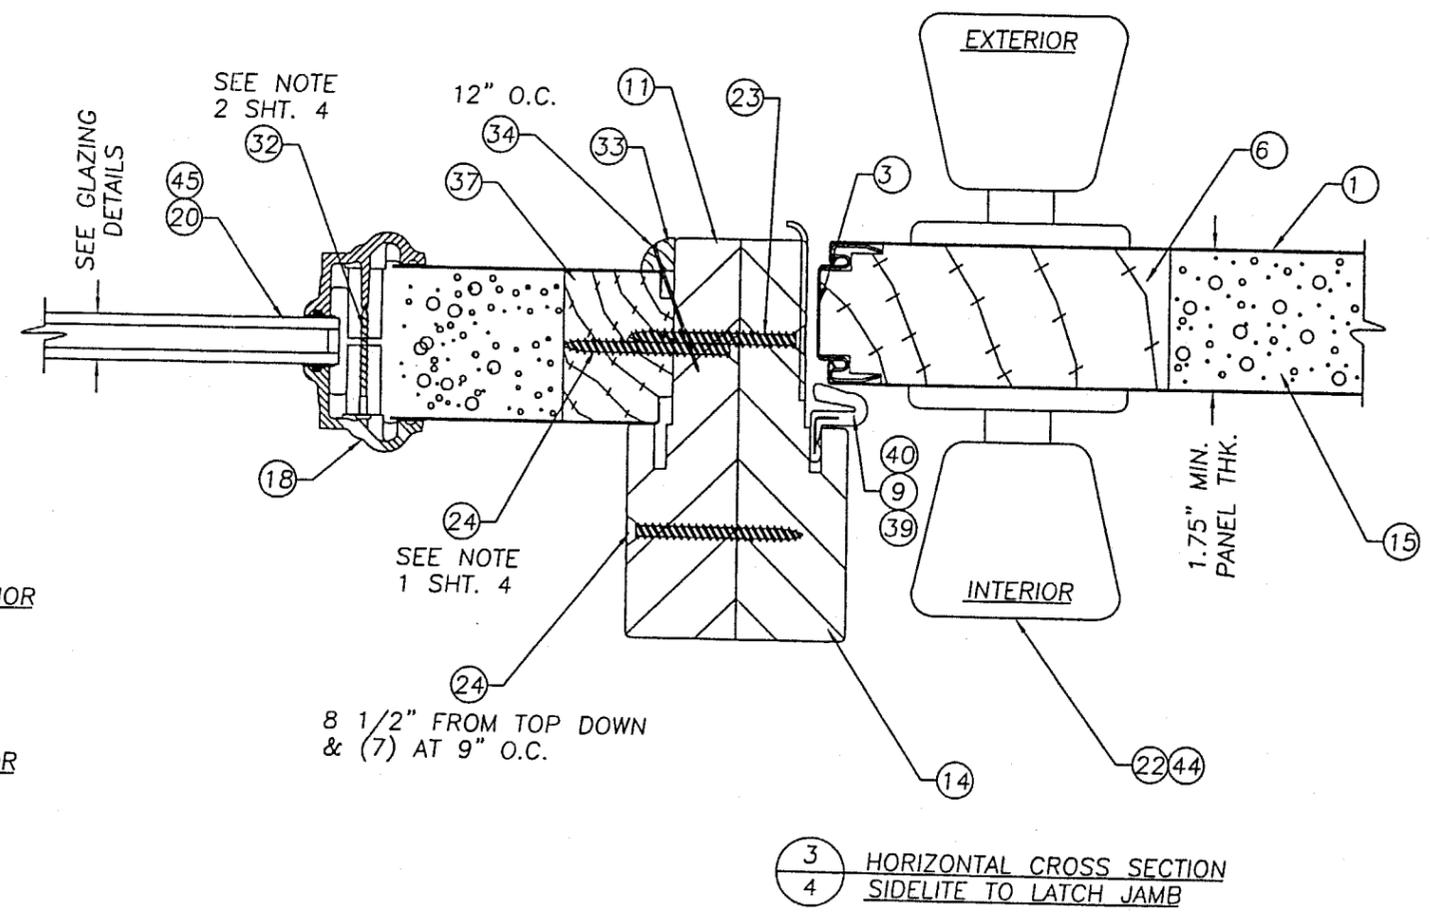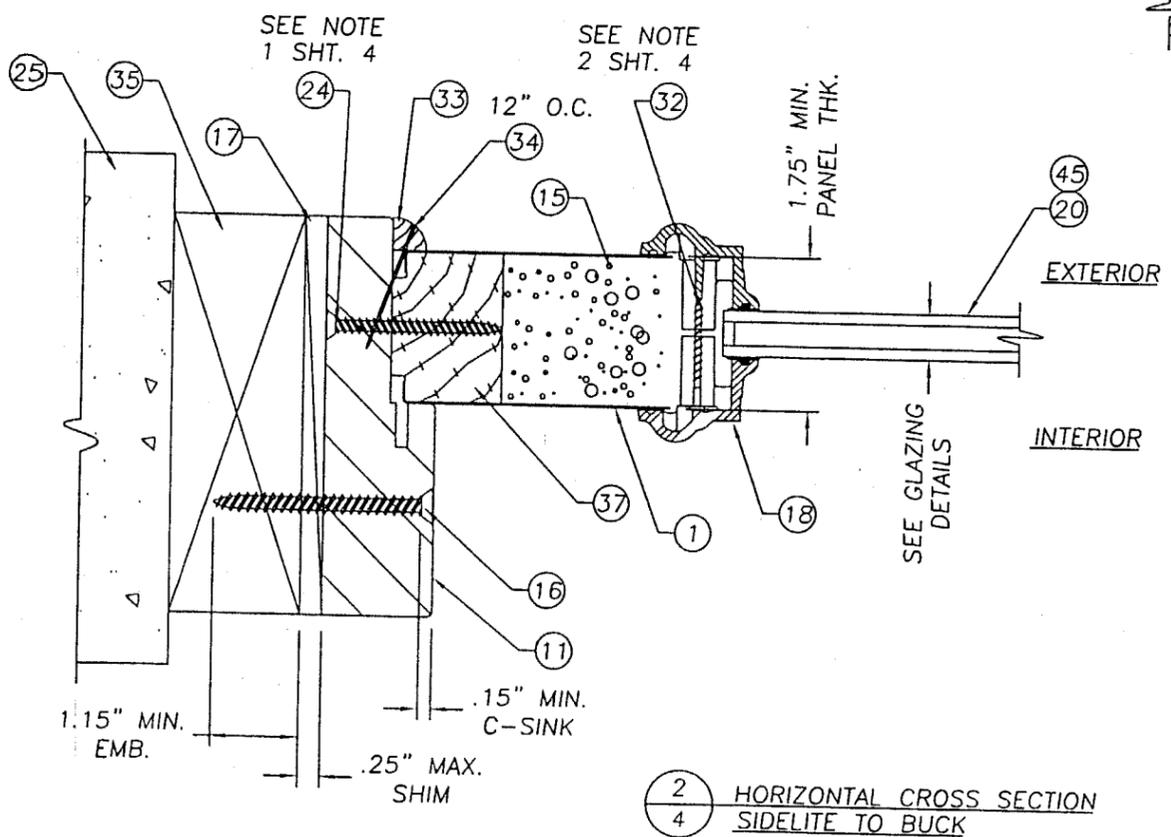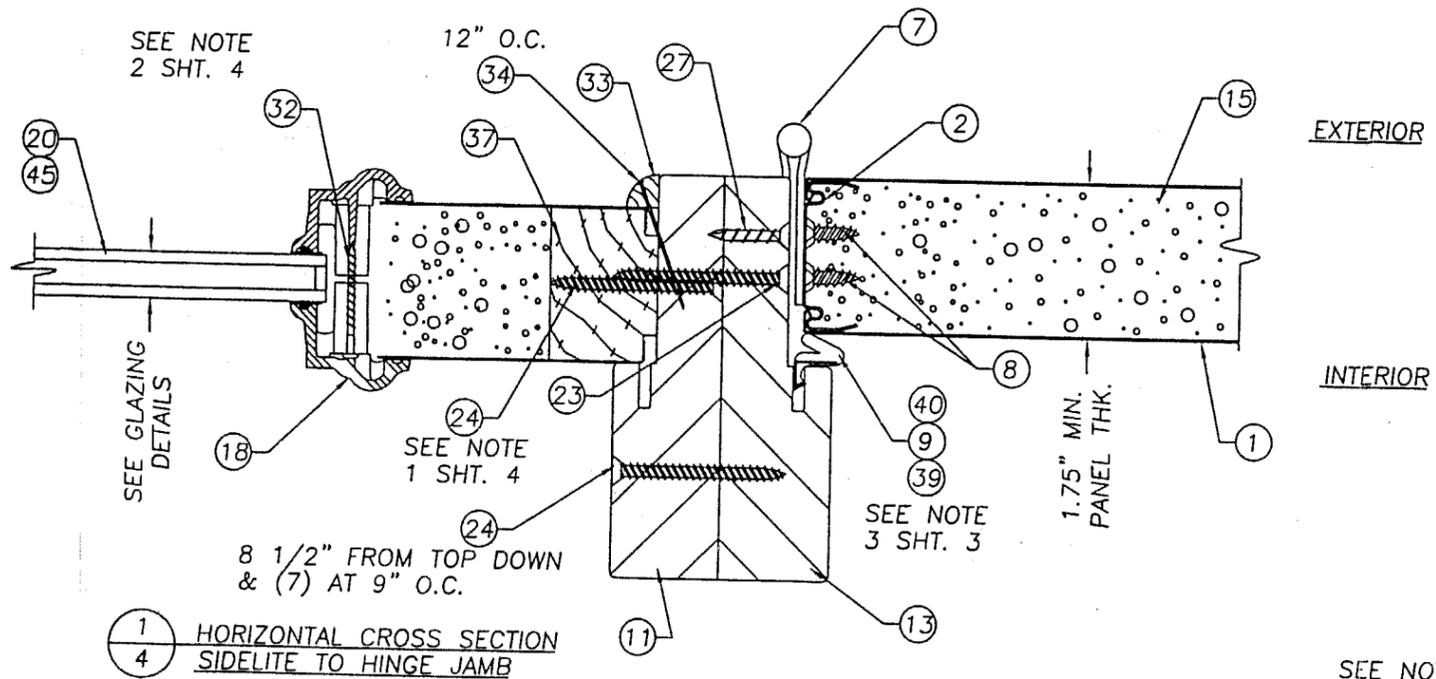

- NOTES:
1. THE SIDELITE IS FASTENED INTO THE JAMB WITH ITEM #24 (#8 x 2" PH. FH SCREW) SPACED AS FOLLOWS: 6" DOWN FROM TOP AND 6" UP FROM BOTTOM WITH (2) MORE EVENLY SPACED, A TOTAL OF (4) SCREWS.
 2. SPACING FOR ITEM #32; TOP & BOTTOM (1) 3 1/2" IN FROM CORNERS & (1) IN THE CENTER. SIDES; (6) SCREWS 3 1/4", 13 3/4", 26 1/2", 39 3/8", 52" & 62 5/8".

STANLEY
 STANLEY DOOR SYSTEMS
 7300 REAMES ROAD
 CHARLOTTE, NC 28216
 PH. (704) 921-3470










PRODUCT: STANLEY OUTSWING OPAQUE
 11-4 x 6-8 STEEL EDGE
 DOOR W/ & W/O SIDELITES
 PART OR ASSEMBLY:
 HORIZONTAL
 CROSS SECTIONS

NO.	DATE	REVISIONS	BY
2	7/21/03	REVISED GENERAL NOTES	RW
1	5/28/03	REVISED BILL OF MATERIALS	TJH

RW BUILDING
 CONSULTANTS, INC.
 813.659.9197

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 03-0611-08
 Expiration Date: 11/01/08
 By: *Charles Bernan*
 Miami Dade Product Control
 Division

DATE: 12/26/00
 SCALE: N.T.S.
 DWG. BY: TJH
 CHK. BY: RW
 DRAWING NO.: 43967
 SHEET 4 OF 7

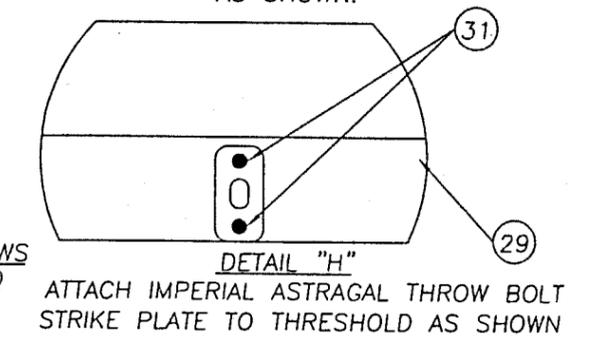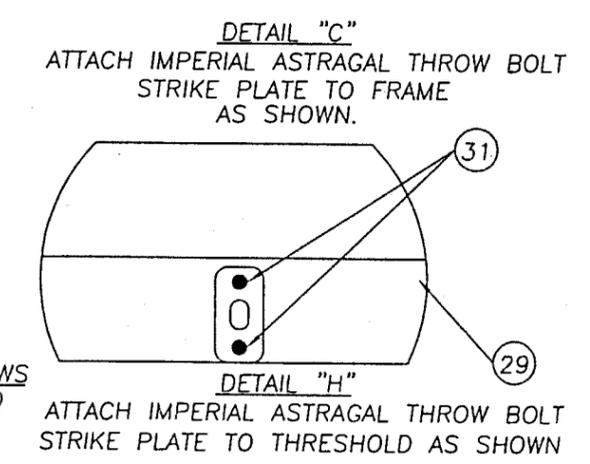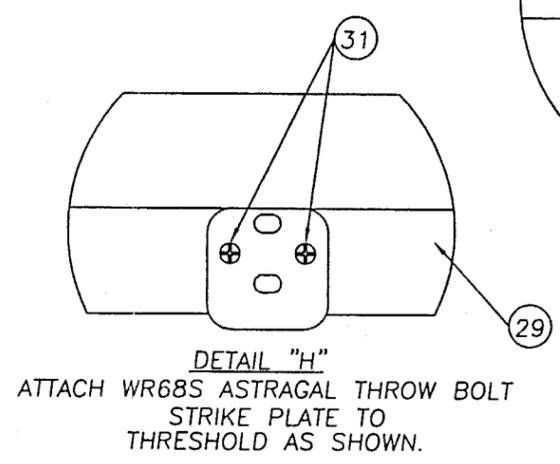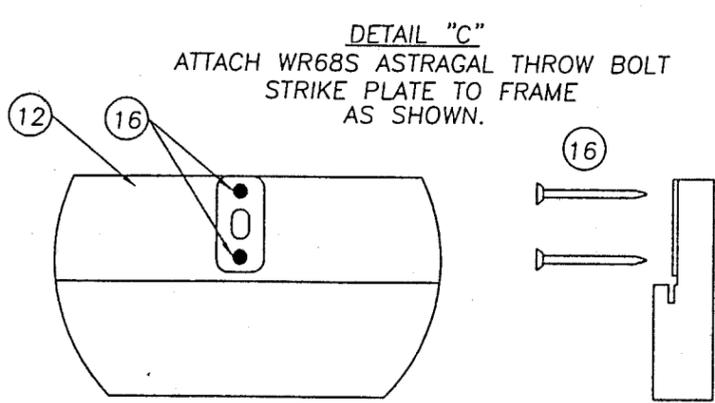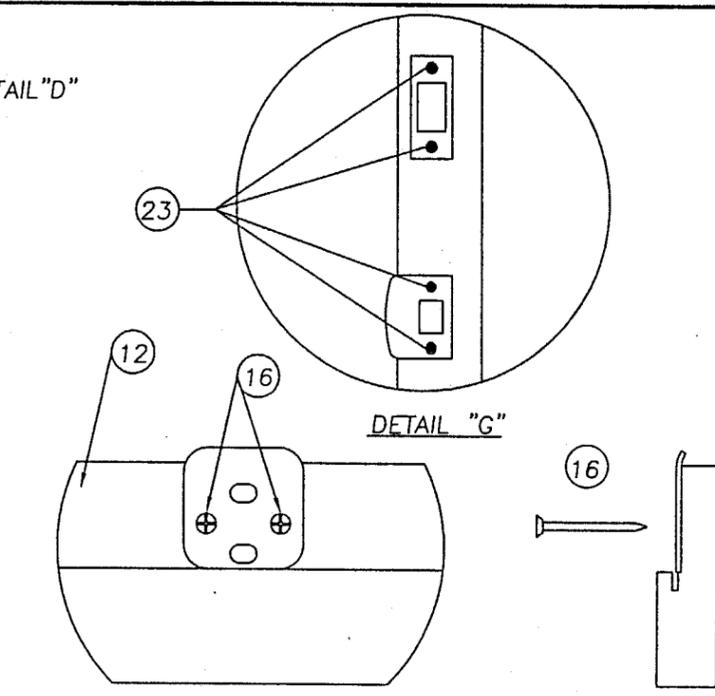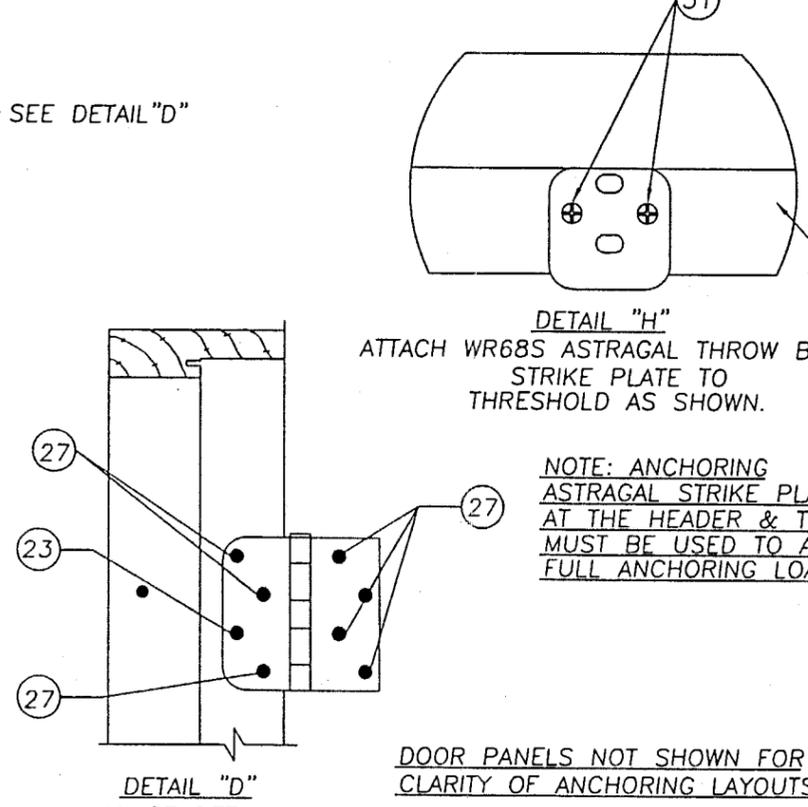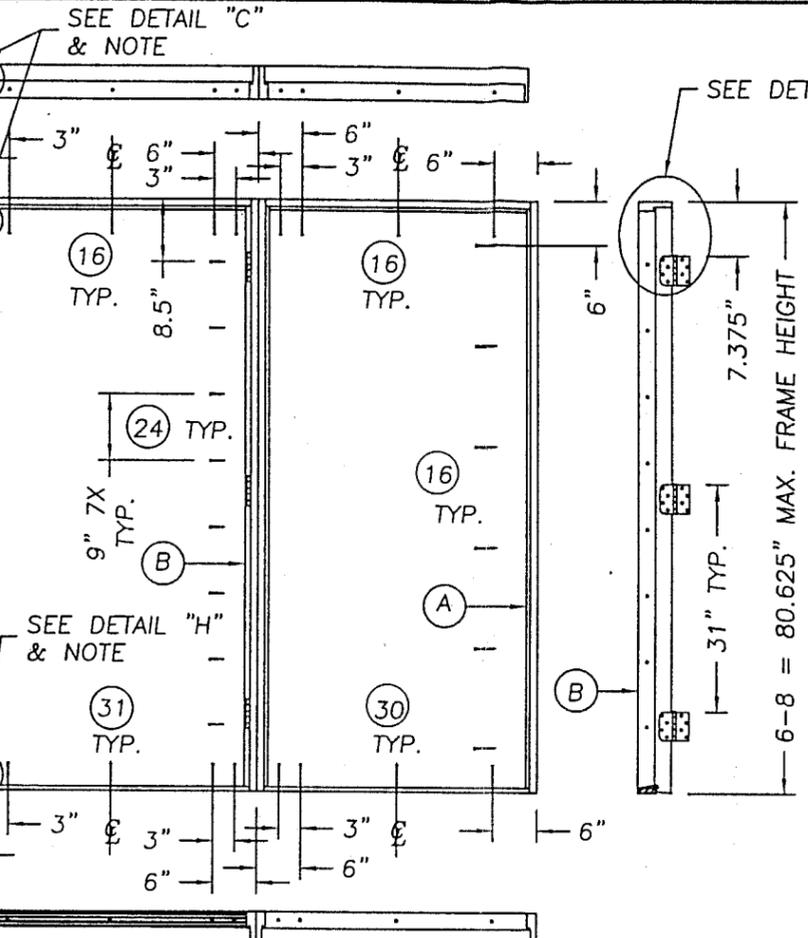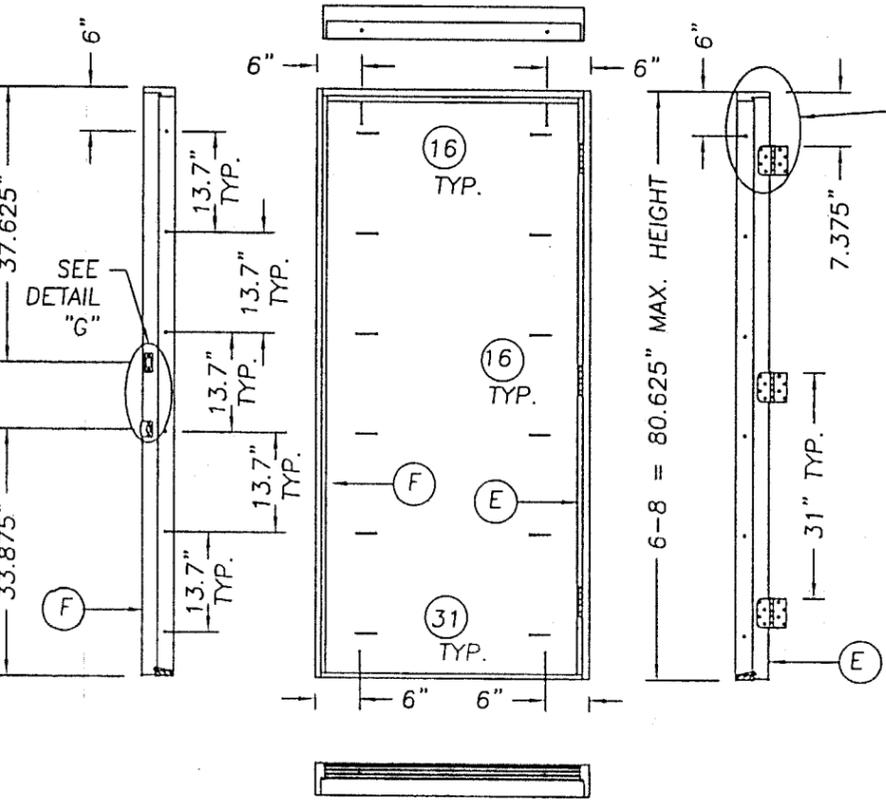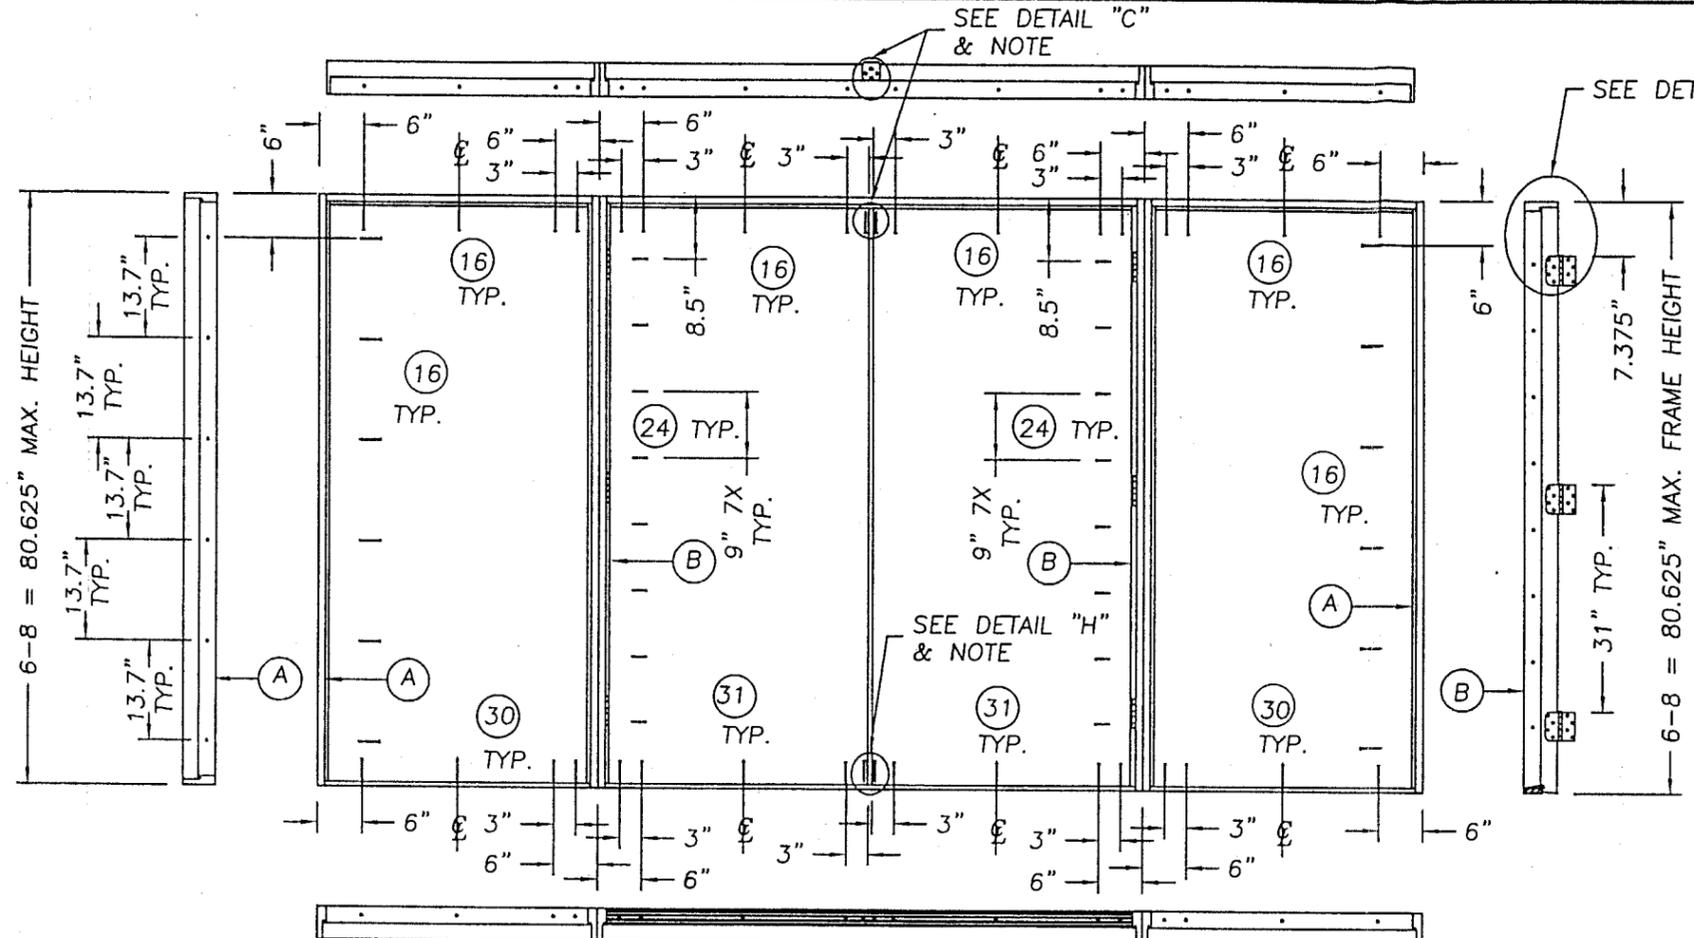

NOTE: ANCHORING ASTRAGAL STRIKE PLATE SCREWS AT THE HEADER & THRESHOLD MUST BE USED TO ACHIEVE FULL ANCHORING LOAD.

DOOR PANELS NOT SHOWN FOR CLARITY OF ANCHORING LAYOUTS

STANLEY
 STANLEY DOOR SYSTEMS
 7300 REAMES ROAD
 CHARLOTTE, NC 28216
 PH. (704) 921-3470


PRODUCT:
 STANLEY OUTSWING OPAQUE
 11-4 x 6-8 STEEL EDGE
 DOOR W/ & W/O SIDELITES
 PART OR ASSEMBLY:
 ANCHORING LAYOUTS
 & DETAILS

NO.	DATE	REVISIONS
2	7/21/03	RW REVIS GENERAL NOTES
1	5/28/03	TJH REVISED BILL OF MATERIALS
		BY


RW BUILDING
 CONSULTANTS, INC.
 813.659.9197

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 02-0611.0B
 Expiration Date 11/01/06
 By *Christie Newman*
 Miami Dade Product Control
 Division


DATE: 12/26/00
 SCALE: N.T.S.
 DWG. BY: TJH
 CHK. BY: RW
 DRAWING NO.: 43967
 SHEET 5 OF 7

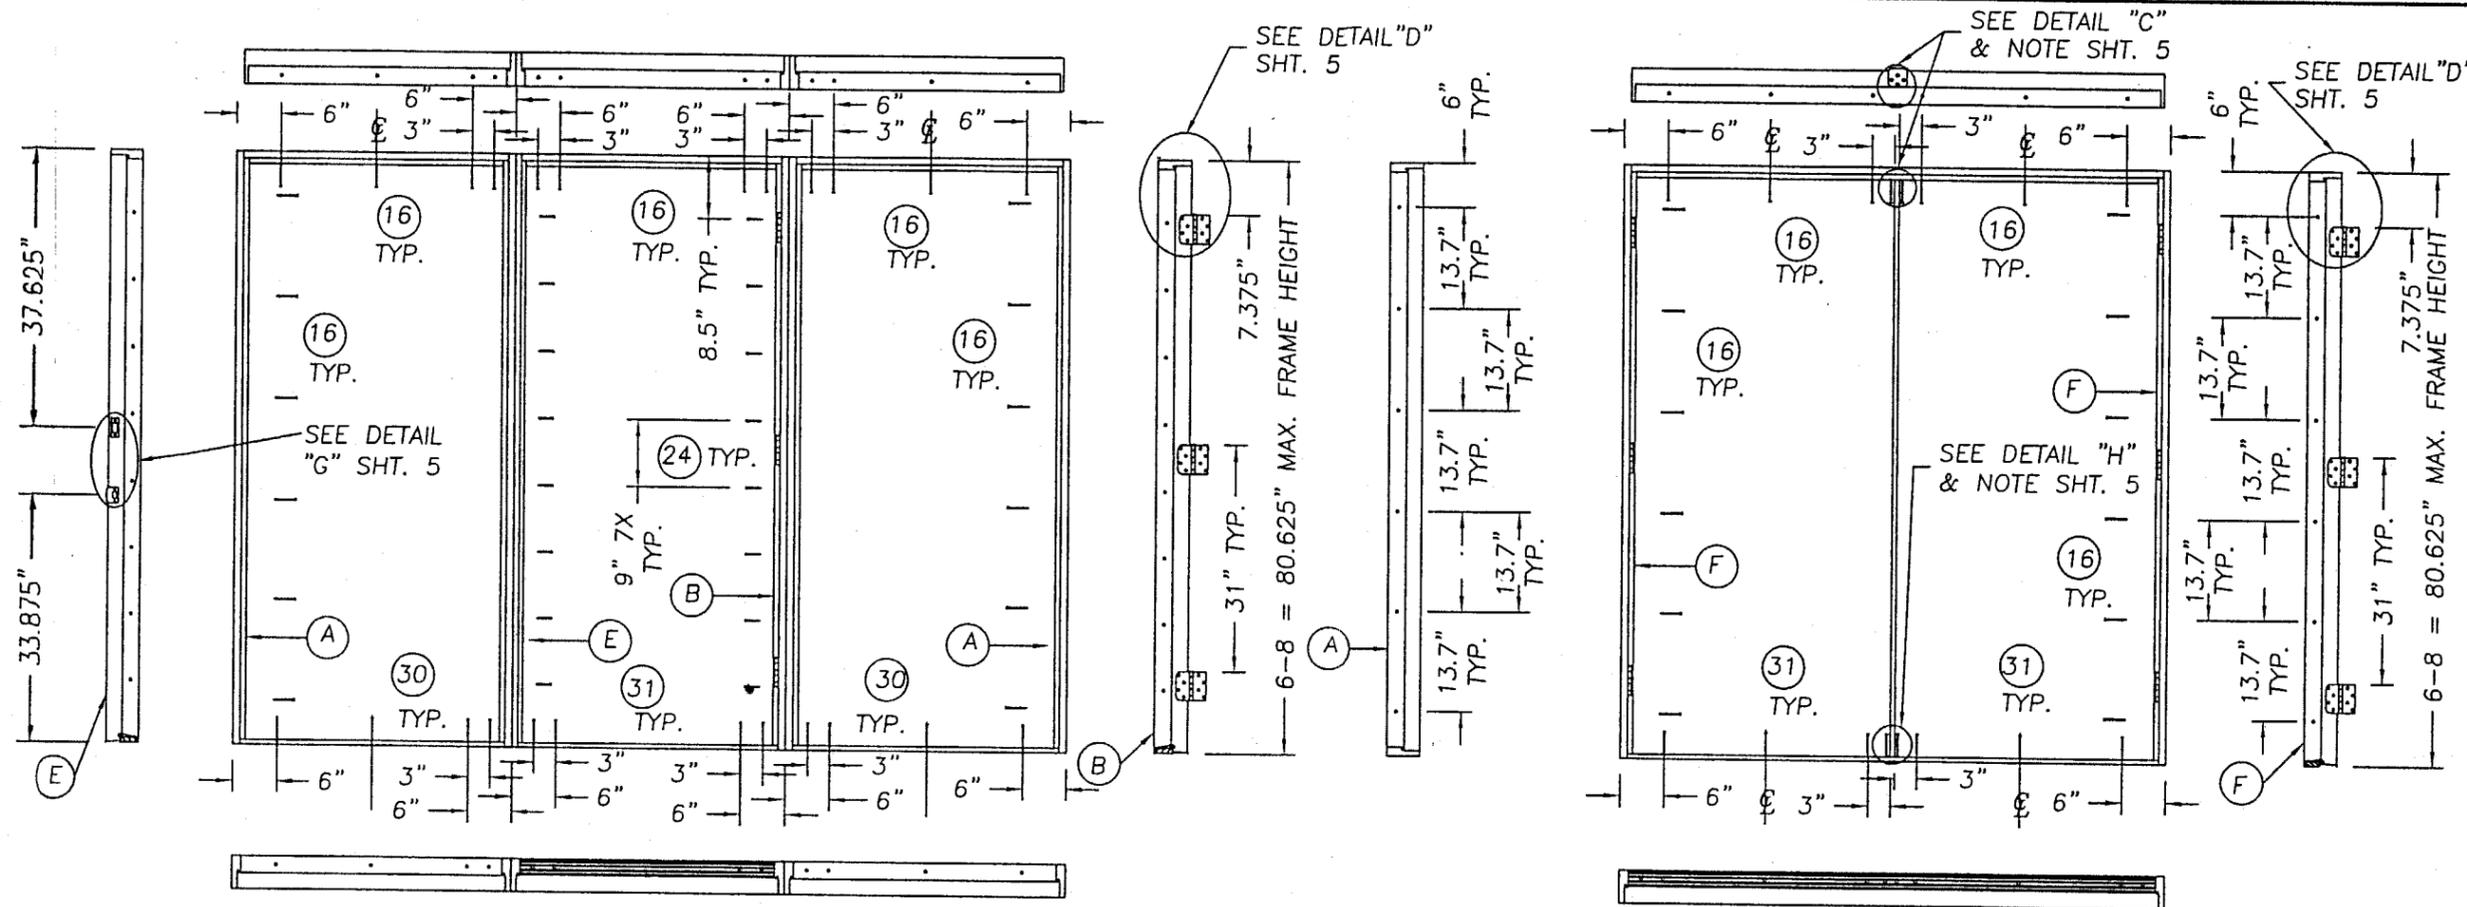

DOOR PANELS NOT SHOWN FOR CLARITY OF ANCHORING LAYOUTS

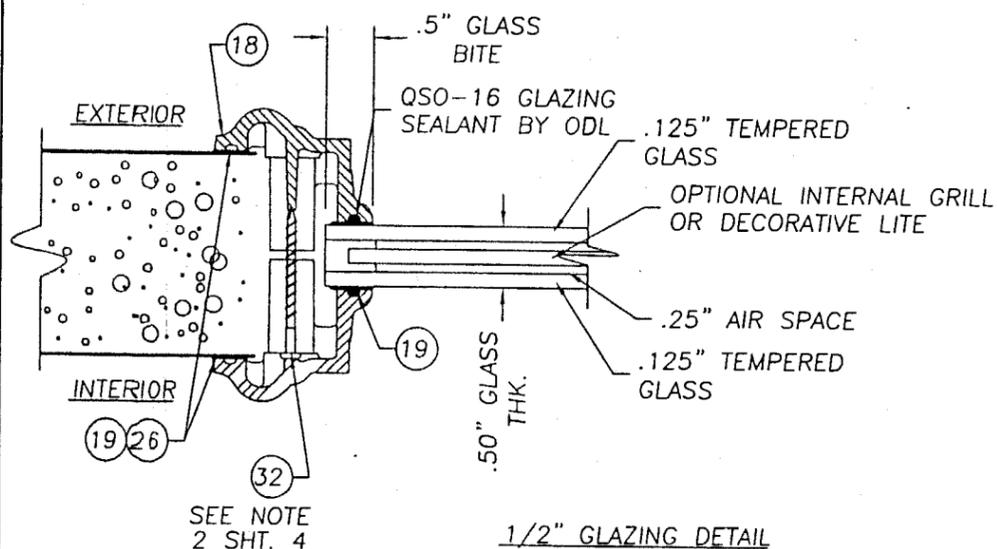

1/2" GLAZING DETAIL

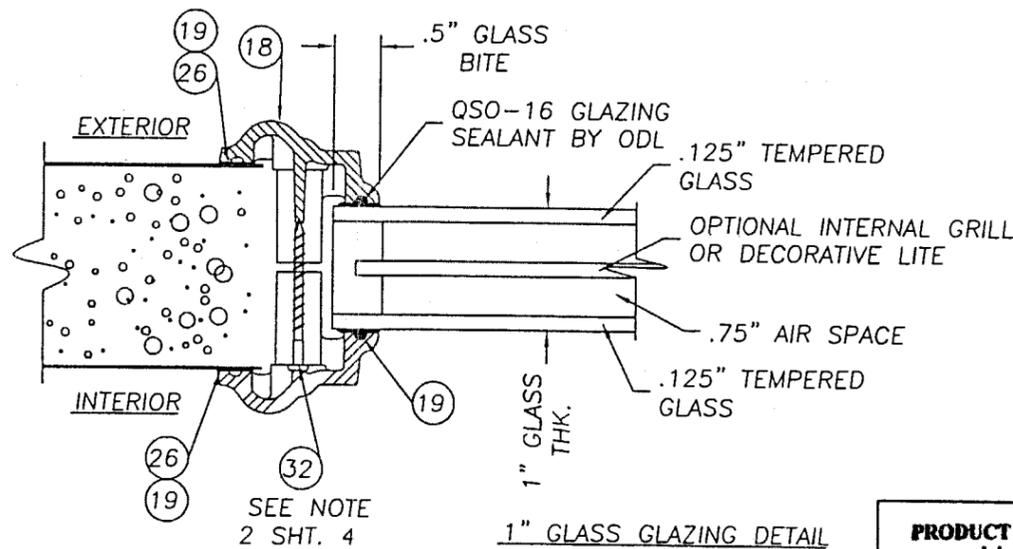

1" GLASS GLAZING DETAIL

NOTE: GLASS LITE FRAME SURROUNDS
ODL Spartech Polycom PP5530 C13
Trinity GE ASA Polycarbonate

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 03-061108
Expiration Date 11/01/03
By: *Cherise Bowman*
Miami Dade Product Control
Division


STANLEY
STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470

PRODUCT:
STANLEY OUTSWING OPAQUE
11-4 x 6-8 STEEL EDGE
DOOR W/ & W/O SIDELITES
PART OR ASSEMBLY:
ANCHORING LAYOUTS, DOOR
MODELS & GLAZING DETAILS


NO.	DATE	REVISIONS	BY
2	7/21/03	REVISED GENERAL NOTES	RW
1	5/28/03	REVISED BILL OF MATERIALS	TJH

RW BUILDING
CONSULTANTS, INC.
813.659.9197


DATE: 12/26/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: 43967
SHEET 6 OF 7

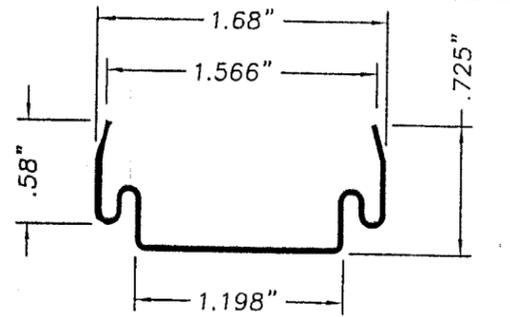


DOOR PANEL STEEL EDGE CAP
TOP, BOTTOM & SIDE .028" THK. STEEL

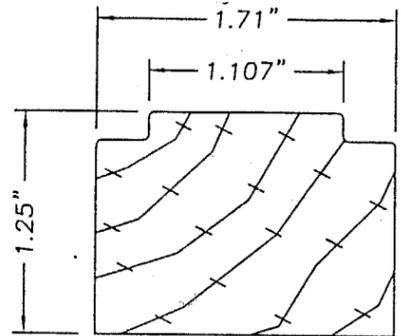


WOOD SIDELITE SIDE STYLE

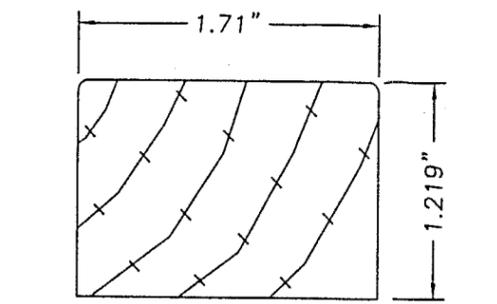


SIDELITE TOP & BOTTOM WOOD STYLE

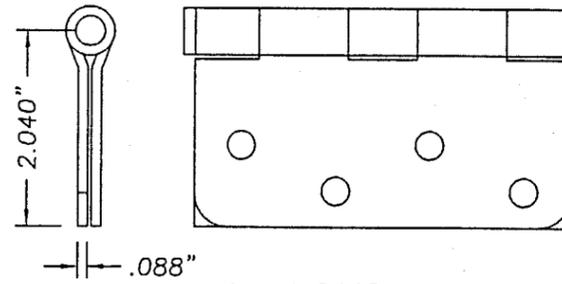


4 x 4 DOOR HINGE

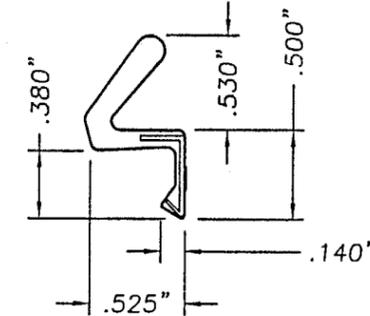


HOLM INDUSTRIES JF65

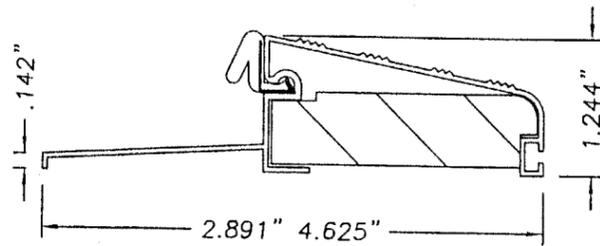

OUTSWING BUMP FACE
ALUMINUM THRESHOLD
.045" WALL THK.

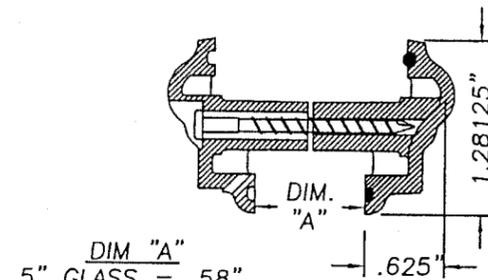


DIM "A"
.5" GLASS = .58"
1" GLASS = 1.08"
ODL Spartech Polycrom PP5530 C13
Trinity GE ASA Polycarbonate Lite Frame

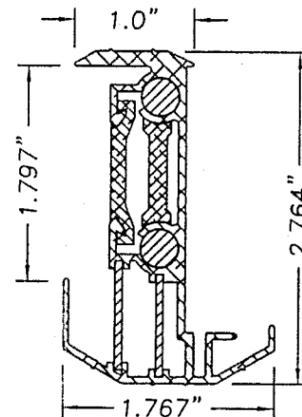


ASTRAGAL HAS
(2) 8 1/4" L.
BOLTS @ BOTTOM
& (2) 17 3/4" L.
BOLTS @ TOP


ASTRAGAL WINDJAMBER II
(WR68S) T-6063 EXTRUDED ALUMINUM

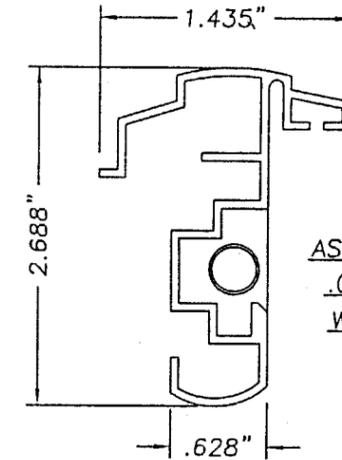


OPTIONAL
ASTRAGAL (IMPERIAL)
.075" WALL ALUM.
W/(2) 12" BOLTS

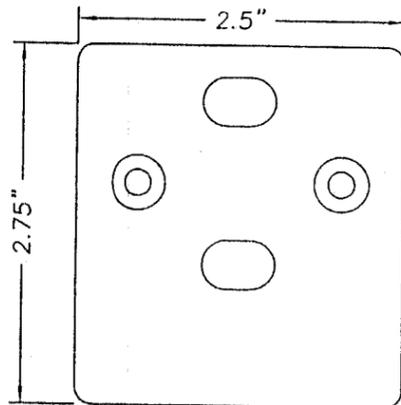


ASTRAGAL THRESHOLD STRIKE PLATE
WR68S .50" ALUM.

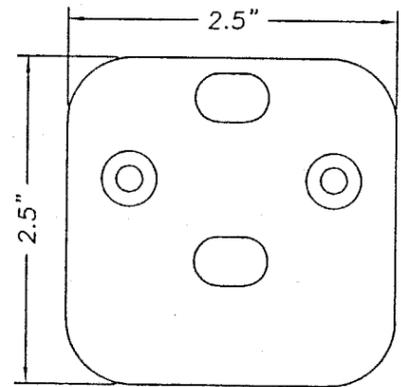


ASTRAGAL HEADER STRIKE PLATE
WR68S .066" STEEL




HOLMES COMPRESSION WEATHERSTRIP

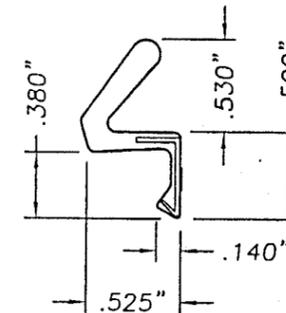


SCHLEGEL Q-LON QDS650

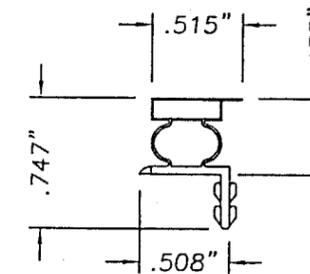

HOLMES MAGNETIC WEATHERSTRIP

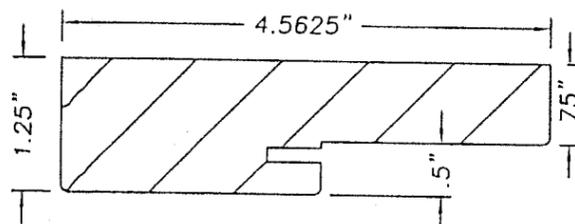

WOOD FRAME

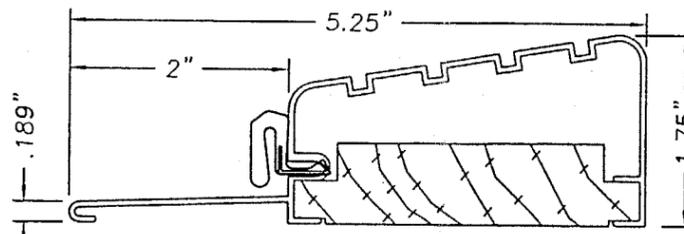

HIGH DAM THRESHOLD
BY IMPERIAL

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 03-0611.08
Expiration Date 11/01/06
By *Cleodore Keenan*
Miami Dade Product Control
Division

STANLEY

STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470

PRODUCT:
STANLEY OUTSWING OPAQUE
11-4 x 6-8 STEEL EDGE
DOOR W/ & W/O SIDELITES
PART OR ASSEMBLY:

UNIT COMPONENTS

NO.	DATE	REVISIONS	BY
2	7/21/03	REVISED GENERAL NOTES	RW
1	5/28/03	REVISED BILL OF MATERIALS	TJH

RW BUILDING
CONSULTANTS, INC.
813.659.9197

DATE: 12/26/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.:
43967
SHEET 7 OF 7