



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Stanley Door Systems
7300 Reams Rd.
Charlotte, NC 28216**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Outswing W/E 6'8" Opaque Insulated Steel Door w/wo Non-Impact Sidelites

APPROVAL DOCUMENT: Drawing No. **39639**, titled "Stanley Outswing Opaque 11-4 x 6-8 Woodedge Door-W/ & W/O Sidelites", sheets 1 through 7 of 7, dated 6/5/00 with revision #5 dated 8/20/03, prepared by R.W. Building Consultants, Inc., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # **01-0928.07** and consists of this page 1 and evidence pages E-1 thru E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No 03-0612.08
Expiration Date: November 01, 2006
Approval Date: October 02, 2003
Page 1**

Stanley Door Systems

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
1. Drawing No. **39639**, titled "Stanley Outswing Opaque 11-4 x 6-8 Woodedge Door-W/ & W/O Sidelites", sheets 1 through 7 of 7, dated 6/5/00 with revision #5 dated 8/20/03, prepared by R.W. Building Consultants, Inc.

B. TESTS


1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Small Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with manufacturer's installation, parts and section drawings marked up by Certified Testing Laboratories, Test Report No. **CTLA 1045-W**, dated 2/17/03, all signed and sealed by Ramesh C. Patel, P. E.

(Submitted under NOA # 01-0226.03)

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
along with manufacturer's installation, parts and section drawings marked up by Certified Testing Laboratories, Test Report No. **CTL 545W** dated 06-06-99, with addendum letter dated 11/17/00, all signed and sealed by Ramesh C. Patel, P. E.

C. CALCULATIONS

1. Anchor Calculations and structural analysis dated 3/7/03, prepared by R.W. Building Consultants, Inc., signed and sealed by Lyndon Schmidt, P.E.
(Submitted under NOA # 01-0226.03)
1. Anchor Calculations and structural analysis dated 07-21-00, prepared, signed and sealed by Mark C. Fetherman, P.E.

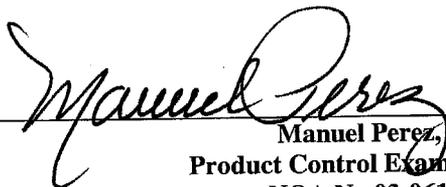
Manuel Perez, P.E.
Product Control Examiner
NOA No 03-0612.08

Expiration Date: November 01, 2006
Approval Date: October 02, 2003

Stanley Door Systems

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

D. MATERIAL CERTIFICATIONS

(Submitted under NOA # 01-0226.03)

1. Photocopy of **4500 Hours Xenon Arch** tensile test report No. **ETC-00-417-10343.0** dated 09-11-01, issued by ETC laboratories Inc. for **GE ASA Polycarbonate plastic**, controlled & **4500 Hours xenon Arch** exposed samples to Stanley Doors, tested per ASTM D-63896a, signed and sealed by Joseph L. Donald. **(original test report in file #01-0928.07)**
2. Photo copy Test report No. **ETC-00-417-10343.0** dated 03-07-01, issued by ETC laboratories Inc. for **GE ASA Polycarbonate plastic** to Stanley Door for "self ignition" per ASTM 1929D, and for "Rate of Burning" per ASTM D635-97 and for "Smoke density" per ASTM D-2843-93, all the test reports for **GE ASA Polycarbonate plastic** (original test report pending from manufacturer)
Photocopy **4500 Hours Xenon Arch** completed tensile test report No. **PRI00034** dated December 14, 2000, issued by PRI Asphalt Technologies to **ODL for Spartech Polycom PP5530-C13, 4500 Hours Xenon Arch** exposed samples, tested per ASTM D-63896a, signed and sealed by Charles L. Thomas, P. E. (original test report pending from manufacturer)
3. Photo copy Test reports No. 15977-104313 (**Infinity**) & 15977-104314 (**Retro**) for "Surface burning characteristics" per ASTM E-84, both dated 12-23,1998, and test report No. ETC-98-417-7209.O (**Infinity**) & test report No. ETC-98-417-7208.O (**Retro**) "self ignition temperature" per ASTM D1929-96 both dated 1-11-99 for BASF polyurethane cores, issued by Omega Point Laboratories (original in file #98-1104.03).
4. Test Report No. **114884-3** "Measuring the Density of Smoke from the Burning or Decomposition of Plastics" per ASTM D-2843-93", dated 11/24/98, all the test reports for ODL Spartech 1643.05 Filled Polypropylene Fiberglass & Mica samples (ODLI-2), issued by **SGS U.S. Testing Co. Inc.** signed and sealed by Joseph G. Cappetta, P.E.
5. Test report No. **MTS Job No. 520490** dated December 8, 1999 per ASTM D638-96a "Standard Methods for Tensile Properties of Plastics", issued by Celotex Corporation Testing Services.

E. QUALITY ASSURANCE

1. Miami-Dade County Building Code Compliance Office.



Manuel Perez, P.E.
Product Control Examiner
NOA No 03-0612.08

Expiration Date: November 01, 2006
Approval Date: October 02, 2003

Stanley Door Systems

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS

1. Statement letter of no financial interest, dated 3/2/03, signed by Daniel Carlson.
2. Statement letter of conformance no financial, dated 3/7/03, signed and sealed by Lyndon Schmidt, P.E.

F. OTHER

1. Letter from the consultant stating that the product is in compliance with Florida Building Code (FBC).
2. Notice of Acceptance No. **01-0928.07**, issued to Stanley Door Systems for their "Sta-Tru" W/E 6'8" Out-swing Res. Ins. Steel Door-Impact w/wo Non-impact Sidelites, approved on 11/01/01 and expiring on 11/01/06.



Manuel Perez, P.E.
Product Control Examiner
NOA No 03-0612.08
Expiration Date: November 01, 2006
Approval Date: October 02, 2003

STANLEY DOOR SYSTEMS

OUTSWING 6-8 OPAQUE STEEL DOOR
W/AND W/OUT SIDELITES IN A WOOD FRAME

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. THIS SYSTEM REQUIRES WINDBORNE DEBRIS EXTERNAL PROTECTIONS AS PRESCRIBED IN "HVHZ" OF THE FLORIDA BUILDING CODE FOR SIDELITES ONLY.
5. DESIGNED PRESSURE RATING SEE TABLES PAGE 1.
6. SIDELITES ARE AN OPTION AND CAN BE IN A SINGLE OR DOUBLE DOOR CONFIGURATION.
7. THIS PRODUCT MEETS THE WATER REQUIREMENTS FOR THE "HIGH VELOCITY HURRICANE ZONES" WITH THE USE OF THE HIGH DAM THRESHOLD.

RESIDENTIAL INSULATED STEEL DOOR (Common to all frame conditions)

Door Panel & Sidelite Construction:

Face sheets: 26 GA.(0.018") minimum thickness, Galvanized steel A-525 commercial quality - AKDQ per ASTM 620 with yield strength $F_y(\text{min.})=46,765$ psi (flush panels) with yield strength $F_y(\text{min.})=40,000$ psi (embossed panels)
Core design: Polyurethane foam core, with 1.7 lbs. density by BASF.

Door Panel Construction: Flush or embossed type. The vertical edges of the skin are flush and glued to the top and bottom rails. The horizontal edges of the panel skin are roll formed over the finger jointed hinge stile and LVL latch stile to form a mechanical lock.



Sidelite Panel Construction: The vertical edges of the skin are flush and glued to the top and bottom finger jointed pine stiles. The horizontal edges of the panel skin are roll formed over the finger jointed side stiles to form a mechanical lock. Panels are sandwich glazed using a two piece plastics lite frame with mitered & welded corners.

TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	COMMON (GENERAL NOTES, TYPICAL ELEVATION)
2	VERTICAL CROSS SECTIONS & BILL OF MATERIALS
3	HORIZONTAL CROSS SECTIONS
4	HORIZONTAL CROSS SECTIONS
5	ANCHORING LOCATIONS & DETAILS
6	ANCHORING LOCATIONS & GLAZING DETAIL
7	FRAME COMPONENTS

DESIGN PRESSURE RATING

UNIT TYPE	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED	
SINGLE	+60.0	-60.0 PSF
SINGLE W/SIDELITES	+50.0	-50.0 PSF
DOUBLE	+50.0 -44.0 PSF W/IMPERIAL AST.	+55.0 -60.0 PSF W/WINDJAMBER II AST.
DOUBLE W/SIDELITES	+50.0 -44.0 PSF W/IMPERIAL AST.	+50.0 -50.0 PSF W/WINDJAMBER II AST.

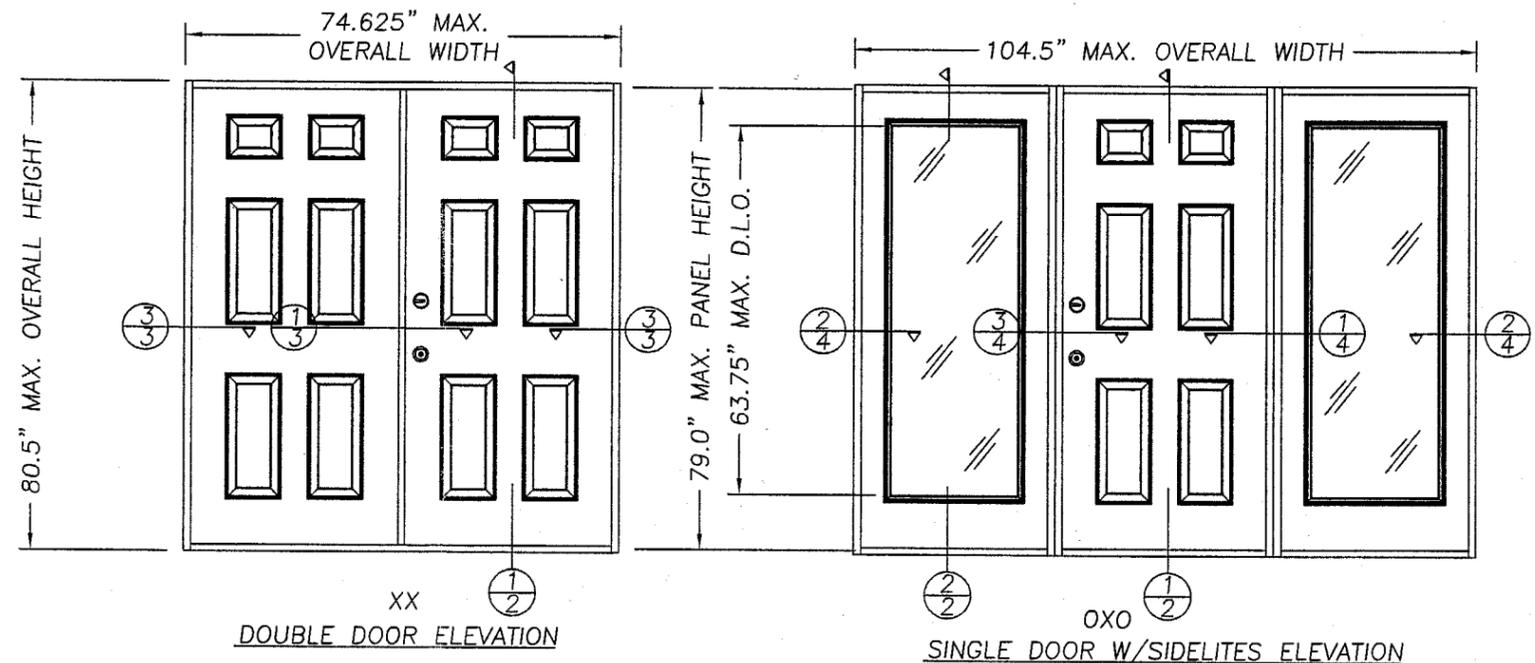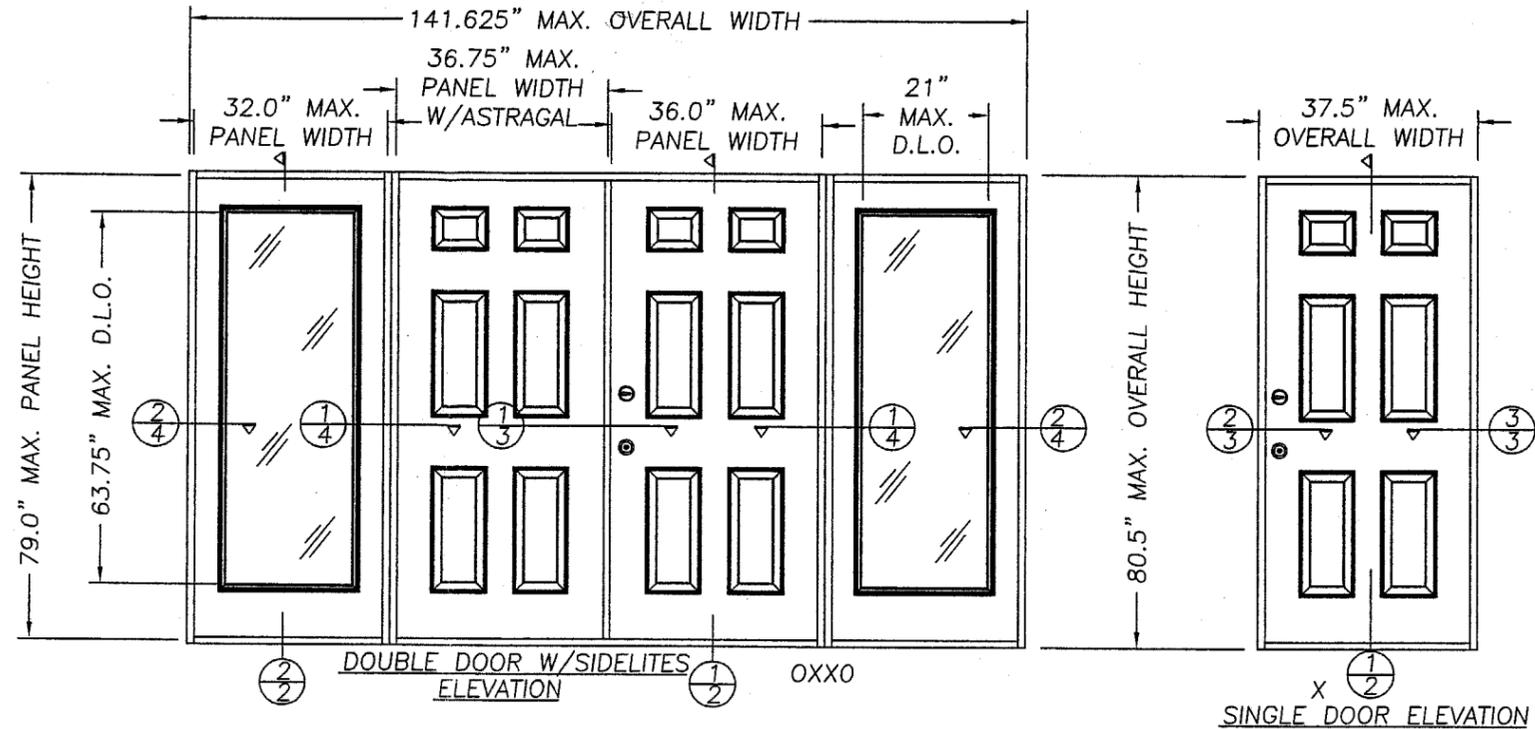

ALL DOOR MODELS ARE VIEWED
FROM THE INTERIOR SIDE
(OUTSWING DOORS)

STANLEY

STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470

PRODUCT: STANLEY OUTSWING OPAQUE
11-4 x 6-8 WOODEDGE
DOOR W/ & W/O SIDELITES

PART OR ASSEMBLY:

ELEVATIONS AND
GENERAL NOTES


NO.	DATE	GENERAL	BY	REVISIONS
5	8/20/03	PER DADE COMMENTS	RW	
4	5/29/03	REVISED BILL OF MATERIALS	TJH	
3	3/10/01	CORRECT B.O.M.	RW	
2	1/12/01	ADD ASA MATERIAL	RW	
1	12/20/00	GENERAL	RW	

RW BUILDING
CONSULTANTS, INC.
813.659.9197


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 03-0612.08
Expiration Date NOV. 1, 2006
By *Maurice Perry*
Miami Dade Product Control
Division

DATE: 6/5/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.:
39639
SHEET 1 of 7

ITEM	DESCRIPTION	MATERIAL
1	DOORSKIN 26ga. (.018" MIN. STEEL)	STEEL
2	WOOD LOCK BLOCK, DOOR PANEL 2.843" x 12" x 1.70"	PINE
3	#10 X 2" PFH WOOD SCREW	STEEL
4	WOOD, TOP RAIL & HINGE STILE BY STANLEY	PINE
5	WOOD, "LVL" LATCH STILE BY STANLEY	LVL
6	1.69" x 1.03" x 34" EXTRUDED COMPOSITE PLASTIC BOTTOM RAIL BY STANLEY	COMPOSITE
7	HINGES 4" X 4" X .088 WT. (STANLEY)	STEEL
8	DOOR BOTTOM SWEEP	VINYL
9	COMPRESSION WEATHERSTRIP (SCHLEGAL QDS 650)	FOAM
10	SIDELITE TOP & BOTTOM RAIL (PONDEROSA PINE)	PINE
11	SIDELITE BLANK JAMB (PONDEROSA PINE)	PINE
12	HEAD JAMB (PONDEROSA PINE)	PINE
13	HINGE JAMB (PONDEROSA PINE)	PINE
14	LATCH JAMB (PONDEROSA PINE)	PINE
15	POLYURETHANE FOAM CORE (BASF) TYPE A. INFINITY: RESIN (P14120R) ISOCYANATE (P1001), CYCLOPENTANE. TYPE B. RETRO: RESIN (P12430R), ISOCYANATE (P1036).	
16	#8 x 2 1/2" PFH WS	STEEL
17	1/4" SHIM MATERIAL	WOOD
18	LITE FRAME (ODL Spartech Polycorn PP5530 C13)	POLYPROP.
19	LITE FRAME (Trinity GE ASA Polycarbonate) (SEE GLAZING DETAILS SHEET 6 OF 7)	ASA
20	GLAZING COMPOUND SILICONE CAULK (GE WINDOW & DOOR)	SILICONE
21	KWIKSET 660 DEADBOLT	-
22	KWIKSET SERIES 200 DL PASSAGE	-
23	#8 x 2" PFH WOOD SCREW	STEEL
25	MASONRY	CONCRETE
26	GLAZING TAPE (VENTURE TAPE .30" W. x .037" THK.)	FOAM
27	#9 x 1.00 F.H. WD SCREWS	STEEL
28	#8 x 2" P. H. WD SCREWS	STEEL
29	BUMP THRESHOLD (WORLD WIDE)	ALUMINUM
30	3/16" TAPCON (ITW) OR 3/16" (ELCO) 2 1/2" LG.	STEEL
31	3/16" TAPCON (ITW) OR 3/16" (ELCO) 2 1/4" LG.	STEEL
32	#8-1 1/4" TEK SCREW (LITE FRAME SCREW)	STEEL
33	GLAZING STOP QUARTER ROUND (1/2" x 1/2")	PINE
34	BRAD TRIM NAIL 2" LG.	STEEL
35	2X BUCK	WOOD
36	OPTIONAL EXTRUDED ALUMINUM ASTRAGAL (IMPERIAL)	ALUM.
37	1.68"X1.22" BLANK STILE (PONDEROSA PINE)	PINE
38	ASTRAGAL EXTRUDED ALUM. (WR68S WINDJAMBER II)	ALUM.
39	COMPRESSION WEATHERSTRIP (HOLM IND. JF65)	FOAM
40	HIGH DAM BUMP THRESHOLD BY IMPERIAL (.051" MIN.)	ALUM.
41	SCHLAGE B260 E-BOLT DEADBOLT	-
42	SCHLAGE B360 DEADBOLT	-
43	SCHLAGE F-10 PASSAGE KNOB	-
44	1/2" & 1" TRINITY/AMPAC GLASS	-

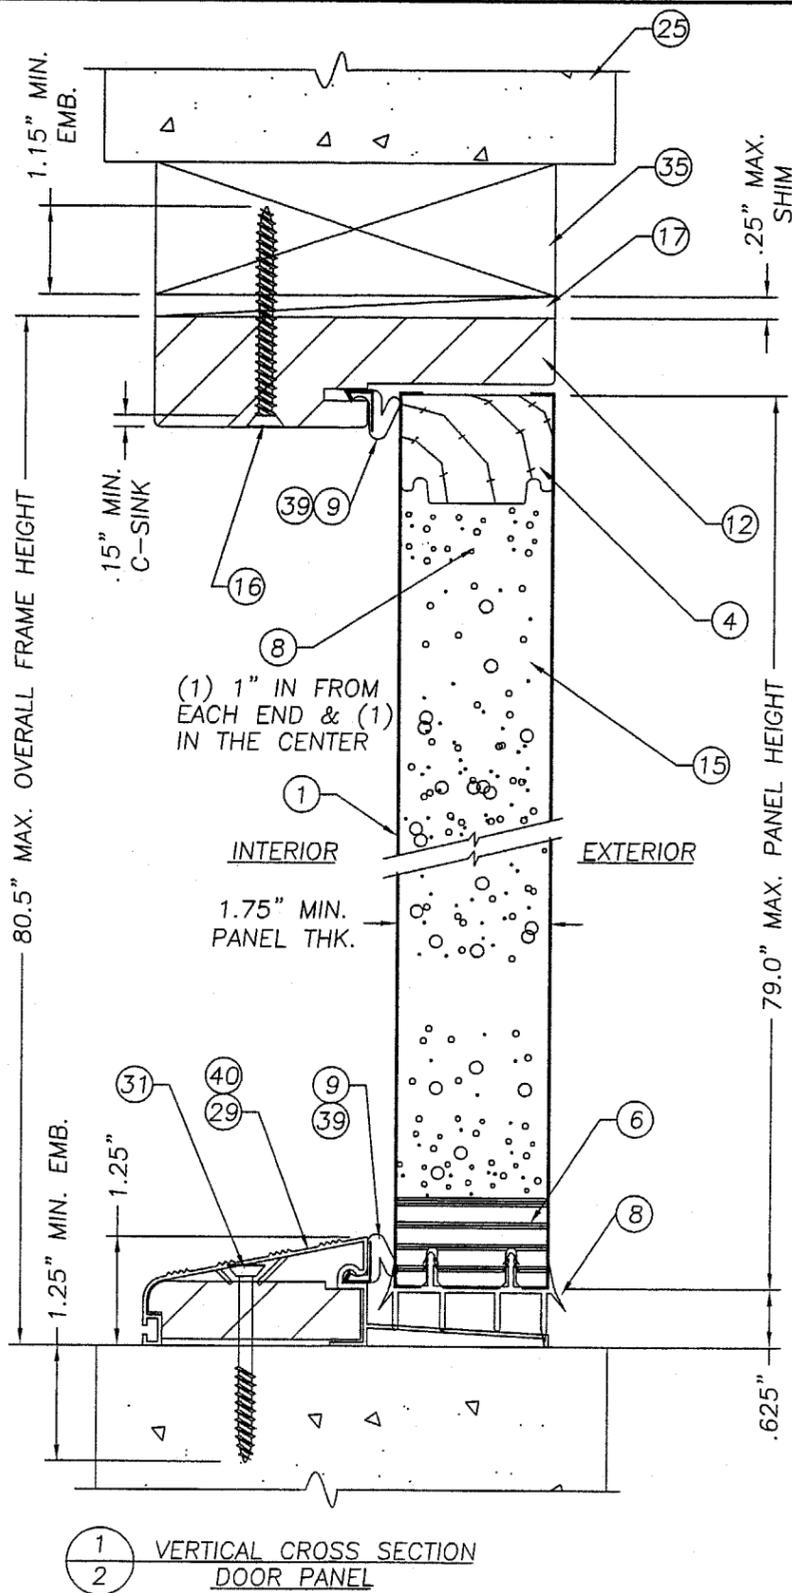

NOTE: SPACING FOR ITEM #32; TOP & BOTTOM (1) 3 1/2" IN FROM CORNERS & (1) IN THE CENTER. SIDES; (6) SCREWS 3 1/4", 13 3/4", 26 1/2", 39 3/8", 52" & 62 5/8".

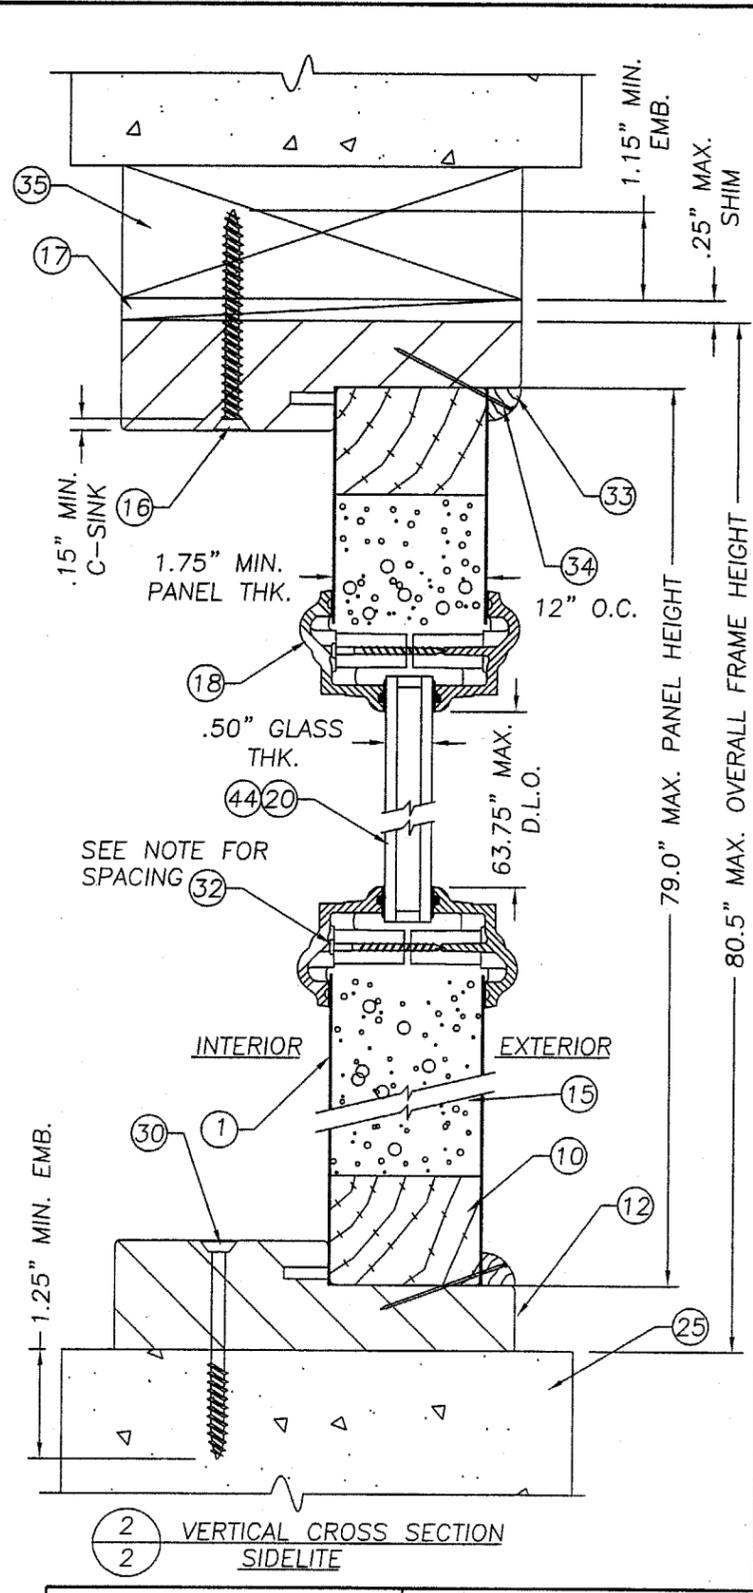

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 03-0612.08 Expiration Date NOV. 1, 2006
By *Manuel Soto* Miami Dade Product Control Division


DATE: 6/5/00
SCALE: 1/2"=1"
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: 39639
SHEET 2 OF 7

STANLEY
STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470


PRODUCT: STANLEY OUTSWING OPAQUE 11-4 x 6-8 WOODENGE DOOR W/W/O SIDELITES
PART OR ASSEMBLY: VERTICAL CROSS SECTIONS & BILL OF MATERIALS

NO	DATE	REVISIONS
5	8/20/03	PER DADP COMMENTS
4	5/29/03	REVISED BILL OF MATERIALS
3	3/10/01	CORRECT B.O.M.
2	1/12/01	ADD ASA MATERIAL
1	12/20/00	GENERAL


RW BUILDING CONSULTANTS, INC.
813.659.9197

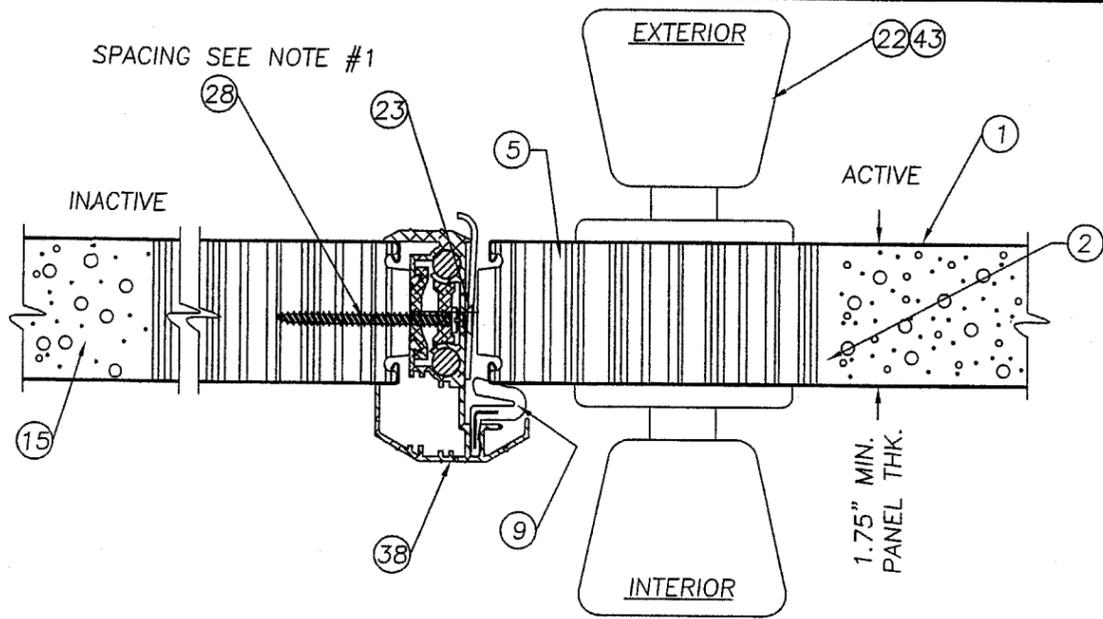

1 HORIZONTAL CROSS SECTION
3 AT ASTRAGAL, TYP. (W/ITEM #38 WR68S)

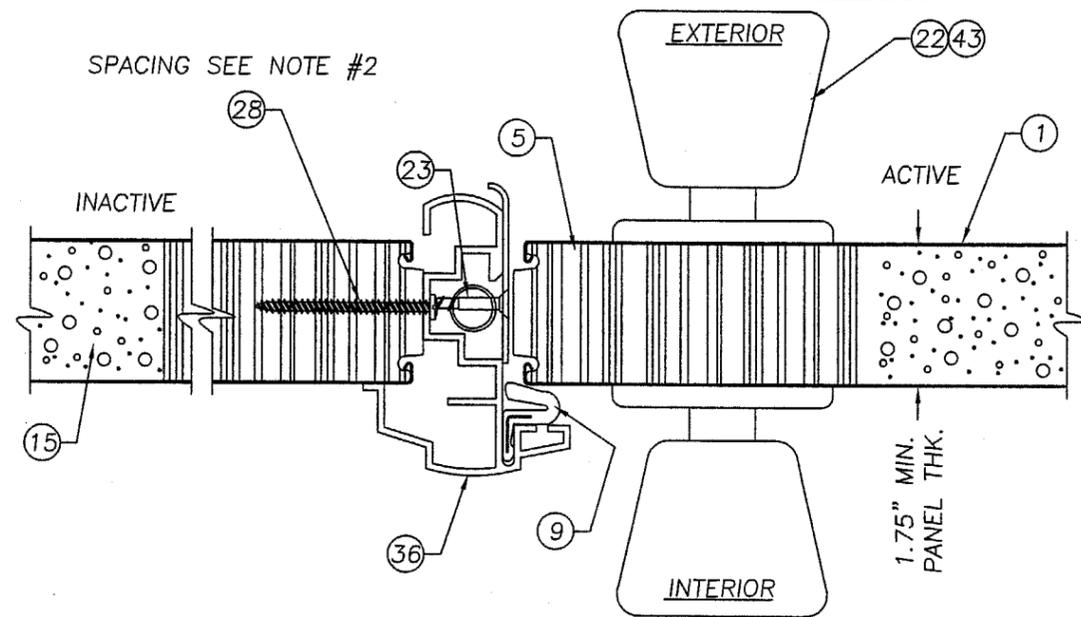


1 OPTIONAL HORIZONTAL CROSS SECTION
3 AT ASTRAGAL, TYP. (W/ITEM #36 IMPERIAL)

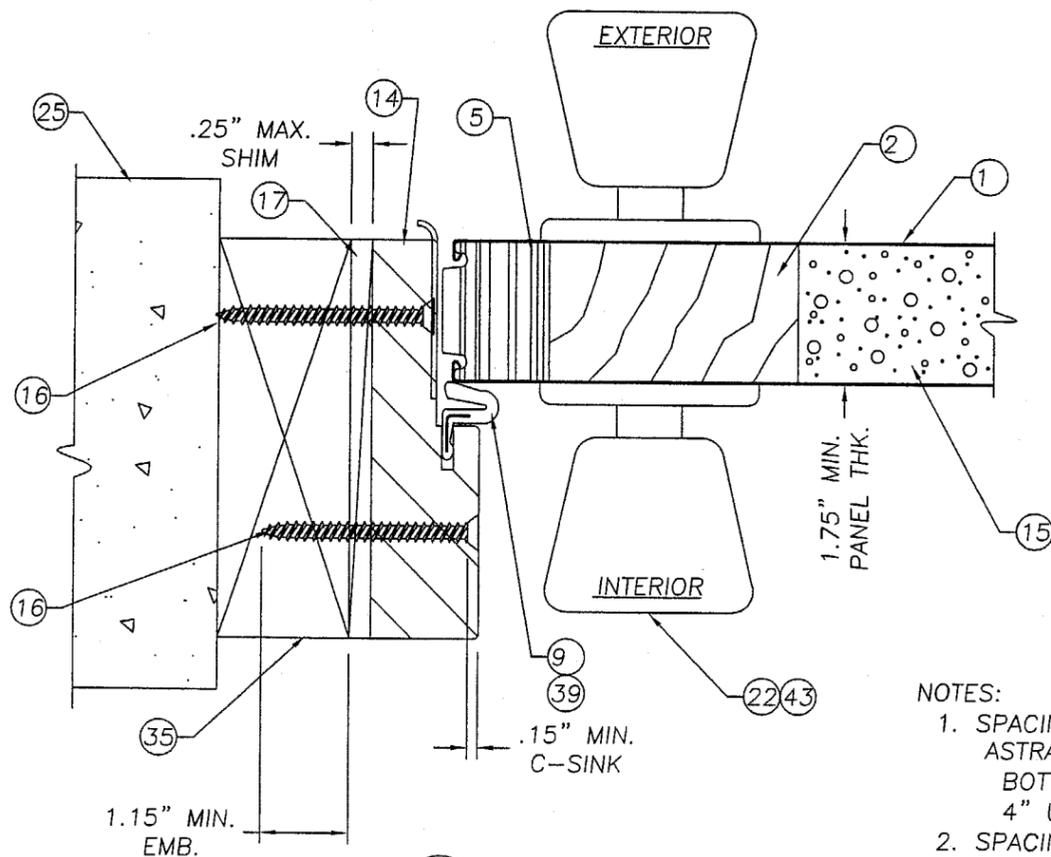

2 HORIZONTAL CROSS SECTION
3 AT LATCH JAMB TO BUCK, TYP.

NOTES:

1. SPACING FOR ITEM #28 ON THE WR68S ASTRAGAL IS AS FOLLOWS: TOP DOWN & BOTTOM UP; 1", 3", 5", 26", & (1) 4" UP FROM THE STRIKE.
2. SPACING FOR ITEM #28 ON THE IMPERIAL ASTRAGAL IS AS FOLLOWS: TOP DOWN & BOTTOM UP; 1", 2 1/2", 4", 5 1/2", 13", 18" & 26".

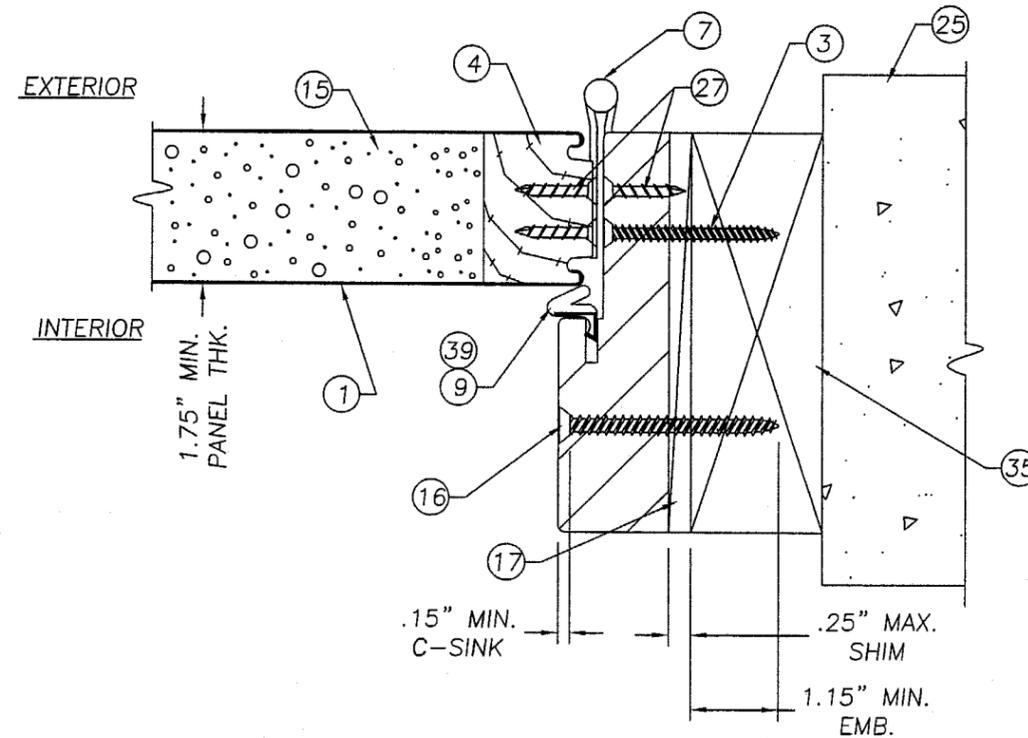

3 HORIZONTAL CROSS SECTION
3 AT HINGE JAMB TO BUCK, TYP.

STANLEY
STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470

PRODUCT:
STANLEY OUTSWING OPAQUE
11-4 x 6-8 WOODEDGE
DOOR W/ & W/O SIDELITES
PART OR ASSEMBLY:




HORIZONTAL
CROSS SECTIONS

NO	DATE	GENERAL	BY	REVISIONS
5	8/20/03	PER DADE COMMENTS	RW	
4	5/29/03	REVISED BILL OF MATERIALS	TJH	
3	3/10/01	CORRECT B.O.M.	RW	
2	1/12/01	ADD ASA MATERIAL	RW	
1	12/20/00	GENERAL	RW	


RW BUILDING
CONSULTANTS, INC.
813.659.9197

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 03-0612-08
Expiration Date NOV 1 2006
By *Manuel Perez*
Miami Dade Product Control
Division


DATE: 6/5/00
SCALE: 1/2" = 1"
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: 39639
SHEET 3 OF 7

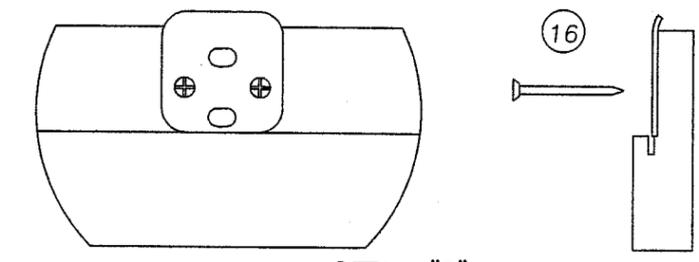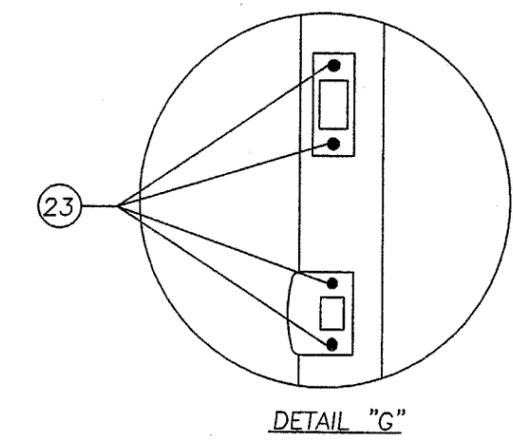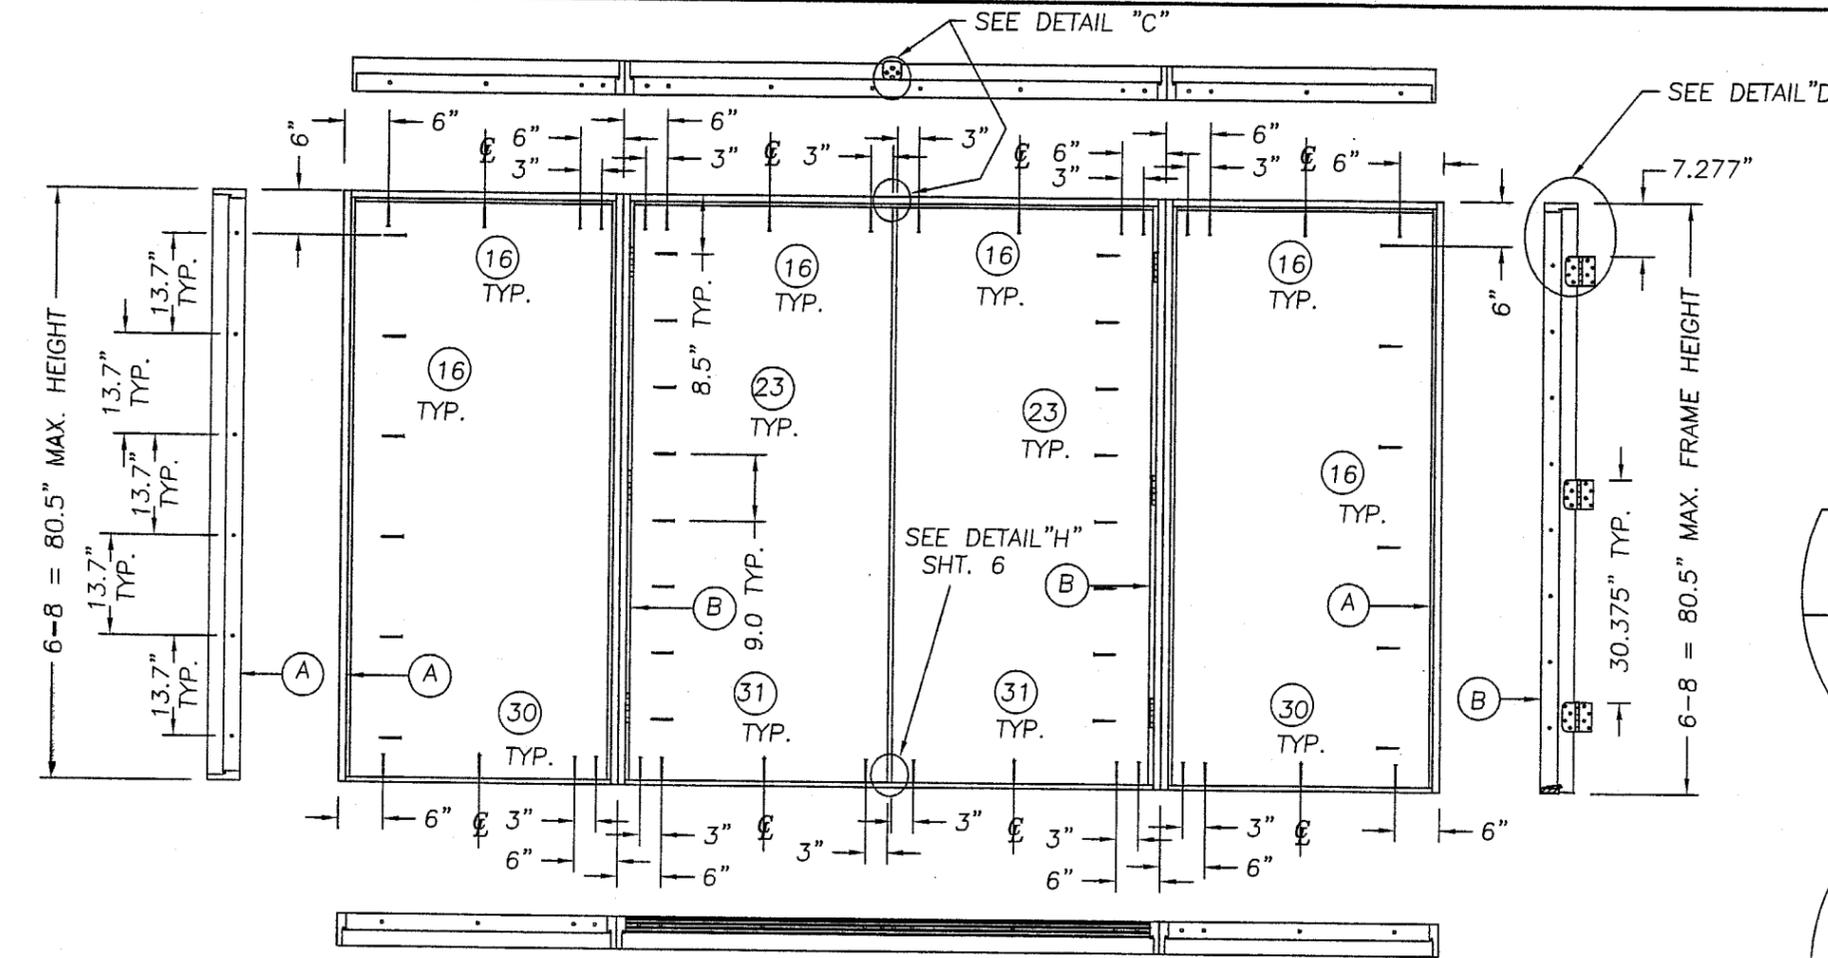


DETAIL "C"
ATTACH WR68S ASTRAGAL THROW BOLT STRIKE PLATE TO FRAME AS SHOWN.

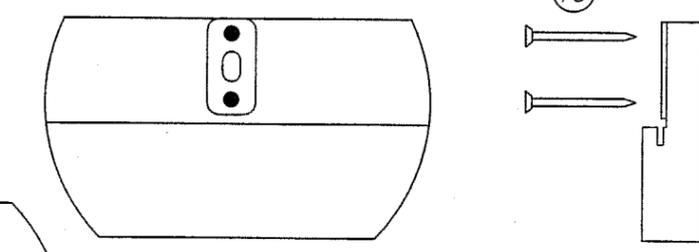


DETAIL "C"
ATTACH IMPERIAL ASTRAGAL THROW BOLT STRIKE PLATE TO FRAME AS SHOWN.

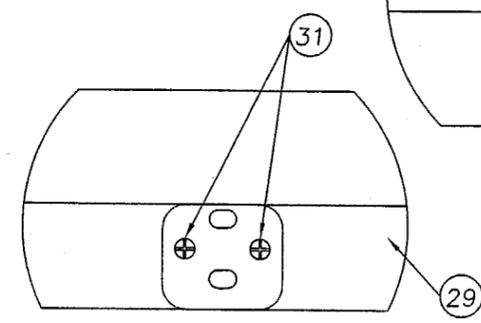


DETAIL "H"
ATTACH WR68S ASTRAGAL THROW BOLT STRIKE PLATE TO THRESHOLD AS SHOWN.

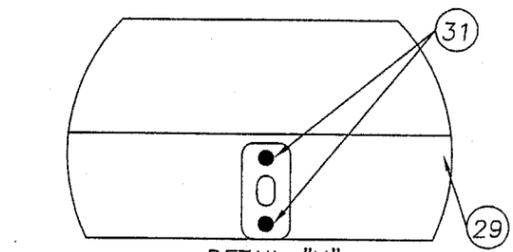

DETAIL "H"
ATTACH IMPERIAL ASTRAGAL THROW BOLT STRIKE PLATE TO THRESHOLD AS SHOWN

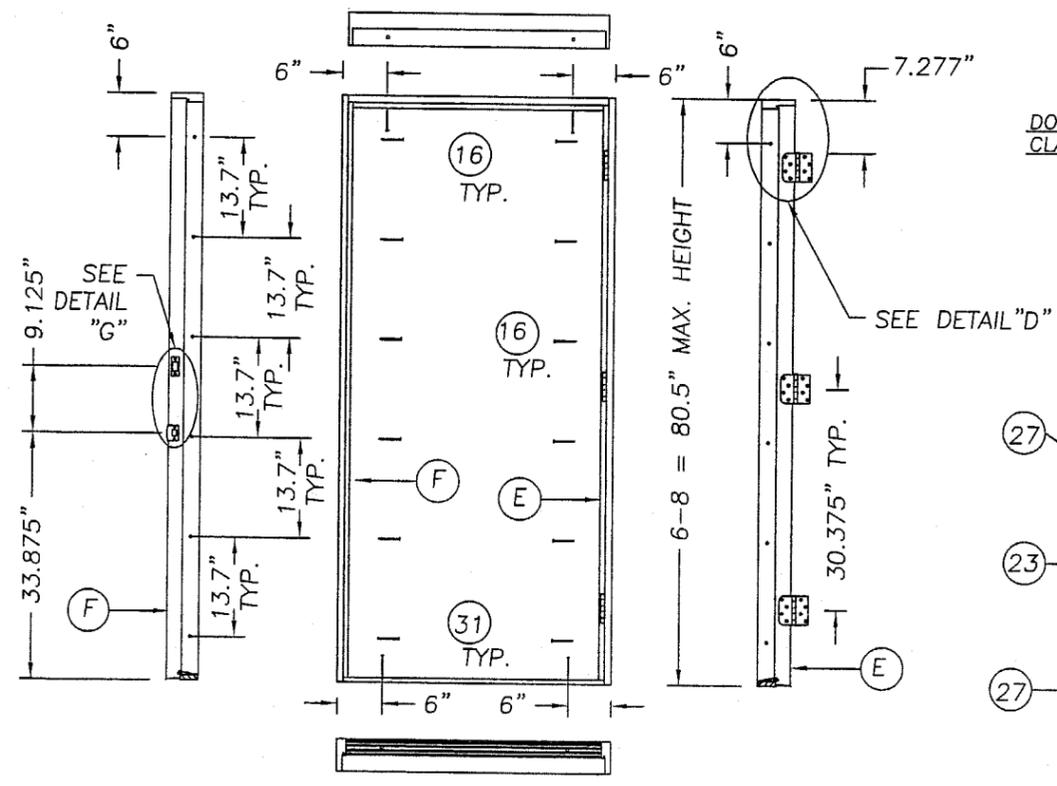

DOOR PANELS NOT SHOWN FOR CLARITY OF ANCHORING LOCATIONS

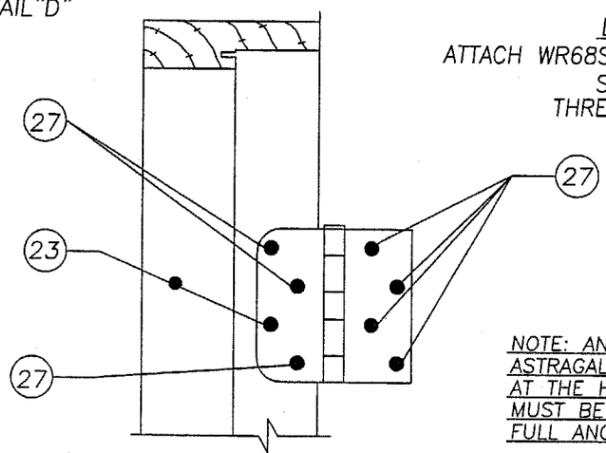

DETAIL "D"
HINGE DETAIL

NOTE: ANCHORING ASTRAGAL STRIKE PLATE SCREWS AT THE HEADER & THRESHOLD MUST BE USED TO ACHIEVE FULL ANCHORING LOAD.

STANLEY
STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470


PRODUCT:
STANLEY OUTSWING OPAQUE
11-4 x 6-8 WOODEDGE
DOOR W/ & W/O SIDELITES
PART OR ASSEMBLY:
ANCHORING LAYOUTS
& DETAILS

NO.	DATE	REVISIONS	BY
5	8/20/03	PER DADE COMMENTS	RW
4	5/29/03	REVISED BILL OF MATERIALS	TJH
3	3/10/01	CORRECT B.O.M.	RW
2	1/12/01	ADD ASA MATERIAL	RW
1	12/20/00	GENERAL	RW


RW BUILDING
CONSULTANTS, INC.
813.659.9197

DATE: 6/5/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: 39639
SHEET 5 OF 7


PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 03-0612.08 Expiration Date NOV. 1, 2006
By *Manuel Perez*
Miami Dade Product Control Division

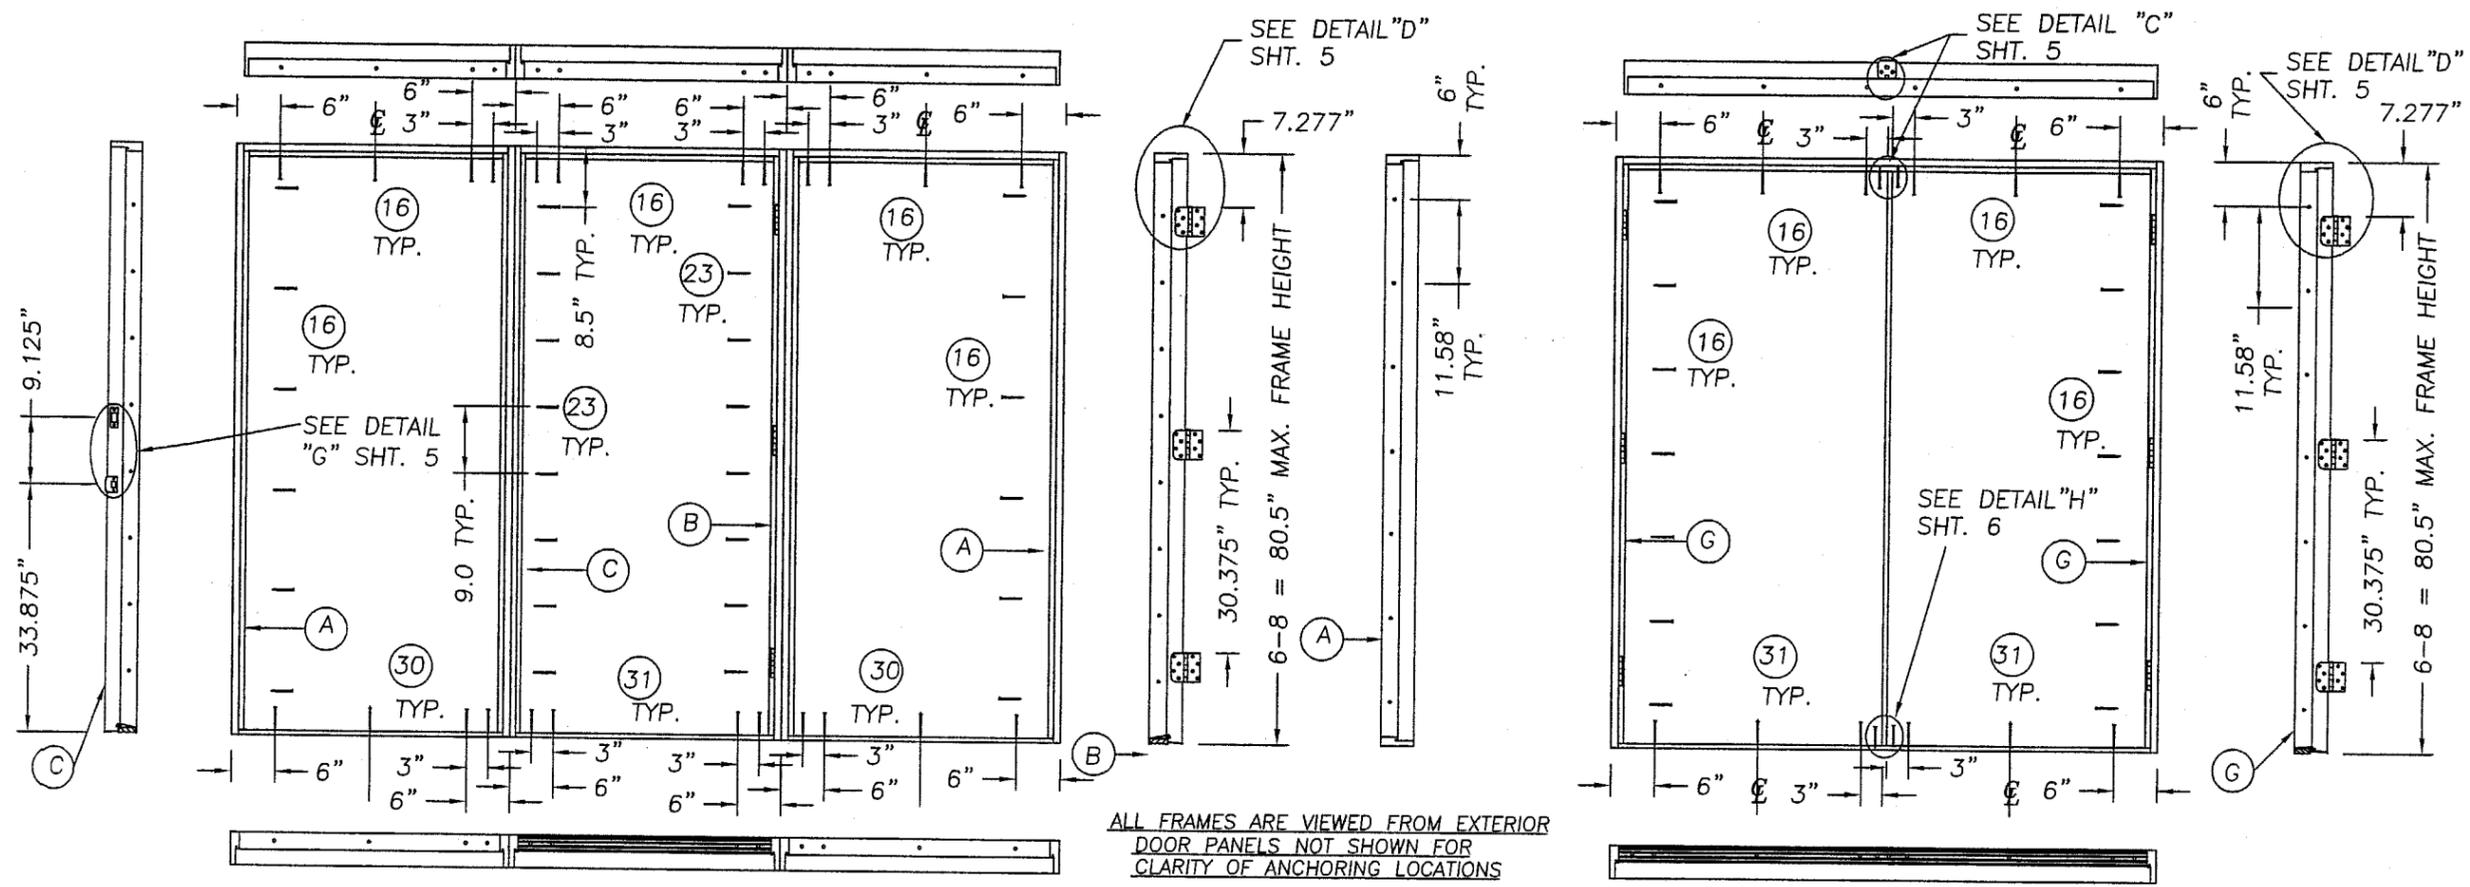

ALL FRAMES ARE VIEWED FROM EXTERIOR
 DOOR PANELS NOT SHOWN FOR
 CLARITY OF ANCHORING LOCATIONS

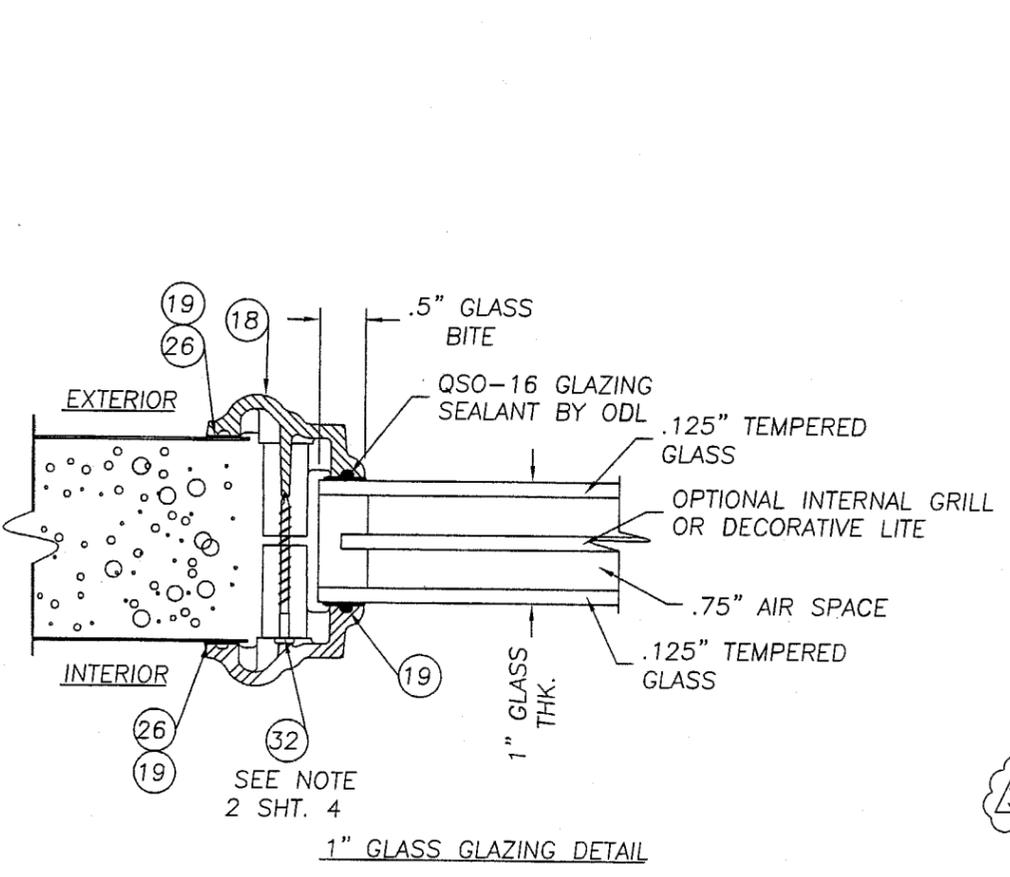

1" GLASS GLAZING DETAIL

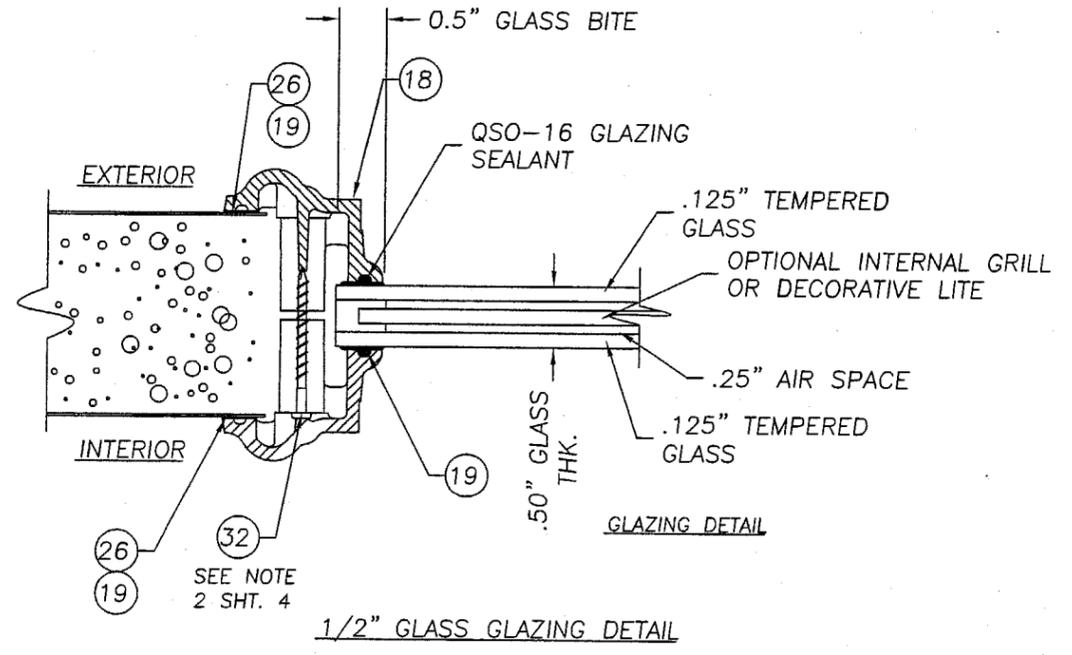

1/2" GLASS GLAZING DETAIL



NOTE: GLASS LITE FRAME SURROUNDS
 ODL Spartech Polycorn PP5530 C13
 Trinity GE ASA Polycarbonate

STANLEY
 STANLEY DOOR SYSTEMS
 7300 REAMES ROAD
 CHARLOTTE, NC 28216
 PH. (704) 921-3470


PRODUCT:
 STANLEY OUTSWING OPAQUE
 11-4 x 6-8 WOODGE
 DOOR W/ & W/O SIDELITES
 PART OR ASSEMBLY:
 ANCHORING LAYOUTS
 & GLAZING DETAIL

NO.	DATE	BY	REVISIONS
5	8/20/03	RW	PER DADE COMMENTS
4	5/29/03	TJH	REVISED BILL OF MATERIALS
3	3/10/01	RW	CORRECT B.O.M.
2	1/12/01	RW	ADD ASA MATERIAL
1	12/20/00	RW	GENERAL


RW BUILDING
 CONSULTANTS, INC.
 813.659.9197

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. **03-0612.08**
 Expiration Date **NOV. 1, 2006**
 By *Maurice*
 Miami Dade Product Control
 Division


DATE: 6/5/00
 SCALE: N.T.S.
 DWG. BY: TJH
 CHK. BY: RW
 DRAWING NO.: 39639
 SHEET 6 OF 7

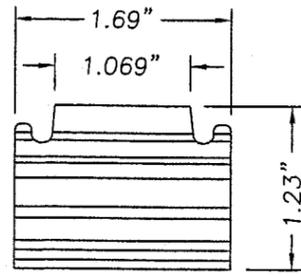


5 LATCH STILE
LVL
(79.0" LONG)

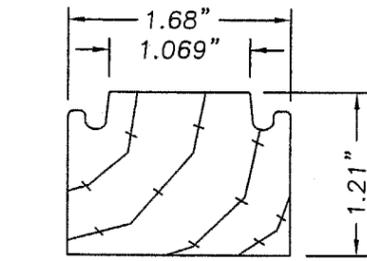


4 TOP RAIL & HINGE STILE
PINE
(TOP RAIL - 34.0" LONG)
(HINGE STILE - 79.0" LONG)

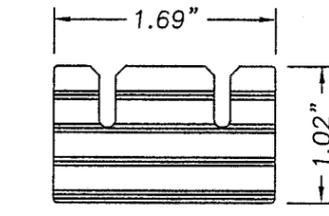


6 EXTRUDED BOTTOM RAIL
COMPOSITE

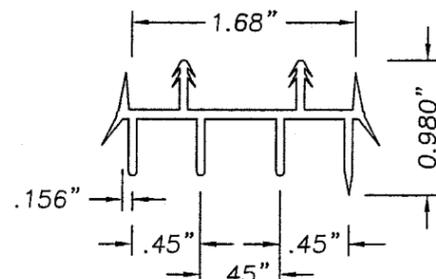


8 DOOR BOTTOM SWEEP
EXTRUDED VINYL

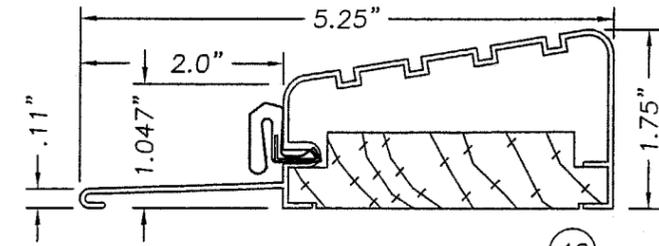



40 HIGH DAM THRESHOLD
BY IMPERIAL
MEETS WATER REQUIREMENTS

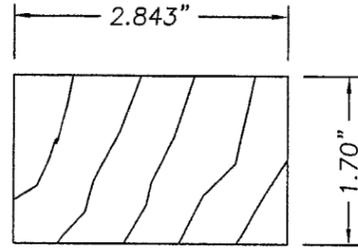

2 WOOD LOCK BLOCK
12" LONG

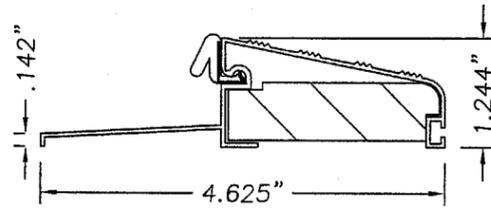


29 OUTSWING BUMP FACE
ALUMINUM THRESHOLD
.045" WALL THK.

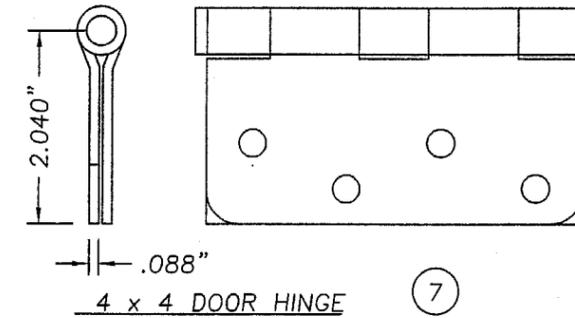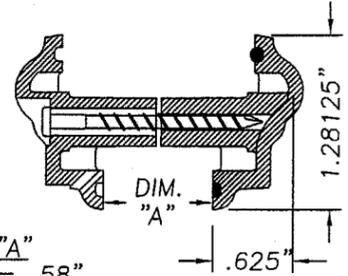


7 4 x 4 DOOR HINGE

DIM "A"
.5" GLASS = .58"
1" GLASS = 1.08"
ODL Spartech Polycom PP5530 C13
Trinity GE ASA Polycarbonate Lite Frame

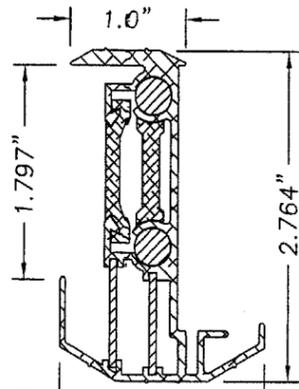


38 ASTRAGAL WINDJAMBER II
(WR68S) T-6063 EXTRUDED ALUMINUM


ASTRAGAL HAS
(2) 8 1/4"
BOLTS @ BOTTOM
& (2) 17 3/4"
BOLTS @ TOP

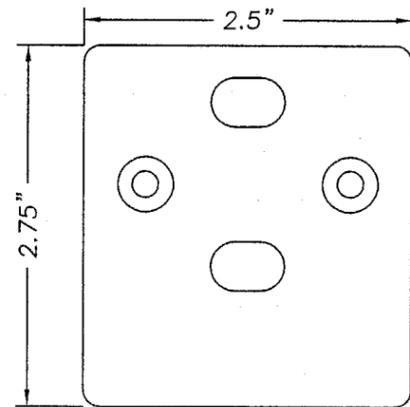


38 ASTRAGAL THRESHOLD STRIKE PLATE
WR68S .50" ALUM.

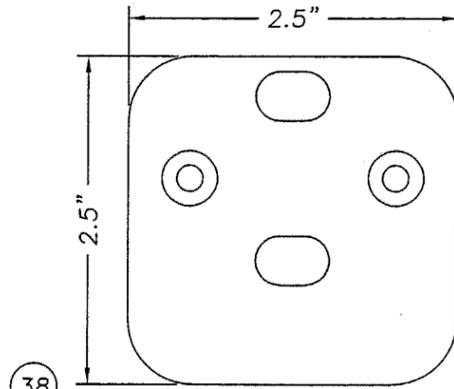


38 ASTRAGAL HEADER STRIKE PLATE
WR68S .066" STEEL

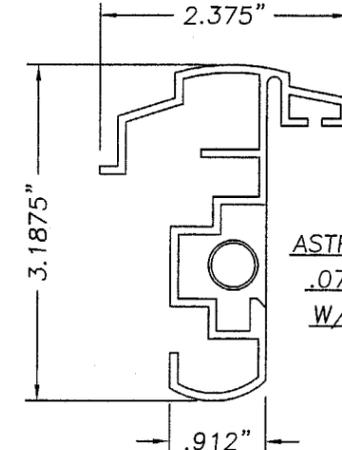


36 OPTIONAL
ASTRAGAL (IMPERIAL)
.075" WALL ALUM.
W/(2) 12" BOLTS



9 SCHLEGEL Q-LON QDS650

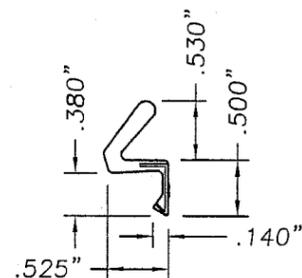

39 HOLM INDUSTRIES JF65

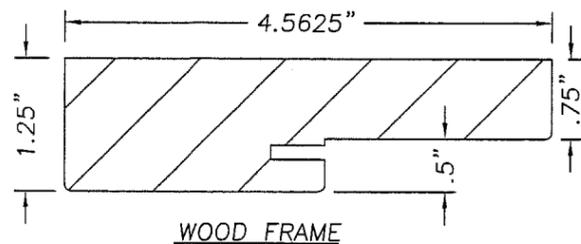

11 12 13 14 WOOD FRAME

STANLEY
STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470

PRODUCT:
STANLEY OUTSWING OPAQUE
11-4 x 6-8 WOODEDGE
DOOR W/ & W/O SIDELITES
PART OR ASSEMBLY:
FRAME COMPONENTS

NO	DATE	GENERAL	ADD ASA MATERIAL	CORRECT B.O.M.	REVISED BILL OF MATERIALS	PER DATE COMMENTS	BY
5	8/20/03						RW
4	2/4/03						ZRK
3	3/10/01						RW
2	1/12/01						RW
1	12/20/00						RW

RW BUILDING
CONSULTANTS, INC.
813.659.9197

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 03-0612-08
Expiration Date Nov. 1, 2006
By *Manuel Srey*
Miami Dade Product Control
Division

DATE: 6/5/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: 39639
SHEET 7 OF 7