



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

**Universal Aluminum Windows & Doors, Inc.  
1675 W. 31<sup>ST</sup> Place  
Hialeah, FL 33012**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: Series Outswing Aluminum French Door w/Sidelites**

**APPROVAL DOCUMENT:** Drawing No. W99-79, titled "Alum Outswing Door with Sidelites, sheets 1 through 6 of 6, prepared by Al Farooq Corporation, dated 11/19/99 w/ last revision on 07-17-00, signed and sealed by Dr. Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: None**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA renews NOA # 00-0208.03 and, consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by Ishaq I. Chanda, P.E.

8/14/13



**NOA No 03-0709.02  
Expiration Date: August 17, 2008  
Approval Date: August 14, 2003  
Page 1**

**Universal Aluminum Windows & Doors, Inc.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

(For File ONLY. Not part of NOA)

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No. W99-79, titled "Alum Outswing Door with Sidelites, sheets 1 through 6 of 6, prepared by Al Farooq Corporation, dated 11/19/99 w/ last revision on 07-17-00, signed and sealed by Dr. Humayoun Farooq, P.E.

**B. TESTS: *Original Submitted under NOA#00-0208.03 (Original test conducted under PA 202-94, now called TAS 202-94)***

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94  
along with installation diagram of an outswing doors w\sidelite prepared by Fenestration Testing Laboratories, Test Report No.6 (FTL2077) dated 11-02-99, signed and sealed by Aldo P. Gonzales, P.E.
2. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94  
along with installation diagram of an outswing single doors, prepared by Fenestration Testing Laboratories, Test Report No. 4 (FTL 2055), dated 07-13-98, signed and sealed by Late Gilbert Diamond, P.E.

**C. CALCULATIONS (Original submitted under NOA#00-0208.03)**

1. Structural performance, comparative analysis and anchor verification calculations dated 12-11-1999, and revised on 07-14-00, prepared by Al-Farooq Corporation, signed and sealed by Dr. Humayoun Farooq, P.E.
2. Additional glazing calculations, dated 6/30/03, Al- Farooq Corporation, signed and sealed by Dr. Humayoun Farooq, P. E.

**D. MATERIAL CERTIFICATIONS**

1. None


**E. STATEMENTS (Original submitted under NOA#00-0208.03)**

1. Letter of conformance, dated 12-16-1999 signed & sealed by Dr. Humayoun Farooq, P.E.
2. Statement letter of no financial interest, dated 12-16-1999, signed by Dr. Humayoun Farooq, P.E.
3. Statement letter of compliance dated 12-02-1999, issued by Fenestration Testing lab, signed and sealed by Aldo P. Gonzales, P.E.
4. Addendum letter dated 01-10-2000 issued by Fenestration Testing Lab, clarifying glazing, signed and sealed by Aldo P. Gonzales, P.E.

**F. OTHER**


1. Notice of Acceptance No. **00-0208.03** expiring on 8/17/03.
2. Glazing complies w/ ASTM E1300-98.

*Ishaq I. Chanda*  
\_\_\_\_\_  
Ishaq I. Chanda, P.E.  
Product Control Examiner  
NOA No 03-0709.02  
Expiration Date: August 17, 2008  
Approval Date: August 14, 2003

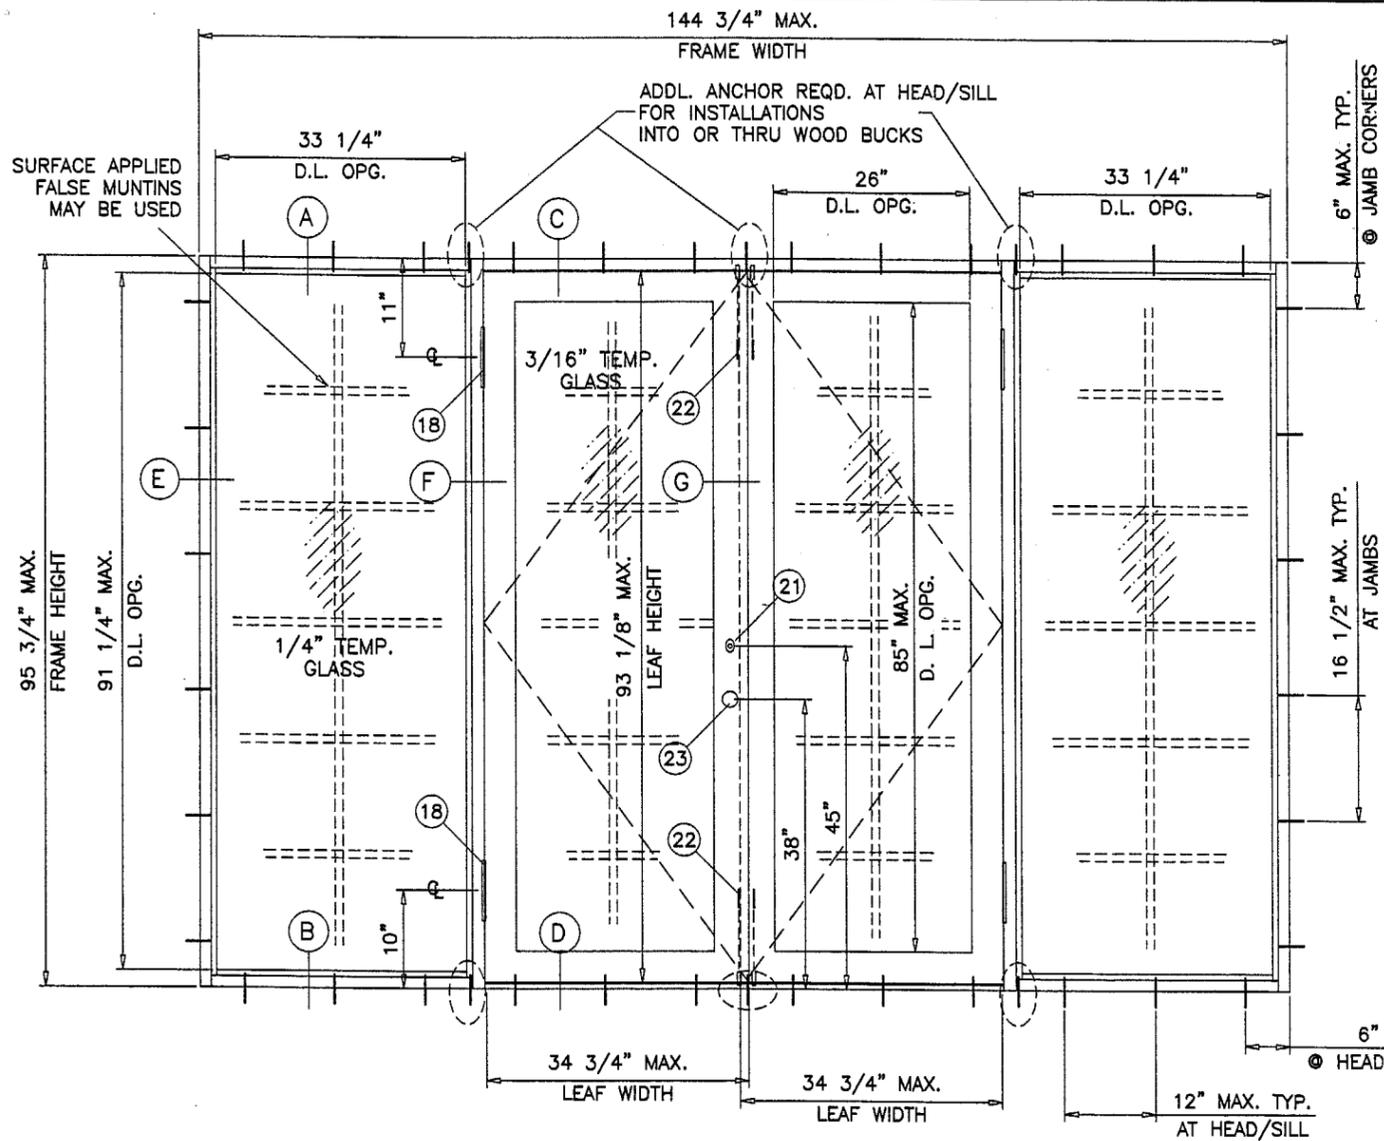

( O X X O )

DUAL LEAF DOORS COMPARATIVE ANALYSIS  
 BASED ON FTL-2077  
 SEE 'TABLE 1' ON SHEET 2

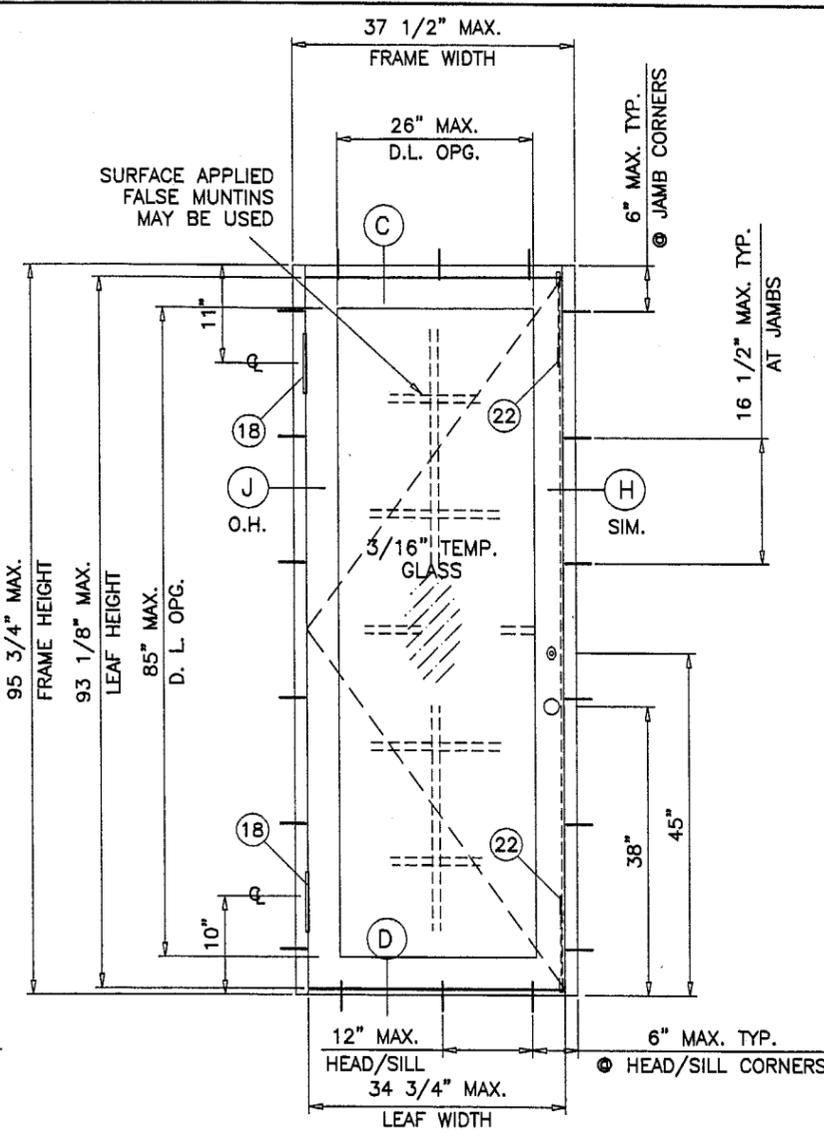

( X )

SINGLE LEAF DOORS COMPARATIVE ANALYSIS  
 BASED ON FTL-2055  
 SEE 'TABLE 2' ON SHEET 2

TYPICAL ELEVATIONS  
 TESTED UNITS

NOTES:

1. THIS STRUCTURE IS DESIGNED AS PER THE SOUTH FLORIDA BUILDING CODE 1994 EDITION FOR DADE COUNTY. ALSO FOR WIND LOADS AS PER ASCE 7-88 USING CORRESPONDING LOADS.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. ALL STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED.

TYPICAL ANCHORS: SPACED AS PER ELEVATIONS

A = 1/4\"/>

THRU 1BY BUCK INTO MASONRY OR DIRECTLY INTO MASONRY  
 1-1/4\"/>

B = 1/4\"/>

PRODUCT RENEWED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 03-0709-02  
 Expiration Date Aug 17, 2008  
 By Ishaq I. Chaudhry  
 Miami Dade Product Control  
 Division

APPROVED AS COMPLYING WITH THE  
 SOUTH FLORIDA BUILDING CODE  
 DATE August 17, 2000  
 BY Ishaq I. Chaudhry  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 00-0208-03

Engr. DR. HUMAYOUN FAROOQ  
 STRUCTURES  
 FLA. PE # 16557

JUL 17 2000

**AL-FAROOQ CORPORATION**  
 ENGINEERS, PLANNERS & PRODUCT DESIGN  
 1235 SW 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978

ALUM OUTSWING DOOR WITH SIDELITES  
**UNIVERSAL ALUMINUM WINDOWS**  
 1675 W. 31ST PLACE  
 HIALEAH, FL. 33012  
 TEL. (305) 825-7900 FAX (305) 825-5805

NO	DATE	DESCRIPTION
A	01.28.00	SINGLE LEAF DOOR/CHART ADD.
B	06.12.00	GENERAL REVISION
C	07.17.00	SHT. 2 REV. PER BCCO COMM'S


date: 11-19-99  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W99-79**  
 sheet 1 of 6

COMP-ANL W99-79UW

'TABLE 1'

SINGLE OR DUAL LEAF DOORS WITH 3/16" TEMPERED GLASS				DOORS WITH SIDELITES 1/4" TEMPERED GLASS (SIDELITES ONLY)				
DOOR HEIGHT FT./IN.	DOOR WIDTH FT./IN.		DESIGN LOAD - PSF		DESIGN LOAD - PSF (-VE)			
	X	XX	EXT. (+)	INT. (-)	SIDELITE WIDTH			
					24 INCHES	30 INCHES	36 INCHES	42 INCHES
6/8	2/0	4/0	60.0	111.1	111.1	111.1	111.1	111.1
	2/6	5/0	60.0	87.6	87.6	87.6	87.6	87.6
	3/0	6/0	60.0	72.4	72.4	72.4	72.4	72.4
7/0	2/0	4/0	60.0	105.6	105.6	105.6	105.6	105.2
	2/6	5/0	60.0	83.4	83.4	83.4	83.4	83.4
	3/0	6/0	60.0	68.8	68.8	68.8	68.8	68.8
8/0	2/0	4/0	60.0	92.1	91.9	82.3	74.9	69.1
	2/6	5/0	60.0	72.7	72.7	72.7	68.5	63.6
	3/0	6/0	60.0	60.0	60.0	60.0	60.0	59.1

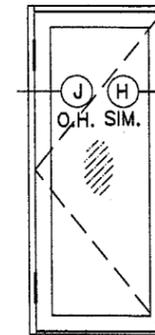

( X )  
TABLE '2'

'TABLE 2' (X)

SINGLE LEAF DOORS (X) WITH 3/16" TEMPERED GLASS			
NOMINAL DIMS.		DESIGN LOAD - PSF	
DOOR HEIGHT FT./IN.	DOOR WIDTH FT./IN.	EXT. (+)	INT. (-)
6/8	2/0	100.0	158.8
	2/6	100.0	128.6
	3/0	100.0	108.0
7/0	2/0	100.0	151.3
	2/6	100.0	122.4
	3/0	100.0	102.9
8/0	2/0	100.0	128.0
	2/6	100.0	105.2
	3/0	90.0	90.0

'TABLE 1' APPLIES TO ALL CONFIGURATIONS OTHER THAN X  
'TABLE 2' APPLIES TO SINGLE DOORS ONLY


NOTE:

THE 60.0 AND 100.0 PSF EXT.(+) LOAD LIMITATIONS SHOWN IN CHARTS ARE DUE TO WATER INFILTRATION TESTS. WHEN WATER INFILTRATION RESISTANCE IS NOT REQUIRED THEN THE EXTERIOR LOAD CAPACITY WILL BE EQUAL TO THE INTERIOR LOAD.

NOMINAL HEIGHT	FRAME HEIGHT	LEAF HEIGHT
6/8	79-3/4"	77-1/8"
7/0	83-3/4"	81-1/8"
8/0	95-3/4"	93-1/8"

NOMINAL WIDTH	FRAME WIDTH	LEAF WIDTH
2/0	25-1/2"	22-3/4" ( X )
4/0	47-7/8"	22-3/4" ( XX )
2/6	31-1/2"	28-3/4" ( X )
5/0	59-7/8"	28-3/4" ( XX )
3/0	37-1/2"	34-3/4" ( X )
6/0	71-7/8"	34-3/4" ( XX )

**PRODUCT RENEWED**  
as complying with the Florida Building Code  
Acceptance No 03-0709-02  
Expiration Date Aug 17, 2008  
By Ishaq I. Chanda  
Miami Dade Product Control Division

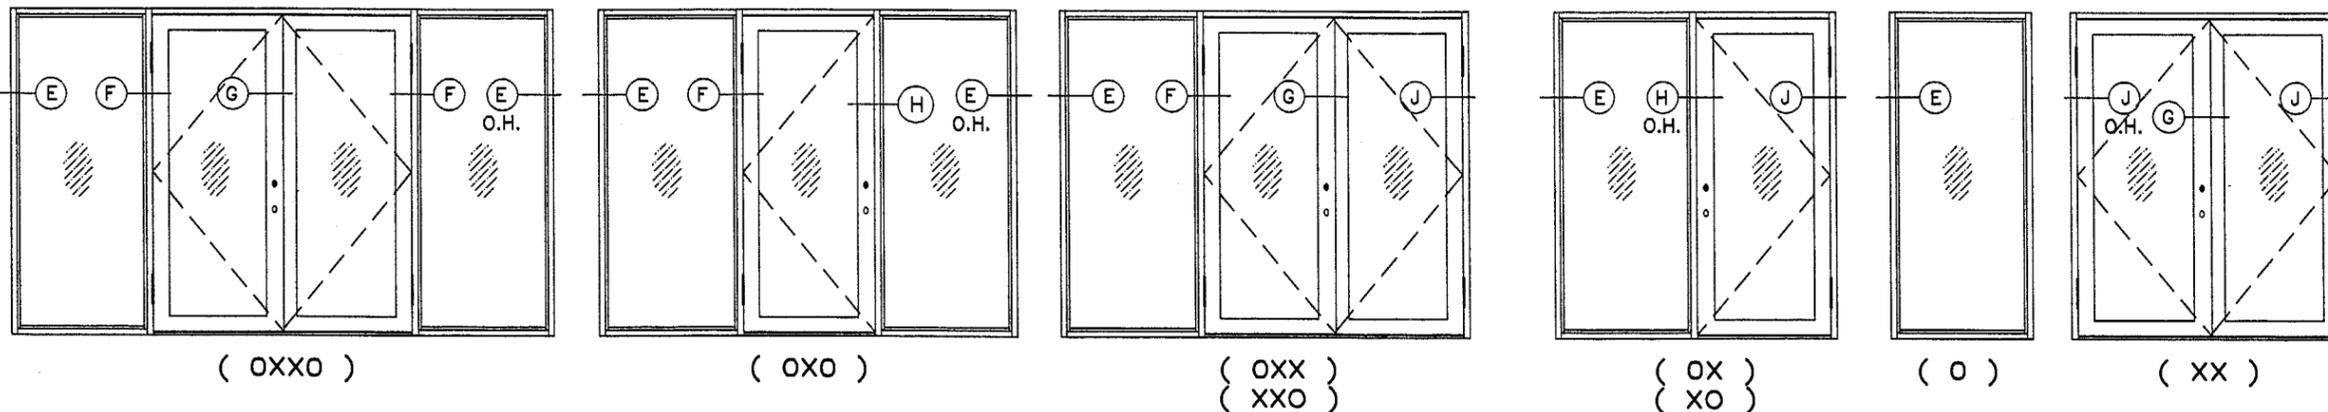

APPROVED CONFIGURATIONS  
TABLE '1'

MIAMI DADE COUNTY APPROVED  
IMPACT RESISTANT SHUTTERS REQUIRED

Engr. DR. HIJMAOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557

JUL 17 2008

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
DATE August 17, 2000  
BY Ishaq I. Chanda  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 00-0208-03





**AL-FAROOQ CORPORATION**  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W99-79UW

ALUM OUTSWING DOOR WITH SIDELITES  
**UNIVERSAL ALUMINUM WINDOWS**  
1675 W. 31ST PLACE  
HIALEAH, FL. 33012  
TEL. (305) 825-7900 FAX (305) 825-5805

revisions:	no	date	by	description

date: 11-19-99  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W99-79**  
sheet 2 of 6

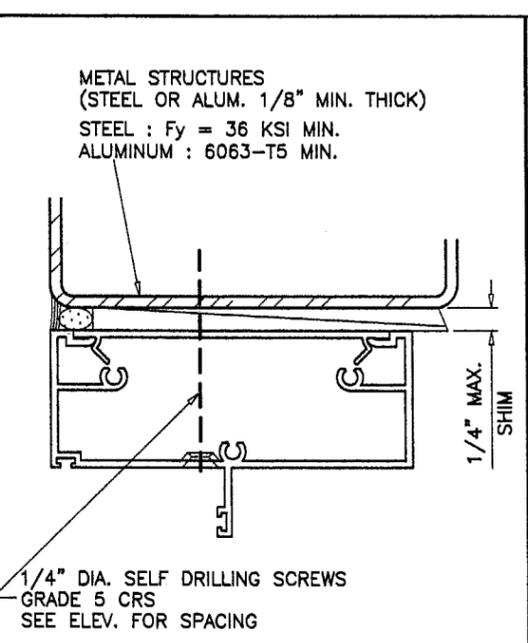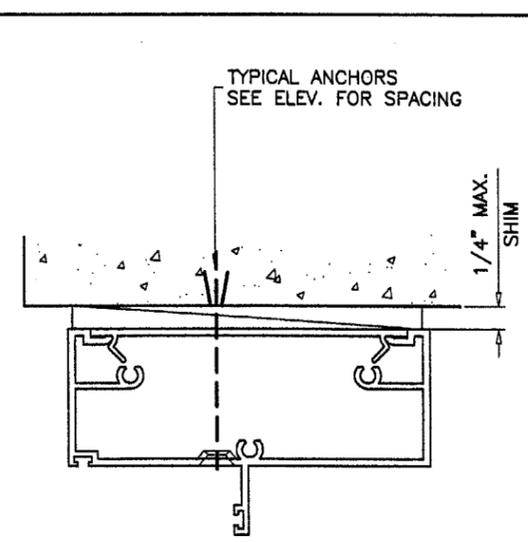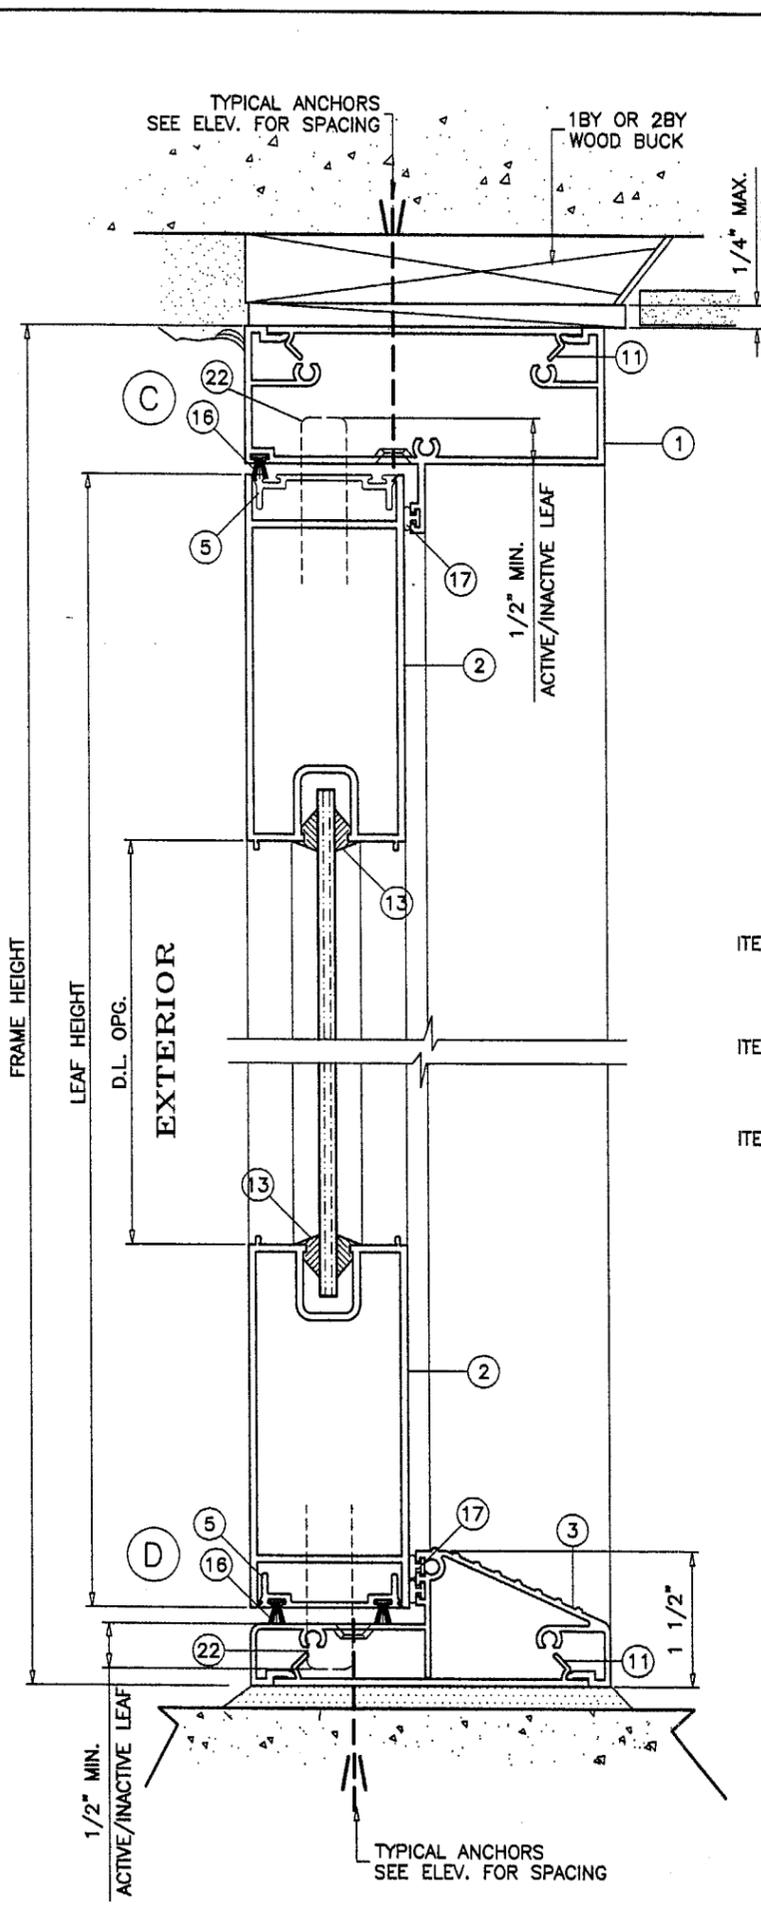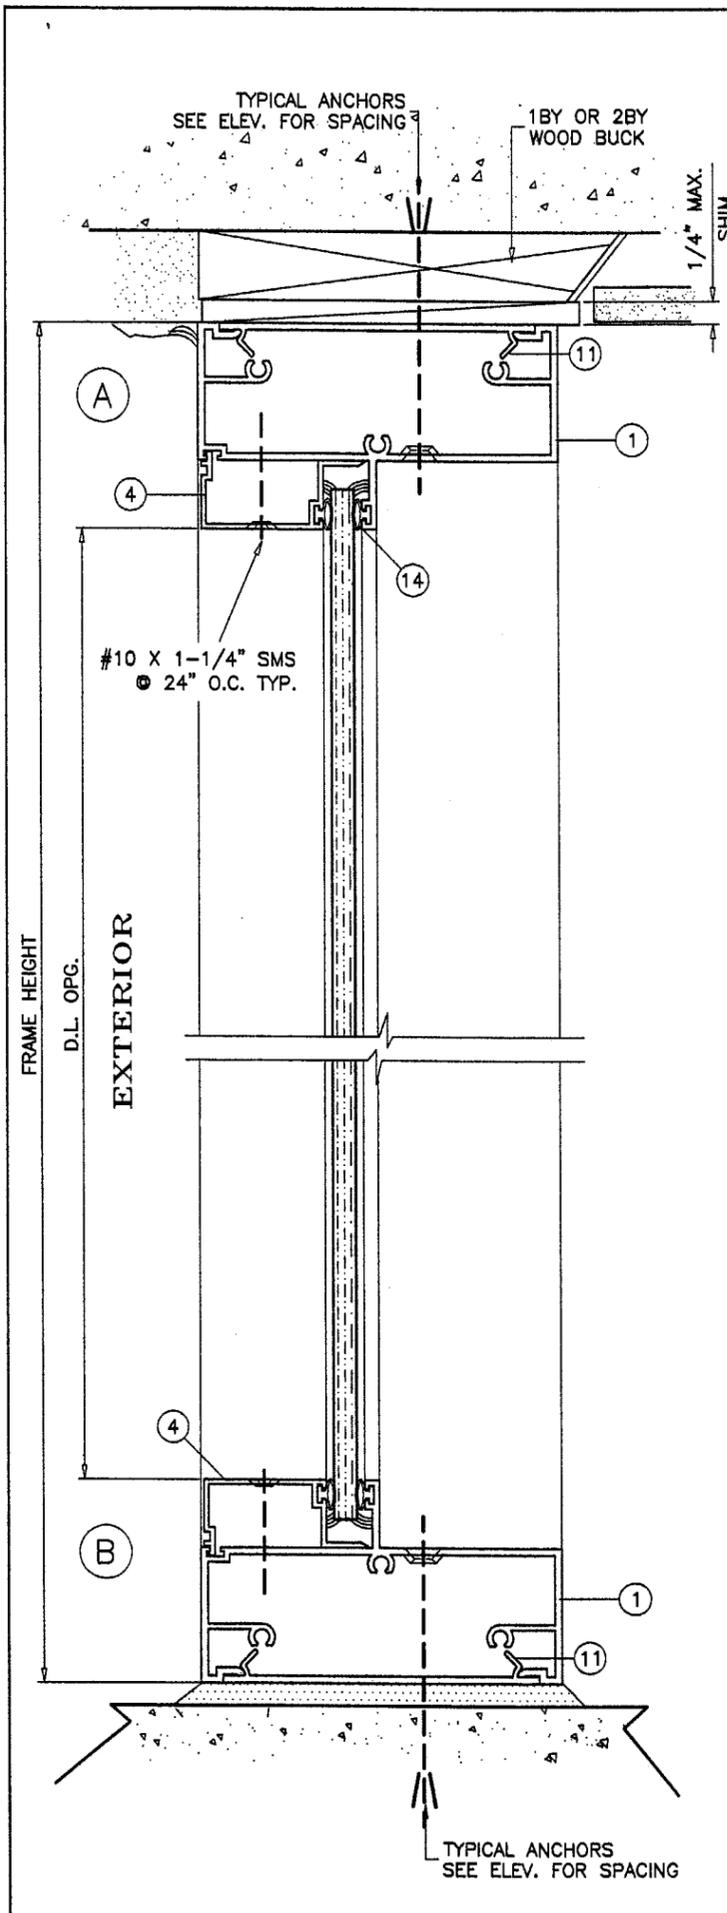

**SEALANTS:**

FRAME AND LEAF CORNERS, INSTALLATION SCREWS AT SILL AND ALL METAL PARTS CONNECTIONS SEALED WITH WHITE/ALUMINUM COLORED SEALANT.

**LOCKS:**

- ITEM# 22 MANUALLY OPERATED FLUSH BOLTS AT TOP AND BOTTOM OF EACH ACTIVE AND INACTIVE LEAF LOCK STILE WITH OPERATORS AT 12" AND 76" FROM BOTTOM.
- ITEM# 21 DEAD BOLT LOCK BY WESLOCK INTL. OR HARLOCK WITH ALUM STRIKE PLATE AT ACTIVE LEAF LOCK STILE 45" FROM BOTTOM KEY OPERATED ON EXT. AND THUMB TURN ON INTERIOR.
- ITEM# 23 CONVENTIONAL DOOR KNOB BY WESLOCK INTL. OR HARLOC WITH ALUM STRIKE PLATE AT ACTIVE LEAF LOCK STILE 38" FROM BOTTOM.

NOTE: FLUSH BOLTS ON ACTIVE LEAF MUST BE ENGAGED DURING PERIODS OF HURRICANE WARNING.

WOOD BUCKS NOT BY UNIVERSAL WINDOWS, MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

Engr. DR. HUMAYOON FAROOQ  
STRUCTURES  
FLA. PE # 16557  
  
JUL 17 2000

**PRODUCT RENEWED**  
as complying with the Florida  
Building Code  
Acceptance No. 03-0709-02  
Expiration Date AUG 17 2008  
  
By Ishaq I. Chanda  
Miami Dade Product Control  
Division  
  
APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE August 19, 2000  
BY Ishaq I. Chanda  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 00-0208-03

**afc**

**AL-FAROOQ CORPORATION**  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W99-79UW


---

ALUM OUTSWING DOOR WITH SIDELITES  
**UNIVERSAL ALUMINUM WINDOWS**  
1675 W. 31ST PLACE  
HIALEAH, FL. 33012  
TEL. (305) 825-7900 FAX (305) 825-5805

revisions:	
no.	date by description

date: 11-19-99	scale: 1/2" = 1"	dr. by: HAMID	chk. by:
----------------	------------------	---------------	----------

drawing no.  
**W99-79**  
sheet 3 of 6

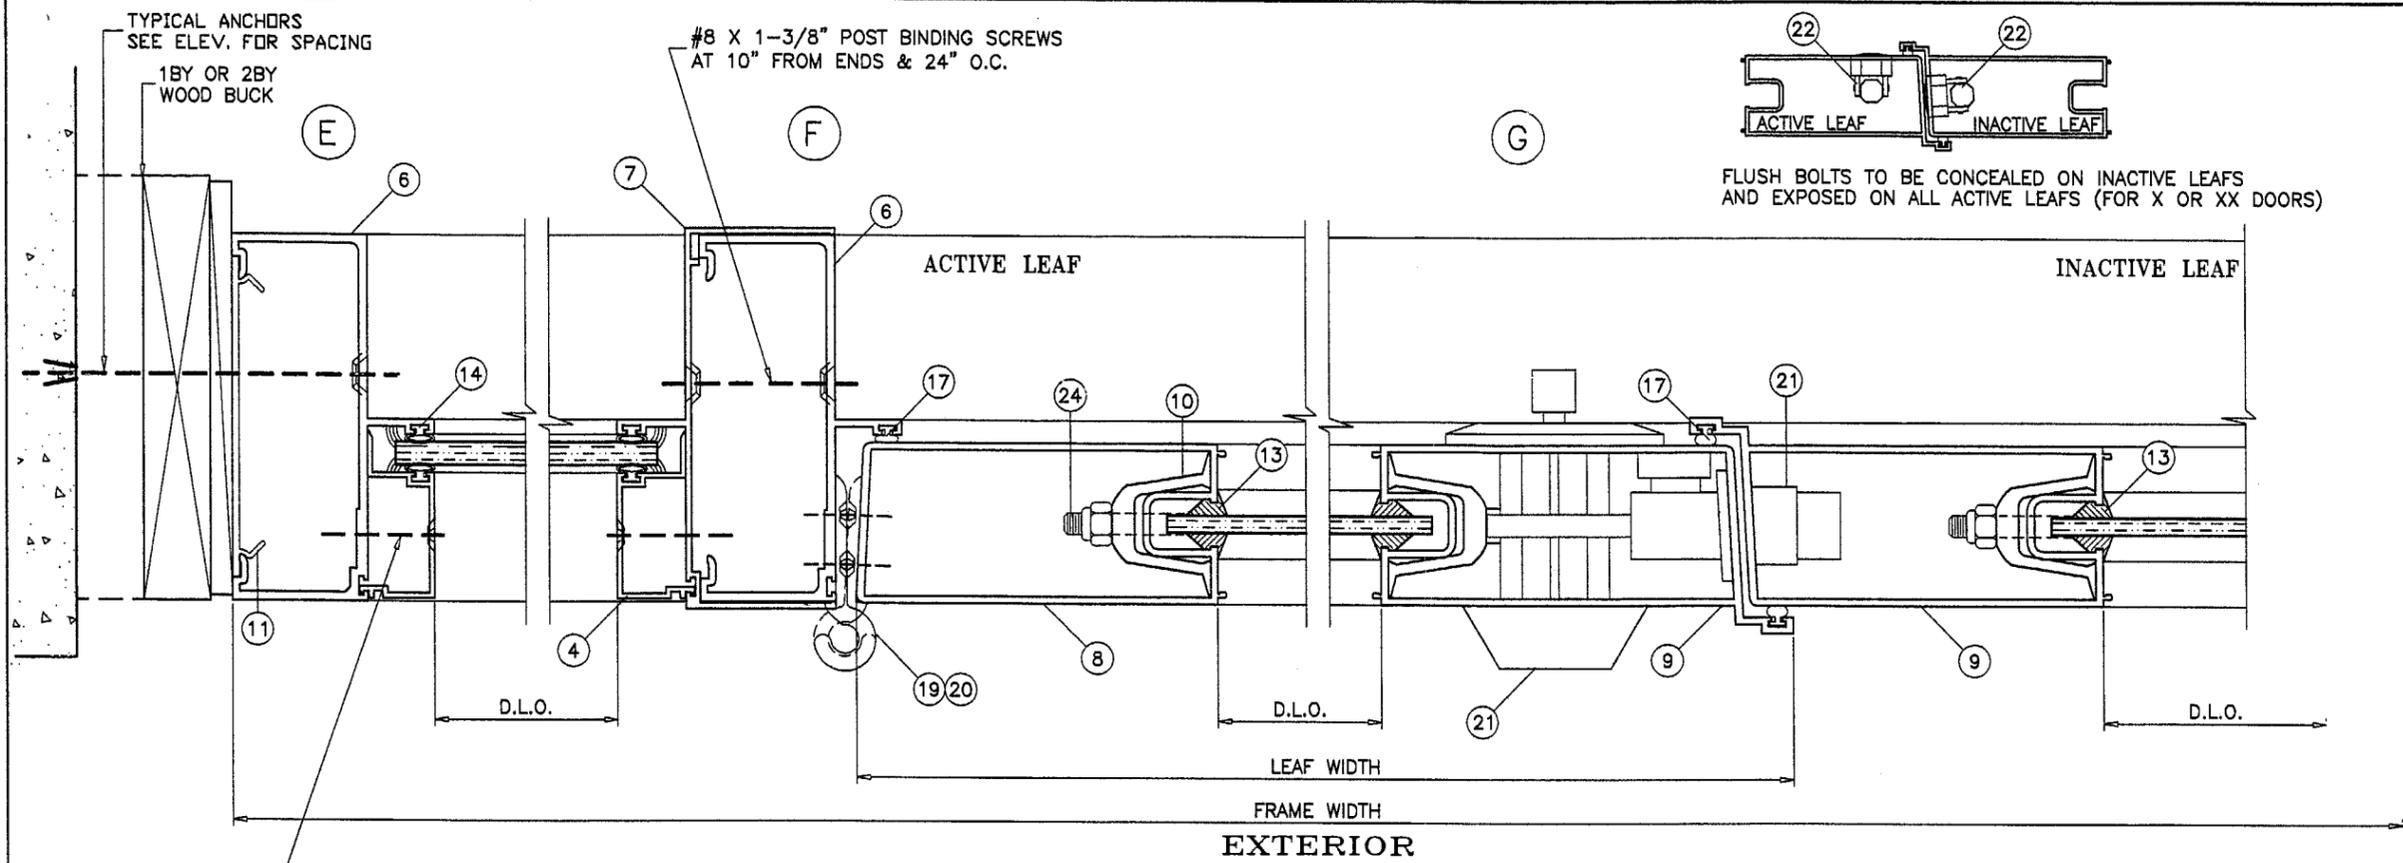


EXTERIOR


#10 X 1-1/4" SMS  
@ 24" O.C. TYP.

#8 X 1-3/8" POST BINDING SCREWS  
AT 10" FROM ENDS & 24" O.C.

TYPICAL ANCHORS  
SEE ELEV. FOR SPACING

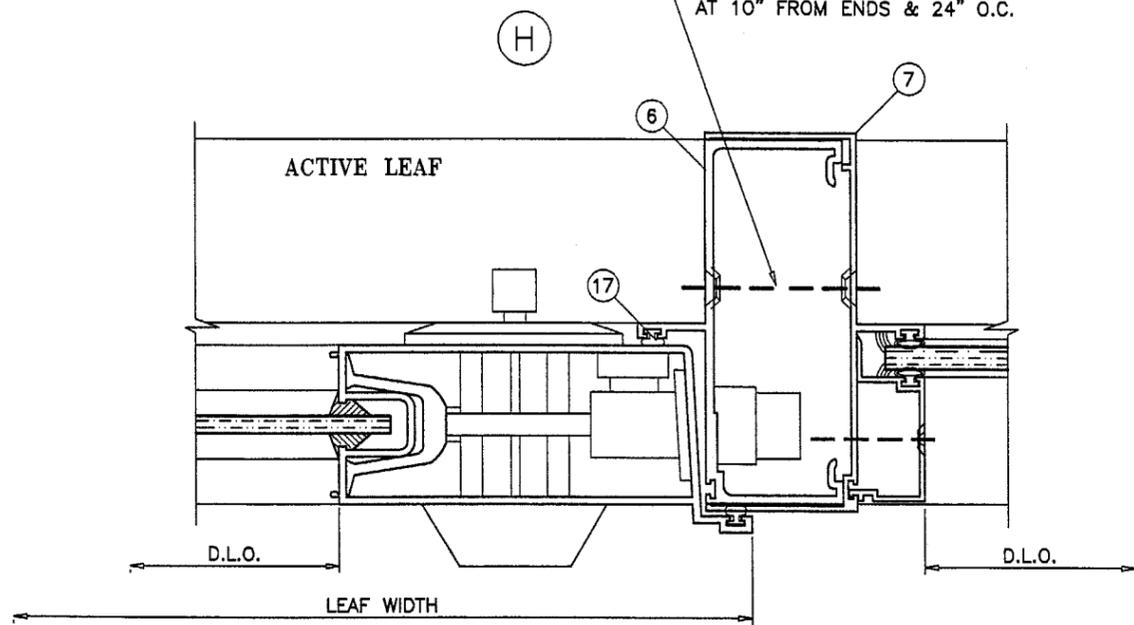

**PRODUCT RENEWED**  
in complying with the Florida  
Building Code  
Acceptance No. 03-0709-02  
Expiration Date AD 5/17/2008  
By Ishaq I. Chanda  
Miami Code Production  
Division

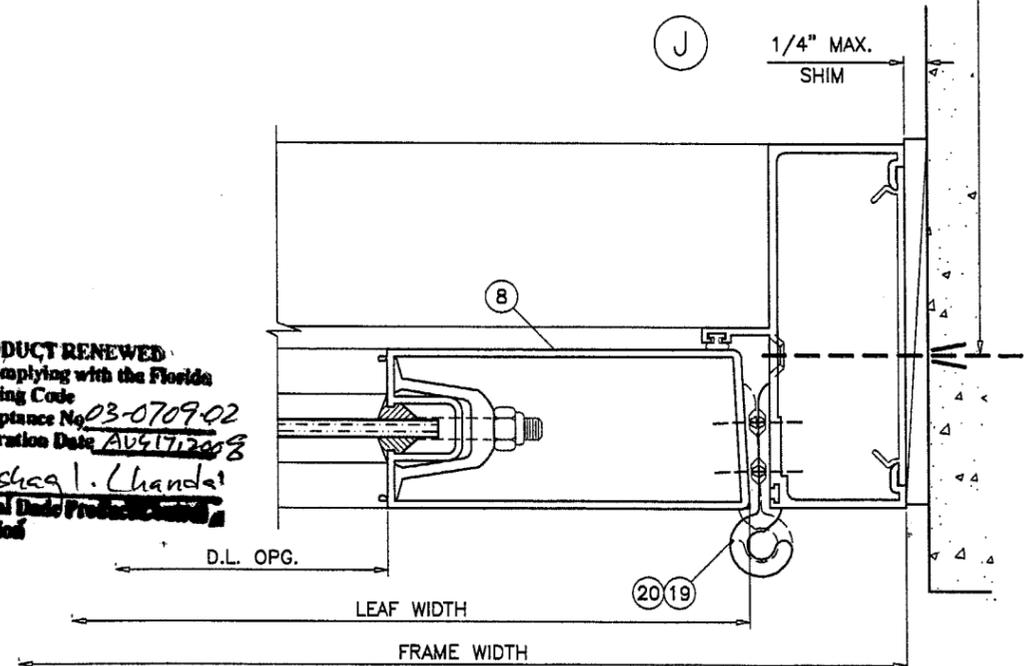

Engr. DR. HUMAYOON FAROOQ  
STRUCTURES  
FLA. PE # 16557  
  
JUL 17 2000

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE August 17, 2000  
BY Ishaq I. Chanda  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 00-0208-03

**AL-FAROOQ CORPORATION**  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978

ALUM OUTSWING DOOR WITH SIDELITES  
**UNIVERSAL ALUMINUM WINDOWS**  
1675 W. 31ST PLACE  
HIALEAH, FL. 33012  
TEL. (305) 825-7900 FAX (305) 825-5805


no	date	by	description

date: 11-19-99  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:


drawing no.  
**W99-79**

sheet 4 of 6


COMP-ANL\W99-79UW

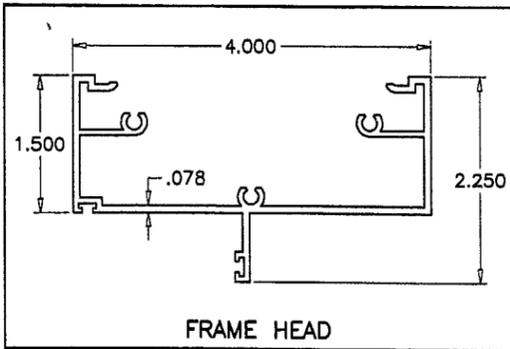


FRAME HEAD

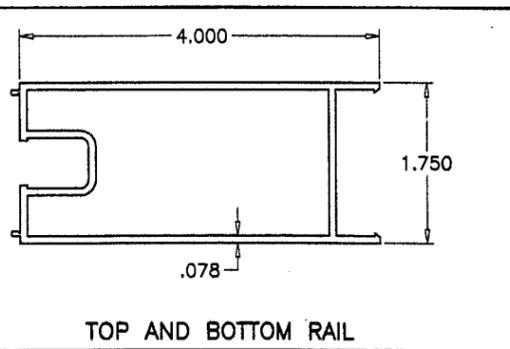


TOP AND BOTTOM RAIL

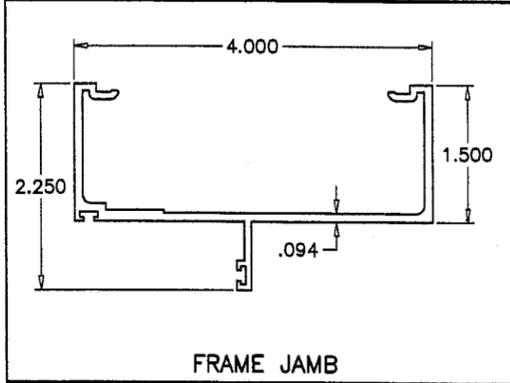


FRAME JAMB

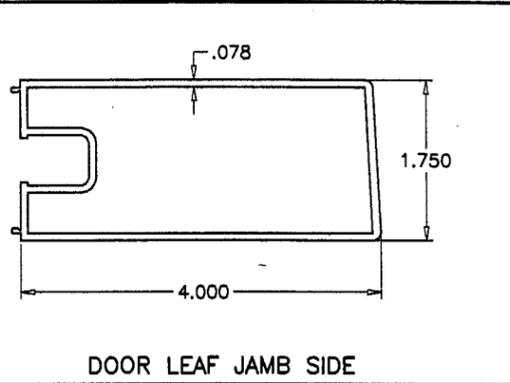


DOOR LEAF JAMB SIDE

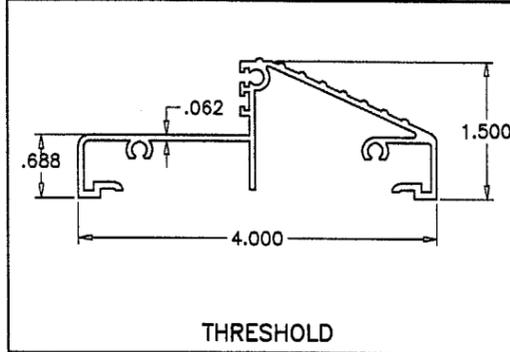


THRESHOLD

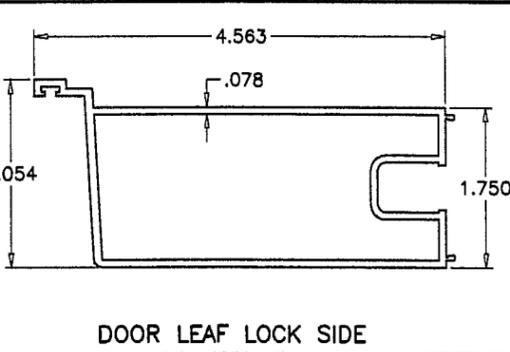


DOOR LEAF LOCK SIDE

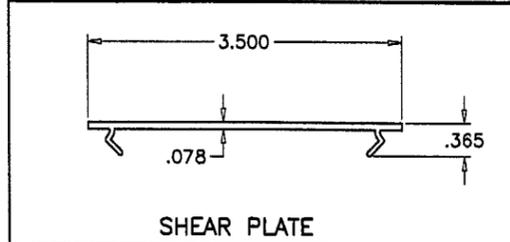


SHEAR PLATE

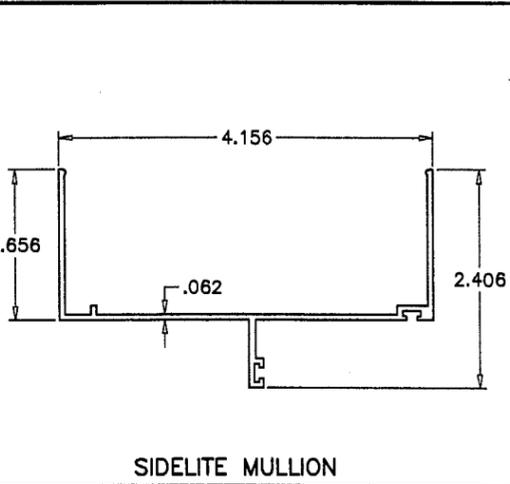


SIDELITE MULLION

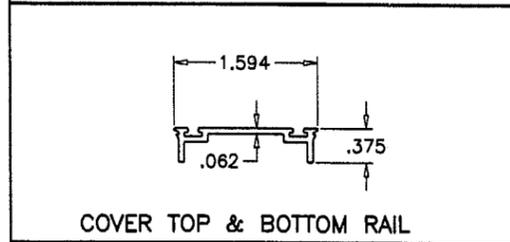


COVER TOP & BOTTOM RAIL

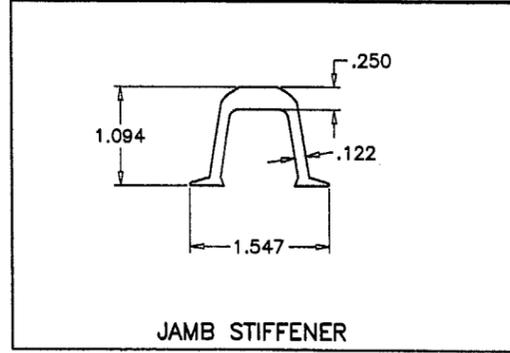

JAMB STIFFENER

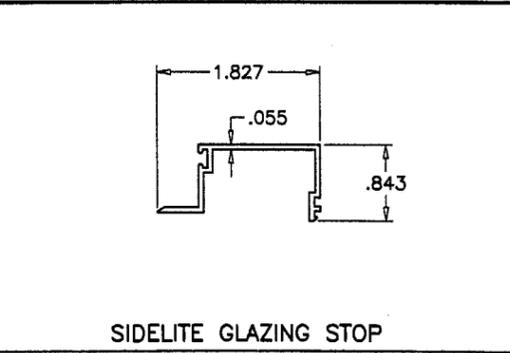


SIDELITE GLAZING STOP

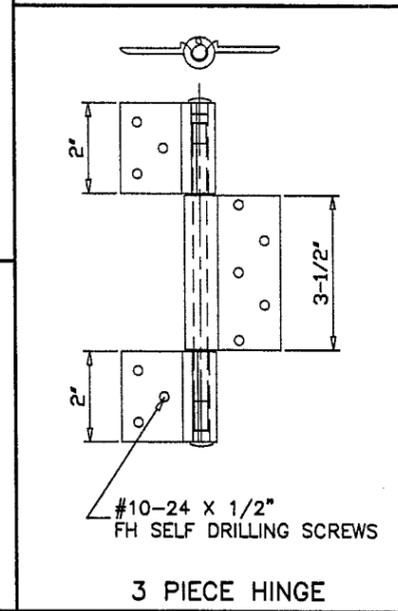


3 PIECE HINGE

ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	UA-1089	AS REQD.	FRAME HEAD	6063-T6	
2	UA-1092	2/ LEAF	TOP AND BOTTOM RAIL	6063-T6	-
3	UA-1094	1	DOOR FRAME SILL	6063-T6	-
4	UA-1100	AS REQD.	GLAZING BEAD - SIDELITE	6063-T6	-
5	UA-1096	2/ LEAF	SNAP COVER TOP & BOTTOM RAIL	6063-T5	-
6	UA-1091	2	DOOR FRAME JAMB	6063-T6	-
7	UA-1099	AS REQD.	SIDE LITE STILE	6063-T6	-
8	UA-1090	1/ LEAF	DOOR LEAF JAMB - HINGE SIDE	6063-T6	-
9	UA-1093	1/ LEAF	DOOR LEAF - LOCK SIDE	6063-T6	-
10	UA-1095	4/ LEAF	JAMB STIFFENER	6063-T6	4" LONG
11	A-4008	AS REQD.	SHEAR PLATE @ ANCHOR LOCATIONS	6063-T5	6-7/8" LONG
12	-	-	NOT USED	-	-
13	PS-1125	AS REQD.	WEDGE GASKET	VINYL	TREMCO
14	-	AS REQD.	BULB GASKET	VINYL	-
15	-	-	NOT USED	-	-
16	S-7800	AS REQD.	FIN-SEAL WEATHERSTRIPPING	-	.187 X .330
17	WV-3021	AS REQD.	BULB WEATHERSTRIPPING	VINYL	WIBORG
18	-	2/ LEAF	HINGE ASSEMBLY	-	-
19	UA-1097	1/ HINGE	HINGE CENTER HASP	6063-T6	-
20	UA-1098	2/ HINGE	HINGE OUTER HASP	6063-T6	-
21	-	1	DEAD BOLT LOCK SET	-	WESLOCK INTL. OR HARLOCK
22	-	2/ LEAF	MANUALLY OPERATED FLUSH BOLT	ZINC CAST	DELTA IND.
23	-	1	CONVENTIONAL DOOR KNOB SET	-	WESLOCK INTL. OR HARLOCK
24	-	2/ LEAF	3/8" DIA. THREADED ROD	STEEL	FULL LENGTH
25	#10X1"	AS REQD.	FRAME ASSY. SCREWS	-	PAN HEAD SMS

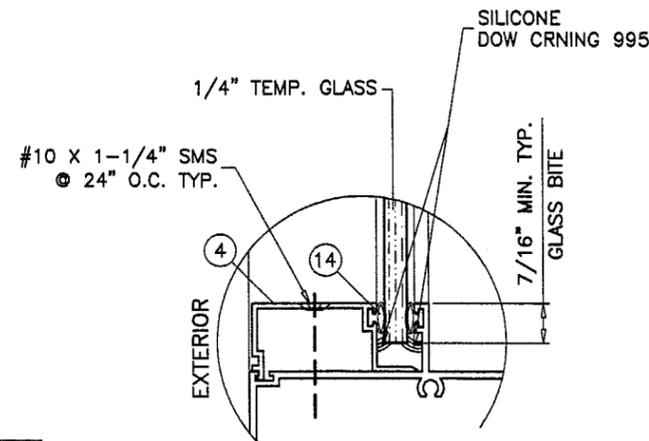

GLAZING DETAIL SIDELITE

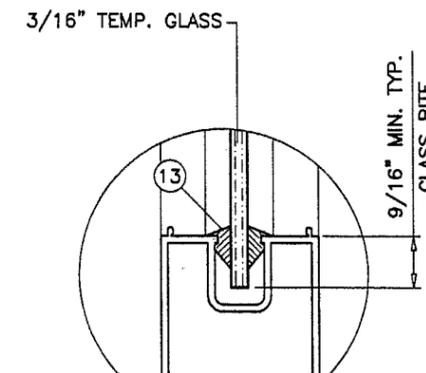

GLAZING DETAIL DOOR LEAF

**PRODUCT RENEWED**  
 as complying with the Florida  
 Building Code  
 Acceptance No. 03-0709.02  
 Expiration Date AUG 17, 2008  
 By Ishag I. Chaudh  
 Miami Dade Product Control  
 Division

Engr. DR. HUMAYOUN FAROOQ  
 STRUCTURES  
 FLA. PE # 76557

JUL 17 2000


APPROVED AS COMPLYING WITH THE  
 SOUTH FLORIDA BUILDING CODE  
 DATE August 19, 2000  
 BY Ishag I. Chaudh  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 00-0208-03

**AL-FAROOQ CORPORATION**  
 ENGINEERS, PLANNERS & PRODUCT DESIGN  
 1235 SW 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL W99-79UW


ALUM OUTSWING DOOR WITH SIDELITES  
**UNIVERSAL ALUMINUM WINDOWS**  
 1675 W. 31ST PLACE  
 HIALEAH, FL. 33012  
 TEL. (305) 825-7900 FAX (305) 825-5805

revisions:	no	date	by	description


date: 11-19-99  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:  
 drawing no.  
**W99-79**  
 sheet 5 of 6

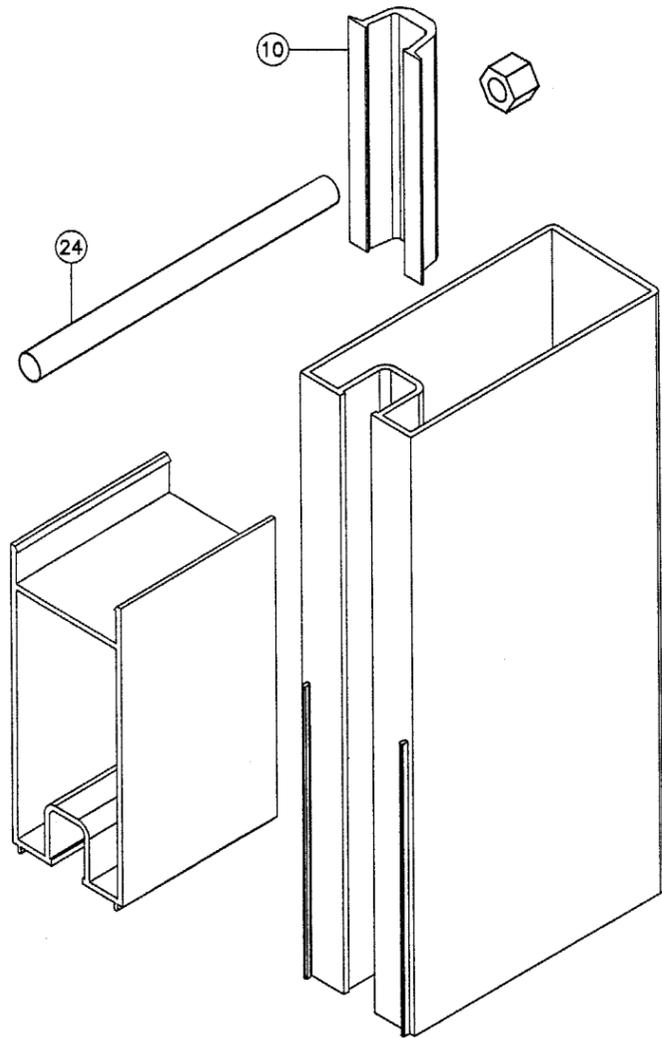


LEAF CORNER

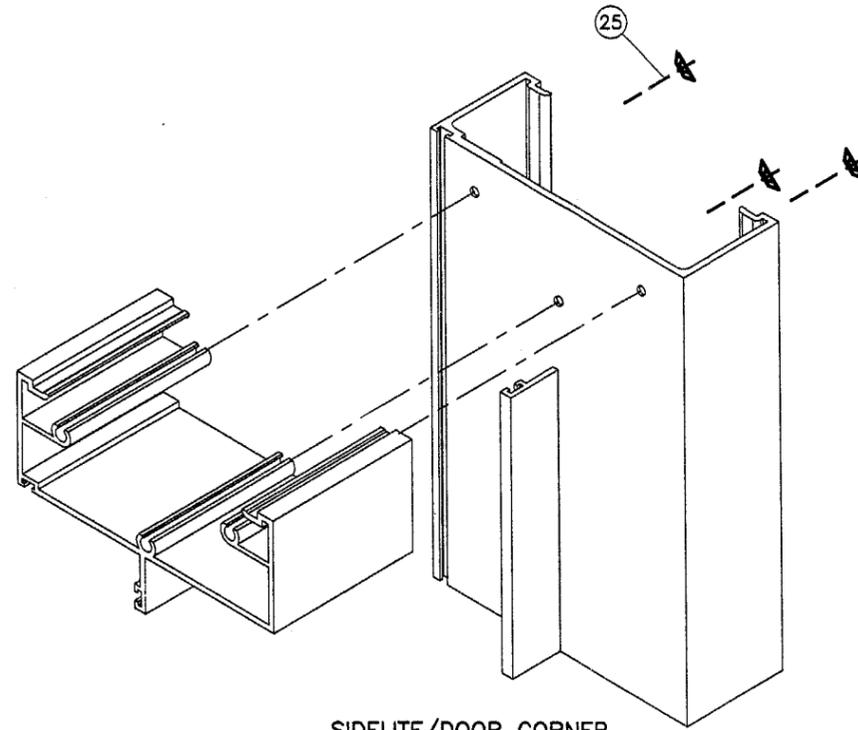

SIDELITE/DOOR CORNER

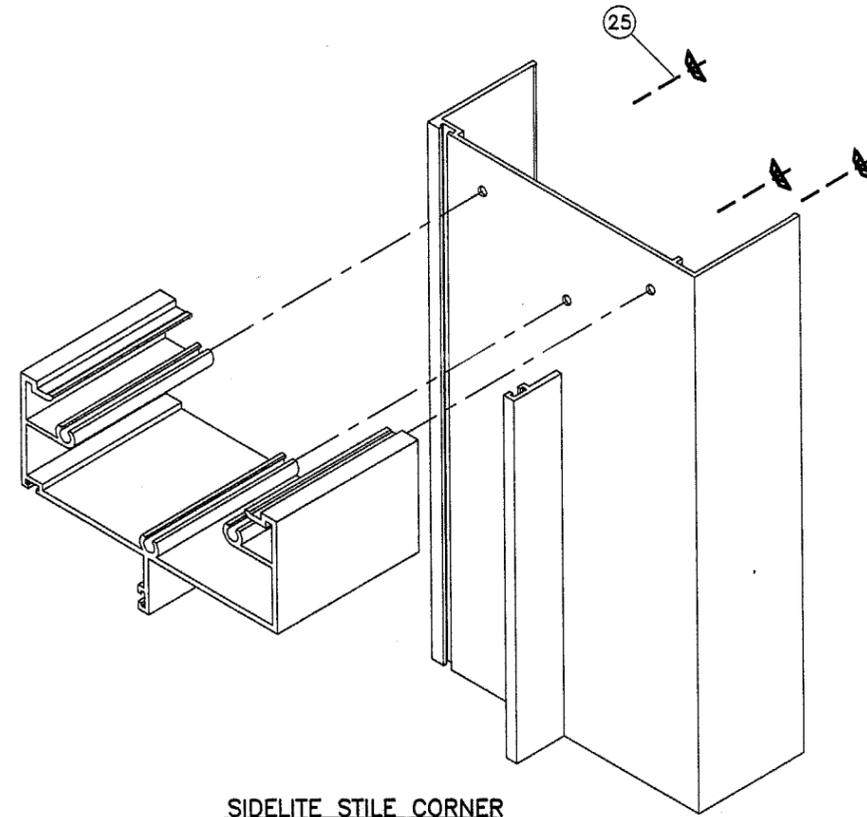

SIDELITE STILE CORNER

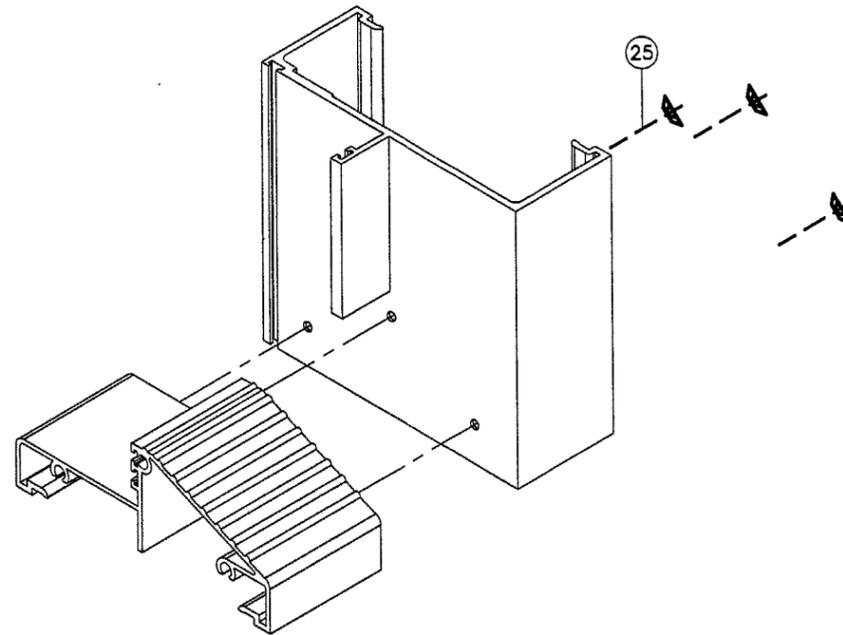

DOOR SILL CORNER

Engr. DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 18557

JUL 17 2000

PRODUCT RENEWED  
as complying with the Florida  
Building Code  
Acceptance No. 03-0708-02  
Expiration Date AUG 17, 2003  
By Ishaq I. Chanda  
Miami Dade Product Control  
Division

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE August 17, 2000  
BY Ishaq I. Chanda  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 00-0208-03

**AL-FAROOQ CORPORATION**  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978

ALUM OUTSWING DOOR WITH SIDELITES  
**UNIVERSAL ALUMINUM WINDOWS**  
1675 W. 31ST PLACE  
HIALEAH, FL. 33012  
TEL. (305) 825-7900 FAX (305) 825-5805

revisions:	
no	date by description

date: 11-19-99  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W99-79**