



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

---

**Jeld-Wen, Inc.  
201 Evans Road  
Rantoul, Il 61866**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone

**DESCRIPTION: "French View" Aluminum Clad Wood Door Sidelites**

**APPROVAL DOCUMENT:** Drawing No. W03-86, titled "'French View' Alum Clad Wood Door Sidelites ", sheets 1 through 5 of 5, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E., dated 09/22/03, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence page E-1, as well as approval document mentioned above. The submitted documentation was reviewed by **Theodore Berman, P.E.**



**NOA No 03-1016.03  
Expiration Date: February 19,2009  
Approval Date: February 19, 2004  
Page 1**

Jeld-Wen, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**A. DRAWINGS**

1. Manufacturer's die drawings and sections
2. Drawing No. W03-86, titled "French View' Alum Clad Wood Door Sidelites ", sheets 1 through 5 of 5, prepared by Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E.

**B. TESTS**

1. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94  
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
3) Air Infiltration Test, per FBC, TAS 202-94  
4) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
5) Water Resistance Test, per FBC, TAS 202-94  
along with installation diagram of a French View Aluminum Clad Wood Door Sidelites, prepared by Stork® Twin City Testing, Test Report No. TCTCW103001, dated 08/07/03, signed and sealed by John Lee, P.E.

**C. CALCULATIONS**

1. Anchor Calculations, ASTM-E1300-98, and Structural Analysis, prepared by Al-Farooq Corporation, dated October 13, 2003, signed and sealed by Humayoun Farooq, P.E.

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**


1. Notice of Acceptance No. **01-0205.02** issued to Solutia Inc. for their "Saflex /Keepsafe Maximum" dated 05/17/01, expiring on 05/21/06

**F. STATEMENTS**

1. Statement letter of conformance, dated October 15, 2003, signed and sealed by Humayoun Farooq, P.E.
2. Statement letter of no financial interest, dated October 15, 2003, signed and sealed by Humayoun Farooq, P.E.

**G. OTHER**

1. Letter from the consultant stating that the product is in compliance with the Florida Building Code (FBC).

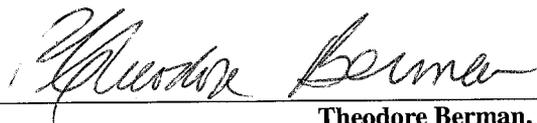

Theodore Berman, P.E.  
Theodore Berman, Product Control Division  
NOA No 03-1016.03  
Expiration Date: February 19, 2009  
Approval Date: February 19, 2004


**HEIGHTS:**

NOMINAL HEIGHT	FRAME HEIGHT
6/8	79-1/2"
6/11	82-1/2"
8/0	95-1/2"

**WIDTHS:**

NOMINAL WIDTH	FRAME WIDTH
2/0	24-3/4"
2/6	30-3/4"
3/0	36-3/4"
3/2	38-3/4"
3/6	42-3/4"

DESIGN LOAD CAPACITY - PSF			
SIDELITE HEIGHT FT./IN.	SIDELITE WIDTH FT./IN.	3/8" OVERALL GLASS	
		EXT. (+)	INT. (-)
6/8	2/0	65.0	65.0
	2/6	65.0	65.0
	3/0	65.0	65.0
	3/2	65.0	65.0
	3/6	58.9	58.9
6/11	2/0	65.0	65.0
	2/6	65.0	65.0
	3/0	65.0	65.0
	3/2	65.0	65.0
	3/6	57.7	57.7
8/0	2/0	65.0	65.0
	2/6	65.0	65.0
	3/0	65.0	65.0
	3/2	65.0	65.0

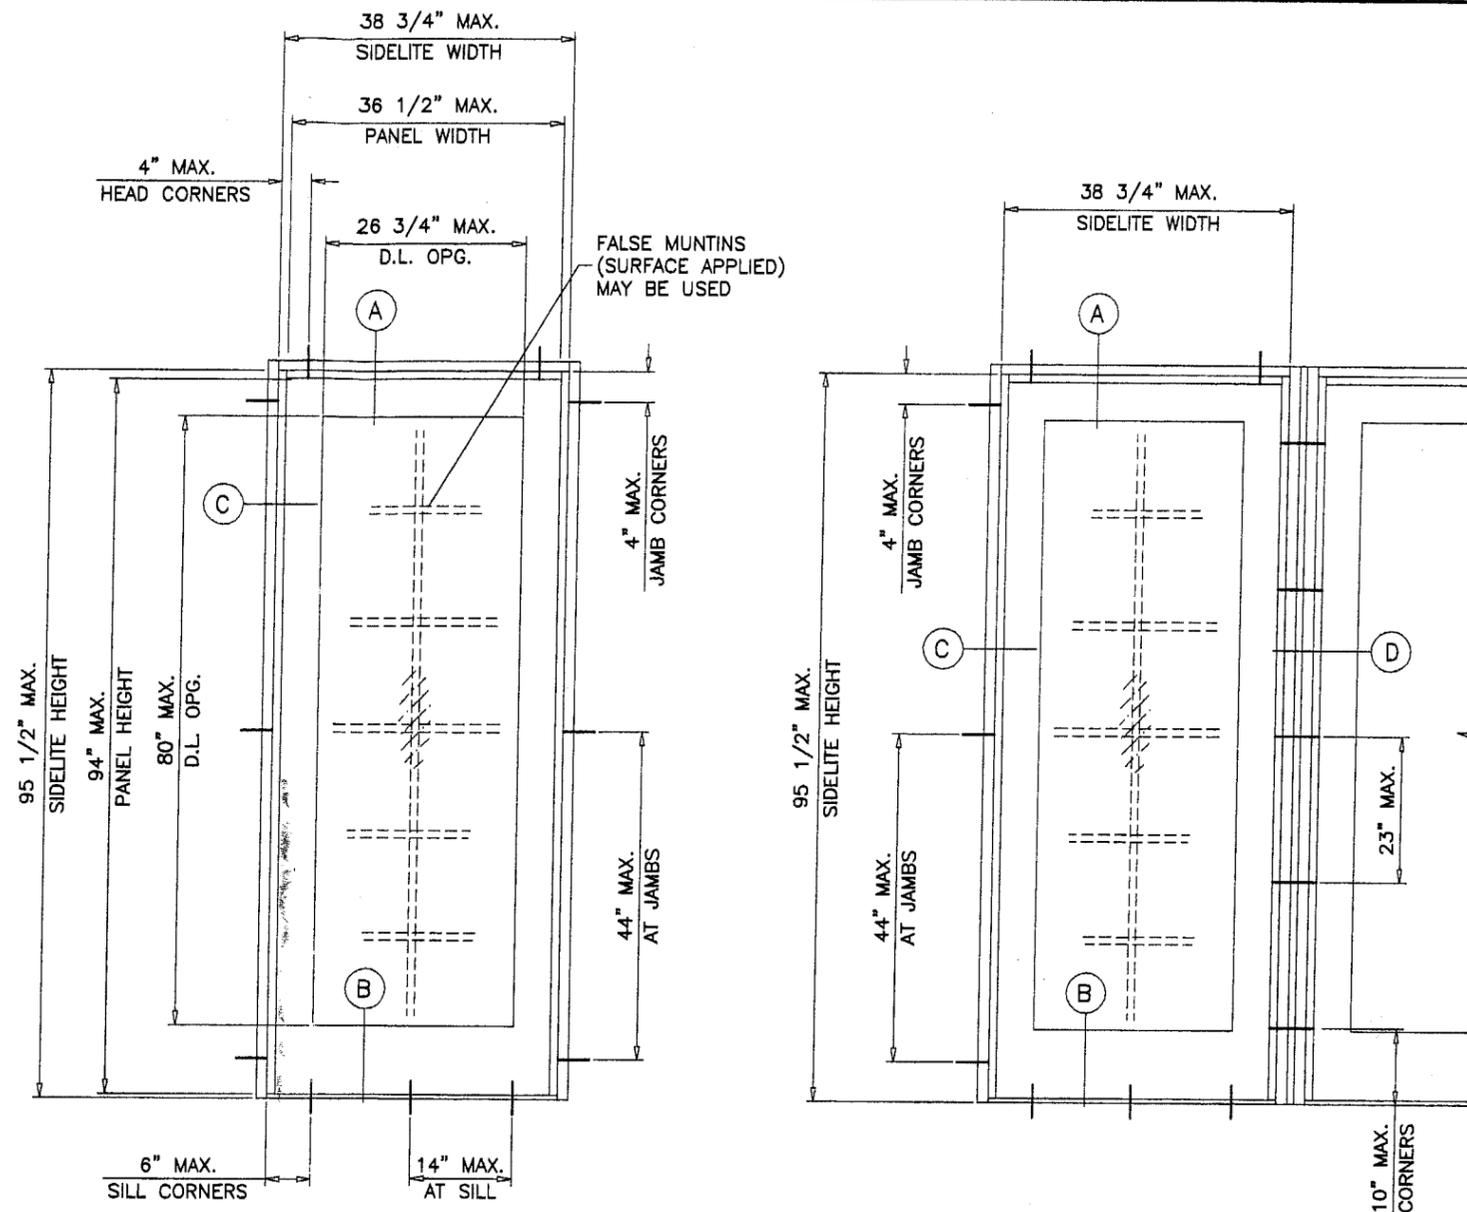

**TYPICAL ELEVATIONS**

**'FRENCH VIEW' ALUM CLAD WOOD DOOR SIDELITES**

SIDELITES GLAZED WITH LAMINATED GLASS RATED FOR LARGE MISSILE IMPACT AND REQUIRE NO SHUTTERS.

THESE PRODUCTS CAN BE INSTALLED AS SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF TWO OR MORE UNITS, ALSO IN COMBINATION WITH MIAMI-DADE COUNTY APPROVED PRODUCTS USING APPROVED MULLIONS IN BETWEEN.


DESIGN LOAD RATING FOR SIDELITES TO BE AS PER CHARTS SHOWN ABOVE.

THIS PRODUCT IS DESIGNED TO COMPLY WITH THE HIGH VELOCITY HURRICANE ZONE OF THE 2001 FLORIDA BUILDING CODE.

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

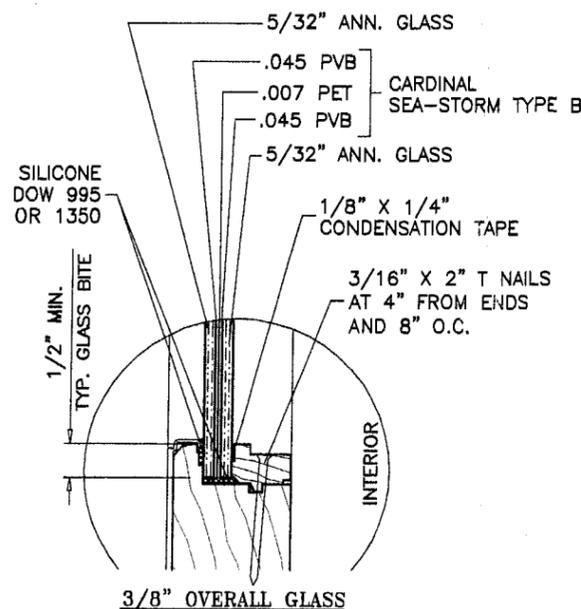

Approved as complying with the Florida Building Code  
 Date 02/19/04  
 NOA# 03-1016-03  
 Miami Dade Product Control  
 Division  
 By *Chas. Berman*

Engr. DR. HUMAYOUN FAROOQ  
 STRUCTURES  
 FLA. PE # 16557  
 C.A.N. 3538  
 OCT 15 2003

**af c**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS, PLANNERS & PRODUCT DESIGN  
 1235 SW 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W03-86JW

---


**'FRENCH VIEW' ALUM CLAD WOOD DOOR SIDELITES**  
**JELD WEN WINDOW DIVISION**  
 201 EVANS ROAD  
 RANTOUL, ILLINOIS 61866  
 TEL. (217) 893-4444 FAX (217) 893-7650

---

no.	date	by	description

---

date: 09-22-03  
 scale: 1/2"=1'-0"  
 dr. by: HAMID  
 chk. by:   
 drawing no. **W03-86**  
 sheet 1 of 5

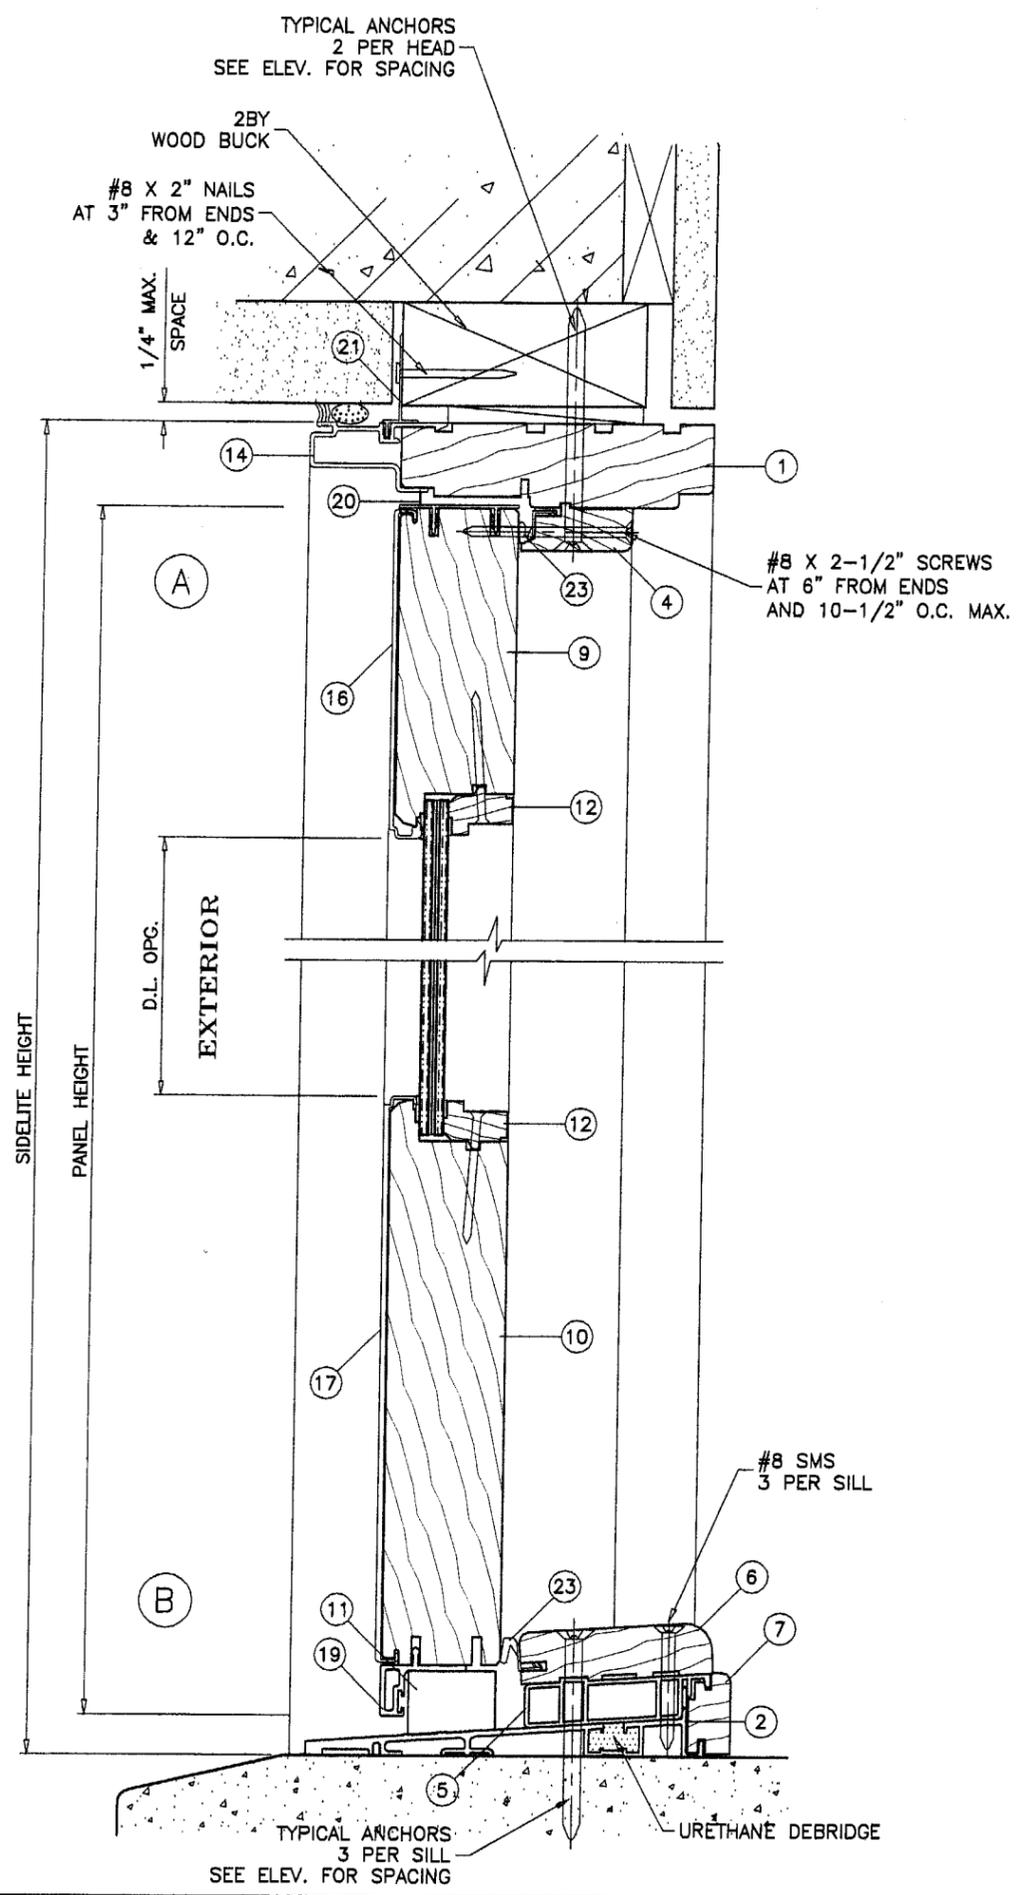

ITEM NO.	NUMBER	QTY.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	MD-11	1	FRAME HEAD	WOOD	JELD-WEN
2	MFD004	1	FRAME SILL	6063-T5	-
3	MD-07	2	FRAME JAMB	WOOD	JELD-WEN
4	MD-05/08	AS REQD.	INTERIOR STOP	WOOD	JELD-WEN
5	MFD044	1	SILL THRESHOLD	RIGID PVC	-
6	MFD014	1	OAK THRESHOLD	WOOD	JELD-WEN
7	MFDJW016	1	OAK SILL TRIM	WOOD	JELD-WEN
8	MD-24	1/ LEAF	FIXED STILE	WOOD	JELD-WEN
9	MD-25	1/ LEAF	TOP RAIL	WOOD	JELD-WEN
10	MD-02	1/ LEAF	BOTTOM RAIL	WOOD	JELD-WEN
11	MFD058	1	SILL SUPPORT BLOCK	PVC	-
12	CA-17	AS REQD.	GLASS STOP (IMPACT)	WOOD	JELD-WEN
13	MFD068	2	SIDE JAMB TRIM STOPS	WOOD	JELD-WEN
14	MFD017	1	HEAD EXTRUSION	6063-T5	-
15	MFD015A	2	JAMB EXTRUSION	6063-T5	-
16	CC-195	1	TOP RAIL CLADDING	6063-T5	-
17	MFD002	1	BOTTOM RAIL CLADDING	6063-T5	-
18	CC-195	2	FIXED STILE CLADDING	6063-75	-
19	MFD030	1/ LEAF	BOTTOM RAIL WEATHERSTRIP CARRIER	PVC	-
20	Q3599	1/ LEAF	PANEL CAP WITH SEAL	PVC	-
21	-	AS REQD.	NAILING FIN	PVC	-
22	Q4379	AS REQD.	PANEL W'STRIPPING	PVC	AMESBURY
23	12103	AS REQD.	FRAME W'STRIPPING, FOAM TIP	PVC	AMESBURY

WOOD BUCKS NOT BY JELD-WEN, MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

**TYPICAL ANCHORS:** SEE ELEV. FOR SPACING

- 1/4" TAPCONS**  
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURE  
 1-1/2" MIN. PENETRATION INTO WOOD  
 THRU 1BY WOOD BUCKS INTO MASONRY OR CONC.  
 1-1/4" MIN. EMBED INTO MASONRY OR CONC.  
 DIRECTLY INTO MASONRY OR CONC.  
 1-1/4" MIN. EMBED INTO MASONRY OR CONC.
- #14 SMS**  
 INTO APPROVED MULLIONS (NO SHIM SPACE)

**SEALANT:**  
 FRAME AND PANEL CORNERS AND INSTALLATION SCREWS AT SILL SEALED WITH SCHNEE-MOREHEAD SM8400 SEALANT.

Approved as complying with the Florida Building Code  
 Date 02/19/04  
 NOAF 03-1016.03  
 Miami Code Product Control  
 Division  
 By *[Signature]*

Engr: DR. HUMAYUN FAROOQ  
 STRUCTURES  
 FLA. PE # 16557  
 C.A.N. 3538  
 OCT 15 2003

**afc**

**AL-FAROOQ CORPORATION**  
 ENGINEERS, PLANNERS & PRODUCT DESIGN  
 1235 SW 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL (305) 264-8100 FAX (305) 262-6978  
 COMP-ANL\W03-86JW


FRENCH VIEW ALUM CLAD WOOD DOOR SIDELITES  
**JELD WEN WINDOW DIVISION**  
 201 EVANS ROAD  
 RANTOUL, ILLINOIS 61866  
 TEL (217) 893-4444 FAX (217) 893-7650

revisions:	no	date	by	description


date: 09-22-03  
 scale: 3/8" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W03-86**  
 sheet 2 of 5


TYPICAL ANCHORS  
SEE ELEV. FOR SPACING

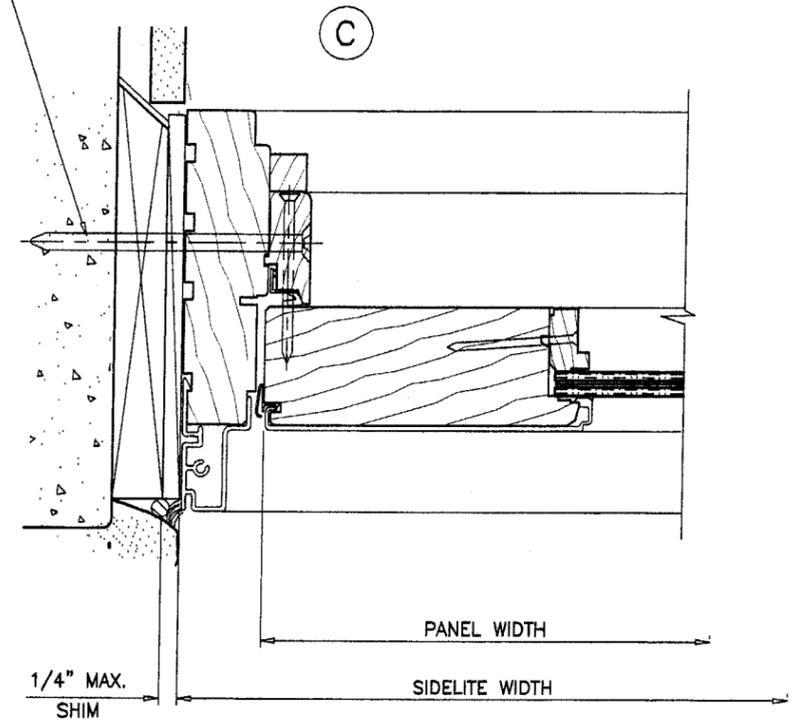

TYPICAL ANCHORS  
SEE ELEV. FOR SPACING

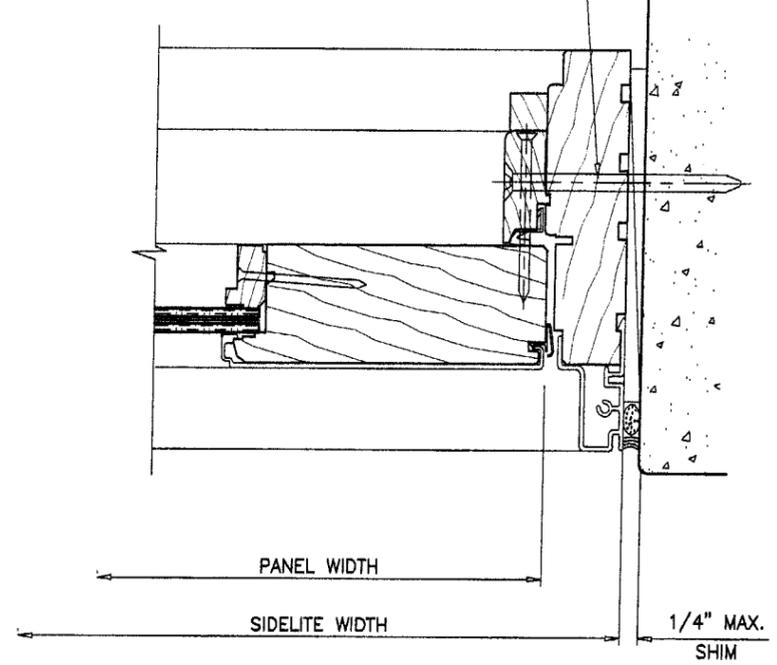


#8 X 2-1/2" SCREWS  
AT 6" FROM ENDS  
AND 10-1/2" O.C. MAX.

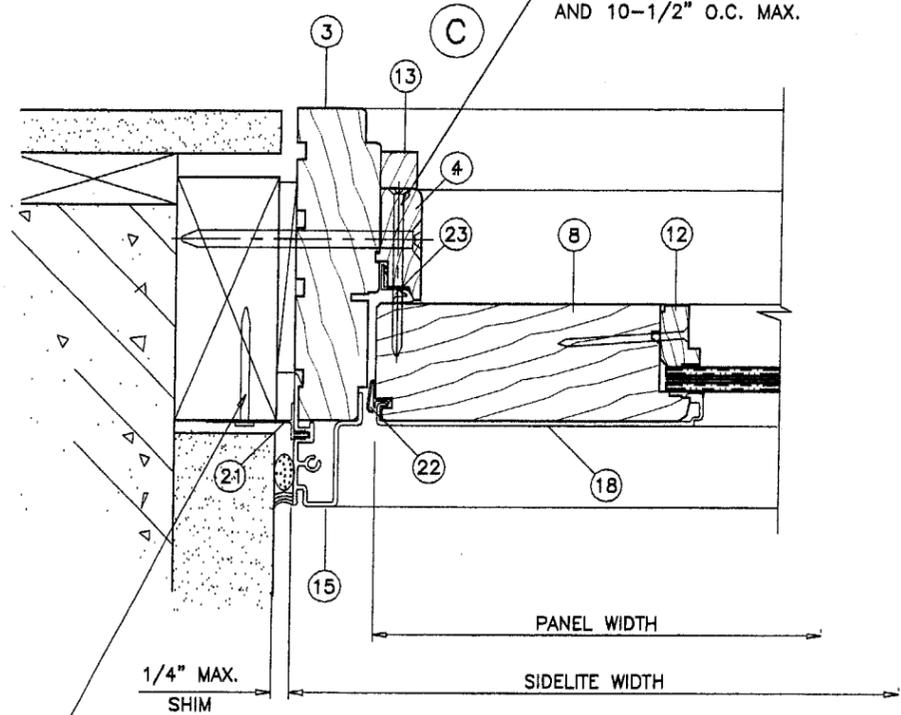

DADE COUNTY APPR'D MULLION  
SEE SEPARATE NOA

TYPICAL ANCHORS  
SEE ELEV. FOR SPACING

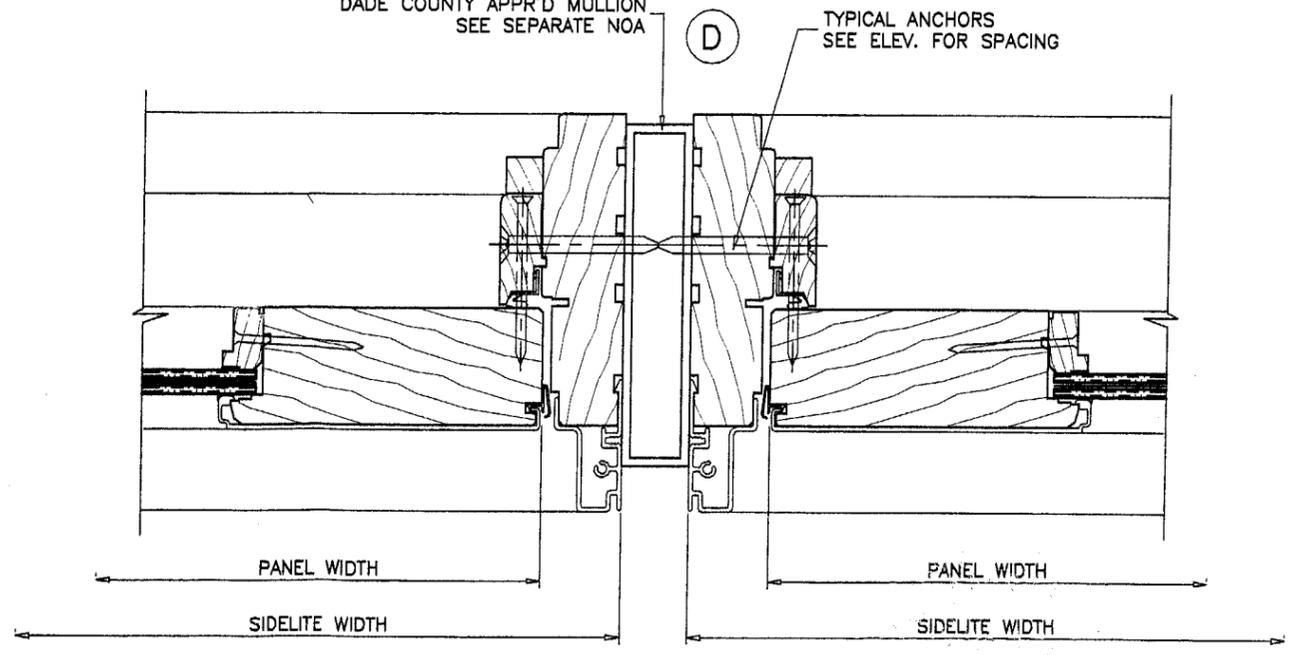

#8 X 2" NAILS  
AT 3" FROM ENDS  
& 12" O.C.

Approved as complying with the  
Florida Building Code  
Date: 02/19/04  
NOA# 03-1016.09  
Miami Dade Product Control  
Division  
By: *Alvin Bermyan*

Engr: DR. HUMAYOON FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538  
*[Signature]*  
OCT 15 2003

*afc*

AL-FAROOQ CORPORATION  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978

'FRENCH VIEW' ALUM CLAD WOOD DOOR SIDELITES  
JELD WEN WINDOW DIVISION  
201 EVANS ROAD  
RANTOUL, ILLINOIS 61866  
TEL (217) 893-4444 FAX (217) 893-7650


COMP-ANL\W03-86JW

revisions:	no	date	by	description


date: 09-22-03  
scale: 3/8" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W03-86**


sheet 3 of 5

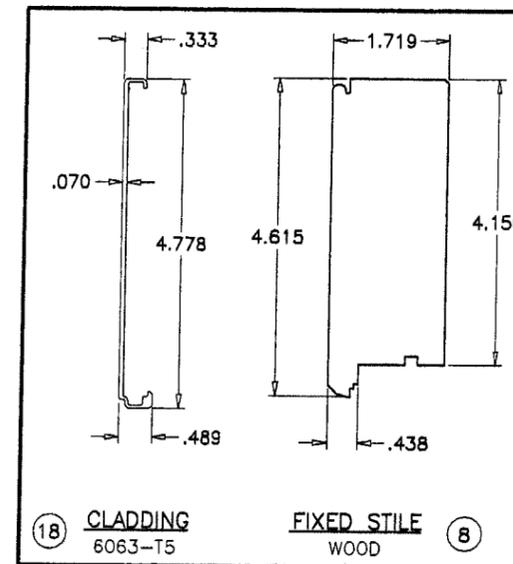


18 CLADDING 6063-T5  
8 FIXED STILE WOOD

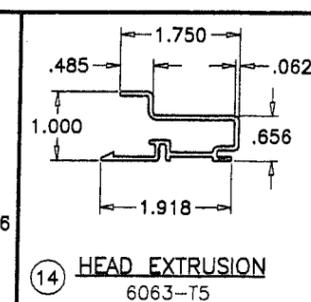


14 HEAD EXTRUSION 6063-T5

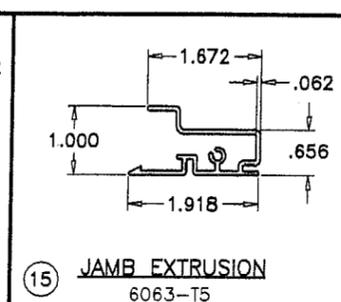


15 JAMB EXTRUSION 6063-T5

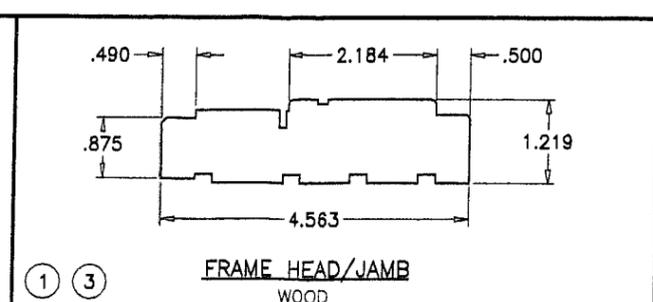


1 3 FRAME HEAD/JAMB WOOD

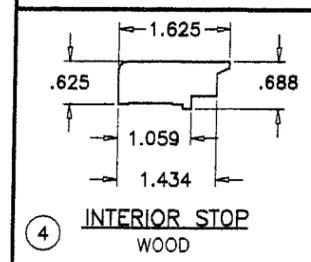


4 INTERIOR STOP WOOD

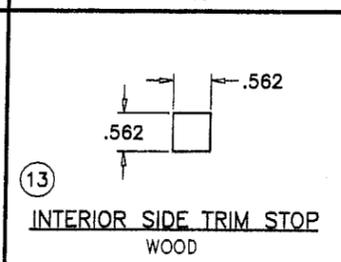


13 INTERIOR SIDE TRIM STOP WOOD

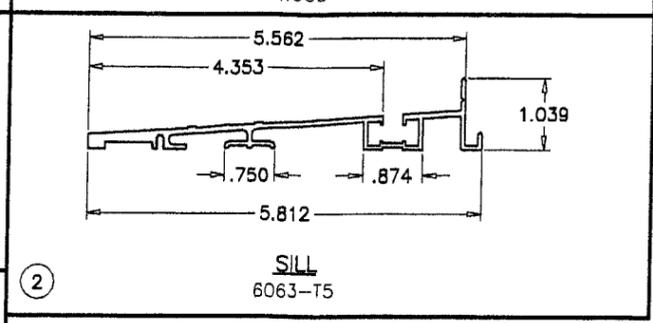


2 SILL 6063-T5

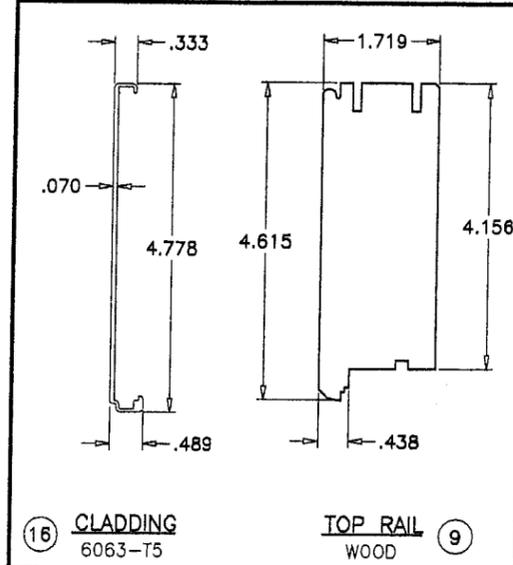


16 CLADDING 6063-T5  
9 TOP RAIL WOOD

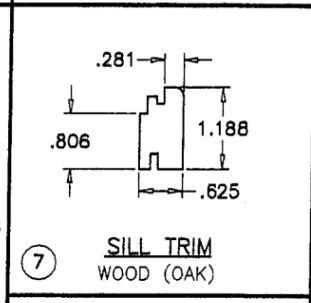


7 SILL TRIM WOOD (OAK)

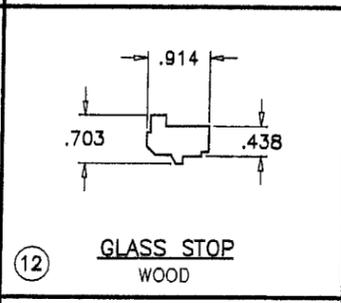


12 GLASS STOP WOOD

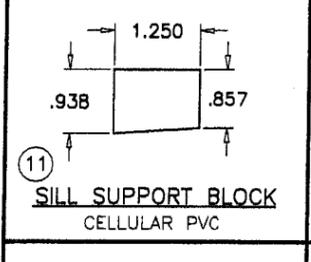


11 SILL SUPPORT BLOCK CELLULAR PVC

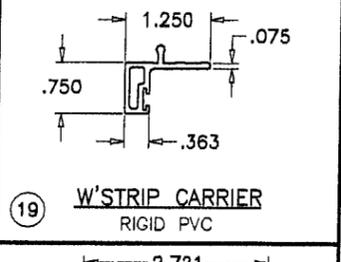


19 W'STRIP CARRIER RIGID PVC

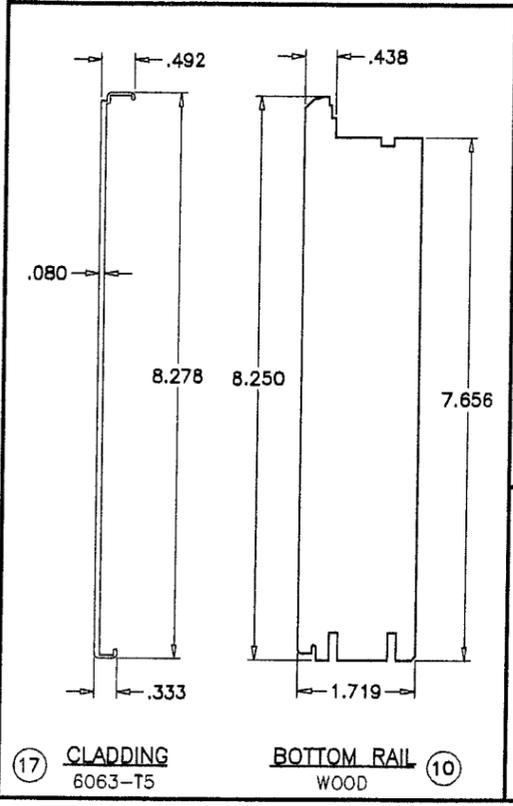


17 CLADDING 6063-T5  
10 BOTTOM RAIL WOOD

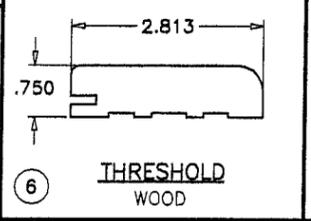

6 THRESHOLD WOOD

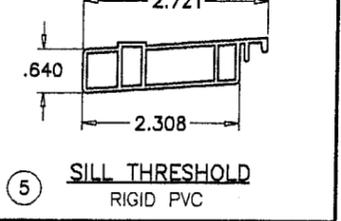


5 SILL THRESHOLD RIGID PVC

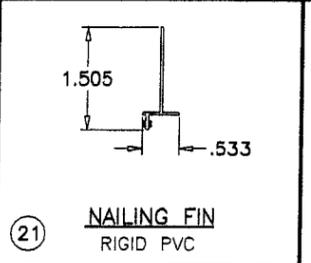

21 NAILING FIN RIGID PVC

TYPICAL WOOD-PONDEROSA PINE

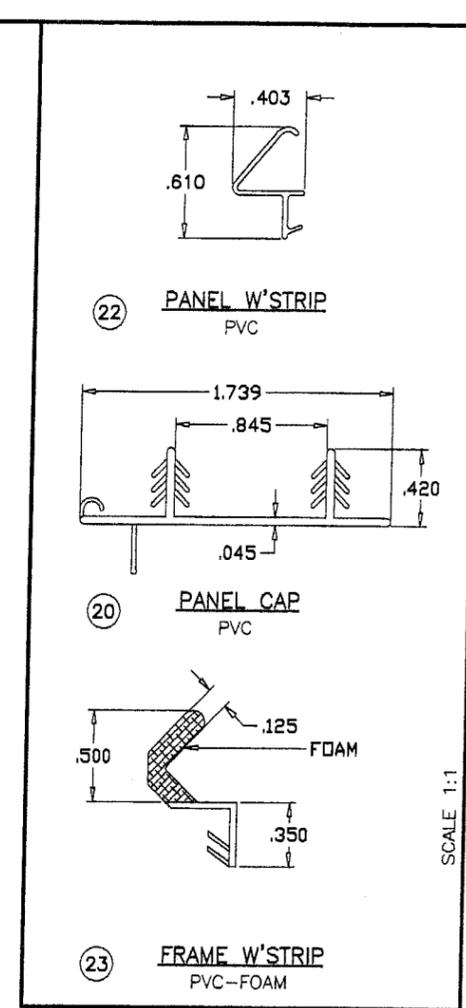

22 PANEL W'STRIP PVC  
20 PANEL CAP PVC  
23 FRAME W'STRIP PVC-FOAM

SCALE 1:1

Approved as complying with the Florida Building Code  
Date 02/19/04  
NOAH 03-1016.02  
Miami Dade Product Control  
Division  
By Alexander Gorman

Engr: DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

OCT 15 2003

AL-FAROOQ CORPORATION  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL (305) 264-8100 FAX (305) 262-6978

FRENCH VIEW ALUM CLAD WOOD DOOR SIDELITES  
JELD WEN WINDOW DIVISION  
201 EVANS ROAD  
RANTOUL, ILLINOIS 61866  
TEL (217) 893-4444 FAX (217) 893-7650

revisions:	no	date	by	description


date: 09-22-03  
scale: 3/8" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
W03-86


sheet 4 of 5

COMP-ANL\W03-86JW


# 8 X 1-1/2" SCREW #6 X 2-1/4" SCREWS

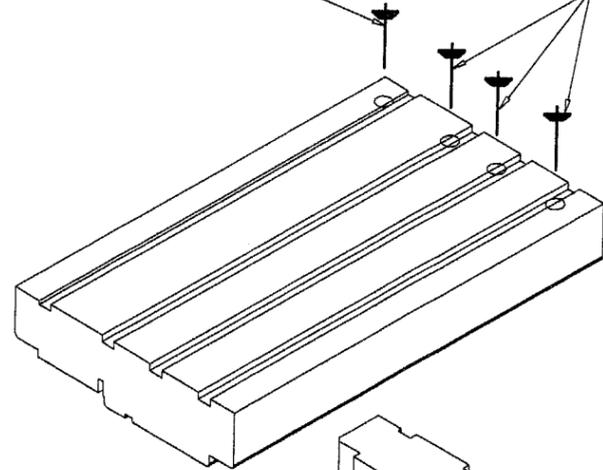

FRAME TOP CORNER

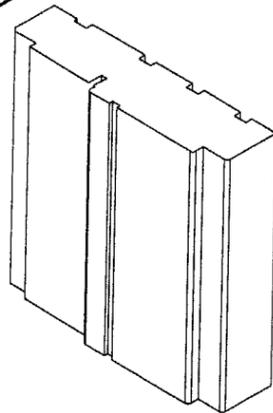


5" X 1/2" WOOD DOWEL

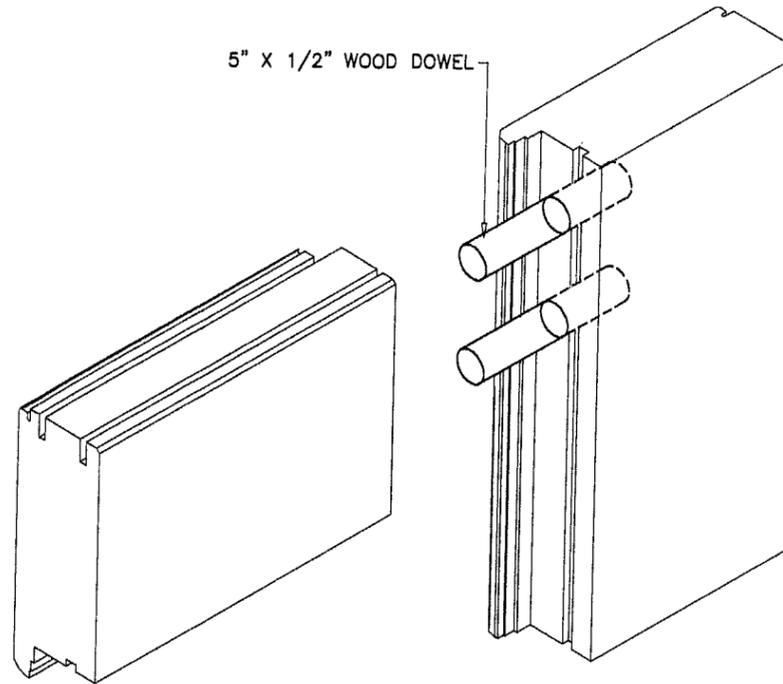

PANEL TOP CORNER

USE JET WELD 200 HOT MELT POUR BY '3M' WITH DOWELS


5" X 1/2" WOOD DOWEL

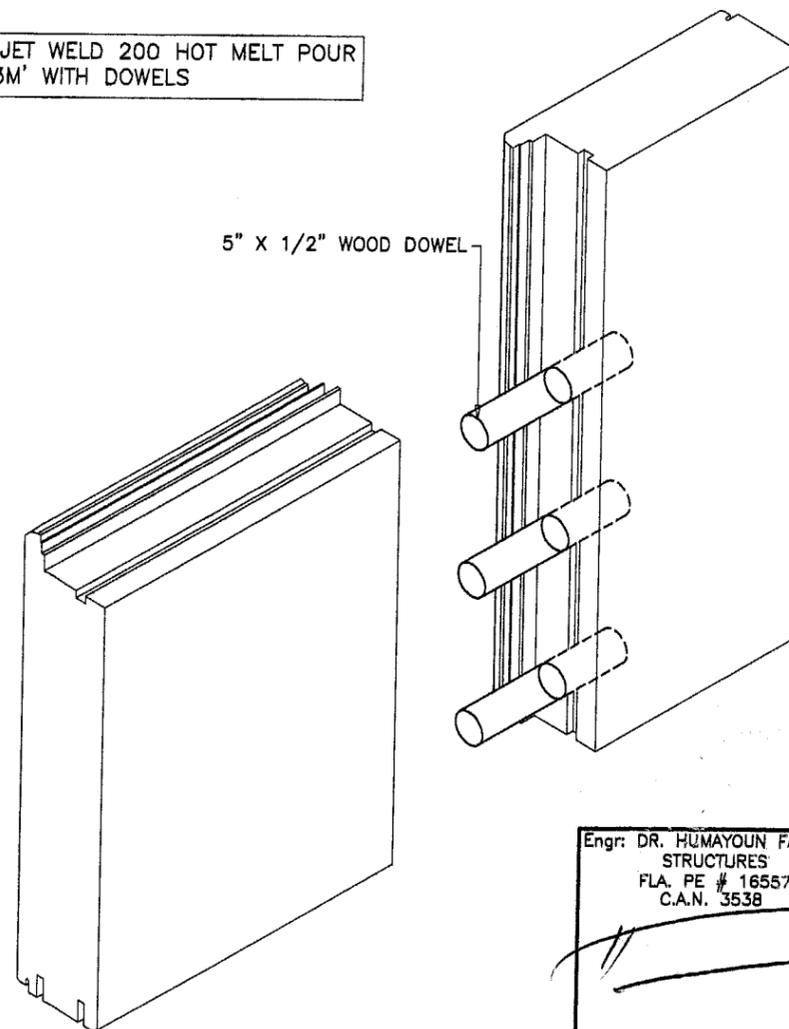

PANEL BOTTOM CORNER

# 8 X 1-1/2" SCREW

#6 X 2-1/4" SCREWS

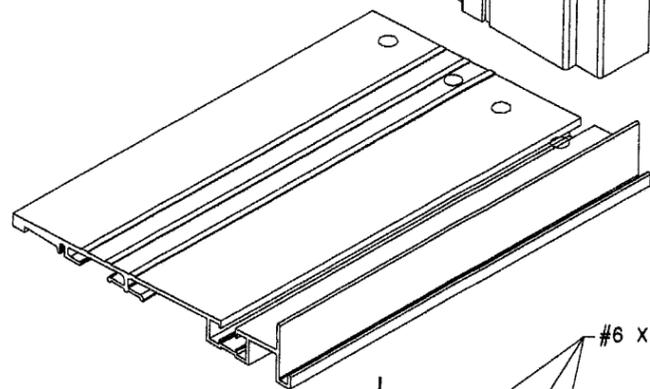

FRAME BOTTOM CORNER

Approved as complying with the  
Florida Building Code  
Date 02/19/04  
NOA# 03-1010-03  
Miami Dept Product Control  
Division  
By *[Signature]*

Engr. DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

OCT 15 2003

*afc*  
AL-FAROOQ CORPORATION  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANI\W03-86JW

'FRENCH VIEW' ALUM CLAD WOOD DOOR SIDELITES  
JELD WEN WINDOW DIVISION  
201 EVANS ROAD  
RANTOUL, ILLINOIS 61866  
TEL (217) 893-4444 FAX (217) 893-7650

revisions:	no	date	by	description

date: 09-22-03  
scale: 3/8" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
W03-86

sheet 5 of 5