



BUILDING CODE COMPLIANCE OFFICE (BCCO)
 PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
 METRO-DADE FLAGLER BUILDING
 140 WEST FLAGLER STREET, SUITE 1603
 MIAMI, FLORIDA 33130-1563
 (305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

Thermo-Kool/Mid-South Industries, Inc.
 723 East 21st Street
 Laurel, Mississippi 39441

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Walk-In Cooler / Freezer

APPROVAL DOCUMENT: Drawing No. 02-564, titled "Walk-In Cooler / Freezer", sheets 1 through 5 of 5, prepared by Knezevich and Associates, Inc., signed and sealed by V. J. Knezevich, P.E., dated October 01, 2003, last revision #1 dated January 21, 2004 bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.


INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1, evidence submitted page(s) as well as approval document mentioned above. The submitted documentation was reviewed by **Helmy A. Makar, P.E.**




Helmy A. Makar
 03/04/2004


NOA No 03-1023.01
 Expiration Date: 03/04/2009
 Approval Date: 03/04/2004
 Page 1

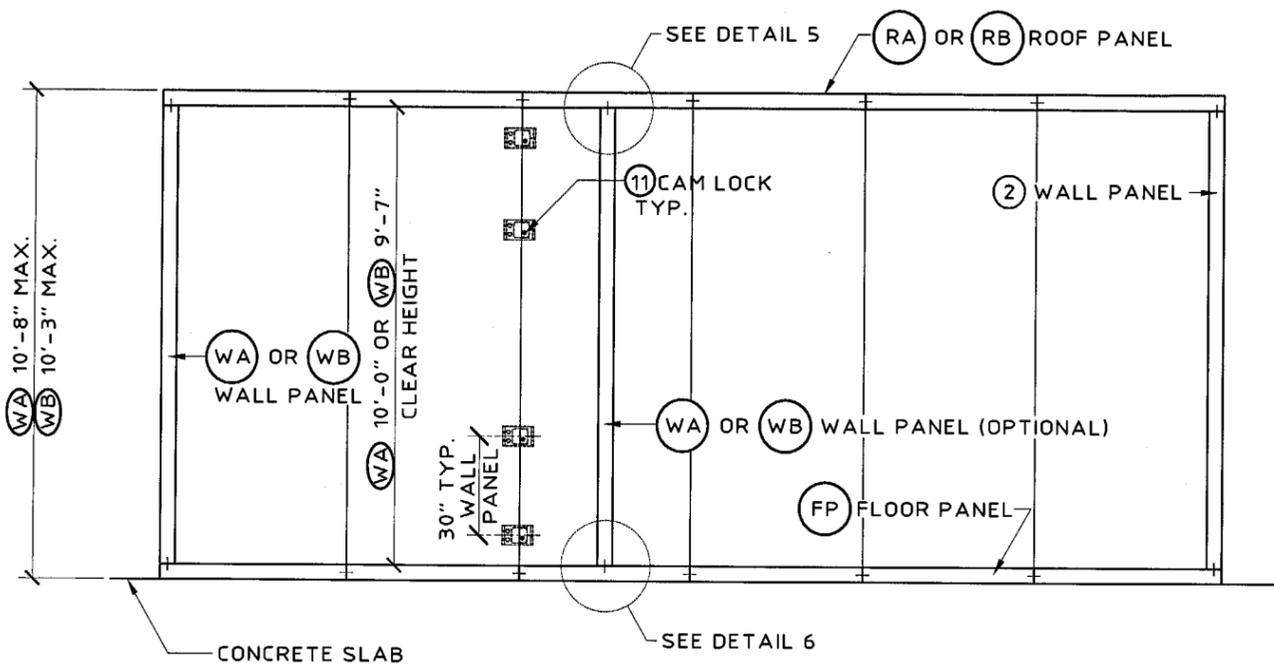

A SECTION (TYP.)
SCALE: 1/4" = 1'-0"

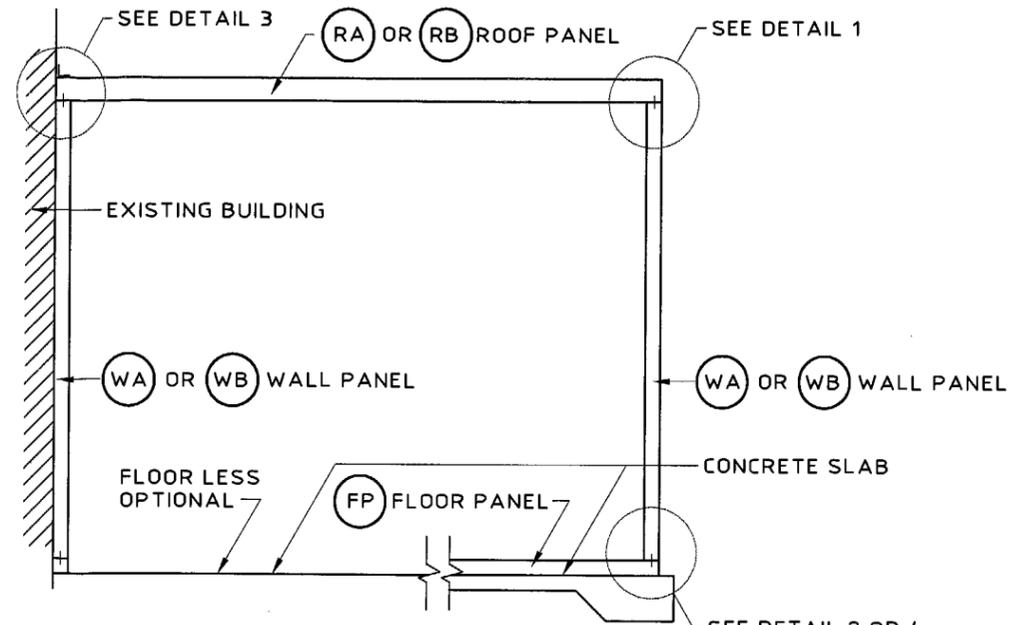


B SECTION (TYP.)
SCALE: 1/4" = 1'-0"

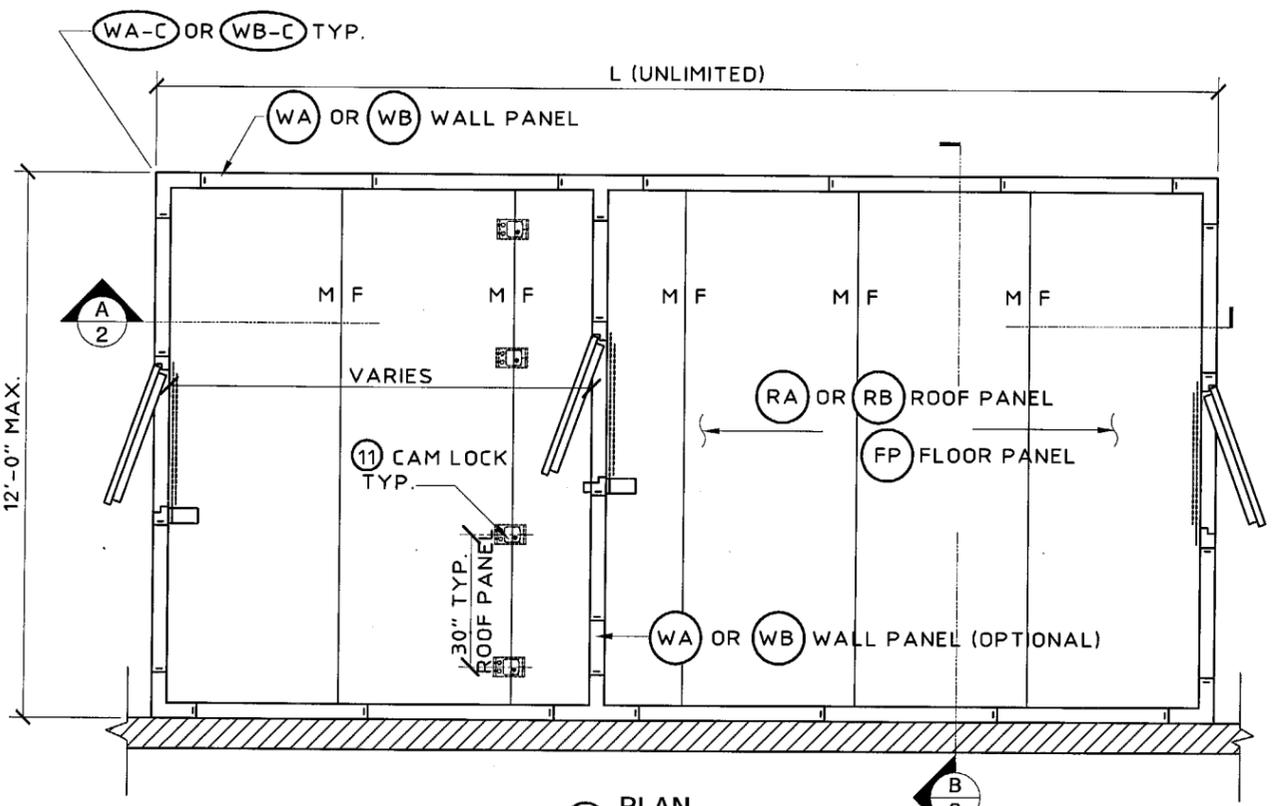

C PLAN
SCALE: 1/4" = 1'-0"


TABLE 1 LOADS FOR FOUNDATION DESIGN	NET WIND UPLIFT (P _V) AND SHEAR (P _H) FORCES	
	ROOF PANEL MAXIMUM SPAN 12'-0"	
P _V	-286 # / FT	
P _H	± 248 # / FT	

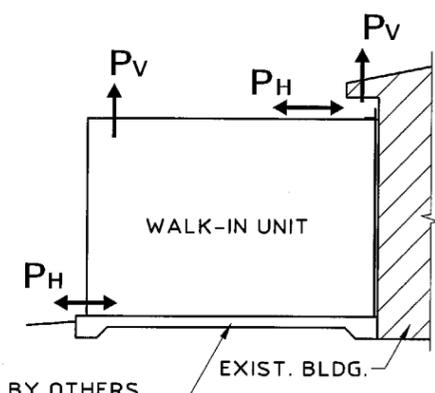

FOUNDATION BY OTHERS
(SEE TABLE 1, FOR LOADS)


D ELEVATION
NTS

TABLE 2 UNIT WIDTH (W) FT - IN	MINIMUM UNIT LENGTH (L) FOR A GIVEN UNIT WITH (W) FT - IN	
	STEEL FACINGS	ALUM. FACINGS
LESS OR EQUAL TO 11'-5"	16'-0"	12'-0"
GREATER THAN 11'-5" UP TO 12'-0"	20'-0"	16'-0"

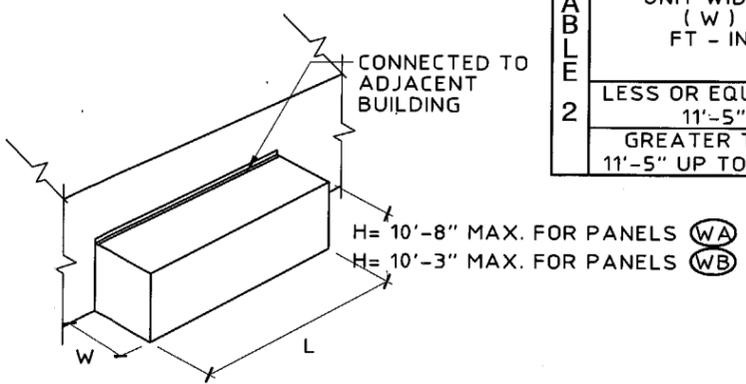

SEE TABLE 2 FOR WIDTH/LENGTH LIMITATION

Approved as complying with the Florida Building Code
Date 03/04/2004
NOA# 03-1023-01
Miami Dade Product Control Division
By Helmy A. Maki



Knezevich & Associates, Inc.
Consulting Engineers • Product Testing
330 N. Andrews Ave., Suite 450 • Ft. Lauderdale, FL 33301
Tel. (954) 522-3690 • Fax (954) 522-3691 • COA # 3205
Website: www.knezevich.com • E-mail: KA@knezevich.com
Copyright © 2004 Knezevich & Associates, Inc.


WALK-IN COOLER/FREEZER
THERMO-KOOL
Mid-South Industries, Inc.
Post Office Box 989
Laurel, Mississippi 39441
TEL: (601) 649-4600
FAX: (601) 649-0558
www.thermokol.com

V.J. Knezevich
Professional Engineer
FL License No.: PE 0010983

JAN 19 2004

no.	date	description	revisions
1	10/21/04/ZMS	COUNTY COMMENTS	

date	10/01/2003
scale	AS NOTED
drawn by	MCR
design by	ZMS
checked by	VJK
drawing no.	02-564
sheet	2 of 5

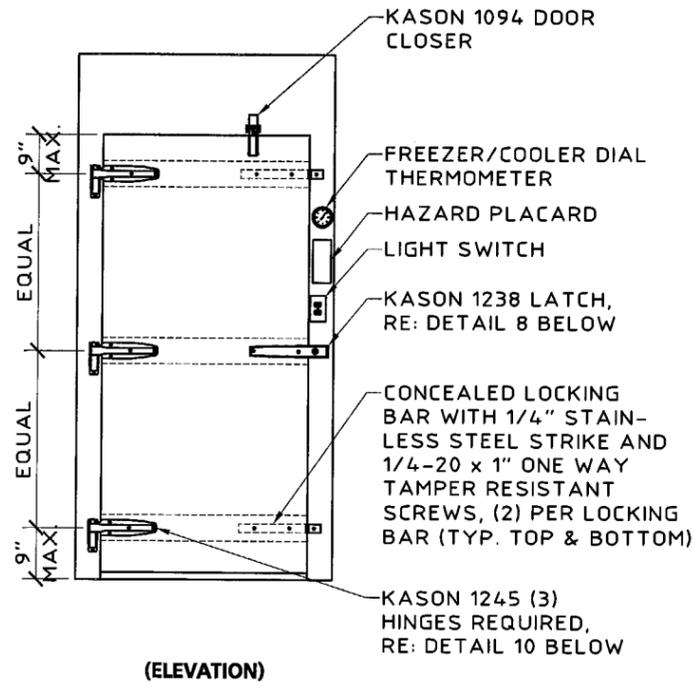


(ELEVATION)

ENTRANCE DOOR EXPOSED TO EXTERIOR

SCALE: 3/8" = 1'-0"

46"x91 3/4" MAX DS WITH 37"x77 11/16" DOOR
OPENING TYPE WA OR WB OR MIX & MATCH

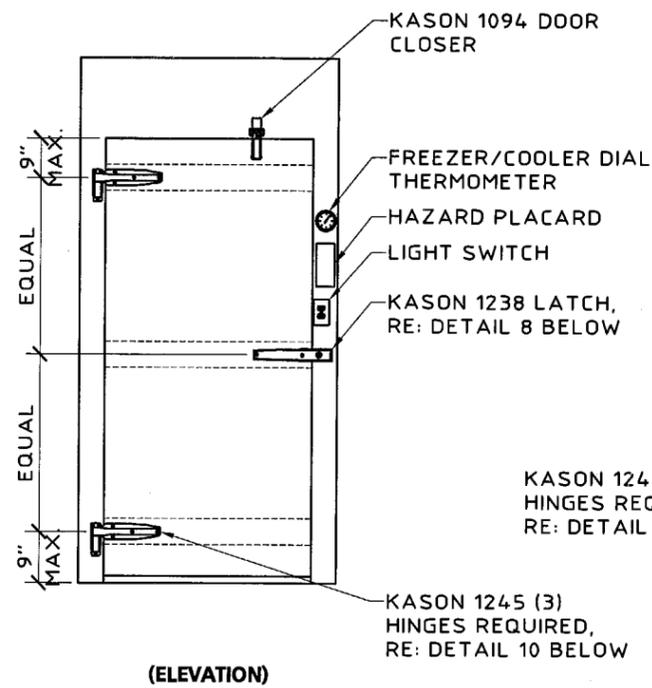


(ELEVATION)

PARTITION DOOR OR UNEXPOSED TO EXTERIOR

SCALE: 3/8" = 1'-0"

46"x91 3/4" MAX DS WITH 37"x77 11/16" DOOR
OPENING TYPE WA OR WB OR MIX & MATCH

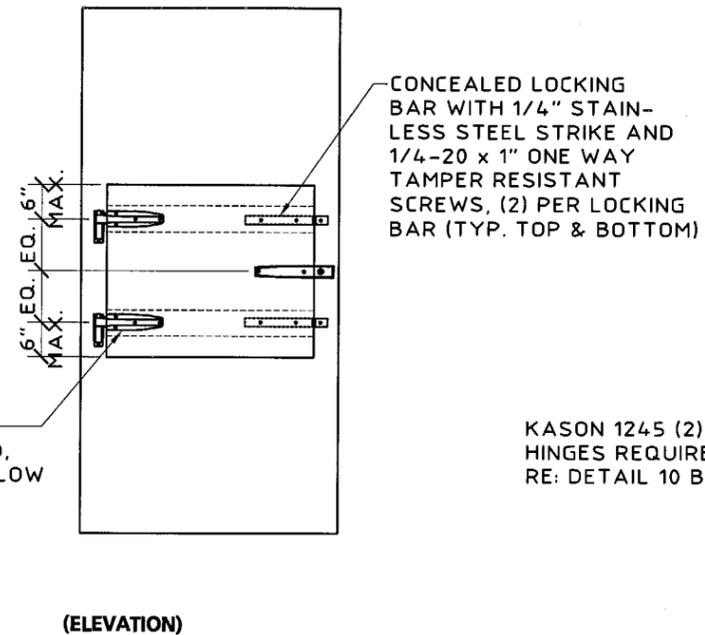


(ELEVATION)

REACH-IN DOOR EXPOSED TO EXTERIOR

SCALE: 3/8" = 1'-0"

46"x91 3/4" MAX DS WITH 30"x30" DOOR
OPENING TYPE WA OR WB OR MIX & MATCH

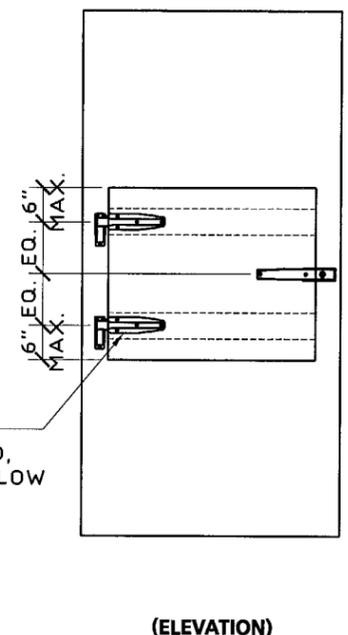


(ELEVATION)


REACH-IN DOOR UNEXPOSED TO EXTERIOR

SCALE: 3/8" = 1'-0"


46"x91 3/4" MAX DS WITH 30"x30" DOOR
OPENING TYPE WA OR WB OR MIX & MATCH

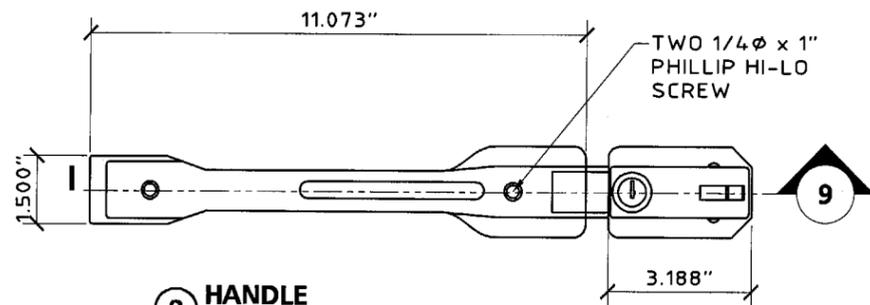

8 HANDLE
SCALE: 3" = 1'-0"

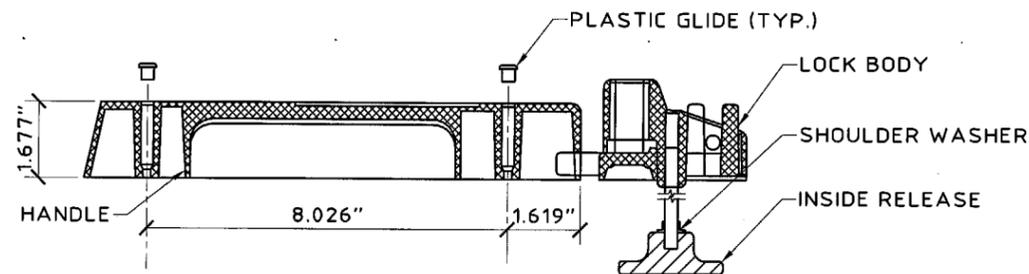

9 SECTION
SCALE: 3" = 1'-0"

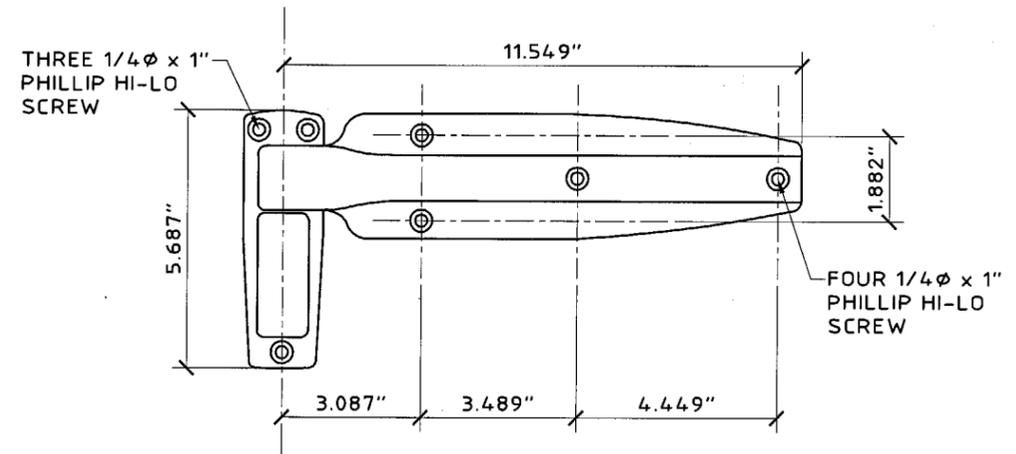

10 HINGES
SCALE: 3" = 1'-0"

Approved as complying with the
Florida Building Code
Date 03/04/2004
NOA# 03-1023.01
Miami Dade Product Control
Division
By Hermy A. Mader



Knezevich & Associates, Inc.
Consulting Engineers • Product Testing
330 N. Andrews Ave., Suite 450 • Ft. Lauderdale, FL 33301
Tel. (954) 522-3690 • Fax (954) 522-3691 • COA # 3205
Website: www.knezevich.com • E-mail: KA@knezevich.com
Copyright © 2004 Knezevich & Associates, Inc.

WALK-IN COOLER/FREEZER
THERMO-KOOL
Mid-South Industries, Inc.
Post Office Box 989
Laurel, Mississippi 39441
TEL: (601) 649-4600
FAX: (601) 649-0558
www.thermokoil.com

V.J. Knezevich
Professional Engineer
FL License No. FE 0410983
JAN 19 2004

no.	date	by	description	COUNTY COMMENTS
1	01/21/04	ZMS		

revisions


date 10/01/2003

scale AS NOTED drawn by MCR


design by ZMS checked by VJK

drawing no. **02-564**



sheet 4 of 5

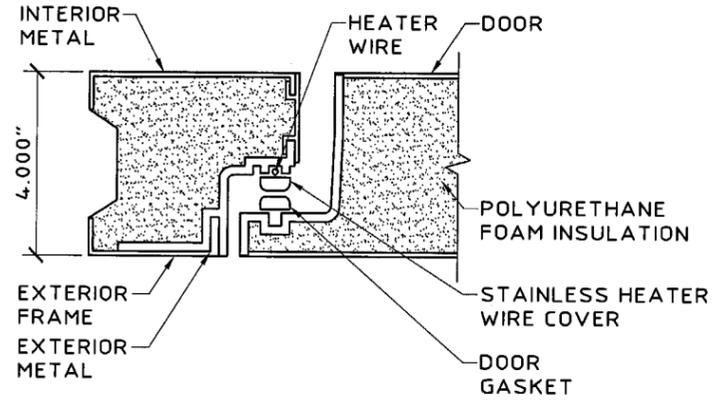


13 DOOR JAMB
SCALE: 3" = 1' - 0"

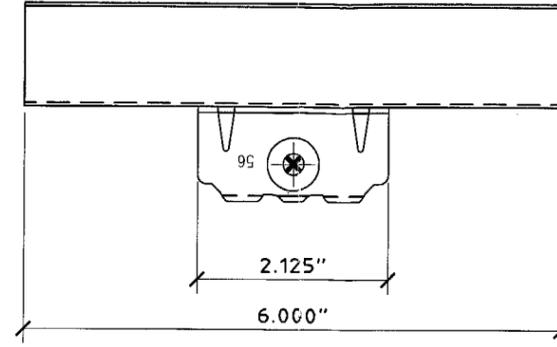

STRIKE ASSEMBLY

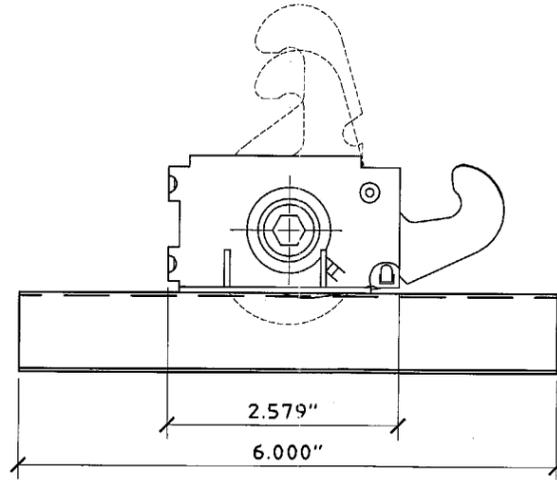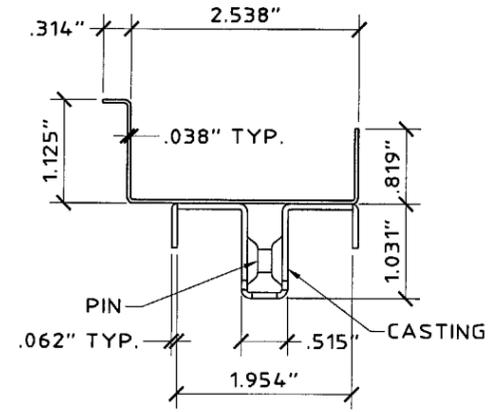


SHORT HOOK ASSEMBLY

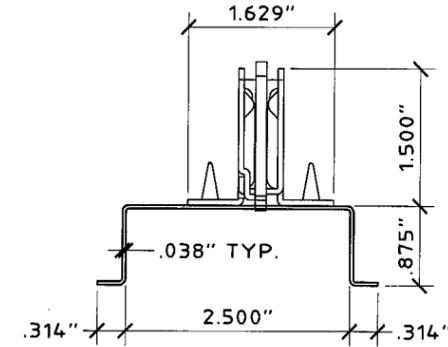

14 CAMLOCK DETAILS BY KASON INDUSTRIES, INC.
SCALE: HALF SIZE

Approved as complying with the
 Florida Building Code
 Date 03/04/2004
 NOA# 03-1023.01
 Miami Dade Product Control
 Division
 By Helmut A. Habel



Knezevich & Associates, Inc.
 Consulting Engineers • Product Testing
 330 N. Andrews Ave., Suite 450 • Ft. Lauderdale, FL 33301
 Tel. (954) 522-3690 • Fax (954) 522-3691 • COA # 3205
 Website: www.Knezevich.com • E-mail: KA@Knezevich.com
 Copyright © 2004 Knezevich & Associates, Inc.

WALK-IN COOLER/FREEZER
 THERMO-KOOL
 Mid-South Industries, Inc.
 Post Office Box 989
 Laurel, Mississippi 39441
 TEL: (601) 649-4600
 FAX: (601) 649-0658
 www.thermokol.com

V.J. Knezevich
 Professional Engineer
 FL License No.: FE 0010983

JAN 19 2004

no.	date	by	description
1	01/21/04	ZMS	COUNTY COMMENTS

revisions

date 10/01/2003

scale AS NOTED drawn by MCR

design by ZMS checked by VJK

drawing no. 02-564

sheet 5 of 5