



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Jeld-Wen, Inc.
201 Evans Rd.
Rantoul, IL 61866**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Tradition Plus" Aluminum Clad Wood Casement Window.

APPROVAL DOCUMENT: Drawing No. **W03-93**, titled "Tradition Plus Alum Clad Wood Casement", sheets 1 through 4 of 4, prepared by Al-Farooq Corporation, dated 10/15/03, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and Approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Theodore Berman, P.E.**

TMB
2/9/2004


**NOA No 03-1204.02
Expiration Date: March 04, 2009
Approval Date: March 04, 2004
Page 1**

Jeld-Wen, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **W03-93**, titled "Tradition Plus Alum Clad Wood Casement", sheets 1 through 4 of 4, prepared by Al-Farooq Corporation, dated 10/15/03, signed and sealed by Humayoun Farooq, P.E.

B. TESTS

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
along with marked-up drawings and installation diagram of a Tradition Plus Casement Window, prepared by Stork Twin City Testing Corporation, Test Report No. **TCTCW103005**, dated 09/26/03, signed and sealed by John Lee, P.E.

A. CALCULATIONS

1. Anchor Calculations, ASTM-E1300-98, and structural analysis, dated 10/14/03, prepared by Al Farooq Corporation, signed and sealed by Humayoun Farooq, P.E.

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

B. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **03-0417.01** issued to Cardinal L.G. for their "Laminated Glass Cardinal Sea-Storm Type B" dated 05/15/03, expiring on 12/30/07.

E. STATEMENTS

1. Statement letter of conformance, dated October 14, 2003, signed and sealed by Humayoun Farooq, P.E.
2. Statement letter of no financial interest, dated October 14, 2003, signed and sealed by Humayoun Farooq, P.E.

F. QUALITY ASSURANCE

1. Miami Dade County Building Code Compliance Office.

G. OTHER

1. Letter from the consultant stating that the product is in compliance with the Florida Building Code (FBC)


Theodore Berman, P.E.

Deputy Director, Product Control Division

NOA No 03-1204.02

Expiration Date: March 04, 2009

Approval Date: March 04, 2004

DESIGN LOAD CAPACITY - PSF			
WINDOW DIMS.		5/16" LAM. ANN. GLASS	
WIDTH	HEIGHT	EXT. (+)	INT. (-)
17"	32" (2)	66.0	80.0
20"		66.0	80.0
24"		66.0	80.0
28"		66.0	80.0
30"		66.0	80.0
36"		66.0	70.0
17"	36" (2)	66.0	80.0
20"		66.0	80.0
24"		66.0	80.0
28"		66.0	80.0
30"		66.0	74.7
36"		62.2	62.2
17"	40" (2)	66.0	80.0
20"		66.0	80.0
24"		66.0	80.0
28"		66.0	72.0
30"		66.0	67.2
36"		56.0	56.0
17"	48" (3)	66.0	80.0
20"		66.0	80.0
24"		66.0	80.0
28"		66.0	80.0
30"		66.0	80.0
36"		66.0	70.0
17"	56" (3)	66.0	80.0
20"		66.0	80.0
24"		66.0	80.0
28"		66.0	77.1
30"		66.0	72.0
36"		60.0	60.0
17"	60" (3)	66.0	80.0
20"		66.0	80.0
24"		66.0	80.0
28"		66.0	72.0
30"		66.0	67.2
36"		56.0	56.0
17"	64" (3)	66.0	80.0
20"		66.0	80.0
24"		66.0	78.8
28"		66.0	67.5
30"		63.0	63.0
17"	72" (3)	66.0	80.0
20"		66.0	80.0
24"		66.0	70.0
28"		60.0	60.0
30"		56.0	56.0

() = NO. OF ANCHORS PER JAMB

DESIGN LOAD CAPACITY - PSF			
WINDOW DIMS.		5/16" LAM. ANN. GLASS	
WIDTH	HEIGHT	EXT. (+)	INT. (-)
17"	32" (3)	66.0	80.0
20"		66.0	80.0
24"		66.0	80.0
28"		66.0	80.0
30"		66.0	80.0
36"		66.0	80.0
17"	36" (3)	66.0	80.0
20"		66.0	80.0
24"		66.0	80.0
28"		66.0	80.0
30"		66.0	80.0
36"		66.0	80.0
17"	40" (3)	66.0	80.0
20"		66.0	80.0
24"		66.0	80.0
28"		66.0	80.0
30"		66.0	80.0
36"		66.0	80.0
17"	48" (4)	66.0	80.0
20"		66.0	80.0
24"		66.0	80.0
28"		66.0	80.0
30"		66.0	80.0
36"		66.0	80.0
17"	56" (4)	66.0	80.0
20"		66.0	80.0
24"		66.0	80.0
28"		66.0	80.0
30"		66.0	80.0
36"		66.0	78.1
17"	60" (4)	66.0	80.0
20"		66.0	80.0
24"		66.0	80.0
28"		66.0	80.0
30"		66.0	80.0
36"		66.0	72.5
17"	64" (4)	66.0	80.0
20"		66.0	80.0
24"		66.0	80.0
28"		66.0	80.0
30"		66.0	80.0
17"	72" (4)	66.0	80.0
20"		66.0	80.0
24"		66.0	80.0
28"		66.0	80.0
30"		66.0	74.7

() = NO. OF ANCHORS PER JAMB

WINDOWS GLAZED WITH LAMINATED GLASS RATED FOR LARGE MISSILE IMPACT AND REQUIRE NO SHUTTERS.

TRADITION PLUS ALUM CLAD WOOD CASEMENT WINDOW

THESE PRODUCTS CAN BE INSTALLED AS SINGLE UNITS, ALSO IN COMBINATION WITH MIAMI-DADE COUNTY APPROVED PRODUCTS USING APPROVED MULLIONS IN BETWEEN.


DESIGN LOAD RATING FOR WINDOWS TO BE AS PER CHARTS SHOWN ABOVE.

THIS PRODUCT IS DESIGNED TO COMPLY WITH THE HIGH VELOCITY HURRICANE ZONE OF THE 2001 FLORIDA BUILDING CODE.

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

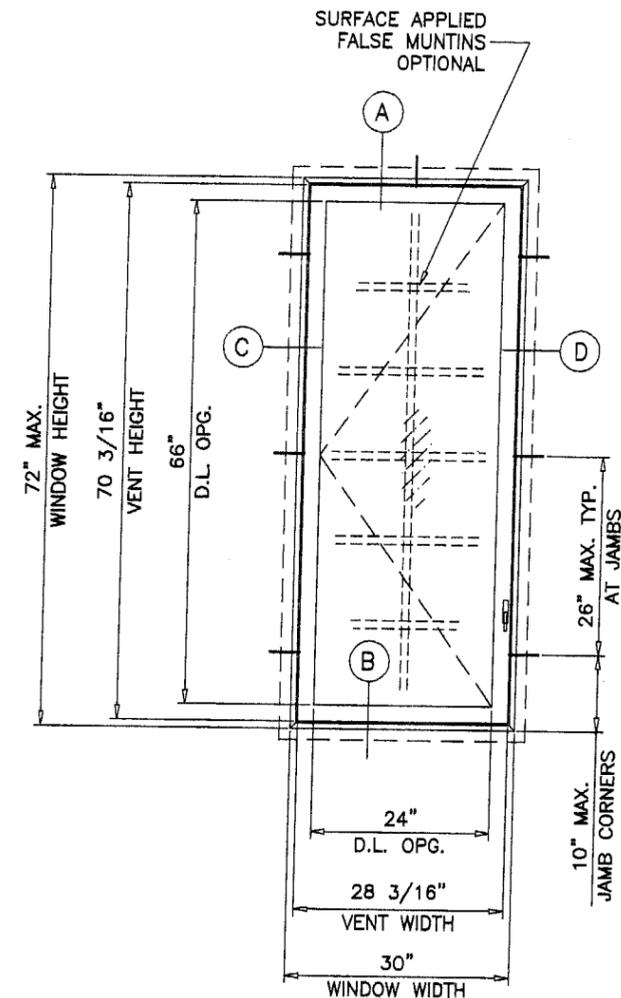

TYPICAL ELEVATION
TESTED UNIT

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

NOV 20 2003

Approved as complying with the
Florida Building Code
Date 03/04/04
NGA# 03-1204.02
Miami Dade Product Control
Division
By *Alfredo Roman*

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W03-93JW

TRADITION PLUS ALUM CLAD WOOD CASEMENT WDW.




JELD WEN WINDOW DIVISION
201 EVANS ROAD
RANTOUL, ILLINOIS 61866
TEL. (217) 893-4444 FAX (217) 893-7650

no.	date	by	description

date: 10-15-03
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:

drawing no.
W03-93

sheet 1 of 4

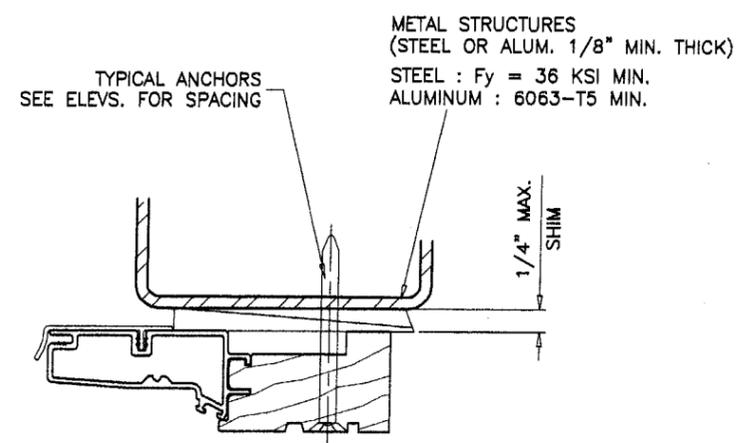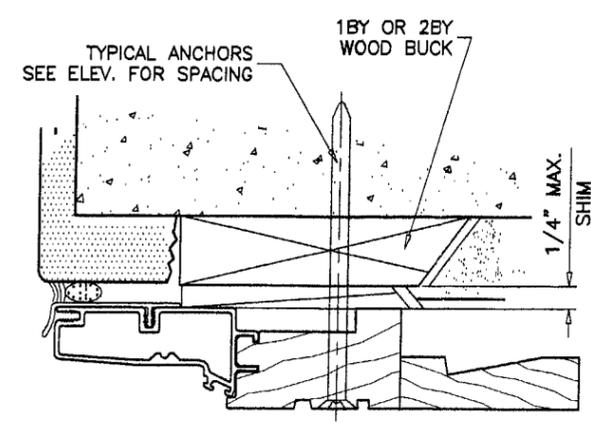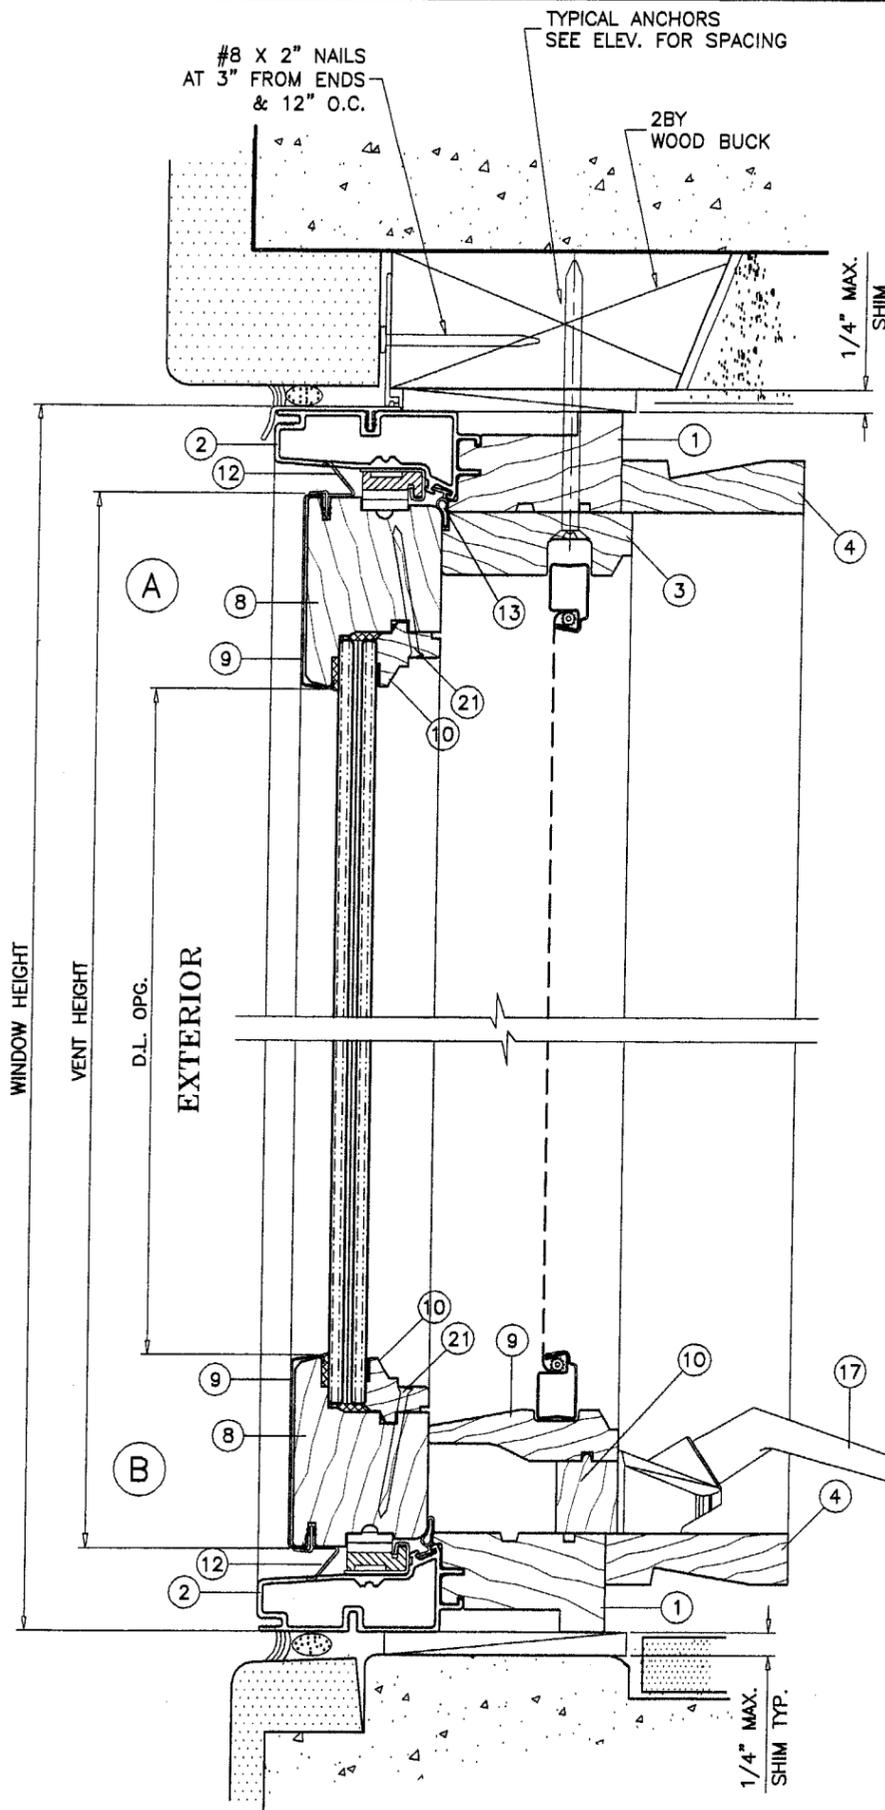


WOOD BUCKS NOT BY JELD-WEN, MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" TAPCONS
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURE
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY WOOD BUCKS INTO MASONRY OR CONC.
 1-1/4" MIN. EMBED INTO MASONRY OR CONC.
 DIRECTLY INTO MASONRY OR CONC.
 1-1/4" MIN. EMBED INTO MASONRY OR CONC.

#14 SMS
 INTO APPROVED MULLIONS (NO SHIM SPACE)

LOCKS:
 SINGLE ACTUATED 2 POINT OR 3 POINT LOCK SYSTEM BY 'ASHLAND' AT LOCK STILE WITH METAL KEEPERS AT FRAME JAMB.

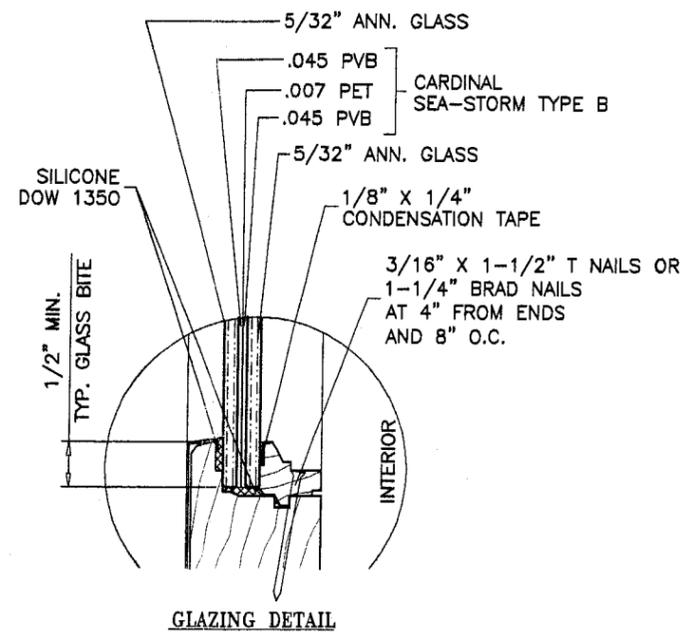

Approved as complying with the Florida Building Code
 Date 03/04/04
 NOAN 03-1204.02
 Miami Dade Product Control
 Division
 By *[Signature]*

Engr: DR. HILMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

NOV 20 2003

afc

AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W03-93JW

TRADITION PLUS ALUM CLAD WOOD CASEMENT WDW.

JELD WEN WINDOW DIVISION
 201 EVANS ROAD
 RANTOUL, ILLINOIS 61866
 TEL (217) 893-4444 FAX (217) 893-7650


no	date	by description

date: 10-15-03
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:


drawing no.
W03-93

sheet 2 of 4

DADE COUNTY APPR'D MULLION
SEE SEPARATE NOA

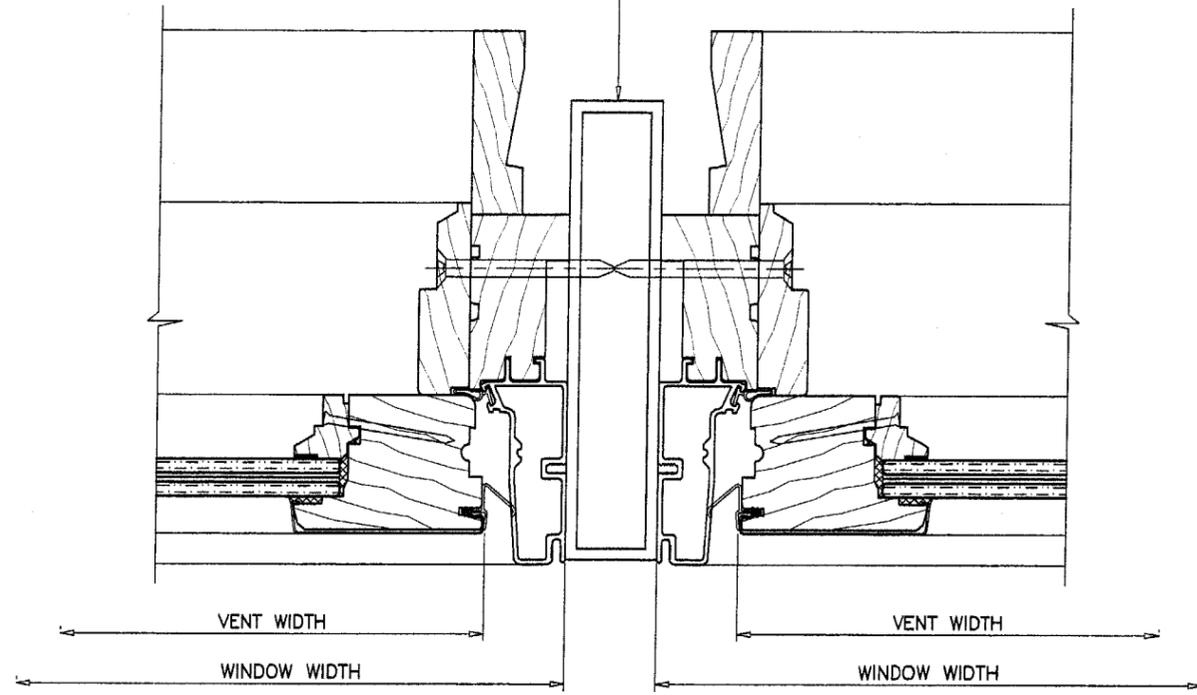

ITEM #	PART NO.	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	CA-259/260	4	FRAME HEAD/SILL/JAMB	WOOD	JELD-WEN
2	CC-182	4	FRAME NOSING	6063-T5	-
3	CA-255	1	HEAD STOP	WOOD	JELD-WEN
4	CA-281/282	AS REQD.	X-JAMB (OPTIONAL)	WOOD	JELD-WEN
5	CA-253/254	2	SIDE STOP	WOOD	JELD-WEN
6	CA-256	1	SILL COVER 'A'	WOOD	JELD-WEN
7	CA-258	1	SILL COVER 'B'	WOOD	JELD-WEN
8	CA-250/251	4	VENT	WOOD	JELD-WEN
9	-	4	VENT COVER	3105-H16	-
10	CA-267/268	4	GLASS STOP	WOOD	JELD-WEN
11	-	-	-	-	JELD-WEN
12	Q4783	AS REQD.	VENT W'STRIPPING	POLYPROPYLENE	PLASTIC PROFILES
13	Q3334	-	BULB W'STRIPPING	PVC	AMESBURY
14	-	-	-	-	-
15	-	1/ WDW.	2 POINT OR 3 POINT LOCK SYSTEM	STEEL	ASHLAND
16	-	2/ VENT	KEEPERS AT LOCK LOCATIONS	STEEL	AT VENT
17	-	1/ VENT	DUAL ARM ROTO-GEAR OPERATOR SYSTEM	-	TRUTH
18	-	2/ VENT	SERIES 14 2BAR HINGES	STEEL	TRUTH
19	-	3/ VENT	CONCEALED INTERLOCKING SNUBBER	-	TRUTH
20	-	-	-	-	-
21	3/16" X 1-1/2"	AS REQD.	'T' NAILS	-	AT 4" FROM ENDS & 8" O.C.

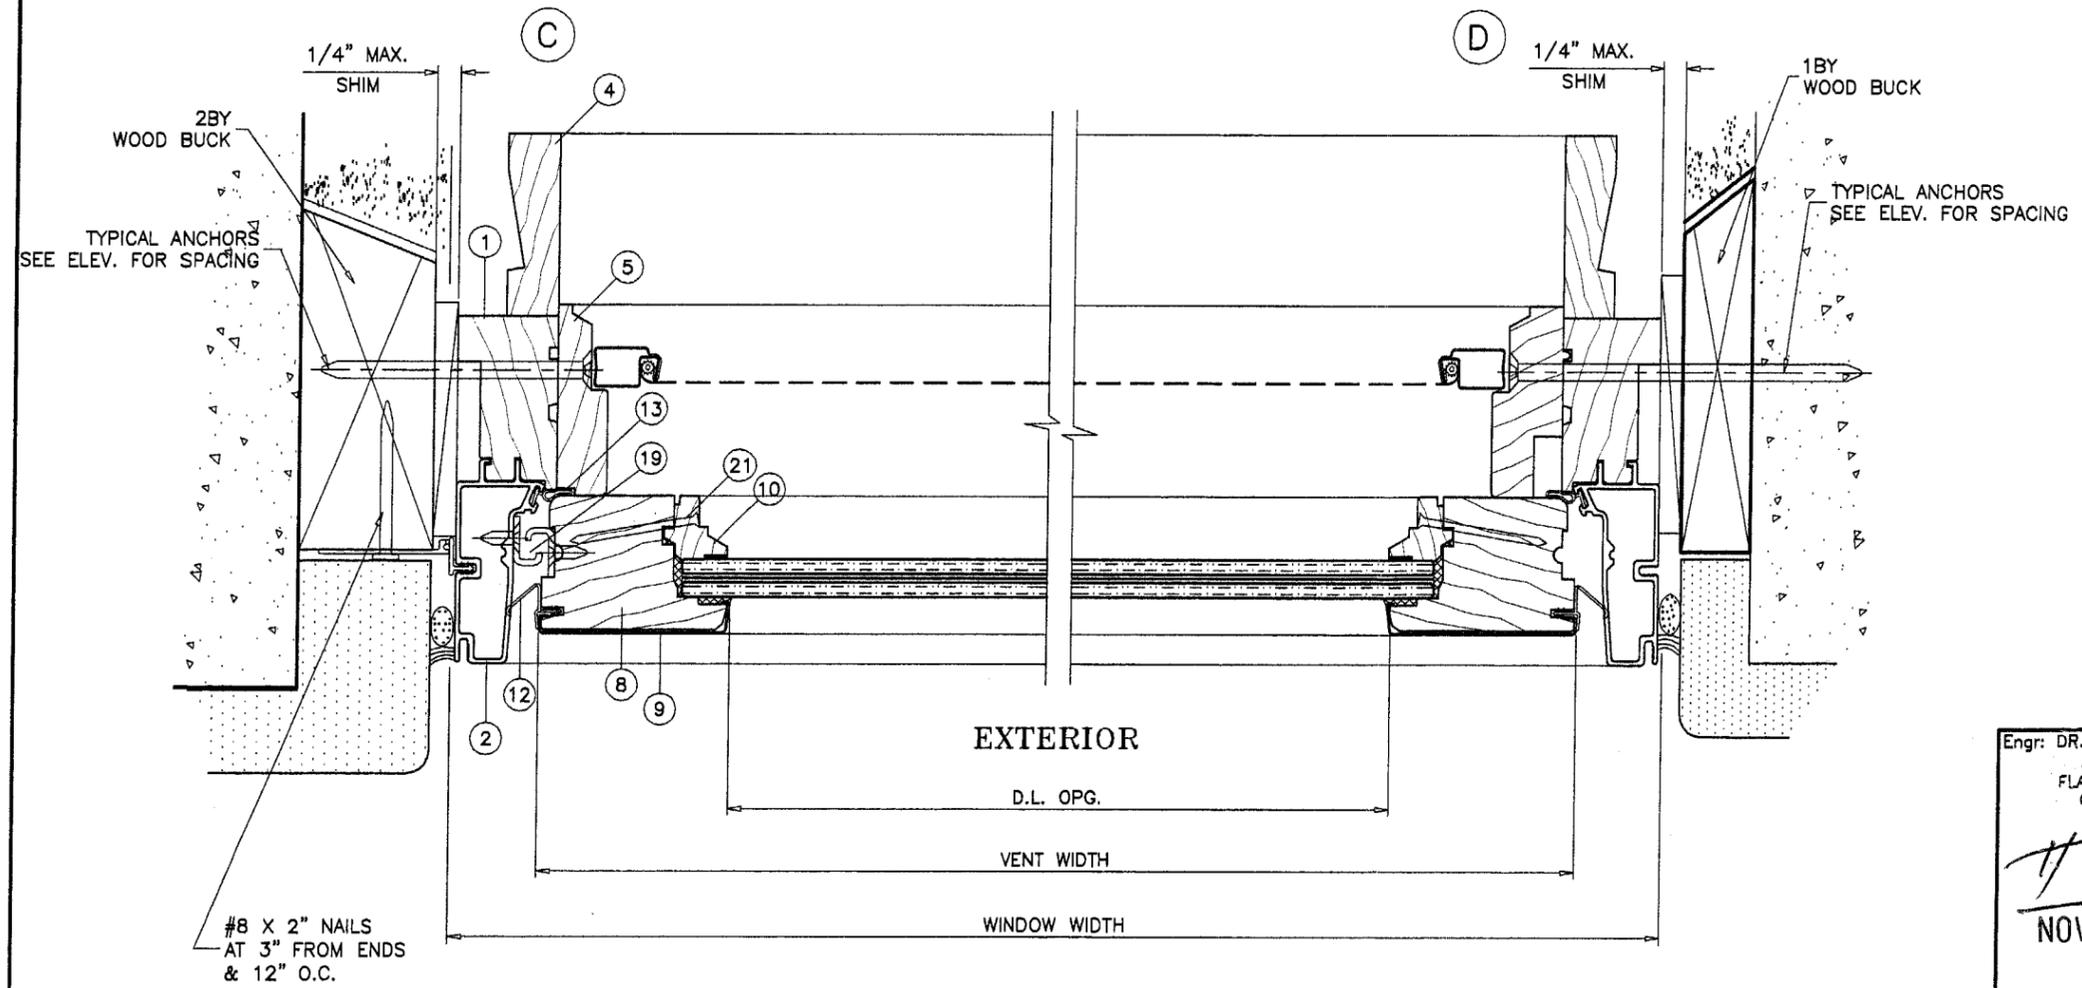

Approved as complying with the
Florida Building Code
Date 03/04/04
NOA# 03-1204.02
Miami Dade Product Control
Division
By Sheeran Kerna


Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

NOV 20 2003


AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

TRADITION PLUS ALUM CLAD WOOD CASEMENT WDW.
JELD WEN WINDOW DIVISION
201 EVANS ROAD
RANTOUL, ILLINOIS 61866
TEL (217) 893-4444 FAX (217) 893-7650


revisions:	no	date	by	description
date:	10-15-03	scale:	1/2" = 1"	dr. by:
				HAMID
				chk. by:
drawing no.	W03-93			
sheet	3 of 4			

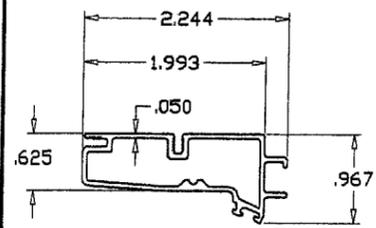


② FRAME NOSING

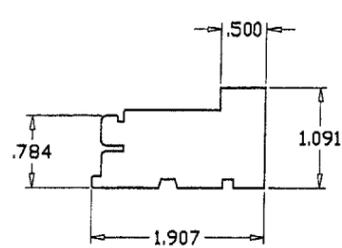


① HEAD/SILL/JAMB

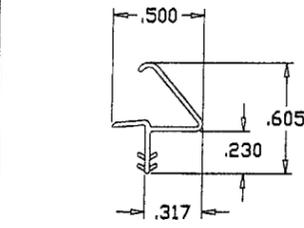


⑫ VENT WEATHERSTRIP

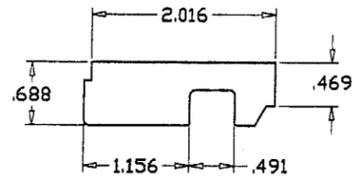

③ HEAD STOP




④ X-JAMB

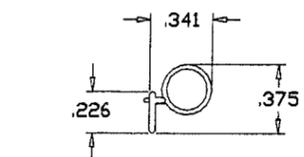

⑬ BULB WEATHERSTRIP


SCALE 1:1

SASH AND OTHER WOOD COMPONENTS TO BE WHITE PINE OR PONDEROSA PINE.

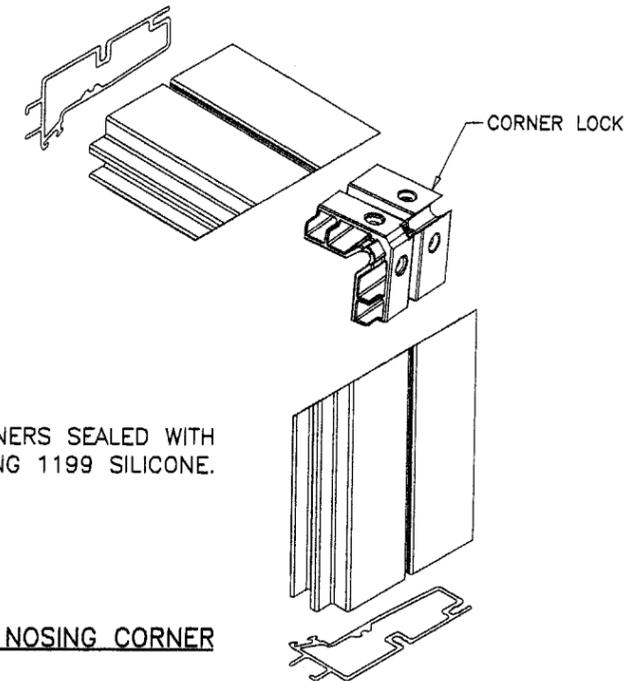


FRAME CORNERS SEALED WITH DOW CORNING 1199 SILICONE.


FRAME NOSING CORNER

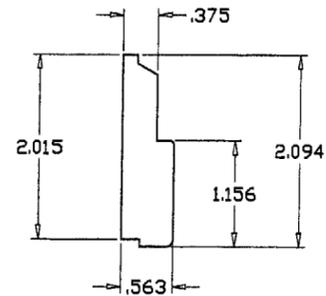


⑤ SIDE STOP




⑩ GLASS STOP

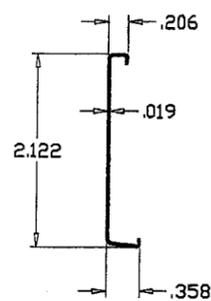


⑨ VENT COVER

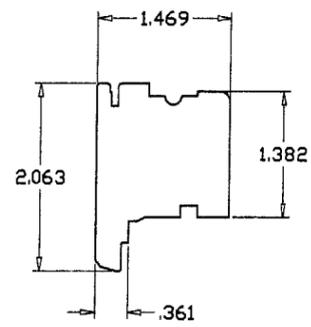


⑧ VENT

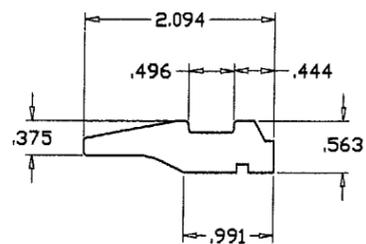


⑥ SILL COVER 'A'



⑦ SILL COVER 'B'

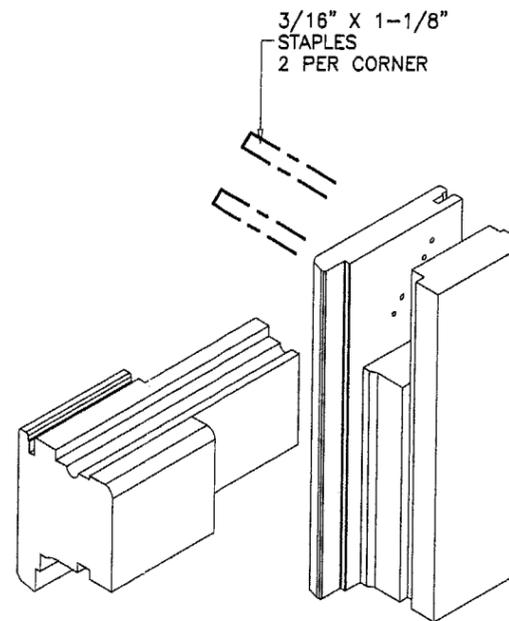

VENT CORNER

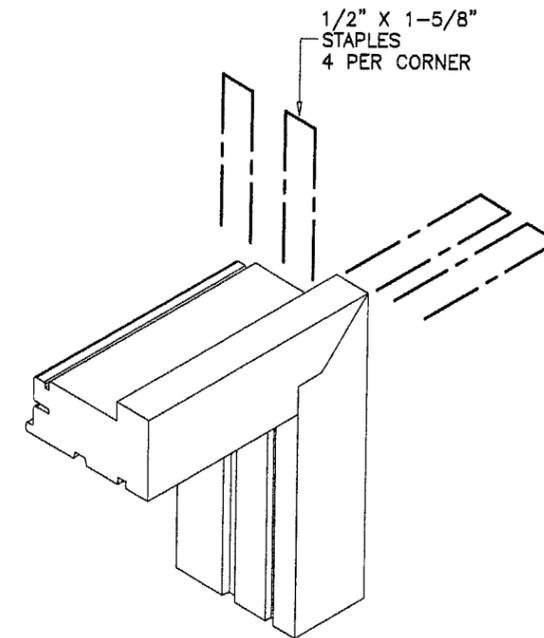

FRAME CORNER

Approved as complying with the
Florida Building Code
Date 03/04/04
NOA# 03-1204.02
Miami Dade Product Control
Division
By: *Cherelle Berner*

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

H
NOV 20 2003

afsc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

TRADITION PLUS ALUM CLAD WOOD CASEMENT WDW.
JELD WEN WINDOW DIVISION
201 EVANS ROAD
RANTOUL, ILLINOIS 61866
TEL. (217) 893-4444 FAX (217) 893-7650

no	date	by	description

date: 10-15-03
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W03-93
sheet 4 of 4

COMP-ANL W03-93JW