



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Therma-Tru Corp.
108 Mutzfeld Road
Butler, IN 46721**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Component Approval - Plastics - Therma-Tru Fiberglass Door Skin

APPROVAL DOCUMENT: Drawing No. S-2157-A1, titled "Fiberglass Skin Component Approval", sheets 1 through 3 of 3, prepared by RW Building Consultants, Inc., dated 8/14/01 with revision #2 dated 12/08/03, prepared by R.W. Building Consultant, Inc., signed and sealed by Wendell Haney, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 02-0612.02 consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No 03-1210.07
Expiration Date: January 18, 2007
Approval Date: May 27, 2004
Page 1**

Therma-Tru Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **S-2157-A1**, titled "Fiberglass Skin Component Approval", sheets 1 through 3 of 3, dated 8/14/01 with revision #2 dated 12/08/03, prepared by RW Building Consultants, Inc., signed and sealed by Wendell Haney, P.E.

B. TESTS

1. Five Year Weathering Test for TCM, BTC, & PVC, prepared by Subtropical Testing Service, signed by Lon Hicks, P.E.
"Submitted under 02-0612.02"
2. 4500 hours Xenon Arch Test for SMC, TCM, & PVC, prepared by Subtropical Testing Service, signed by Lon Hicks, P.E.
"Submitted under 02-0612.02"
3. Tensile Property Test for SMC, TCM, PVC, & RTS, prepared by ETC Laboratories, Test Report No. **ETC-01-741-10921.0**, signed and sealed by Joseph L. Doldan, P.E.
"Submitted under 02-0612.02"
4. Test Reports for "Self Ignition", "Rate of Burning", and "Smoke Density", prepared by ETC Laboratories, Test Report No. **ETC-01-741-11250.0**, signed and sealed by Joseph L. Doldan, P.E.
"Submitted under 02-0612.02"
5. Letter of Explanation of lite frame composition by Therma-Tru, dated by 12/4/01, signed and sealed by Steven P. Kepler, P.E.
"Submitted under 02-0612.02"

C. CALCULATIONS

1. None

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. None

F. STATEMENTS

1. None



Manuel Perez, P.E.
Product Control Examiner
NOA No 03-1210.07
Expiration Date: January 18, 2007
Approval Date: May 27, 2004

Therma-Tru Corporation


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

G. OTHER

1. Letter stating that the reason for this revision is to show changes due to manufacturing tolerances, dated December 9, 2003, signed by Rick Wright.
2. Notice of Acceptance No. **02-0612.02**, issued to Therma-Tru Corporation for their Plastics Components Approval-Therma-Tru Fiberglass Door, approved on 01/18/02 and expiring on 01/18/07.

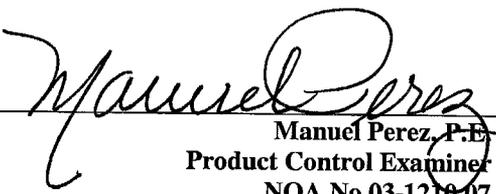
Manuel Perez, P.E.
Product Control Examiner
NOA No 03-1210-07
Expiration Date: January 18, 2007
Approval Date: May 27, 2004

THERMA-TRU CORPORATION
 1687 WOODLANDS DRIVE MAUMEE, OHIO 43537 PH. 800-537-8822
FIBERGLASS SKIN COMPONENT
APPROVAL



MINIMUM SKIN THICKNESS
 6'8 Door Panel = 0.090" +/-0.010"
 8'0 Door Panel = 0.125" +/-0.010"

Classic-Craft Fiberglass Skin

Notes:

1. Type of Door Skin - SMC: Sheet Molding Compound (Therma-Tru's Fiberglass)
2. Color - Oak (Tan)
3. Tensile Strength - 6,000 psi
4. Process - Molded in Grain (Red Oak deep grain)
5. Mfg. Facility - Therma-Tru Indiana, 108 Mutzfeld Road, Butler Indiana 46721

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	CLASSIC-CRAFT FIBERGLASS SKIN
2	FIBER-CLASSIC FIBERGLASS SKIN
3	SMOOTH-STAR FIBERGLASS SKIN

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. **03-1210-07**
 Expires Date **JAN. 18, 2007**
 By *Wendell W. Haney*
 Master Trade Product Control
 Division

NO.	DATE	REVISIONS	BY
2	12/08/03	ADD TOLERANCE	RW
1	12/17/01	ADD NOTES	RW

Product Approval Documents Prepared By:
RW BUILDING CONSULTANTS, INC.
 P.O. Box 230 Vairco FL 33595
 Phone No.: 813.659.9197
 Florida Board of Professional Engineers
 Certificate Of Authorization No. 9813
Wendell W. Haney 12/11/03
 Wendell W. Haney, P.E. NO. 54158

RW BUILDING
 CONSULTANTS, INC.
 813.659.9197

DATE: 8/14/01
 SCALE: N.T.S.
 DWG. BY: TJH
 CHK. BY: RW
 DRAWING NO.: S-2157-A1
 SHEET 1 OF 3



MINIMUM SKIN THICKNESS
 6'8 Door Panel = 0.065" +/- 0.010"
 8'0 Door Panel = 0.110" +/- 0.010"

Fiber—Classic Fiberglass Skin

Notes:

1. Type of Door Skin — SMC: Sheet Molding Compound (Therma-Tru's Fiberglass)
2. Color — Oak (Tan)
3. Tensile Strength — 6,000 psi
4. Process — Molded in Grain (Red Oak standard grain)
5. Mfg. Facility — Therma-Tru Indiana, 108 Mutzfeld Road, Butler Indiana 46721

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 08-1210-07
 Expiration Date JAN. 18, 2007
 By *Wendell W. Haney*
 Miami/Dade Product Control
 Division

DATE: 8/14/01
 SCALE: N.T.S.
 DWG. BY: TJH
 CHK. BY: RW
 DRAWING NO.: S-2157-A1
 SHEET 2 OF 3

RW BUILDING CONSULTANTS, INC.
 813.659.9197

NO.	DATE	REVISIONS	BY
2.	12/08/03	ADD TOLERANCE	RW
1.	12/17/01	ADD NOTES	RW

Product Approval Documents Prepared By:
RW BUILDING CONSULTANTS, INC.
 P.O. Box 230, Valrico FL 33595
 Phone No.: 813.659.9197
 Florida Board of Professional Engineers
 Certificate Of Authorization No: 9813
Wendell W. Haney 12/11/03
 Wendell W. Haney, P.E. No. 54158




MINIMUM SKIN THICKNESS
 6'8 Door Panel = 0.070" +/- 0.010"
 8'0 Door Panel = 0.070" +/- 0.010"

Smooth—Star Fiberglass Skin

Notes:

1. Type of Door Skin — SMC: Sheet Molding Compound (Therma-Tru's Fiberglass)
2. Color — Smooth (White)
3. Tensile Strength — 6,000 psi
4. Process — 80 Grit Brushed (smooth no grain)
5. Mfg. Facility — Therma-Tru Indiana, 108 Mutzfeld Road, Butler Indiana 46721

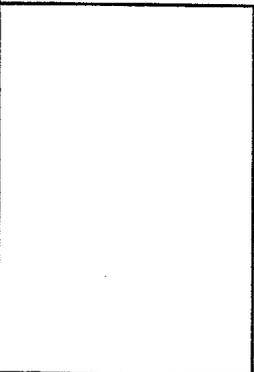

PRODUCT REVIEWED
 as complying with the Florida
 Building Code
 Acceptance No. **03-1210-07**
 Expiration Date **JAN. 18, 2007**
 By *Wendell W. Haney*
 Florida State Product Control
 Division

DATE: 8/14/01
 SCALE: N.T.S.
 DWG. BY: TJH
 CHK. BY: RW
 DRAWING NO.: S-2157-A1
 SHEET 3 OF 3

RW BUILDING
 CONSULTANTS, INC.
 813.659.9197

NO.	DATE	REVISIONS	BY
2.	12/08/03	ADD TOLERANCE	RW
1.	12/17/01	ADD NOTES	RW

Product Approval Documents Prepared By:
RW BUILDING CONSULTANTS, INC.
 P.O. Box 230 Vairico FL 33595
 Phone No.: 813.659.9197
 Florida Board of Professional Engineers
 Certificate Of Authorization No. 9813
Wendell W. Haney 12/11/03
 Wendell W. Haney, P.E. NO. 54158