



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Ingersoll-Rand
2720 Tobey Drive
Indianapolis, IN 46219**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series H16 FG Full Glazed Single Steel Entry Door

APPROVAL DOCUMENT: Drawing No "1035W", titled "Series H16 FG Full Glazed Single Steel Door", sheets 1 through 7 of 7 prepared by manufacture, dated 04/09/03 with revision "B" on 06/29/04, signed and sealed by Gordon Dennis Thomas, P. E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence page E-1 and E-2, as well as approval document mentioned above. The submitted documentation was reviewed by **Herminio F. Gonzalez, P.E., Director, BCCO**

7/28/04
Jey



**NOA No 04-0303.03
Expiration Date: August 19, 2009
Approval Date: August 19, 2004**

Ingersoll-Rand

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's parts and sections drawings.
2. Drawing No "1035W", titled "H16 FG- Full Glazed Single Steel Door", sheets 1 through 7 of 7, dated 04/09/03 with revision "B" on 06/29/04, prepared by manufacture, signed and sealed by Gordon Dennis Thomas, P.E.

B. TESTS

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Large Missile Impact Test per FBC, TAS 201-94
4) Cyclic Wind Pressure Loading per FBC, TAS 203-94
5) Forced Entry Test, per FBC 2411.3.2.1 (b) and TAS 202-94
along with marked-up drawings and installation diagram of outswing steel door, prepared by Certified Testing Laboratories Architectural Division, Test Report No. **CTLA-1035W** dated 05/28/03, signed and sealed by Ramesh Patel, P.E.
2. Test Report on Tensile Test, along with marked up drawings and installation diagram of outswing steel door, prepared by Certified Testing Laboratories Architectural Division, Test Report No. **CTLA- 1035W** dated 05/28/03, signed and sealed by Ramesh Patel, P.E.

C. CALCULATIONS:

1. Anchor Calculations, ASTM-E1300, and structural analysis, prepared by Product Technology Corporation, dated 07/14/03, signed and sealed by Rene J. Quiroga, P. E.

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **01-1204.01**, issued to " E.I. Dupont DeNemours" for their Sentry Glass ® Plus", dated 1/17/02 and expiring on 1/14/07.

F. STATEMENTS

1. Statement letter of conformance, dated 02/27/04, issued by Ingersoll-Rand, signed by Roger Vitt.
2. Statement letter of no financial interest, dated 02/27/04, issued by Ingersoll-Rand, signed by Roger Vitt.



Herminio F. Gonzalez, P.E.
Director, Building Code Compliance Office

NOA No 04-0303.03


Expiration Date: August 19, 2009

Approval Date: August 19, 2004

Ingersoll-Rand


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. Statement letter of no financial interest, dated 07/18/03, issued by Product Technology Corporation, signed and sealed by Rene J. Quiroga, P.E.
- G. OTHER**
1. Letter from consultant stating that the product is in compliance with the Florida Building Code (FBC).

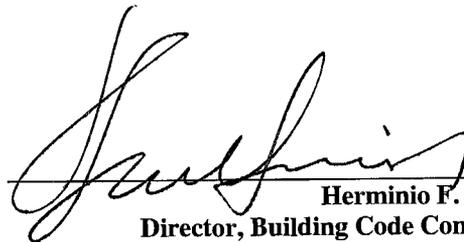

Herminio F. Gonzalez, P.E.
Director, Building Code Compliance Office

NOA No 04-0303.03
Expiration Date: August 19, 2009
Approval Date: August 19, 2004

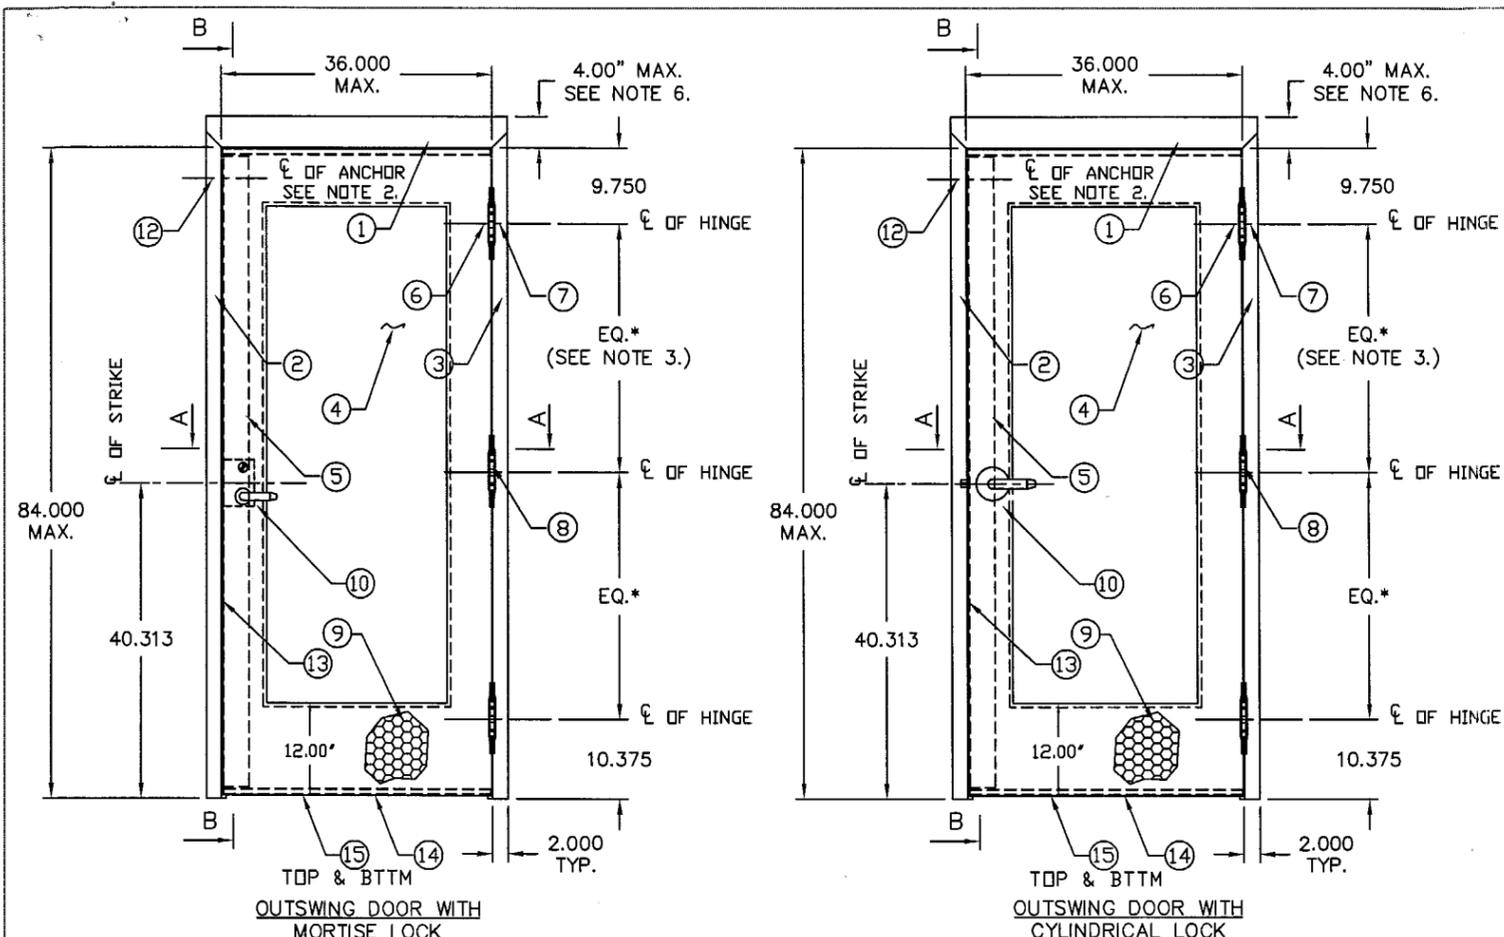


REVISIONS			
LTR	DESCRIPTION	DATE	APPROVED
A	APPROVAL DWGS.	04/09/03	
B	REVISED PER DC BCCO YMF	06/29/04	


Approved as complying with the Florida Building Code
 Date 08/19/04
 NOAH 04-030303
 Miami-Dade Product Control
 Division By *[Signature]*

[Signature]
 7/2/04

TYPICAL DOOR SLAB CONFIGURATIONS:

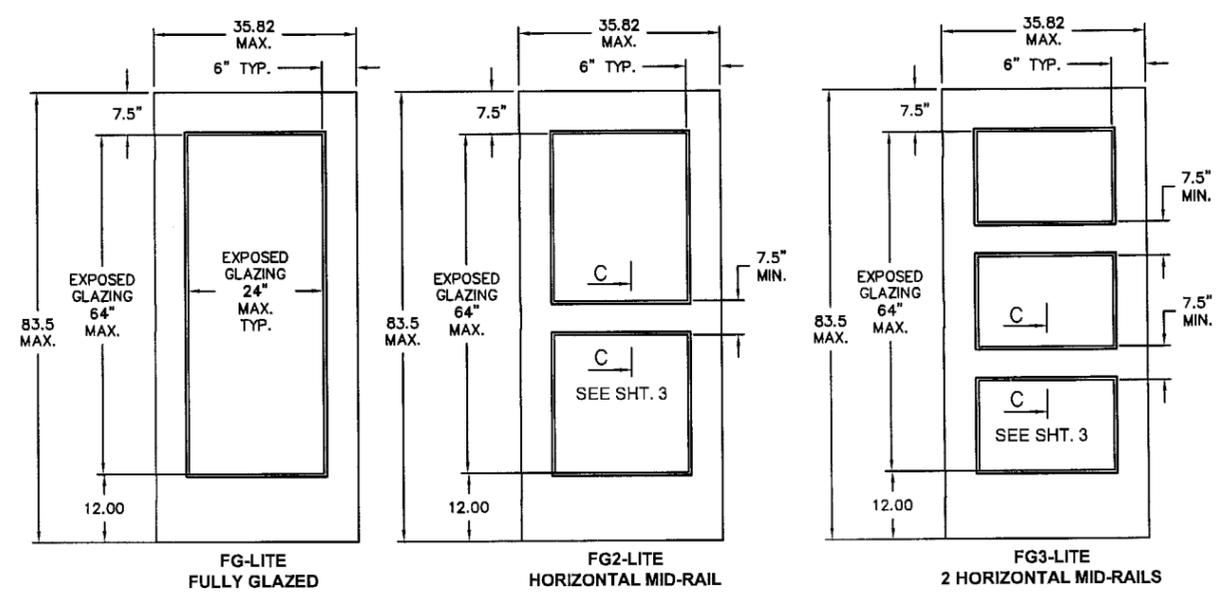

DESIGN PRESSURE RATING		
	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED	WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED
POSITIVE	NOT APPROVED	+ 75 PSF
NEGATIVE	NOT APPROVED	- 75 PSF

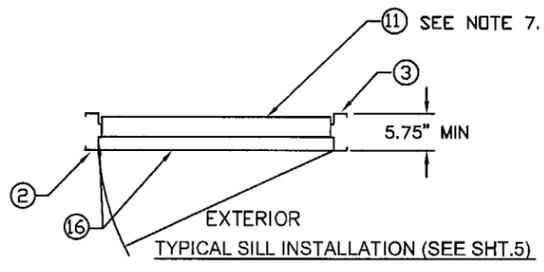

NOTES:

- ONE ROW OF PS074 WEATHERSTRIPPING PER JAMB AND HEAD. INSTALL PER SHT 7
- ANCHOR REQUIREMENTS: SEE SHT 5 FOR APPROVED ANCHOR AND INSTALLATION REQUIREMENTS.
- HINGE REQUIREMENTS: LOCATIONS: 9.75" FROM RABBET IN HEAD TO CL OF TOP HINGE, 10.38" FROM FLOOR TO CL OF BOTTOM HINGE, EQUALLY SPACED IN BETWEEN.
- SEE SHEET 6 FOR AVAILABLE STANDARD OPENING SIZES AND SPECIFICATIONS.
- HARDWARE INSTALLATION AS PER MANUFACTURER'S INSTRUCTIONS.
- 4" FACE HEAD IS AVAILABLE WHEN FRAME IS GROUTED WITH CONCRETE.
- APPLY CAULK AS NEEDED.

ITEM	QUANTITY	DESCRIPTION	MATERIAL	SIZE
1	1	HEAD SEE SHT 3 & 7. ASTM A366	.053" MIN. STL	MAX. 40"
2	1	STRIKE JAMB. SEE SHT 3 & 7	.053" MIN. STL	MAX. 88"
3	1	HINGE JAMB SEE SHT 3 & 7. ASTM A366	.053" MIN. STL	MAX. 88"
4	1	GLAZING TYPE: 1. POLYCARBONATE SHEET (LEXAN) 2. LAMINATED GLASS (SENTRYGLAS PLUS)	.5" MIN. THICK .0562" MIN. THICK	24" X 64" MAX. 24" X 64" MAX.
5	1	LOCKSIDE REINFORCEMENT CHANNEL	.093" MIN. STL	1.66" X 3.5" X 81.44" MAX.
6	NOTE 3.	HINGE REINFORCEMENT DOOR ASTM A621	.171" MIN. STL.	1.28" X 9.19"
7	NOTE 3.	HINGE REINFORCEMENT FRAME ASTM A621	.171" MIN. STL.	1.28" X 9.19"
8	NOTE 3.	STANLEY F179/1900 OR HAGER 1279 HINGES	X .134	4.50" X 4.50" (12-24 MS 4 SCREWS PER HINGE LEAF)
9	2	CORE MATERIAL: HONEYCOMB AROUND THE CUTOUT	PHENOLIC RESIN IMPREGNATED W/1" CELL SIZE	
10	1	LOCKING HARDWARE - LOCKSET 1) SCHLAGE L9000 SERIES MORTISE LOCK 2) FALCON M-SERIES MORTISE LOCK C) LOCKNETICS CM5500 SERIES MORTISE LOCK D) SCHLAGE D/ND-SERIES CYLINDRICAL LOCK E) FALCON T-SERIES CYLINDRICAL LOCK F) LOCKNETICS CM5100 SERIES CYLINDRICAL LOCK		
11	1	THRESHOLD SILL W/BUMPER GASKET, SHT.6 1) NAT'L GUARD 950A 3) ZERO 566A 2) PEMCO 2005AS	.100" ALUM. 6063 T5	5.5" X 0.5" X 36" MAX
12	NOTE 2.	JAMB ANCHOR	SEE SHT. 5	
13	6	PS074 WEATHER STRIPPING, SHEET 6	TPE	MAX. 17"
14	1	FAS-SEAL DOOR SWEEP, SHEET 6	TPE	MAX. 35.66"
15	2	END CHANNEL ASTM A924	.070" MIN. STL	.69" X 1.66" X 35.66" MAX.
16	AS NEEDED	BUTYL RUBBER OR 100% SILICONE		

BEND RADIUS

THIRD ANGLE PROJECTION

DRAWN: YMF DATE: 03.11.03

CHECKED:

APPROVED:

ENG. APPVL:


INGERSOLL-RAND COMPANY
 STEELCRAFT MFG.
 9017 BlueAsh Rd. Cincinnati Ohio 45242

TITLE: DADE COUNTY
 H16 FG - FULL GLASS DOOR
 WITH IR COMMERCIAL LOCK HARDWARE
 3070 SINGLE DOORS

SIZE: FLAT DWG NO. 1035W SHEET 1 OF 7 REV B


SCALE: NTS AUTOCAD SHEET OF

REVISIONS			
LTR	DESCRIPTION	DATE	APPROVED
A	APPROVAL DWGS.	04/09/03	

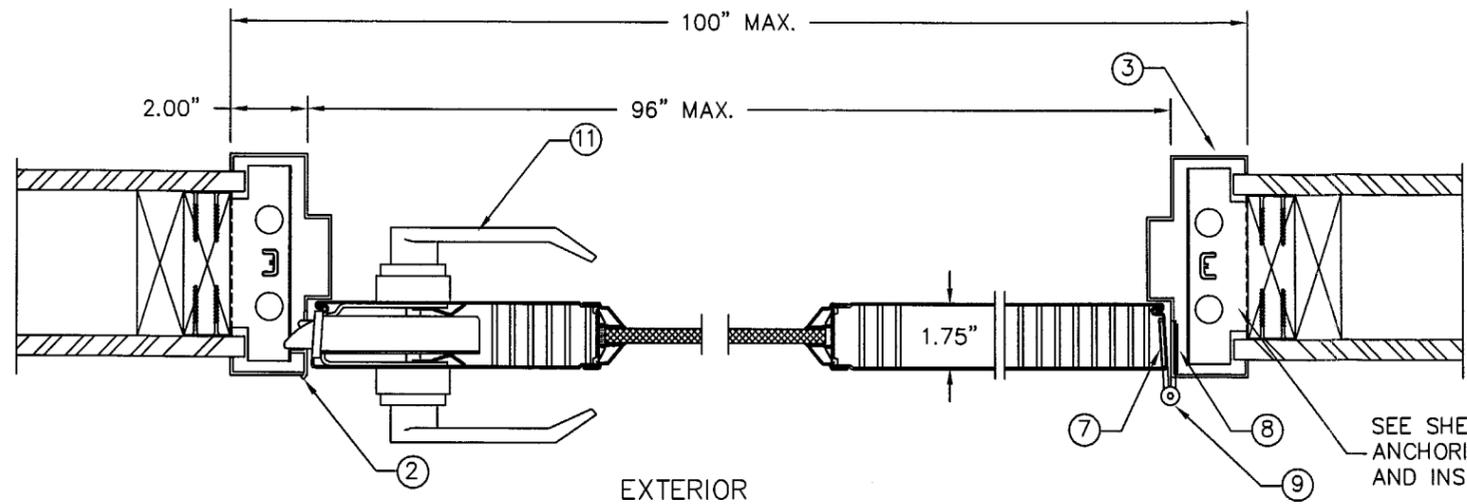


EXTERIOR
SECTION A-A
MORTISE LOCKSET
SCHLAGE L9000 SERIES
FALCON M-SERIES
LOCKNETICS CM5500 SERIES

SEE SHEET 5 FOR ANCHORING OPTIONS AND INSTALLATION

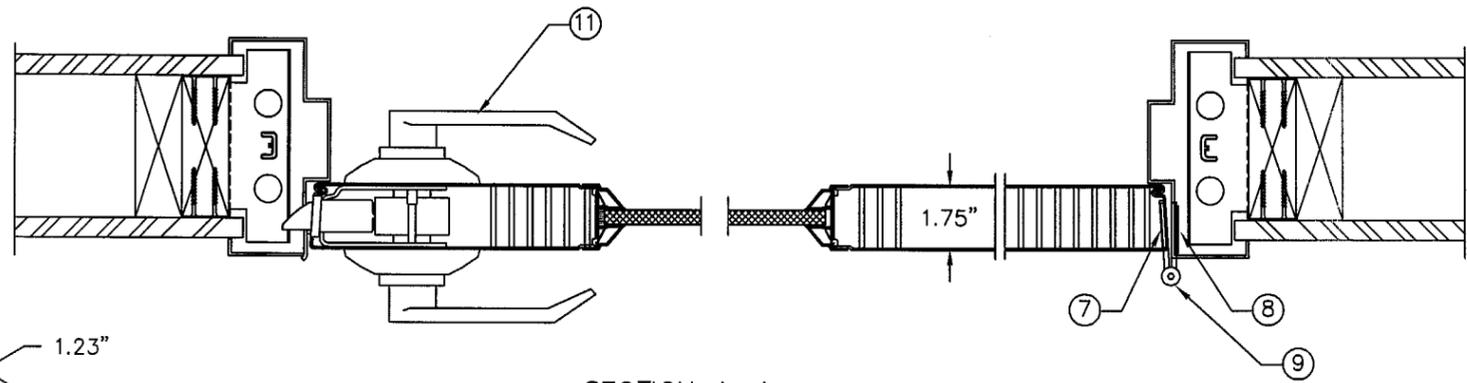


SECTION A-A
CYLINDRICAL LOCKSET
SCHLAGE D - SERIES
FALCON T - SERIES
LOCKNETICS CM5100 SERIES

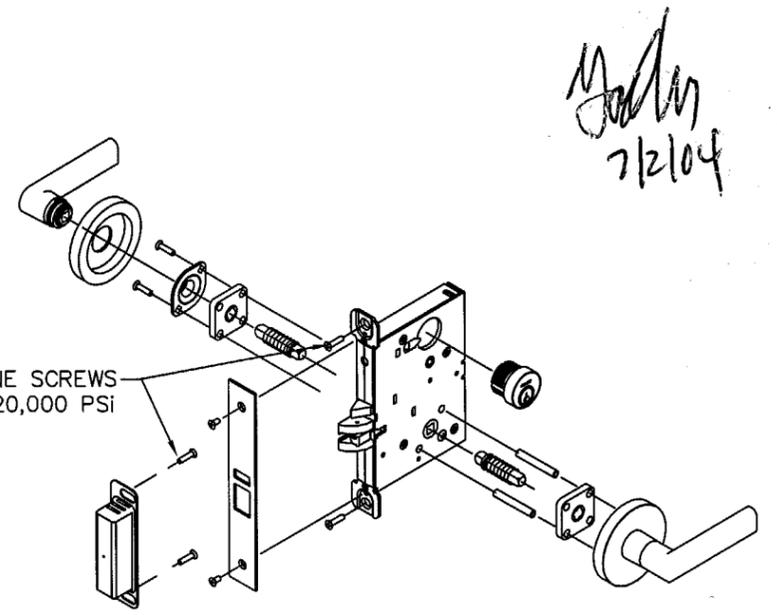


#12-24 MACHINE SCREWS
Fy min=120,000 PSI

SCHLAGE L9000 SERIES
KEYED MORTISE LOCKSET W/O DEADBOLT

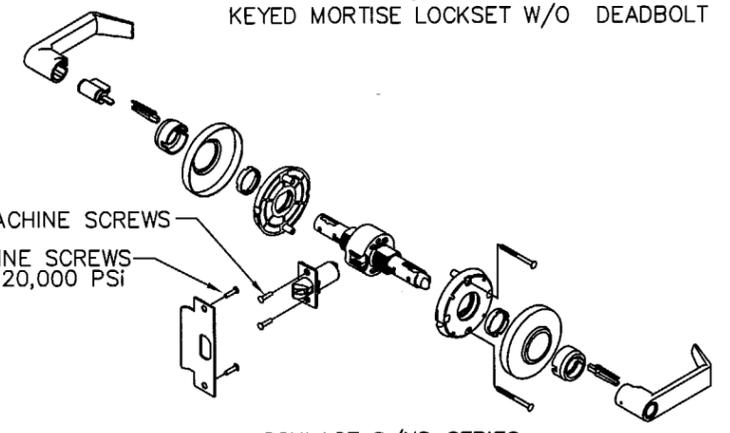


#8-32 MACHINE SCREWS
#12-24 MACHINE SCREWS
Fy min=120,000 PSI


SCHLAGE D/ND SERIES
CYLINDRICAL LEVER LOCKSET

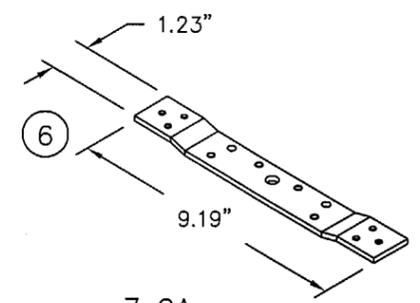

7 GA.
DOOR HINGE
REINFORCEMENT

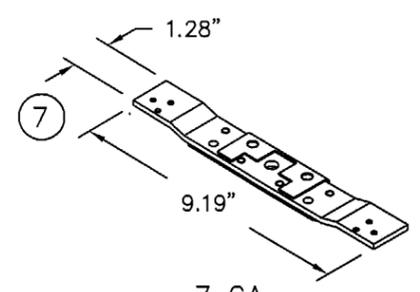

7 GA.
FRAME HINGE
REINFORCEMENT

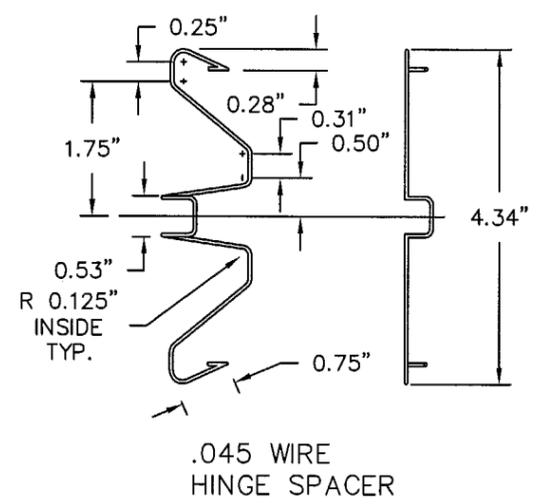

.045 WIRE
HINGE SPACER



NOTES:

1. SEE SHT.1 FOR ELEVATION, MATERIAL AND SIZE
2. SEE SHT.1 NOTE 2. AND SHT.5 FOR ANCHOR REQUIREMENTS
3. SEE SHT. 5 FOR WALL CONSTRUCTION AND ANCHORING SYSTEM OPTIONS AND INSTALLATION
4. SEE SHT.4 FOR AVAILABLE OPENING SIZES, JAMB DEPTHS AND SPECIFICATIONS
5. APPROVED HARDWARE INSTALLATION IS PER MANUFACTURER'S INSTRUCTIONS


Approved as complying with the
Florida Building Code
Date 08/19/04
NOA# 04-0303.03
Miami-Dade Product Control
Division
By *[Signature]*

BEND RADIUS		INGERSOLL-RAND COMPANY STEELCRAFT MFG. 9017 BlueAsh Rd. Cincinnati Ohio 45242	
THIRD ANGLE PROJECTION			
DRAWN YMF	DATE 04/09/03	TITLE DADE COUNTY CROSS SECTION OF DOOR AND FRAME IR COMMERCIAL LOCK HARDWARE 3070 SINGLE DOORS	
CHECKED		SIZE FLAT	DWG NO. 1035W
APPROVED		SHEET 2 OF 7	
ENG. APPVL		SCALE: NTS	AUTOCAD
		SHEET OF	




[Handwritten Signature]
7/2/04

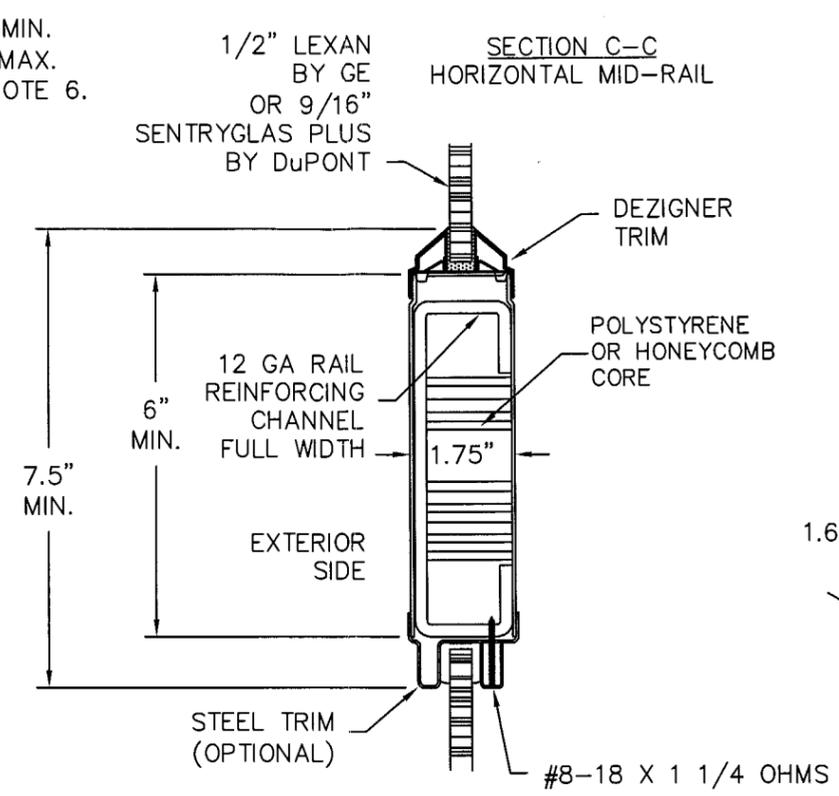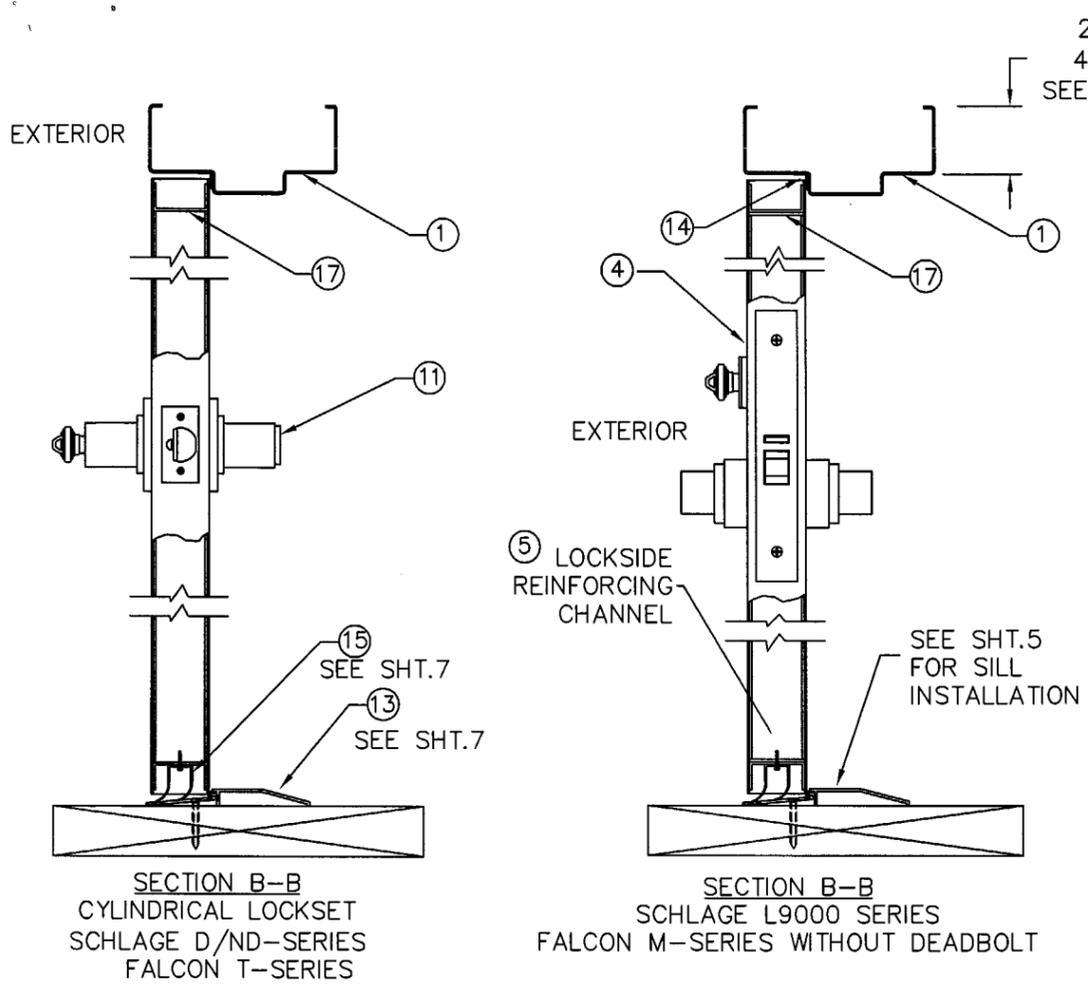

REVISIONS		
LTR	DESCRIPTION	DATE
A	APPROVAL DWG	02/26/03

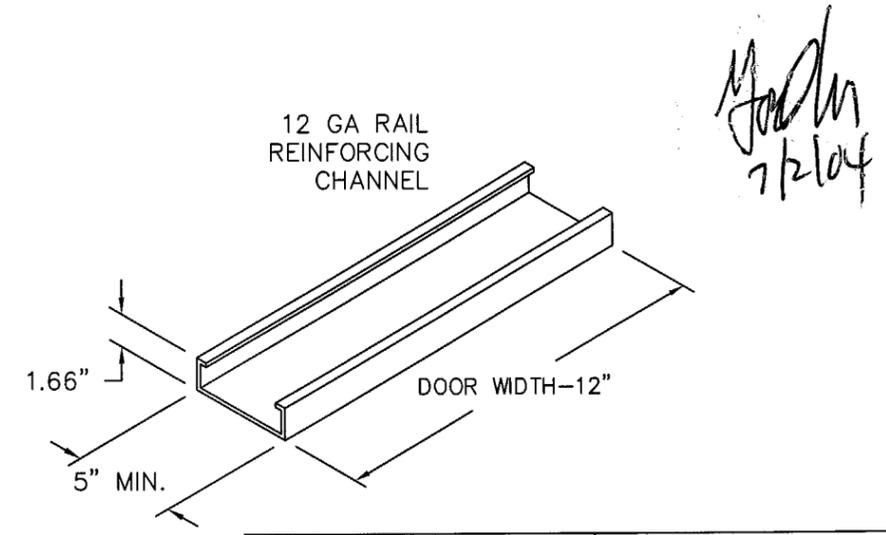

Approved as complying with the Florida Building Code
 Date 08/19/04
 NOA# 02-0303-03
 Miami Dade Product Control Division
Handwritten signature

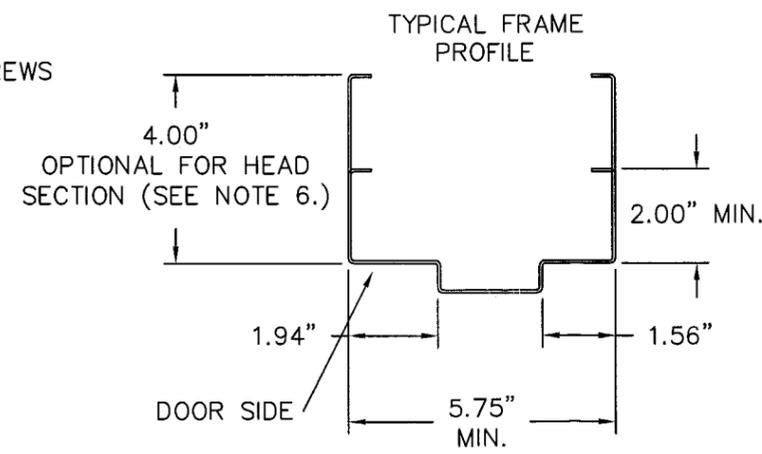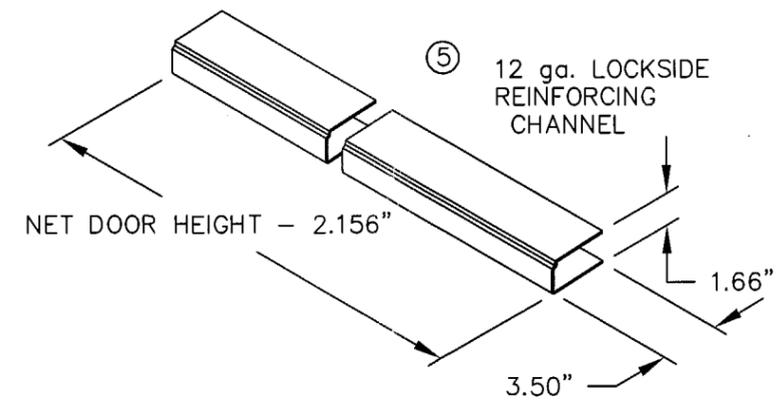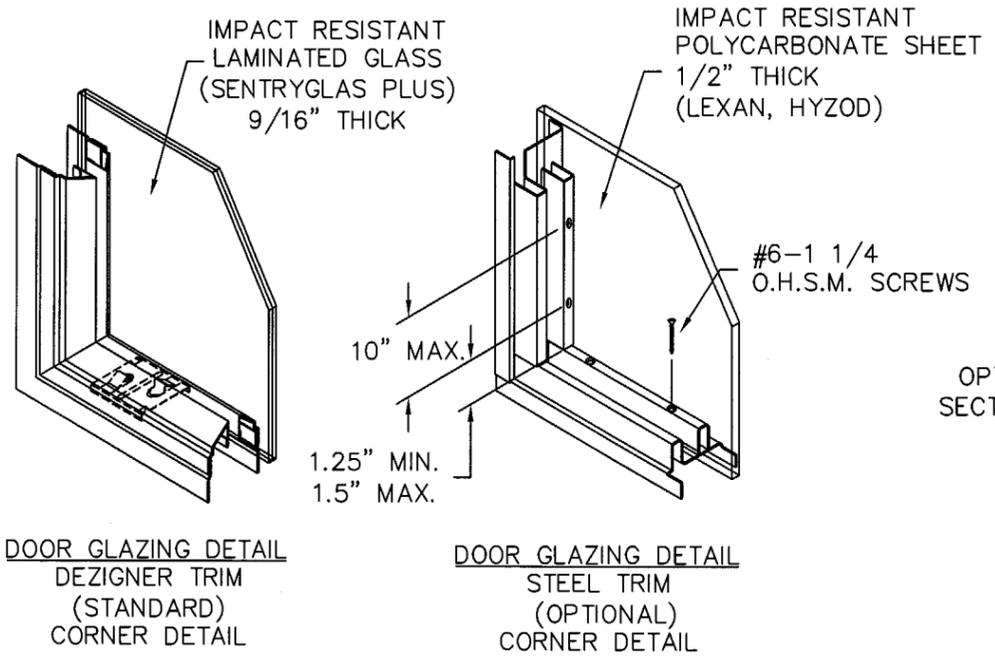

- NOTES:
- SEE SHT.1 FOR ELEVATION, MATERIAL AND SIZE
 - SEE SHT.1 NOTE 2. FOR ANCHOR REQUIREMENTS
 - SEE SHT. 5 FOR WALL CONSTRUCTION AND ANCHORING SYSTEM
 - SEE SHT. 4 FOR AVAILABLE OPENING SIZES, JAMB DEPTHS AND SPECIFICATIONS
 - HARDWARE INSTALLATION IS PER MANUFACTURER'S INSTRUCTIONS
 - HEAD SECTION CAN HAVE 4" FACE DIMENSION WHEN IT'S GROUTED WITH CONCRETE
 - WALL CONSTRUCTION STRUCTURAL MEMBERS MUST BE DESIGNED TO COMPLY WITH APPROVED DESIGN PRESSURE RATING.

BEND RADIUS				INGERSOLL-RAND COMPANY STEELCRAFT MFG. 9017 BlueAsh Rd. Cincinnati Ohio 45242	
THIRD ANGLE PROJECTION					
DRAWN	DATE	TITLE			
YMF	08/12/02	DADE COUNTY CROSS SECTION OF DOOR AND FRAME IR COMMERCIAL LOCK HARDWARE H16 4 FG(2)(3) 3070 FULLY GLAZED SINGLE DOORS			
CHECKED		SIZE	FLAT	DWG NO.	REV
APPROVED				1035W	A
ENG. APPVL		SCALE:	NTS	AUTOCAD	SHT 3 OF 7

REVISIONS

LTR	DESCRIPTION	DATE	APPROVED
A	APPROVAL DWG YMF	04/08/03	

Handwritten signature
7/2/04

AVAILABLE FRAME CONFIGURATIONS (SEE NOTE 1.)

TABLE 1.

FRAME SERIES	JAMB DEPTH	FRAME MATERIAL		MAX. DOOR OPENING SIZE		GLAZING MATERIAL	
		DESCR.	GA./MIN. THK	WIDTH	HEIGHT	DESCR.	THICKNESS
F	5.75" MIN.	CRS/HRS GALV	16/.053" 14/.067" 12/.099"	3'0"	7'0"	POLYCARBONATE (LEXAN, HYZOD)	.5" MIN.
		STAINLESS STEEL	16/.053"				
MU	5.75" MIN.	CRS/HRS GALV	16/.053" 14/.067"			LAMINATED GLASS (SENTRYGLAS PLUS)	.56" MIN.


AVAILABLE DOOR CONFIGURATIONS (SEE NOTE 2.)

TABLE 2.

MAXIMUM DOOR OPENING SIZE		SKIN MATERIAL		MAXIMUM GLASS OPENING SIZE		GLAZING MATERIAL	
WIDTH	HEIGHT	DESCR.	GA./MIN. THK	WIDTH	HEIGHT	DESCR.	THICKNESS
3'0"	7'0"	CRS GALV	16/.053" 14/.067"	2'0"	5'4"	POLYCARBONATE (LEXAN, HYZOD)	.5" MIN.
		STAINLESS STEEL	16/.053"			LAMINATED GLASS (SENTRYGLAS PLUS)	.56" MIN.

TABLE 3.

CRS ASTM A1008
HRS ASTM A1011
GALV: A60 ASTM A924
STL: 304,316 ASTM A666

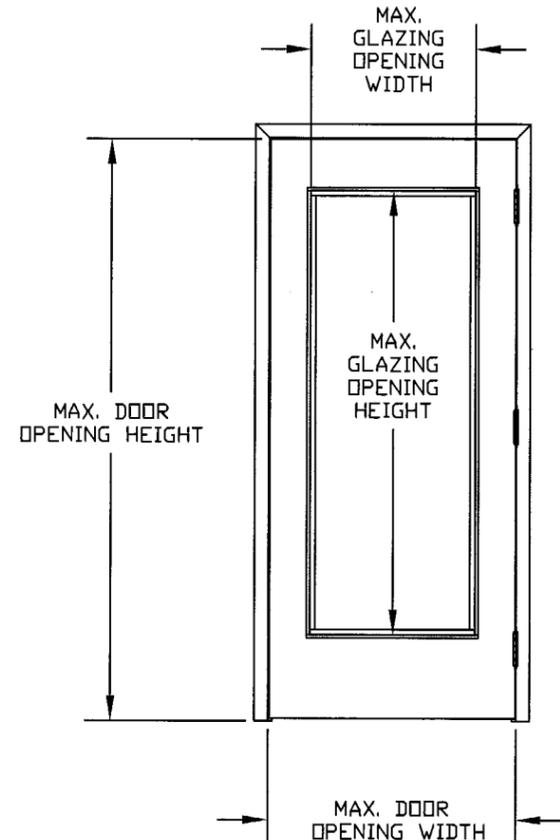

NOTES:

- FRAME CONSTRUCTION
 - MINIMUM JAMB DEPTH - 5 3/4", MIN. STOP HEIGHT - 5/8"
 - FRAMES AVAILABLE AS FLUSH (F-SERIES) AND MULT-USE (MU-SERIES) (SEE TABLE 1 & SHT.7)
- DOOR CONSTRUCTION
 - MINIMUM DOOR THICKNESS - 1 3/4"
 - GLASS OPENING SIZE TESTED (SEE TABLE 2.) IS MAX SIZE AVAILABLE FOR 3'0" X 7'0" DOOR OPENING. ALL SMALLER SIZES ARE ACCEPTABLE.
 - MAXIMUM GLASS OPENING SIZE WILL CHANGE IN PROPORTION WITH DOOR SIZE.
 - FOR GLAZING DETAILS REFER TO SHEET 3.
- FOR MATERIAL SPECIFICATIONS REFERENCE SEE TABLE 3.



Approved as complying with the Florida Building Code
Date 08/19/04
NOA# 04-0303-03
Miami-Dade Product Control
Division
By *[Signature]*

BEND RADIUS		<p>9017 BlueAsh Rd. Cincinnati Ohio 45242</p>			
<p>THIRD ANGLE PROJECTION</p>					
DRAWN YMF	DATE 04/08/03	TITLE DADE COUNTY DOOR AND FRAME CONFIGURATIONS AND MATERIAL SPECS.			
CHECKED		SIZE	FLAT	DWG NO. 1035W	SHEET 4 OF 7
APPROVED		SCALE: NTS		AUTOCAD	REV A
ENG. APPVL					



REVISIONS			
LTR	DESCRIPTION	DATE	APPROVED
A	TEST DWG	YMF 04/09/03	
B	REVISED PER DC BCCO	YMF 06/28/04	

Handwritten signature
7/2/04



A WIRE MASONRY ANCHOR INTO GROUT FILLED FRAME AND BLOCK WALL

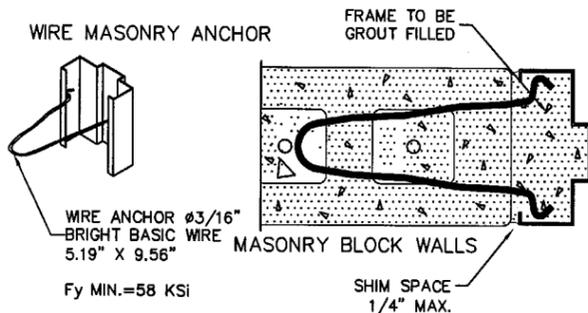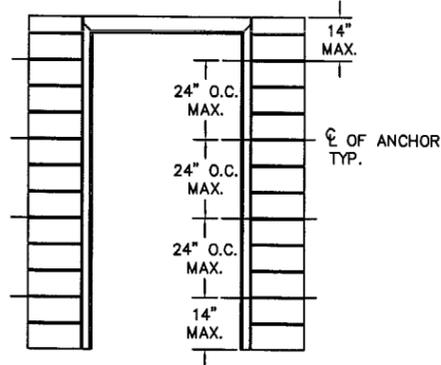



B WOOD STUD ANCHOR

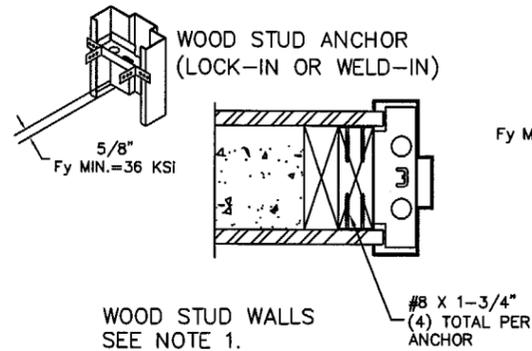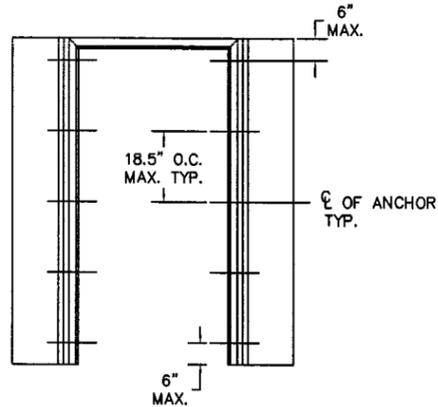




C STEEL STUD ANCHOR

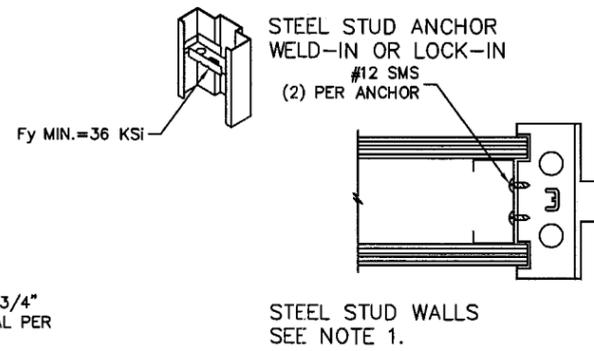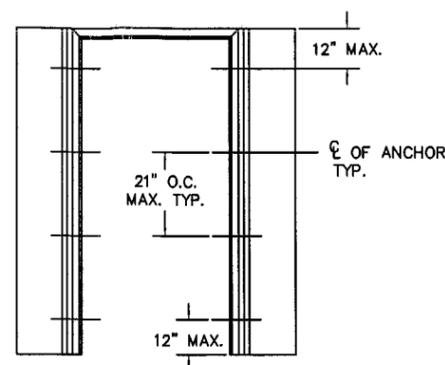

D EXISTING MASONRY ANCHOR (EMA) INTO CONCRETE WALL OR CMU

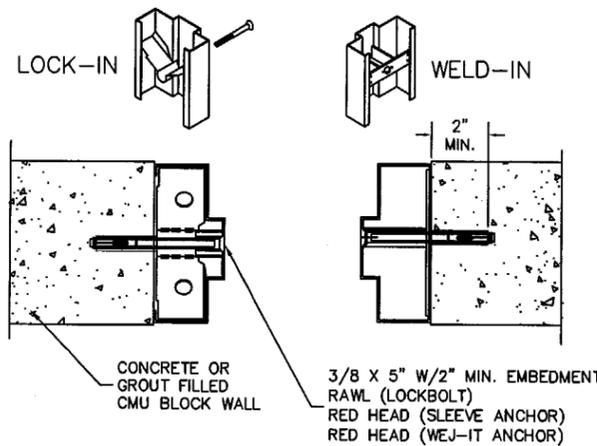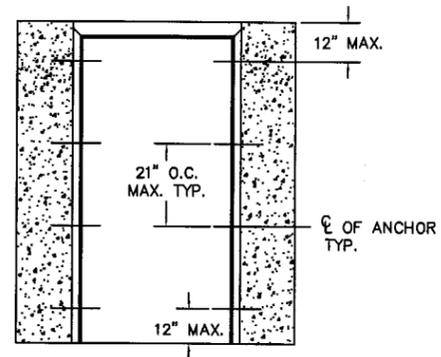

E EXISTING MASONRY ANCHOR (EMA) WITH LAG BOLT INTO WOOD STUD WALL

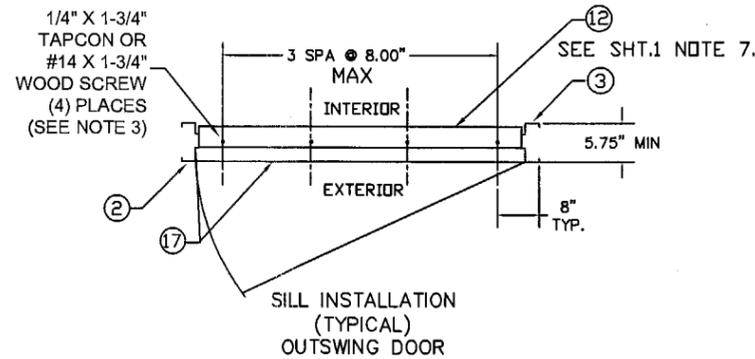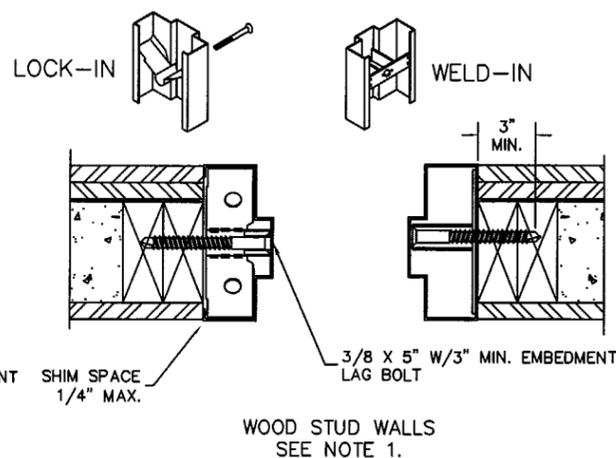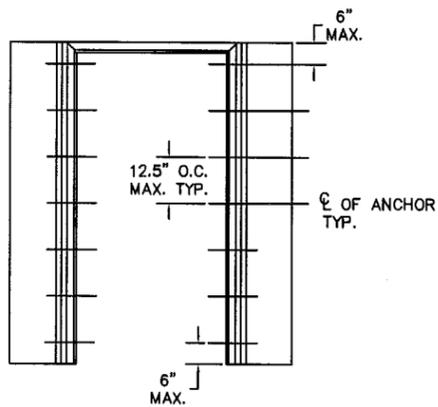

Approved as complying with the Florida Building Code
Date 08/19/04
NOA# 04-0303-03
Miami-Dade Product Control Division
By *Handwritten signature*



NOTES:

- WOOD OR STEEL STRUCTURAL MEMBERS OF WOOD AND STEEL-STUD WALLS MUST BE DESIGNED TO CARRY AT LEAST 320 #/ft. LOAD, AND SHOULD BE VERIFIED BY THE APPROPRIATE OFFICIAL.
- NUMBER OF ANCHORS FOR VARIOUS OPENING HEIGHTS IS LIMITED BY MAXIMUM DISTANCE BETWEEN ANCHORS, SHOWN ON THIS SHEET.
- HOLE PATTERN VARIES BY MANUFACTURER


BEND RADIUS				INGERSOLL-RAND COMPANY STEELCRAFT MFG. 9017 BlueAsh Rd. Cincinnati Ohio 45242	
THIRD ANGLE PROJECTION					
DRAWN YMF	DATE 04/09/03	TITLE DADE COUNTY ANCHOR DETAILS / MOUNTING CONDITIONS			
CHECKED		SIZE	FLAT	DWG. NO. 1035W	REV B
APPROVED		SCALE: NTS		AUTOCAD	SHEET 5 OF 7
ENG. APPVL					

REVISIONS


LTR	DESCRIPTION	DATE	APPROVED
A	RELEASE TO SHOP	04/09/03	

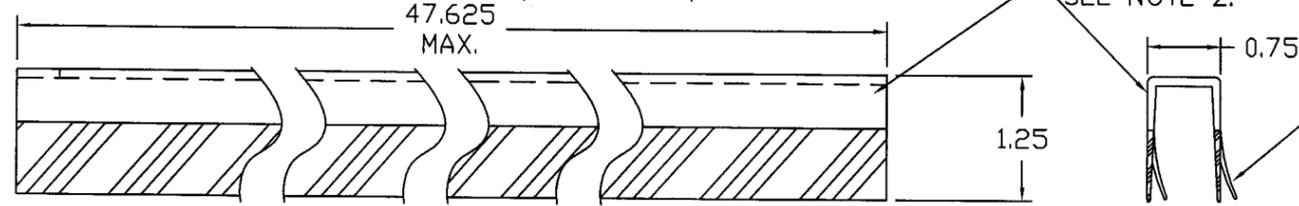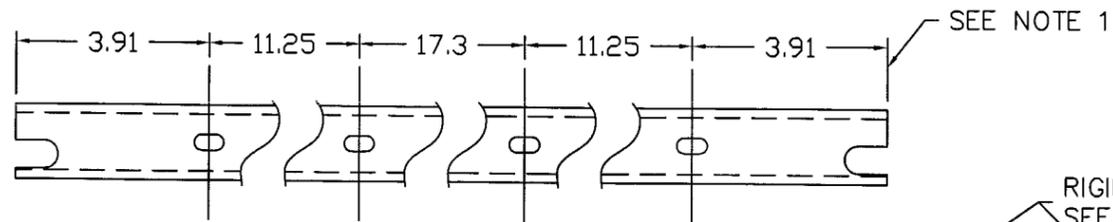


FAS-SEAL DOOR SWEEP

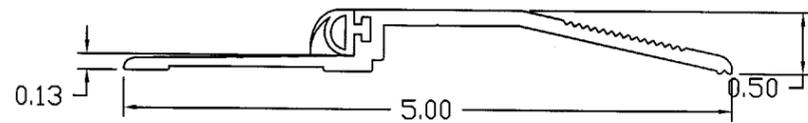


ZERO INT'L 566 SERIES THRESHOLD WITH NEOPRENE BUMPER

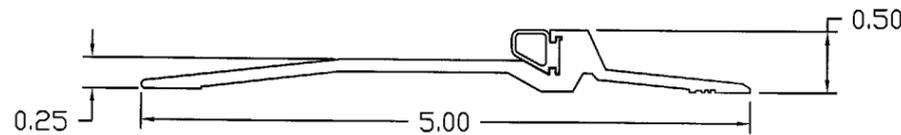

PEMCO 2005 SERIES THRESHOLD WITH SILICONE, VINYL OR PILE SEAL

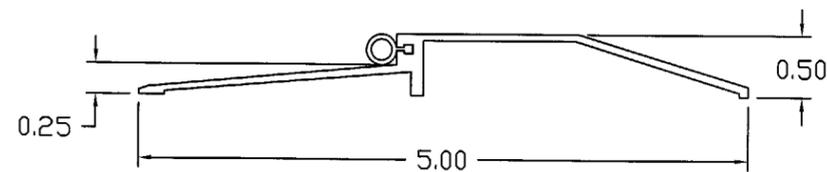

NATIONAL GUARD 950 SERIES THRESHOLD WITH SILICONE, VINYL OR NEOPRENE BUMPER

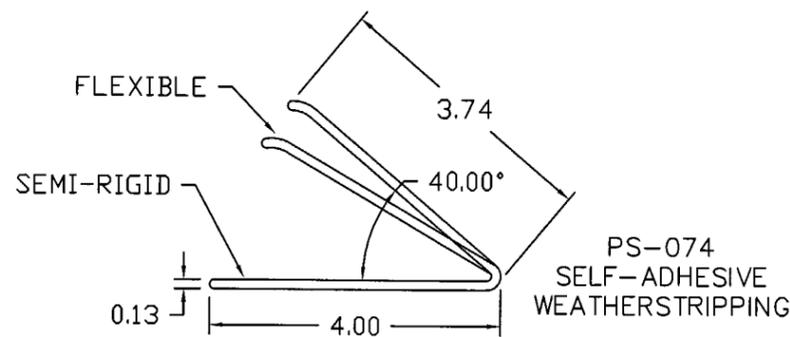

PS-074 SELF-ADHESIVE WEATHERSTRIPPING

SEE NOTE 1

RIGID SECTION SEE NOTE 2.

FLEXIBLE SECTION SEE NOTE 3.

#12-24 MACHINE SCREW SS Fy=120,000 PSI

SCHLAGE CM5500 AND PRO5500 SERIES MORTISE LOCKSET W/ AUTOBOLT

#8-32 MS SS Fy=120,000 PSI

#12-24 MS SS Fy=120,000 PSI

FALCON, T-SERIES CYLINDRICAL LEVER LOCKSET

#12-24 MACHINE SCREW SS Fy=120,000 PSI

FALCON M-SERIES MORTISE LOCKSET W/ DEAD BOLT

#12-24 MS SS Fy=120,000 PSI

#8-32 MS SS Fy=120,000 PSI

SCHLAGE CM5100 AND PRO5100 SERIES CYLINDRICAL LEVER LOCKSET


NOTES:

1. SWEEP MOUNTING SLOT LOCATIONS MAY VARY WITH DIFFERENT DOOR WIDTH.
2. DOOR SWEEP RIGID SECTION IS MADE OF PRO-FAX #PD-199 POLYPROPYLENE HOMOPOLYMER
3. DOOR SWEEP FLEXIBLE SECTION IS MADE OF SANTOPRENE #101-73 73 DUROMETER - SHORE A SCALE

Handwritten signature and date: 7/2/04

Approved as complying with the Florida Building Code
 Date 08/19/04
 NOAH 04-0303-03
 Miami Dade Product Control Division
 By *[Signature]*

BEND RADIUS



THIRD ANGLE PROJECTION
 DRAWN YMF DATE 04/08/03

CHECKED

APPROVED

ENG. APPVL



INGERSOLL-RAND COMPANY
 STEELCRAFT MFG.
 9017 BlueAsh Rd. Cincinnati Ohio 45242

TITLE DADE COUNTY
 SINGLE DOORS HARDWARE





SIZE FLAT DWG NO. 1035W SHEET 6 OF 7 REV A

SCALE: NTS AUTOCAD

REVISIONS

LTR	DESCRIPTION	DATE	APPROVED
A	RELEASE TO SHOP		

John
7/2/04

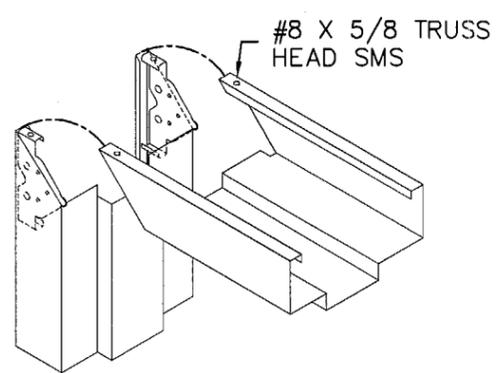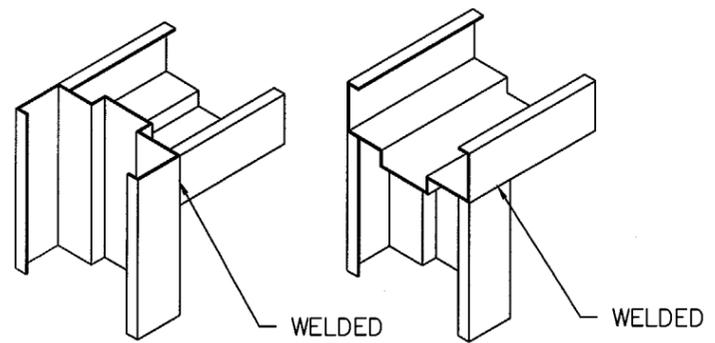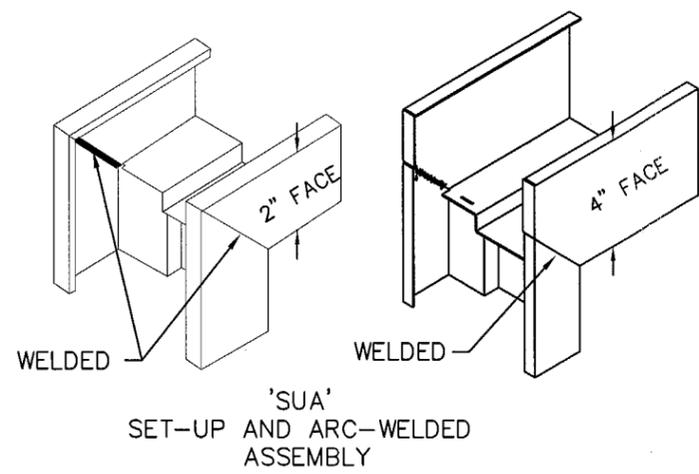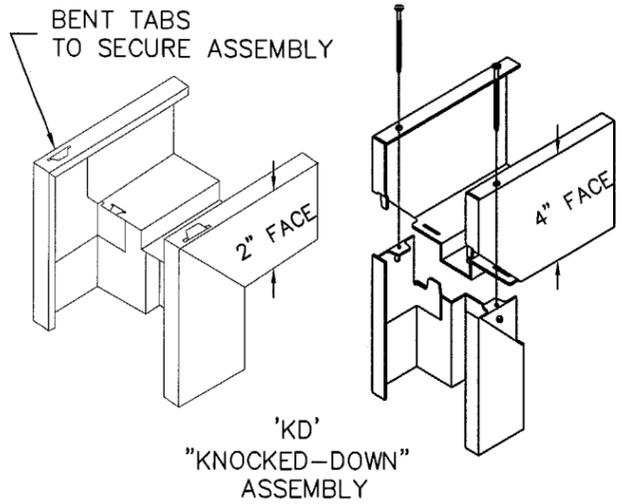


HEAD NOTCHED AND BUTTED BETWEEN JAMBS

HEAD SITS ON TOP OF NOTCHED JAMBS

'MU'
"MULTI-USE" SERIES
ASSEMBLY

Approved as complying with the
Florida Building Code
Date 08/19/04
NOA# 04-0303-03
Miami Dade Product Control
Division
By *[Signature]*

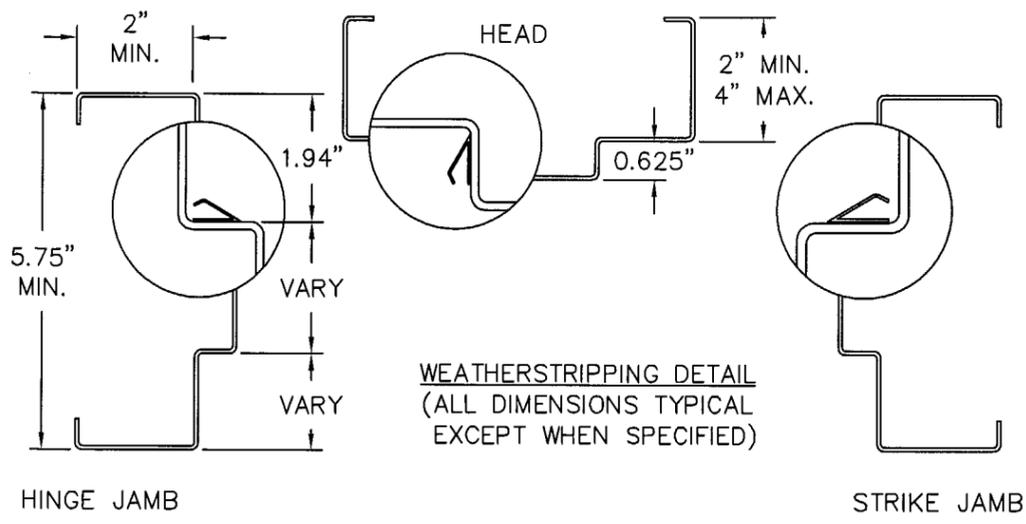

BEND RADIUS		<p>INGERSOLL-RAND COMPANY STEELCRAFT MFG. 9017 BlueAsh Rd. Cincinnati Ohio 45242</p>	
<p>THIRD ANGLE PROJECTION</p>			
DRAWN YMF	DATE 04/09/03	TITLE DADE COUNTY CORNER DETAILS AND WEATHERSTRIPPING ATTACHMENT FOR FLUSH FRAME AND MU FRAMES	
APPROVED		SIZE FLAT	DWG NO. 1035W
ENG. APPVL		SCALE: NTS	AUTOCAD
		SHEET 7 OF 7	REV A