



BUILDING CODE COMPLIANCE OFFICE (BCCO)
 PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
 METRO-DADE FLAGLER BUILDING
 140 WEST FLAGLER STREET, SUITE 1603
 MIAMI, FLORIDA 33130-1563
 (305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

Jeld-Wen, Inc.
 31725 Highway 97 North
 Chiloquin, OR 97624

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series- JELD-WEN Premium Wood Door, 6-8 and 8-0 Glazed Outswing Double Door
APPROVAL DOCUMENT: Drawing No. S-2036, titled "Series-JELD-WEN Premium Wood Door 6-8 and 8-0 Glazed Outswing Double Door" Sheets 1 through 7 of 7, prepared by manufacture dated 02/25/04 with revision "4" on 02/25/04 signed and sealed by James J. Dobrowski, P.E., bearing the Miami-Dade County Product Control Revision/Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises and renews NOA # 02-0722.11 and, consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Theodore Berman, P. E.**

NOA No 04-0312.01
 Expiration Date: April 26, 2009
 Approval Date: May 20, 2004
 Page 1



Jeld-Wen, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **S-2036**, titled "Series JELD-WEN Premium Wood Door 6-8 and 8-0 Glazed Outswing Double Door" Sheets 1 through 7 of 7, prepared by R. W. Building Consultant Inc. dated 02/25/04 with revisions "4" 02/25/04 signed and sealed by James J. Dobrowski, P.E.

B. TESTS

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1 (b) and TAS 202-94
along with marked-up drawings and installation diagram of double glazed outswing wood doors, prepared by Certified Testing Laboratories, Test Report No. **CTLA-572WA**, and **CTLA-572WC** both dated July 17 & 18, 2000 and revised by addendum letter dated March 15, 2001, signed and sealed by Ramesh Patel, P.E.
"Submitted under NOA # 02-0722.11"
2. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94 along with marked-up drawings and installation diagram of double glazed outswing wood doors, prepared by Certified Testing Laboratories, Test Report No. **CTLA-701W** dated June 08, 2001, signed and sealed by Ramesh Patel, P.E.
"Submitted under NOA # 02-0722.11"
3. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1 (b) and TAS 202-94
along with marked-up drawings and installation diagram of double glazed outswing wood doors, prepared by Certified Testing Laboratories, Test Report No. **CTLA-570WB**, dated July 25, 2000, signed and sealed by Ramesh Patel, P.E.
"Submitted under NOA # 02-0722.11"

C. CALCULATIONS

1. Anchor calculations ASTM-E1300, and structural analysis, dated 8/24/00, prepared, signed and sealed by Mark Fetherman, P.E.
"Submitted under NOA # 02-0722.11"
2. Wood strength referenced properties data from, "Wood Handbook" and table prepared by manufacturer
"Submitted under NOA # 02-0722.11"



Theodore Berman, P. E.

Deputy Director, Product Control Division

NOA No 04-0312.01

Expiration Date: April 26, 2009

Approval Date: May 20, 2004

Jeld-Wen, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. None

F. STATEMENTS

1. Statement letter of conformance and no financial interest, dated 07/26/2000, signed and sealed by Mark C. Fetherman, P.E.
“Submitted under NOA # 02-0722.11”
2. Statement letter dated 07/20/2000 designating Rick Wright of R. W. Consulting Inc., as the contact person for Jeld-Wen product approval, issued by Jeld-Wen, signed by Steve Frey
“Submitted under NOA # 02-0722.11”
3. Letter dated 7/20/2000 states that Rick Wright of R.W. Building Consultants Inc. has been contracted to represent JELD-WEN Inc., in matter pertaining to Metro-Dade County Product Approval, signed by Steve Frey.
“Submitted under NOA # 02-0722.11”
4. Letter dated 03/10/04 states that JELD-WEN is renewing and revising NOA # **02-0722.11**, signed by Steve Frey.

G. OTHER

1. Letter from the consultant stating that the product is in compliance with the Florida Building Code (FBC).

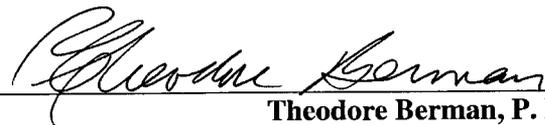
Theodore Berman, P. E.

Deputy Director, Product Control Division

NOA No 04-0312.01

Expiration Date: April 26, 2009

Approval Date: May 20, 2004

JELD-WEN®

PREMIUM WOOD DOOR
6-8 AND 8-0 GLAZED OUTSWING DOUBLE DOOR

GENERAL NOTES


1. THIS PRODUCT IS DESIGNED TO MEET THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. IMPACT RESISTANT SHUTTERS ARE REQUIRED
5. DESIGNED PRESSURE RATING SEE TABLE PAGE 1.

RESIDENTIAL STILE & RAIL WOOD DOOR (Common to all frame conditions)

Frame Construction: The head and side jambs are finger jointed ponderosa pine measuring 4.5625" x 1.25". The head and side jambs are mortised, butted and joined using (3) 16GA. 2" x 1/2" crown staples at the top corners. The bump threshold is attached to the floor.

Door Panel Construction: The panel is a stile and rail construction. The stiles and rails are constructed from solid wood of either Douglas Fir or Western Hemlock. They are laminated with a .0625" thk. wood veneer of the following species:

Douglas Fir, Western Hemlock, Ponderosa Pine, Northern Red Oak, Red Maple, Black Cherry, Yellow Poplar, True Hickory, True Mahogany, Black Walnut, & Red Alder. The veneer face sheet is glued to the stiles and rails. The top rail is connected to the perimeter stiles w/(2) .5" dia. min. x 4" long wooden dowels and the bottom rail is connected to the perimeter stile w/(3) .5" dia. min. x 4" long wooden dowels. The glazing is captured between the wood cap on the exterior and the wood glass stop on the interior. The panels are wet glazed using PRC 365 silicone.

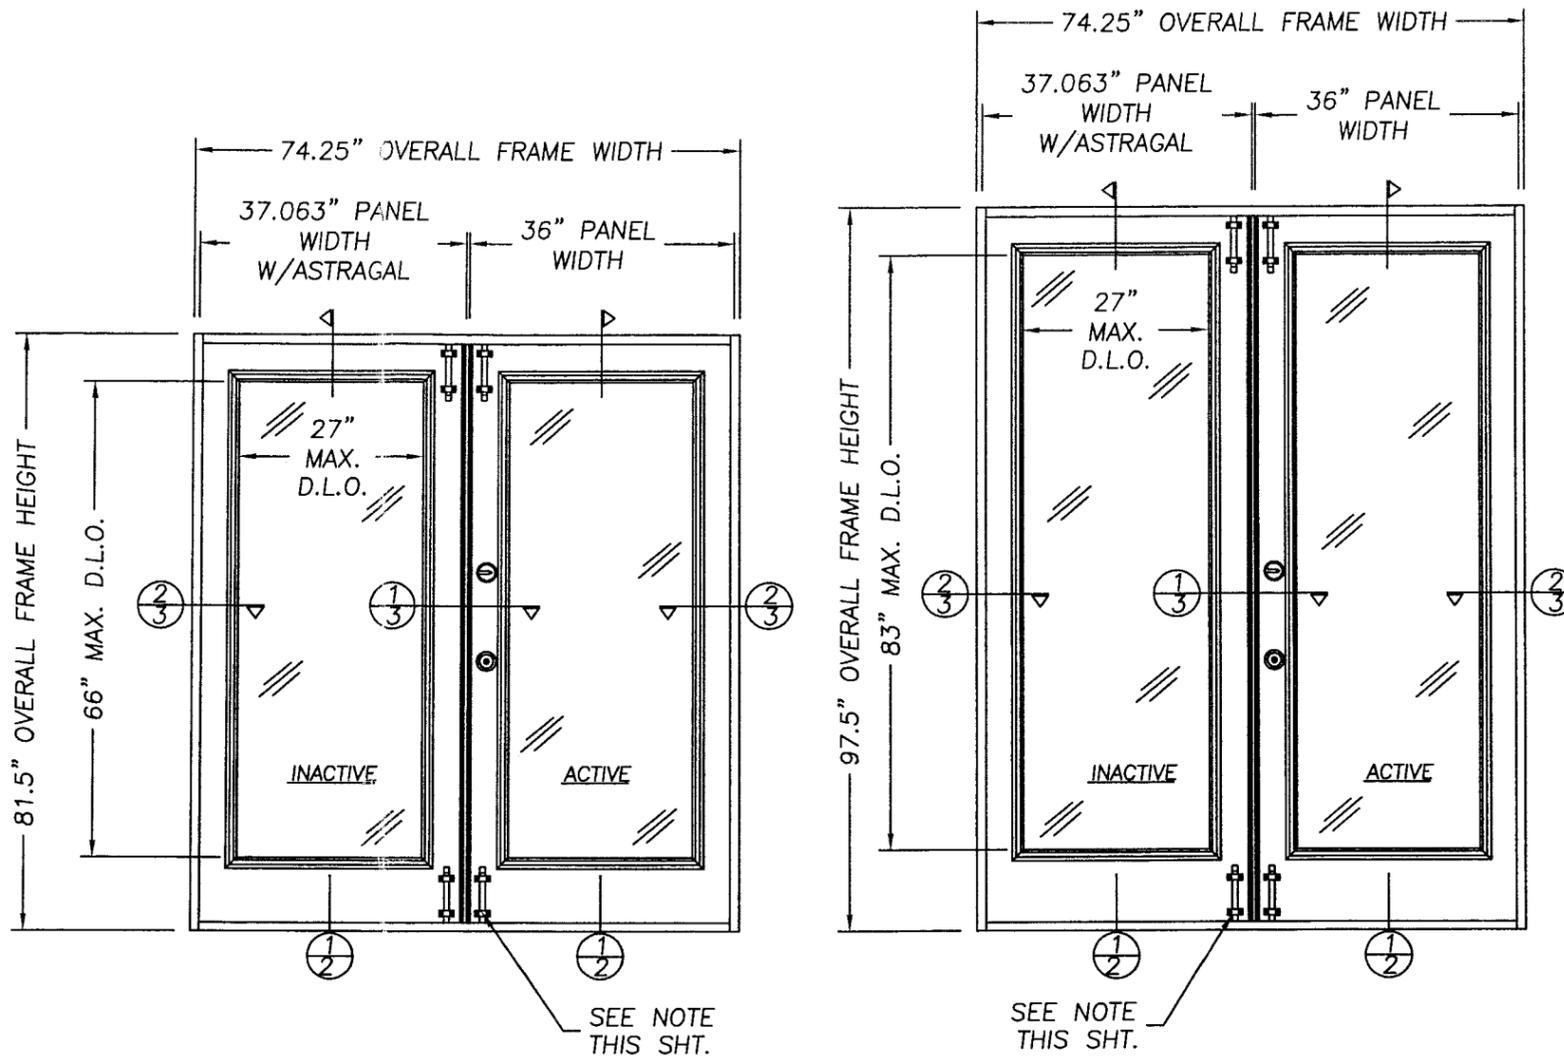

6-8 DOUBLE DOOR ELEVATION

8-0 DOUBLE DOOR ELEVATION

ALL MODELS ARE VIEWED FROM INTERIOR

NOTE
THE SURFACE BOLTS ARE AN OPTION ON THE ACTIVE DOOR AND ARE USED TO ACHIEVE A HIGHER PRESSURE SEE SHT. 3 SECTIONS 1/3 & NOTE 2 SHT. 3 FOR SURFACE BOLT OPTIONS (SEE DESIGN PRESSURE TABLE)

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT:
PREMIUM WOOD DOOR
6-8 AND 8-0 GLAZED OUTSWING
DOUBLE DOOR
PART OR ASSEMBLY:
GENERAL NOTES
TYPICAL ELEVATION

NO.	DATE	BY	REVISIONS
4	02/25/04	KMN	GENERAL REVISION
3	06/26/02	KMN	GENERAL REVISION
2	04/04/01	TJH	GENERAL REVISION
1	02/23/01	TJH	GENERAL REVISION

DATE: 2/25/04
SCALE: NTS
DWG. BY: KMN
CHK. BY: SF
DRAWING NO.: S-2036
SHEET 1 OF 7


DESIGN PRESSURE RATING (OUTSWING DOORS) WHERE WATER INFILTRATION REQUIREMENT IS NEEDED				
DOOR SIZE	W/SURFACE BOLTS ON INACTIVE PANEL		W/SURFACE BOLTS ON BOTH PANEL	
6-8	+47.0psf	-47.0psf	+65.0psf	-70.0psf*
8-0	+32.0psf	-32.0psf	+60.0psf	-60.0psf

NOTE: 6-8 TRUE DIVIDED MUNTIN LITE DOOR PANELS CANNOT EXCEED +65.0psf -65.0psf

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	COMMON (GENERAL NOTES, TYPICAL ELEVATION)
2	VERTICAL CROSS SECTION & B.O.M.
3	HORIZONTAL CROSS SECTIONS 1/3 & 2/3
4	ANCHORING LOCATIONS & DETAILS
5	GLAZING AND RAIL DETAILS
6	UNIT COMPONENTS
7	DOOR MODELS

James Dobrowski
4-19-04

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No. 04-0312-01
Expiration Date 04/26/04
By *Robert Bernan*
Miami Dade Product Control Division

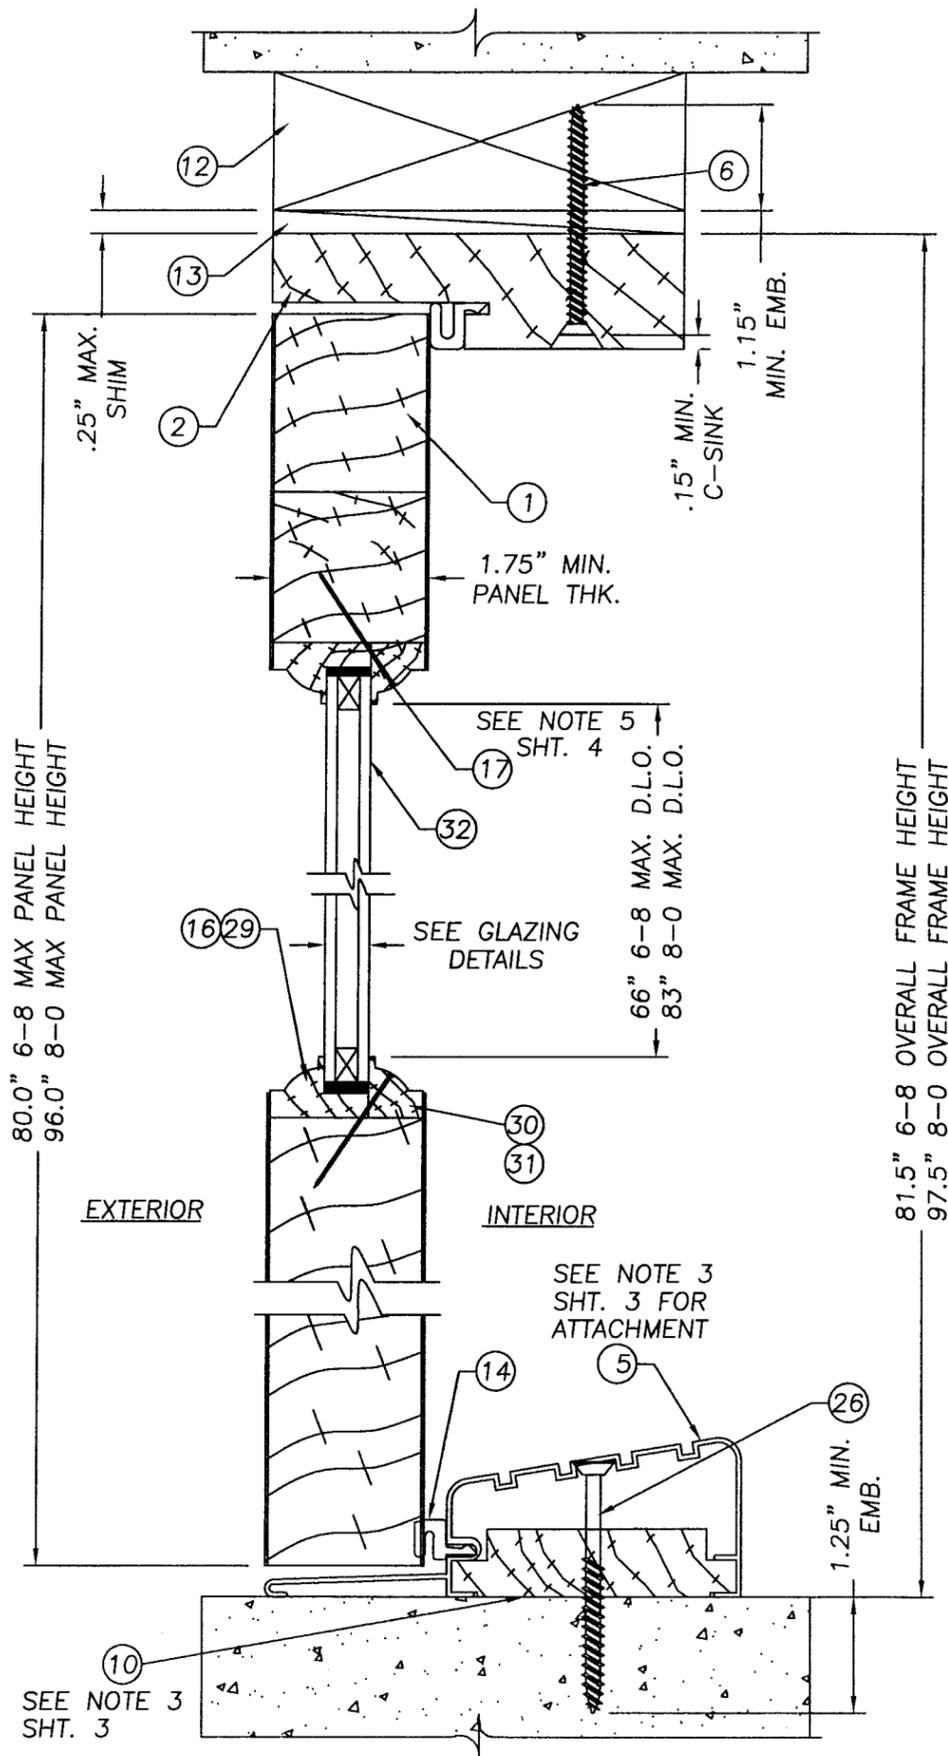

1 VERTICAL CROSS SECTION
2

Item	DESCRIPTION	Material
1	STILE & RAIL 6-8/8-0 WOOD DOOR (DOUGLAS FIR, WESTERN HEMLOCK, PONDEROSA PINE, NORTHERN RED OAK, RED MAPLE, BLACK CHERRY, YELLOW POPLAR, TRUE HICKORY, TRUE MAHOGANY, BLACK WALNUT, & RED ALDER)	PINE
2	HEAD JAMB (1 1/4" x 4 5/8" PONDEROSA PINE)	PINE
3	HINGE JAMB (1 1/4" x 4 5/8" PONDEROSA PINE)	PINE
4	(1) PIECE WOOD ASTRAGAL	PINE
5	BUMPER THRESHOLD (.051" WALL EXTRUDED ALUM. IMPERIAL)	ALUMINUM
6	#8 x 2 1/2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
7	KWIKSET TITAN 400 SERIES LOCK	
8	KWIKSET TITAN 720 SERIES DEADBOLT	
9	1/4" x 2 1/2" LG. TAPCON OR ITW BUILDDEX TAPCON (PER CURRENT NOA) OR ELCO TAPCON (PER CURRENT NOA)	STEEL
10	SILICONE CAULK (CR LAWRENCE 33S)	SILICONE
11	NOT USED	-
12	2x WOOD BUCK	WOOD
13	1/4" MAX. SHIMS	WOOD
14	COMPRESSION WEATHERSTRIP (Q-LON QDS-650)	FOAM
15	#10 x 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
16	WOOD CAP FOR .50" THK. GLASS	PINE
17	BRAD TRIM NAIL 1 1/2" L.	STEEL
18	4" x 4" BUTT HINGE 12GA. (.089" MIN)	STEEL
19	#9 x 1" PHILLIPS FLATHEAD WOOD SCREW	STEEL
20	#8 x 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
21	SURFACE BOLT (IVES, .25" STEEL)	STEEL
22	SURFACE BOLT STRIKE PLATE (IVES, .125" STEEL)	STEEL
23	1/4" CARRIAGE BOLT x 3" LG.	STEEL
24	1/4" JAMB NUT	STEEL
25	#10 x 2 1/2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
26	1/4" x 2 3/4" MIN. LG. TAPCON OR ITW BUILDDEX TAPCON (PER CURRENT NOA) OR ELCO TAPCON (PER CURRENT NOA)	STEEL
27	NOT USED	-
28	NOT USED	-
29	WOOD CAP FOR .125" THK. GLASS	PINE
30	WOOD GLASS STOP FOR .125" THK. GLASS	PINE
31	WOOD GLASS STOP FOR .50" THK. GLASS	PINE
32	1/2" INSULATED TEMPERED GLASS (BY PPG) 1/8" TEMPERED GLASS (BY PPG)	GLASS GLASS
33	GLAZING COMPOUND (PRC 365 BY DE-SOTO INTER.)	SILICONE
34	BRAD TRIM NAIL 3/4" L.	STEEL
35	TRUE DIVIDED GLASS GLAZING STOP	WOOD

James Dobrowolski
4-19-01

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057



PRODUCT:
PREMIUM WOOD DOOR
6-8 AND 8-0 GLAZED OUTSWING
DOUBLE DOOR
PART OR ASSEMBLY:
VERTICAL CROSS SECTIONS

NO.	DATE	REVISIONS
5	02/25/04	GENERAL REVISION KMN
4	08/27/02	GENERAL REVISION KMN
3	06/26/02	GENERAL REVISION KMN
2	04/04/01	GENERAL REVISION TJH
1	02/23/01	GENERAL REVISION TJH

DATE: 02/25/04
SCALE: NTS
DWG. BY: KMN
CHK. BY: SF
DRAWING NO.: S-2036
SHEET 2 OF 7

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 01-0312.01
Expiration Date 04/26/09

By *Alvan Bernan*
Miami Dade Product Control
Division

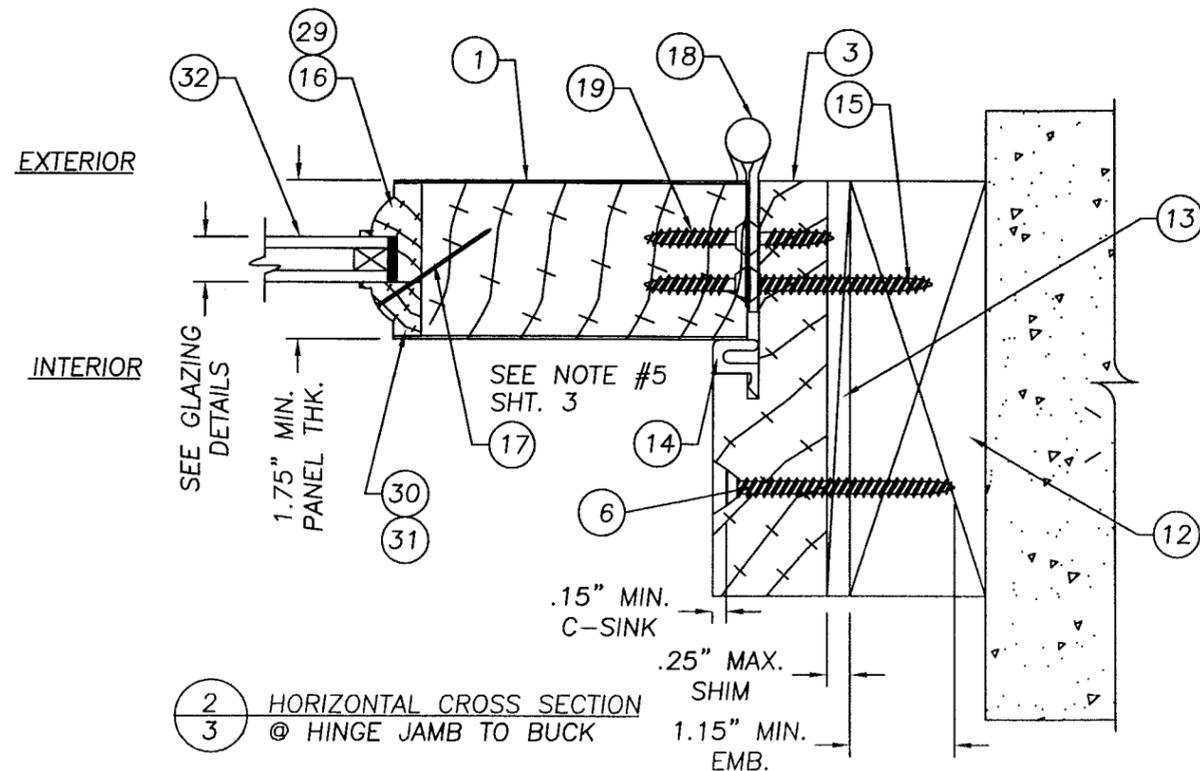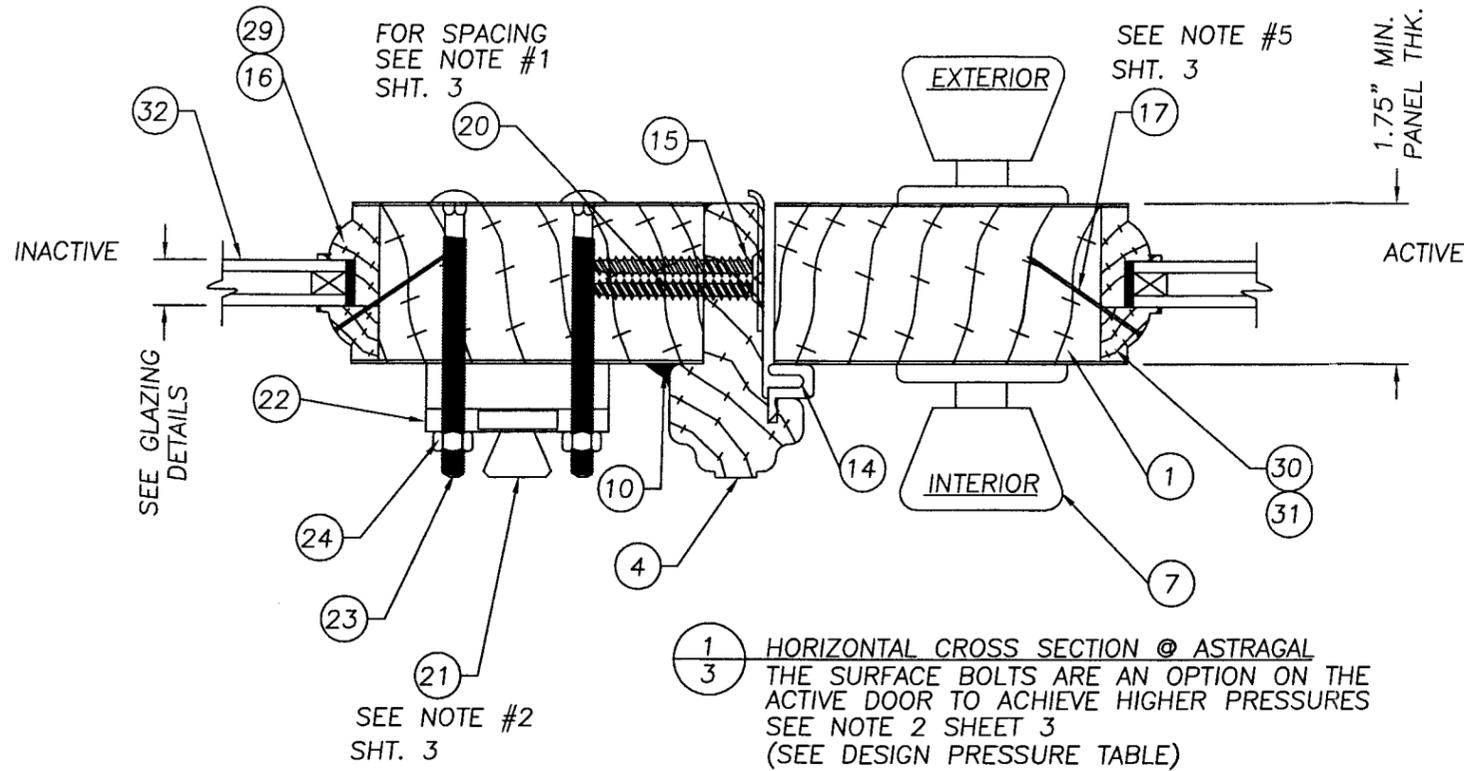

NOTES: (TYP. TO ALL FRAME CONFIGURATIONS)

1. SPACING FOR ITEM #20 (#8 x 2" SCREW) TO ATTACH THE WOOD ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS: FOR THE 6-8 UNIT TOP DOWN; 3", 12" & 21", FOR THE 8-0 UNIT TOP DOWN; 3", 14", 25" & 36". THE SPACING FROM THE BOTTOM UP IS THE SAME FOR BOTH UNITS; 3", 13 3/8" & 24 1/8".
2. THE SURFACE BOLTS ARE INSTALLED ON BOTH THE ACTIVE AND INACTIVE DOOR, AT THE TOP AND BOTTOM. THEY ARE NOT SHOWN ON THE ACTIVE DOOR IN SECTION 1/3 FOR CLARITY. SURFACE BOLTS ON THE ACTIVE DOOR ARE AN OPTION TO ACHIEVE HIGHER DESIGN PRESSURES SEE DESIGN PRESSURE TABLE.
3. THE THRESHOLD IS NOT ATTACHED TO THE FRAME, IT IS NOTCHED AND ATTACHED TO THE FLOOR WITH ITEMS #26 1/4" x 2 3/4" TAPCON AND #10 (OR LAWRENCE 33S SILICONE CAULK). APPLY A CONTINUOUS BEAD .125" THK. x .375" W. AROUND ALL (4) OUTER EDGES WITH A MINIMUM OF (2) ROWS IN A ZIG ZAG PATTERN IN THE MIDDLE THE ENTIRE LENGTH OF THE THRESHOLD, .125" THK. x .375" W.
4. THE TOP CORNERS OF THE DOOR FRAME, ARE STAPLED TOGETHER USING (3) 16GA. x 2" LG. x 1/2" CROWN STAPLES.
5. SPACING FOR ITEM #17 IS A MAX. OF 12" O.C.

James Dobrowski
4-19-04

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT: PREMIUM WOOD DOOR
6-8 AND 8-0 GLAZED OUTSWING
DOUBLE DOOR
PART OR ASSEMBLY:
HORIZONTAL CROSS SECTIONS

NO.	DATE	BY	REVISIONS
4	02/25/04	KMN	GENERAL REVISION
3	08/27/02	KMN	GENERAL REVISION
2	04/04/01	TJH	GENERAL REVISION
1	02/23/01	TJH	GENERAL REVISION

DATE: 02/25/04

SCALE: NTS

DWG. BY: KMN

CHK. BY: SF

DRAWING NO.: S-2036

SHEET 3 OF 7







PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 04-0312.01
Expiration Date 04/26/09
By *Cherilyn Kemmer*
Miami Dade Product Control
Division

JELD-WEN, INC.
 31725 HIGHWAY 97 NORTH
 CHILOQUIN, OR. 97624
 PH. 541.783.2057

PRODUCT:
 PREMIUM WOOD DOOR
 6-8 AND 8-0 GLAZED OUTSWING
 DOUBLE DOOR
 PART OR ASSEMBLY:
 ANCHORING LOCATIONS AND DETAILS


NO.	DATE	BY	REVISIONS
3	02/25/04	KMN	GENERAL REVISION
2	04/04/01	TJH	GENERAL REVISION
1	02/23/01	TJH	GENERAL REVISION

DATE: 02/25/04
 SCALE: NTS
 DWG. BY: KMN
 CHK. BY: SF
 DRAWING NO.: S-2036
 SHEET 4 OF 7

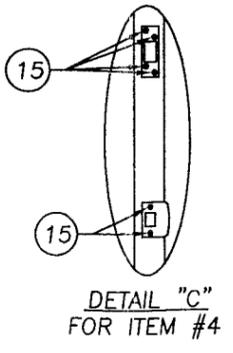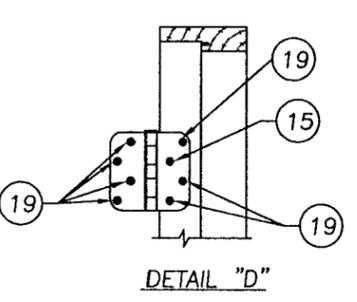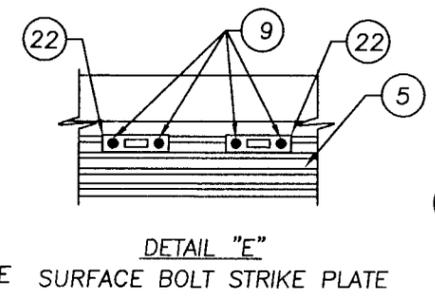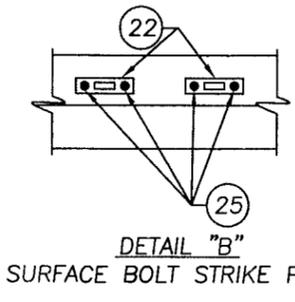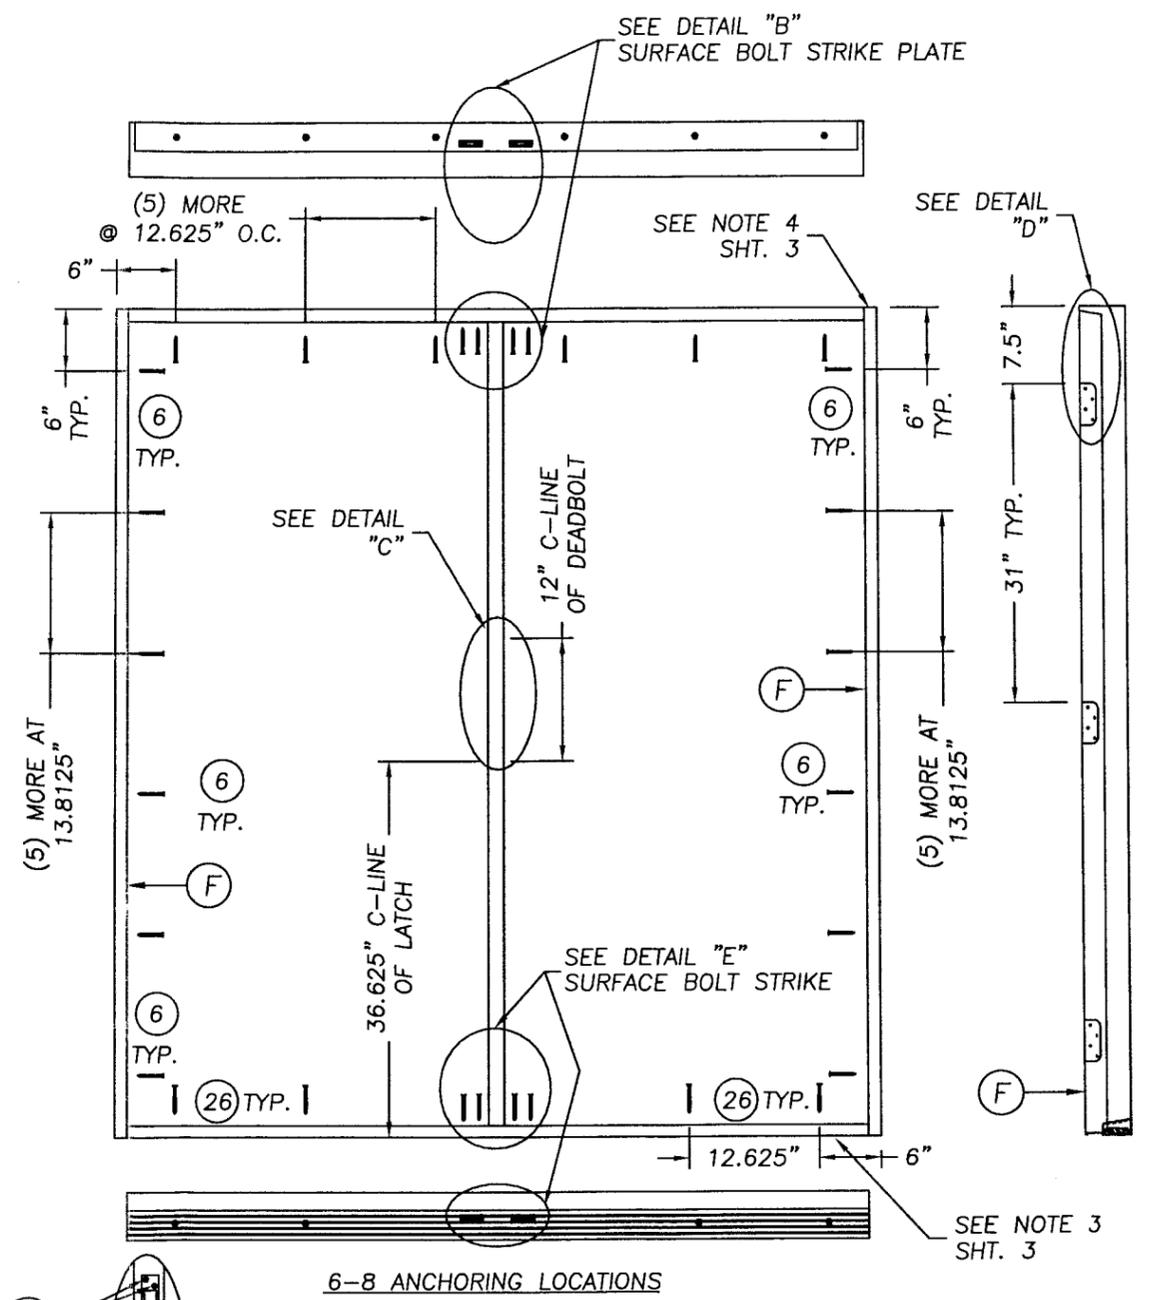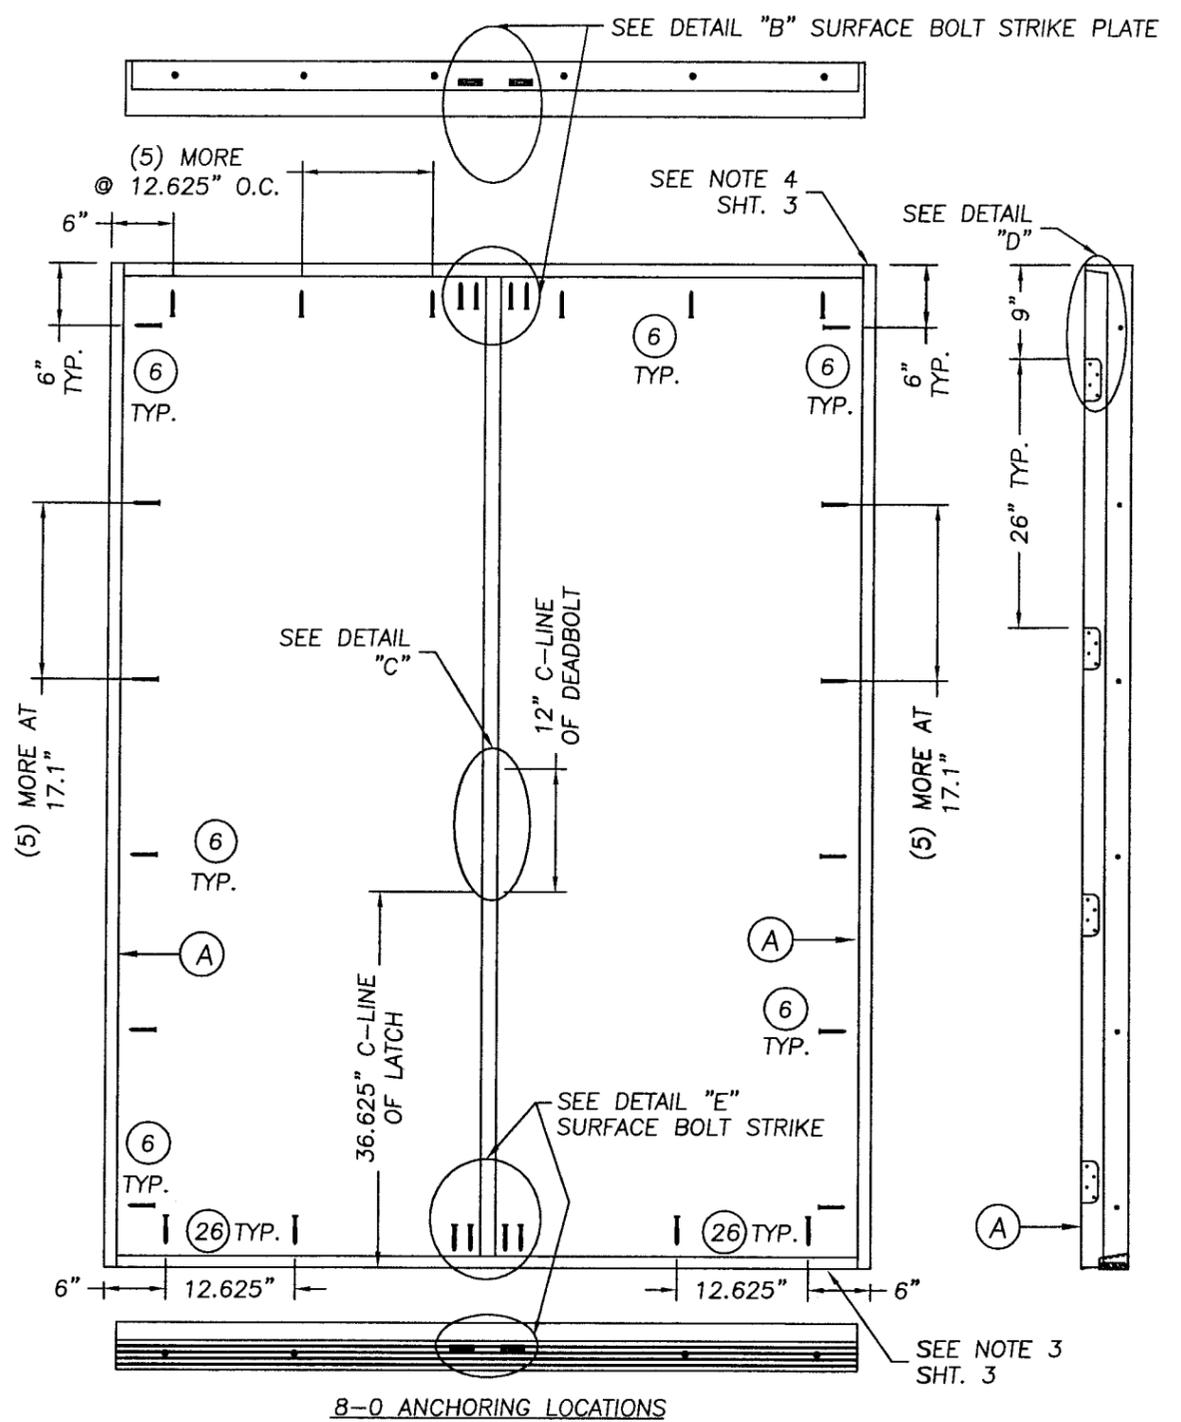


James Dabrowski
 4-19-04

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 04-0312.01
 Expiration Date 04/26/09
 By *Colvin Lerner*
 Miami Dade Product Control
 Division

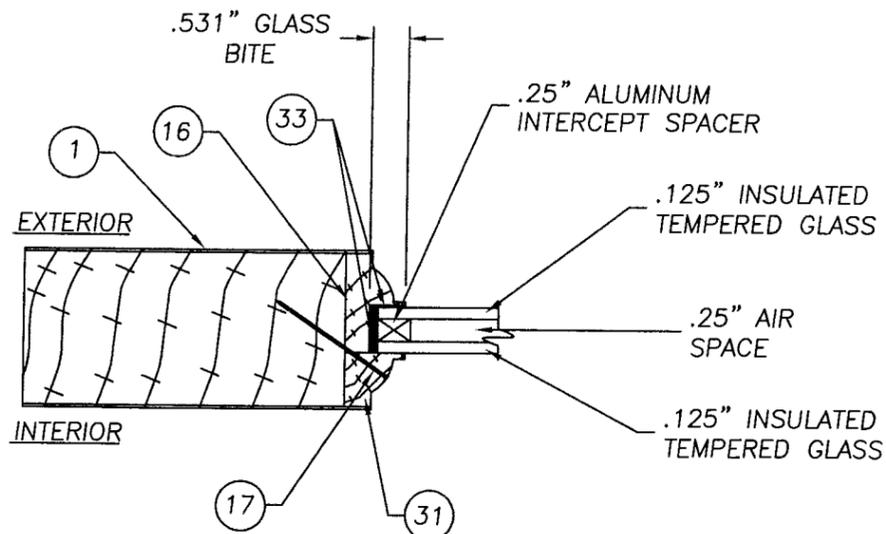


**.50" INSULATED TEMPERED GLASS
GLAZING DETAIL
SCALE: 1/2" = 1"**

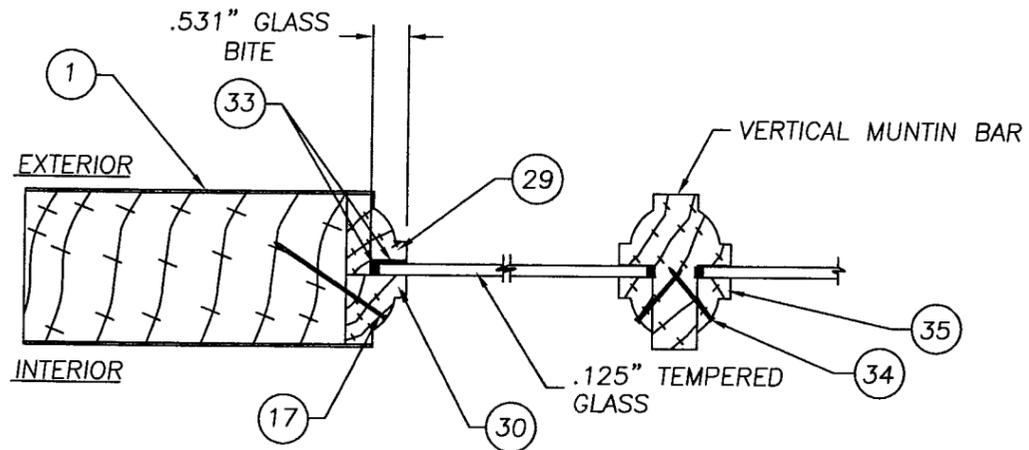


**.125" TEMPERED GLASS
GLAZING DETAIL
SCALE: 1/2" = 1"**


NOTE:
THE MULTI-LITE DOOR PANEL
IS MADE UP OF TRUE
DIVIDED GLASS PANELS.




**TRUE DIVIDED GLASS GLAZING STOP
SCALE: FULL**

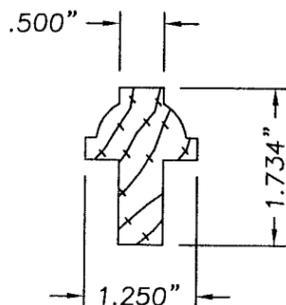

**VERTICAL MUNTIN BAR DETAIL
SCALE: 1/2" = 1"**

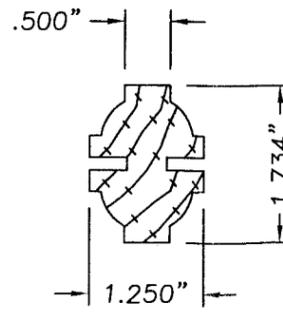


**CENTER BAR DETAIL
SCALE: 1/2" = 1"**

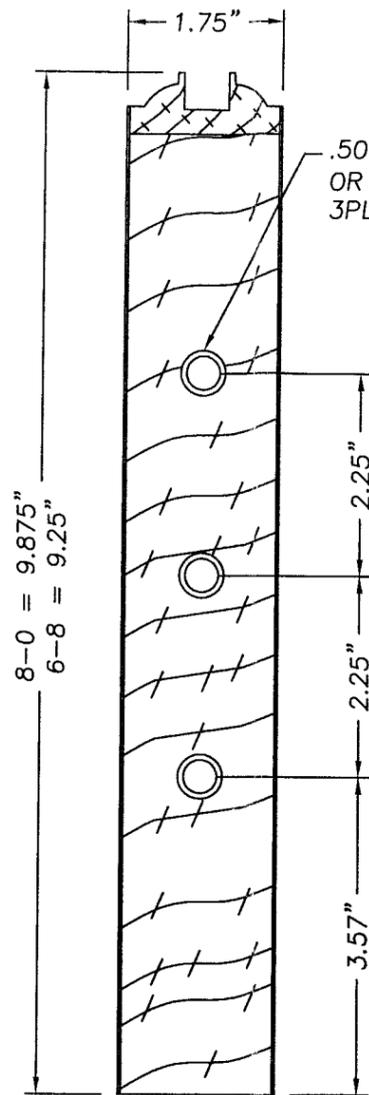


**BOTTOM RAIL
SCALE: 1/2" = 1"**

.50" WOOD DOWEL x 4.0" LG., 2PLCS OR
.625" WOOD DOWEL x 4.0" LG., 2PLCS

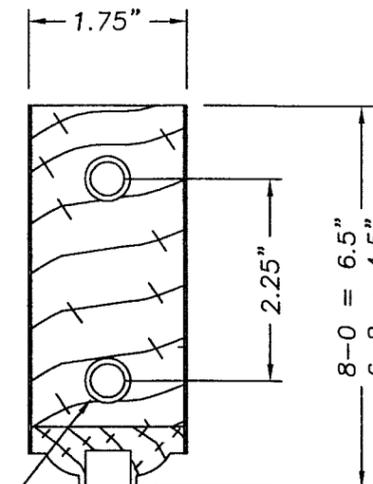

**TOP RAIL
SCALE: 1/2" = 1"**

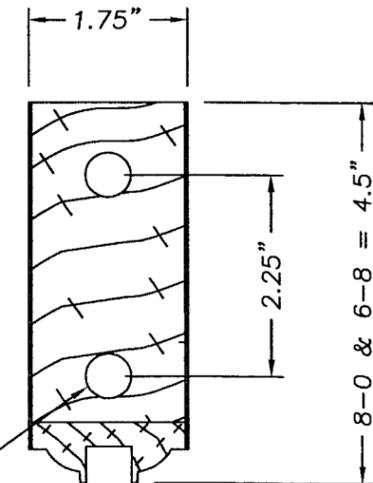

**SIDE STILE
SCALE: 1/2" = 1"**

.50" WOOD DOWEL x 4.0" LG., 2PLCS OR
.625" WOOD DOWEL x 4.0" LG., 2PLCS

NOTE:
DOWELS ARE GLUED AND PRESSED 2.0" INTO
THE RAILS AND STILES AT PANEL ASSEMBLY.

James Dobrowski
4-19-04

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT:
PREMIUM WOOD DOOR
6-8 AND 8-0 GLAZED OUTSWING
DOUBLE DOOR

PART OR ASSEMBLY:
GLAZING AND RAIL DETAILS

NO.	DATE	BY	REVISIONS
3	02/25/04	KMN	GENERAL REVISION
2	04/04/01	TJH	GENERAL REVISION
1	02/23/01	TJH	GENERAL REVISION

DATE: 02/25/04

SCALE: NTS

DWG. BY: KMN


CHK. BY: SF

DRAWING NO.:


S-2036

SHEET 5 OF 7


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 04-0312.01
Expiration Date 04/26/09
By *Alvin Berme*
Miami Dade Product Control
Division

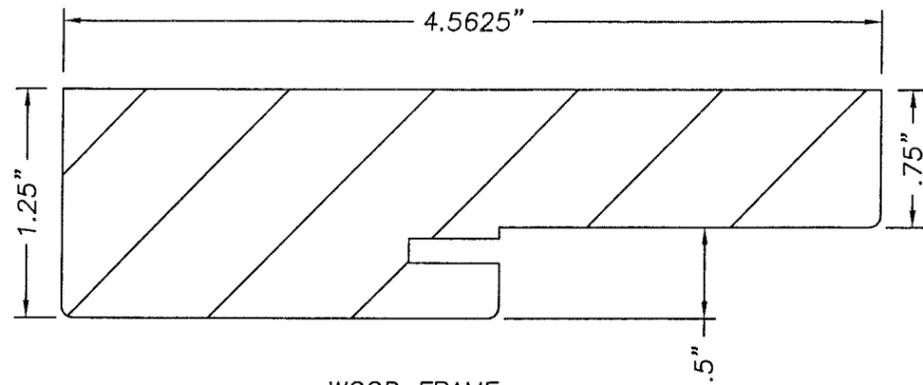


WOOD FRAME

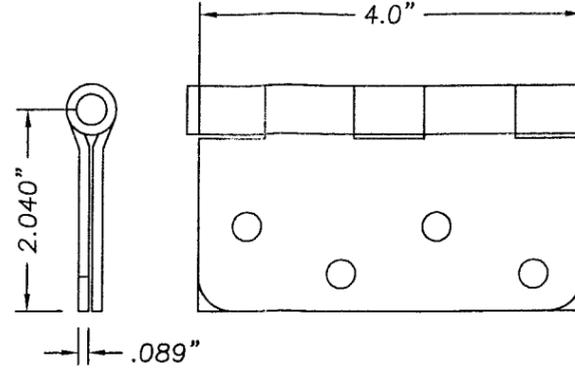


4 x 4 DOOR HINGE

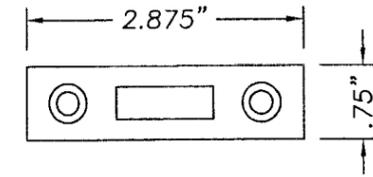


SURFACE BOLT STRIKE (IVES .125" STEEL)

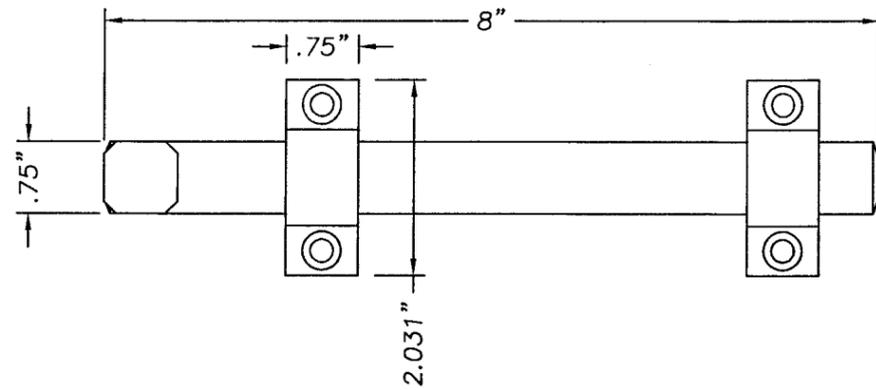

SURFACE BOLT (IVES .25" STEEL)

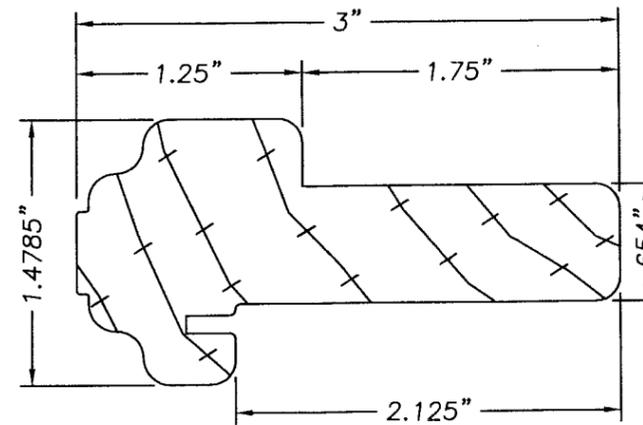

(1) PIECE WOOD ASTRAGAL

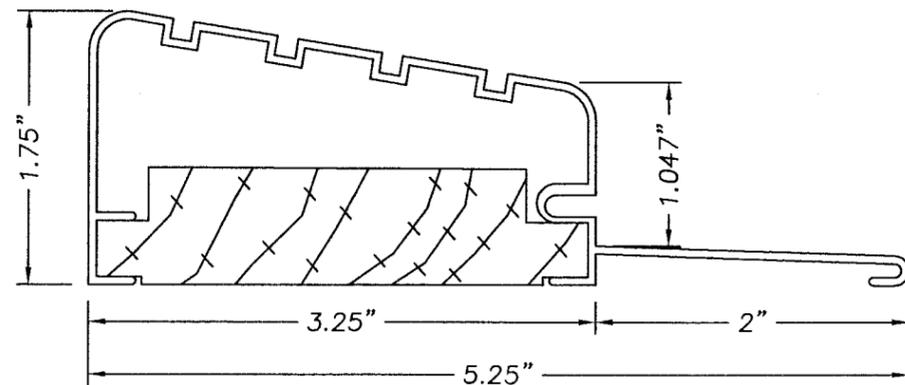

OUTSWING BUMP FACE ALUMINUM THRESHOLD
.051" WALL THK.

James Dobrowolski
4-19-04

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 04-0312.01
Expiration Date 04/26/09
By: *Chad Berno*
Miami Dade Product Control
Division

DATE: 02/25/04
SCALE: NTS
DWG. BY: KMN
CHK. BY: SF
DRAWING NO.: S-2036
SHEET 6 OF 7


JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT:
PREMIUM WOOD DOOR
6-8 AND 8-0 GLAZED OUTSWING
DOUBLE DOOR
PART OR ASSEMBLY:
UNIT COMPONENTS

NO.	DATE	BY	REVISIONS
3	02/25/04	KMN	GENERAL REVISION
2	04/04/01	TJH	GENERAL REVISION
1	02/23/01	TJH	GENERAL REVISION



8-0 DOOR MODELS
SEE NOTE THIS SHEET

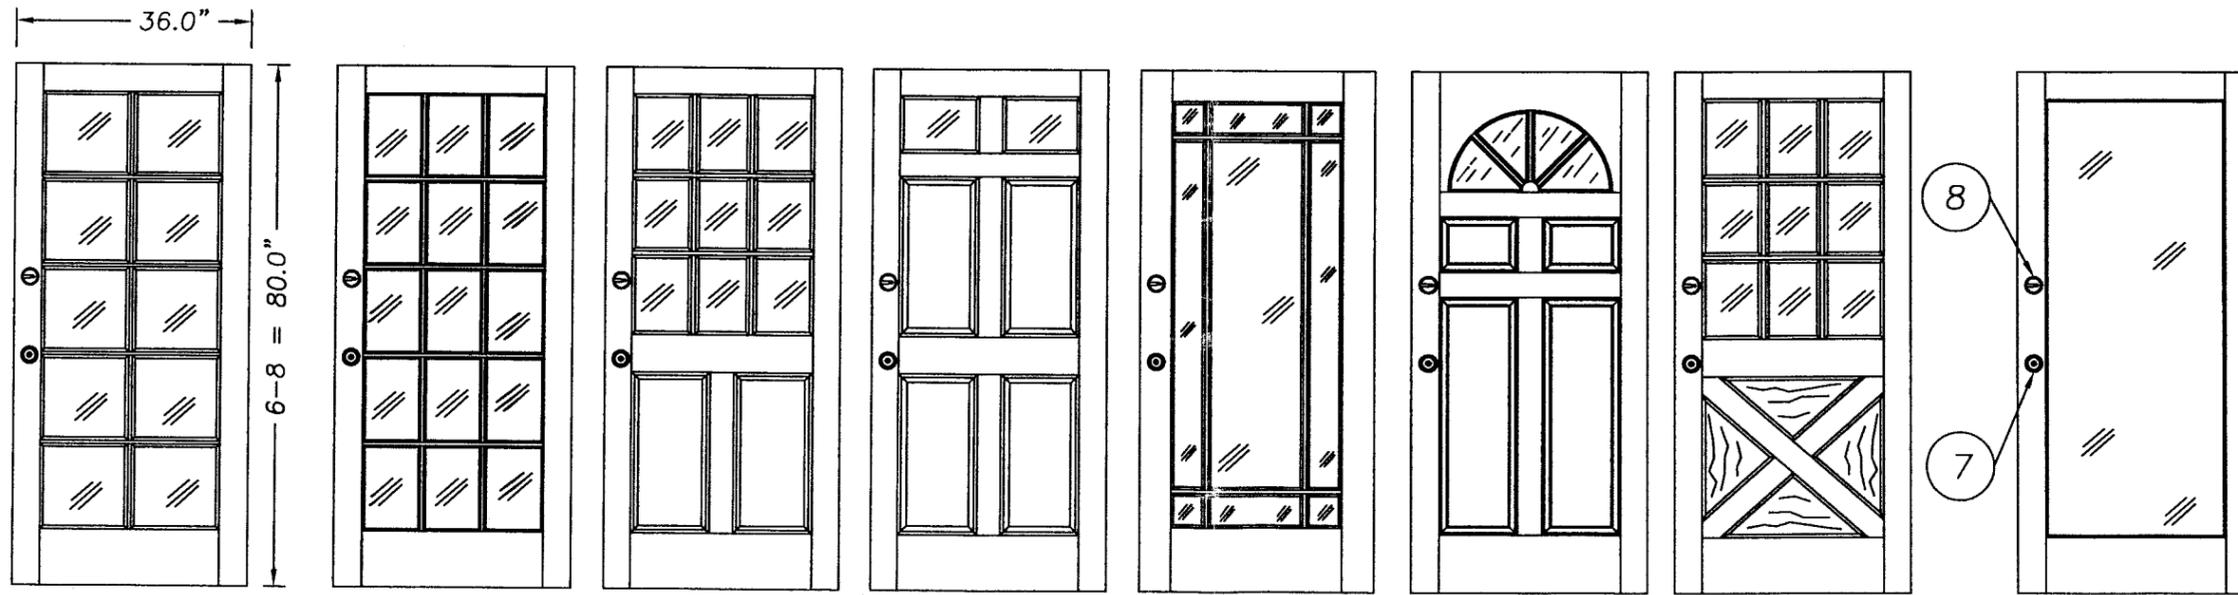

6-8 DOOR MODELS N.T.S.
SEE NOTE THIS SHEET

NOTE:
THE MULTI-LITE DOOR PANEL
IS MADE UP OF TRUE DIVIDED
GLASS PANELS. THE MAX. DESIGN
PRESSURE FOR THE 6-8 DOORS W/TRUE
DIVIDED GLASS IS +65 psf -65 psf
SEE DESIGN PRESSURE TABLE SHT. 1

James Dobrowolski
4-19-04

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT:
PREMIUM WOOD DOOR
6-8 AND 8-0 GLAZED OUTSWING
DOUBLE DOOR
PART OR ASSEMBLY:
DOOR MODELS

NO.	DATE	BY	REVISIONS
3	02/25/04	KMN	GENERAL REVISION
2	04/04/01	TJH	GENERAL REVISION
1	02/23/01	TJH	GENERAL REVISION

DATE: 02/25/04
SCALE: NTS
DWG. BY: KMN
CHK. BY: SF
DRAWING NO.: S-2036
SHEET 7 OF 7

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 04-0312-01
Expiration Date 04/26/09
By: *Gloria Bern*
Miami Dade Product Control
Division