



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Plaza Door Company, Inc.
5900 Australian, Ave.
Suite # 3
Mangonia Park, FL**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Titan Series VII- Non Impact Aluminum Sliding Glass Door

APPROVAL DOCUMENT: Drawing No. **03-043**, titled "Titan Series VII – Non Impact Aluminum Sliding Glass Door", sheets 1 through 6 of 6, prepared by EngCo, Inc., dated 12/10/03, signed and sealed by Pedro De Figueiredo, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.


TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Theodore Berman, P.E.**



**NOA No 04-0428.02
Expiration Date: June 24, 2009
Approval Date: June 24, 2004
Page 1**

Plaza Door Company, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **03-043**, titled "Titan Series VII- Non Impact Aluminum Sliding Glass Door", sheets 1 through 6 of 6, prepared by EngCo, Inc., dated 12/10/03, signed and sealed by Pedro De Figueiredo, P.E.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411.3.2.1 and TAS 202-94along with marked-up drawings and installation diagram of an aluminum sliding glass door, prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0151-0226-03** dated 2/21-3/21/03, signed and sealed by Vinu J. Abraham, P.E.
2. Test reports on
 - 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 2) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94along with marked-up drawings and installation diagram of an aluminum sliding glass door, prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0171-0802-03**, dated 8/05-13/03, signed and sealed by Vinu J. Abraham, P.E.

C. CALCULATIONS

1. Anchor Calculations, ASTM E-1300, and structural analysis, prepared by EngCo, Inc., dated 12/08/03, signed and sealed by Pedro De Figueiredo, P.E.

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. None

F. STATEMENTS

1. Statement letter of no financial interest, dated 12/15/03, signed and sealed by Pedro De Figueiredo, P.E.
2. Statement letter of conformance and no financial interest, dated 04/26/04, signed by Randall W. / Stowell.

G. OTHER

1. Letter from consultant stating that the product is in compliance with the Florida Building Code (FBC).



Theodore Berman, P.E.
Deputy Director, Product Control Division
NOA No 04-0428.02
Expiration Date: June 24, 2009
Approval Date: June 24, 2004

INDEX:


- SHEET 1 of 6 - GENERAL NOTES AND COMPONENTS
- SHEET 2 of 6 - ELEVATION AND DESIGN RATING
- SHEET 3 of 6 - 90° TOP VIEW & SECTION DETAILS
- SHEET 4 of 6 - SECTION DETAILS
- SHEET 5 of 6 - CORNER ASSEMBLY, GLAZING DETAIL AND HARDWARE
- SHEET 6 of 6 - ANCHORAGE TABLES AND BILL OF MATERIALS

GENERAL NOTES:


- 1- CODE: THIS PRODUCT HAS BEEN TESTED AND DESIGNED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE 2001 Ed.
- 2- DEFINITION: THIS PRODUCT IS AN ALUMINUM SLIDING GLASS DOOR NON IMPACT RESISTANT. (APPROVED HURRICANE SHUTTERS MUST BE INSTALLED IN ORDER TO COMPLY WITH IMPACT RESISTANT CRITERIA)
- 3- POSTING: 'TITAN VII SERIES - NON IMPACT ALUMINUM SLIDING GLASS DOORS PLAZA DOOR COMPANY, INC WEST PALM BEACH - FLORIDA DADE COUNTY PRODUCT CONTROL APPROVED'
- 4- DESIGN LOADS: THE DESIGNED LOADS MUST BE CALCULATED BY A PROFESSIONAL ARCHITECT OR ENGINEER FOR EACH SPECIFIC PROJECT. THE CALCULATED DESIGNED PRESSURE MUST NOT EXCEED THE ALLOWABLE APPROVED PRESSURE.
- 5- MATERIAL: ALL ALUMINUM PARTS TO BE 6063-T6 ALLOY OR AS NOTED AND GLAZING TO BE AS SPECIFIED ON THIS APPROVAL.
- 6- FASTENERS: ASSEMBLY SCREWS AND ANCHORS SHALL BE AS SPECIFIED IN THE CURRENT SET OF DRAWINGS. INSTALLATION AND LOADS AS PER THIS APPROVAL. ANCHOR SPACING AND LOADS MUST NOT EXCEED THE MAXIMUM LIMITS SPECIFIED BY THIS APPROVAL.
- 7- USE: IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR, ARCHITECT OR ENGINEER OF RECORD TO VERIFY THE FOLLOWING:
 - 7.1- THE STABILITY OF THE STRUCTURE WHERE THE PRODUCT IS TO BE ATTACHED INSURING PROPER ANCHORAGE.
 - 7.2- THE SITE SPECIFIC PROJECT CRITERIA, SUCH AS BUT NOT LIMITED TO, LOCAL CODE REQUIREMENTS, DESIGNED PRESSURES ETC.
 - 7.3- THAT THIS APPROVAL IS ADEQUATE TO THE SPECIFIC PROJECT.
- 8- MANUFACTURER NOTICE: ALL IDEAS, DESIGNS, ARRANGEMENTS AND PLANS INDICATED AS REPRESENTED BY THIS DRAWING ARE OWNED BY , AND THE PROPERTY OF PLAZA DOOR COMPANY AND WERE CREATED, EVOLVED AND DEVELOPED FOR USE ON, AND IN CONNECTION WITH, THE SPECIFIED PROJECT. NONE OF SUCH IDEAS, DESIGNS, ARRANGEMENTS OR PLANS SHALL BE USED BY OR DISCLOSED TO ANY PERSON, FIRM OR CORPORATION FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF THE MANUFACTURER.
- 9- 33 1/3% INCREASE IN ALLOWABLE LOADS HAVE NOT BEEN USED IN THE DESIGN OF THE ANCHORS FOR THIS PRODUCT APPROVAL. HOWEVER, WOOD SCREWS WITH 1.33 INCREASE FOR WIND LOAD DURATION HAVE BEEN USED.

DOOR ALLOWABLE DESIGNED PRESSURES
SEE SHEET 2 OF 5 FOR PRESSURES
ALLOWABLE DESIGNED PRESSURES X SIZES.


DOOR COMPONENTS

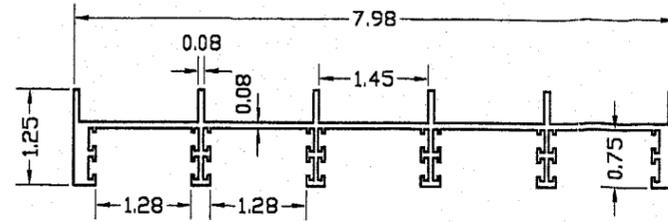


1- FIVE TRACK JAMB (MODIFIED PDC-10)
ALLOY: 6063-T6

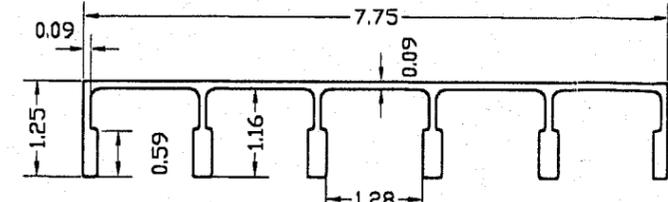


2- FIVE TRACK HEADER (PDC-033)
ALLOY: 6063-T6

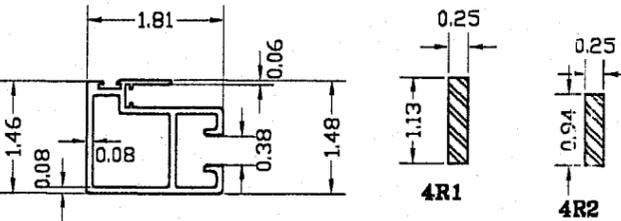


4- DOOR INTERLOCK **4R- DOOR REINFORCEMENT**
ALLOY: 6063-T6 ALLOY: 6061-T6




9A- CORNER ADAPTOR (PDC-002)
ALLOY: 6063-T6




9AR- CORNER ADAPTOR REINFORCEMENT
ALLOY: 6061-T6

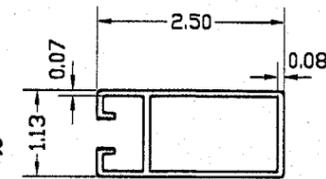


9B- CORNER ADAPTOR (PDC-015)
ALLOY: 6063-T6

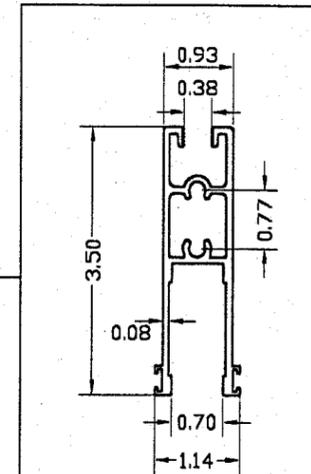

8- DOOR BOTTOM RAIL (PDC-082)
ALLOY: 6063-T6

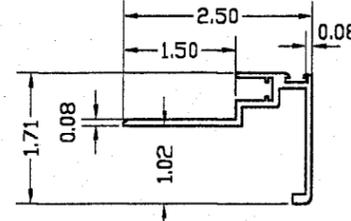


7- POCKET INTERLOCK (PDC-020)
ALLOY: 6063-T6

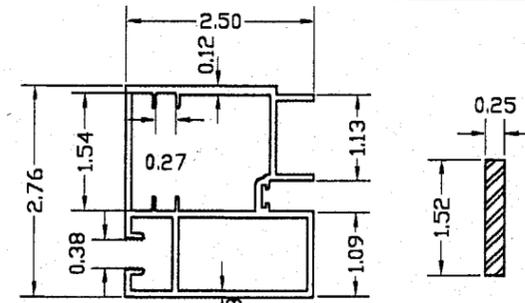


9- DOOR END RAIL (PDC-066)
ALLOY: 6063-T6

9R- DOOR REINF. STEEL ASTM A36

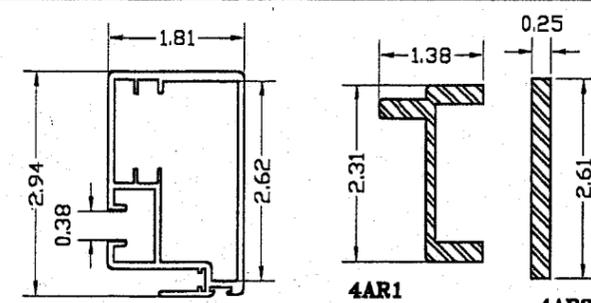


4A- DOOR HD INTERLOCK (PDC-072)
ALLOY: 6063-T6


4AR- DOOR REINFORCEMENT
ALLOY: 6061-T6

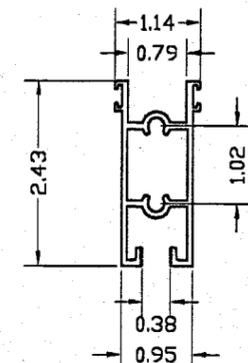

8A- DOOR TOP RAIL (PDC-016)
ALLOY: 6063-T6



5- GLASS ADAPTOR (PDC-091)
ALLOY: 6063-T6

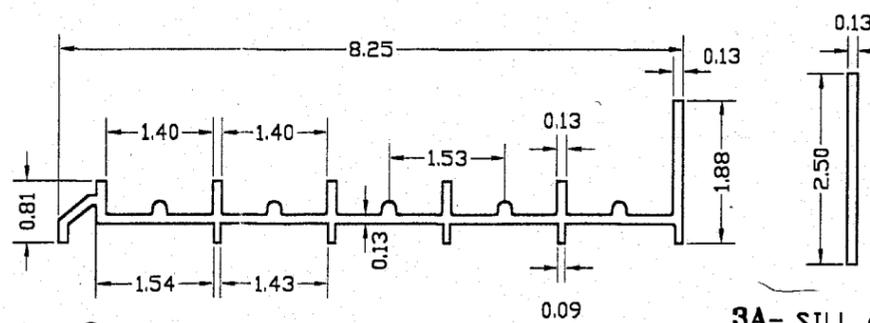

3- FIVE TRACK SILL (PDC-038)
ALLOY: 6063-T6

3A- SILL ADAPTOR
ALLOY: 6063-T5

Approved as complying with the Florida Building Code
Date: 06/24/04
NOA#: 04-0428-02
Miami Dade Product Control
Division
By: *[Signature]*

MANUFACTURER: PLAZA DOOR CO., INC

5900 AUSTRALIAN AVE.
SUITE #3
WEST PALM BEACH
FLORIDA, 33402
PHONE: (561) 842-6551
FAX: (561) 842-6541

PRODUCT: Titan Series

VII - NON IMPACT
ALUMINUM SLIDING GLASS
DOOR

Engineering: EngCo Inc.

CA 8116
6971 W. SUNRISE BLVD. 104
PLANTATION, FL. 33313
TEL.: (954) 585-0304
FAX.: (954) 585-0305



DEC 15 2003

Engineer Seal
Pedro De Figueiredo
PE 52609



Date: 12/10/03
Scale: NA
Design by: PPMF

Revision:


Drawing Number
03-043

Sheet
1 of 6

ELEVATIONS & DESIGN RATING

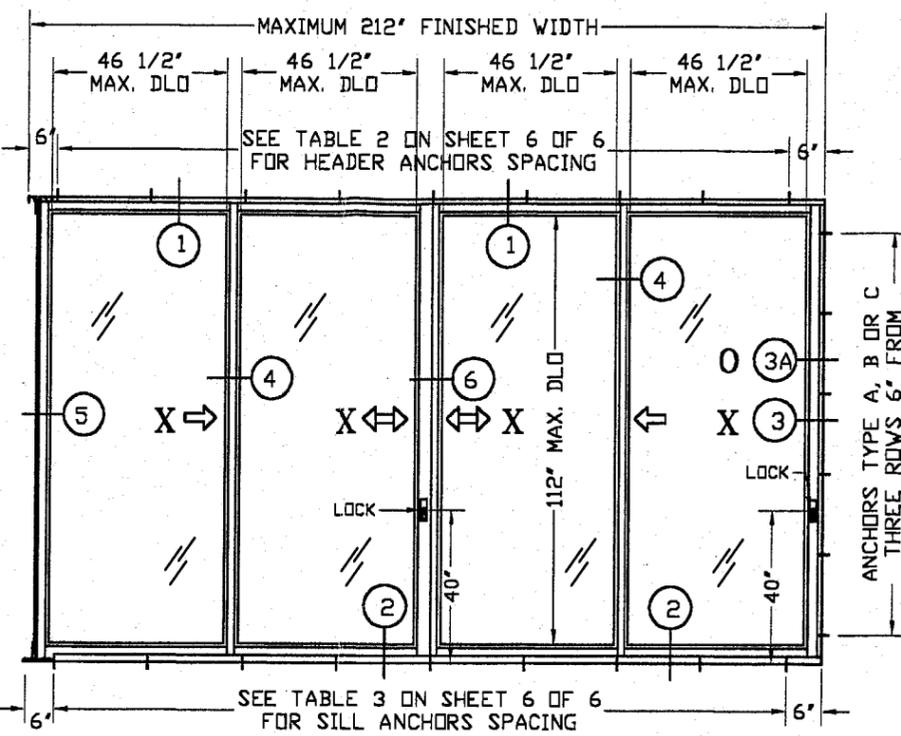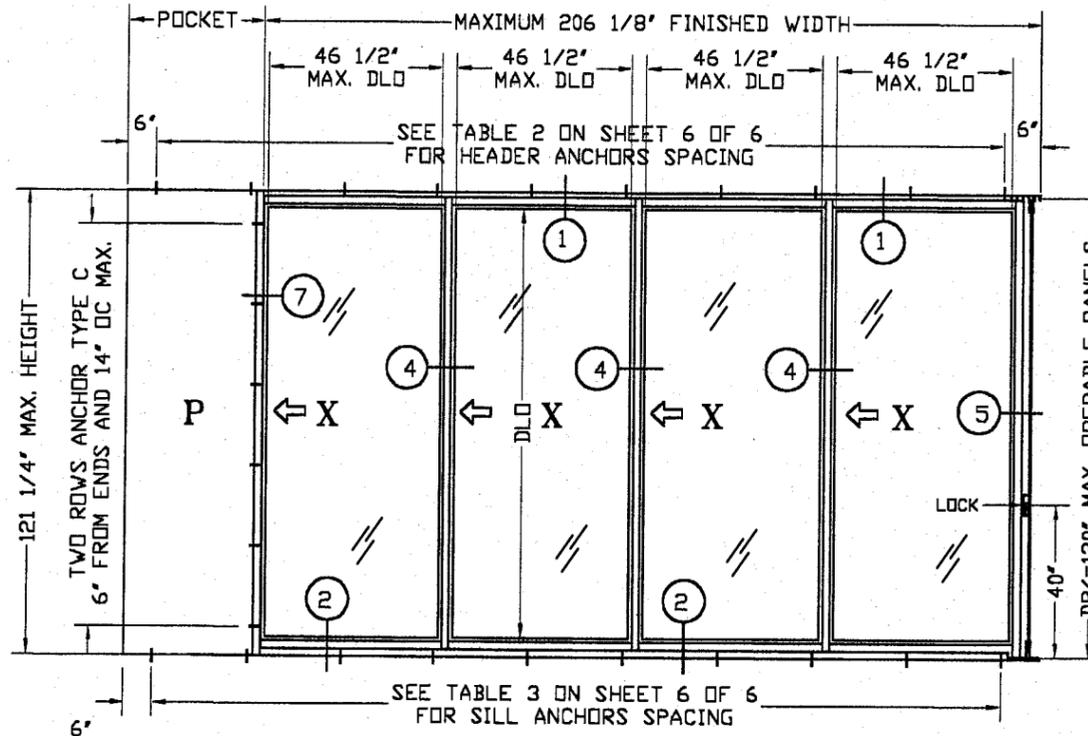

MODEL: DOUBLE 90°
 AVAILABLE CONFIGURATIONS:
 D-AB-PXXXX // XXXX (AS SHOWN)
 D-AB-PXXXX // XXXO
 D-An...XX // OX...
 DOOR CONFIGURATIONS CAN BE
 ARRANGED INTO MANY
 COMBINATIONS OF MOVABLE PANELS
 (X), FIXED PANELS (O) AND/OR
 POCKETS (P).
 NUMBER OF PANELS: n

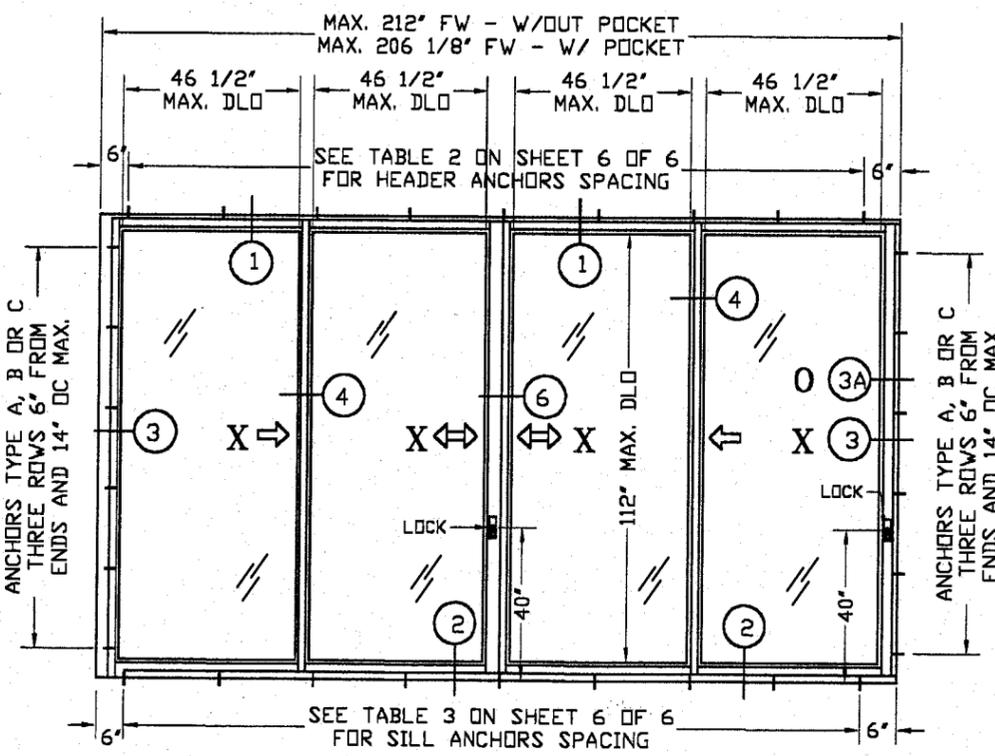


MODEL: SINGLE
 AVAILABLE CONFIGURATIONS:
 S-A4-XXXX (AS SHOWN)
 S-A4-OXXX
 S-An...XO...
 DOOR CONFIGURATIONS CAN BE
 ARRANGED INTO MANY
 COMBINATIONS OF MOVABLE PANELS
 (X), FIXED PANELS (O) AND/OR
 POCKETS (P).
 NUMBER OF PANELS: n

TABLE 1 - ALLOWABLE DESIGNED PRESSURES (Psf)

DLO HEIGHT	DOOR DLO WIDTH (INCHES)			
	28 1/2	34 1/2	40 1/2	46 1/2
88	-76, +76*	-66, +66*	-59, +59*	-54, +54*
100	-74, +74*	-64, +64*	-57, +57*	-52, +52*
112	-72, +72*	-62, +62*	-55, +55*	-50, +50

NOTES:
 1- DLO ARE IN INCHES
 2- DESIGNED PRESSURES ARE IN PSF
 3- * IN AREAS WHERE THE DOOR DESIGN IS LIMITED BY WATER INFILTRATION, USE **MAXIMUM +50 PSF** FOR POSITIVE PRESSURE. SEE ILLUSTRATION 'Z' BELOW.

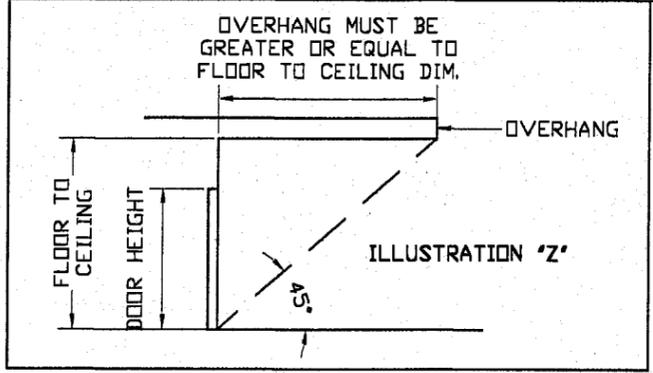

Approved as complying with the
 Florida Building Code
 Date: 06/24/04
 NOA# 04-0428-02
 Miami Dade Product Control
 Division
 By: *[Signature]*

MANUFACTURER:
PLAZA DOOR CO., INC
 5900 AUSTRALIAN AVE.
 SUITE #3
 WEST PALM BEACH
 FLORIDA, 33402
 PHONE: (561) 842-6551
 FAX: (561) 842-6541

PRODUCT:
Titan Series
 VII - NON IMPACT
 ALUMINUM SLIDING GLASS
 DOOR

Engineering:
EngCo Inc.
 CA 8116
 6971 W. SUNRISE BLVD. 104
 PLANTATION, FL. 33313
 TEL: (954) 585-0304
 FAX: (954) 585-0305

[Signature]

DEC 15 2003
 Engineer Seal
 Pedro De Figueiredo
 PE 52609

Date: 12/10/03
 Scale: NA
 Design by: PPMF

Revision:

Drawing Number
03-043

Sheet
2 of 6

MANUFACTURER:
**PLAZA DOOR
 CO., INC**
 5900 AUSTRALIAN AVE.
 SUITE #3
 WEST PALM BEACH
 FLORIDA, 33402
 PHONE: (561) 842-6551
 FAX: (561) 842-6541

PRODUCT:
Titan Series
 VII - NON IMPACT
 ALUMINUM SLIDING GLASS
 DOOR

Engineering:
EngCo Inc.
 CA 8116
 6971 W. SUNRISE BLVD. 104
 PLANTATION, FL. 33313
 TEL: (954) 585-0304
 FAX: (954) 585-0305

[Signature]
 DEC 15 2003


Engineer Seal
 Pedro De Figuerado
 PE 52609

Date: 12/10/03
 Scale: NA
 Design by: PPMF

Revision:

Drawing Number
 03-043

Sheet
 3 of 6

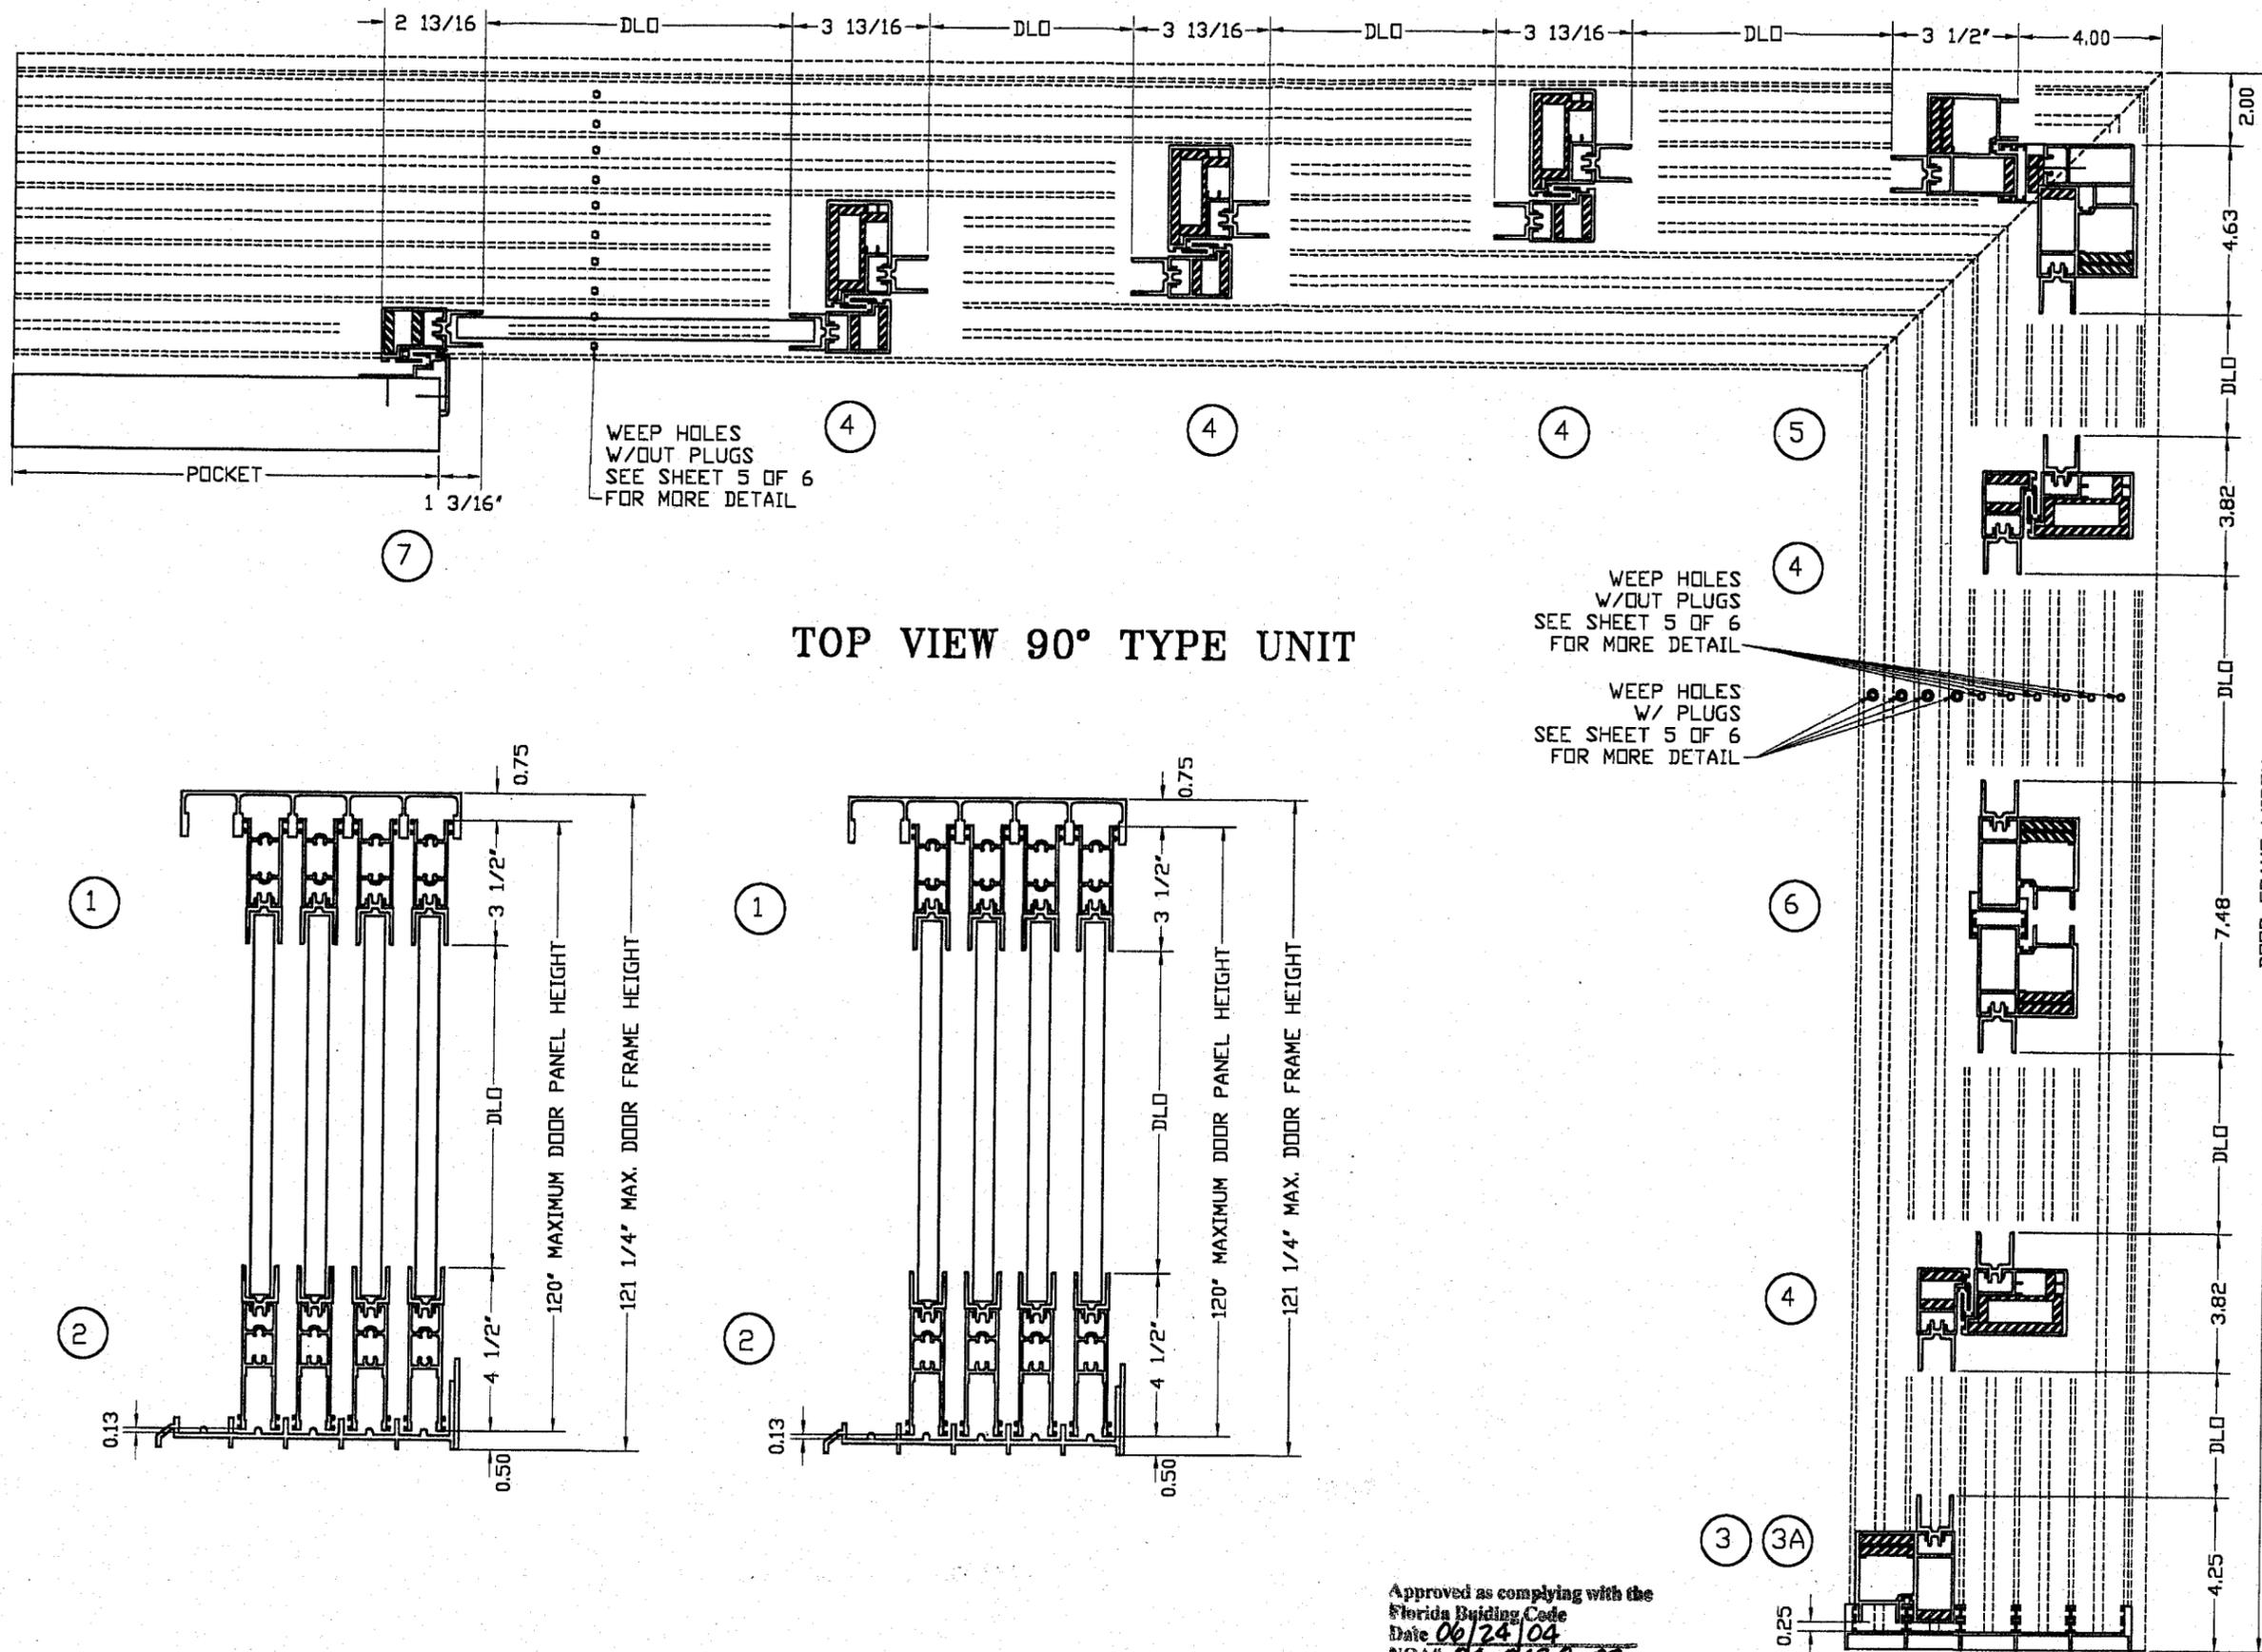

Approved as complying with the
 Florida Building Code
 Date 06/24/04
 NOAM 04-0478-02
 Miami Dade Product Control
 Division
 By: *[Signature]*

MANUFACTURER:
**PLAZA DOOR
 CO., INC**
 5900 AUSTRALIAN AVE.
 SUITE #3
 WEST PALM BEACH
 FLORIDA, 33402
 PHONE: (561) 842-6551
 FAX: (561) 842-6541

PRODUCT:
Titan Series
 VII - NON IMPACT
 ALUMINUM SLIDING GLASS
 DOOR

Engineering:
EngCo Inc.
 CA 8116
 6971 W. SUNRISE BLVD. 104
 PLANTATION, FL. 33313
 TEL: (954) 585-0304
 FAX: (954) 585-0305

DEC 15 2003

Engineer Seal
 Pedro De Figueiredo
 PE 52609


Date: 12/10/03
 Scale: NA
 Design by: PPMF

Revision:


Drawing Number
 03-043

Sheet
 4 of 6

6- MID LOCK DETAIL

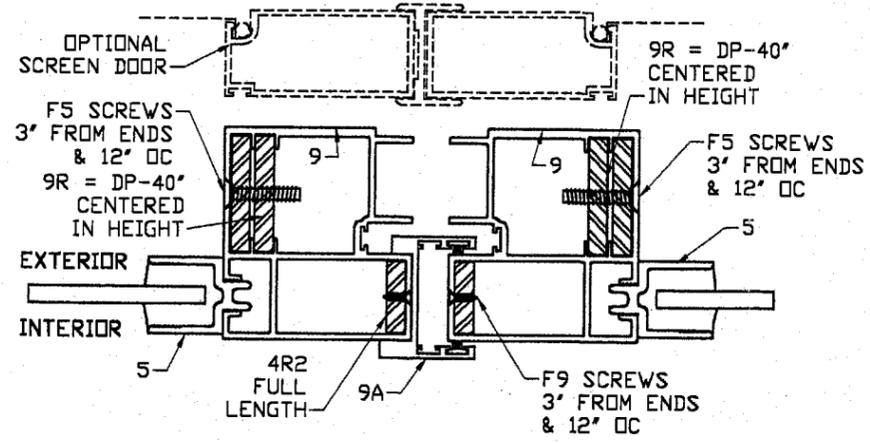


3- JAMB DETAIL
 OPERABLE PANEL W/ LOCK
 3A- JAMB DETAIL
 FIXED W/OUT LOCK

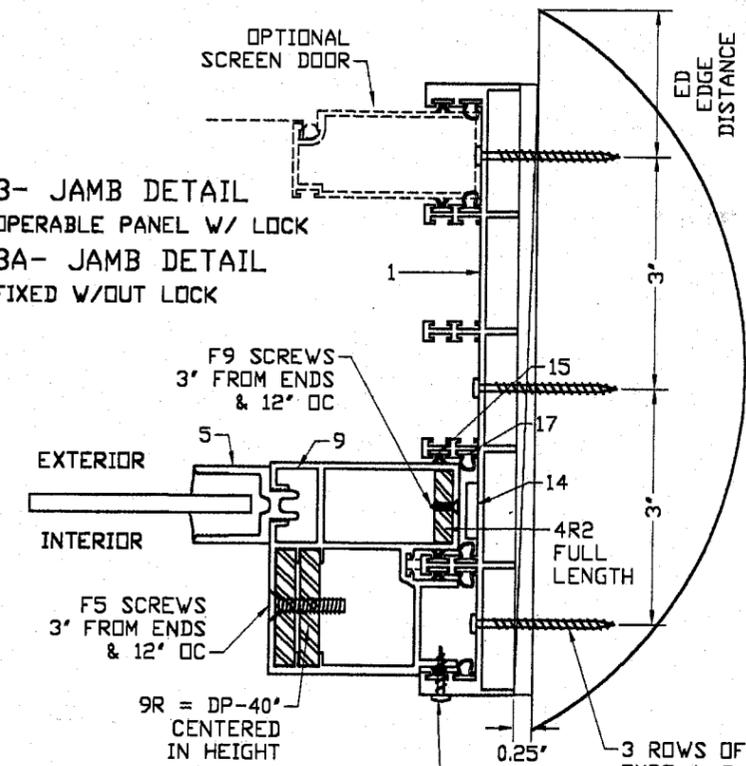

APPLICABLE ONLY FOR FIXED
 DOOR PANEL - DETAIL 3A
 #10-16x 1 1/4" SMS 6" FROM
 ENDS AND SPACED AT 20" OC


FASTENERS	
F1- 2-015-0	- #10X2 1/2" FH SS SMS
F2- 2-022-0	- #10X1 1/4" FH SS SMS
F3- 2-003-0	- #14X1" PH SS SMS
F4- 2-010-0	- #12X1 1/4" PH SS SMS
F5- 2-050-0	- #10-32X1" FH SS MS
F6- 2-064-0	- 1/8"X1/2" POP RIVETS SS
F7- 2-070-0	- #8X1 1/4" PH SS SMS
F8- 2-090-0	- #10-24X1/4" FH SS MS
F9- 2-024-0	- #10X3/4" FH SS SMS

7- POCKET END RAIL

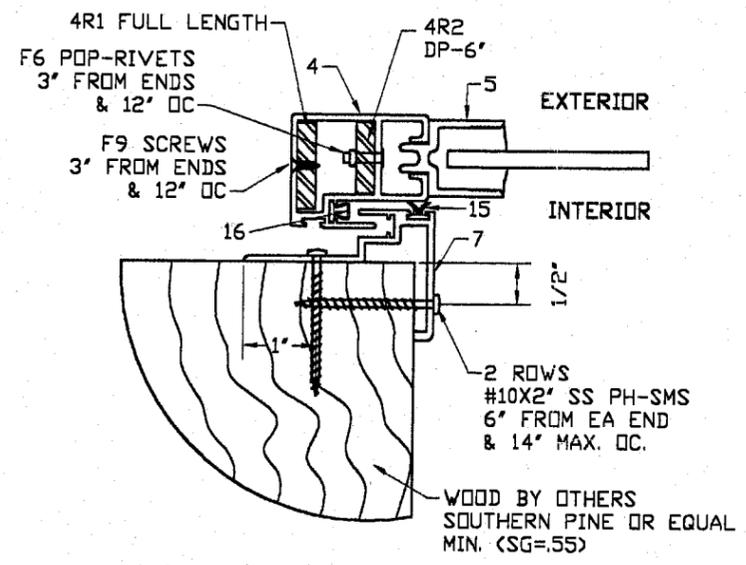

WOOD BY OTHERS
 SOUTHERN PINE OR EQUAL
 MIN. (SG=55)

2- SILL DETAIL

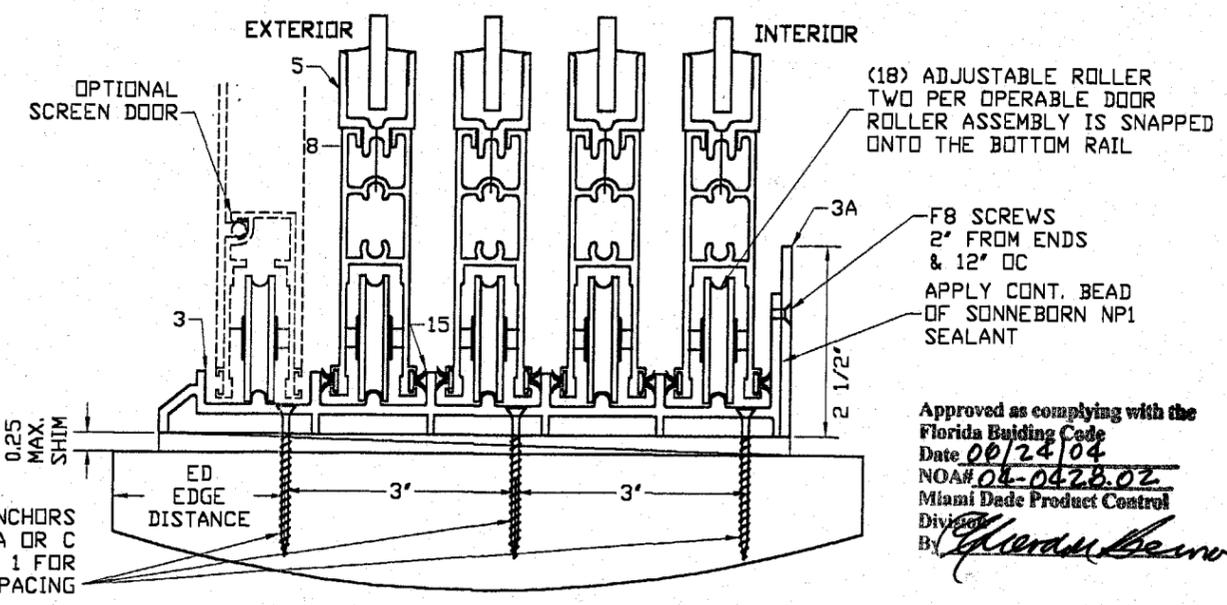


(18) ADJUSTABLE ROLLER
 TWO PER OPERABLE DOOR
 ROLLER ASSEMBLY IS SNAPPED
 ONTO THE BOTTOM RAIL


F8 SCREWS
 2" FROM ENDS
 & 12" OC
 APPLY CONT. BEAD
 OF SONNEBORN NP1
 SEALANT

Approved as complying with the
 Florida Building Code
 Date 06/24/04
 NOAH 04-0428.02
 Miami Dade Product Control
 Division
 By *Cherida Beano*


4- INTERLOCK DETAIL

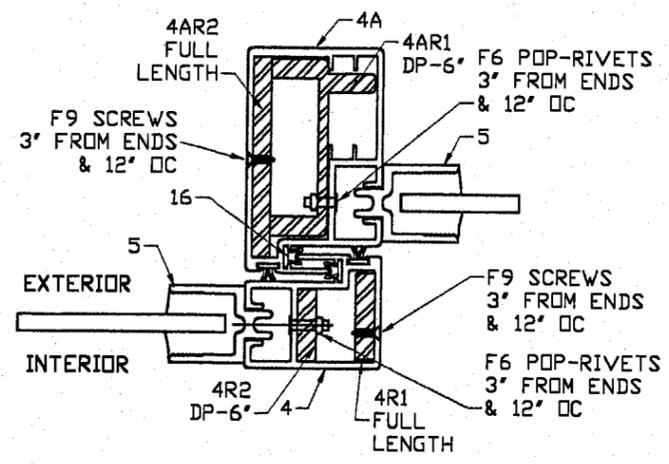

5- 90° CORNER DETAIL

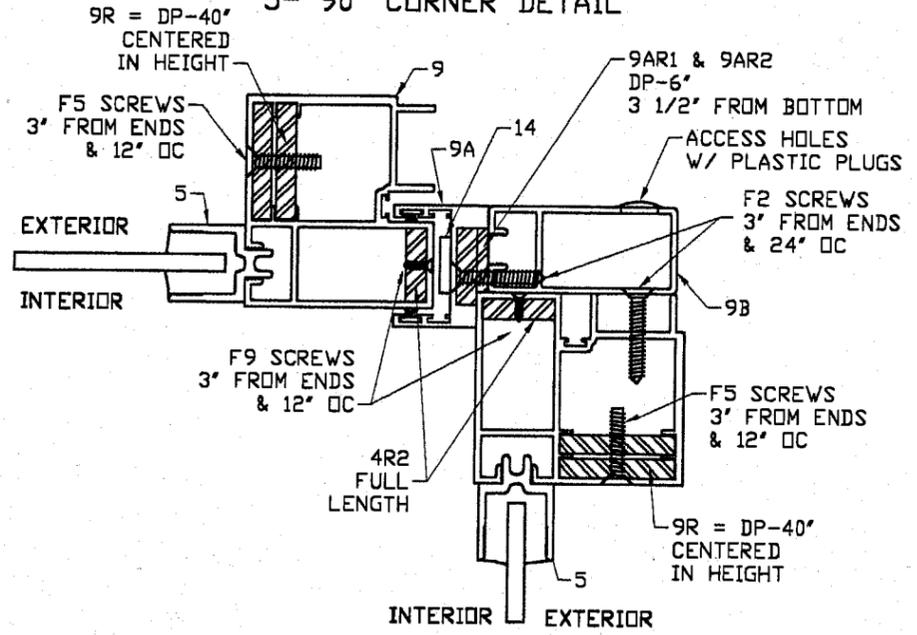


1- HEADER DETAIL

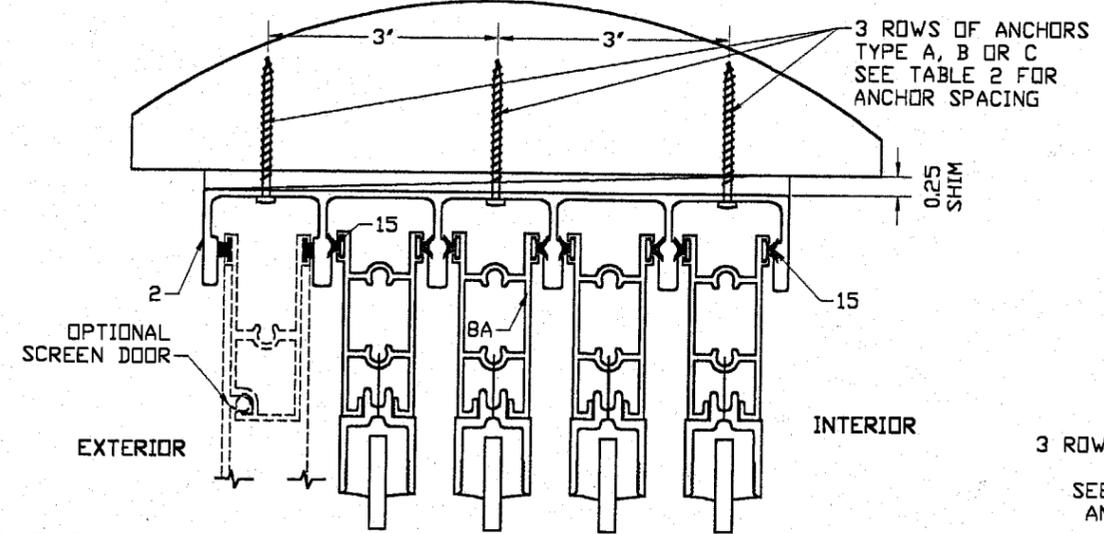

INTERIOR


GLAZING DETAIL

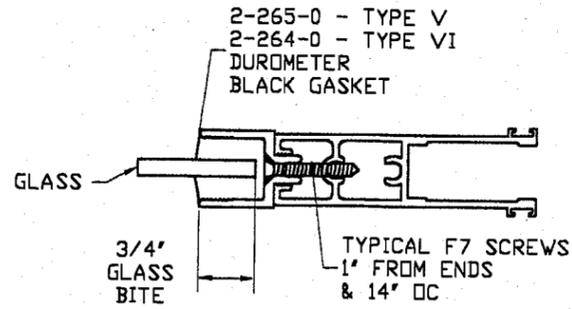

PLUGS IF REQUIRED TO BE USED ONLY ON THE INTERIOR SIDE OF DOOR


SILL DRAINAGE

CLUSTER OF TEN 3/8" DIAM WEEP HOLES AT EA DRAIN PAN LOCATED 17" FROM EA. END AND 20" OC.

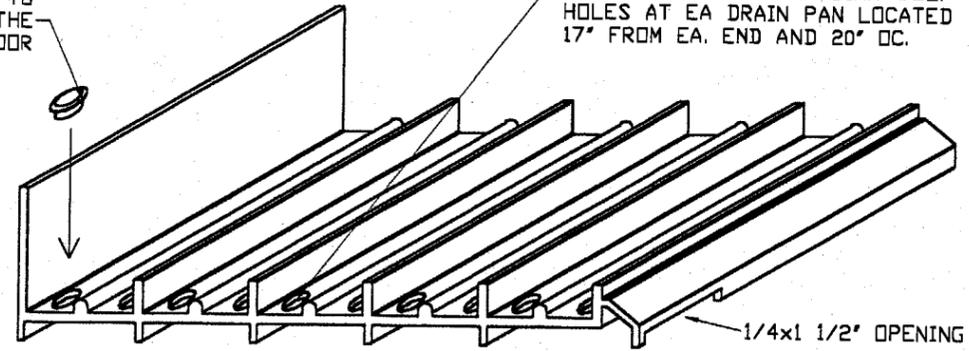

1 1/2" X 1/4" FACTORY APPLIED DRAIN PAN LOCATED 17" FROM ENDS AND MAX. 20" OC

FRAMING CORNER ASSEMBLY

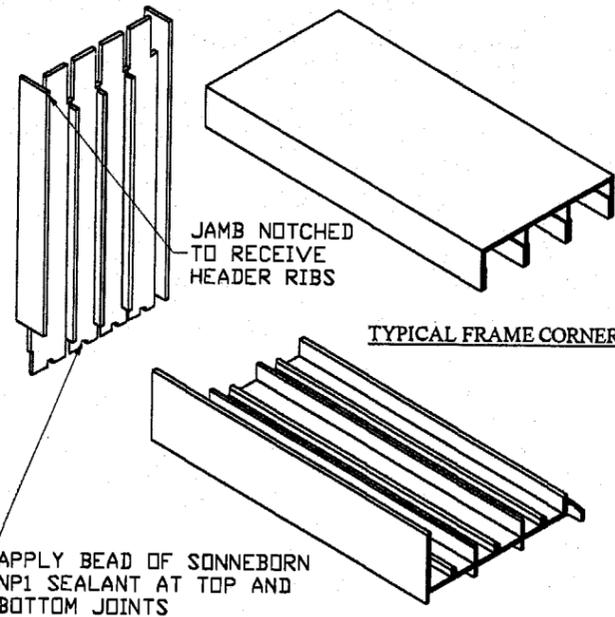


JAMB NOTCHED TO RECEIVE HEADER RIBS

TYPICAL FRAME CORNER

APPLY BEAD OF SONNEBORN NP1 SEALANT AT TOP AND BOTTOM JOINTS

DOOR CORNER ASSEMBLY

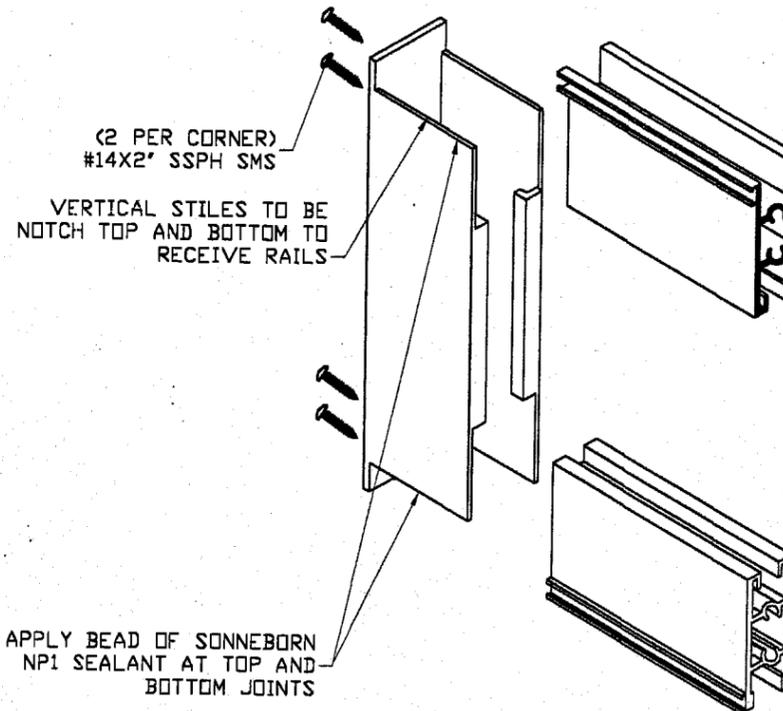

(2 PER CORNER) #14X2" SSPH SMS

VERTICAL STILES TO BE NOTCH TOP AND BOTTOM TO RECEIVE RAILS

APPLY BEAD OF SONNEBORN NP1 SEALANT AT TOP AND BOTTOM JOINTS

NON IMPACT GLASS TYPES
V - 1/4" TEMPERED GLASS
VI - 3/8" TEMPERED GLASS

70 DUROMETER BLACK GASKETS	
 2-264-0	 2-265-0

HARDWARE NOTES:

1- ROLLER ASSEMBLY: EACH OPERABLE PANEL IS DESIGNED WITH TWO ROLLERS (PART# 2-300-0) AT EACH CORNER BOTTOM RAIL OF DOOR PANEL. ROLLER ASSEMBLY IS SNAPPED ONTO THE BOTTOM RAIL OF THE DOOR.
 2- DEAD LOCK (PART# 2-350-0) ONE PER EACH END RAIL, MEETING RAILS OR 90° CORNER RAILS OF OPERABLE PANELS. LOCATED 40" FROM CENTERLINE OF LOCK TO SILL. LOCK ASSEMBLY IS ATTACHED TO RAIL BY USING TWO #6-32X1/4 SSFH SCREWS.

SEALANT'S NOTES:

- PERIMETER SEALANT: SONNEBORN NP1 URETHANE SEALANT
- FRAME JOINT SEALANT: SONNEBORN NP1 URETHANE SEALANT
- GLAZING GASKET JOINT SEALANT: SONNEBORN NP1 URETHANE SEALANT

WEATHER STRIPPING:

 2-402-0 FINSEAL 7525	 2-400-0 FINSEAL 7518	 2-249-0 PVC BULB
 2-403-0 FINSEAL 8416	 2-401-0 FINSEAL 7520	 2-250-0 PVC BULB

MANUFACTURER:
PLAZA DOOR CO., INC

5900 AUSTRALIAN AVE.
SUITE #3
WEST PALM BEACH
FLORIDA, 33402
PHONE: (561) 842-6551
FAX: (561) 842-6541

PRODUCT:
Titan Series
VII - NON IMPACT
ALUMINUM SLIDING GLASS
DOOR

Engineering:
EngCo Inc.

CA 8116
6971 W. SUNRISE BLVD. 104
PLANTATION, FL. 33313
TEL: (954) 585-0304
FAX: (954) 585-0305

DEC 15 2003

Engineer Seal
Pedro De Figueiredo
PE 52609

Date: 12/10/03
Scale: NA
Design by: PPMF

Revision:

Drawing Number
03-043

Sheet
5 of 6

Approved as complying with the
Florida Building Code
Date 06/24/04
NOA# 04-0428-02
Miami Dade Product Control
Division
By: *Cherita Bonu*

FRAMING ANCHOR SPACING SELECTION TABLES

**TABLE 2
MAXIMUM INCHES OC HEADER ANCHORS SPACING**

DLO HEIGHT	DESIGNED PRESSURE (psf)				
	50	54	59	66	76
88	18-17-20	17-15-20	15-14-20	14-12-20	12-11-20
100	16-15-20	15-14-20	14-12-20	12-11-20	11-10-20
112	15-13-20	13-12-20	12-11-20	11-10-20	9-9-20

**TABLE 3
MAXIMUM INCHES OC SILL ANCHORS SPACING**

DLO HEIGHT	DESIGNED PRESSURE (psf)				
	50	54	59	66	76
88	11-na-20	10-na-20	9-na-20	8-na-18	7-na-16
100	10-na-20	9-na-20	8-na-18	7-na-16	6-na-14
112	9-na-19	8-na-18	7-na-16	7-na-15	6-na-13

ANCHOR NOTES:

1- (A-B-C): THE ABOVE TABLE VALUES A ARE FOR ANCHOR SPACING WHEN USING TYPE A ANCHORS, B ARE FOR ANCHOR SPACING WHEN USING TYPE B ANCHORS, C ARE FOR ANCHOR SPACING WHEN USING TYPE C ANCHORS

2- MINIMUM EMBEDMENT ARE BEYOND WALL DRESSING.

3- na: NOT AVAILABLE

ANCHOR TYPES:

A- 3/16" TAPCON BY ELCO WITH 1 3/4" MIN. EMBEDMENT INTO 3320 psi CONCRETE - MIN. EDGE DISTANCE: 1 7/8".

B- #10 ss WOOD SCREWS BY ELCO WITH 1 1/2" MIN. EMBEDMENT INTO PT WOOD (SG>=.55) - MIN. E. D. >= 3/4".

C- 1/4" TAPCON BY ELCO WITH 1 3/4" MIN. EMBEDMENT INTO 3320 psi CONCRETE - MIN. EDGE DISTANCE: 2 1/2".

BILL OF MATERIALS:

LOG	DESCRIPTION	PART#	MATERIAL	SUPPLIER
1	FIVE TRACK JAMB	PDC-10(X2)	ALUM. 6063-T6	PLAZA DOOR
2	FIVE TRACK HEADER	PDC-33	ALUM. 6063-T6	PLAZA DOOR
3	FIVE TRACK SILL	PDC-38	ALUM. 6063-T6	PLAZA DOOR
3A	SILL ADAPTOR		ALUM. 6063-T5	PLAZA DOOR
4	DOOR INTERLOCK	PDC-14	ALUM. 6063-T6	PLAZA DOOR
4R1	1/4X1 1/8" PLATE REINF.		ALUM. 6061-T6	PLAZA DOOR
4R2	1/4X 7/8" PLATE REINF.		ALUM. 6061-T6	PLAZA DOOR
4A	DOOR HD INTERLOCK	PDC-72	ALUM. 6063-T6	PLAZA DOOR
4AR1	REINFORCEMENT	PDC-73	ALUM. 6061-T6	PLAZA DOOR
4AR2	1/4X2 5/8" PLATE REINF.		ALUM. 6061-T6	PLAZA DOOR
5	GLASS ADAPTOR	PDC-91	ALUM. 6063-T6	PLAZA DOOR
7	POCKET INTERLOCK	PDC-20	ALUM. 6063-T6	PLAZA DOOR
8	DOOR BOTTOM RAIL	PDC-82	ALUM. 6063-T6	PLAZA DOOR
8A	DOOR TOP RAIL	PDC-16	ALUM. 6063-T6	PLAZA DOOR
9	DOOR END RAIL	PDC-66	ALUM. 6063-T6	PLAZA DOOR
9R	1/4X1 1/2 REINF.		STEEL ASTM A36	PLAZA DOOR
9A	CORNER ADAPTOR	PDC-002	ALUM. 6063-T6	PLAZA DOOR
9AR1	1/4X1 REINFORCEMENT		ALUM. 6061-T6	PLAZA DOOR
9AR2	1/8X7/8 REINFORCEMENT		ALUM. 6061-T6	PLAZA DOOR
9B	CORNER ADAPTOR	PDC-15	ALUM. 6063-T6	PLAZA DOOR
10D	3/8" GLAZING GASKET	2-265-0	PVC	TEAM PLASTICS
10E	1/4" GLAZING GASKET	2-200-0	PVC	TEAM PLASTICS
11	HP WEATHER TAB	3-009-0		PLAZA DOOR
12	TRACK RAIN PAN	3-008-0	ALUMINUM	PLAZA DOOR
13	LOCK ESCUTCHEON	2-351-0		ADAMS RITE 4430
14	LOCK KEEPER	3-001-0	STAINLESS STEEL	PLAZA DOOR
15	FINSEAL	2-407-0		SCHLEGAL
16	VINYL BULB	2-249-0		TEAM PLASTICS
17	VINYL BULB	2-250-0		TEAM PLASTICS
18	ADJUSTABLE ROLLER	2-300-0		SAUNDERS ENG. #P-13
19	DEADLOCK	2-350-0		ADAMS R. 1B47-02SS
20	3/8" WEEP DRAIN PAN PLUG	3-010	NYLON	PLAZA DOOR

**MANUFACTURER:
PLAZA DOOR
CO., INC**

5900 AUSTRALIAN AVE.
SUITE #3
WEST PALM BEACH
FLORIDA, 33402
PHONE: (561) 842-6551
FAX: (561) 842-6541

**PRODUCT:
Titan Series
VII - NON IMPACT
ALUMINUM SLIDING GLASS
DOOR**

**Engineering:
EngCo Inc.**
CA 8116
6971 W. SUNRISE BLVD. 104
PLANTATION, FL. 33313
TEL: (954) 585-0304
FAX: (954) 585-0305



DEC 15 2003

Engineer Seal
Pedro De Figueredo
PE 52609

Date: 12/10/03
Scale: NA
Design by: PPMF

Revision:

Drawing Number
03-043

Sheet
6 of 6

Approved as complying with the
Florida Building Code
Date 06/24/04
NOA# 04-0328.02
Miami Dade Product Control
Division
By: *[Signature]*