



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Jeld-Wen, Inc.
31725 Highway 97 North
Chiloquin, OR 97624**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Jeld-Wen Premium Inswing Single Opaque Wood Door w/wo Sidelites and Bolts

APPROVAL DOCUMENT: Drawing No S-2037, titled "Wood Stile & Rail Door Opaque 6-8/8-0 Inswing Single W/ & W/o Sidelites" Sheets 1 through 9 of 9, prepared by manufacture dated 07/21/00 with revision "4" on 07/15/02 by signed and sealed by, James J. Dobrowski, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews and revises NOA # 02-0722.10** consists of this page 1 and evidence pages E-1, E-2, and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Herminio F. Gonzalez, P.E., Director, BCCO**

NOA No 04-0714.05

Expiration Date: August 23, 2009

Approval Date: September 09, 2004

Page 1

Jcy
8/19/04



NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **S-2037**, titled "Wood Stile & Rail Door Opaque 6-8/8-0 Inswing Single W/ & W/o Sidelites" Sheets 1 through 9 of 9, prepared by manufacture, dated 07/21/00 with revision "4" on 07/15/02, signed and sealed by James J. Dobrowski, P.E.

B. TESTS

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411 3.2.1 (b) and TAS 202-94
along with marked-up drawings and installation diagram of single outswing/inswing opaque wood doors with sidelites, prepared by Certified Testing Laboratories, Test Report No. **CTLA570W**, and **570WC** dated July 22,2000 and July 15, 2000 and **revised** on May1st, 2001 and May 3rd, 2001 respectively, signed and sealed by Ramesh Patel, P.E.
"Submitted under NOA # 02-0722.10"

C. CALCULATIONS

1. Wood strength referenced properties data from, "Wood Handbook" and table prepared by manufacturer
"Submitted under NOA # 02-0722.10"
2. Anchor verification calculations, dated 8-24-00 prepared, signed and sealed by Mark Fetherman, P.E. (transferred from file # **01-0206.27**)
"Submitted under NOA # 02-0722.10"

D. QUALITY ASSURANCE


1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. None

F. STATEMENTS

1. Statement letter of conformance and "No financial interest" dated July 24, 2000, signed and sealed by Mark C. Fetherman, P.E.
"Submitted under NOA # 02-0722.10"
2. Statement letter of no financial interest, dated January 11, 2001, signed by Steve Frey, Products Testing Manager, Jeld-Wen, Inc.
"Submitted under NOA # 02-0722.10"

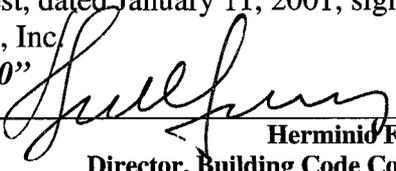


Herminio F. Gonzalez, P.E.
Director, Building Code Compliance Office
NOA No 04-0714.05

Expiration Date: August 23, 2009
Approval Date: September 09, 2004

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. Statement letter of compliance, as part of test reports No. **CTLA570W**, and **572WC**, issued by Certified Testing Laboratories, signed and sealed by Ramesh Patel, P.E.
“Submitted under NOA # 02-0722.10”
4. Statement letter issued by Jeld-wen, dated January 11, 2001, designating Rick Wright of R W Building Consultant, as representative and contact person, signed by Steve Frey.
“Submitted under NOA # 02-0722.10”
5. Letter of explanation dated May 22, 2001, issued by Certified Testing Laboratories for test reports CTLA-570 W, CTLA-570 WB, CTLA-570 WC and CTLA-572 WA, signed by Jim Blakely.
“Submitted under NOA # 02-0722.10”
6. Letter of explanation dated May 23, 2001, issued by Ramesh Patel, P. E., witnessing engineer Certified Testing Laboratories for test reports CTLA-570 W, CTLA-570 WB, CTLA-570 WC and CTLA-572 WA, signed and sealed by Ramesh Patel, P. E.
“Submitted under NOA # 02-0722.10”
7. Letter of clarification for laboratory data, issued by Certified Testing Laboratories, signed by Christopher Benett (Lab Manager) for test reports CTLA-570 W, CTLA-570 WB, CTLA-570 WC and CTLA-572 WA, signed and sealed by Ramesh Patel, P. E. (witnessing engineer).
“Submitted under NOA # 02-0722.10”
8. Letter dated July 19, 2001, issued by Ramesh Patel, P.E. Consulting Engineer outlining corrective action for future test report submittal, signed and sealed by Ramesh Patel, P. E.
“Submitted under NOA # 02-0722.10”
9. Addendum letter dated July 16, 2001, issued by Certified Testing Laboratories for clarification of issues related to test reports CTLA-570W & CTLA-570WC, signed by Christopher Bennett (Lab Manager) and signed and sealed by Ramesh Patel, P. E.
“Submitted under NOA # 02-0722.10”
10. Statement letter dated July 15, 2002, issued by Jeld-Wen for the extend of revision to the approved NOA# **01-0206.27**, signed by Steve Frey.
“Submitted under NOA # 02-0722.10”
11. Jeld-Wen proposal letter dated May 09, 2002 and BCCO response dated 05-18-02
“Submitted under NOA # 02-0722.10”
12. Revised test reports CTLA-570 W, CTLA-570 WB, CTLA-570 WC and CTLA-572 WA, issued by Certified Testing Laboratories, signed and sealed by Ramesh Patel.P. E.
“Submitted under NOA # 02-0722.10”

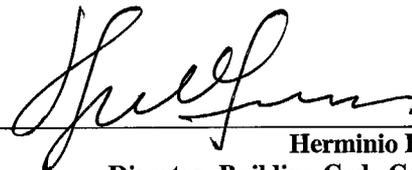

Herminio F. Gonzalez, P.E.
Director, Building Code Compliance Office
NOA No 04-0714.05

Expiration Date: August 23, 2009
Approval Date: September 09, 2004

Jeld-Wen, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

13. Revised test reports CTLA-570 W, CTLA-570 WB, CTLA-570 WC and CTLA-572 WA, issued by Certified Testing Laboratories, signed and sealed by Ramesh Patel, P. E.
“Submitted under NOA # 02-0722.10”
14. Faxed Laboratory Worksheet data dated July 05, 2001 supplied by Certified Testing Laboratories for test reports CTLA-570 W, CTLA-570 WB, CTLA-570 WC and CTLA-572 WA.
“Submitted under NOA # 02-0722.10”
15. Various letter of explanation and addendum letter referenced above.
“Submitted under NOA # 02-0722.10”
16. Manufacturing plant address of Jeld-Wen series “Nord / Morgan”.
“Submitted under NOA # 02-0722.10”
17. Glazing complies w/ASTME-1300-98.
“Submitted under NOA # 02-0722.10”

G. OTHER

1. Notice of Acceptance No. **02-0722.10**, issued to Jeld Wen, Inc, Nord/Morgan Inswing Single Opaque Door w/wo Sidelites & Bolts, approved on September 19, 2002 and expiring on August 23, 2004.
2. Letter from the consultant stating that the product is in compliance with the Florida Building Code (FBC).



Herminio F. Gonzalez, P.E.
Director, Building Code Compliance Office
NOA No 04-0714.05

Expiration Date: August 23, 2009
Approval Date: September 09, 2004

JELD-WEN®

PREMIUM WOOD DOOR
6-8 AND 8-0 OPAQUE INSWING
SINGLE DOOR W/ AND W/O SIDELITES

GENERAL NOTES

1. THIS PRODUCT HAS BEEN DESIGNED TO COMPLY WITH HIGH VELOCITY HURRICANE ZONE OF THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. IMPACT RESISTANT SHUTTERS ARE REQUIRED.
5. DESIGNED PRESSURE RATING SEE TABLE PAGE.
6. SIDELITES ARE AN OPTION AND CAN BE IN A SINGLE OR DOUBLE CONFIGURATION.

RESIDENTIAL STILE & RAIL WOOD DOOR (Common to all frame conditions)

Frame Construction: The head and side jambs are finger jointed ponderosa pine measuring 4.5625" X 1.25". The head and side jambs are mortised, butted and joined using (3) 16GA. 2" X 1/2" crown staples at the top corners. The inswing threshold is attached to the floor.


Door Panel Construction: The panel is a stile and rail construction. The stiles and rails are constructed from solid wood of either Douglas Fir or Western Hemlock. They are laminated with a .0625" thk. wood veneer of the following species: Douglas Fir, Western Hemlock, Ponderosa Pine, Northern Red Oak, Red Maple, Black Cherry, Yellow Poplar, True Hickory, True Mahogany, Black Walnut, & Red Alder. The veneer face sheet is glued to the stiles and rails. The top and intermediary rails are connected to the perimeter stiles w/(2) 1/2" min. dia. x 4" L. wooden dowels and the bottom rail is connected to the perimeter stile w/(3) 1/2" min. dia. x 4" L. wooden dowels. The inset panels are of Ponderosa Pine or Douglas Fir and are glued into the stiles and rails.

Sidelite Construction: Panel is a stile and rail construction same as the door panel. The glazing is captured between the wood cap on the exterior and the wood glass stop on the interior. The panels are wet glazed using PRC 365 silicone.

TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	COMMON (GENERAL NOTES, TYPICAL ELEVATION)
2	VERTICAL CROSS SECTIONS & B.O.M.
3	HOIZONTAL CROSS SECTIONS 1/3, 2/3, 3/3 & 4/3
4	HOIZONTAL CROSS SECTIONS 1/4, 2/4 & 3/4
5	ANCHORING LOCATIONS, SINGLE W/(2) SL & DETAILS
6	ANCHORING LOCATIONS SINGLE & SINGLE W/(1) SL
7	GLAZING DETAILS & RAIL DETAILS
8	FRAME COMPONENTS
9	DOOR MODELS

DESIGN PRESSURE RATING		
	WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED	
6-8 MODELS	+65.0psf	-70.0psf
8-0 MODELS W/OUT BOLT	+55.0psf	-55.0psf
8-0 MODELS W/BOLTS	+65.0psf	-70.0psf

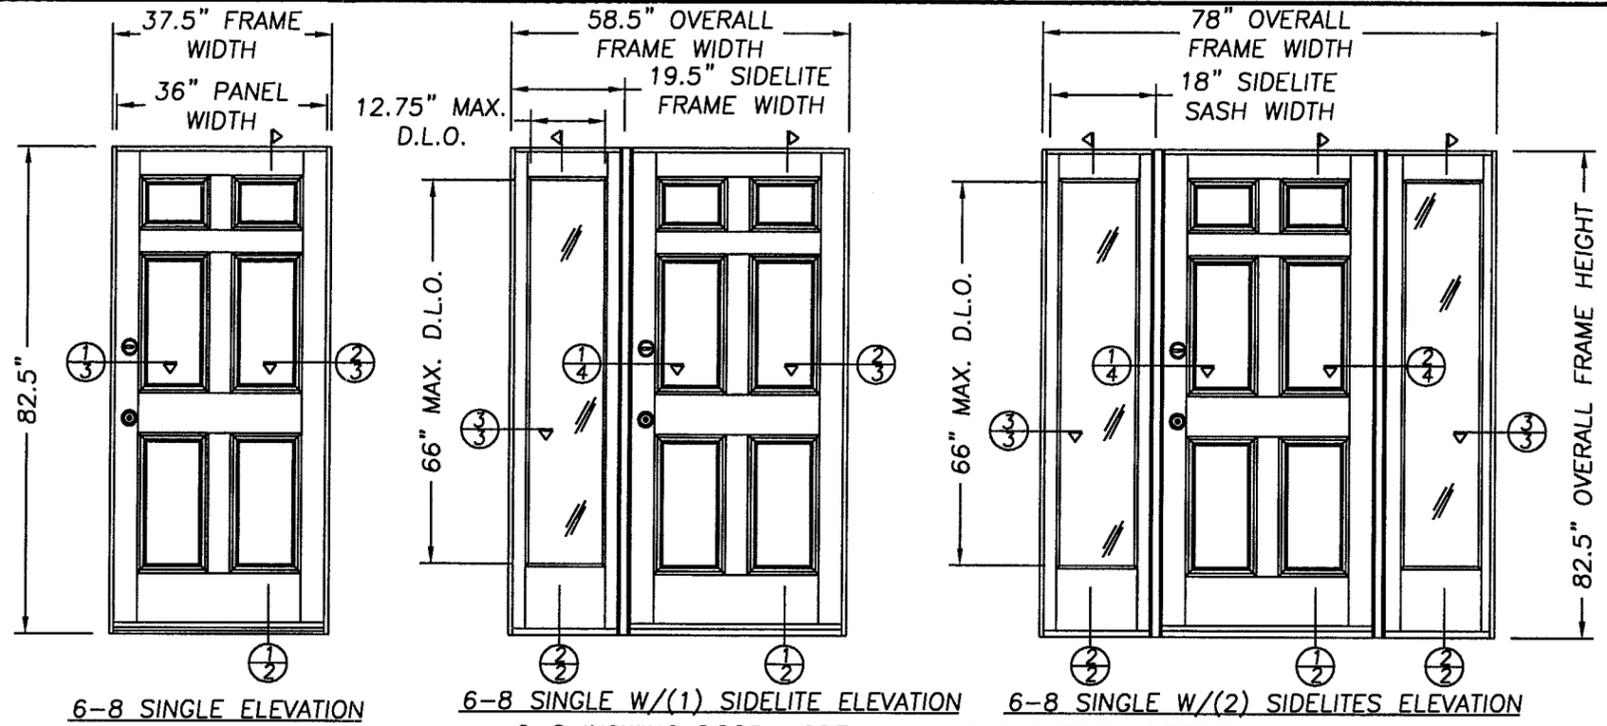


6-8 SINGLE ELEVATION

6-8 SINGLE W/(1) SIDELITE ELEVATION

6-8 SINGLE W/(2) SIDELITES ELEVATION

6-8 INSWING DOOR MODELS ARE VIEWED FROM INTERIOR

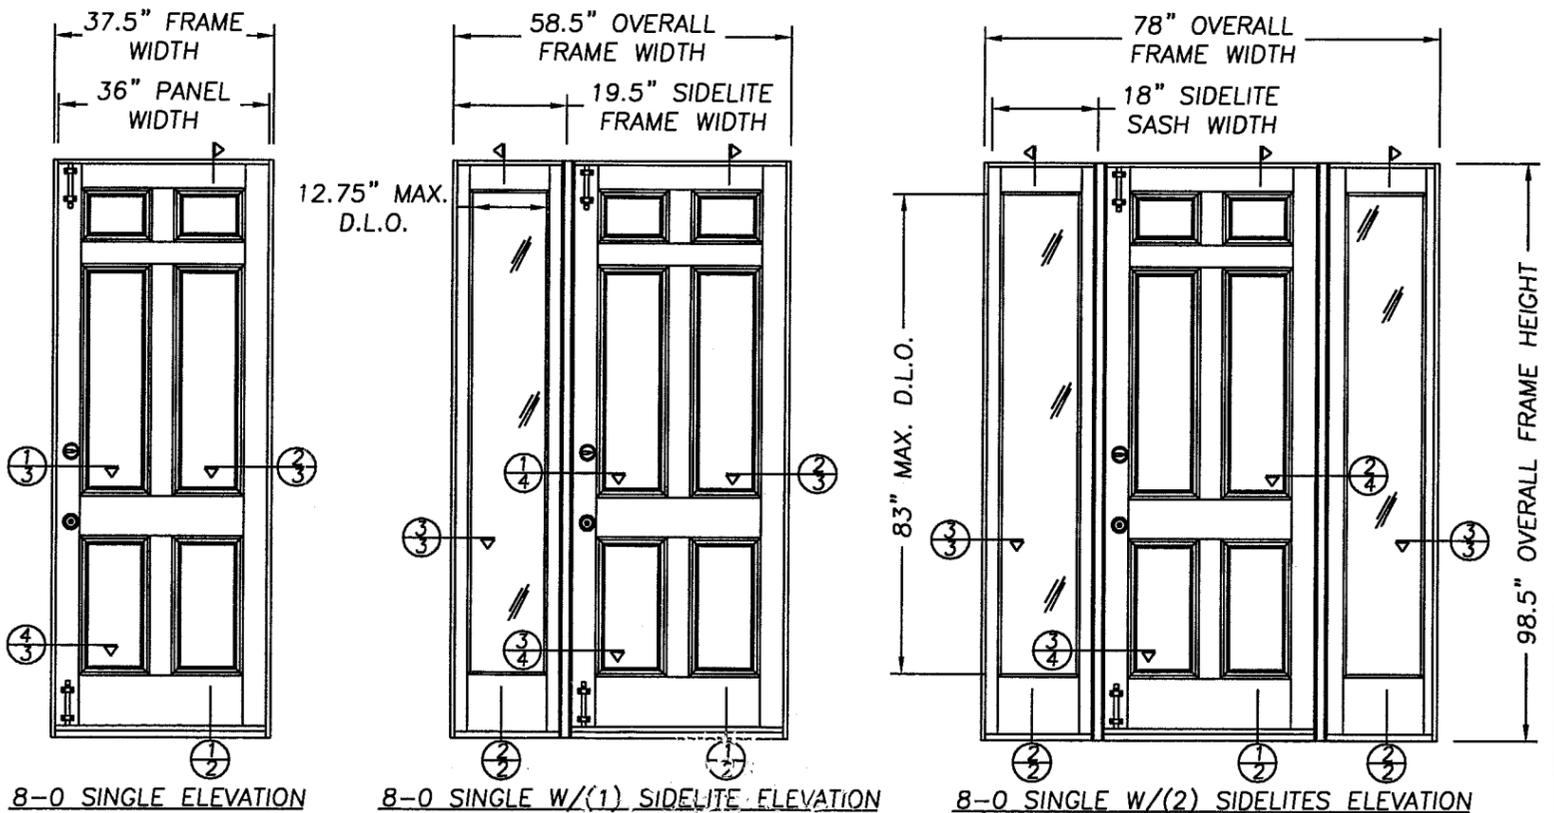

8-0 SINGLE ELEVATION

8-0 SINGLE W/(1) SIDELITE ELEVATION

8-0 SINGLE W/(2) SIDELITES ELEVATION

8-0 INSWING DOOR MODELS ARE VIEWED FROM INTERIOR
THE SURFACE BOLTS ARE AN OPTION
USED TO ACHIEVE A HIGHER PRESSURE
SEE SHEET 3 SECTION 4/3 AND SHEET 4
SECTION 3/4 FOR SURFACE BOLT OPTIONS

James Dolan
8-10-04


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 04-0714.05
Expiration Date 08/26/09
By *[Signature]*
Micalada Product Control
Division

JELD-WEN, INC.
401 Harbor Isles Blvd
Klamath Falls, OR 97601
PH. 1.800.JELD.WEN

PRODUCT: WOOD STILE & RAIL DOOR
OPAQUE 6-8/8-0 INSWING
SINGLE W/ & W/O SIDELITES
PART OR ASSEMBLY:
ELEVATIONS &
GENERAL NOTES

NO.	DATE	BY	REVISIONS
4	07/15/02	KMN	GENERAL REVISION
3	07/13/01	TJH	GENERAL REVISION
2	05/03/01	TJH	GENERAL REVISION
1	04/19/01	TJH	GENERAL REVISION

DATE: 7/21/00
SCALE: NTS
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2037
SHEET 1 of 9

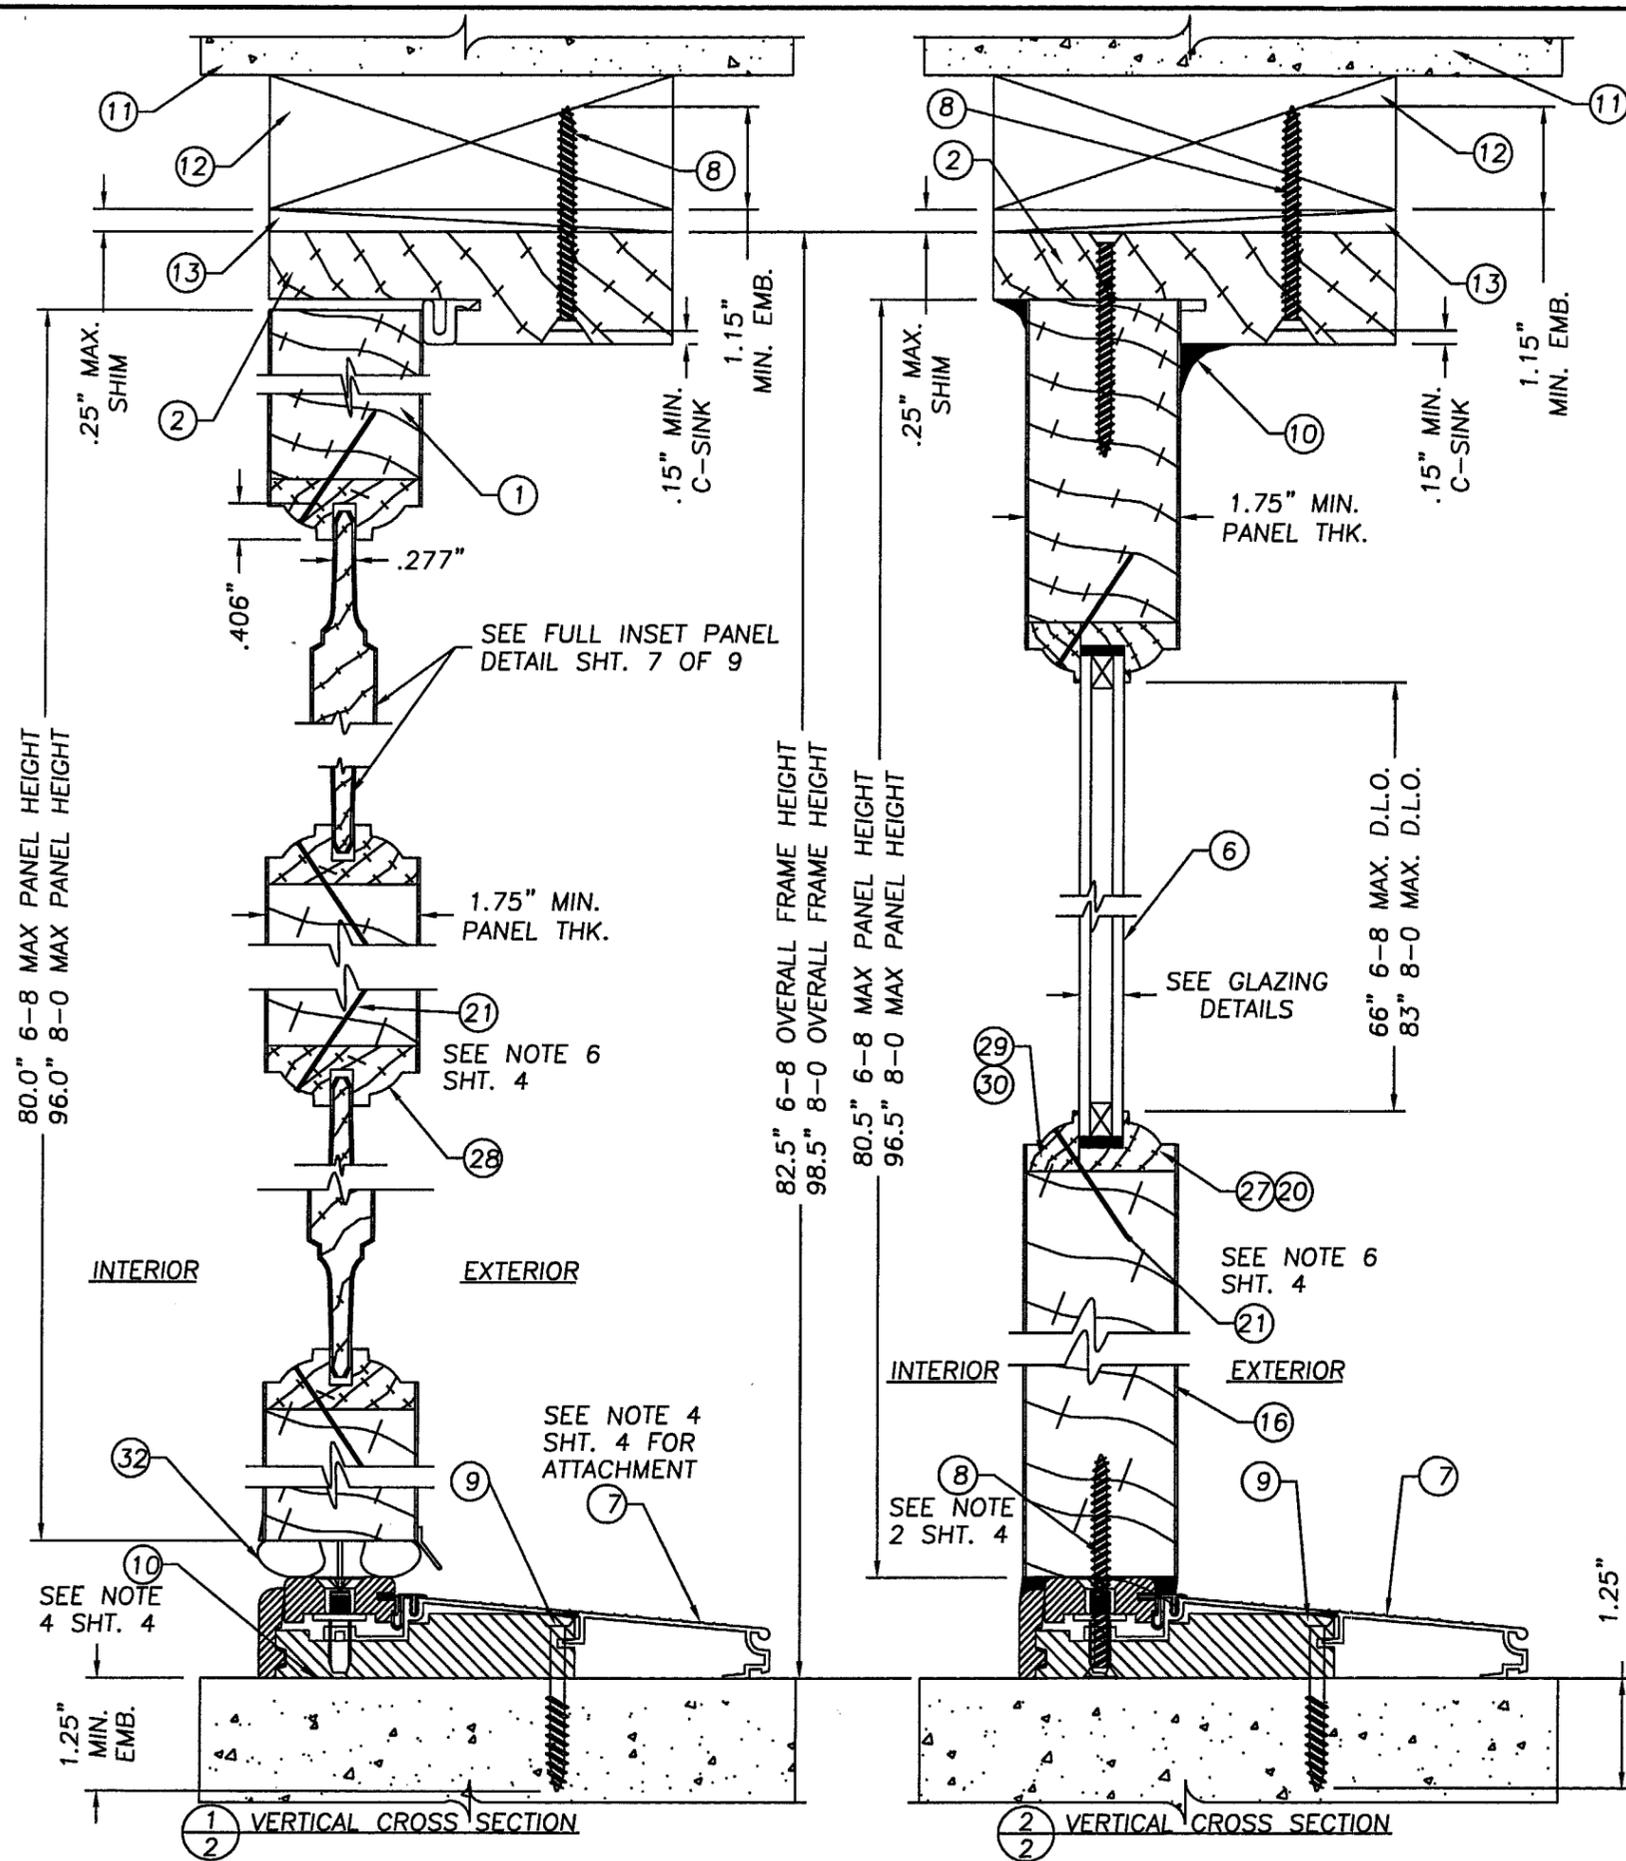

Item	DESCRIPTION	Material
1	NORD/MORGAN/NICOLAI STYLE & RAIL 6-8/8-0 WOOD DOOR (DOUGLAS FIR, WESTERN HEMLOCK, PONDEROSA PINE, NORTHERN RED OAK, RED MAPLE, BLACK CHERRY, YELLOW POPLAR, TRUE HICKORY, TRUE MAHOGANY, BLACK WALNUT, & RED ALDER)	
2	HEAD JAMB (1 1/4" x 4 5/8" PONDEROSA PINE)	PINE
3	LATCH JAMB (1 1/4" x 4 5/8" PONDEROSA PINE)	PINE
4	HINGE JAMB (1 1/4" x 4 5/8" PONDEROSA PINE)	PINE
5	BLANK JAMB (1 1/4" x 4 5/8" PONDEROSA PINE)	WOOD
6	1/2" INSULATED TEMPERED GLASS (BY PPG)	GLASS
7	1/8" TEMPERED GLASS (BY PPG)	GLASS
8	#8 x 2 1/2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
9	1/4" x 2 1/2" LG. TAPCON OR ITW BUILDDEX TAPCON OR ELCO TAPCON	STEEL
10	SILICONE CAULK (CR LAWRENCE 33S)	SILICONE
11	MASONRY WALL	CONC.
12	2x WOOD BUCK	WOOD
13	1/4" MAX. SHIMS	WOOD
14	COMPRESSION WEATHERSTRIP (Q-LON QDS-650)	FOAM
15	#10 x 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
16	NORD/MORGAN/NICOLAI STYLE & RAIL 6-8/8-0 WOOD SIDELITE (DOUGLAS FIR, WESTERN HEMLOCK, PONDEROSA PINE & NORTHERN RED OAK)	PINE
17	KWIKSET TITAN 400 SERIES LOCK	
18	1/4" x 1 3/8" WOOD MULLION CAP	PINE
19	LVL MULLION SPACER 5/8" x 4 9/16"	LVL
20	WOOD CAP FOR .50" THK. GLASS	PINE
21	BRAD TRIM NAIL 1 1/2" L.	STEEL
22	GLAZING COMPOUND (PRC 365 BY DE-SOTO INTER.)	SILICONE
23	4" x 4" BUTT HINGE 12GA. (.089" MIN)	STEEL
24	#9 x 1" PHILLIPS FLATHEAD WOOD SCREW	STEEL
25	#10 x 3" PHILLIPS FLATHEAD WOOD SCREW	STEEL
26	KWIKSET TITAN SERIES DEADBOLT	
27	WOOD CAP FOR .125" THK. GLASS	PINE
28	WOOD CAP FOR DOOR EMBOSS PANEL	PINE
29	WOOD GLASS STOP FOR .125" THK. GLASS	PINE
30	WOOD GLASS STOP FOR .50" THK. GLASS	PINE
31	#10 x 2 1/2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
32	VINYL INSWING DOOR BOTTOM SWEEP	VINYL
33	BRAD TRIM NAIL 1" L.	STEEL
34	SURFACE BOLT (IVES, .25" STEEL)	STEEL
35	SURFACE BOLT STRIKE PLATE (IVES, .125" STEEL)	STEEL
36	1/4" CARRIAGE BOLT x 3" LG. (SURFACE BOLT ATTACH.)	STEEL
37	1/4" JAMB NUT (SURFACE BOLT ATTACH.)	STEEL

JELD-WEN, INC.
401 Harbor Isles Blvd
Klamath Falls, OR 97601
PH. 1.800.JELD.WEN


PRODUCT: WOOD STILE & RAIL DOOR
OPAGUE 6-8/8-0 INSWING
SINGLE W/ & W/O SIDELITES
PART OR ASSEMBLY:
VERTICAL CROSS SECTIONS
& BILL OF MATERIALS

NO.	DATE	REVISIONS
4	07/15/02	GENERAL REVISION KMN
3	07/13/01	GENERAL REVISION TJH
2	05/03/01	GENERAL REVISION TJH
1	04/19/01	GENERAL REVISION TJH
		BY


Jerry Schawch
8-10-04

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 04-0314.05
Expiration Date 08/23/04
By *[Signature]*
Miami Office Product Control
Division


DATE: 7/21/00
SCALE: 1/2" = 1"
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2037
SHEET 2 OF 9

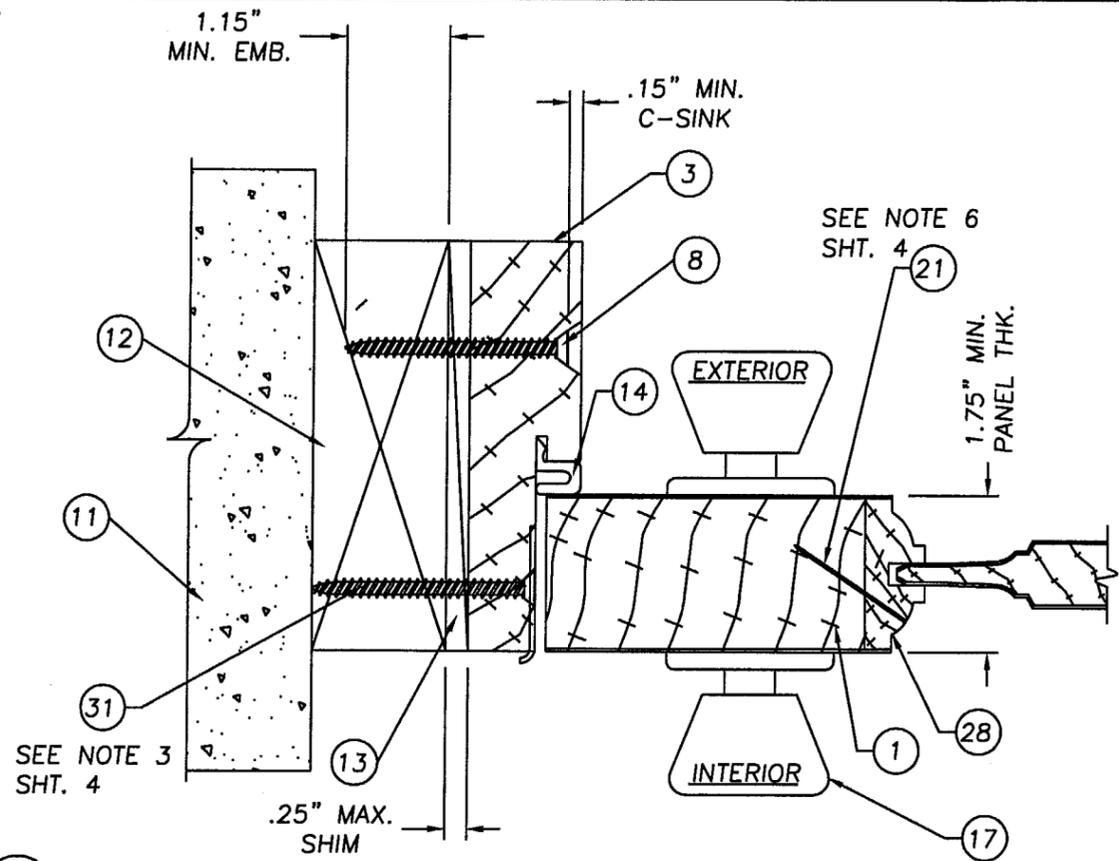


1 HORIZONTAL CROSS SECTION
3 @ LATCH JAMB TO BUCK

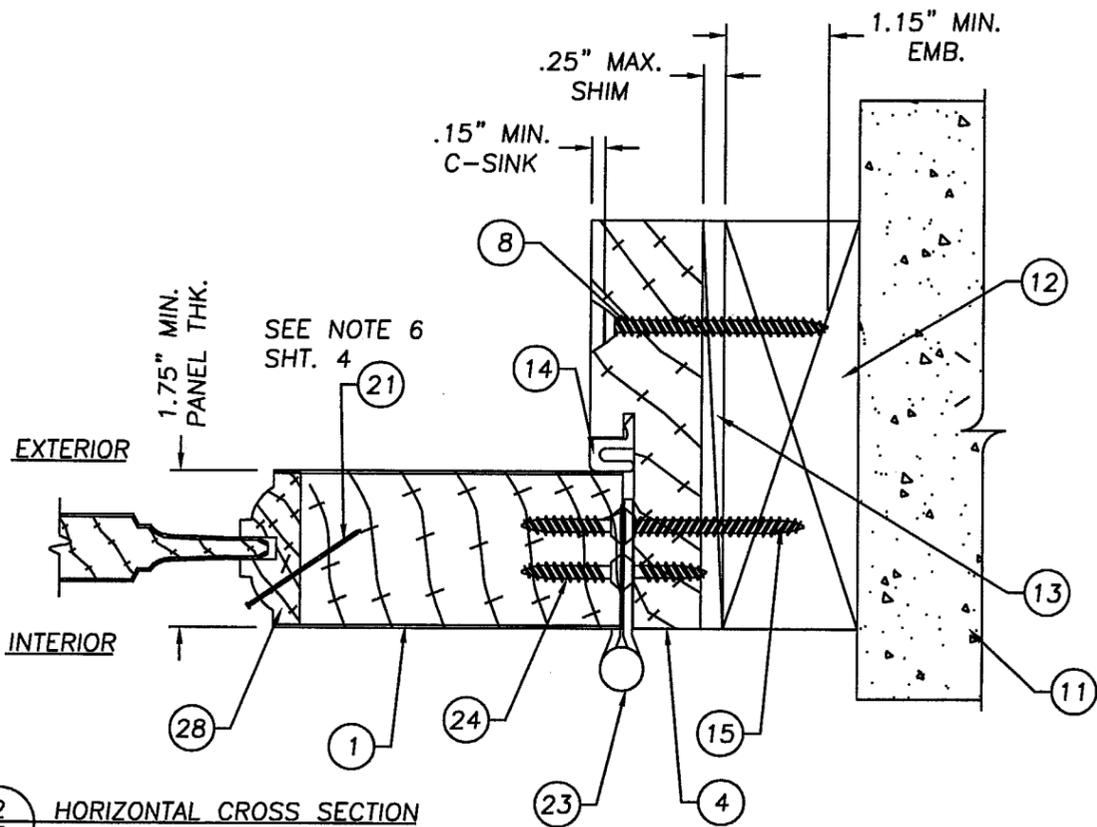

2 HORIZONTAL CROSS SECTION
3 @ HINGE JAMB TO BUCK

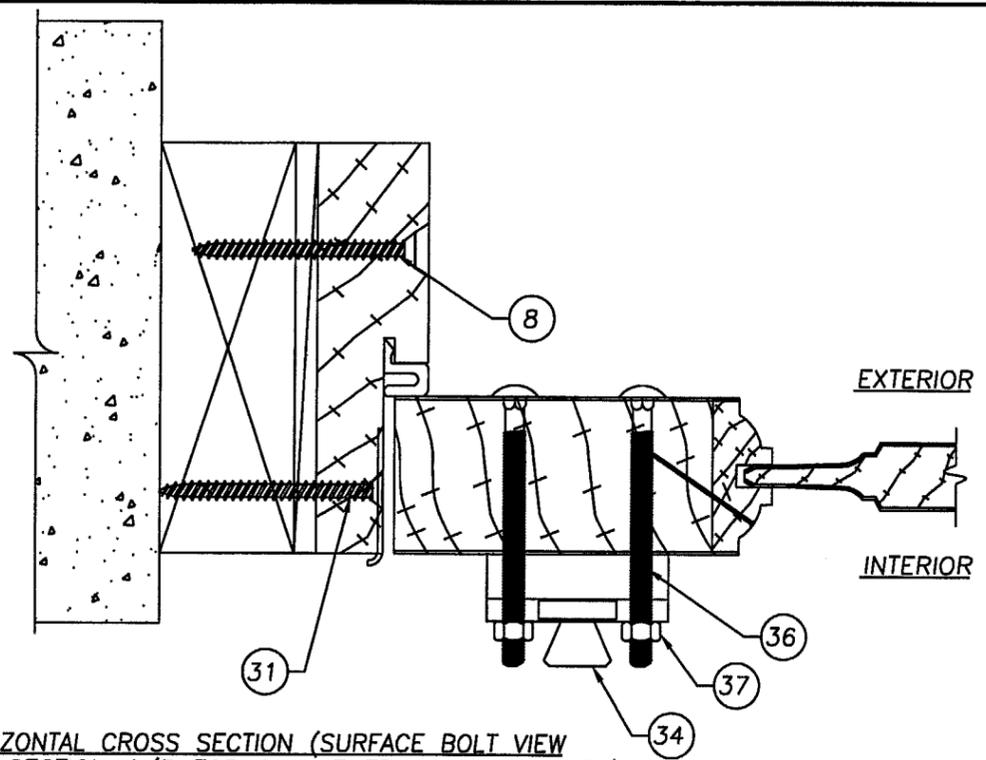

4 HORIZONTAL CROSS SECTION (SURFACE BOLT VIEW)
3 SEE SECTION 1/3 FOR ALL OTHER PART CALLOUTS)
THE SURFACE BOLTS ARE AN OPTION
TO ACHIEVE HIGHER PRESSURES
8-0 DOORS ONLY

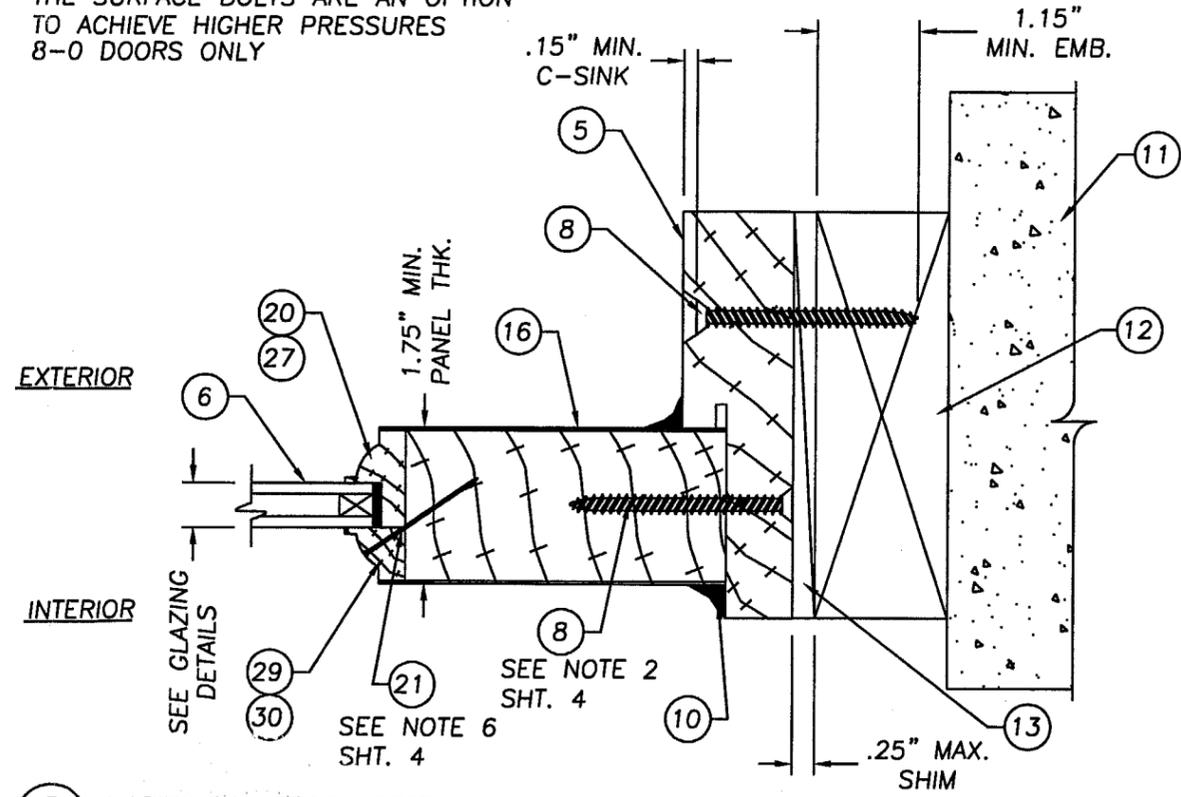


3 HORIZONTAL CROSS SECTION
3 @ SIDELITE TO BUCK, TYP.

James Bolmusa
B-10-DU

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 04-0714.05
Expiration Date 08/23/09
By *[Signature]*
Miami Dade Product Control
Division

JELD-WEN, INC. 401 Harbor Isles Blvd Klamath Falls, OR 97601 PH. 1.800.JELD.WEN																					
PRODUCT: WOOD STILE & RAIL DOOR OPAQUE 6-8/8-0 INSWING SINGLE W/ & W/O SIDELITES	PART OR ASSEMBLY: HORIZONTAL CROSS SECTION 1/3, 2/3, 3/3, & 4/3																				
<table border="1"> <thead> <tr> <th>NO.</th> <th>DATE</th> <th>REVISIONS</th> </tr> </thead> <tbody> <tr> <td>3</td> <td>07/13/01</td> <td>GENERAL REVISION TJH</td> </tr> <tr> <td>2</td> <td>05/03/01</td> <td>GENERAL REVISION TJH</td> </tr> <tr> <td>1</td> <td>04/19/01</td> <td>GENERAL REVISION TJH</td> </tr> </tbody> </table>	NO.	DATE	REVISIONS	3	07/13/01	GENERAL REVISION TJH	2	05/03/01	GENERAL REVISION TJH	1	04/19/01	GENERAL REVISION TJH	<table border="1"> <thead> <tr> <th>BY</th> <th>DATE</th> </tr> </thead> <tbody> <tr> <td>TJH</td> <td></td> </tr> <tr> <td>TJH</td> <td></td> </tr> <tr> <td>TJH</td> <td></td> </tr> </tbody> </table>	BY	DATE	TJH		TJH		TJH	
NO.	DATE	REVISIONS																			
3	07/13/01	GENERAL REVISION TJH																			
2	05/03/01	GENERAL REVISION TJH																			
1	04/19/01	GENERAL REVISION TJH																			
BY	DATE																				
TJH																					
TJH																					
TJH																					
DATE: 7/21/00 SCALE: 1/2" = 1" DWG. BY: TJH CHK. BY: RW DRAWING NO.: S-2037 SHEET 3 OF 9																					

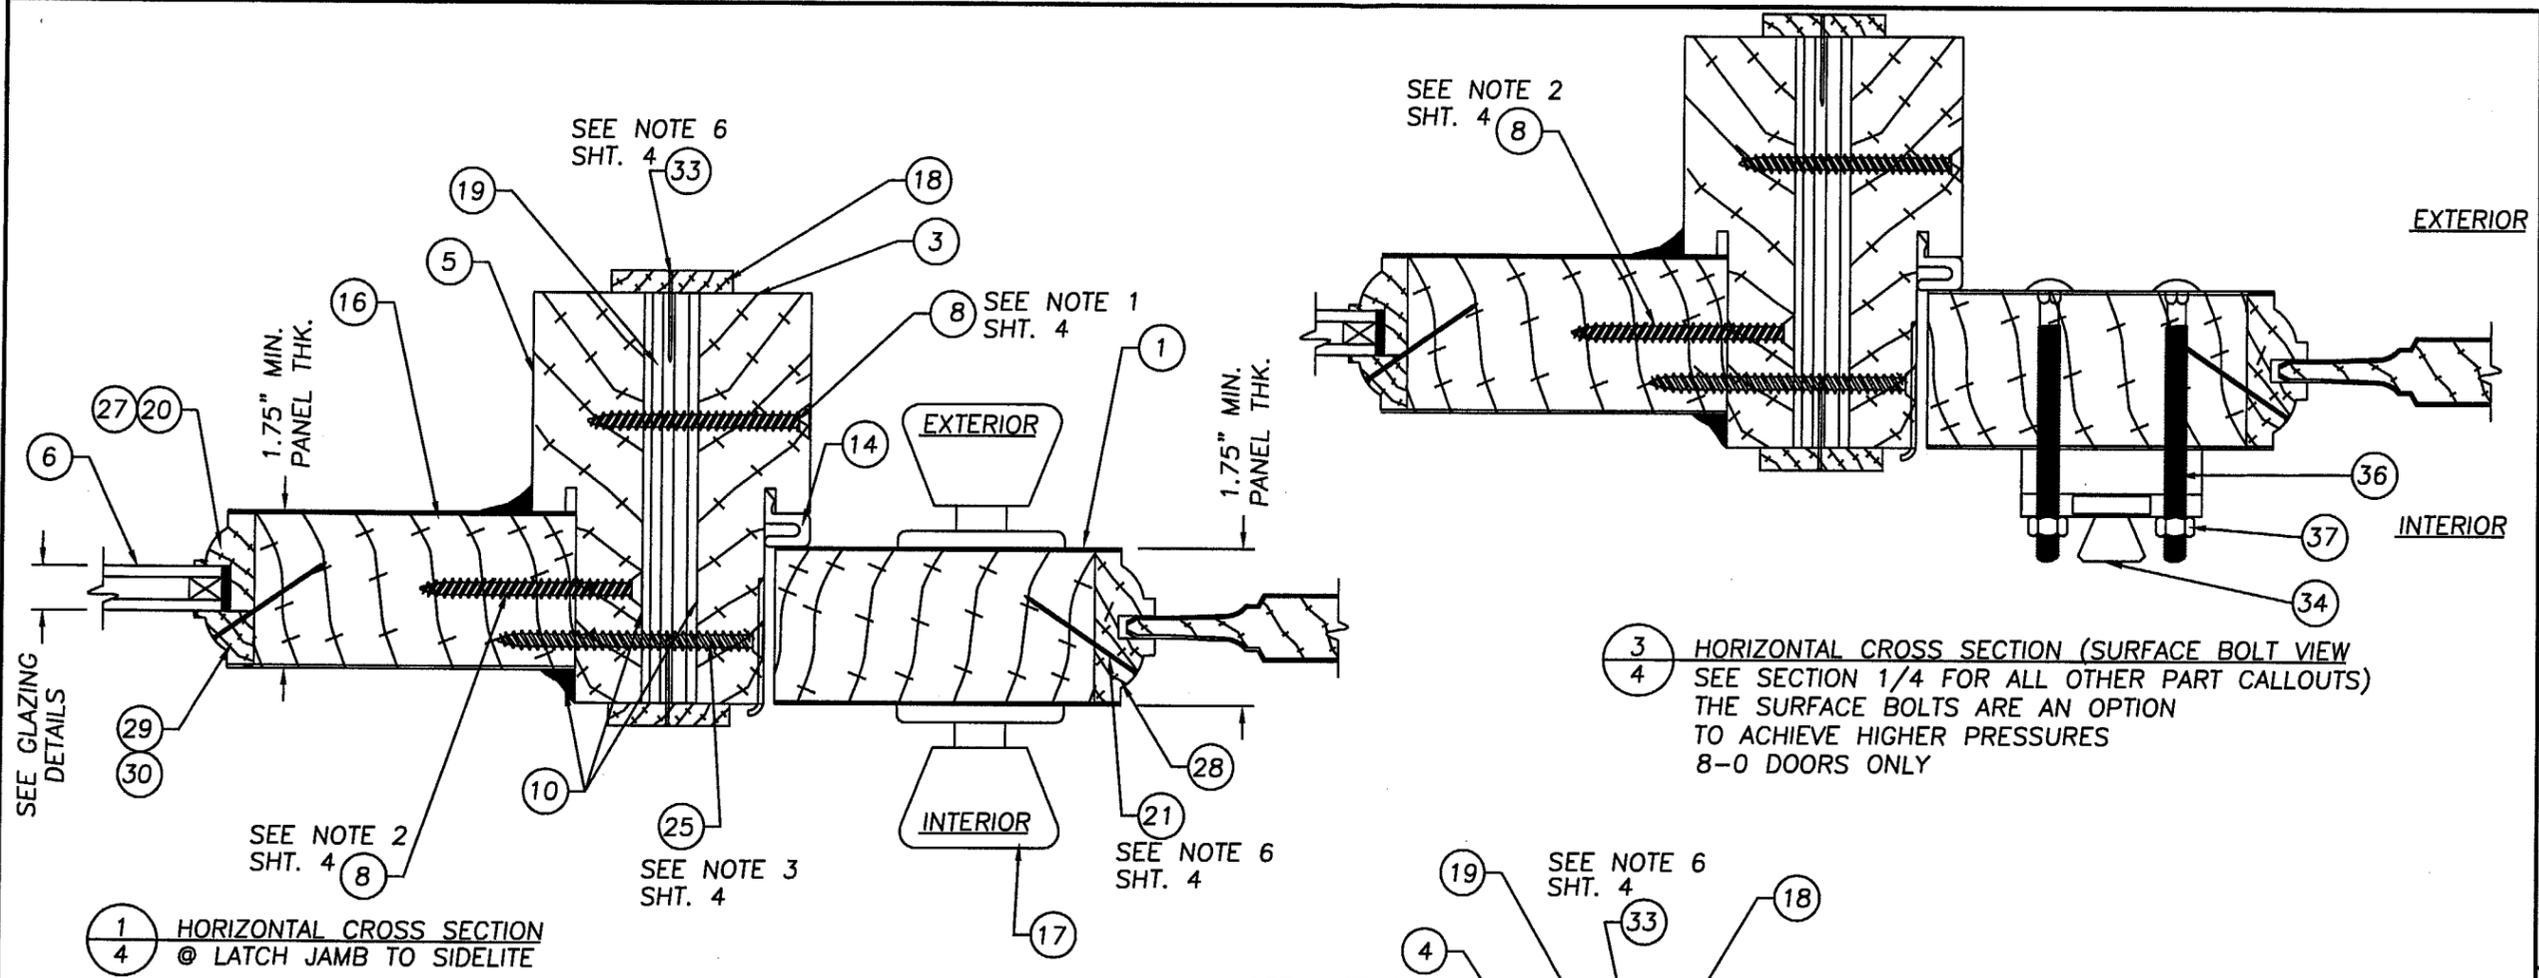

JELD-WEN, INC.
 401 Harbor Isles Blvd
 Klamath Falls, OR 97601
 PH. 1.800.JELD.WEN

PRODUCT: WOOD STILE & RAIL DOOR
 OPAQUE 6-8/8-0 INSWING
 SINGLE W/ & W/O SIDELITES
 PART OR ASSEMBLY:
 HORIZONTAL CROSS
 SECTIONS 1/4, 2/4, & 3/4

NO.	DATE	REVISIONS	BY
3	07/13/01	GENERAL REVISION	TJH
2	05/03/01	GENERAL REVISION	TJH
1	04/19/01	GENERAL REVISION	TJH


- NOTES: (TYP. TO ALL FRAME CONFIGURATIONS)
1. SPACING FOR ITEM #8 AT THE MULLION IS AS FOLLOWS; 8-0 UNITS 6" DOWN FROM TOP & (6) MORE AT @ 14.375" O.C. 6-8 UNITS SAME AS THE PERIMETER SPACING FOR THE 6-8 UNITS.
 2. SPACING FOR ITEM #8 ATTACHING THE SIDELITE INTO THE FRAME: 6" FROM TOP AND BOTTOM CORNERS AND (2) MORE EVENLY SPACED, (4) TOTAL.
 3. WHEN ATTACHING STRIKE & DEADBOLT PLATES TO THE JAMB USE: ON SINGLE UNITS; ITEM #31 (#10 x 2 1/2"), ON SINGLE UNITS W/SIDELITES ITEM #25 (#10 x 3").
 4. THE THRESHOLD IS NOT ATTACHED TO THE FRAME, IT IS NOTCHED AND ATTACHED TO THE FLOOR WITH ITEMS #9 1/4" x 2 1/2" TAPCON AND #10 (CR LAWRENCE 33S SILICONE CAULK). APPLY A CONTINUOUS BEAD .125" THK. x .375" W. AROUND ALL (4) OUTER EDGES WITH A MINIMUM OF (2) ROWS IN A ZIG ZAG PATTERN IN THE MIDDLE THE ENTIRE LENGTH OF THE THRESHOLD, .125" THK. x .375" W.
 5. THE TOP CORNERS OF THE DOOR FRAME, AND ALL FOUR CORNERS OF THE SIDELITE FRAME ARE STAPLED TOGETHER USING (3) 16GA. x 2" LG. x 1/2" CROWN STAPLES.
 6. SPACING FOR ITEM #21 & #31 IS A MAX. OF 8" O.C.

James Dohrowski
 8-10-04

2 HORIZONTAL CROSS SECTION
 4 @ HINGE JAMB TO SIDELITE

PRODUCT REVISED
 to comply with the Florida
 Building Code
 Acceptance No 04-0714.05
 Expiration Date 08/31/09
 By *[Signature]*
 Miami Door Product Control
 Division

DATE: 7/21/00
 SCALE: 1/2" = 1"
 DWG. BY: TJH
 CHK. BY: RW
 DRAWING NO.: S-2037
 SHEET 4 OF 9

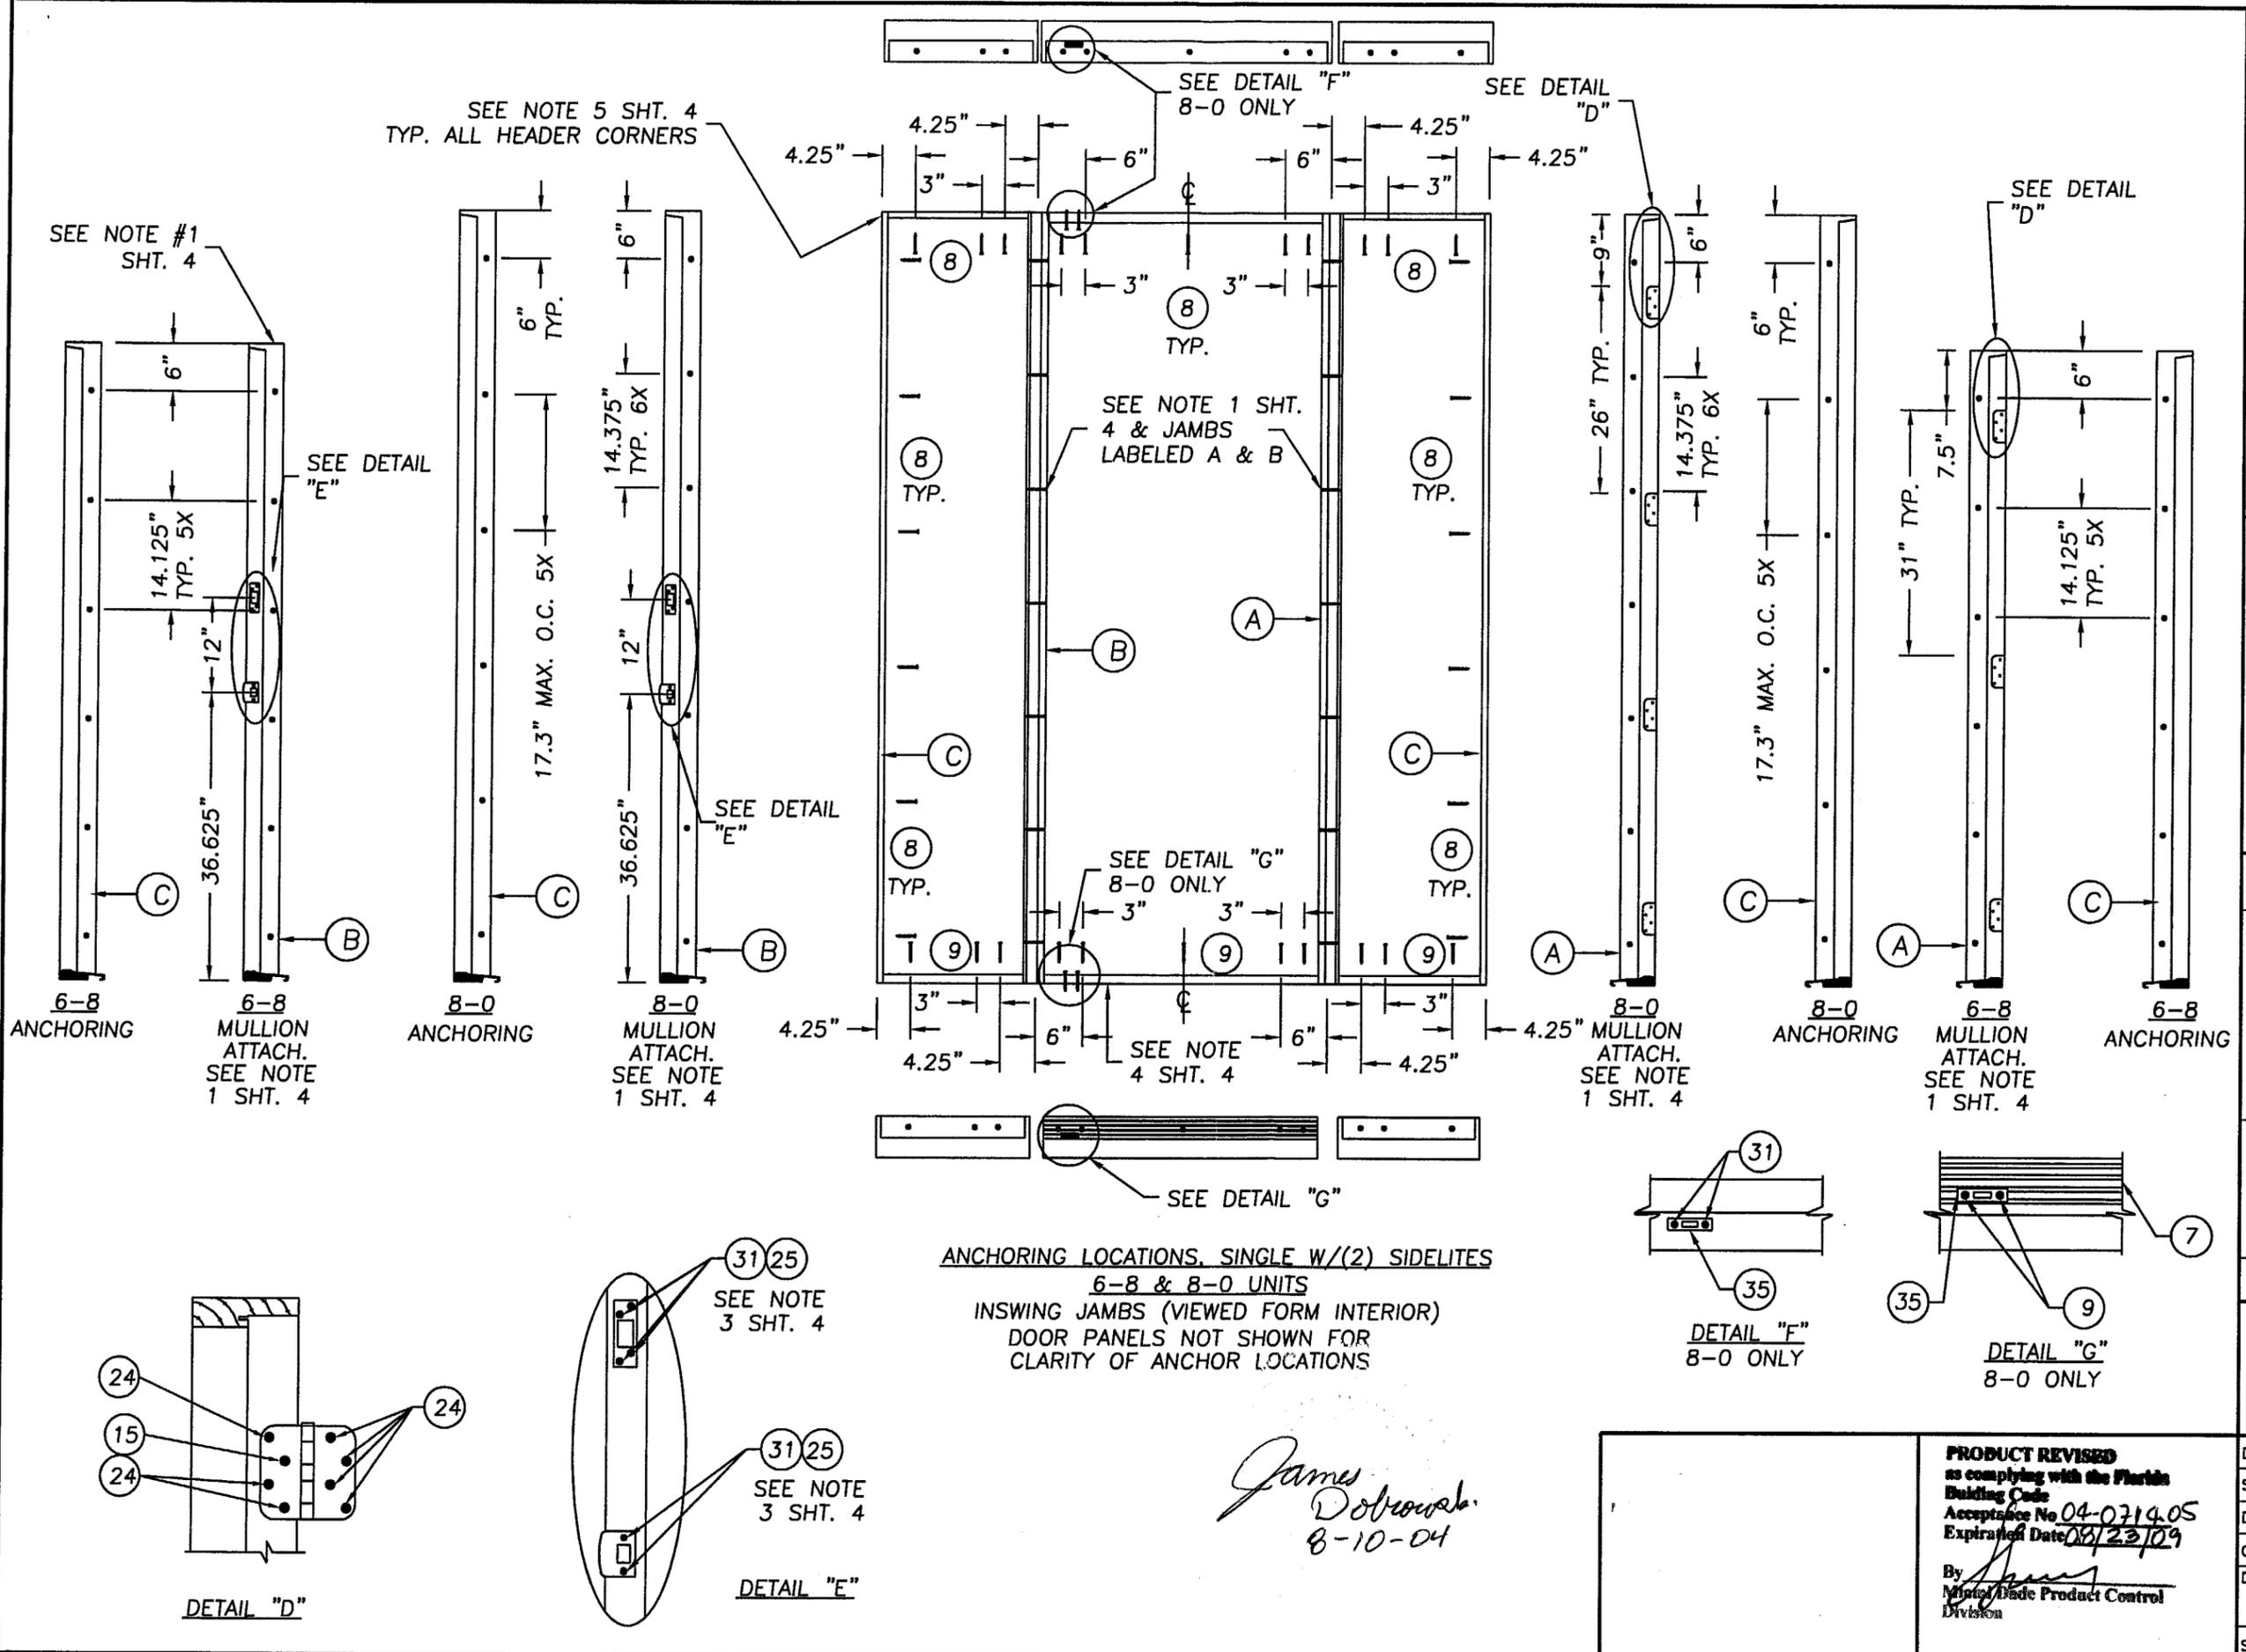

JELD-WEN, INC.
 401 Harbor Isles Blvd
 Klamath Falls, OR 97601
 PH. 1.800.JELD.WEN

PRODUCT:
 WOOD STILE & RAIL DOOR
 OPAQUE 6-8/8-0 INSWING
 SINGLE W/ & W/O SIDELITES
 PART OR ASSEMBLY:
 ANCHORING LOCATIONS
 & DETAILS

NO.	DATE	REVISIONS	BY
3	07/13/01	GENERAL REVISION	TJH
2	05/03/01	GENERAL REVISION	TJH
1	04/19/01	GENERAL REVISION	TJH





DATE:	7/24/00
SCALE:	NTS
DWG. BY:	TJH
CHK. BY:	RW
DRAWING NO.:	S-2037
SHEET	5 OF 9


James Dobrowolski
 8-10-04

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 04-0714.05
 Expiration Date 08/23/09

By *[Signature]*
 Metal/Door Product Control
 Division

ANCHORING LOCATIONS, SINGLE W/(2) SIDELITES
 6-8 & 8-0 UNITS
 INSWING JAMBS (VIEWED FROM INTERIOR)
 DOOR PANELS NOT SHOWN FOR
 CLARITY OF ANCHOR LOCATIONS

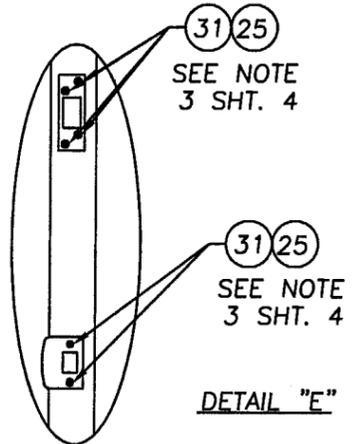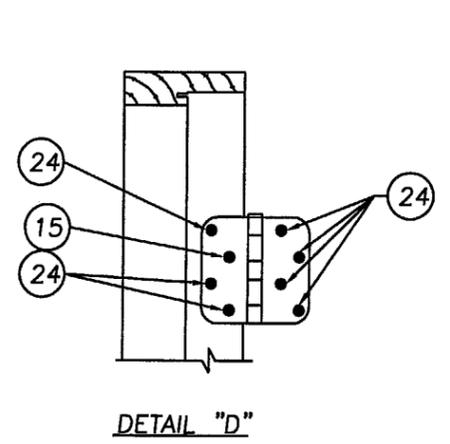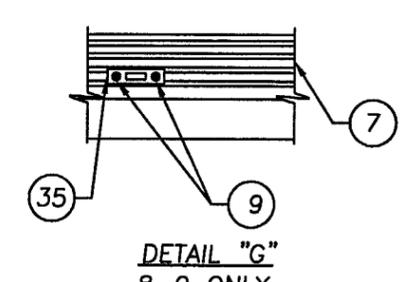

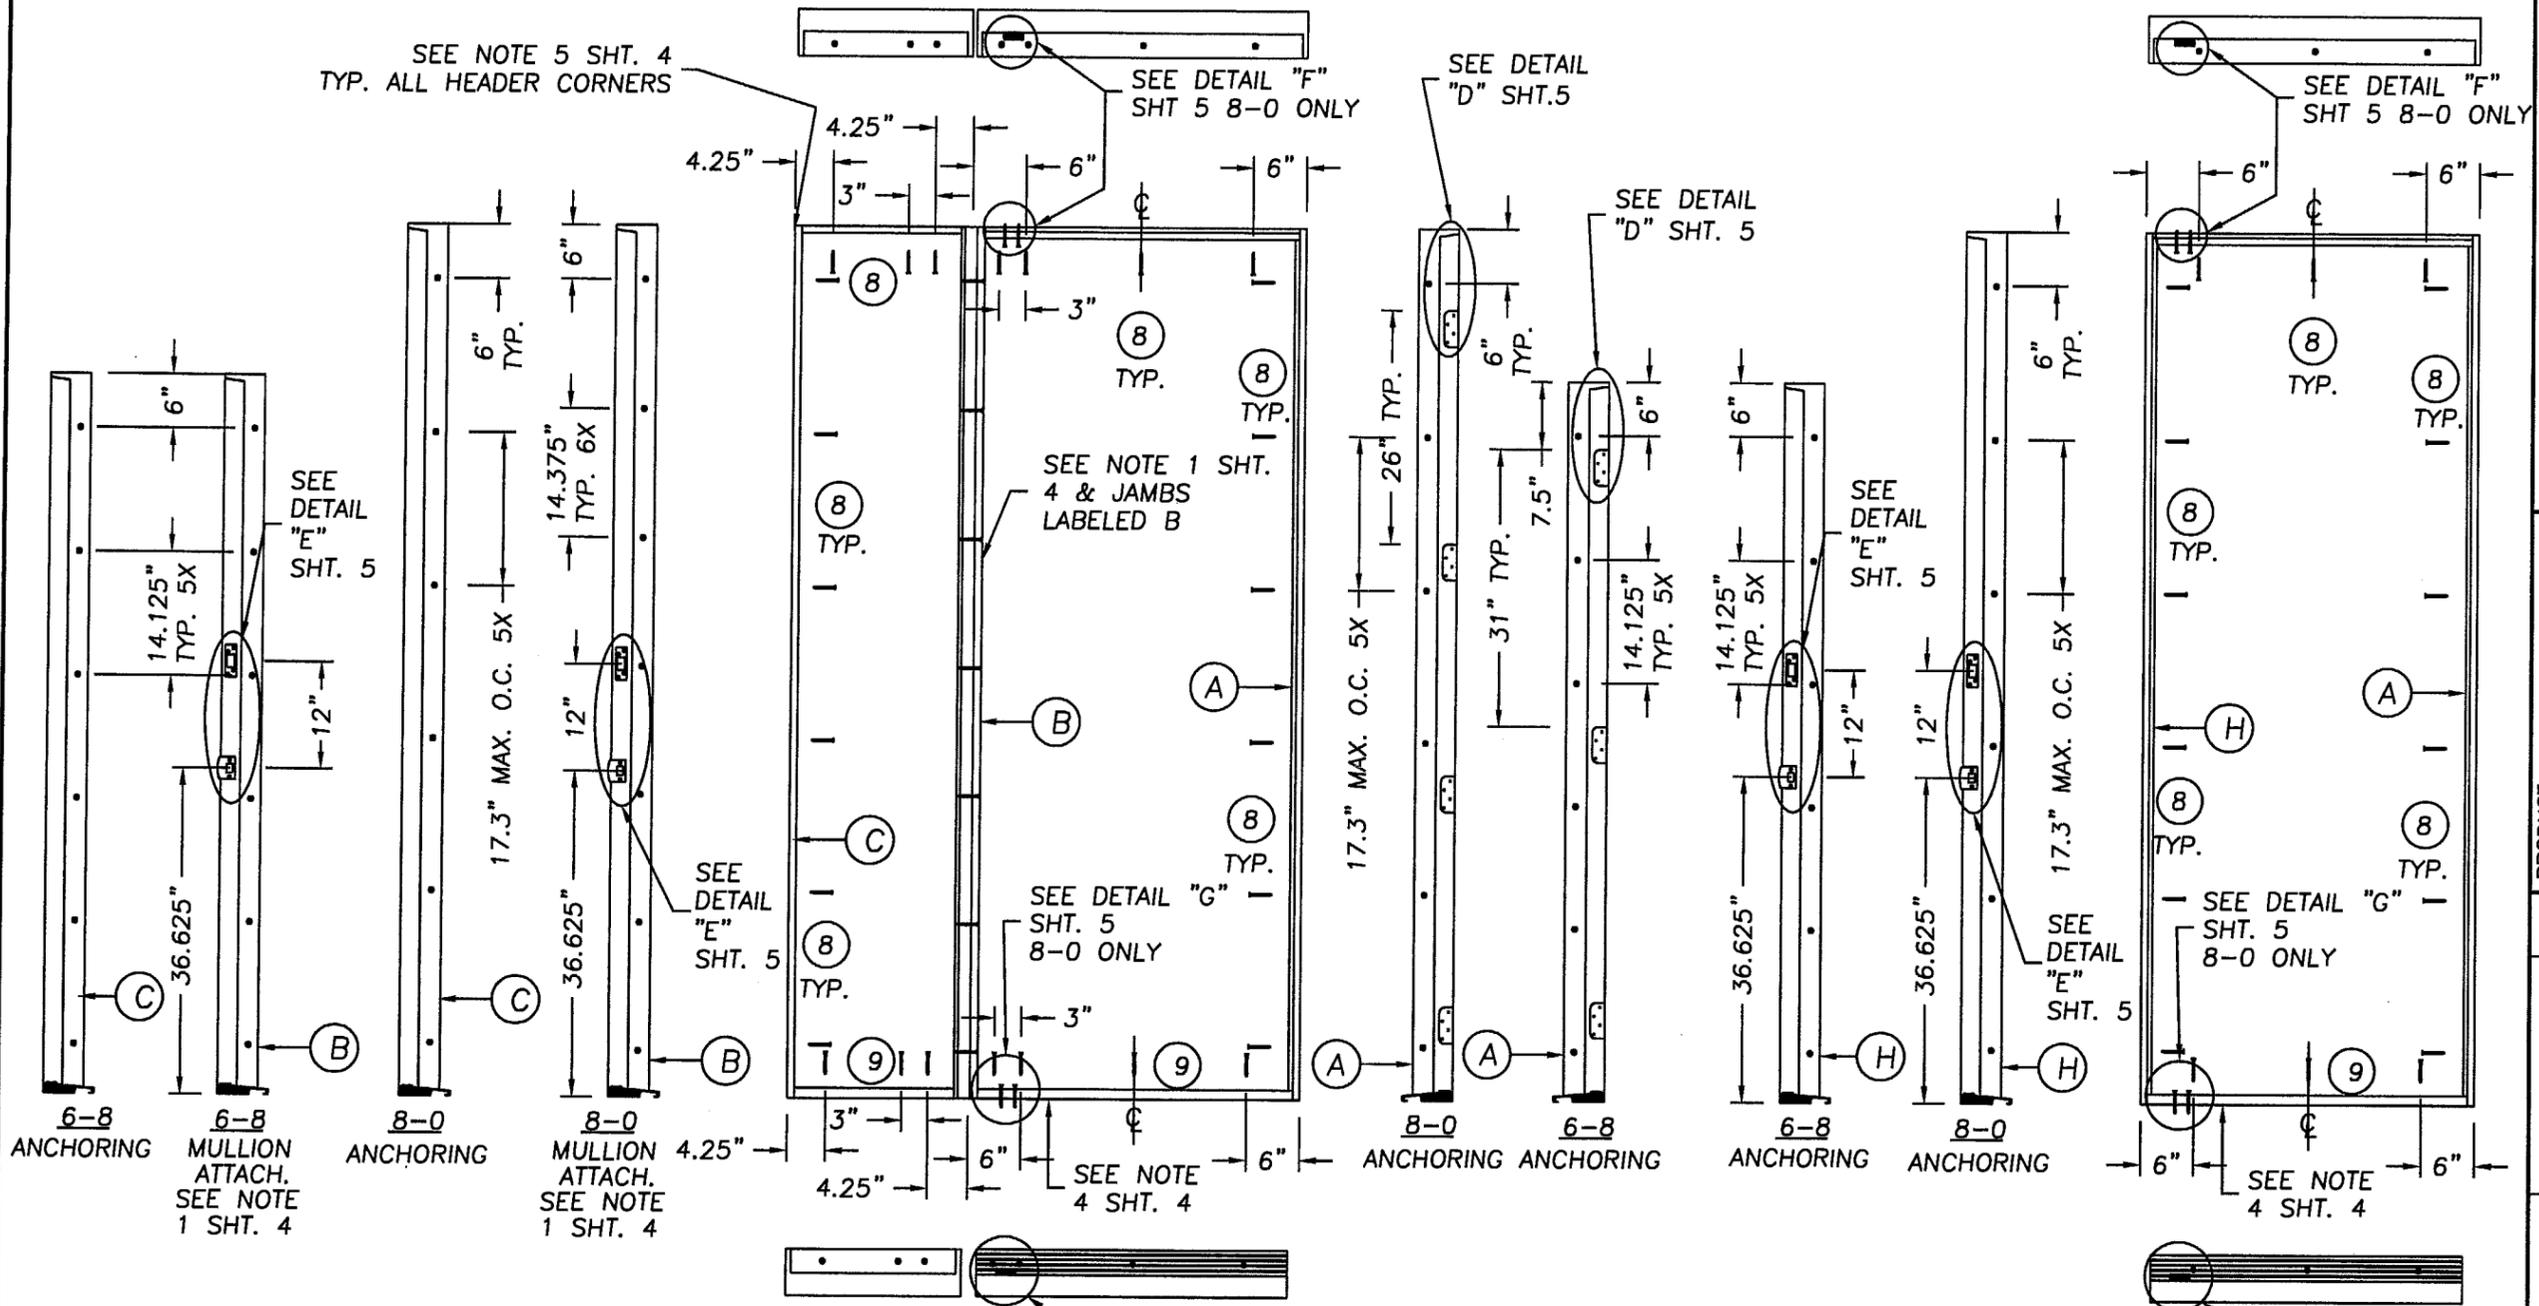

SEE NOTE 5 SHT. 4
TYP. ALL HEADER CORNERS

SEE DETAIL "F"
SHT 5 8-0 ONLY

SEE DETAIL
"D" SHT.5

SEE DETAIL "F"
SHT 5 8-0 ONLY

SEE NOTE 1 SHT.
4 & JAMBS
LABELED B

SEE DETAIL
"D" SHT. 5

SEE DETAIL
"E"
SHT. 5

SEE DETAIL "G"
SHT. 5
8-0 ONLY

SEE DETAIL "G"
SHT. 5
8-0 ONLY

SEE DETAIL
"F"
SHT. 5

SEE NOTE
4 SHT. 4

SEE NOTE
4 SHT. 4

SEE DETAIL "G"
SHT. 5 8-0 ONLY

INSWING JAMBS (VIEWED FORM INTERIOR)
DOOR PANELS NOT SHOWN FOR
CLARITY OF ANCHOR LOCATIONS

SEE DETAIL "G"
SHT. 5 8-0 ONLY

ANCHORING LOCATIONS, SINGLE W/(1) SIDELITE
6-8 & 8-0 UNITS

ANCHORING LOCATIONS, SINGLE
6-8 & 8-0 UNITS

JELD-WEN, INC.
401 Harbor Isles Blvd
Klamath Falls, OR 97601
PH. 1.800.JELD.WEN


PRODUCT:
WOOD STILE & RAIL DOOR
OPAQUE 6-8/8-0 INSWING
SINGLE W/ & W/O SIDELITES
PART OR ASSEMBLY:
ANCHORING LOCATIONS

NO.	DATE	REVISIONS	BY
3	07/13/01	GENERAL REVISION TJH	
2	05/03/01	GENERAL REVISION TJH	
1	04/19/01	GENERAL REVISION TJH	


James Dobrowski
8-10-04

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 09-074.05
Expiration Date 08/23/09
By: *[Signature]*
Mitsui Trade Product Control
Division

DATE:	7/24/00
SCALE:	NTS
DWG. BY:	TJH
CHK. BY:	RW
DRAWING NO.:	S-2037
SHEET	6 OF 9

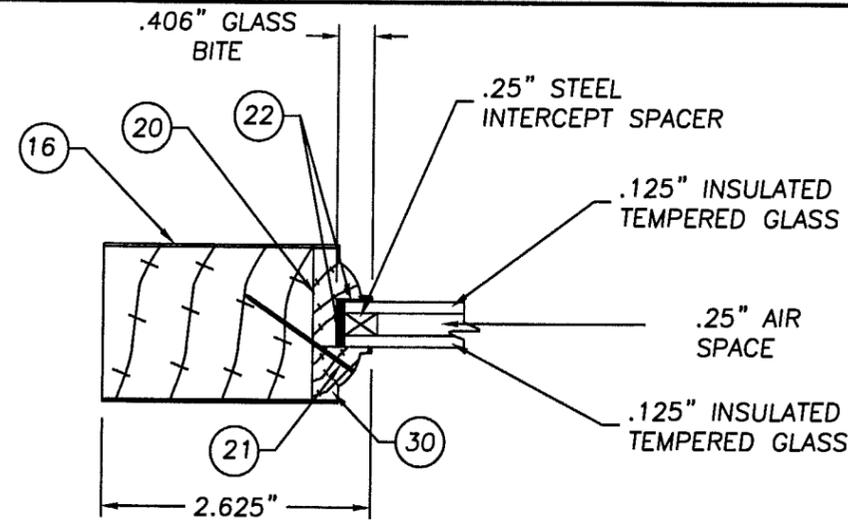


**.50" INSULATED TEMPERED GLASS
GLAZING DETAIL
SCALE: 1/2" = 1"**

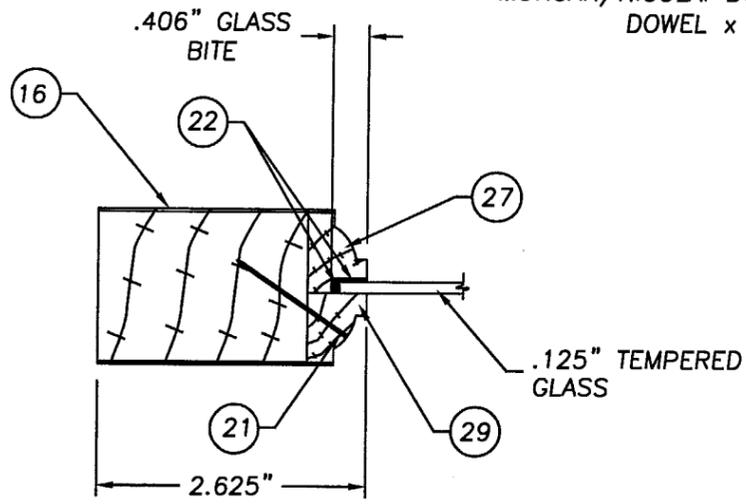


**.125" TEMPERED GLASS
GLAZING DETAIL
SCALE: 1/2" = 1"**

NORD DOOR .50" WOOD
DOWEL x 4.0" LG., 3PLCS
MORGAN/NICOLAI DOOR .625" WOOD
DOWEL x 4.0" LG., 3PLCS

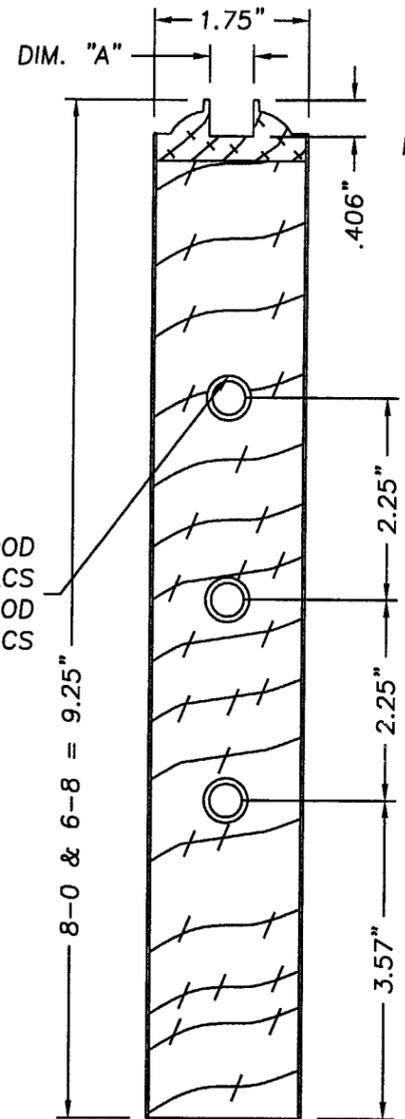

**BOTTOM RAIL
SCALE: 1/2" = 1"**


NORD DOOR .50" WOOD
DOWEL x 4.0" LG., 3PLCS
MORGAN/NICOLAI DOOR .625" WOOD
DOWEL x 4.0" LG., 3PLCS

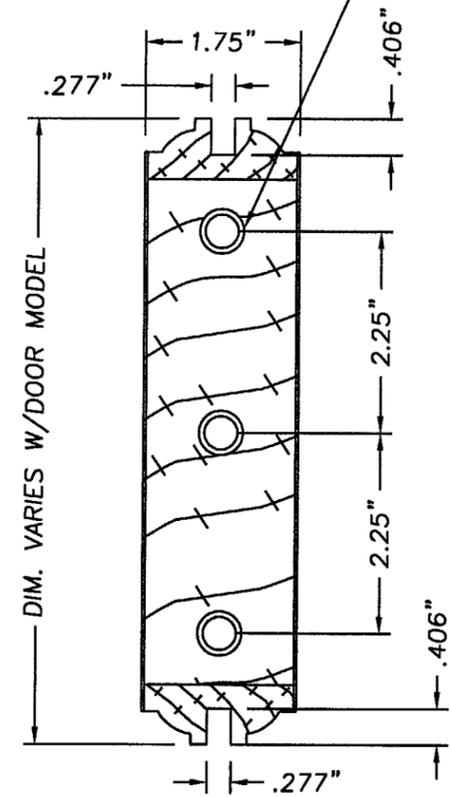


**LOCK RAIL
MULLION
INTERMEDIATE STILE
SCALE: 1/2" = 1"**

NORD DOOR HOLE FOR .50" WOOD
DOWEL x 4.0" LG., 2PLCS
MORGAN/NICOLAI DOOR HOLES FOR
.625" WOOD DOWEL x 4.0" LG., 2PLCS

NORD DOOR .50" WOOD
DOWEL x 4.0" LG., 2PLCS
MORGAN/NICOLAI DOOR .625" WOOD
DOWEL x 4.0" LG., 2PLCS

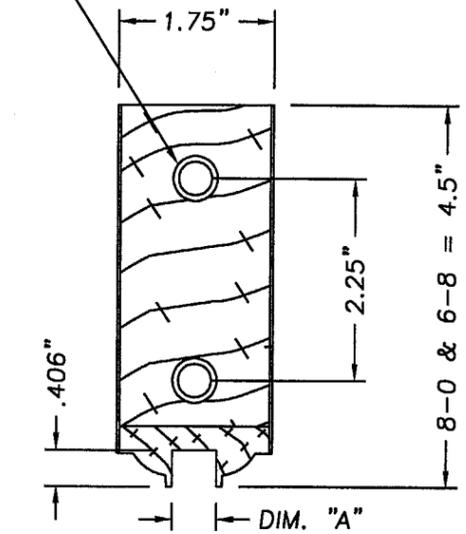

**TOP RAIL
SCALE: 1/2" = 1"**

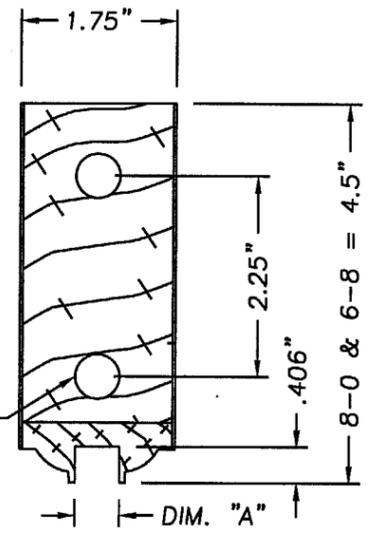


**SIDE STILE
SCALE: 1/2" = 1"**

DIMENSION "A" CHART	
OPENING FOR	DIM. "A"
1/8" GLASS	.152"
1/2" GLASS	.527"
INSET PANEL	.277"

*James Sobrowab
8-10-04*

- NOTES:**
- DOWELS ARE GLUED AND PRESSED 2.0" INTO THE RAILS AND STILES AT PANEL ASSEMBLY WITH PVA TYPE "1" EXTERIOR GLUE.
 - THE INSET PANELS ARE NOT GLUED INTO THE STILES OR RAILS. THEY ARE LEFT TO FLOAT WITH THE DOOR AS IT EXPANDS AND CONTRACTS TO ELIMINATE DOOR CRACKING.

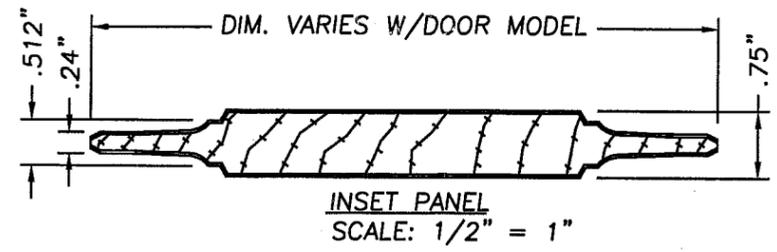

**INSET PANEL
SCALE: 1/2" = 1"**


PRODUCT:
WOOD STILE & RAIL DOOR
OPAQUE 6-8/8-0 INSWING
SINGLE W/ & W/O SIDELITES
PART OR ASSEMBLY:
GLAZING DETAILS
& RAIL DETAILS

NO.	DATE	REVISIONS	BY
3	07/13/01	GENERAL REVISION	TJH
2	05/03/01	GENERAL REVISION	TJH
1	04/19/01	GENERAL REVISION	TJH


DATE: 7/24/00
SCALE: AS NOTED
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2037
SHEET 7 OF 9

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 04-0714.05
Expiration Date 08/23/09
By: *[Signature]*
Miami Dade Product Control
Division


JELD-WEN, INC.
401 Harbor Isles Blvd
Klamath Falls, OR 97601
PH. 1.800.JELD.WEN

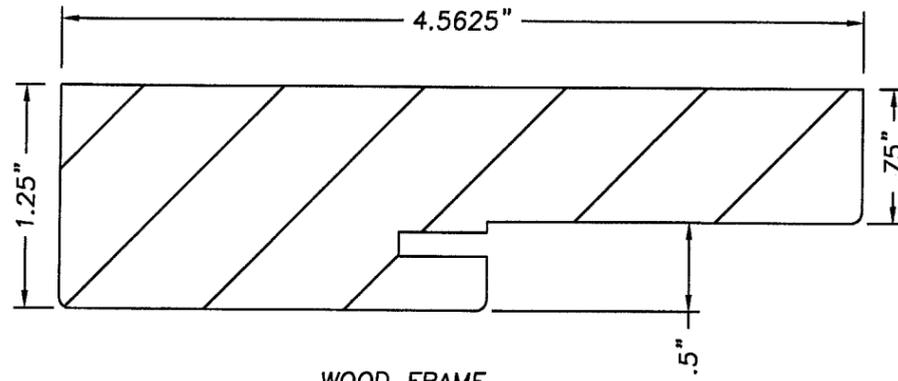


WOOD FRAME

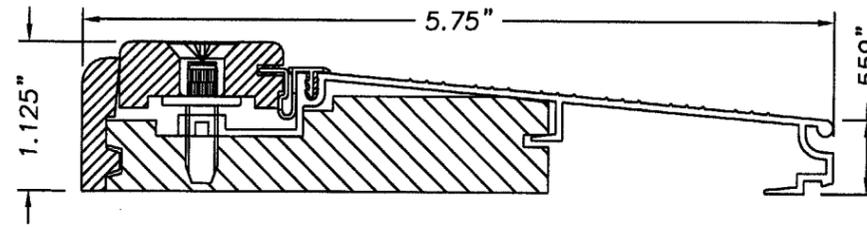


ADJUSTABLE INSWING THRESHOLD
.051" WALL THK.

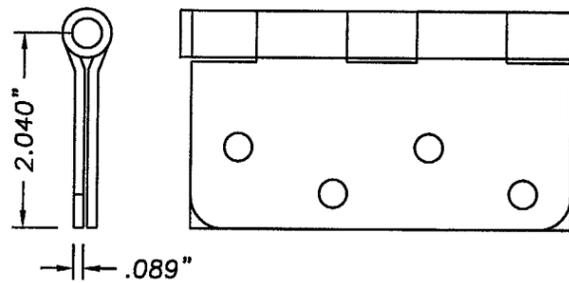


4 x 4 DOOR HINGE

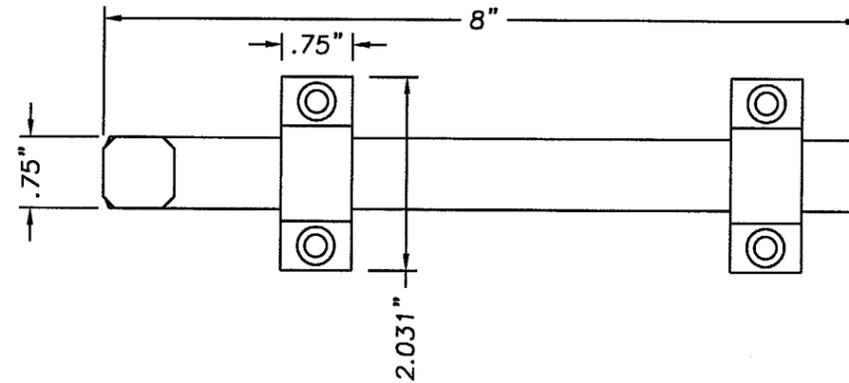

SURFACE BOLT (IVES. MODEL #455 .25" STEEL)

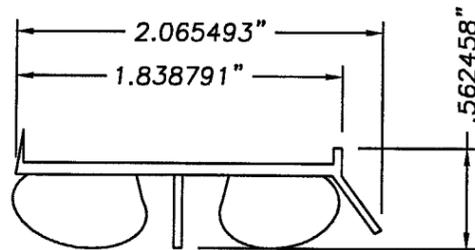

EXTRUDED VINYL INSWING
DOOR BOTTOM SWEEP

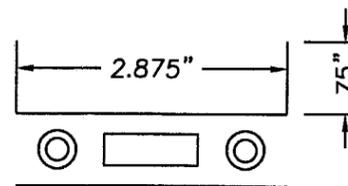

SURFACE BOLT STRIKE (IVES .125" STEEL)

James Dobrowski
8-10-01

JELD-WEN, INC.
401 Harbor Isles Blvd
Klamath Falls, OR 97601
PH. 1.800.JELD.WEN


PRODUCT: WOOD STILE & RAIL DOOR
OPAQUE 6-8/8-0 INSWING
SINGLE W/ & W/O SIDELITES
PART OR ASSEMBLY:
FRAME COMPONENTS

NO.	DATE	REVISIONS	BY
3	07/13/01	GENERAL REVISION	TJH
2	05/03/01	GENERAL REVISION	TJH
1	04/19/01	GENERAL REVISION	TJH







PRODUCT REVISED
to comply with the Florida
Building Code
Acceptance No 04-0714.05
Expiration Date 08/22/09
By *[Signature]*
Minimal Date Product Control
Division

DATE: 7/21/00
SCALE: NTS
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2037
SHEET 8 OF 9


36.0"

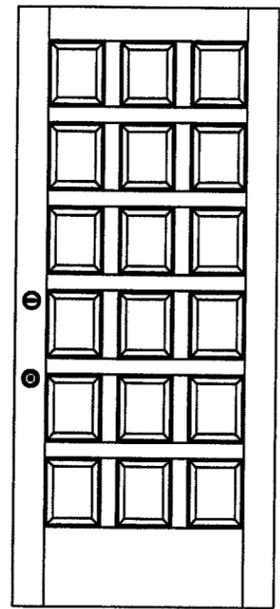

8-0 = 96.0"

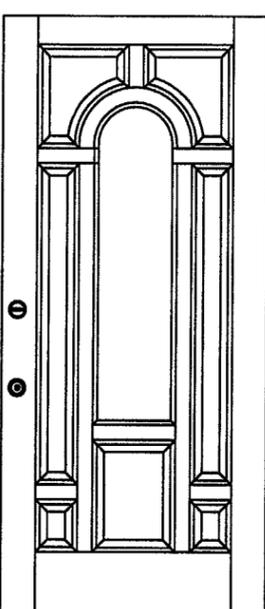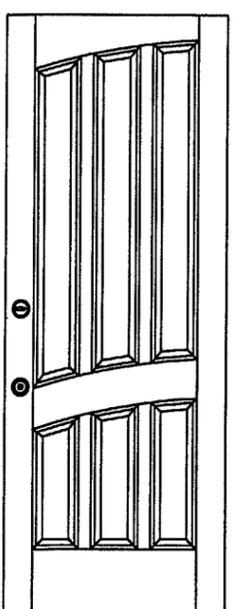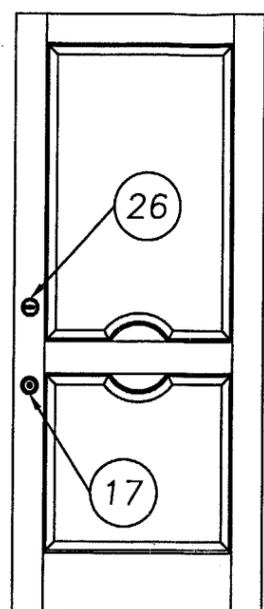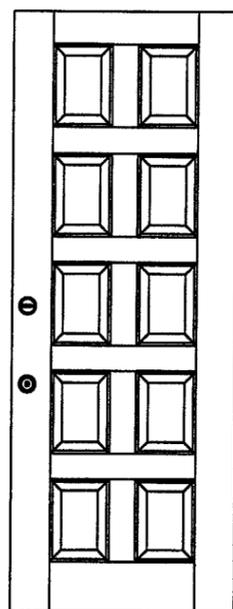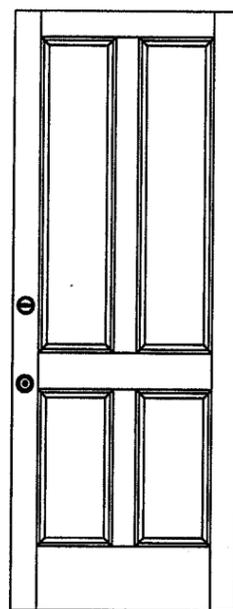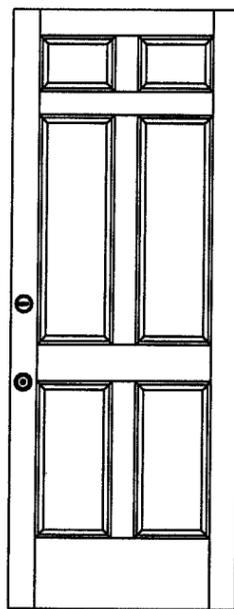

18.0"

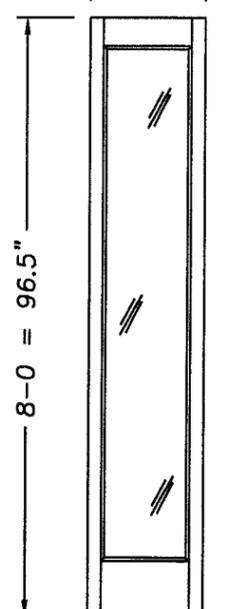


8-0 = 96.5"








8-0 DOOR MODELS N.T.S. (OPAQUE)

8-0 SIDELITE MODEL


36.0"

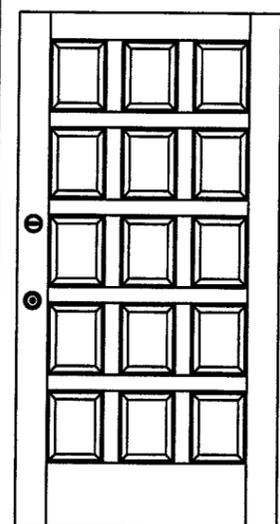

6-8 = 80.0"

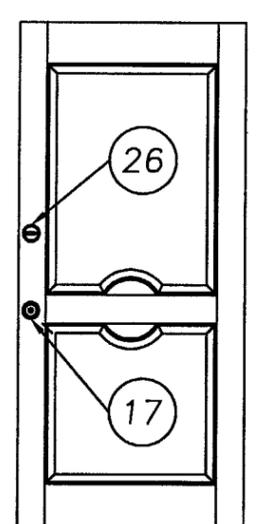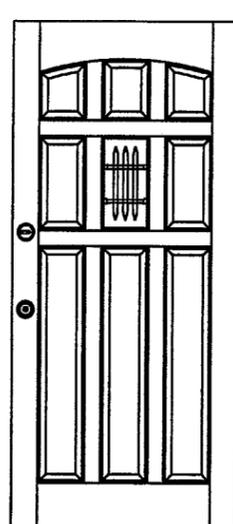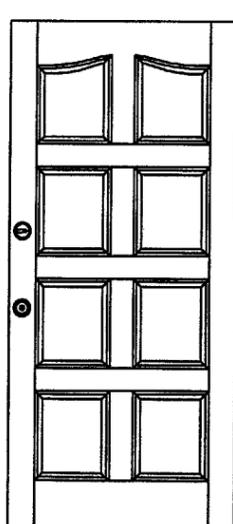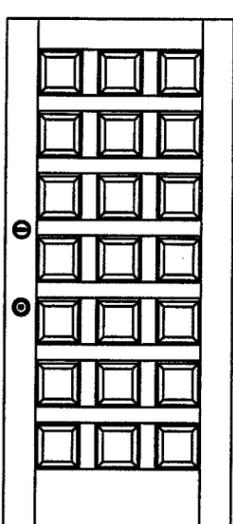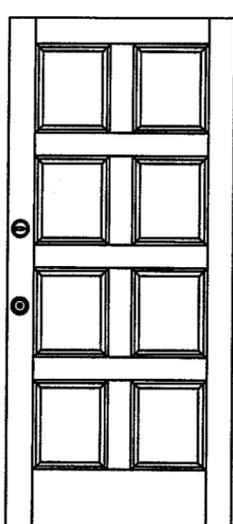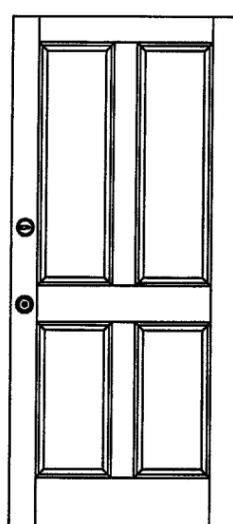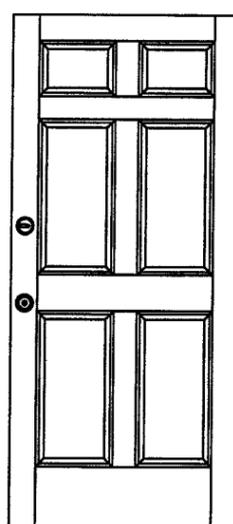




18.0"

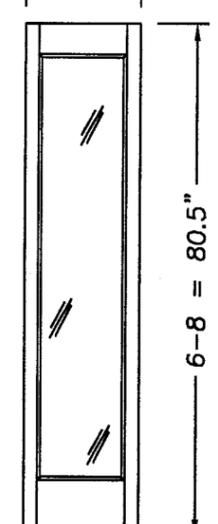

6-8 = 80.5"

6-8 DOOR MODELS N.T.S. (OPAQUE)

6-8 SIDELITE MODEL

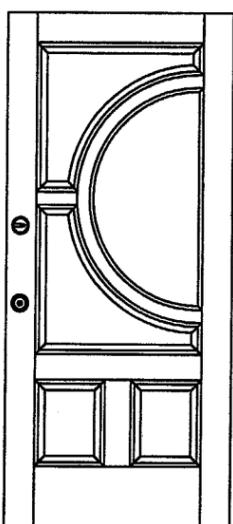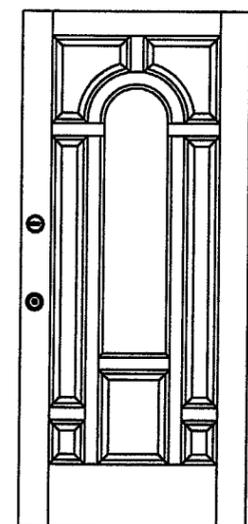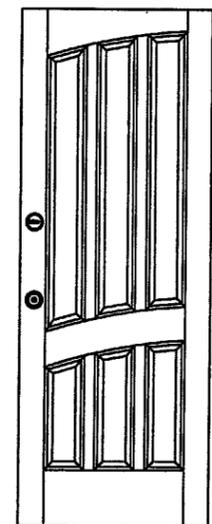

James Dobrowski
8-10-01

PRODUCT REVISION
as complying with the Florida
Building Code
Acceptance No. 04-0314-05
Expiration Date 08/23/09
By *James*
Miami Dade Product Control
Division

JELD-WEN, INC.
401 Harbor Isles Blvd
Klamath Falls, OR 97601
PH. 1.800.JELD.WEN

PRODUCT:
WOOD STILE & RAIL DOOR
OPAQUE 6-8/8-0 INSWING
SINGLE W/ & W/O SIDELITES
PART OR ASSEMBLY:
DOOR MODELS

NO.	DATE	REVISIONS	TJH	BY
3	07/13/01	GENERAL REVISION	TJH	
2	05/03/01	GENERAL REVISION	TJH	
1	04/19/01	GENERAL REVISION	TJH	

DATE: 7/21/00
SCALE: NTS
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2037

SHEET 9 OF 9