



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Andersen Corporation
100 Fourth Avenue North
Bayport, MN 55003**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "Perma-Shield" Vinyl Clad Wood Casement Window

APPROVAL DOCUMENT: Drawing No. **W03-72**, titled "Perma-Shield Vinyl Clad WD. Casement WDW.", sheets 1 through 5 of 5, dated 08/22/03, with revision "B" dated 08/02/04, prepared by AL-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA #04-0504.06 consists of this page 1 and evidence pages E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Herminio F. Gonzalez, P.E., Director, BCCO**



**NOA No 04-0930.02
Expiration Date: June 22, 2008
Approval Date: April 21, 2005
Page 1**

Andersen Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **W03-72** titled "Perma-Shield Vinyl Clad WD. Casement WDW.", sheets 1 through 5 of 5, dated 08/22/03, with revision "**B**" dated 08/02/04, prepared by AL-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E.

B. TESTS

1. Test reports on 1) Air Infiltration Test per FBC, TAS 202-94
2) Uniform Static Air Pressure Test Loading per FBC, TAS 202-94
3) Water Resistance Test per FBC, TAS 202-94
4) Forced Entry Test per FBC 2411.3.2.1 (b) and TAS 202-94
along with marked-up drawings and installation diagram of vinyl clad casement windows, prepared and issued by Architectural Testing, Test report No. **ATI-02-50075.01** dated April 28, 2004, signed and sealed by Steven M. Urich, P.E.

C. CALCULATIONS

1. Anchor Calculations, ASTM-E1300, and structural analysis, prepared by AL-Farooq Corporation, dated 08/02/04, signed and sealed by Humayoun Farooq, P.E.

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. None

F. STATEMENTS

1. Statement letter of no financial interest, dated August 02, 2004, signed by Humayoun Farooq, P.E.
2. Statement letter of conformance, dated August 02, 2004, signed by Humayoun Farooq, P.E.




G. OTHER

1. Letter from the consultant stating that the product is in compliance with the Florida Building Code (FBC).

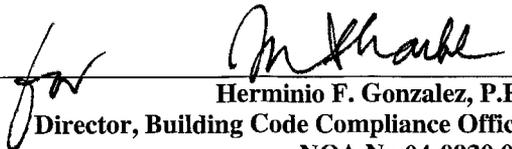

Herminio F. Gonzalez, P.E.
Director, Building Code Compliance Office


NOA No 04-0930.02
Expiration Date: June 22, 2008
Approval Date: April 21, 2005

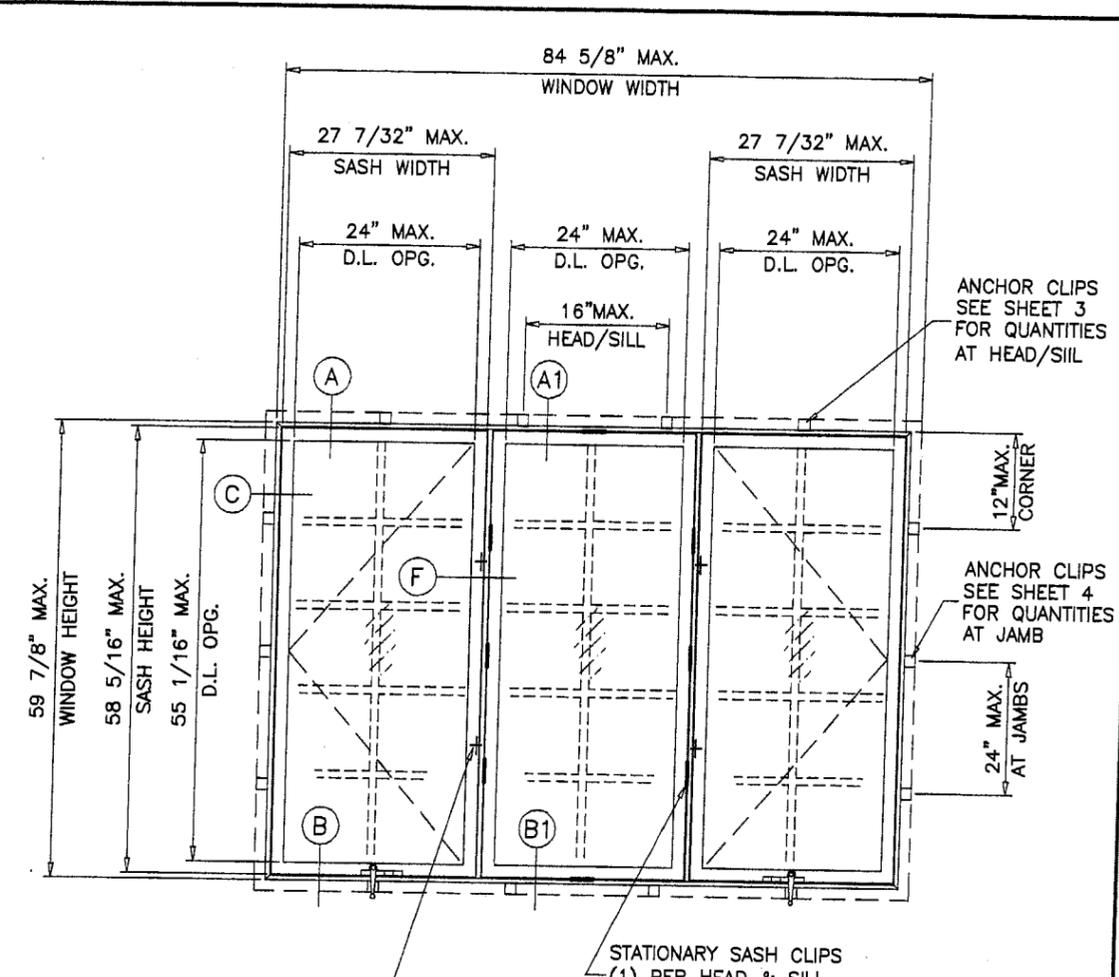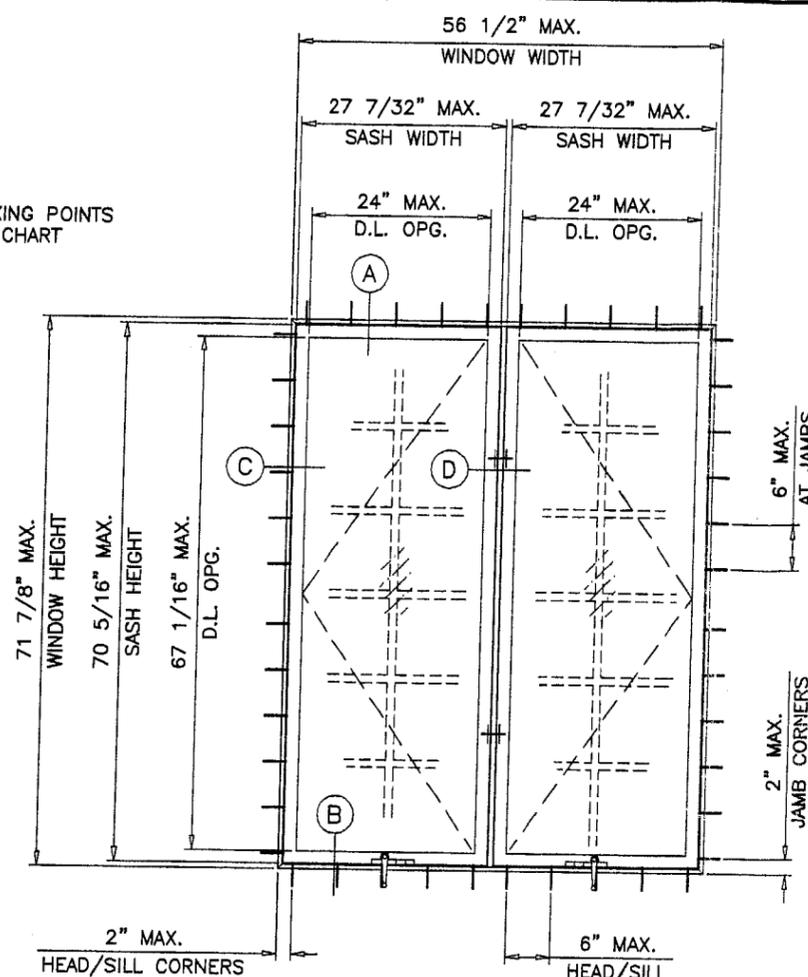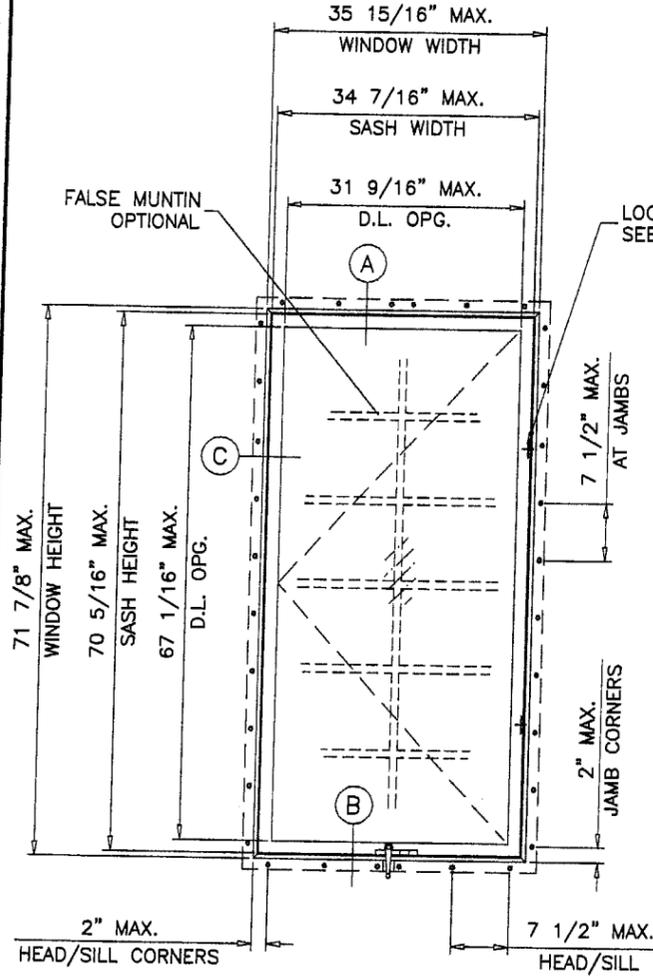

'PERMA-SHIELD' VINYL CLAD WOOD CASEMENT WINDOW

WINDOWS ARE NOT RATED FOR IMPACT, AND REQUIRE PROTECTION BY MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS.

APPROVAL APPLIES TO SINGLE, DOUBLE AND TRIPLE WINDOWS IN ANY COMBINATION OF VENTING OR STATIONARY UNITS.

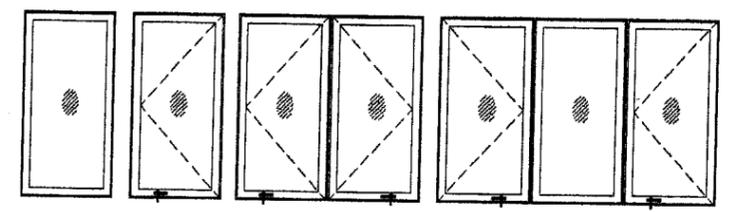


THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE.

WOOD BUCKS BY OTHERS (MIN. 2X4 GRADE 2 SYP), MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A 33% INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF ANCHORS.

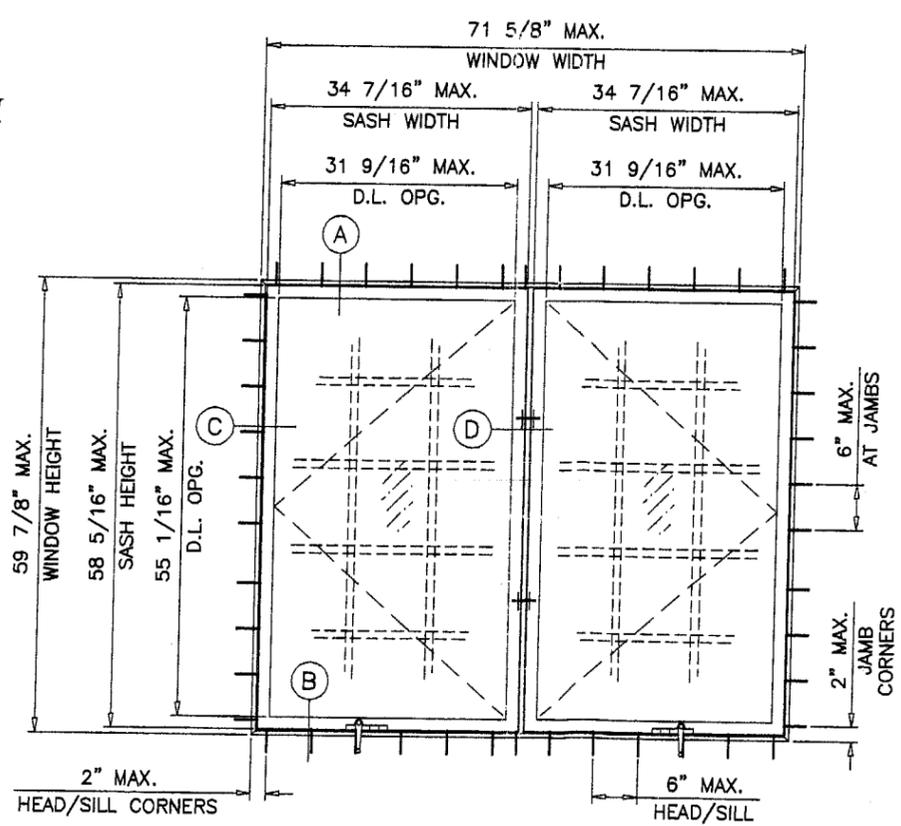

TYPICAL ELEVATIONS TESTED UNITS

WDW. HEIGHT UPTO	NO. OF KEEPERS AT SASH	NO. OF STAT. CLIPS AT STAT. JAMB
28-3/8"	1	1
40-13/16"	1	2
71-7/8"	2	3

WINDOWS CAN BE INSTALLED WITH ANY OF THE FOLLOWING OPTIONS

- OPTION 1: BY USING FASTENERS THRU INSTALLATION FLANGE AT 2" FROM CORNERS AND 7-1/2" O.C. MAX.
 - OPTION 2: BY USING FASTENERS THRU WINDOW FRAME INTO STRUCTURE AT 2" FROM CORNERS AND 6" O.C. MAX.
 - OPTION 3: BY USING FASTENERS THRU ANCHOR CLIPS AT 12" FROM CORNERS AND 24" O.C. MAX.
- SEE SHEETS 3 AND 4 FOR DETAILS.

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

AUG 23 2004

PRODUCT REVIEW
as complying with the Florida Building Code
Acceptance No. 04-0930-02
Expiration Date 06/22/08

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL\W03-72AC

ANDERSEN CORPORATION
100 FOURTH AVE. NORTH
BAYPORT, MN. 55003-1096
TEL (800) 426-7691 FAX (-)



no	date	description
A	02.28.04	CW SIZES ADDED
B	08.02.04	CW SIZES ADDED


date: 08-22-03
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:

drawing no.
W03-72
sheet 1 of 5

DESIGN LOAD CAPACITY - PSF (SINGLE UNITS) VENTING (X), STATIONARY (O)						
WINDOW DESCRIPTION	UNIT WIDTH INCHES	UNIT HT. INCHES	GLASS TYPE 'A' & 'A1'		GLASS TYPE 'B'	
			EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
CR12	17"	24-1/8"	75.0	174.2	75.0	174.2
CN12	20-1/2"		75.0	144.4	75.0	144.4
C12	24-1/8"		75.0	122.7	75.0	122.7
CW12	28-3/8"		75.0	104.3	75.0	104.3
CR125	17"	28-3/8"	75.0	185.1	75.0	185.1
CN125	20-1/2"		75.0	153.5	75.0	153.5
C125	24-1/8"		75.0	130.4	75.0	130.4
CW125	28-3/8"		75.0	110.9	75.0	110.9
CR13	17"	35-15/16"	75.0	150.5	75.0	175.4
CN13	20-1/2"		75.0	117.2	75.0	145.4
C13	24-1/8"		75.0	104.4	75.0	123.6
CW13	28-3/8"		75.0	101.3	75.0	105.1
CXW13	35-15/16"		75.0	81.7	75.0	83.0
CR135	17"	40-13/16"	75.0	136.3	75.0	154.4
CN135	20-1/2"		75.0	99.2	75.0	128.1
C135	24-1/8"		75.0	90.4	75.0	108.8
CW135	28-3/8"		75.0	82.8	75.0	92.5
CXW135	35-15/16"		50.0	72.7	50.0	73.0
CR14	17"	48"	75.0	125.8	75.0	153.2
CN14	20-1/2"		75.0	87.3	75.0	127.0
C14	24-1/8"		70.6	70.6	70.6	107.9
CW14	28-3/8"		69.7	69.7	69.7	91.8
CXW14	35-15/16"		50.0	61.6	50.0	72.5
CR145	17"	52-13/16"	75.0	123.7	75.0	144.4
CN145	20-1/2"		75.0	80.5	75.0	119.7
C145	24-1/8"		63.5	63.5	63.5	101.7
CW145	28-3/8"		50.0	57.4	50.0	86.5
CXW145	35-15/16"		50.0	55.4	50.0	68.3
CR15	17"	59-7/8"	75.0	117.0	75.0	127.3
CN15	20-1/2"		72.4	72.4	75.0	105.6
C15	24-1/8"		55.1	55.1	74.9	89.7
CW15	28-3/8"		50.0	50.2	50.0	76.3
CXW15	35-15/16"		48.4	48.4	50.0	60.2
CR155	17"	64-13/16"	75.0	116.5	75.0	117.6
CN155	20-1/2"		68.0	72.2	68.0	97.5
C155	24-1/8"		50.0	51.8	50.0	82.9
CW155	28-3/8"		43.0	43.0	50.0	70.5
CXW155	35-15/16"	44.5	44.5	50.0	55.6	
CR16	17"	71-7/8"	59.0	93.6	59.0	98.2
CN16	20-1/2"		50.0	70.4	50.0	82.2
C16	24-1/8"		47.9	47.9	50.0	70.8
CW16	28-3/8"		38.7	38.7	50.0	61.3
CXW16	35-15/16"		37.4	37.4	50.0	50.2

DESIGN LOAD CAPACITY - PSF (DOUBLE UNITS) XX, OX, XO OR OO						
WINDOW DESCRIPTION	UNIT WIDTH INCHES	UNIT HT. INCHES	GLASS TYPE 'A' & 'A1'		GLASS TYPE 'B'	
			EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
CR23	33-3/4"	35-15/16"	65.0	119.2	65.0	119.2
CN23	40-3/4"		65.0	114.0	65.0	114.0
C23	48"		65.0	104.2	65.0	108.6
CW23	56-1/2"		65.0	100.0	65.0	100.0
CXW23	71-5/8"		68.9	68.9	68.9	68.9
CR235	33-3/4"	40-13/16"	65.0	107.4	65.0	107.4
CN235	40-3/4"		65.0	98.5	65.0	103.1
C235	48"		65.0	90.0	65.0	98.6
CW235	56-1/2"		50.0	82.8	50.0	88.1
CXW235	71-5/8"		59.2	59.2	59.2	59.2
CR24	33-3/4"	48"	65.0	93.7	65.0	93.7
CN24	40-3/4"		65.0	86.6	65.0	90.4
C24	48"		65.0	70.2	65.0	86.8
CW24	56-1/2"		50.0	69.7	50.0	74.9
CXW24	71-5/8"		51.6	51.6	51.6	51.6
CR245	33-3/4"	52-13/16"	65.0	86.4	65.0	86.4
CN245	40-3/4"		55.1	77.6	55.1	83.5
C245	48"		50.0	63.2	50.0	80.1
CW245	56-1/2"		50.0	57.4	50.0	68.0
CXW245	71-5/8"		47.0	47.0	47.0	47.0
CR25	33-3/4"	59-7/8"	50.0	77.4	50.0	77.4
CN25	40-3/4"		50.0	71.5	50.0	75.1
C25	48"		50.0	54.7	50.0	70.6
CW25	56-1/2"		50.0	50.2	50.0	60.0
CXW25	71-5/8"		41.0	41.0	41.0	41.0
CR255	33-3/4"	64-13/16"	50.0	72.2	50.0	72.2
CN255	40-3/4"		50.0	70.1	50.0	70.1
C255	48"		50.0	51.5	50.0	65.3
CW255	56-1/2"		42.8	42.8	50.0	55.4
CR26	33-3/4"	71-7/8"	50.0	65.9	50.0	65.9
CN26	40-3/4"		50.0	64.1	50.0	64.1
C26	48"		47.5	47.5	50.0	57.8
CW26	56-1/2"		38.5	38.5	50.0	50.0

DESIGN LOAD CAPACITY - PSF (TRIPLE UNITS) XOX, OOX, XOO, OOO OR XXX						
WINDOW DESCRIPTION	UNIT WIDTH INCHES	UNIT HT. INCHES	GLASS TYPE 'A' & 'A1'		GLASS TYPE 'B'	
			EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
C33	71-7/8"	35-15/16"	45.0	75.1	45.0	75.1
C335	71-7/8"	40-13/16"	45.0	66.2	45.0	66.2
C34	71-7/8"	48"	45.0	56.2	45.0	56.2
C345	71-7/8"	52-13/16"	45.0	51.1	45.0	51.1
C35	71-7/8"	59-7/8"	45.0	45.1	45.0	45.1
CW33	84-5/8"	35-15/16"	40.0	40.0	40.0	40.0
CW335	84-5/8"	40-13/16"	40.0	40.0	40.0	40.0
CW34	84-5/8"	48"	40.0	40.0	40.0	40.0
CW345	84-5/8"	52-13/16"	40.0	40.0	40.0	40.0
CW35	84-5/8"	59-7/8"	40.0	40.0	40.0	40.0

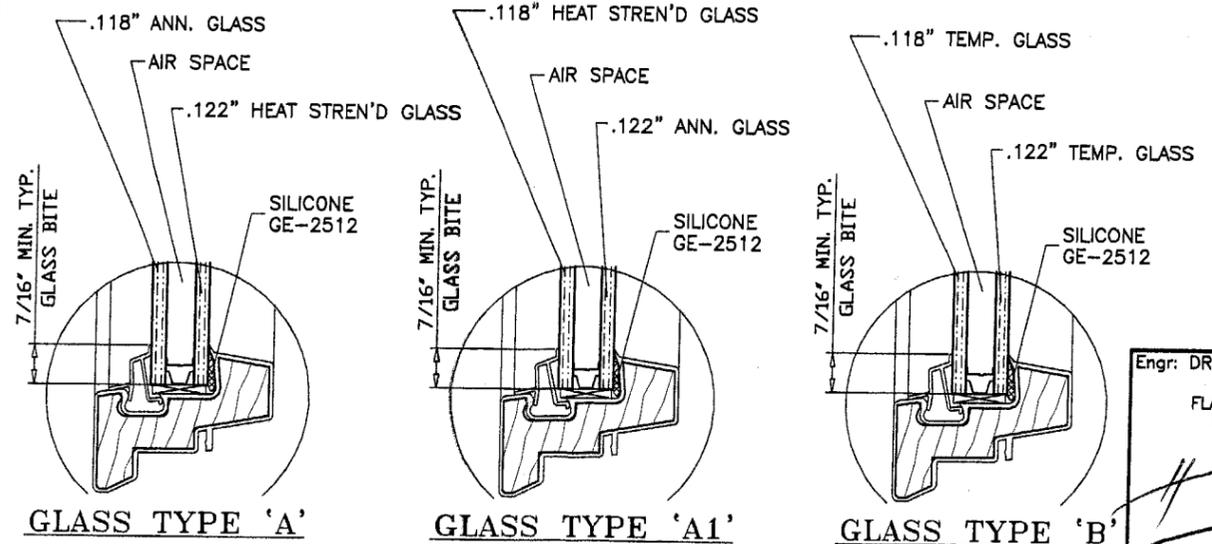

GLAZING OPTIONS

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 04-0930.02
Expiration Date 06/22/08
M. H. H. H.
Miami State Product Control
Division

Engr: DR. HUMAYOON FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

AUG 23 2004

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

PERMA-SHIELD VINYL CLAD WD. CASEMENT WDW.
ANDERSEN CORPORATION
100 FOURTH AVE. NORTH
BAYPORT, MN. 55003-1096
TEL. (800) 426-7891 FAX (-)






revisions:	no.	date	by	description
A	02.28.04			CW SIZES ADDED
B	08.02.04			CW SIZES ADDED

date: 08-22-03
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W03-72

sheet 2 of 5


COMP-ANL\W03-72AC

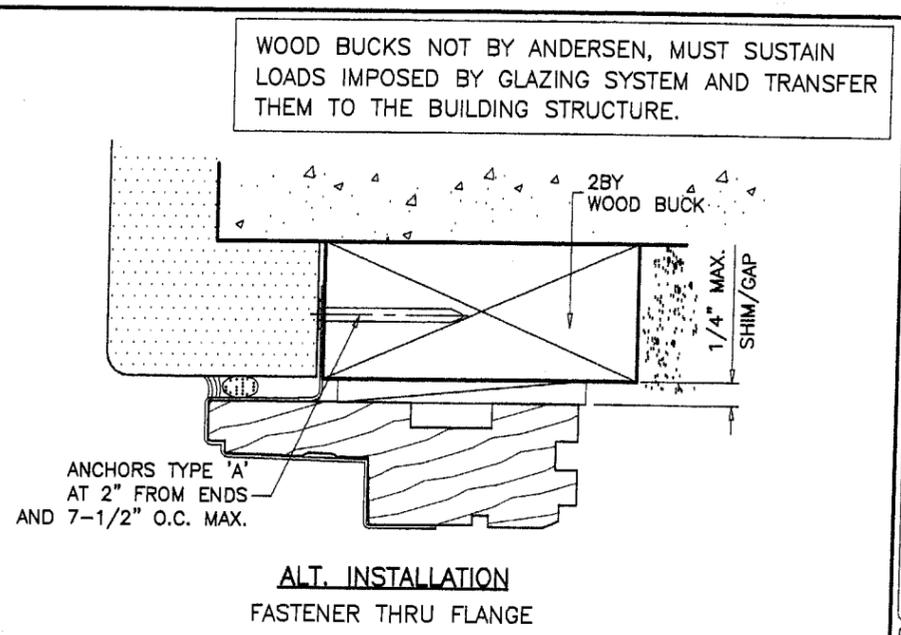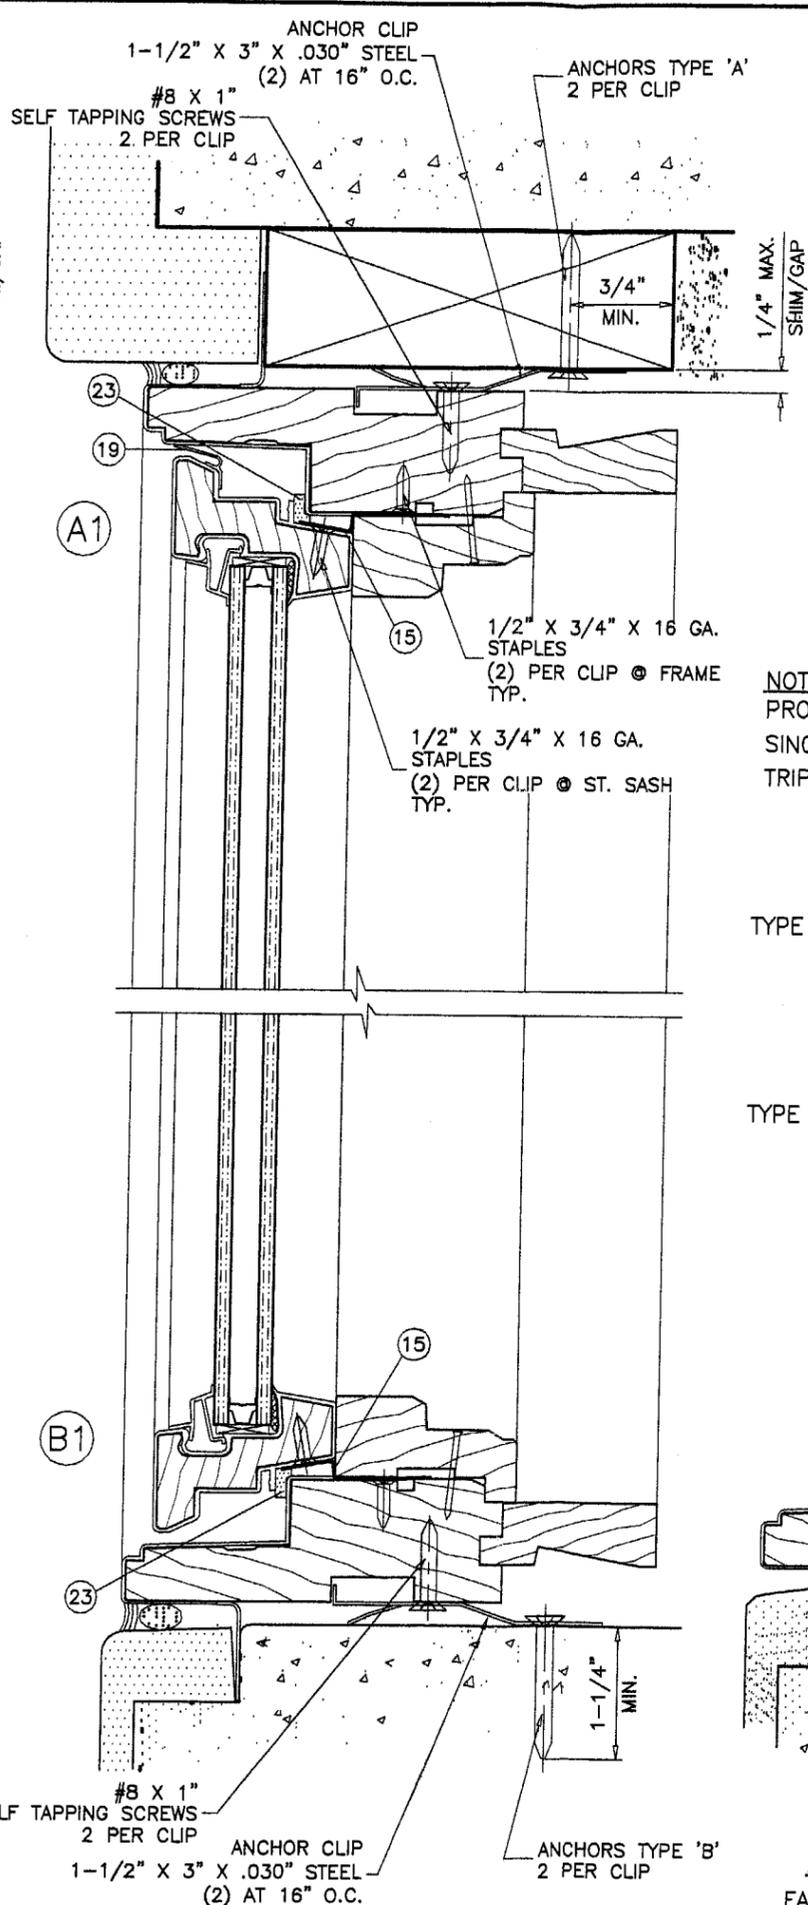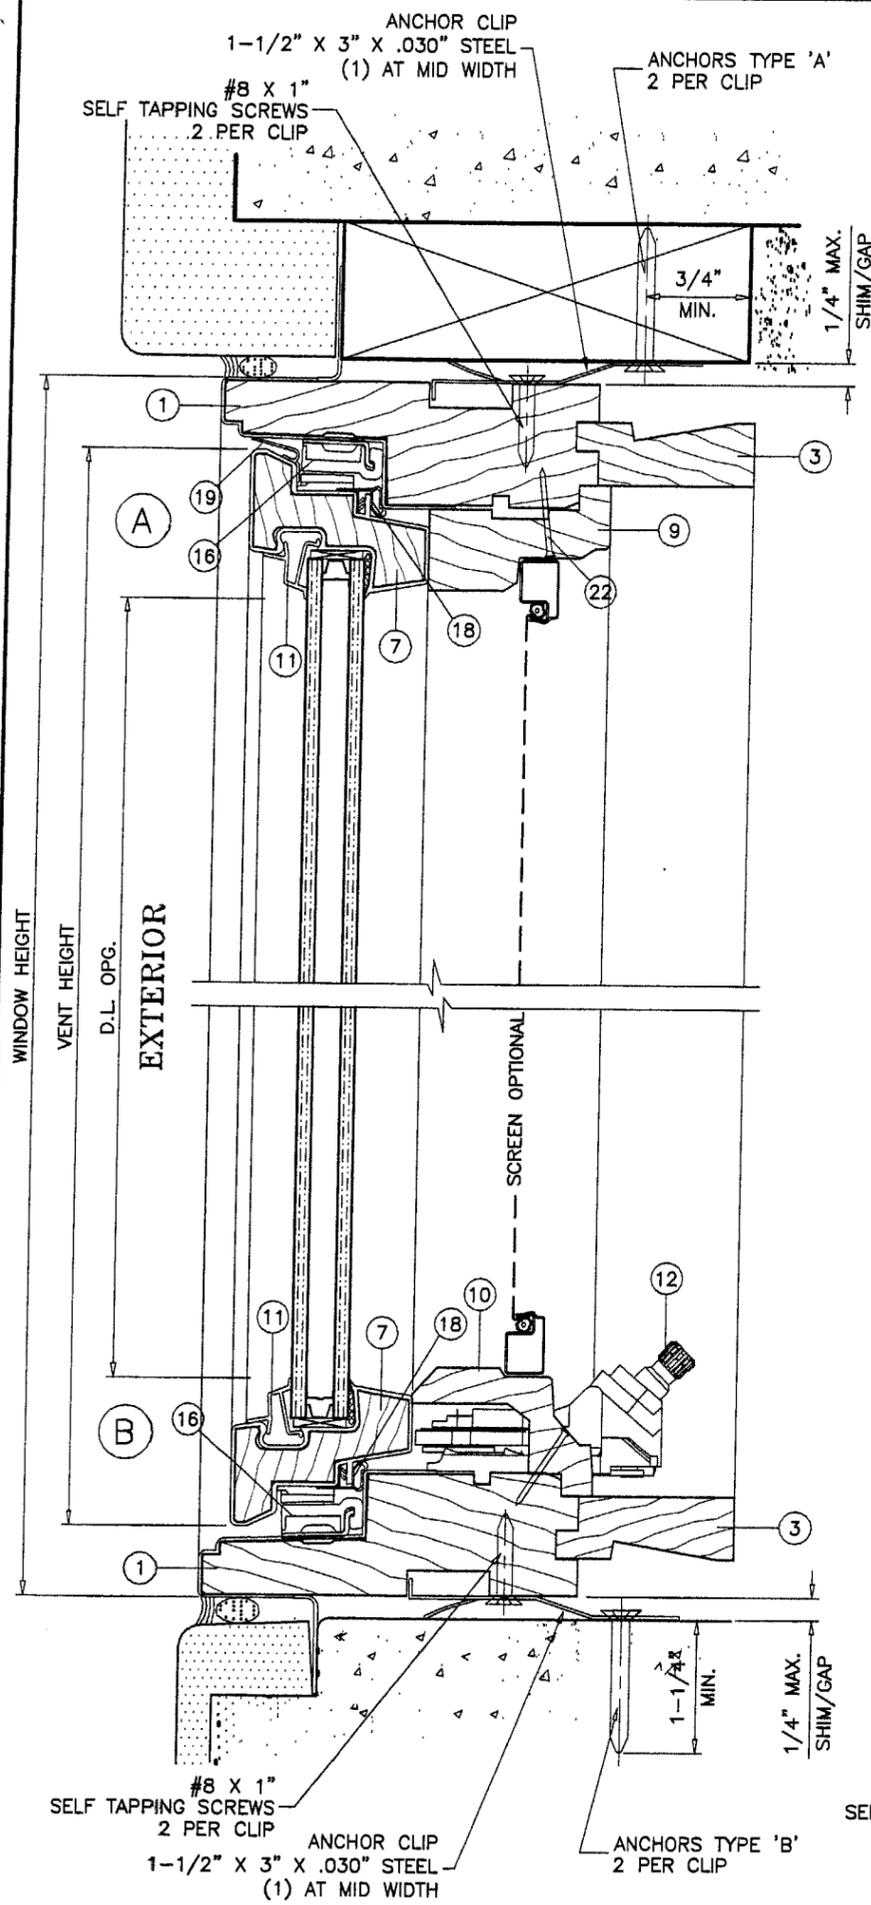

NOTE:
 PROVIDE ANCHOR CLIPS AT HEAD & SILL AS FOLLOWS
 SINGLE AND DOUBLE UNITS: (1) AT CENTER OF EACH SASH
 TRIPLE UNITS: (1) AT CENTER OF END SASH
 (2) AT MIDDLE SASH SEE ELEV.

ANCHOR OPTIONS:
 TYPE 'A' - #8 SMS
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURE
 1-1/2" MIN. PENETRATION INTO WOOD
 ROOFING NAILS, 11GA. X 1-3/4" LONG
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURE
 TYPE 'B' - 3/16" Ø TAPCONS (BY ELCO) OR
 EQUIVALENT CONCRETE ANCHOR
 THRU 1BY WOOD BUCKS INTO MASONRY OR DIRECTLY INTO MASONRY
 1-1/4" MIN. MASONRY EMBED.

LOCKING OPTIONS:
 SURFACE MOUNTED LOCK WITH KEEPERS ON SASH BY AMEROCK CORP.
 (1) POINT LOCK FOR WINDOWS UPTO 28-3/8" HEIGHTS.
 (2) POINT LOCK FOR ALL BIGGER HEIGHTS.

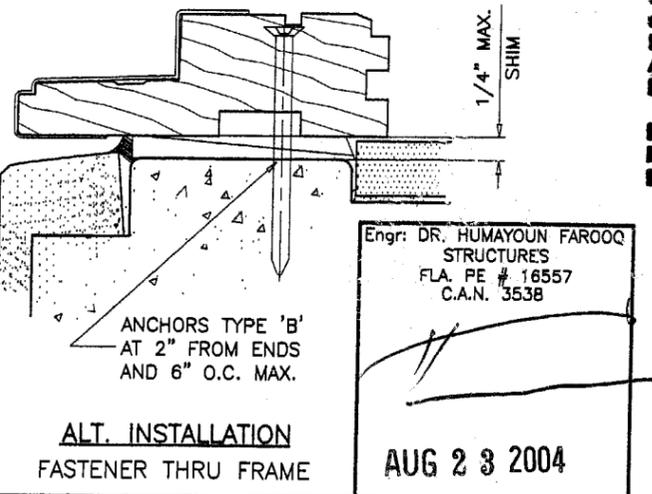

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538
 AUG 23 2004

AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-6978
 COMP-ANL\W03-72AC

ANDERSEN CORPORATION
 100 FOURTH AVE. NORTH
 BAYPORT, MN. 55003-1096
 TEL (800) 426-7691 FAX (-)


no	date	description
A	02.28.04	NO CHANGE THIS SHEET
B	08.02.04	NO CHANGE THIS SHEET

date: 08-22-03
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:


drawing no.
W03-72
 sheet 3 of 5

WDW. HEIGHT UPTO	NO. OF ANCHOR CLIPS AT EACH JAMB
52-13/16"	2
71-7/8"	3

ANCHOR CLIPS EQUALLY SPACED AT JAMBS
1-1/2" X 3" X .030" STEEL
SEE TABLE ABOVE FOR QUANTITIES

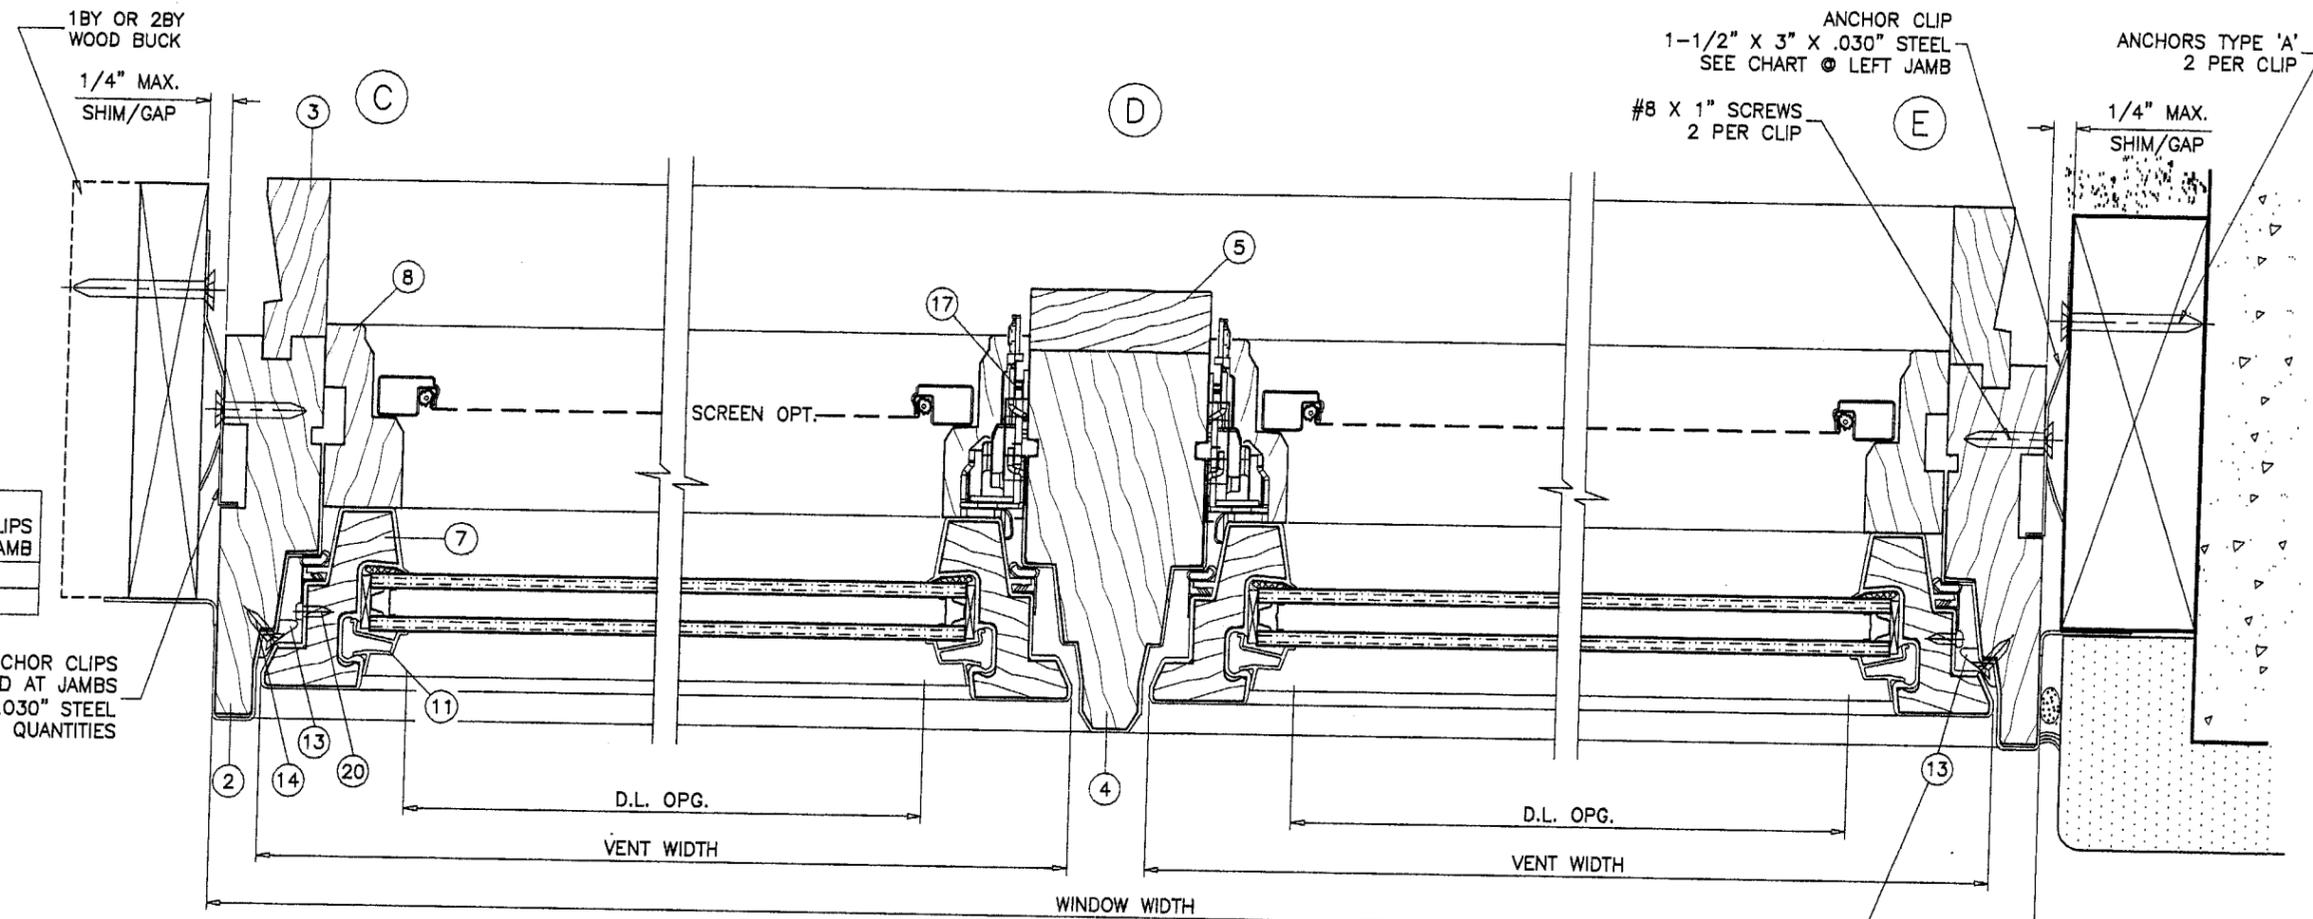


EXTERIOR

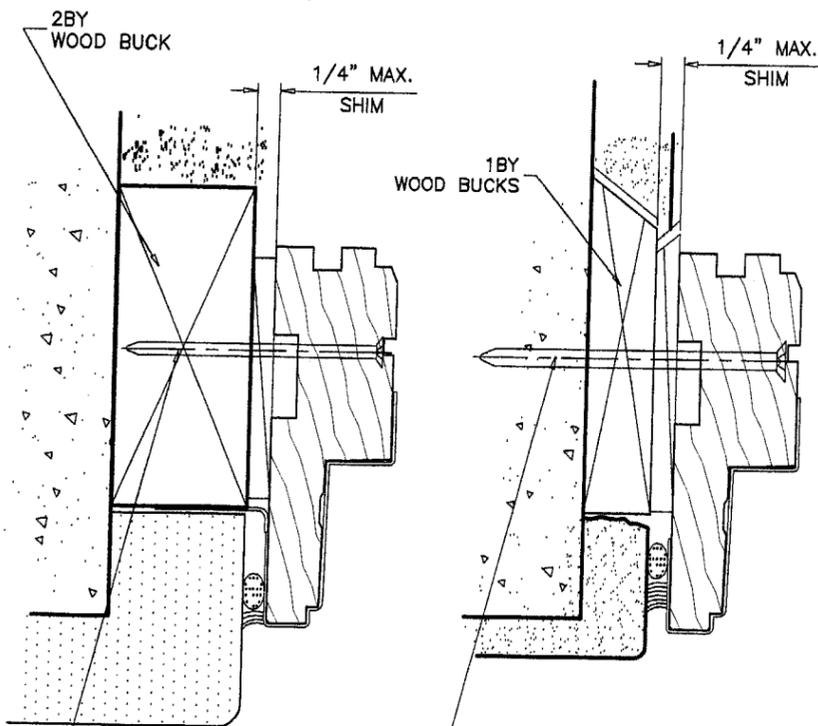


ANCHORS TYPE 'A'
AT 2" FROM ENDS
AND 6" O.C. MAX.

ALT. INSTALLATION
FASTENER THRU FRAME

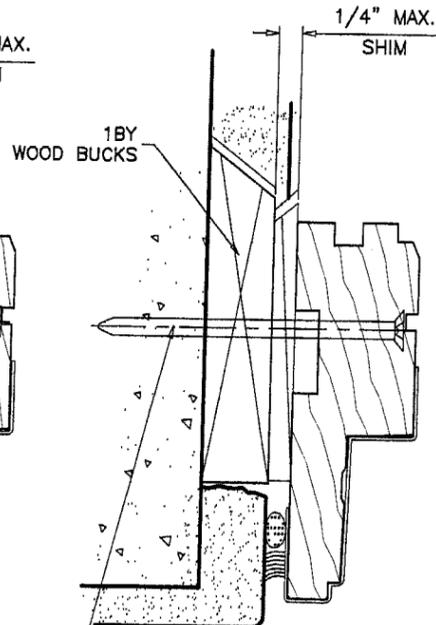

ANCHORS TYPE 'B'
AT 2" FROM ENDS
AND 6" O.C. MAX.

ALT. INSTALLATION
FASTENER THRU FRAME

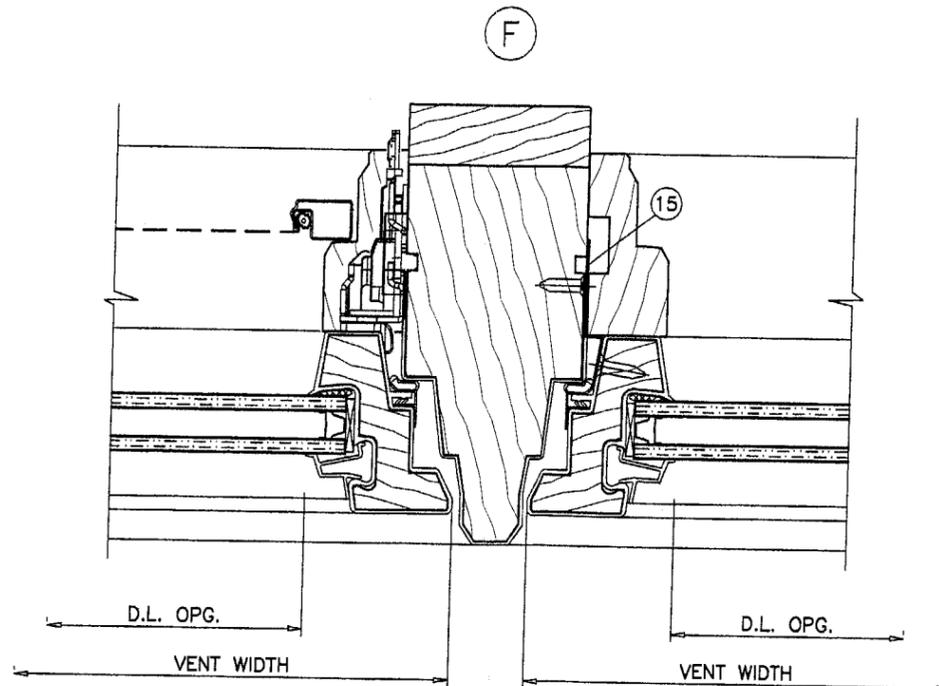

SASH SIZES	NO. OF SNUGGER BRACKETS AT HINGE JAMB
SIZES UPTO 23" X 51-1/4"	1 AT MIDSPAN
ALL OTHER SIZES	2 AT 20" FROM TOP & BOTTOM

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 04-0930.02
Expiration Date 06/22/08
By *[Signature]*
Miami State Product Control
Division

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

AUG 23 2004

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W03-72AC

ANDERSEN CORPORATION
100 FOURTH AVE. NORTH
BAYPORT, MN. 55003-1096
TEL. (800) 426-7691 FAX (-)




revisions:

no	date	by	description
A	02.28.04		NO CHANGE THIS SHEET
B	08.02.04		NO CHANGE THIS SHEET


date: 08-22-03
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W03-72
sheet 4 of 5

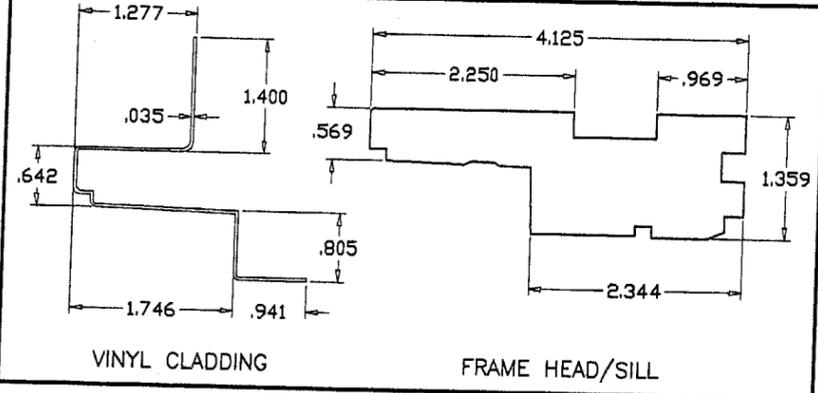


VINYL CLADDING

FRAME HEAD/SILL

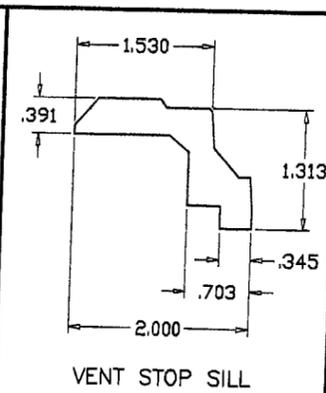


VENT STOP SILL

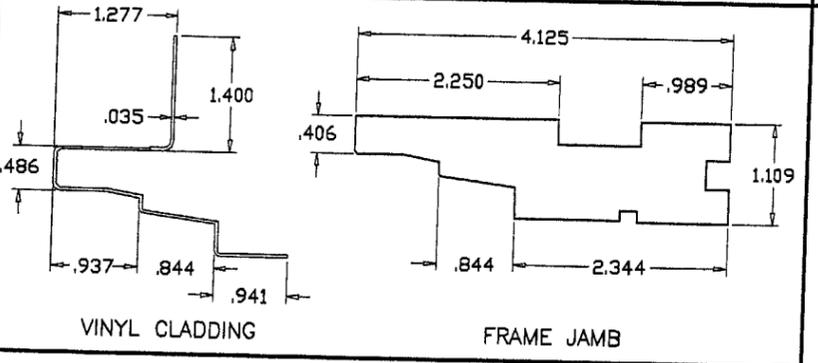


VINYL CLADDING

FRAME JAMB

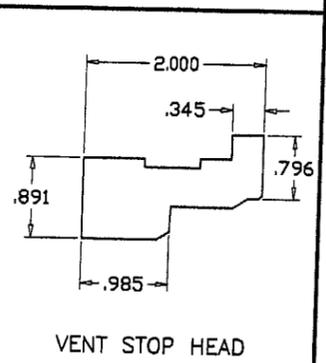


VENT STOP HEAD

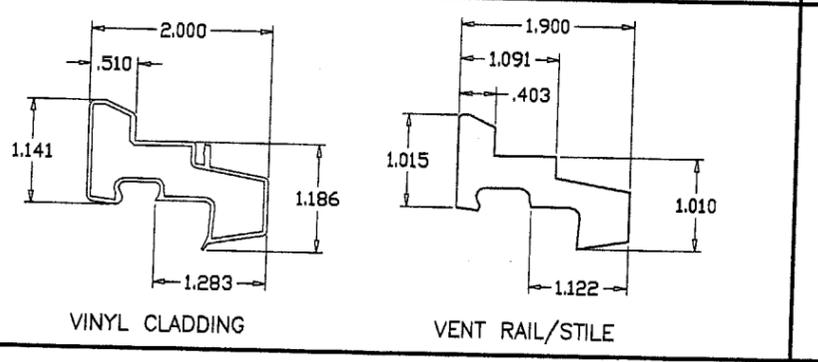


VINYL CLADDING

VENT RAIL/STILE

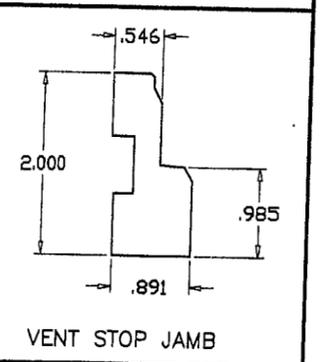


VENT STOP JAMB

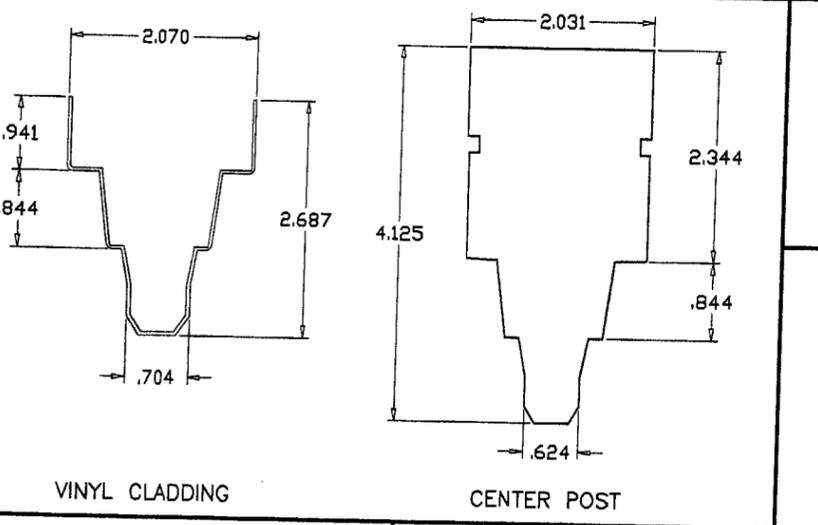


VINYL CLADDING


CENTER POST

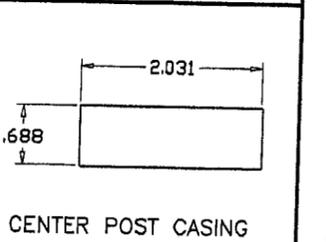


CENTER POST CASING

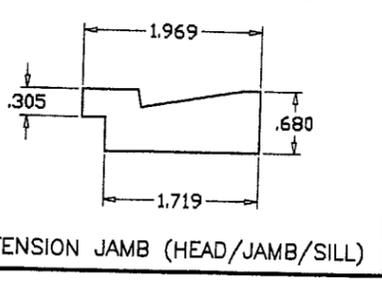

EXTENSION JAMB (HEAD/JAMB/SILL)

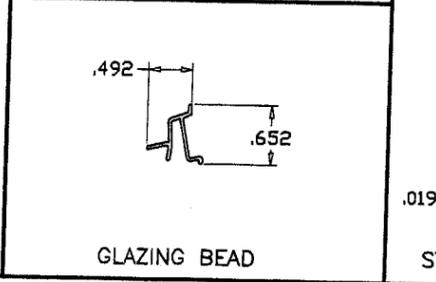

GLAZING BEAD

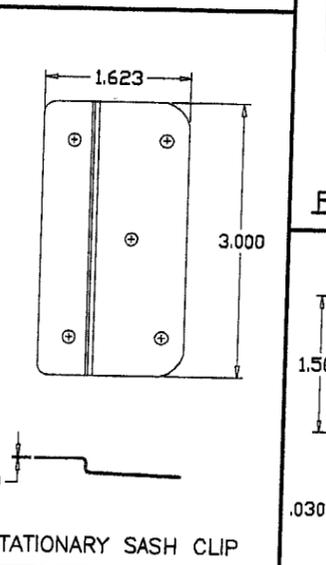


STATIONARY SASH CLIP

COPE CORNERS WITH 3 STAPLES PER CORNER (1-1/2" X 2" X 16 GA.)


ALL WOOD TO BE PONDEROSA PINE OR EQUAL

VINYL CLADDING CORNERS MITER CUT WELDED ALL AROUND

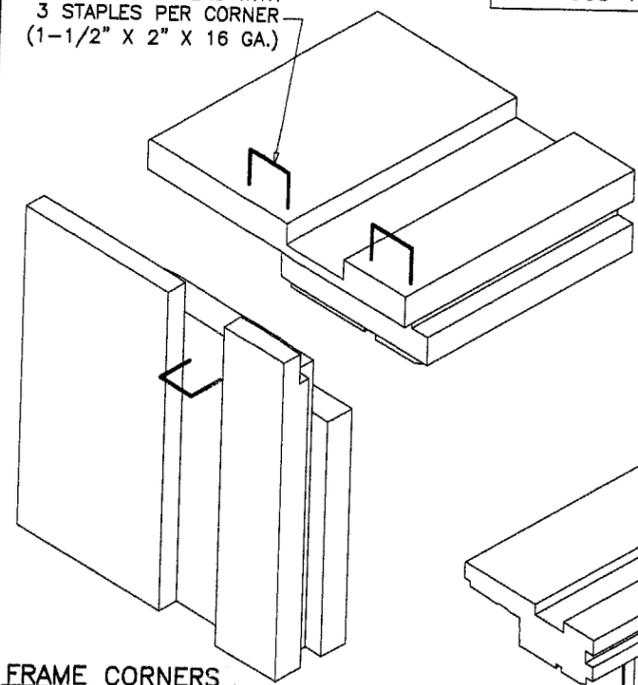


FRAME CORNERS

COPE CORNERS WITH 3 STAPLES PER CORNER (1-1/2" X 2" X 16 GA.)

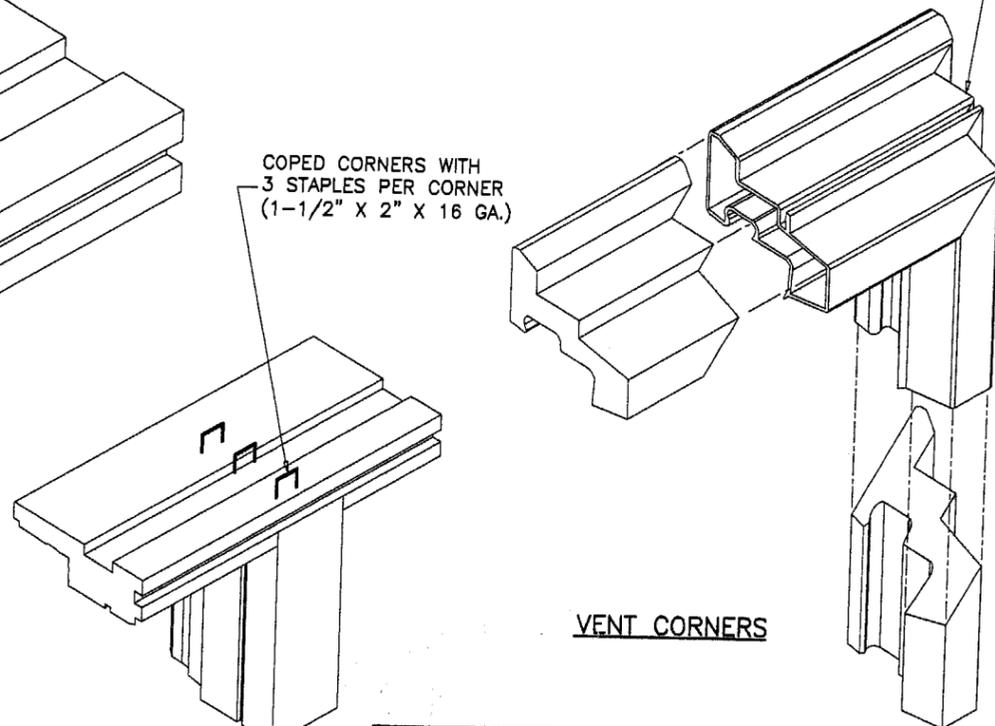

VENT CORNERS

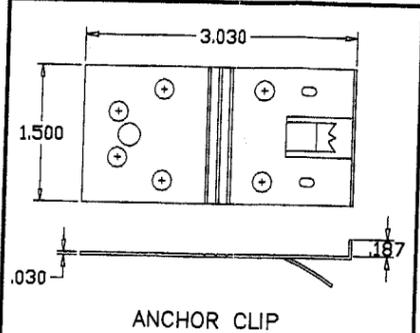

ANCHOR CLIP

ITEM #	NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	30835	AS REQD.	FRAME HEAD/SILL	WOOD	ANDERSEN
2	30838	AS REQD.	FRAME JAMB	WOOD	ANDERSEN
3	-	OPTIONAL	EXTENSION JAMBS	WOOD	ANDERSEN
4	30839	1	POST MULLION	WOOD	ANDERSEN
5	30056	1	CASING MULLION	-	-
6	-	-	-	-	-
7	30013	4/ SASH	SASH RAIL/STILE	WOOD	ANDERSEN
8	-	2/ WDW.	VENT STOP JAMB	WOOD	ANDERSEN
9	30846/48	1/ WDW.	VENT STOP HEAD	WOOD	ANDERSEN
10	30843/45	1/ WDW.	VENT STOP SILL	WOOD	ANDERSEN
11	30184	AS REQD.	GLAZING BEAD	PVC	-
12	30810/12	1/ SASH	ROTO OPERATOR	STEEL	AMEROCK CORP.
13	30241	AS REQD.	SNUGGER BRACKET	POLYCARBONATE	SEE SHEET 4 FOR QUANTITIES
14	#8 X 1/2"	AS REQD.	SNUGGER SCREWS	-	-
15	30053	-	STATIONARY SASH CLIP	GALV. STEEL	-
16	1361409	2/ SASH	HINGE ASEMBLY AT TOP & BOTTOM OF SASH	STEEL	AMEROCK CORP.
17	-	AS REQD.	LOCK W/ KEEPERS ON SASH	STEEL	AMEROCK CORP.
18	30213	AS REQD.	WEATHERSTRIP STILE	-	-
19	30021	AS REQD.	WATERBAR WEATHERSTRIP	-	-
20	30240	AS REQD.	SNUGGER PIN	-	-
21	-	-	-	-	-
22	-	AS REQD.	BRAD NAILS 1-1/2" LONG	GALV. STEEL	-
23	30172	-	FOAM WEATHERSTRIPPING	-	-

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

AUG 23 2004

PRODUCT REVISED
to comply with the Florida
Building Code
Acceptance No. 04-0930-02
Expiration Date 04/22/08

By
Miami Bank Product Control
Division

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

ANDERSEN CORPORATION
100 FOURTH AVE. NORTH
BAYPORT, MN. 55003-1096
TEL (800) 426-7691 FAX (-)

PERMA-SHIELD VINYL CLAD WD. CASEMENT WDW.

NO.	DATE	DESCRIPTION
A	02.28.04	NO CHANGE THIS SHEET
B	08.02.04	NO CHANGE THIS SHEET

revisions:

date: 08-22-03
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W03-72

sheet 5 of 5