



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908
www.buildingcodeonline.com**

NOTICE OF ACCEPTANCE (NOA)

**Jeld-Wen, Inc.
31725 Highway 97 North
Chiloquin, OR 97624**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Jeld-Wen Series "Premium Wood Doors" Inswing Glazed Wood Doors w/ wo Surface bolts at active panels

APPROVAL DOCUMENT: Drawing No. S-2040, titled "Wood stile & rail door, opaque 6-8/8-0 Inswing Double Doors" Sheets 1 through 7 of 7, prepared by manufacture, dated 07/24/00 and last revised on 08/22/05 (sheet 1 revised on 09/06/05) signed and sealed by James J. Dobrowski, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None: Approved Hurricane Protection devices, complying with FBC, as applicable, are required

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises and renews NOA # 02-0722.06 and, consists of this page 1 and evidence pages E-1 & E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P. E.**

**NOA No 04-1025.06
Expiration Date: September 20, 2010
Approval Date: September 22, 2005
Page 1**



Jf
9/22/05

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

- F. **STATEMENTS: Continue** (transferred from files #02-0722.07/ #01-0206.26)
4. Statement letter of compliance, as part of test reports No. CTLA572WA, and 570WB dated July 22, 2000 and dated July 19, 2000 respectively, issued by Certified Testing Laboratories, signed and sealed by Ramesh Patel, P.E
 5. Letter of explanation dated May 22, 2001, issued by Certified Testing Laboratories for test reports CTLA-570 W, CTLA-570 WB, CTLA-570 WB and CTLA-572 WA, signed by Jim Blakely.
 6. Letter of explanation dated May 23, 2001, issued by Ramesh Patel, P. E., witnessing engineer Certified Testing Laboratories for test reports CTLA-570 W, CTLA-570 WB, CTLA-570 WB and CTLA-572 WA, signed and sealed by Ramesh Patel, P. E.
 7. Letter of clarification for laboratory data, issued by Certified Testing Laboratories , signed by Christopher Bennett (Lab Manager) for test reports CTLA-570 W, CTLA-570 WB, CTLA-570 WB and CTLA-572 WA, signed and sealed by Ramesh Patel, P. E. (witnessing engineer).
 8. Addendum letter dated July 17, 2001 and August 02, 2001, issued by Certified Testing laboratory, Ramesh Patel, P. E. (witnessing engineer).
 9. Statement letter dated July 15, 2002, issued by Jeld-Wen for the extent of revision to the approved NOA# 01-0206.28, signed by Steve Frey.
- G. **OTHER**
1. This NOA **revises/renews** # 02-0722.06, expired on September 04, 2004.
 2. Addendum letter dated July 12, 2005, issued by Certified Testing Lab, clarifying in-swing bolts installation for test reports # CTLA572W, CTLA570W & CTLA572WA.
 3. Jeld-Wen proposal letter dated May 09, 2002 and BCCO response dated 05-18-02
 4. Revised test reports CTLA-570 W, CTLA 570WA, CTLA-570 WB, CTLA-570 WC and CTLA-572 WA, issued by Certified Testing Laboratories, signed and sealed by Ramesh Patel, P. E.
 5. Faxed Laboratory Worksheet data, dated July 05, 2001 supplied by the Certified Testing Laboratories and the Lab notes provided thru manufacturer, for test reports CTLA-570 W, CTLA-570 WA, CTLA-570 WB CTLA-570 WC and CTLA-572 WA.
 6. Various letter of explanations and addendum letter referenced above.
 7. Manufacturing plant address of Jeld-Wen series "Nord / Morgan".
 8. Glazing complies with ASTM E-1300-98.

Ishaq I. Chanda

Ishaq I. Chanda, P. E.
Product Control Examiner
NOA No 04-1025.06
Expiration Date: September 20, 2010
Approval Date: September 22, 2005

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

- A. DRAWINGS** (transferred from files #02-0722.06/#01-0206.26)
1. Manufacturer's die drawings and sections.
 2. Drawing No. **S-2040**, titled "Wood stile & rail door, opaque 6-8/8-0 Inswing Double Doors" Sheets 1 through 7 of 7, prepared by manufacture, dated 07/24/00 and last revised on 08/22/05 (sheet 1 revised on 09/06/05) signed and sealed by James J. Dobrowski, P.E.
- B. TESTS** (transferred from files #02-0722.06 / #01-0206.26) Test conducted per SFBC, PA202-94, now termed as FBC, TAS 202-94
1. Test reports on 1) Air Infiltration Test, per PA 202-94
2) Uniform Static Air Pressure Test, Loading per PA 202-94
3) Water Resistance Test, per PA 202-94 (Not Performed)
4) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94
- Along with marked-up drawings and installation diagram of double glazed outswing/Inswing wood doors, prepared by Certified Testing Laboratories, Test Report No. **CTLA572WA**, and **CTLA 572WC** both dated July 17 & 18, 2000 and revised dated May 04, 2001, signed and sealed by Ramesh Patel, P.E.
2. Additional structural test reports No. **CTLA-701W** along with marked-up drawings and installation diagram of fixed 18 lite glazed wood doors, prepared by Certified Testing Laboratories, dated June 08, 2001, signed and sealed by Ramesh Patel, P.E.
- Note: The above test reports have been revised by addendum letter dated July 12, 2005, issued by Certified Testing Laboratories.
- C. CALCULATIONS** (transferred from file #02-0722.06/#01-0206.26)
1. Wood strength referenced properties data from, "Wood Handbook" and table prepared by manufacturer
 2. Anchor verification calculations, dated 8-24-00, prepared, signed and sealed by Mark Fetherman, P.E.
- D. QUALITY ASSURANCE**
1. Miami Dade Building Code Compliance Office (BCCO).
- E. MATERIAL CERTIFICATIONS**
1. None
- F. STATEMENTS** (transferred from files #02-0722.07)
1. Addendum letter dated July 12, 2005, issued by Certified Testing Lab, clarifying in-swing bolts installation for test reports # **CTLA572W**, **CTLA570W** & **CTLA572WA**.
 2. Statement letter of conformance, "No financial interest" and manufacturing remains the same as original dated July 24, 2000, signed & sealed by James J. Dobrowski, P.E.
 3. Statement letter of conformance and "No financial interest" dated July 24, 2000, signed and sealed by Mark C. Fetherman, P.E. (file #02-0722.07)

Ishaq I. Chanda

Ishaq I. Chanda, P. E.

Product Control Examiner

NOA No 04-1025.06

Expiration Date: September 20, 2010

Approval Date: September 22, 2005

JELD-WEN®
PREMIUM WOOD DOORS
6-8 AND 8-0 GLAZED INSWING
SINGLE AND DOUBLE DOORS

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE FLORIDA BUILDING CODE 2001 INCLUDING "HVHZ". INSTALLATION OF THIS SYSTEM IN "HVHZ" AREA REQUIRES THE USE OF APPROVED SHUTTER/EXTERNAL PROTECTION DEVICE, COMPLYING WITH "HVHZ" REQUIREMENTS. INSTALLATION OF THIS SYSTEM OUTSIDE OF "HVHZ", SHALL MEET THE APPLICABLE CODE REQUIREMENTS FOR WINDBORNE DEBRIS PROTECTION.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS PER DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. FOR DESIGNED PRESSURE RATING SEE TABLE 1, PAGE 1.

Frame Construction: The head and side jambs are finger jointed ponderosa pine measuring 4.56" X 1.25". The head and side jambs are mortised, butted and joined using (3) 16GA. 2" X 1/2" crown staples at the top corners. The bump threshold is attached to the floor.





Door Panel Construction: The panel is a stile and rail construction. The stiles and rails are constructed from solid wood of either Douglas Fir or Western Hemlock. They are laminated with a .0625" thk. wood veneer of the following species: (See BOM Item #1 for species). The veneer face sheet is glued to the stiles and rails. The top rail is connected to the perimeter stiles w/ (2) 1/2" dia. x 4" long wooden dowels and the bottom rail is connected to the perimeter stile w/ (3) 1/2" dia. x 4" long wooden dowels. The glazing is captured between the wood cap on the exterior and the wood glass stop on the interior. The panels are wet glazed using PRC 365 silicone.

TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	COMMON (GENERAL NOTES, TYPICAL ELEVATION)
2	VERTICAL CROSS SECTION & B.O.M.
3	HORIZONTAL CROSS SECTIONS
4	ANCHORING LOCATIONS & DETAILS
5	DOOR RAIL DETAILS
6	FRAME COMPONENTS
7	DOOR MODELS

NOTE 1

THE SURFACE BOLTS ARE AN OPTION ON THE ACTIVE DOOR WHEN USING THE WOOD ASTRAGAL. THEY ARE USED TO ACHIEVE A HIGHER PRESSURE RATING. ALL INACTIVE DOORS HAVE SURFACE BOLTS. SEE SHEET 3 FOR SURFACE BOLT OPTIONS.

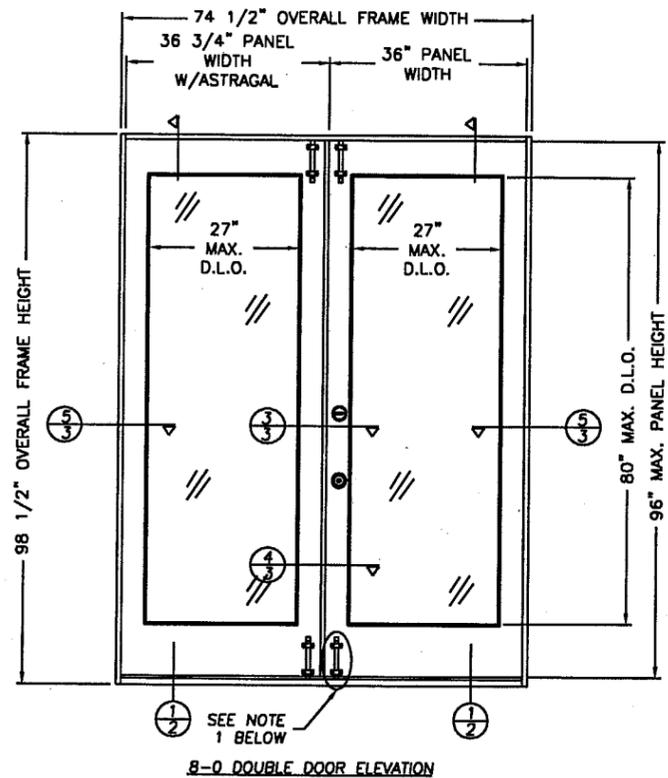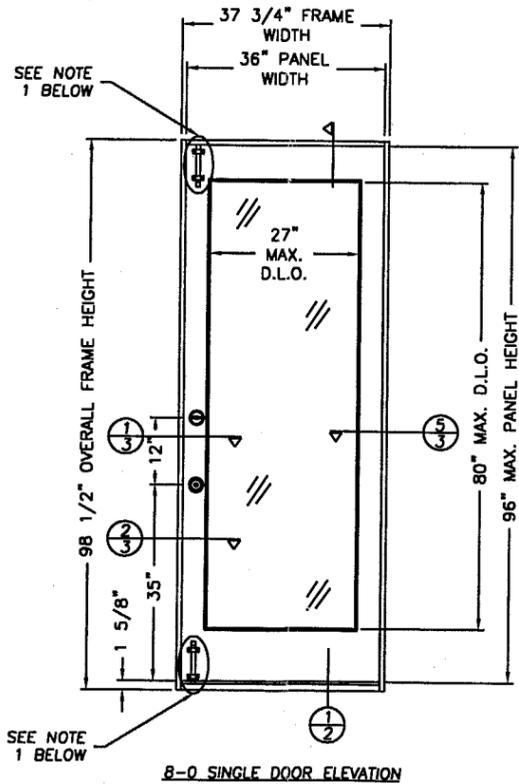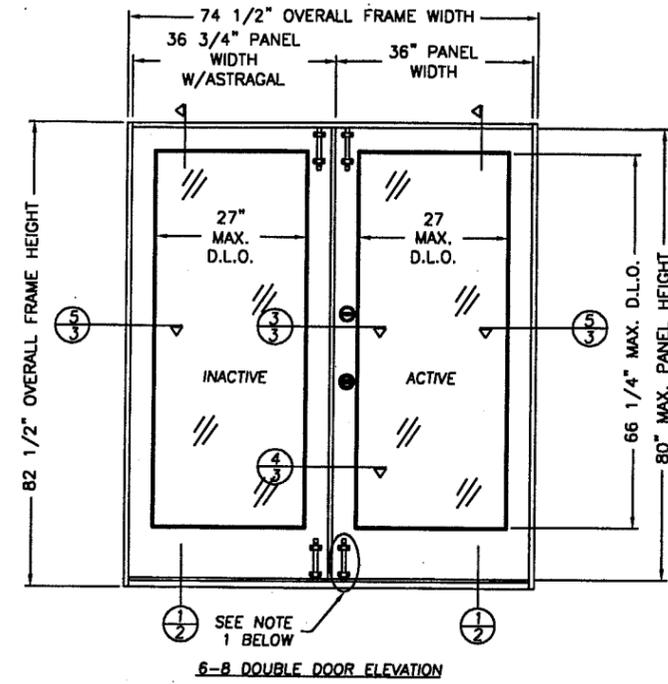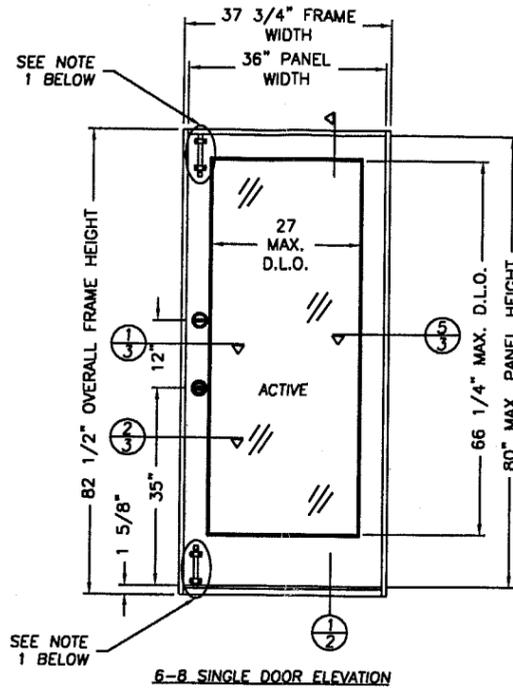

ALL MODELS ARE VIEWED FROM THE INTERIOR.

DESIGN PRESSURE RATING (INSWING DOORS) WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED		
DOOR SIZE	OPTION 1	OPTION 2
	W/O SURFACE BOLTS ON ACTIVE DOOR	WITH SURFACE BOLTS ON ACTIVE DOOR
6-8	+47.0 psf -47.0 psf	+60.0 psf -60.0 psf
8-0	+32.0 psf -32.0 psf	+60.0 psf -60.0 psf

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 04-1025.06
Expiration Date SEPTEMBER 29, 2012
By Ismael I. Llanza
Miami Dade Product Control
Division

DATE: 7-24-00
SCALE: 1 : 32
DWG. BY: TJH
CHK. BY: SS
DRAWING NO.:
S-2040
SHEET 1 OF 7

James D. Obrowski
9-6-06


JELD-WEN, INC.
31725 HIGHWAY 97 N.
CHILOQUIN, OR. 97624
PH. 541.882.3451
1.800.JELD.WEN

PRODUCT: WOOD STILE & RAIL DOOR
GLAZED 6-8 & 8-0 INSWING
SINGLE & DOUBLE DOORS

PART OR ASSEMBLY:
ELEVATIONS &
GENERAL NOTES

NO.	DATE	REVISIONS	BY
6	3-05-05	GENERAL REVISIONS	WAR
3	06/27/02	GENERAL REVISION	KMN
2	08/24/08	GENERAL REVISION	TJH
1	04/04/01	GENERAL REVISION	TJH

James D. Nowak
8-22-05

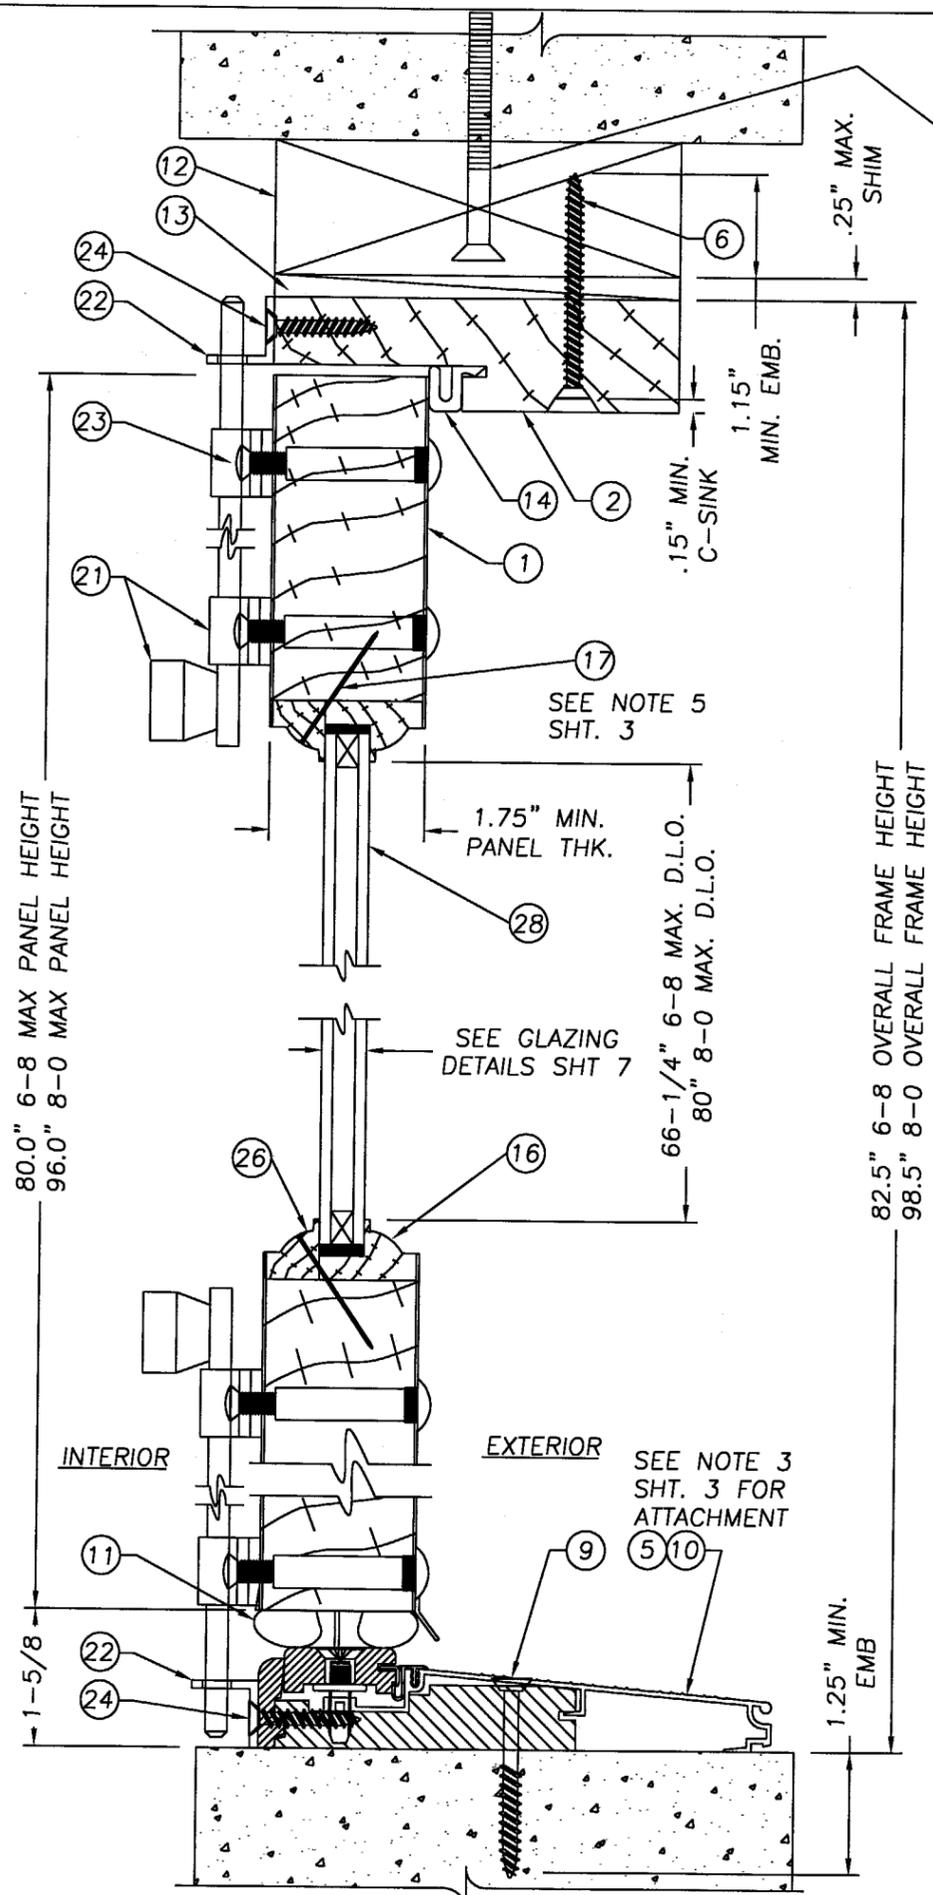

2x BUCK TO SUBSTRATE FASTENING TO BE ENGINEERED SEPERATLY

Item	DESCRIPTION	Material
1	NORD/MORGAN/NICOLAI STILE & RAIL 6-8/8-0 WOOD DOOR (DOUGLAS FIR, WESTERN HEMLOCK, PONDEROSA PINE, NORTHERN RED OAK, RED MAPLE, BLACK CHERRY, YELLOW POPLAR, TRUE HICKORY, TRUE MAHOGANY, BLACK WALNUT, & RED ALDER)	
2	HEAD JAMB (1 1/4" x 4 5/8" PONDEROSA PINE)	PINE
3	HINGE JAMB (1 1/4" x 4 5/8" PONDEROSA PINE)	PINE
4	(1) PIECE WOOD ASTRAGAL	PINE
5	INSWING ADJUSTABLE THRESHOLD (.051" WALL BY IMPERIAL)	ALUMINUM
6	#8 x 2 1/2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
7	KWIKSET TITAN SERIES 400 LOCK	
8	KWIKSET TITAN SERIES 720 DEADBOLT	
9	1/4" x 2 1/2" LG. TAPCON OR ITW BUILDDEX TAPCON (PER CURRENT NOA) OR ELCO TAPCON (PER CURRENT NOA)	STEEL
10	SILICONE CAULK (CR LAWRENCE 33S)	SILICONE
11	INSWING VINYL DOOR BOTTOM SWEEP	VINYL
12	2x WOOD BUCK	WOOD
13	1/4" MAX. SHIMS	WOOD
14	COMPRESSION WEATHERSTRIP (Q-LON QDS-650)	FOAM
15	#10 X 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
16	WOOD CAP FOR .50" THK. GLASS	PINE
17	BRAD TRIM NAIL 1 1/2" L.	STEEL
18	4" x 4" BUTT HINGE 12GA. (.089" MIN)	STEEL
19	#9 x 1" PHILLIPS FLATHEAD WOOD SCREW	STEEL
20	#8 x 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
21	SURFACE BOLT (IVES, .25" STEEL)	STEEL
22	SURFACE BOLT STRIKE PLATE (IVES, .125" STEEL)	STEEL
23	1/4-20 SEX BOLT W/1/4-20 FEMALE END x 1 1/2" L	STEEL
24	#10 x 1 1/4" PHILLIPS FLATHEAD WOOD SCREW	STEEL
25	WOOD CAP FOR .125" THK. GLASS	PINE
26	WOOD GLASS STOP FOR .50" THK. GLASS	PINE
27	WOOD GLASS STOP FOR .125" THK. GLASS	PINE
28	1/2" INSULATED TEMPERED GLASS (BY PPG) 1/8" TEMPERED GLASS (BY PPG)	GLASS GLASS
29	GLAZING COMPOUND (PRC 365 BY DE-SOTO INTER.)	SILICONE
30	BRAD TRIM NAIL 3/4" L.	STEEL
31	TRUE DIVIDED GLASS GLAZING STOP	WOOD

JELD-WEN, INC.
31725 HIGHWAY 97 N.
CHILOQUIN, OR. 97624
PH. 541.882.3451
1.800.JELD.WEN

PRODUCT: WOOD STILE & RAIL DOOR
6-8 & 8-0 GLAZED INSWING
SINGLE AND DOUBLE DOOR
PART OR ASSEMBLY:
VERTICAL CROSS SECTION
& BILL OF MATERIALS

NO.	DATE	REVISIONS	BY
6	3-05-05	GENERAL REVISION	WAR
3	06/27/02	GENERAL REVISION	KMN
2	08/24/01	GENERAL REVISION	TJH
1	04/04/01	GENERAL REVISION	TJH

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 04-1025.06
Expiration Date SEP 20, 2010
By *Ishaq I. Chanda*
Miami Dade Product Control
Division

DATE: 7-24-00
SCALE: 1 : 2
DWG. BY: TJH
CHK. BY: SS
DRAWING NO.: S-2040
SHEET 2 OF 7

1 VERTICAL CROSS SECTION
2

James Dobrowski
8-22-05

JELD-WEN, INC.
31725 HIGHWAY 97 N.
CHILOQUIN, OR. 97624
PH. 541.882.3451
1.800.JELD.WEN


PRODUCT: WOOD STILE & RAIL DOOR
6-8 & 8-0 GLAZED INSWING
SINGLE & DOUBLE DOOR
PART OR ASSEMBLY:
HORIZONTAL CROSS SECTIONS
SECTIONS 1/3, 2/3, 3/3 & 4/3

NO.	DATE	REVISIONS	BY
5	3-05-05	GENERAL REVISION	WAR
2	08/24/01	GENERAL REVISION	TJH
1	04/04/01	GENERAL REVISION	TJH


DATE: 7-27-00
SCALE: 1 : 4
DWG. BY: TJH
CHK. BY: SS
DRAWING NO.: S-2040
SHEET 3 OF 7

NOTES: (TYP. TO ALL FRAME CONFIGURATIONS)


- SPACING FOR ITEM #20 (#8 x 2" SCREW) TO ATTACH THE WOOD ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS: FOR THE 6-8 UNIT TOP DOWN; 3", 12" & 21", FOR THE 8-0 UNIT TOP DOWN; 3", 14", 25" & 36". THE SPACING FROM THE BOTTOM UP IS THE SAME FOR BOTH UNITS; 3", 13 3/8" & 24 1/8".
- THE SURFACE BOLT IS INSTALLED AT THE TOP AND BOTTOM ON BOTH THE ACTIVE AND INACTIVE DOOR.
OPTION 1- SURFACE BOLTS ON INACTIVE DOOR ONLY.
OPTION 2- SURFACE BOLTS ON ACTIVE & INACTIVE DOORS.
SURFACE BOLTS ON BOTH ACTIVE & INACTIVE DOORS ARE AN OPTION TO ACHIEVE HIGHER DESIGN PRESSURES AS INDICATED IN DESIGN PRESSURE RATING TABLE ON SHEET I.
- THE THRESHOLD IS NOT ATTACHED TO THE FRAME, IT IS NOTCHED AND ATTACHED TO THE FLOOR WITH ITEMS #9 2 1/2" TAPCON & #10 (CR LAWRENCE 33S SILICONE CAULK). APPLY A CONTINUOUS BEAD .125" THK. x .375" W. AROUND ALL (4) OUTER EDGES WITH A MINIMUM OF (2) ROWS IN A ZIG ZAG PATTERN IN THE MIDDLE THE ENTIRE LENGTH OF THE THRESHOLD, .125" THK. x .375" W.
- THE TOP CORNERS OF THE DOOR FRAME, ARE STAPLED TOGETHER USING (3) 16GA. x 2" LG. x 1/2" CROWN STAPLES.
- SPACING FOR ITEM #17 IS A MAX. OF 12" O.C.

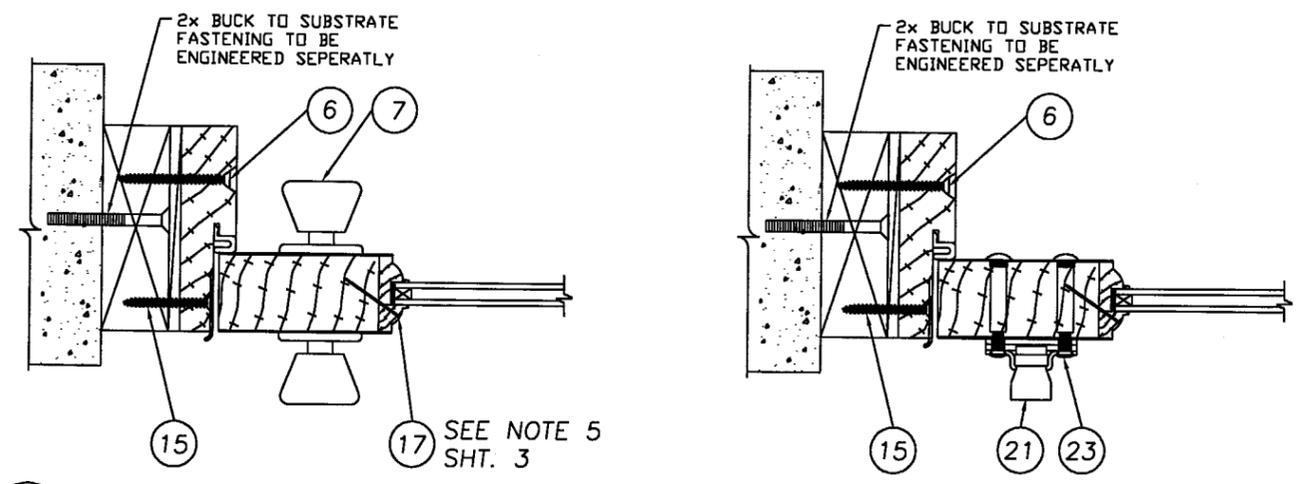


1 3 HORIZONTAL CROSS SECTION LATCH JAMB TO BUCK OPTION #1 (W/O SURFACE BOLTS ON ACTIVE DOOR)
2 3 HORIZONTAL CROSS SECTION LATCH JAMB TO BUCK OPTION #2 (WITH SURFACE BOLTS ON ACTIVE DOOR)

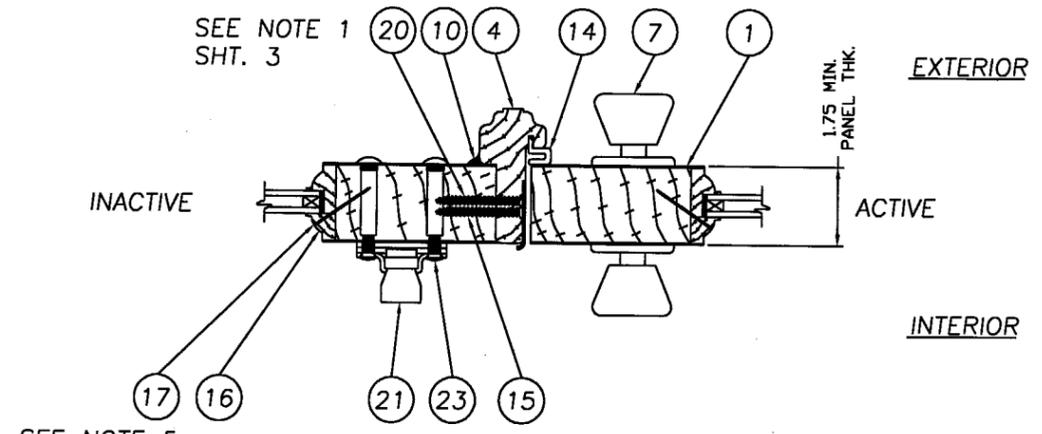

3 3 HORIZONTAL CROSS SECTION AT ASTRAGAL OPTION #1 (W/O SURFACE BOLTS ON ACTIVE DOOR)

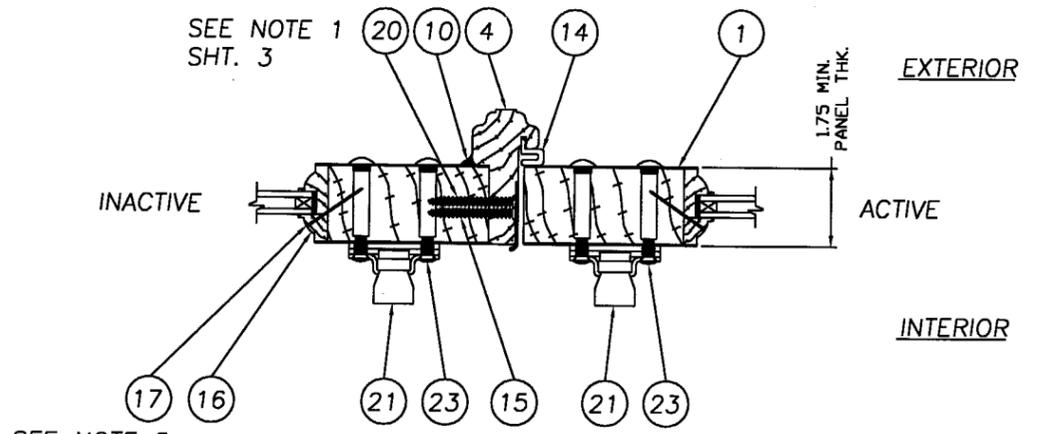


4 3 HORIZONTAL CROSS SECTION AT ASTRAGAL OPTION #2 (WITH SURFACE BOLTS ON ACTIVE DOOR)

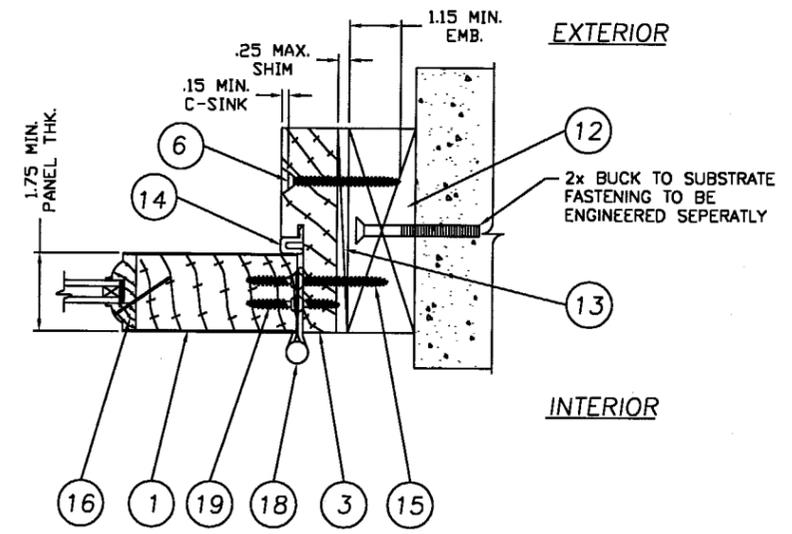


5 3 HORIZONTAL CROSS SECTION AT HINGE JAMB


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 04-1025.06
Expiration Date SEP 2012 2010
By Ishag I. Lhanda
Miami Dade Product Control
Division

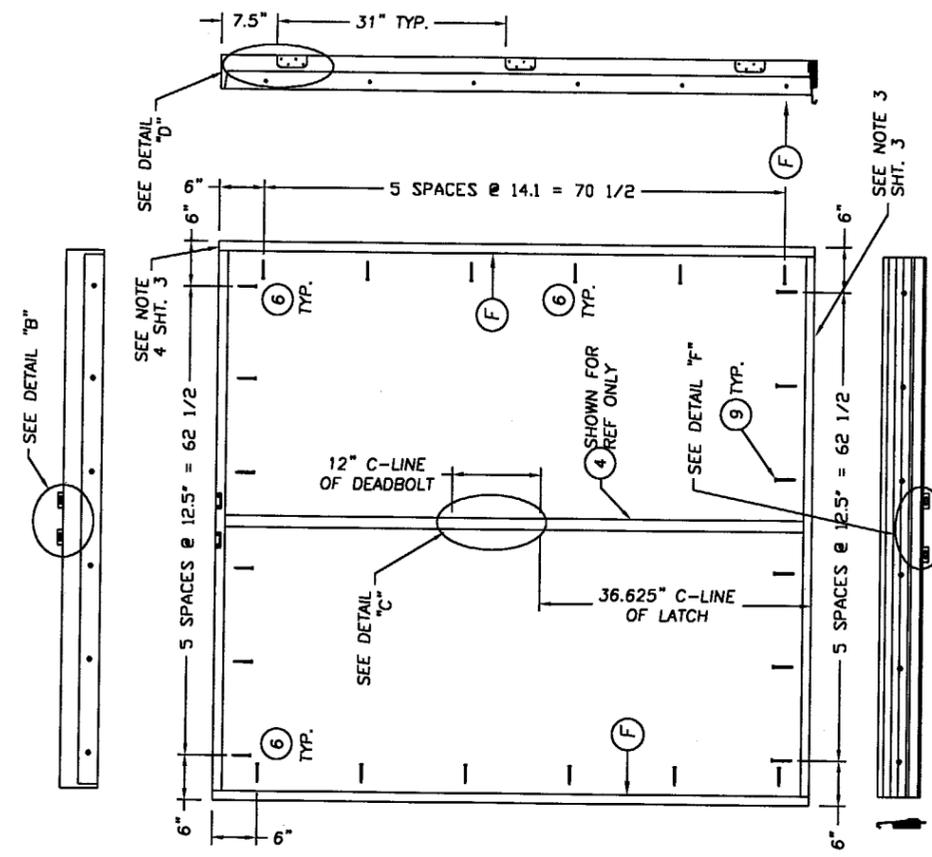


DOUBLE DOOR 6-8 ANCHORING LOCATIONS
VIEWED FROM THE INTERIOR

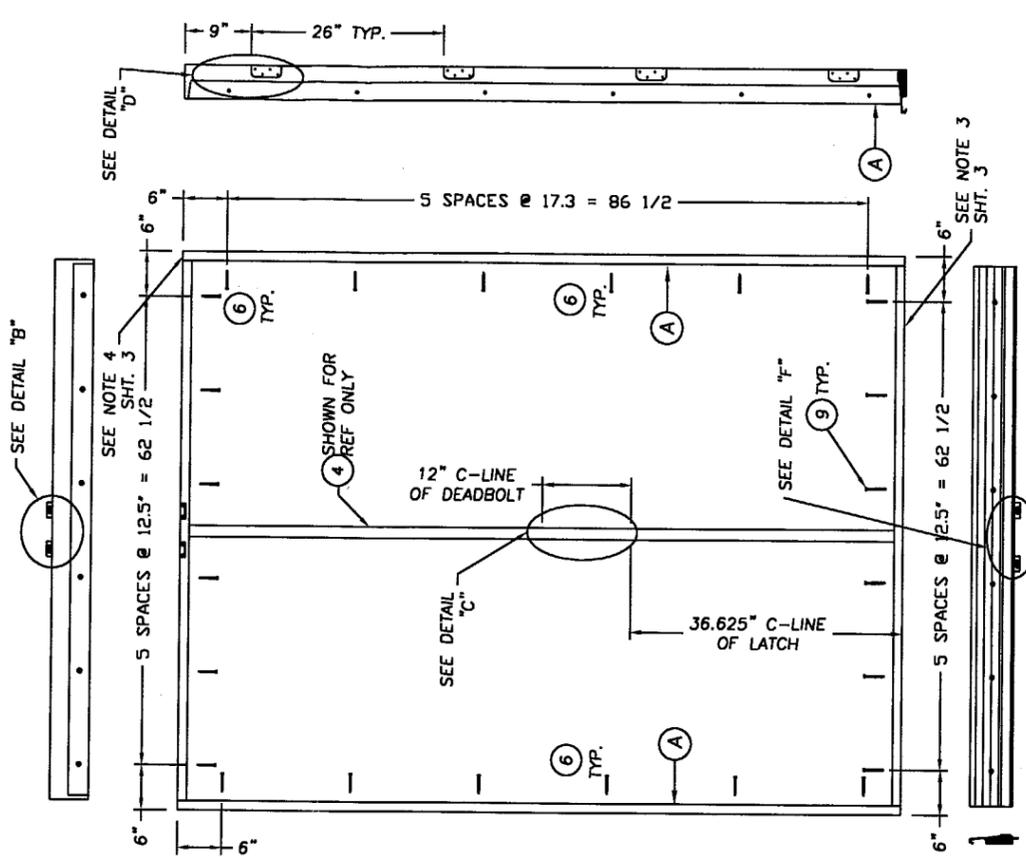


DOUBLE DOOR 8-0 ANCHORING LOCATIONS
VIEWED FROM THE INTERIOR

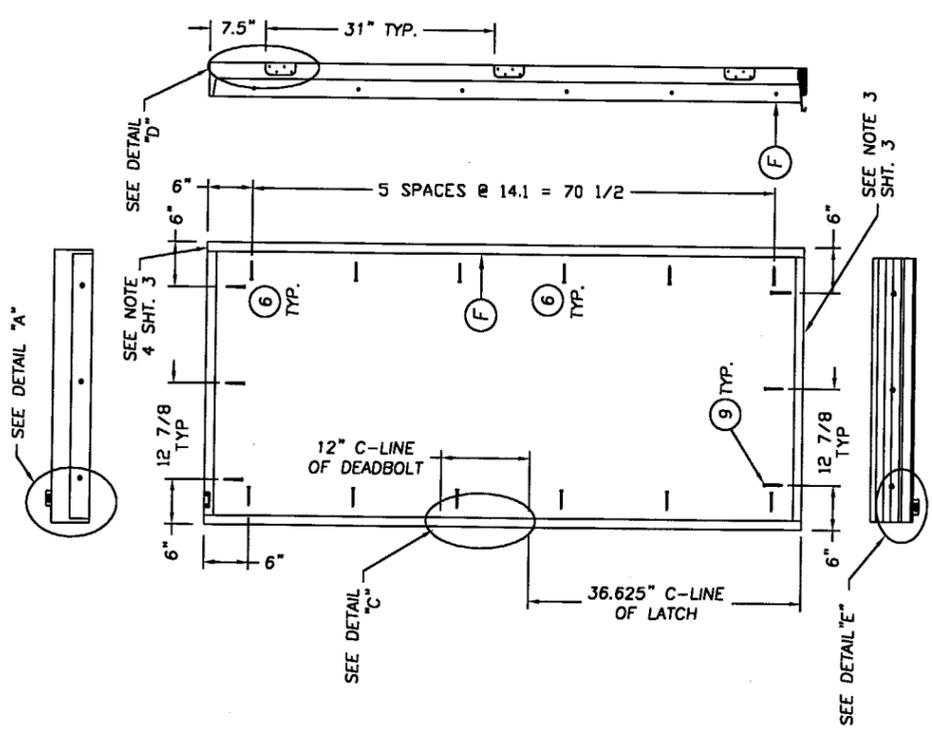

SINGLE DOOR 6-8 ANCHORING LOCATIONS
VIEWED FROM THE INTERIOR

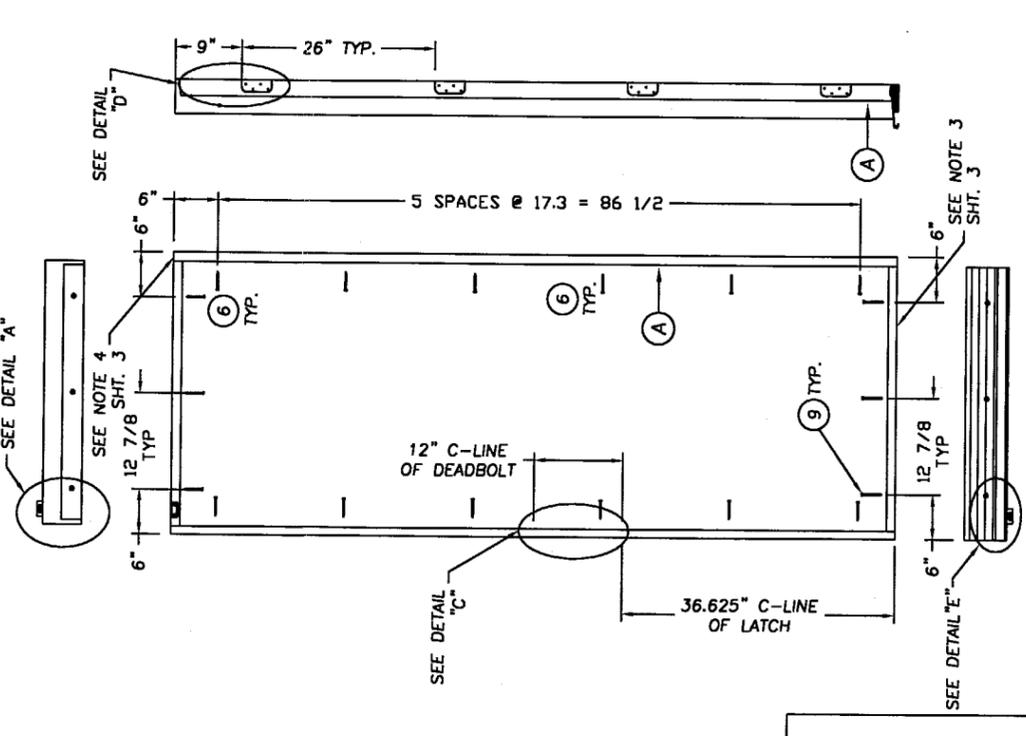

SINGLE DOOR 8-0 ANCHORING LOCATIONS
VIEWED FROM THE INTERIOR

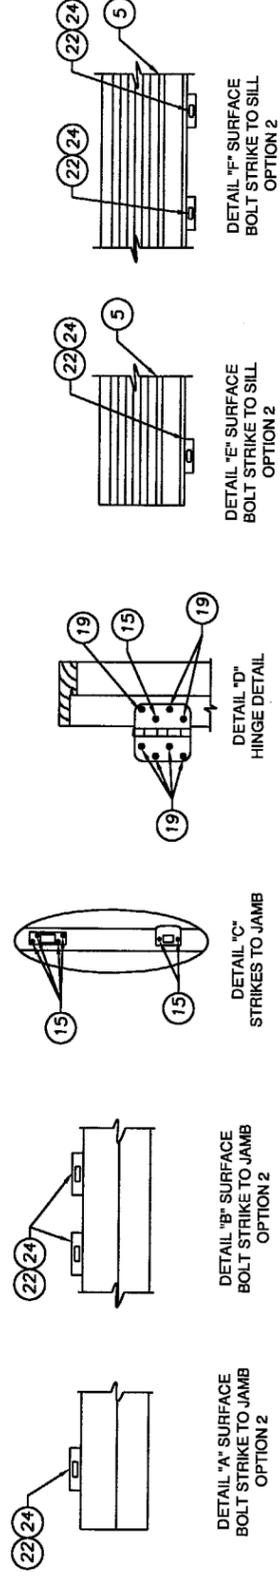

James Dolan
9-22-05

JELD-WEN, INC.
31725 HIGHWAY 97 N.
CHILOQUIN, OR. 97624
PH. 541.882.3451
1.800.JELD.WEN

PRODUCT: WOOD STILE & RAIL DOOR
6-8 & 8-0 GLAZED INSWING
SINGLE & DOUBLE DOOR
PART OR ASSEMBLY:
ANCHORING LOCATIONS
& DETAILS


NO.	DATE	REVISIONS	BY
5	3-05-05	GENERAL REVISION	WAR
2	08/24/01	GENERAL REVISION	TJH
1	04/04/01	GENERAL REVISION	TJH

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 04-1025.06
Expiration Date SEP 20, 2010


By *Isaac I. Chaudh*
Miami Dade Product Control
Division

DATE: 7-24-00
SCALE: 1 : 24
DWG. BY: TJH
CHK. BY: SS
DRAWING NO.: S-2040
SHEET 4 OF 7

James Dobrowolski
8-22-05

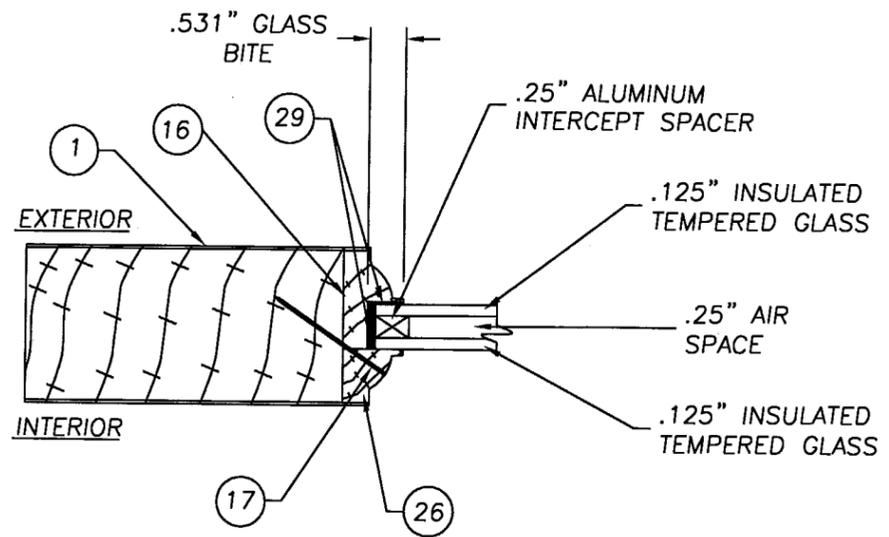


**.50" INSULATED TEMPERED GLASS
GLAZING DETAIL**
SCALE: 1/2" = 1"

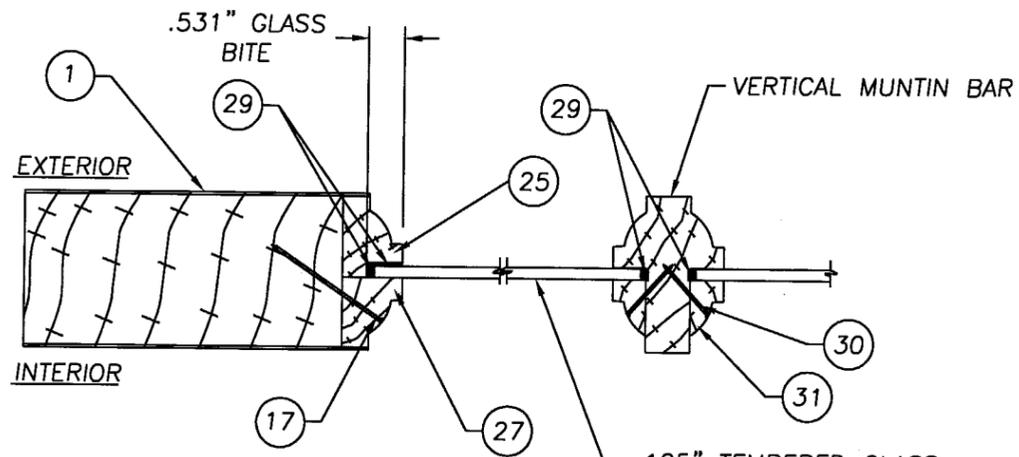


**.125" TEMPERED GLASS
GLAZING DETAIL**
SCALE: 1/2" = 1"


NOTE:
THE MULTI-LITE MUNTIN BAR
DOOR PANEL IS MADE UP OF
TRUE DIVIDED GLASS PANELS.




TRUE DIVIDED GLASS GLAZING STOP
SCALE: FULL

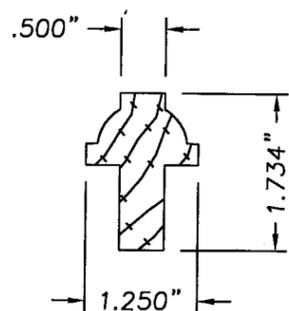

VERTICAL MUNTIN BAR DETAIL
SCALE: 1/2" = 1"

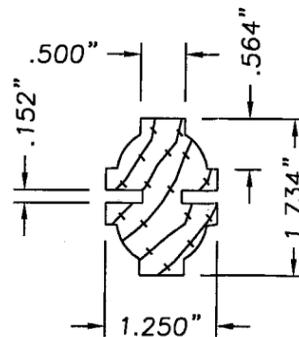

CENTER BAR DETAIL
SCALE: 1/2" = 1"

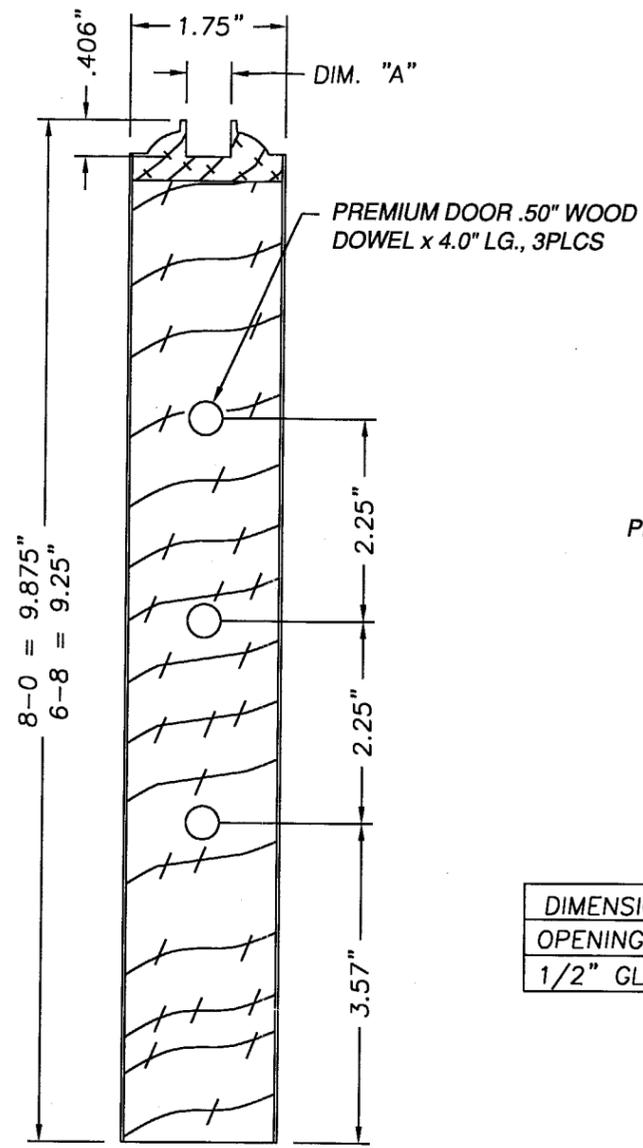


BOTTOM RAIL
SCALE: 1/2" = 1"


NOTE:
DOWELS ARE GLUED AND PRESSED 2.0" INTO
THE RAILS AND STILES AT PANEL ASSEMBLY.

PREMIUM DOOR .50" WOOD
DOWEL x 4.0" LG., 2 PLCS

DIMENSION "A" CHART	
OPENING FOR	DIM. "A"
1/2" GLASS	.527"

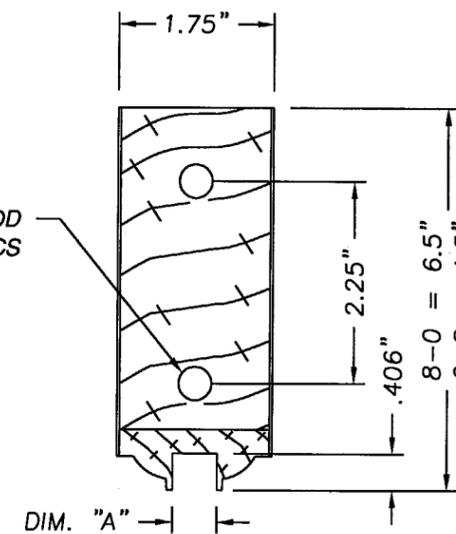

TOP RAIL
SCALE: 1/2" = 1"

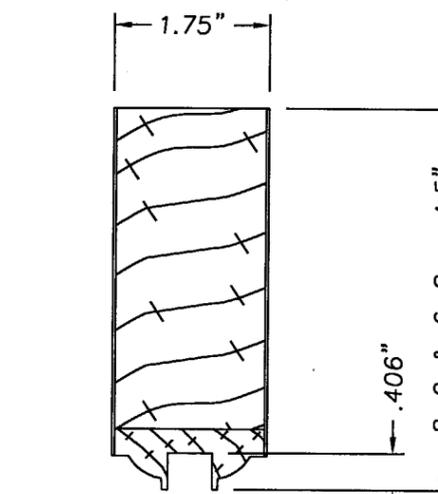

SIDE STILE
SCALE: 1/2" = 1"

JELD-WEN, INC.
31725 HIGHWAY 97 N.
CHILOQUIN, OR. 97624
PH. 541.783.2057


PRODUCT: WOOD STILE & RAIL DOOR
6-8 & 8-0 GLAZED INSWING
SINGLE & DOUBLE DOOR
PART OR ASSEMBLY:
GLAZING DETAILS
& RAIL DETAILS

NO.	DATE	REVISIONS	BY
3	3-05-05	GENERAL REVISION	WAR
2	08/24/01	GENERAL REVISION	TJH
1	04/04/01	GENERAL REVISION	TJH


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 04-1025.06
Expiration Date SEP 20, 2010
By Ishag I. Chauda
Miami Dade Product Control
Division

DATE: 7-24-00
SCALE: 1 : 2
DWG. BY: TJH
CHK. BY: SS
DRAWING NO.:
S-2040
SHEET 5 OF 7


James D. Doherty
8-22-05

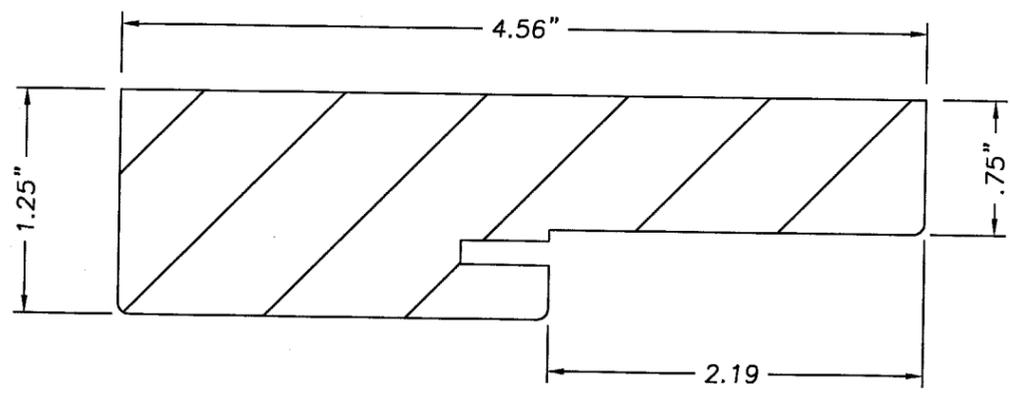


WOOD FRAME

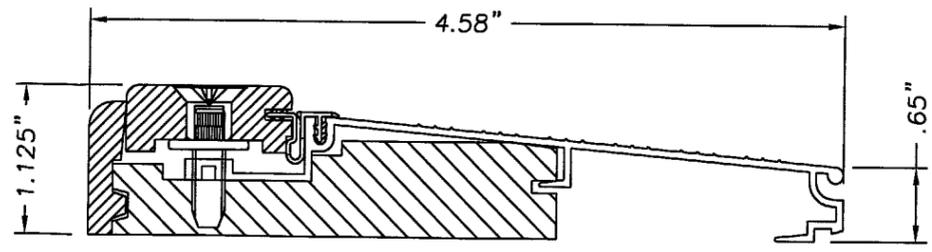


ADJUSTABLE INSWING THRESHOLD
.051" WALL THK.

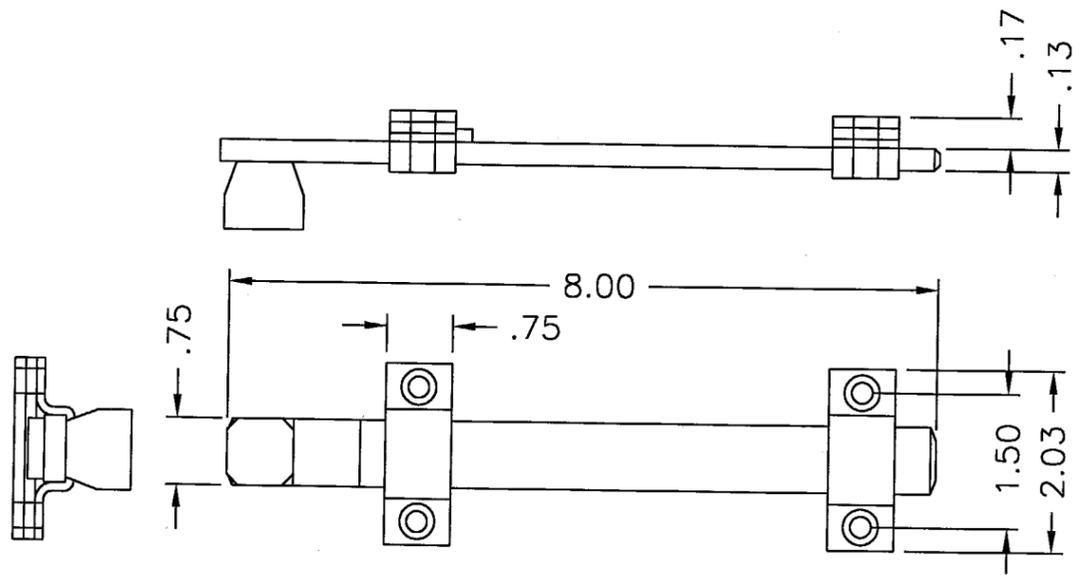


SURFACE BOLT (IVES .25" STEEL MODEL 454)

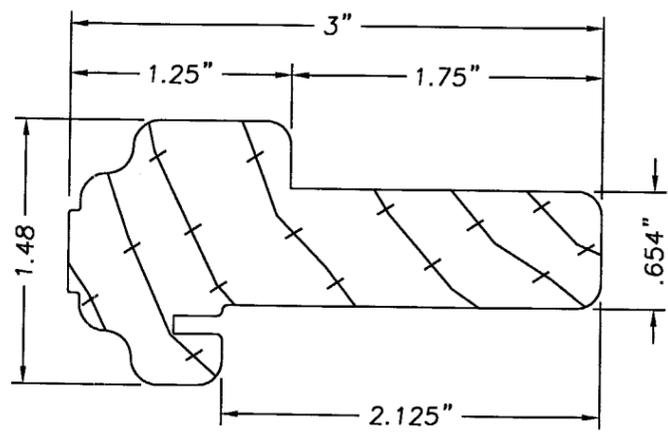


(1) PIECE WOOD ASTRAGAL

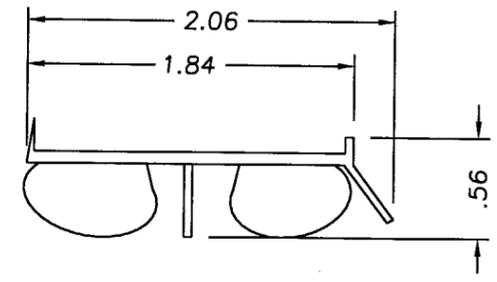

EXTRUDED VINYL INSWING
DOOR BOTTOM SWEEP

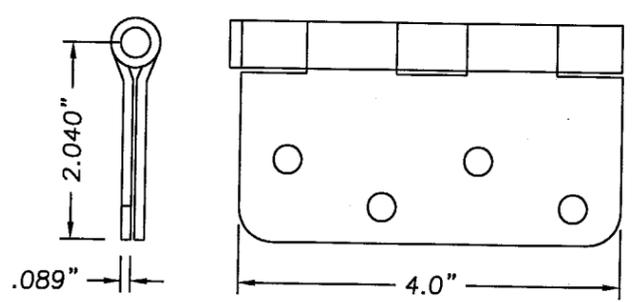

4 x 4 DOOR HINGE

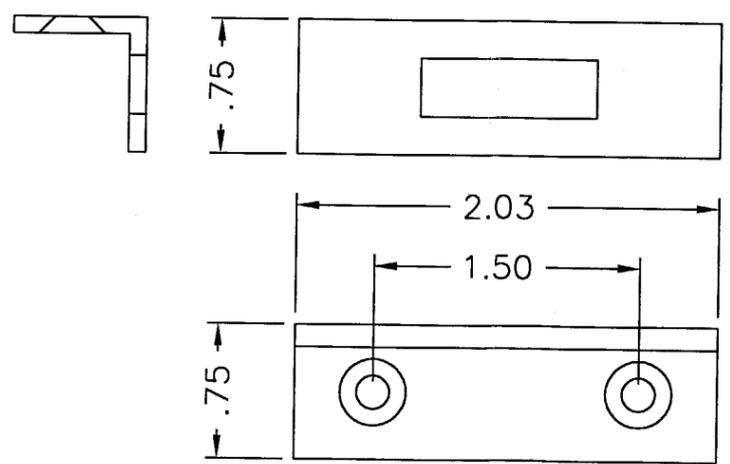

SURFACE BOLT STRIKE (IVES .125" STEEL)

JELD-WEN, INC.
31725 HIGHWAY 97 N.
CHILOQUIN, OR. 97624
PH. 541.882.3451
1.800.JELD.WEN


PRODUCT: WOOD STILE & RAIL DOOR
6-8 & 8-0 GLAZED INSWING
SINGLE & DOUBLE DOOR
PART OR ASSEMBLY:
FRAME COMPONENTS

NO.	DATE	REVISIONS	BY
5	3-05-05	GENERAL REVISION	TJH
2	08/24/01	GENERAL REVISION	TJH
1	04/04/01	GENERAL REVISION	TJH

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 04-1025-06
Expiration Date SEP 20, 2010
By Ishag L. Chaudh
Miami Door Product Control
Division


DATE: 7-24-00
SCALE: 1 : 1
DWG. BY: TJH
CHK. BY: SS
DRAWING NO.: S-2040
SHEET 6 OF 7

James D. Powell
8-22-05

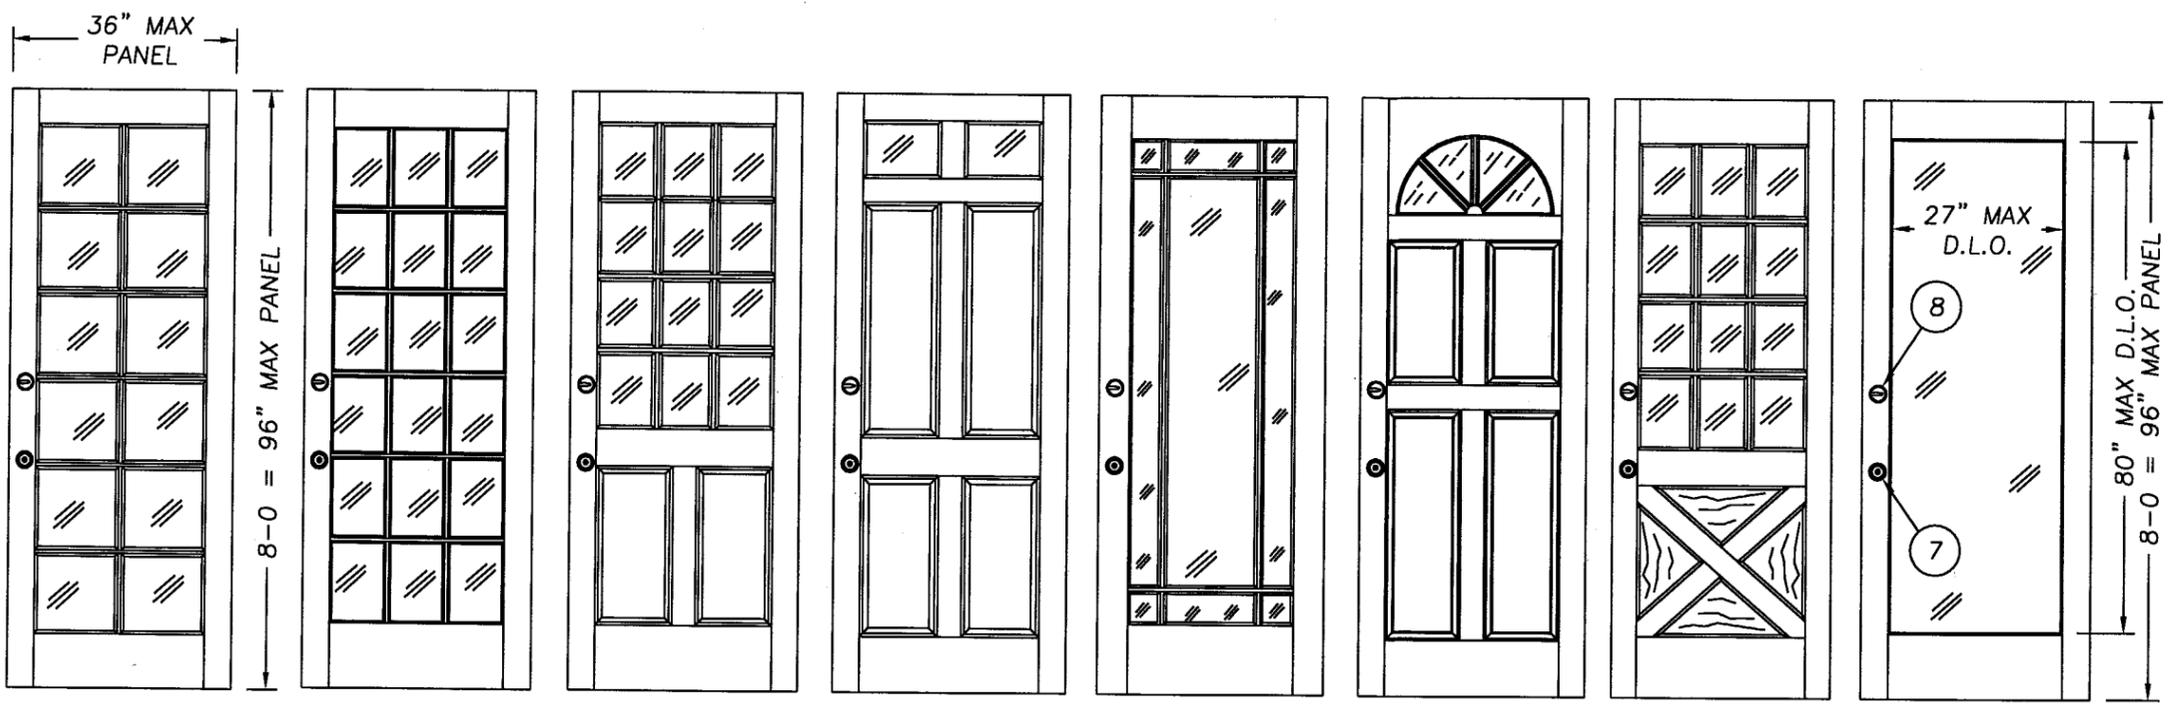

8-0 DOOR MODELS (VIEWED FROM INTERIOR)

8-0 MAX. MUNTIN D.L.O. WIDTH = 12-3/8"
8-0 MAX. MUNTIN D.L.O. HEIGHT = 12-3/8"

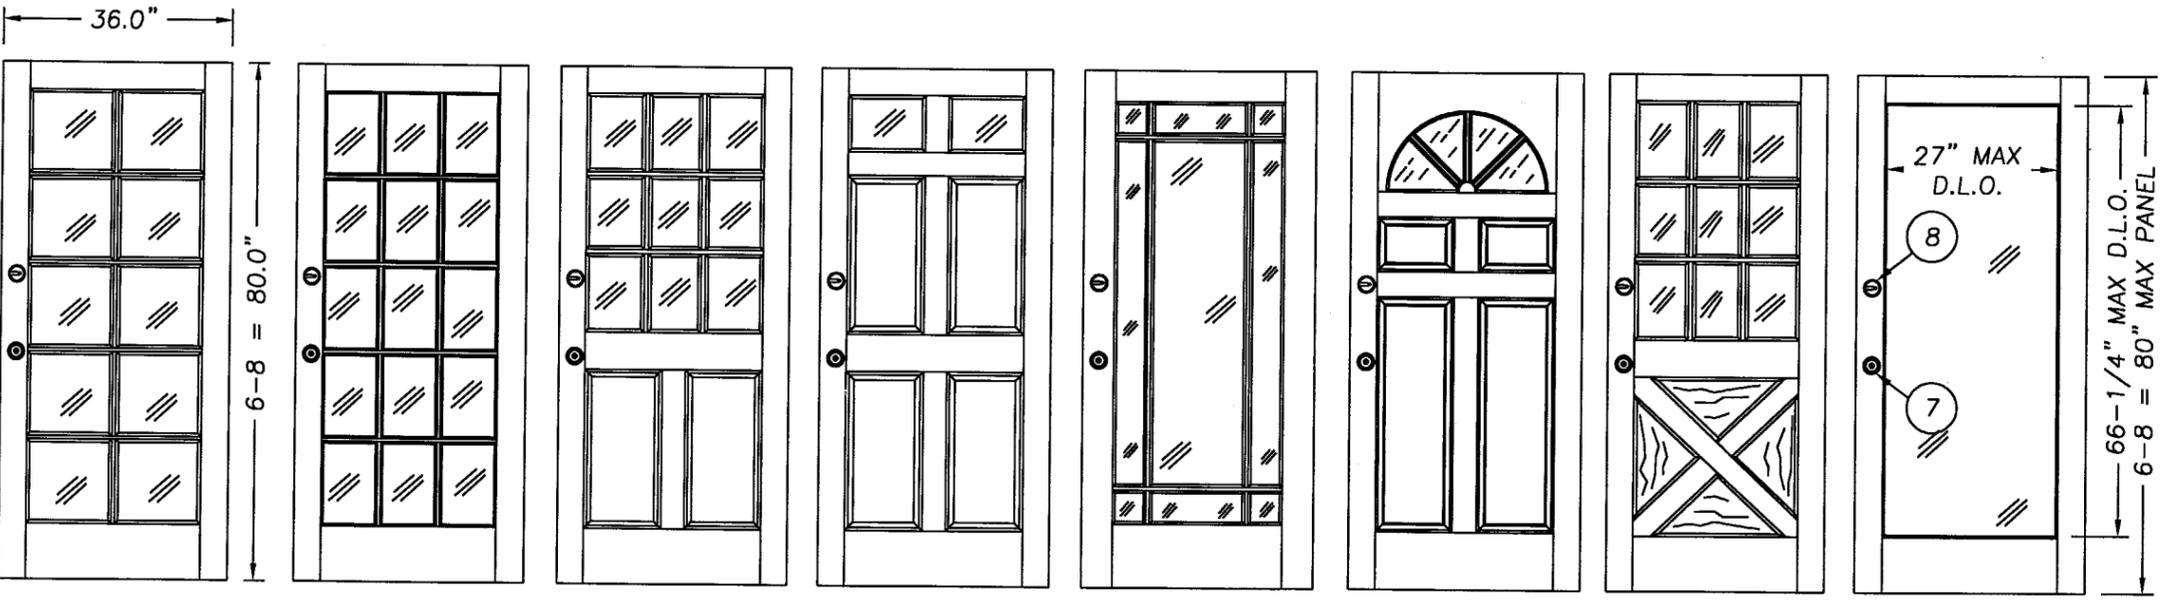

6-8 DOOR MODELS N.T.S. (VIEWED FROM INTERIOR)

6-8 MAX. MUNTIN D.L.O. WIDTH = 12-3/8"
6-8 MAX. MUNTIN D.L.O. HEIGHT = 12-3/8"

NOTE:
THE MULTI-LITE MUNTIN BAR
DOOR PANEL IS MADE UP OF
TRUE DIVIDED GLASS PANELS.

JELD-WEN, INC.
31725 HIGHWAY 97 N.
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT: WOOD STILE & RAIL DOOR
6-8 & 8-0 GLAZED INSWING
SINGLE & DOUBLE DOOR

PART OR ASSEMBLY:
DOOR MODELS

NO.	DATE	REVISIONS	BY
3	1-10-05	GENERAL REVISIONS	WAR
2	08/24/01	GENERAL REVISION	TJH
1	04/04/01	GENERAL REVISION	TJH

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 04-1025.06
Expiration Date ~~SEPTEMBER 2010~~
By *Iskhan J. Chaudhry*
Miami Dade Product Control
Division

DATE: 7-24-00
SCALE: 1 : 2
DWG. BY: TJH
CHK. BY: SS
DRAWING NO.: S-2040
SHEET 7 OF 7