



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

Premdor Entry Systems
One Premdor Drive
Dickson, TN 37055

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Outswing Single Glazed Wood Door with Sidelites and Transom

APPROVAL DOCUMENT: Drawing No. **Royal OS1**, Rev "A", titled "Royal Mahogany" single door w/sidelite/transom, outswing", dated 10-06-99, sheets 1 through 6 of 6, prepared by manufacture, bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: None: Approved applicable Hurricane protection device complying with FBC is required.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA # 01-1119.02** consists of this page 1 and evidence pages E-1 as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



NOA No 04-1213.02
Expiration Date: December 20, 2009
Approval Date: February 03, 2005
Page 1

1/12/2005

Premdor Entry Systems

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **Royal OS1**, Rev "A", titled "Royal Mahogany" single door w/sidelite/transom, outswing", dated 10-06-99, sheets 1 through 6 of 6, prepared by manufacture.

B. TESTS (original test report transferred from file # **01-1119.02**. Tested per SFBC, PA 202-94 now termed as FBC, TAS 202-94)

1. Test Report No. **NCTL-210-2192-1, 2, 3** prepared by National Certified Testing Laboratories, dated 06/21/99, signed and sealed by Barry D. Portnoy, P.E., for the following tests:
 - 1) Air Infiltration Test, per PA 202-94
 - 2) Uniform Static Air Pressure Test, Loading per PA 202-94
 - 3) Water Resistance Test, per PA 202-94.
 - 4) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94

Along with manufacturer's parts and section drawings marked by National Certified Testing Laboratories. This test report was revised by addendum letter dated 11-19-2001, issued by NCTL, signed and sealed by Barry D. Portnoy, P.E.

C. CALCULATIONS (original test report transferred from file # **01-1119.02**)

1. Anchor calculations prepared by Product & Application Engineering, Inc., Project No. 99-0902, Report No. 02, dated September 03 1999, revised on September 14, 2001, signed and sealed by Manuel Martinez, P.E.
2. Glazing complies with ASTM E-1300-98.

D. MATERIAL CERTIFICATIONS

1. None

E. QUALITY ASSURANCE By:


1. Miami Dade Building Code Compliance Office (BCCO).

F. STATEMENTS

1. Stateman letter of conformance, dated 11-29-1999, signed & sealed by Manuel Martinez, P. E.
2. Statement letter of no financial interest to test lab, dated 11-05-01, signed by Kurt Balthozer, P. E. (Premdor).
3. Statement letter of compliance dated July 15, 1999, issued by National Certified Testing Laboratories, signed and sealed by Barry D. Portnoy, P.E.
4. Addendum letters dated 11-19-2001 & 11-24-2001 for Test Report No. **NCTL-210-2192-1, 2 & 3** prepared by National Certified Testing Laboratories, issued by signed and sealed by Barry D. Portnoy, P.E
5. Renewal requested by Premdor (Masonite) dated September 29, 2004, signed by Steve Schreiber.


G. OTHER

1. This NOA **renews** Notice of Acceptance No. **01-1119.02** issued to Premdor Entry Systems, expired on 12/11/04.




Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No 04-1213.02
Expiration Date: December 20, 2009
Approval Date: February 03, 2005

PREMDOR (ROYAL MAHOGANY)
SINGLE DOOR W/SIDELITE/TRANSOM
GLAZED IN A WOOD FRAME W/BUMPER
THRESHOLD (OUTSWING)

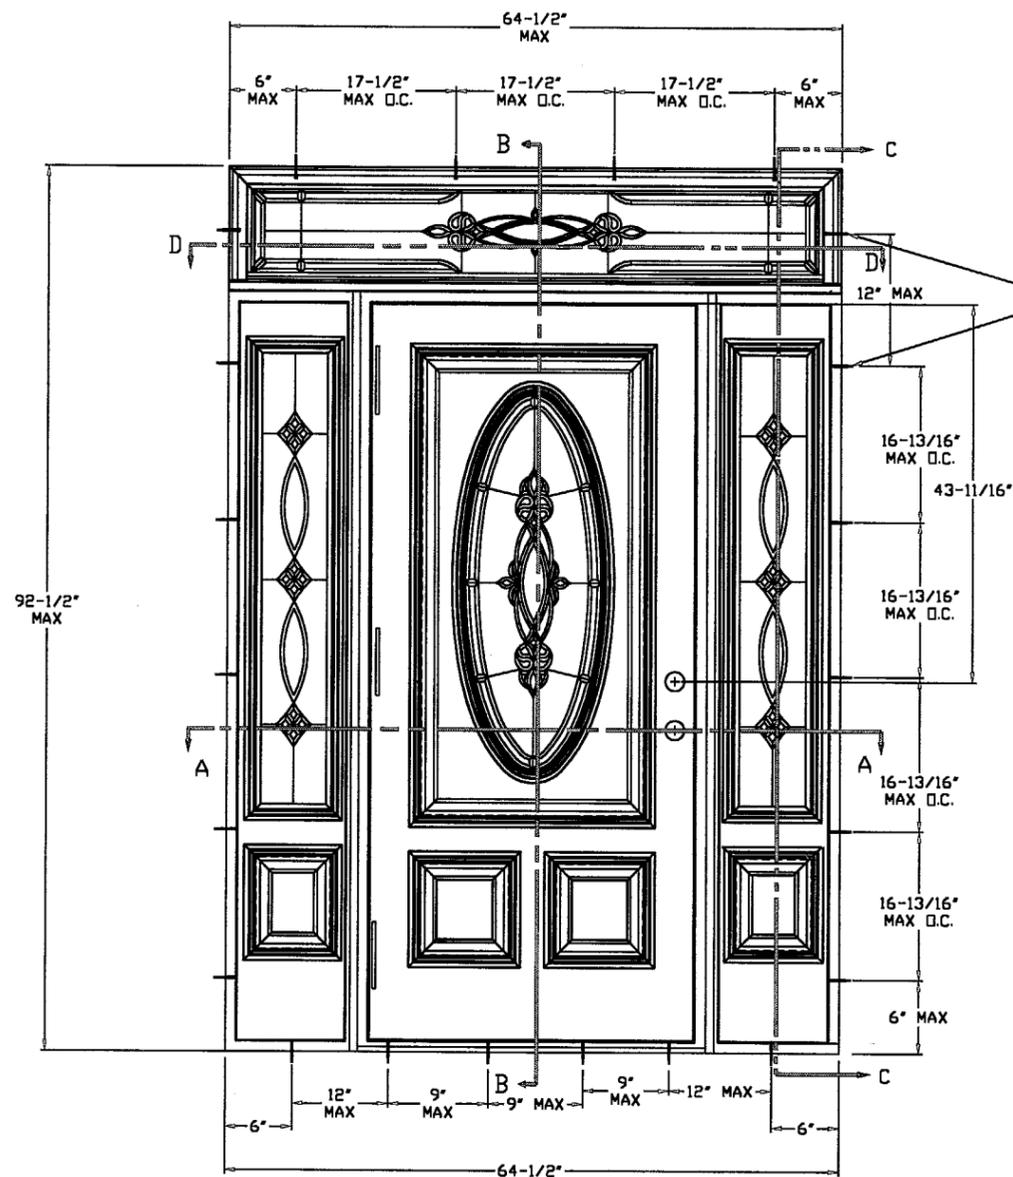

#10 x 1 3/8\"/>



HINGE LOCATIONS

NOTES:




- WOOD BUCKS BY OTHERS. MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
- THE PRECEDING DRAWINGS ARE INTENDED TO QUALIFY THE FOLLOWING INSTALLATIONS.
 - A. WOOD FRAME CONSTRUCTION WHERE DOOR SYSTEM IS ANCHORED TO A MINIMUM TWO BY WOOD OPENING.
 - B. MASONRY OR CONCRETE CONSTRUCTION WHERE DOOR SYSTEM IS ANCHORED TO A MINIMUM TWO BY STRUCTURAL WOOD BUCK.
 - C. MASONRY OR CONCRETE CONSTRUCTION WHERE DOOR SYSTEM IS ANCHORED DIRECTLY TO CONCRETE OR MASONRY WITH OR WITHOUT A NON-STRUCTURAL ONE BY WOOD BUCK.
- ALL ANCHORING SCREWS TO BE #10 WITH MINIMUM 1 3/8\"/>

DESIGN PRESSURE RATINGS	
Positive	+60.0 psf
Negative	-65.0 psf


PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 04-1213-02
Expiration Date DEC 20, 2009
By Ishaq I. Chauda
Miami Dade Product Control
Division

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE December 11, 2001
BY Ishaq I. Chauda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-1119-02

OTHER DOOR CONFIGURATIONS

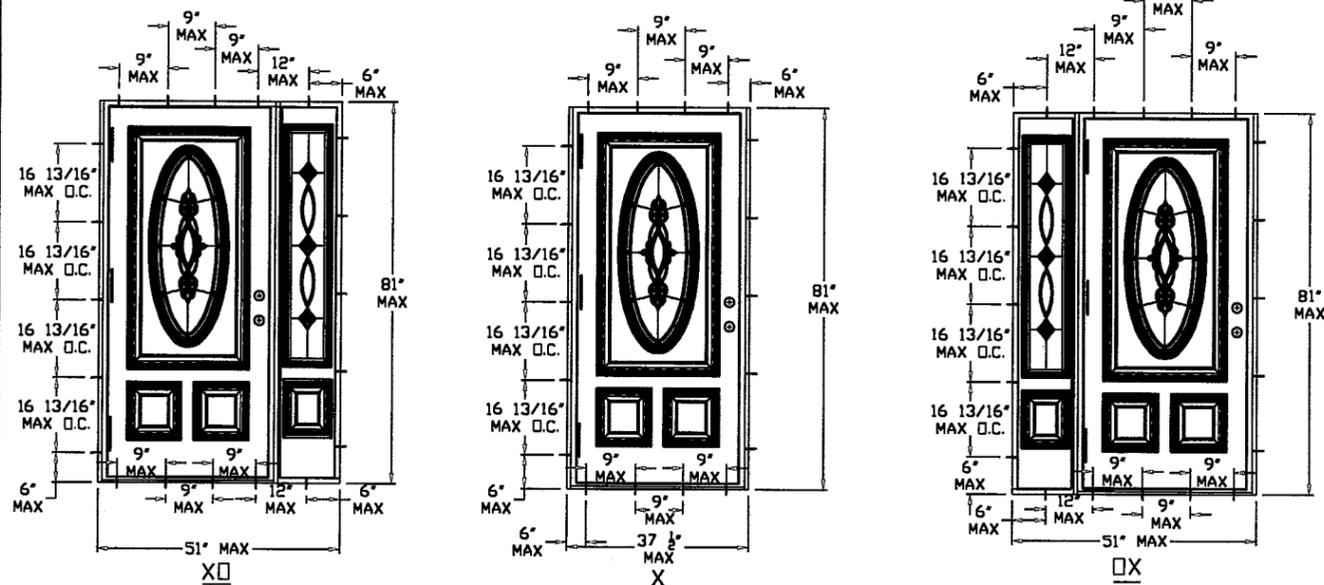


LIMITS: UNLESS NOTED, FRAC.		DEC.	ANG.		
EXTRUSIONS: UNLESS NOTED, STD. COM'L. TOL'S.				A	DADE COUNTY MODIFICATIONS
APPR. BY	DATE	AREA	L.T.R.	REVISIONS	DATE BY
DR. BY JD	DATE 10-6-99	WT./FT.	PART NAME: ROYAL SINGLE W/SIDELITE--ANCHOR OUTSWING		
			SCALE:		
PREMDOR ENTRY SYSTEMS PITTSBURG, KANSAS			ROYAL os1 SHEET 1 OF 6		
					REVISION LETTER A

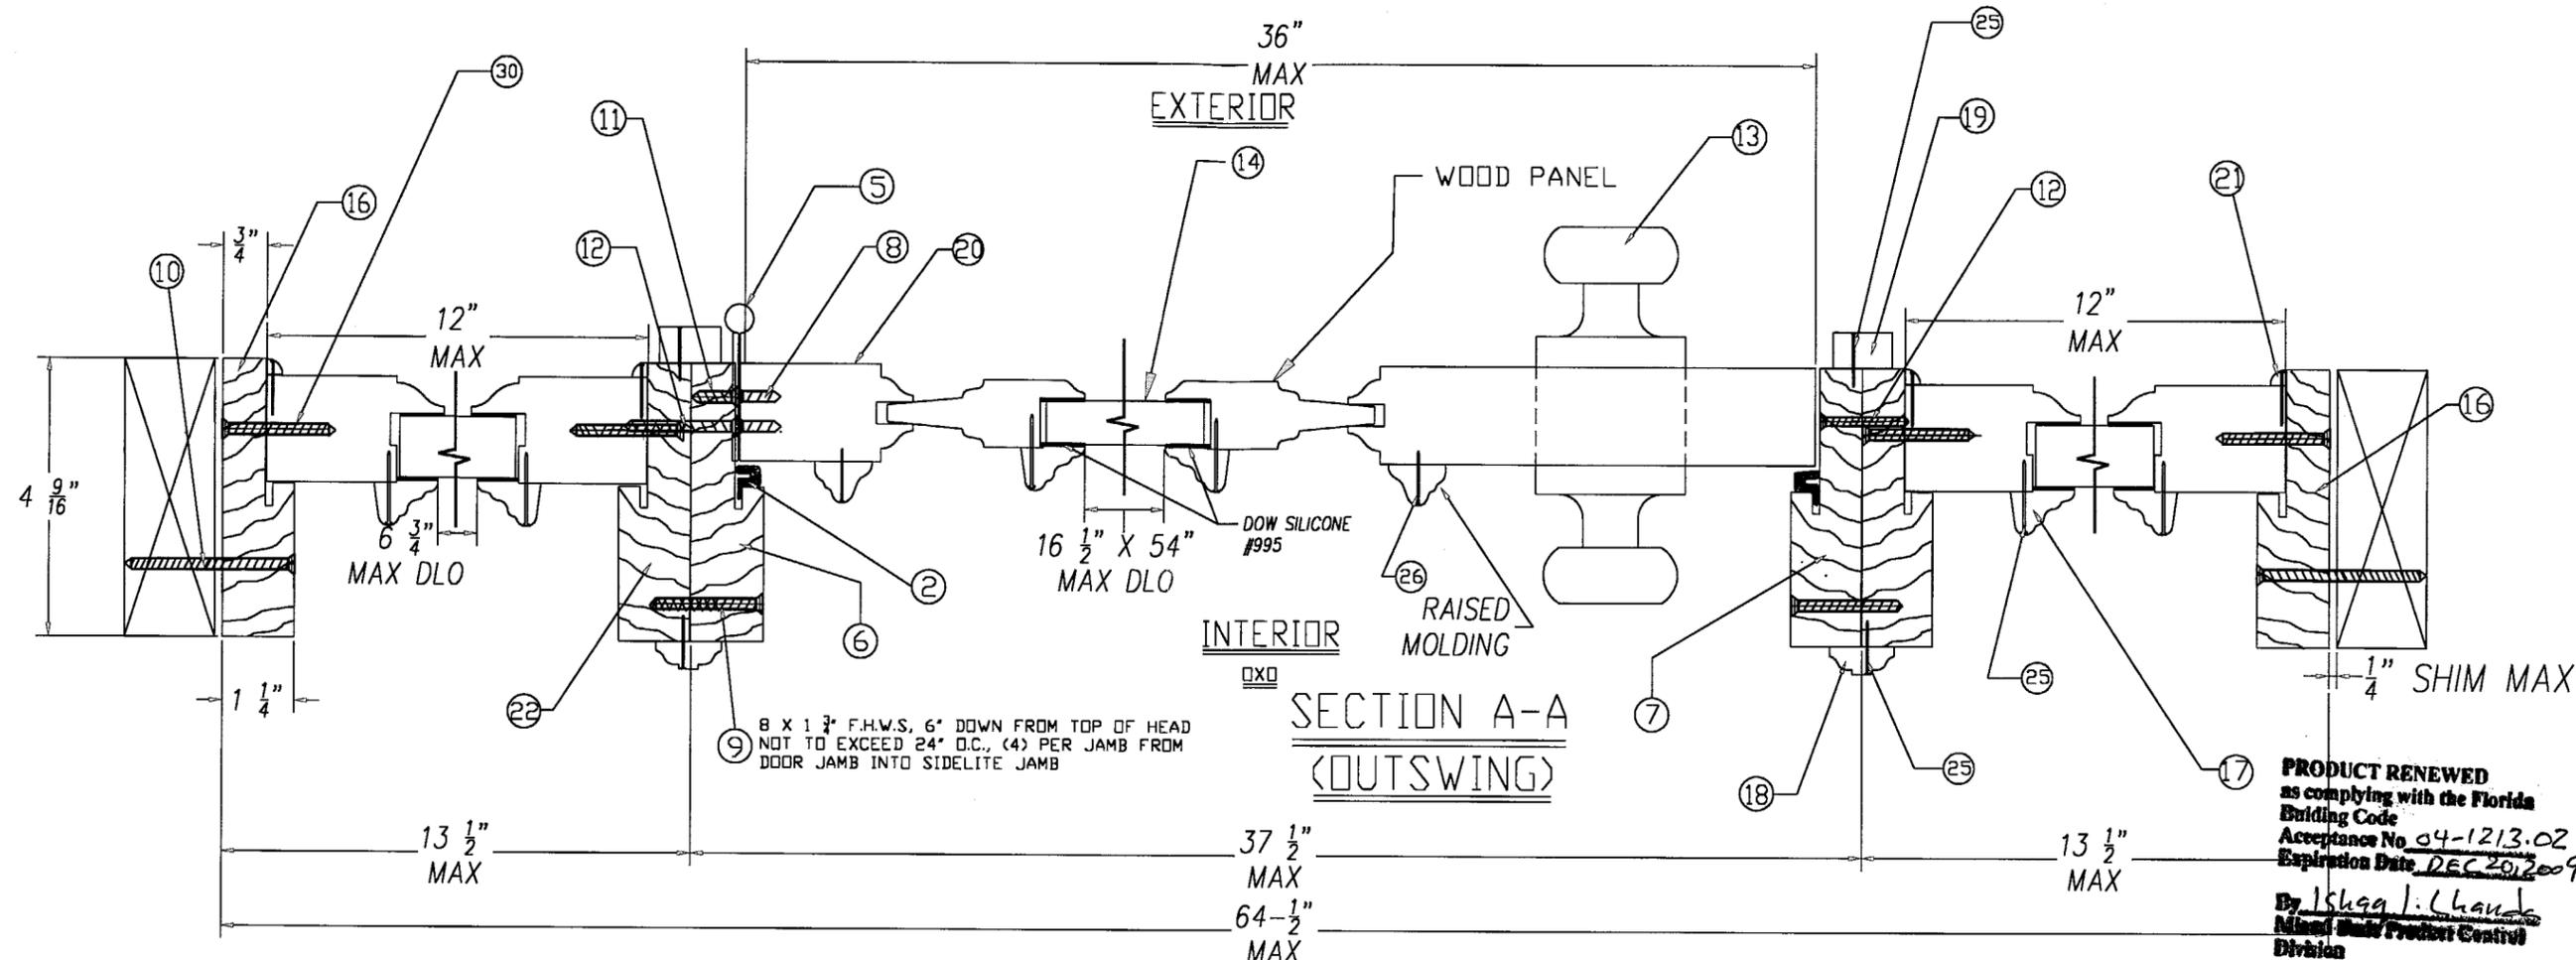


PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 04-1213.02
 Expiration Date DEC 2012009
 By Ishag J. Chaudh
 Miami-Dade Product Control
 Division

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE DEC 11, 2001
 BY Ishag J. Chaudh
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-1119.02

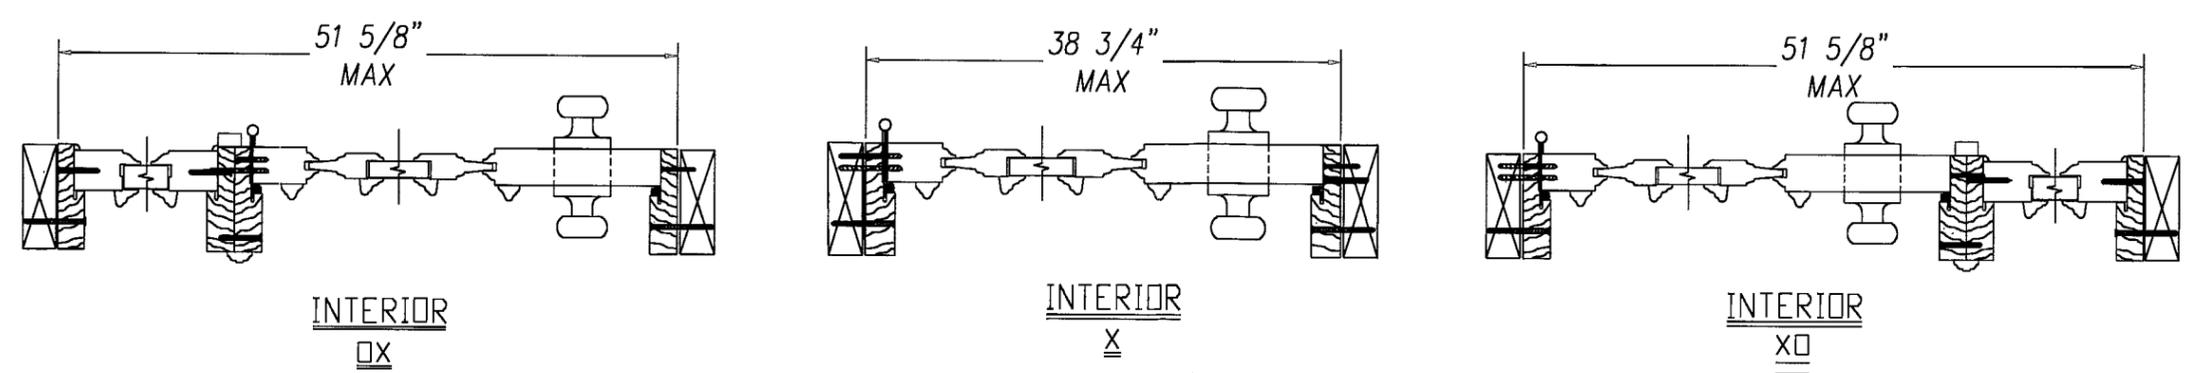


LIMITS: UNLESS NOTED, FRAC. : DEC. : ANG. :			
EXTRUSIONS: UNLESS NOTED, STD. COM'L. TOL'S.			
ENGINEER:	DR. BY JD	DATE 10-6-99	PART NAME: ROYAL DOOR W/SIDELITES -- HORIZONTAL
PREMDOR ENTRY SYSTEMS		SCALE:	
911 E. JEFFERSON		ROYAL os1	
PITTSBURG, KS. 66762		SHEET 2 OF 6	
		REVISION LETTER A	

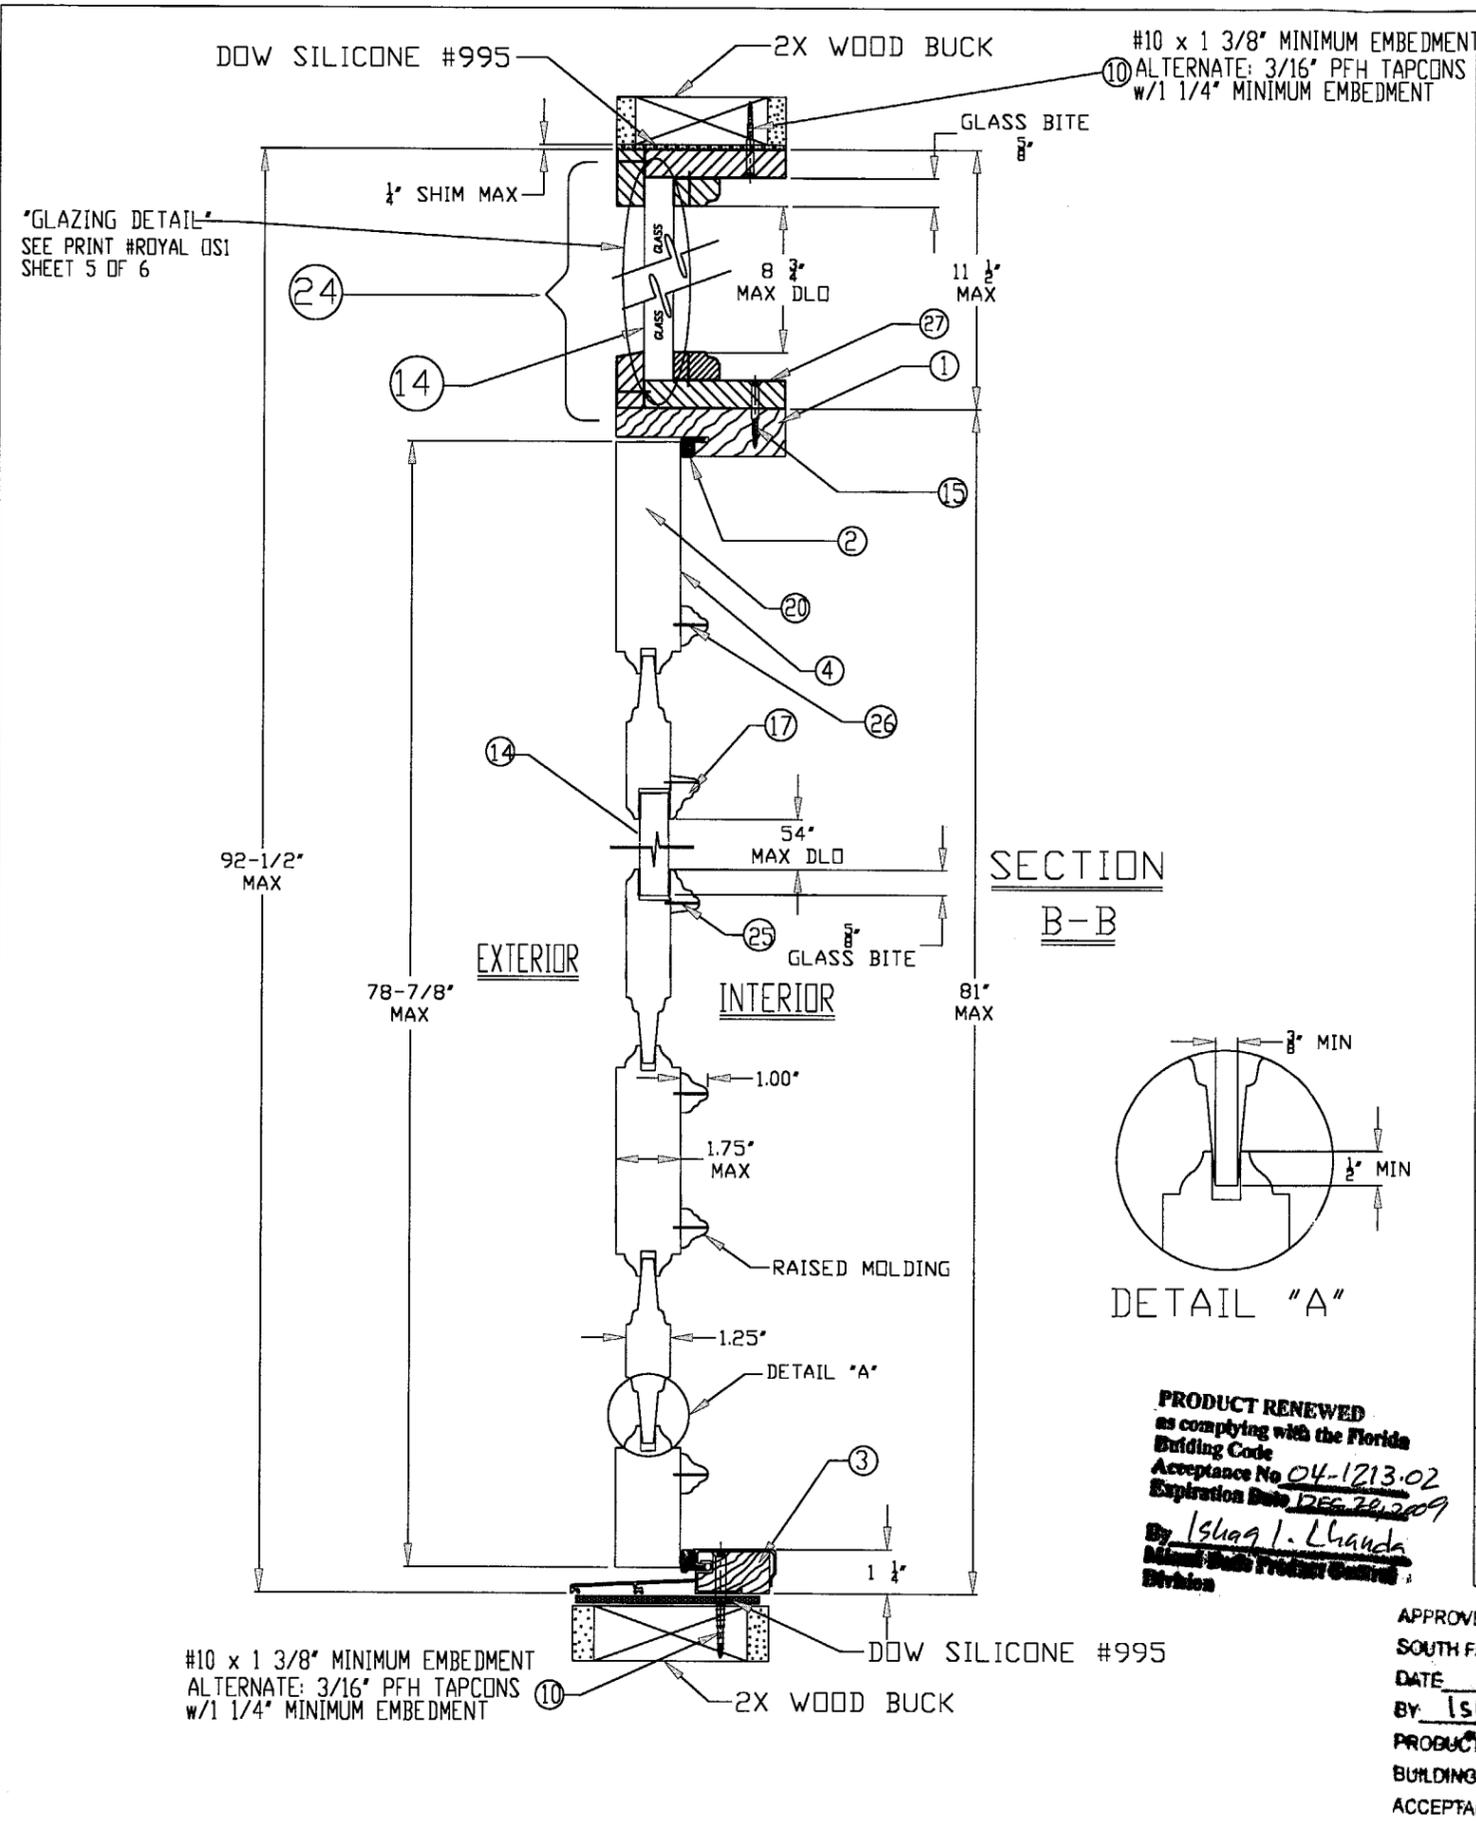

MATERIALS LIST

ITEM NO.	DESCRIPTION	PART NUMBER	COMMENTS
①	WOOD-HEAD JAMB	RO-1	1-1/4" X 4-9/16" MTL. TO BE PINE OR EQUIVALENT
②	COMPRESSION WEATHERSTRIP	RO-2	LOCKSCREEN BRAND LOXSEAL 9650 BRONZE
③	OUTSWING BUMPER THRESHOLD	RO-16	PREMDOR ALUMINUM BUMPER 1-1/4" x 5-5/8"
④	VENEER (Mahogany)		1.4 mm THICK
⑤	4" x 4" HINGE	RO-4	.097" THICK (STEEL), HAGER BRAND
⑥	WOOD HINGE JAMB	RO-6	1-1/4" X 4-9/16" MTL. TO BE PINE OR EQUIVALENT
⑦	WOOD STRIKE JAMB	RO-6	1-1/4" X 4-9/16" MTL. TO BE PINE OR EQUIVALENT
⑧	#10 x 3/4" F.H.W.S.		4 SCREWS PER HINGE INTO DOOR
⑨	#8 x 1-3/4" F.H.W.S.		(4) PER SIDE FROM JAMBS INTO SIDELITE JAMBS (1) THROUGH HEAD AND SILL INTO SIDELITE
⑩	#10 F.H.W.S. WITH 1 3/8" MINIMUM EMBEDMENT OR 3/16" PFH TAPCONS W/MINIMUM 1 1/4" EMBEDMENT		REFER TO ELEVATION VIEW FOR # OF SCREWS USED AND SCREW LOCATIONS.
⑪	#10 x 3/4" F.H.W.S.		(3) PER HINGE INTO JAMB
⑫	#8 x 1-3/4" F.H.W.S.		(2) AT EACH STRIKE PLATE, 1 AT EACH HINGE
⑬	LOCKSET (KWIKSET BRAND)		KWIKSET (TITAN) SERIES 720 FOR LOCK KWIKSET (TITAN) SERIES 780 FOR DEADBOLT
⑭	3/4" THICK I.G. GLASS		PLEASE SEE "GLAZING DETAILS"
⑮	#8 x 1-3/4" F.H.W.S.		(5) FROM TRANSOM TO HEADER, 1ST SCREW 6" IN FROM JAMB SPACING NOT TO EXCEED 12" MAX O.C. THEREAFTER
⑯	OUTER SIDELITE JAMB	RO-7	1-1/4" X 4-9/16" MTL. TO BE PINE OR EQUIVALENT
⑰	GLASS STOP (WOOD)	RO-8	5/16" x 1/2" MTL. TO BE PINE OR EQUIVALENT
⑱	INTERIOR MULL (MAHOGANY)	RO-9	1-1/8" X 15/32" - ITEMS ARE MOLDINGS FOR "SIDE TO SIDE JAMBS" USED AS PART OF MULLION
⑲	EXTERIOR MULL (MAHOGANY)	RO-10	7/8" X 1 1/2" - ITEMS ARE MOLDINGS FOR "SIDE TO SIDE JAMBS" USED AS PART OF MULLION
⑳	DOOR PANEL		MTL. TO BE "OLD GROWTH MAHOGANY"
㉑	1/4 ROUND TRIM	RO-12	1/4" x 1/4"
㉒	MIDDLE SIDELITE JAMB	RO-13	1-1/4" X 4-9/16" MTL. TO BE PINE OR EQUIVALENT
㉔	TRANSOM	RO-15	3/4" X 3-13/16" JAMB- MTL. TO BE PINE OR EQUIVALENT
㉕	4D FINISHING NAIL		1 1/4" LONG NAIL, 6" IN FROM END, MAX 8" O.C. USED ON GLASS STOPS, MULLIONS AND MOLDING
㉖	PIN NAIL		3/4" LONG NAIL, 6" IN FROM END, MAX 8" O.C. USED ON RAISED MOLDING & 1/4 ROUND TRIM
㉗	TRANSOM JAMB -TOP & BOTTOM		3/4" x 3-13/16" MTL. TO BE PINE OR EQUIVALENT
㉘	GLASS STOP - INTERIOR		3/4" X 1-3/16" MTL. TO BE PINE OR EQUIVALENT
㉙	GLASS STOP - EXTERIOR		3/4" X 1-1/2" - MTL. TO BE PINE OR EQUIVALENT
㉚	#10 X 2"		6" DOWN FROM HEADER, 16" MAX O.C. THEREAFTER (5) THROUGH EACH SIDELITE JAMB INTO SIDELITE

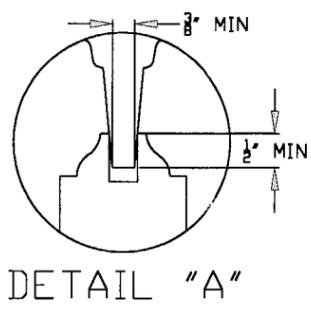

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 04-1213-02
 Expiration Date DEC 20, 2009
 By Ishaq I. Chanda
 Miami State Product Control
 Division

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE Dec 11, 2001
 BY Ishaq I. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-1119-02


LIMITS: UNLESS NOTED, FRAC. DEC. ANG.		A		DADE COUNTY MODIFICATIONS		10/30/00	JD	
APPR. BY	DATE	AREA	LTR.	REVISIONS		DATE	BY	
CK. BY	DATE	WT./FT.	PART NAME: ROYAL DOOR W/SIDELITES--VERTICAL					
DR. BY	DATE		MAT'L:		SCALE:			
PREMDOR ENTRY SYSTEMS PITTSBURG, KANSAS				ROYAL OS1 SHEET 3 OF 6				
							REVISION LETTER A	

"GLAZING DETAIL"
 SEE PRINT #ROYAL OS1
 SHEET 5 OF 6

#10 x 1 3/8" MINIMUM EMBEDMENT
 ALTERNATE: 3/16" PFH TAPCONS
 w/1 1/4" MINIMUM EMBEDMENT

DOW SILICONE #995

2X WOOD BUCK

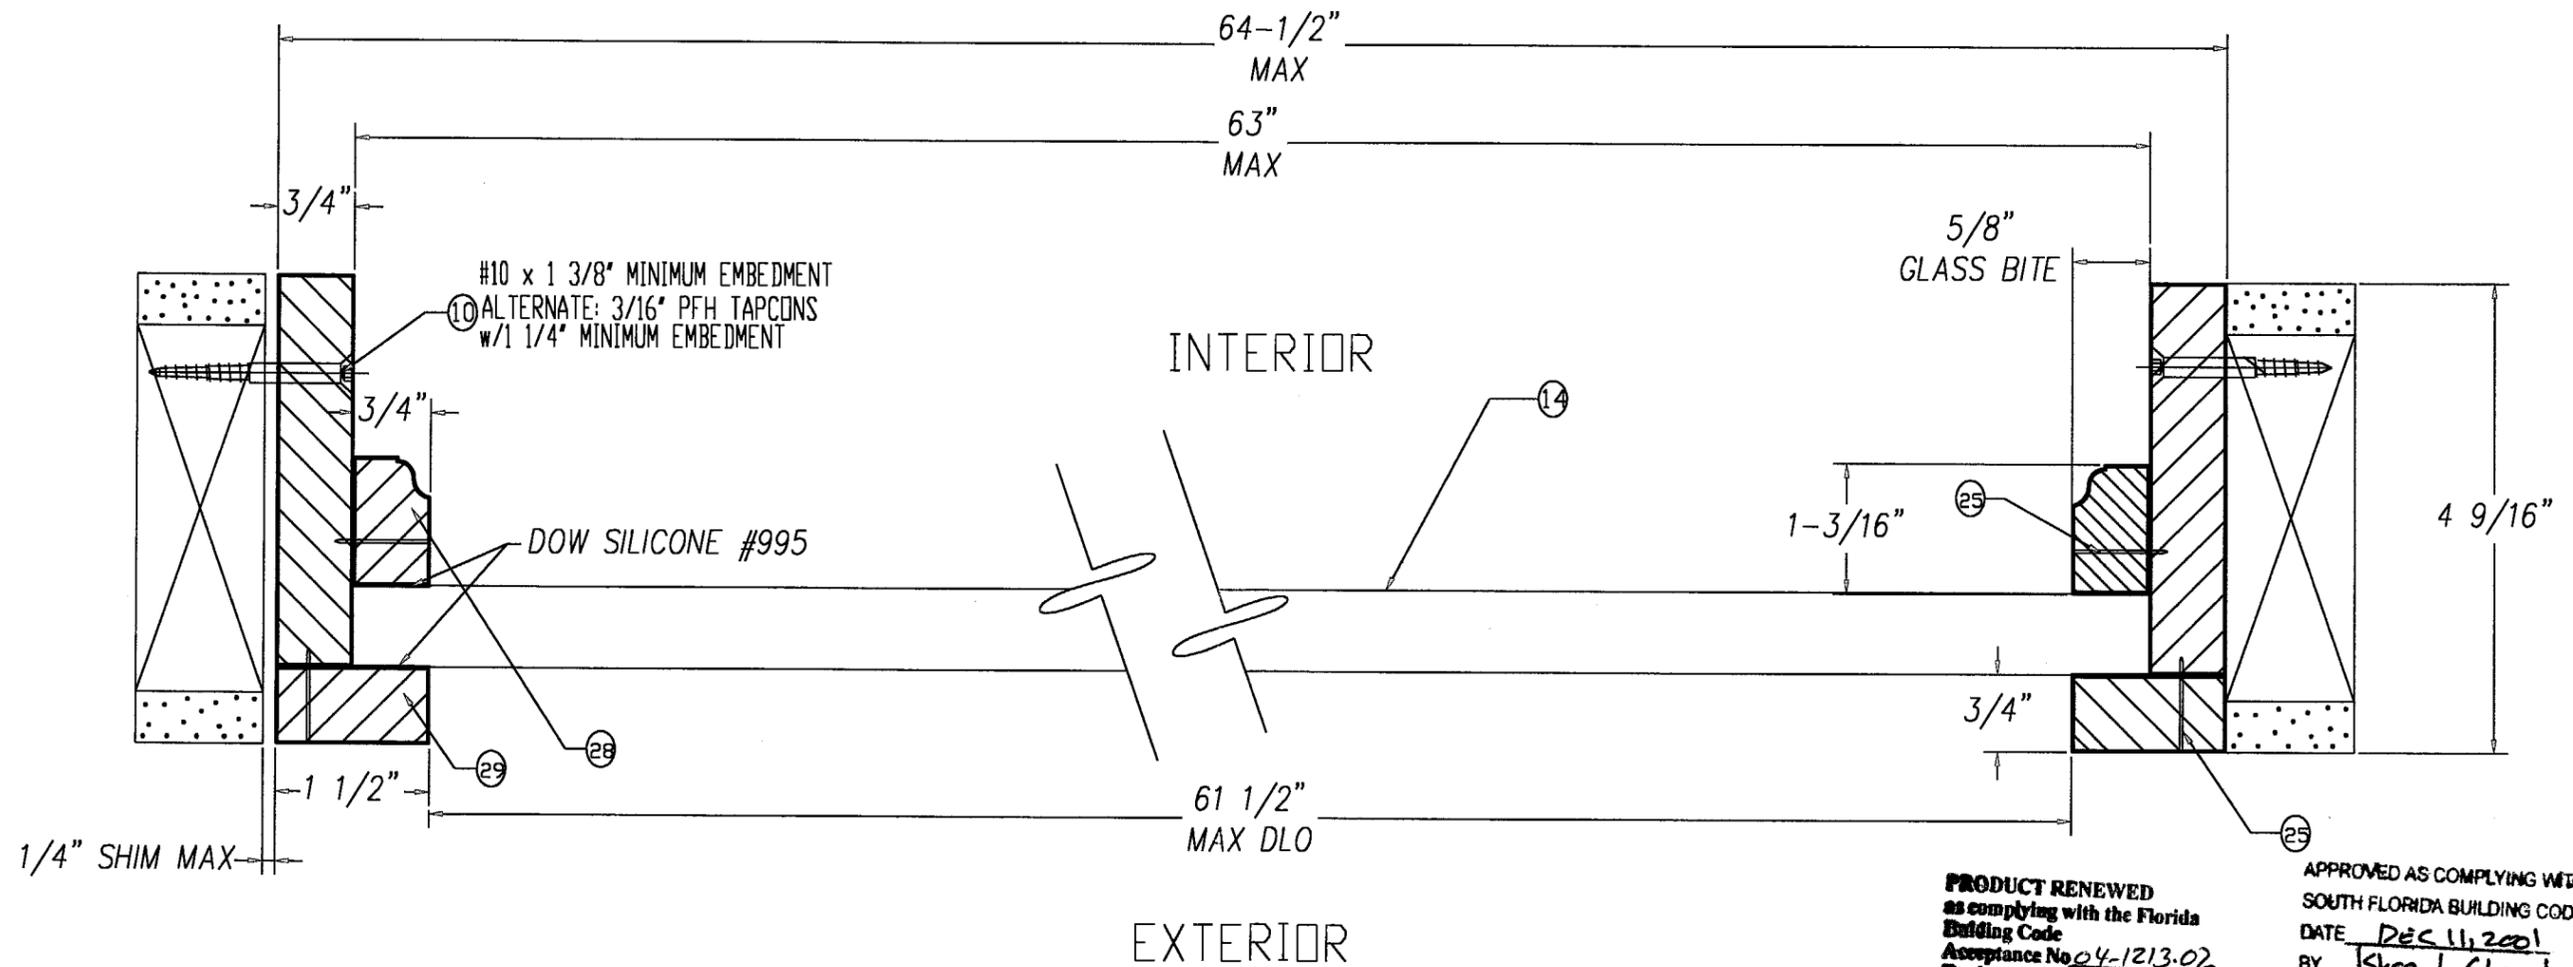


TRANSOM
SECTION D-D

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 04-1213.02
Expiration Date DEC 20, 2009
By Shag I. Chauda
Product Control
Division



APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE Dec 11, 2001
BY Shag I. Chauda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-1119.02

LIMITS: UNLESS NOTED, FRAC. :	DEC. :	ANG. :			
EXTRUSIONS: UNLESS NOTED, STD. COM'L. TOL'S.			A	DADE COUNTY MODIFICATIONS	11/8/00 JD
ENGINEER:			LTR.	REVISIONS	DATE BY
DR. BY JD	DATE 10-6-99		PART NAME: ROYAL DOOR W/SIDELITES -- HORIZONTAL		
			MAT'L:	SCALE:	
PREMDOR ENTRY SYSTEMS 911 E. JEFFERSON PITTSBURG, KS. 66762				ROYAL 051 SHEET 4 OF 6	
				REVISION LETTER A	

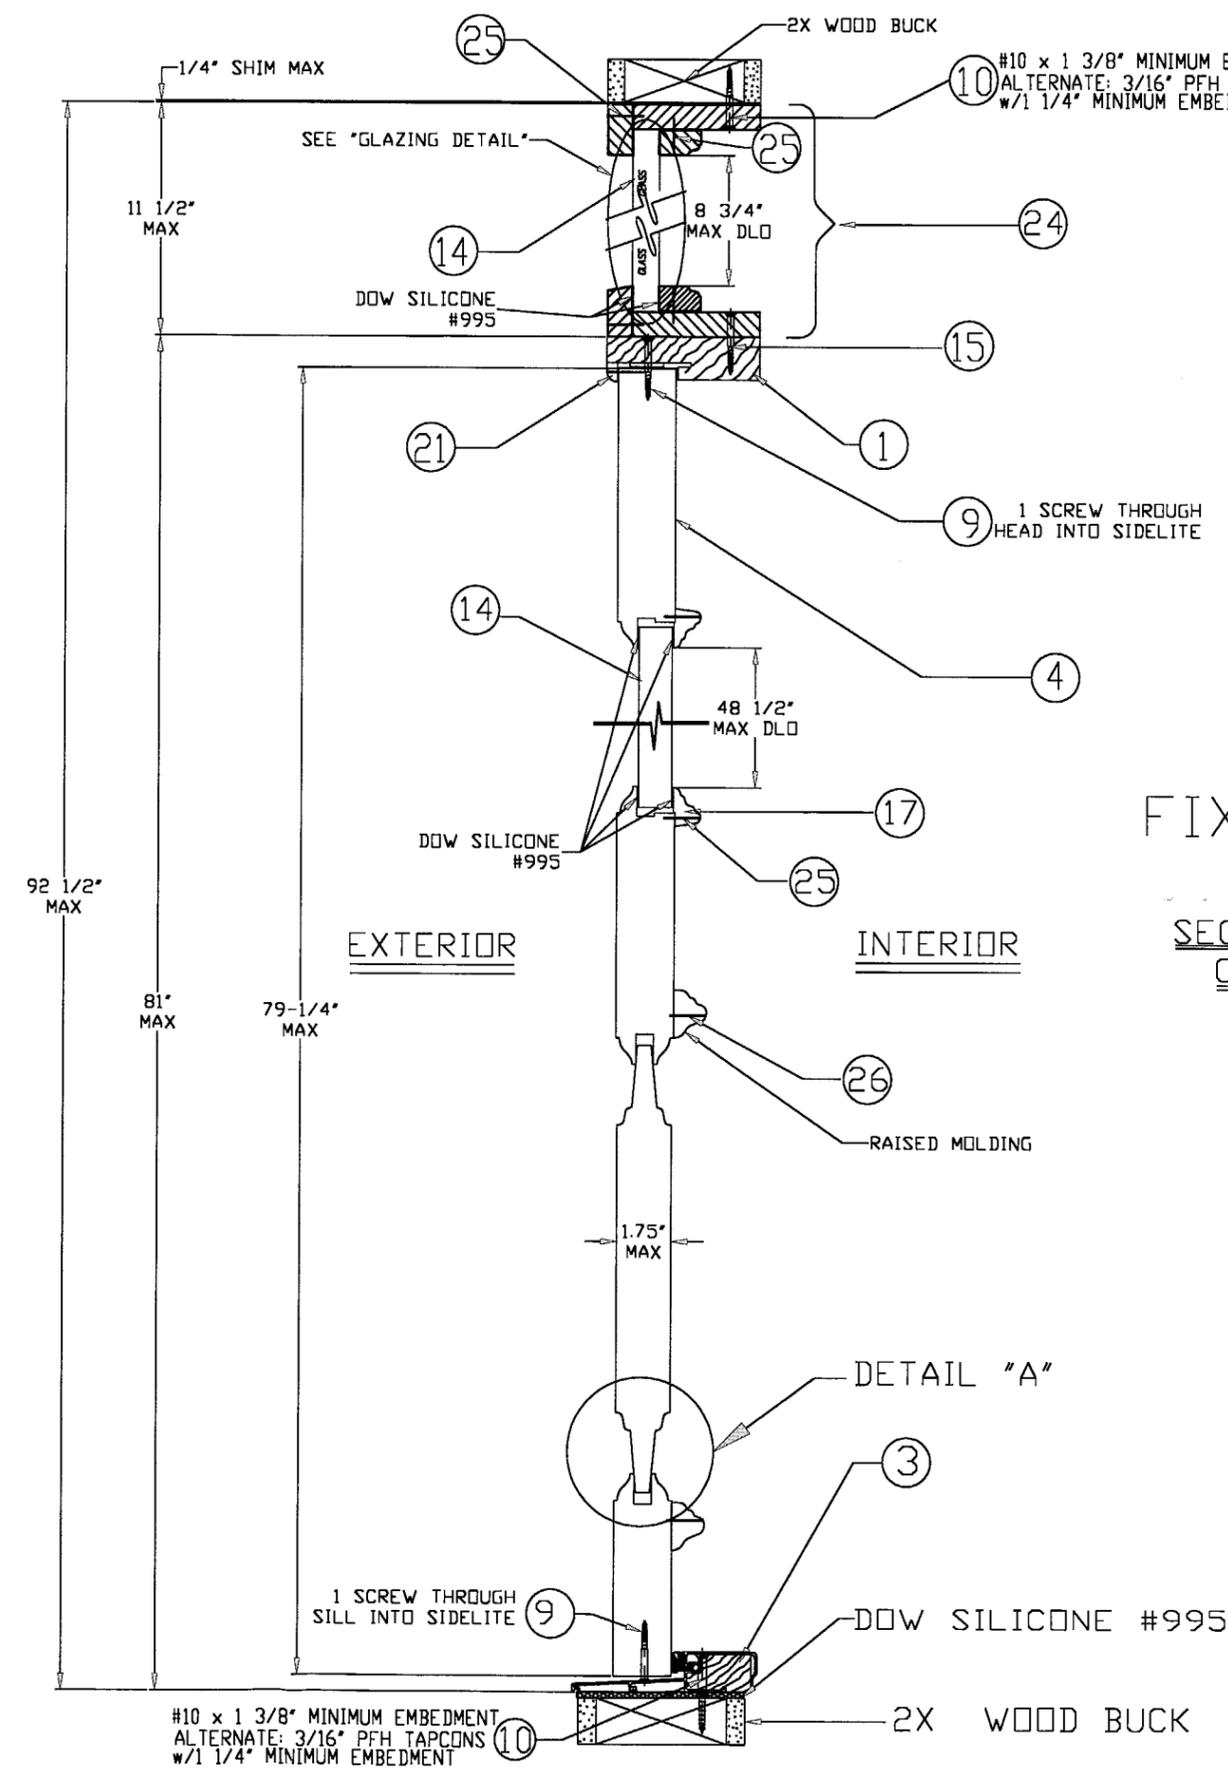

FIXED SIDELITE
SECTION C-C

"GLAZING DETAIL"

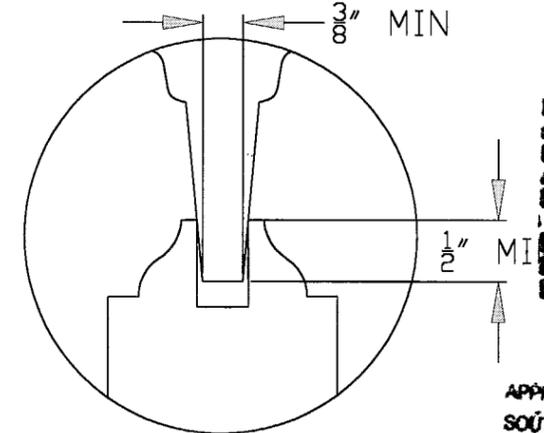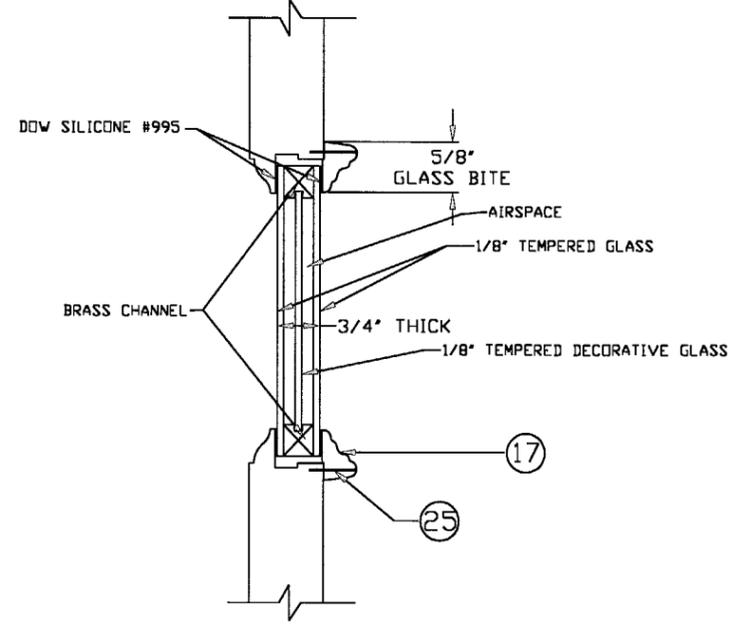

DETAIL "A"

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 04-1213-02
Expiration Date DEC 20, 2009
By Ishaq I. Chande
Product Control Division


APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE DEC 11, 2001
BY Ishaq I. Chande
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-1119-02

LIMITS: UNLESS NOTED, FRAC. : DEC. : ANG. :		A		DADE COUNTY MODIFICATIONS	11/8/00	JD
EXTRUSIONS: UNLESS NOTED, STD. COM'L. TOL'S.		LTR.		REVISIONS	DATE	BY
APPR. BY	DATE	AREA	PART NAME: ROYAL SIDELITE--VERTICAL			
CK. BY	DATE	WT./FT.	SCALE:			
DR. BY J.D.	DATE 10-6-99	MAT'L:				


PREMDOR ENTRY SYSTEMS
PITTSBURG, KANSAS

ROYAL 051
SHEET 5 OF 6


REVISION LETTER A

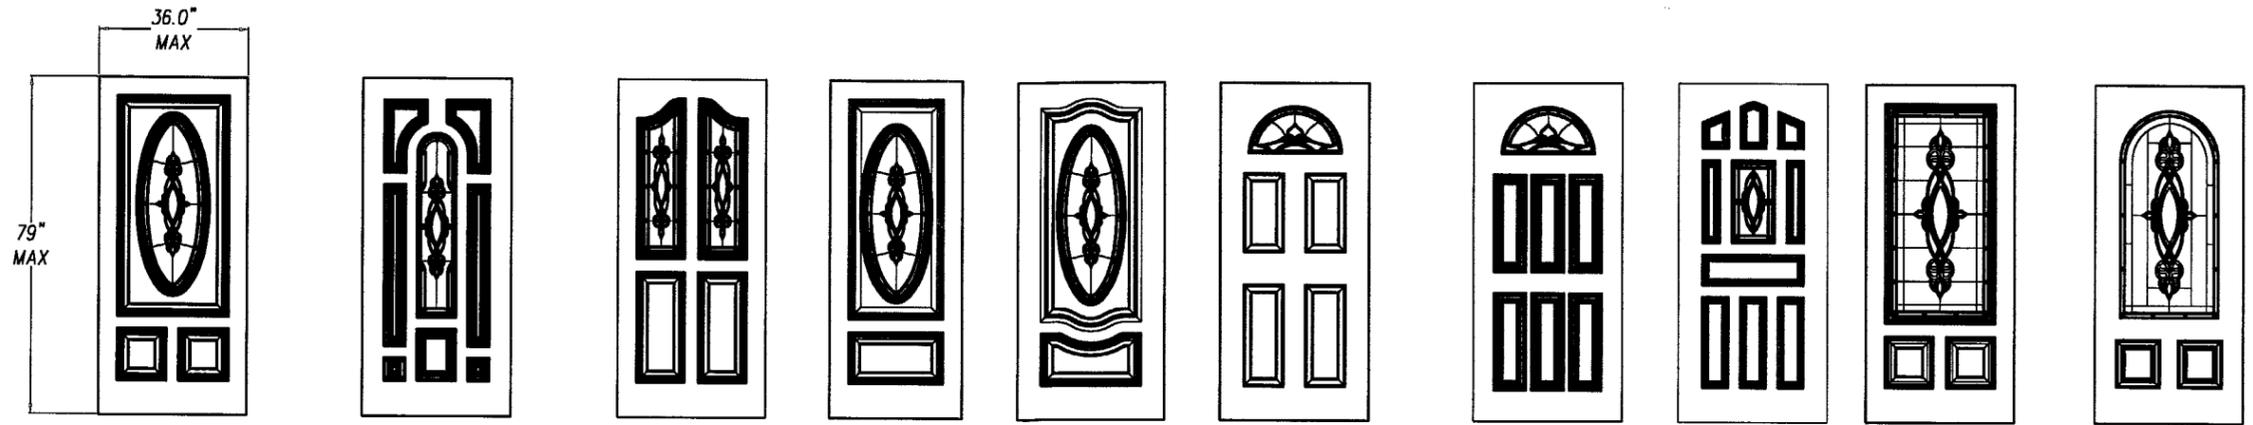

OTHER GLAZED W/DECORATIVE GLASS DOOR PANEL OPTIONS

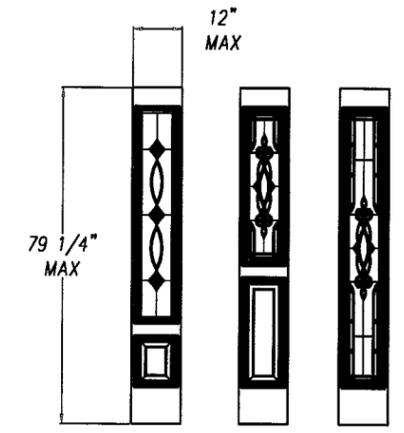

OTHER SIDELITE PANEL OPTIONS

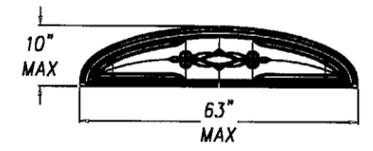

OTHER TRANSOME GLASS LITE OPTIONS

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 04-1213.02
 Expiration Date DEC 30, 2009
 By Ishaq J. Chanda
 Product Control
 Division

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE DECEMBER 11, 2001
 BY Ishaq J. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-1119.02

LIMITS: UNLESS NOTED, FRAC. : DEC. : ANG. :					
EXTRUSIONS: UNLESS NOTED, STD. COMPL. TOL'S.					
APPR. BY	DATE	AREA	LTR.	DADE COUNTY MODIFICATIONS	11/8/00 JD
CK. BY	DATE	WT./FT.	PART NAME:	REVISIONS	DATE BY
DR. BY JD	DATE 10-6-99		MAT'L:	SCALE:	
PREMDOR ENTRY SYSTEMS PITTSBURG, KANSAS				ROYAL 051 SHEET 6 OF 6	
				REVISION LETTER A	