



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

## NOTICE OF ACCEPTANCE (NOA)

**Premdor Entry Systems**  
**One Premdor Drive**  
**Dickson, TN 37055**

### SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

### DESCRIPTION: Inswing Single Glazed Wood Door with Sidelites and Transom

**APPROVAL DOCUMENT:** Drawing No. **Royal is1**, Rev "A", titled "Royal Mahogany" single door w/sidelite/transom, Inswing", dated 10-06-99, sheets 1 through 6 of 6, prepared by manufacture, bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: None: Approved applicable Hurricane protection device complying with FBC is required.**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA # 01-1127.18** consists of this page 1 and evidence pages E-1 as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**

11/21/2005



**NOA No 04-1213.03**  
**Expiration Date: December 20, 2009**  
**Approval Date: February 03, 2005**

Premdor Entry Systems

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

- A. DRAWINGS**
1. Manufacturer's die drawings and sections.
  2. Drawing No. **Royal is1**, Rev "A", titled "Royal Mahogany" single door w/sidelite/transom, Inswing", dated 10-06-99, sheets 1 through 6 of 6, prepared by manufacture.
- B. TESTS** (original test report transferred from file # **01-1127.18**. Tested per SFBC, PA 202-94 now termed as FBC, TAS 202-94)
1. Test Report No. **NCTL-210-2193-1, 2, 3** prepared by National Certified Testing Laboratories, dated 06/21/99, signed and sealed by Barry D. Portnoy, P.E., for the following tests:
    - 1) Air Infiltration Test, per PA 202-94
    - 2) Uniform Static Air Pressure Test, Loading per PA 202-94
    - 3) Water Resistance Test, per PA 202-94 (Not Performed).
    - 4) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94Along with manufacturer's parts and section drawings marked by National Certified Testing Laboratories. This test report was revised by addendum letter dated 11-26-2001, issued by NCTL, signed and sealed by Barry D. Portnoy, P.E.
- C. CALCULATIONS** (original test report transferred from file # **01-1127.18**)
1. Anchor calculations prepared by Product & Application Engineering, Inc., Project No. 99-0902, Report No. 02, dated September 03 1999, revised on September 14, 2001, signed and sealed by Manuel Martinez, P.E.
  2. Glazing complies with ASTM E-1300-98.
- D. MATERIAL CERTIFICATIONS**
1. None
- E. QUALITY ASSURANCE By:**
1. Miami Dade Building Code Compliance Office (BCCO).
- F. STATEMENTS**
1. Stateman letter of conformance, dated 11-29-1999, signed & sealed by Manuel Martinez, P. E.
  2. Statement letter of no financial interest to test lab, dated 11-05-01, signed by Kurt Balthozer, P. E. (Premdor).
  3. Statement letter of compliance dated October 18, 1999, issued by National Certified Testing Laboratories, signed and sealed by Barry D. Portnoy, P.E.
  4. Addendum letters dated 11-24-2001 & 11-26-2001 for Test Report No. **NCTL-210-2193-1, 2 & 3** prepared by National Certified Testing Laboratories, issued by signed and sealed by Barry D. Portnoy, P.E
  5. Renewal requested by Premdor (Masonite) dated September 29, 2004, signed by Steve Schreiber.
- G. OTHER**
1. This NOA **renews** Notice of Acceptance No. **01-1127.18** issued to Premdor Entry Systems, expired on 12/20/04.
  2. Laboratory notes (Raw data) for Test Report No. **NCTL-210-2193-1, 2, 3** supplied via fax dated 11-24-01 by National Certified Testing Laboratories.

*Ishaq I. Chanda*

Ishaq I. Chanda, P.E.  
Product Control Examiner  
NOA No 04-1213.03


Expiration Date: December 20, 2009

Approval Date: February 03, 2005


PREMDOR (ROYAL MAHOGANY)  
 SINGLE DOOR W/SIDELITE/TRANSOM  
 GLAZED IN A WOOD FRAME W/BUMPER  
 THRESHOLD (IN SWING)

NOTES:

- 1.) WOOD BUCKS BY OTHERS. MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
- 2.) THE PRECEDING DRAWINGS ARE INTENDED TO QUALIFY THE FOLLOWING INSTALLATIONS.
- A. WOOD FRAME CONSTRUCTION WHERE DOOR SYSTEM IS ANCHORED TO A MINIMUM TWO BY WOOD OPENING.
- B. MASONRY OR CONCRETE CONSTRUCTION WHERE DOOR SYSTEM IS ANCHORED TO A MINIMUM TWO BY STRUCTURAL WOOD BUCK.
- C. MASONRY OR CONCRETE CONSTRUCTION WHERE DOOR SYSTEM IS ANCHORED DIRECTLY TO CONCRETE OR MASONRY WITH OR WITHOUT A NON-STRUCTURAL ONE BY WOOD BUCK.
3. ALL ANCHORING SCREWS TO BE #10 WITH MINIMUM 1 3/8" EMBEDMENT INTO WOOD SUBSTRATE OR 3/16" PFH TAPCONS WITH 1 1/4" MINIMUM EMBEDMENT INTO MASONRY.
4. UNIT MUST BE INSTALLED WITH "MIAMI-DADE COUNTY APPROVED" SHUTTERS
5. THREE STAPLES PER JAMB INTO HEADER ON SIDELITES AND DOOR, THREE PER JAMB INTO BASE ON SIDELITES AND DOORS.
6. LATEX SEALANT TO BE APPLIED AT SIDE BY SIDE JAMBS, TRANSOM, AND SIDELITES.
7. PERIMETER OF FRAME TO BE CAULKED USING DOW SILICONE #995 OR EQUIVALENT.

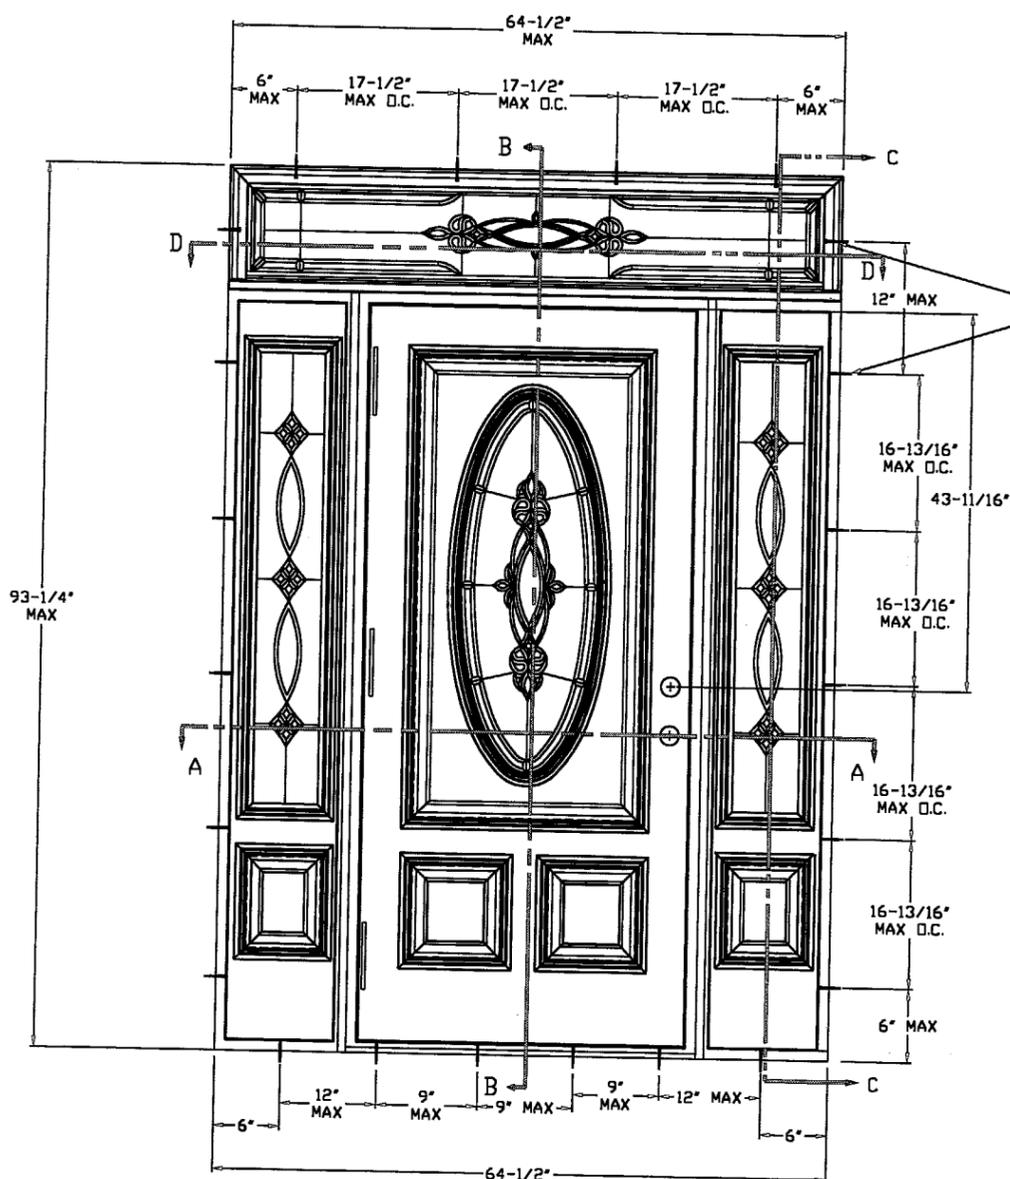

#10 x 1 3/8" MINIMUM EMBEDMENT  
 (6) PER SIDES  
 ALTERNATE: 3/16" PFH TAPCONS  
 w/1 1/4" MINIMUM EMBEDMENT

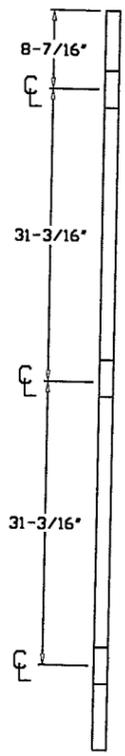


HINGE LOCATIONS

**PRODUCT RENEWED**  
 as complying with the Florida  
 Building Code  
 Acceptance No. 04-1213-D3  
 Expiration Date DEC 20, 2009  
 By Ishag J. Chauda  
 Miami Dade Product Control  
 Division



DESIGN PRESSURE RATINGS		
	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED *	WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED
Positive	Not Approved *	+60.0 psf
Negative	Not Approved *	-65.0 psf

\* UNITS SHALL BE INSTALLED ONLY AT LOCATIONS PROTECTED BY A CANOPY OR OVERHANG SUCH THAT THE ANGLE BETWEEN THE EDGE OF CANOPY OR OVERHANG TO SILL IS LESS THAN 45 DEGREES. UNLESS UNIT IS INSTALLED IN NON-HABITABLE AREAS WHERE THE UNIT AND THE AREA ARE DESIGNED TO ACCEPT WATER INFILTRATION.





OTHER DOOR CONFIGURATIONS

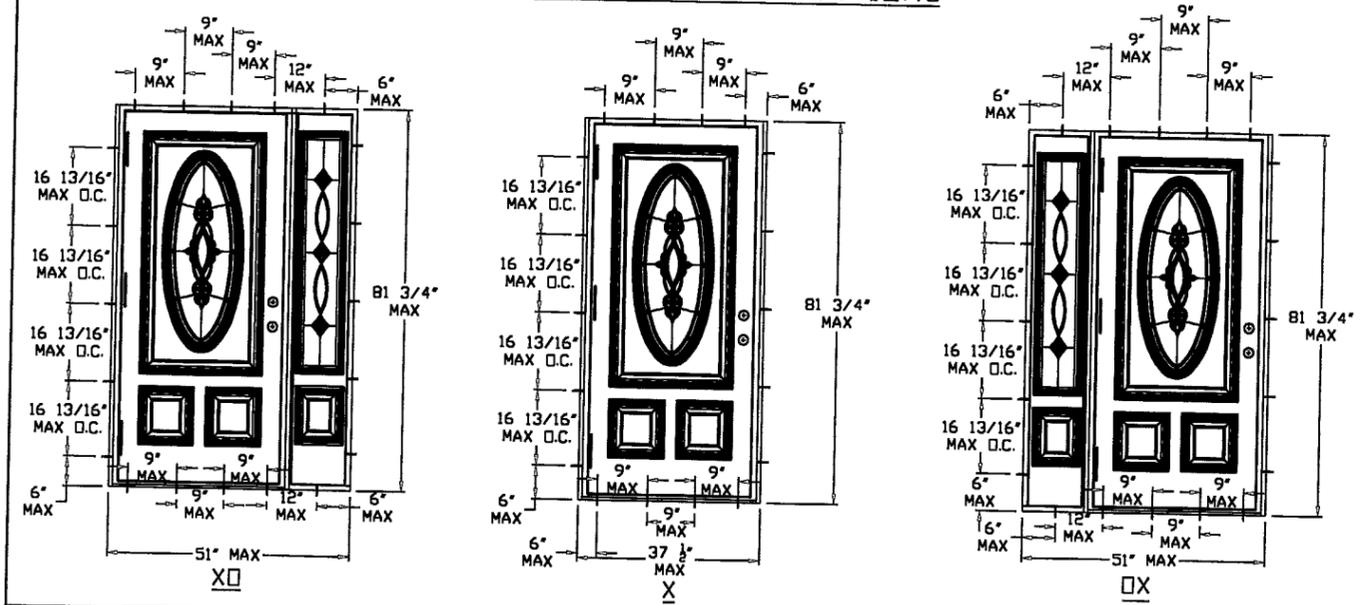

APPROVED AS COMPLYING WITH THE  
 SOUTH FLORIDA BUILDING CODE  
 DATE DECEMBER 20, 2001  
 BY Ishag J. Chauda  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 01-1127-18




LIMITS: UNLESS NOTED, FRAC. : DEC. : ANG. :		A		DADE COUNTY MODIFICATIONS		10/31/00	JD
APPR. BY	DATE	AREA	LTR.	REVISIONS		DATE	BY
CR. BY	DATE	WT./FT.	PART NAME: ROYAL SINGLE W/SIDELITE--ANCHOR INSWING				
DR. BY JD	DATE 10-6-99	MATERIAL:		SCALE:			
PREMDOR ENTRY SYSTEMS PITTSBURG, KANSAS				ROYAL is1 SHEET 1 OF 6			
REVISION LETTER							

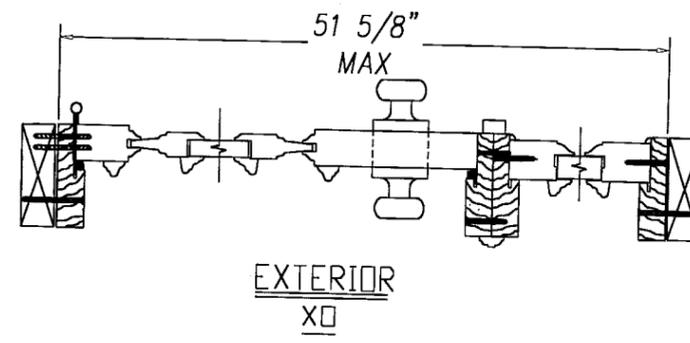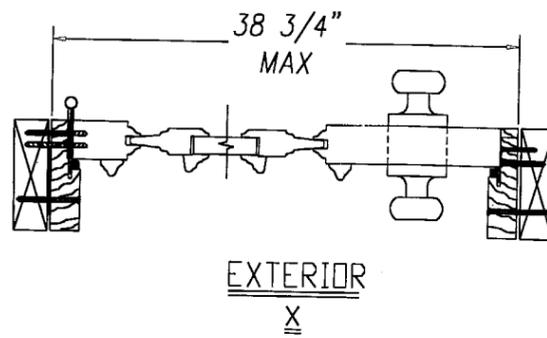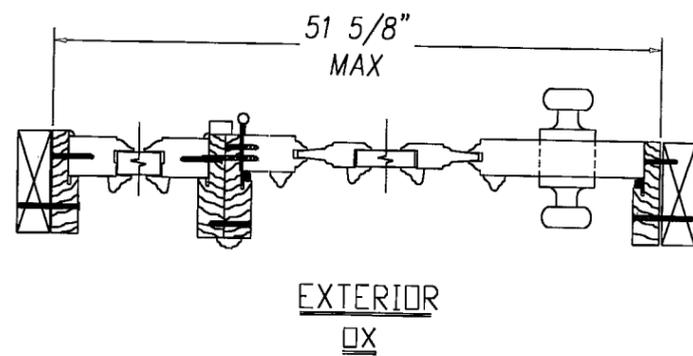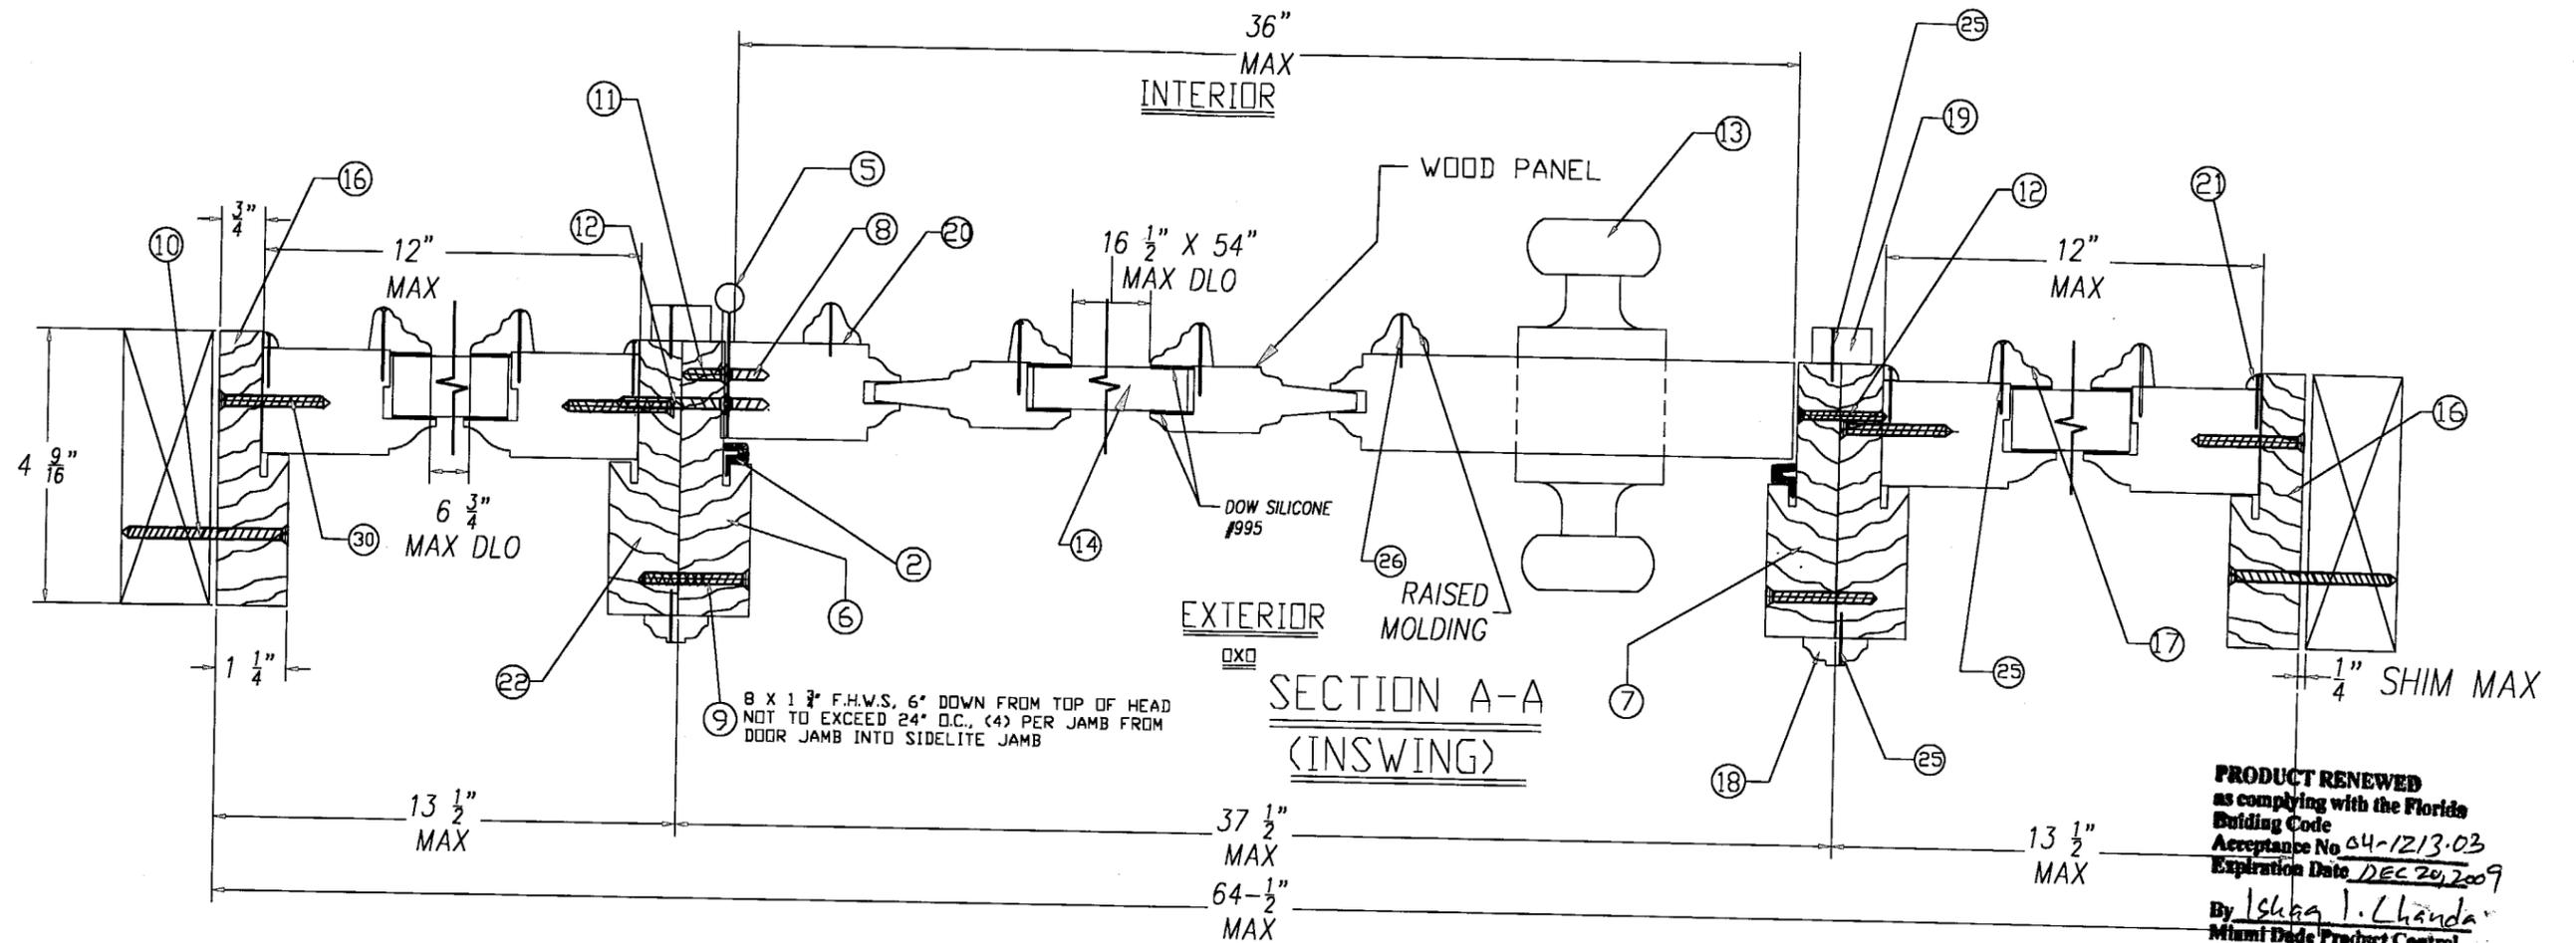

**PRODUCT RENEWED**  
 as complying with the Florida  
 Building Code  
 Acceptance No. 04-1213-03  
 Expiration Date DEC 20, 2009  
 By Ishaq I. Chanda  
 Miami Dade Product Control  
 Division


APPROVED AS COMPLYING WITH THE  
 SOUTH FLORIDA BUILDING CODE  
 DATE DEC 20, 2001  
 BY Ishaq I. Chanda  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 01-1127-18

LIMITS: UNLESS NOTED, FRAC. : DEC. : ANG. :			
EXTRUSIONS: UNLESS NOTED, STD. COMPL. TOL'S.			
ENGINEER:	A	DADE COUNTY MODIFICATIONS	11/8/00 JD
DR. BY JD	LTR.	REVISIONS	DATE BY
DATE 10-6-99	PART NAME: ROYAL DOOR W/SIDELITES -- HORIZONTAL	SCALE:	
PREMDOR ENTRY SYSTEMS		ROYAL is1	
911 E. JEFFERSON		SHEET 2 OF 6	
PITTSBURG, KS. 66762		REVISION LETTER A	

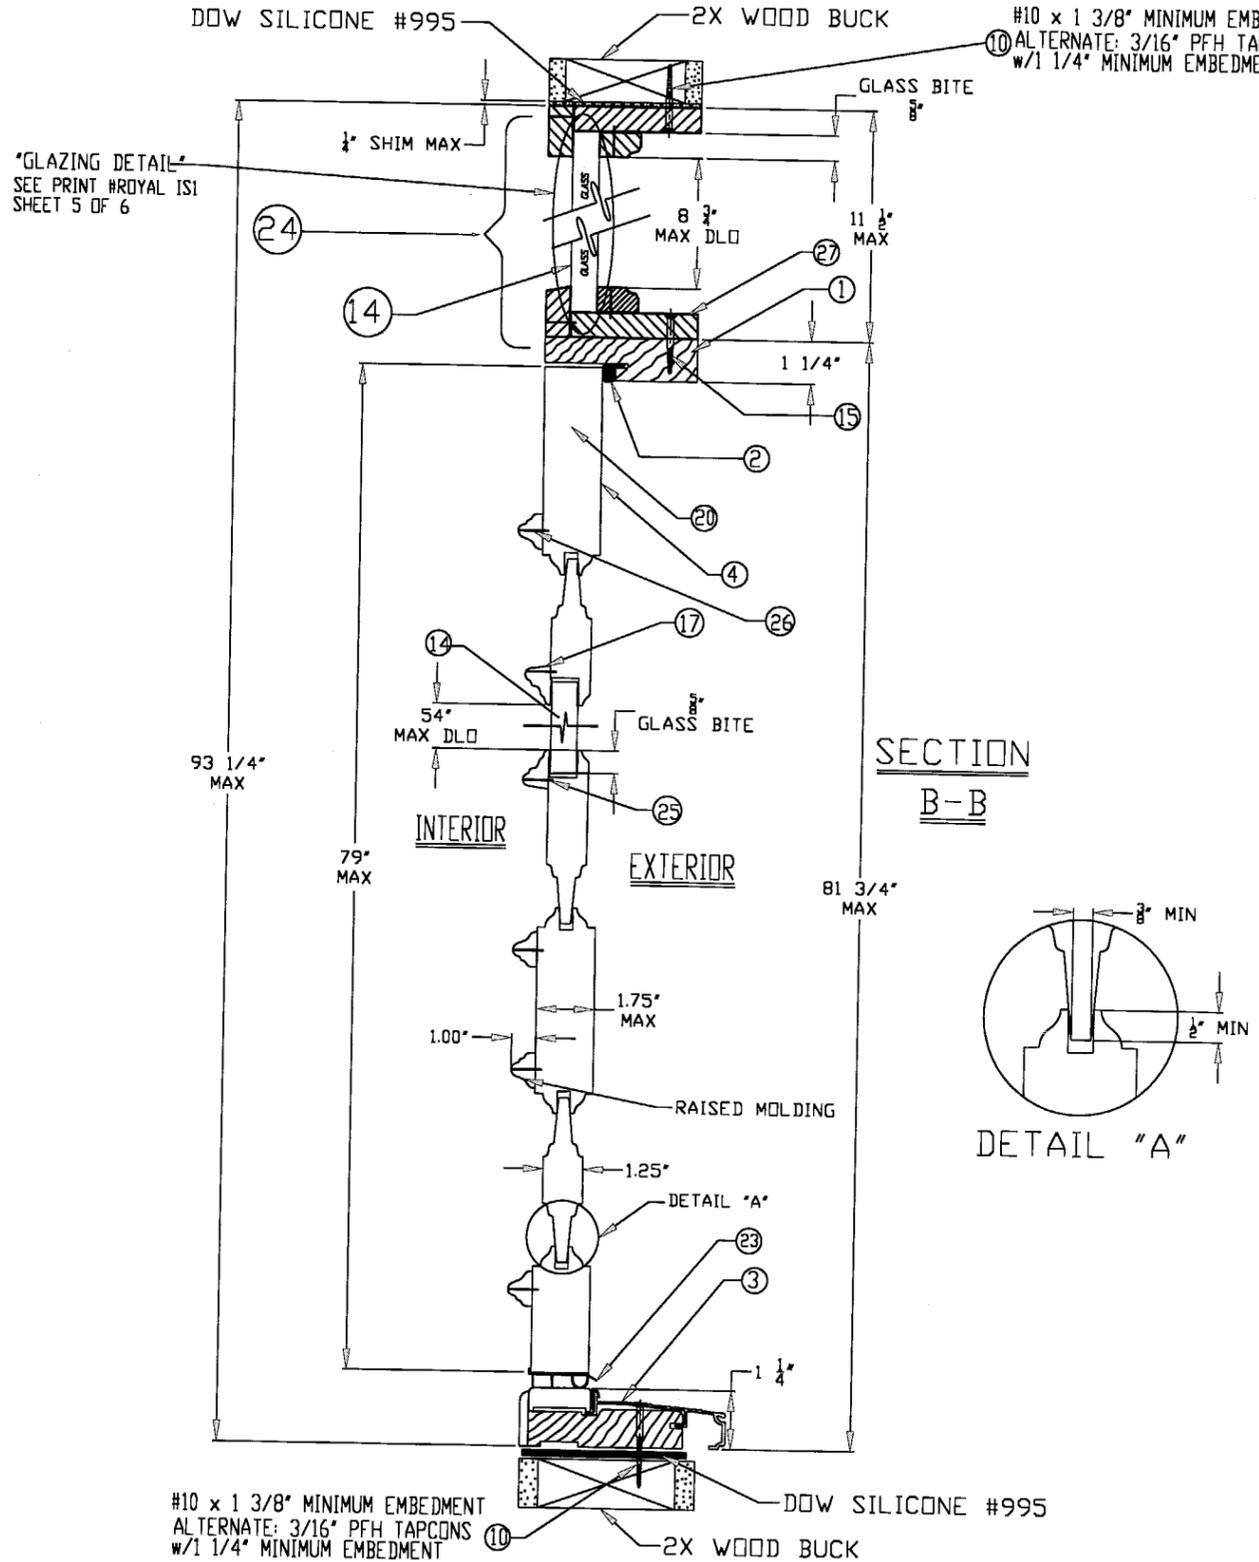

"GLAZING DETAIL"  
SEE PRINT #ROYAL IS1  
SHEET 5 OF 6

SECTION  
B-B



MATERIALS LIST

ITEM NO.	DESCRIPTION	PART NUMBER	COMMENTS
①	WOOD-HEAD JAMB	RO-1	1-1/4" X 4-9/16" MTL. TO BE PINE OR EQUIVALENT
②	COMPRESSION WEATHERSTRIP	RO-2	LOCKSCREEN BRAND LOXSEAL 9650 BRONZE
③	OAK/ALUMINUM ADJ. THRESHOLD	RO-3	PREMDOR OAK/ALUMINUM SILL 1-1/4" x 5-5/8"
④	VENEER (MAHOGANY)		1.4 mm THICK
⑤	4" x 4" HINGE	RO-4	.097" THICK (STEEL), HAGER BRAND
⑥	WOOD HINGE JAMB	RO-6	1-1/4" X 4-9/16" MTL. TO BE PINE OR EQUIVALENT
⑦	WOOD STRIKE JAMB	RO-6	1-1/4" X 4-9/16" MTL. TO BE PINE OR EQUIVALENT
⑧	#10 x 3/4" F.H.W.S.		4 SCREWS PER HINGE INTO DOOR
⑨	#8 x 1-3/4" F.H.W.S.		(4) PER SIDE FROM JAMBS INTO SIDELITE JAMBS (1) THROUGH HEAD AND SILL INTO SIDELITE
⑩	#10 F.H.W.S. WITH 1 3/8" MINIMUM EMBEDMENT OR 3/16" PFH TAPCONS W/MINIMUM 1 1/4" EMBEDMENT		REFER TO ELEVATION VIEW FOR # OF SCREWS USED AND SCREW LOCATIONS.
⑪	#10 x 3/4" F.H.W.S.		(3) PER HINGE INTO JAMB
⑫	#8 x 1-3/4" F.H.W.S.		(2) AT EACH STRIKE PLATE, 1 AT EACH HINGE
⑬	LOCKSET (KWIKSET BRAND)		KWICKSET (TITAN) SERIES 720 FOR LOCK KWICKSET (TITAN) SERIES 780 FOR DEADBOLT
⑭	3/4" THICK I.G. GLASS		PLEASE SEE "GLAZING DETAILS"
⑮	#8 x 1-3/4" F.H.W.S.		(5) FROM TRANSOM TO HEADER, 1ST SCREW 6" IN FROM JAMB SPACING NOT TO EXCEED 12" MAX O.C. THEREAFTER
⑯	OUTER SIDELITE JAMB	RO-7	1-1/4" X 4-9/16" MTL. TO BE PINE OR EQUIVALENT
⑰	GLASS STOP (WOOD)	RO-8	5/16" x 1/2" MTL. TO BE PINE OR EQUIVALENT
⑱	INTERIOR MULL (MAHOGANY)	RO-9	1-1/8" X 15/32" - ITEMS ARE MOLDINGS FOR "SIDE TO SIDE JAMBS" USED AS PART OF MULLION
⑲	EXTERIOR MULL (MAHOGANY)	RO-10	7/8" X 1 1/2" - ITEMS ARE MOLDINGS FOR "SIDE TO SIDE JAMBS" USED AS PART OF MULLION
⑳	DOOR PANEL		MTL. TO BE "OLD GROWTH MAHOGANY"
㉑	1/4 ROUND TRIM	RO-12	1/4" x 1/4"
㉒	MIDDLE SIDELITE JAMB	RO-13	1-1/4" X 4-9/16" MTL. TO BE PINE OR EQUIVALENT
㉓	BOTTOM SWEEP	RO-14	RJF KERSEAL EXTRUSIONS- PVC SWEEP
㉔	TRANSOM	RO-15	3/4" X 3-13/16" JAMB- MTL. TO BE PINE OR EQUIVALENT
㉕	4D FINISHING NAIL		1 1/4" LONG NAIL, 6" IN FROM END, MAX 8" O.C. USED ON GLASS STOPS, MULLIONS & MOLDING
㉖	PIN NAIL		3/4" LONG NAIL, 6" IN FROM END, MAX 8" O.C. USED ON RAISED MOLDING & 1/4 ROUND TRIM
㉗	TRANSOM JAMB -TOP & BOTTOM		3/4" x 3-13/16" MTL. TO BE PINE OR EQUIVALENT
㉘	GLASS STOP - EXTERIOR		3/4" X 1-3/16" MTL. TO BE PINE OR EQUIVALENT
㉙	GLASS STOP - INTERIOR		3/4" X 1-1/2" - MTL. TO BE PINE OR EQUIVALENT
㉚	#10 x 2" F.H.W.S		6" DOWN FROM HEAD, 16" MAX O.C. THEREAFTER (5) THROUGH EACH SIDELITE JAMB INTO SIDELITE

#10 x 1 3/8" MINIMUM EMBEDMENT  
ALTERNATE: 3/16" PFH TAPCONS  
W/1 1/4" MINIMUM EMBEDMENT

**PRODUCT RENEWED**  
as complying with the Florida  
Building Code  
Acceptance No. 04-1213-03  
Expiration Date DEC 2012  
By Ishag I. Chanda  
Miami-Dade Product Control  
Division


APPROVED AS COMPLYING WITH THE  
FLORIDA BUILDING CODE  
DATE DEC 29, 2001  
BY Ishag I. Chanda  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 01-1127.18

LIMITS: UNLESS NOTED, FRAC. :		DEC. :		ANG. :	
EXTRUSIONS: UNLESS NOTED, STD. COM'L. TOL'S.		A		DADE COUNTY MODIFICATIONS	
APPR. BY	DATE	AREA	LTR.	REVISIONS	10/30/00 JD
CK. BY	DATE	WT./FT.	PART NAME: ROYAL DOOR W/SIDELITES--VERTICAL		DATE BY
DR. BY JD	DATE 10-6-99	MAT'L:		SCALE:	

PREMDOR ENTRY SYSTEMS  
PITTSBURG, KANSAS

ROYAL IS1  
SHEET 3 OF 6

REVISION LETTER A



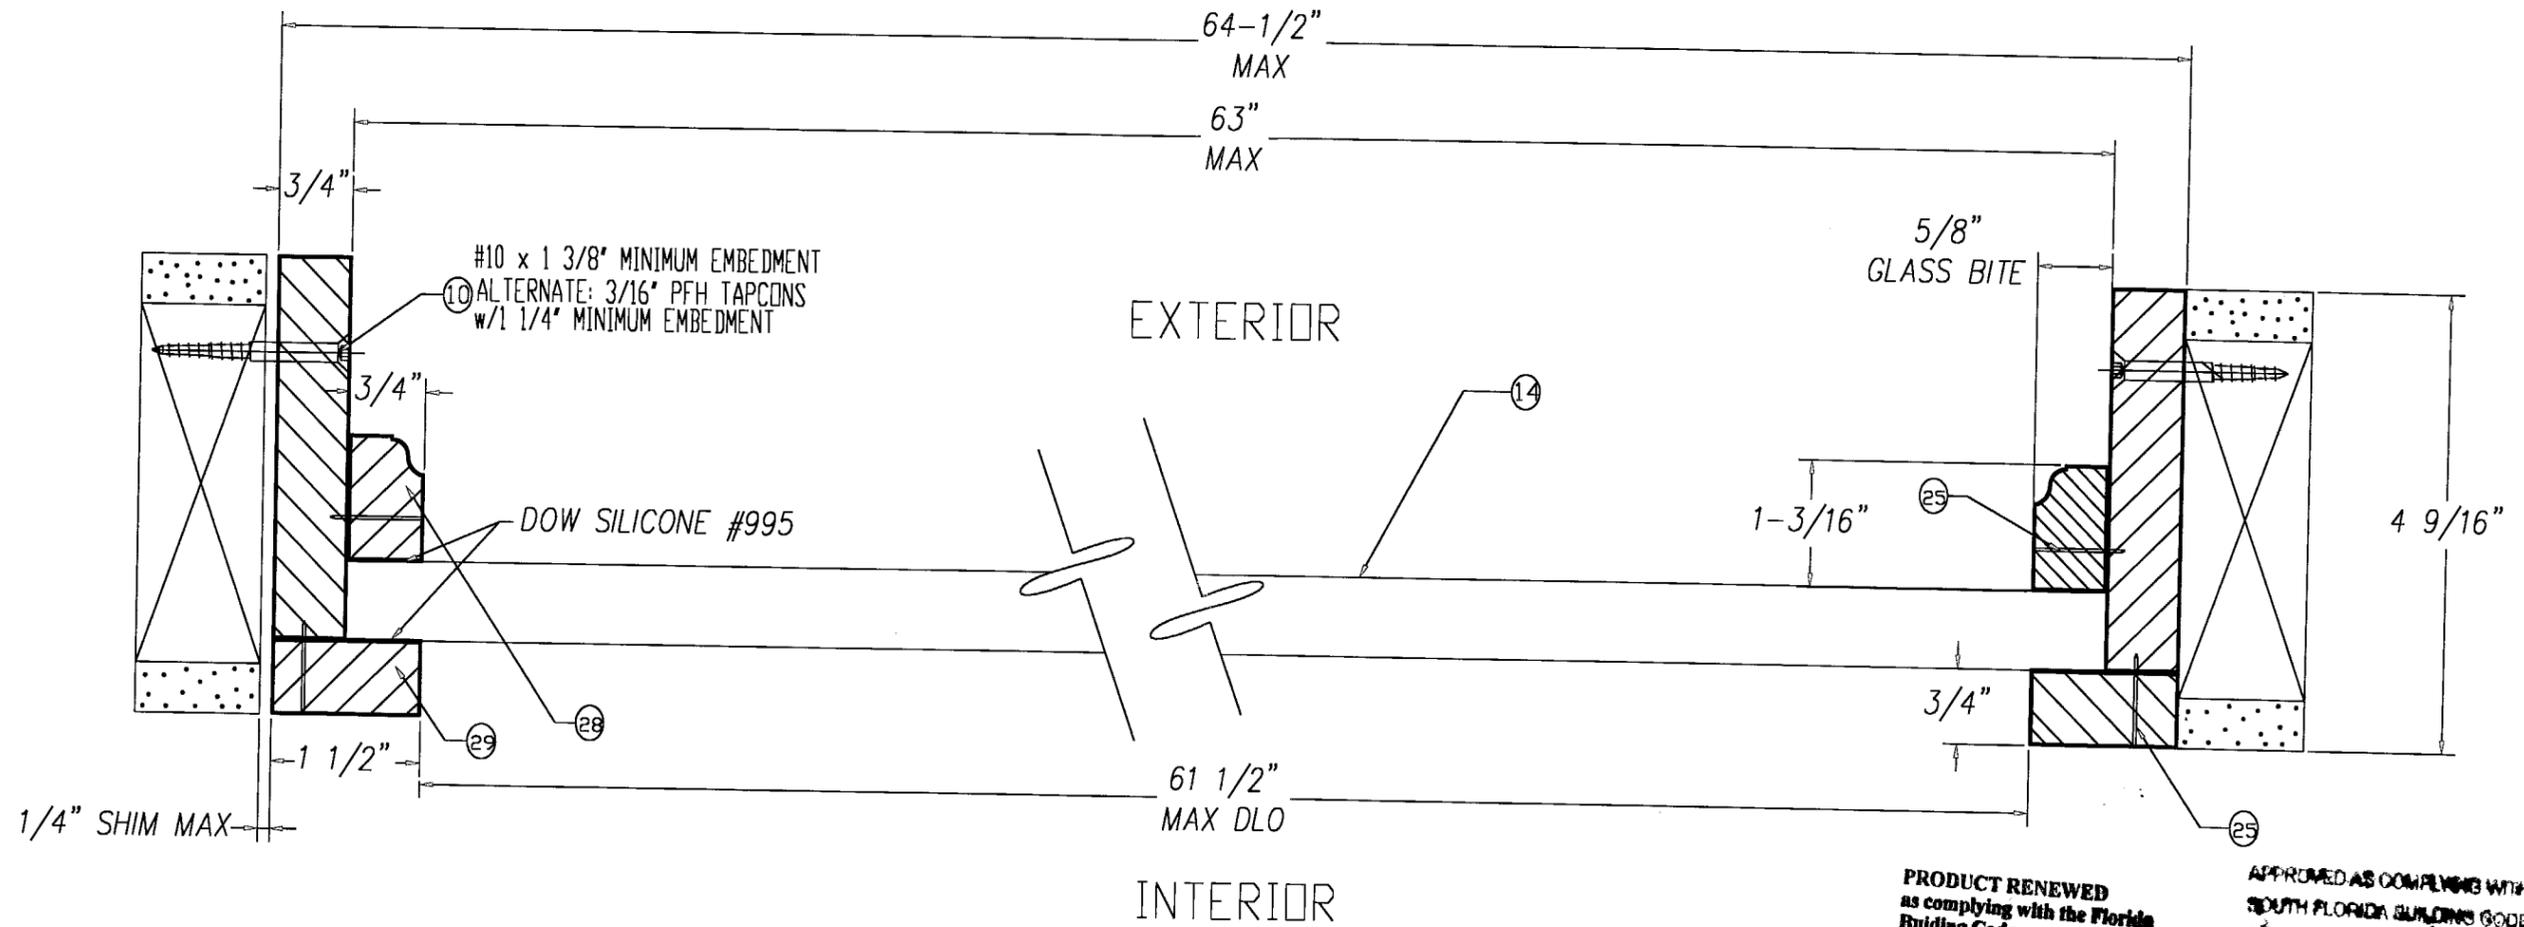


TRANSOM  
SECTION D-D

PRODUCT RENEWED  
as complying with the Florida  
Building Code  
Acceptance No. 04-121303  
Expiration Date DEC 20, 2009  
By Ishag I. Chanda  
Miami World Product Control  
Division

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE Dec 20, 2001  
BY Ishag I. Chanda  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 01-1127-08

LIMITS: UNLESS NOTED, FRAC. : DEC. : ANG. :					
EXTRUSIONS: UNLESS NOTED, STD. COM'L. TOL'S.		A DADE COUNTY MODIFICATIONS		11/8/00	JD
ENGINEER:		LTR. REVISIONS		DATE	BY
DR. BY JD DATE 10-6-99		PART NAME: ROYAL DOOR W/SIDELITES --- HORIZONTAL		SCALE:	
PREMDOR ENTRY SYSTEMS 911 E. JEFFERSON PITTSBURG, KS. 66762		ROYAL is1 SHEET 4 OF 6		REVISION LETTER A	

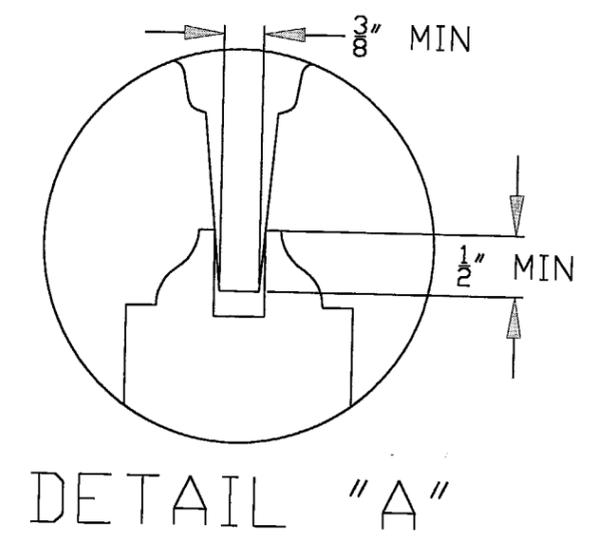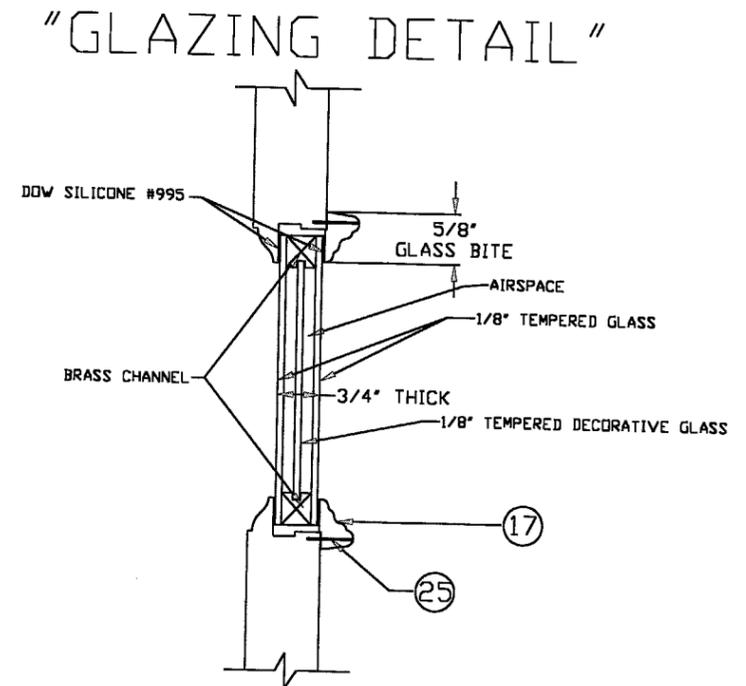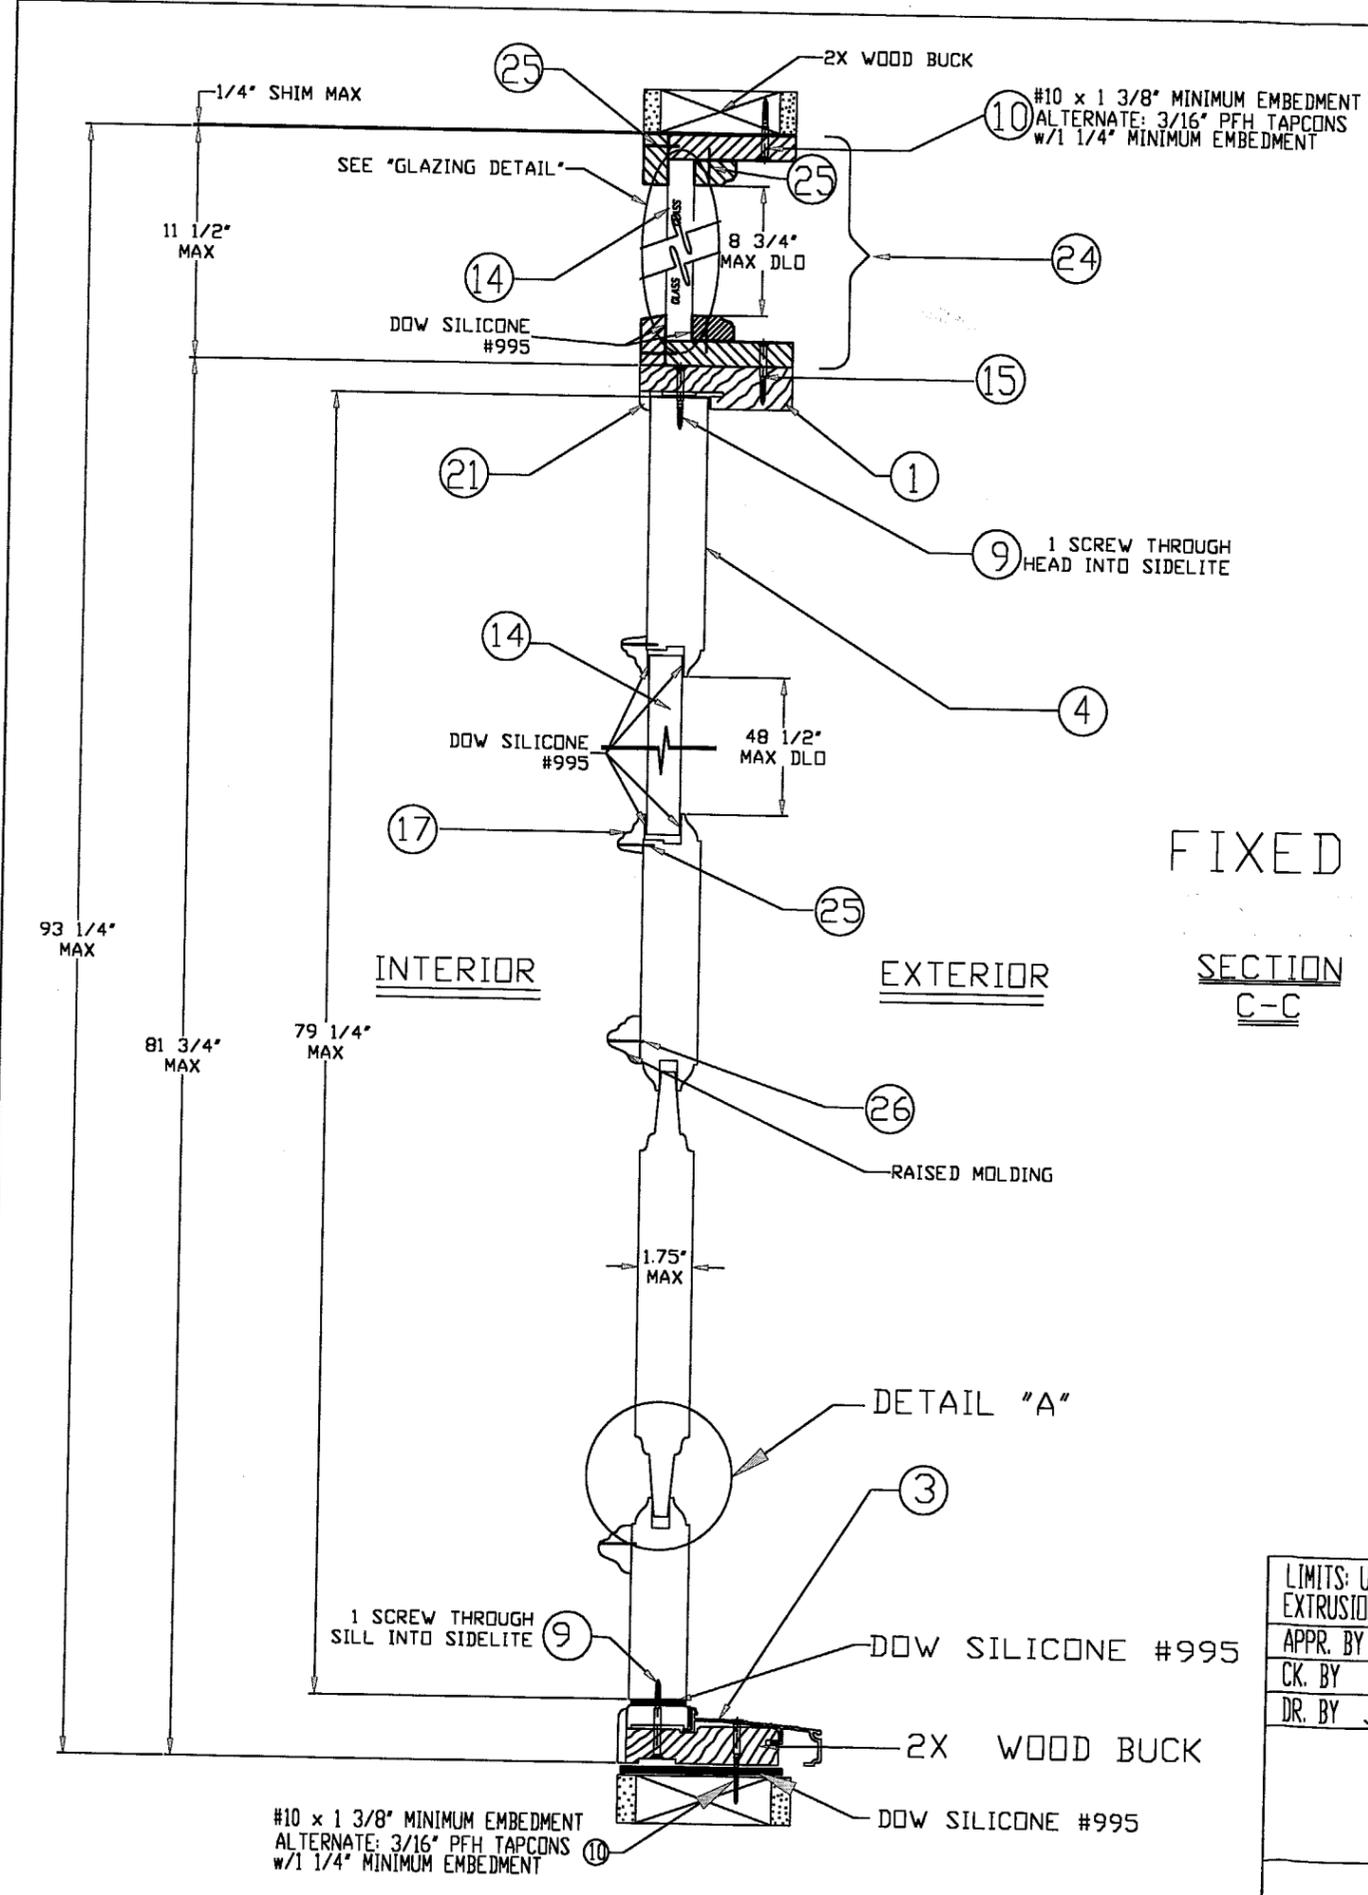


FIXED SIDELITE

SECTION C-C


PRODUCT RENEWED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 04-1213-03  
 Expiration Date DEC 20, 2009  
 By Ishaq I. Chanda  
 Miami Dade Product Control  
 Division

APPROVED AS COMPLYING WITH THE  
 SOUTH FLORIDA BUILDING CODE  
 DATE DEC 20, 2001  
 BY Ishaq I. Chanda  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 01-1127-18


LIMITS: UNLESS NOTED, FRAC. : DEC. : ANG. :					
EXTRUSIONS: UNLESS NOTED, STD. COM'L. TOL'S.					
APPR. BY	DATE	AREA	A	DADE COUNTY MODIFICATIONS	11/8/00 JD
CK. BY	DATE	WT./FT.	LTR.	REVISIONS	DATE BY
DR. BY J.D.	DATE 10-6-99			PART NAME: ROYAL SIDELITE--VERTICAL	
			MAT'L:	SCALE:	
PREMDOR ENTRY SYSTEMS PITTSBURG, KANSAS				ROYAL is1 SHEET 5 OF 6	
					REVISION LETTER A

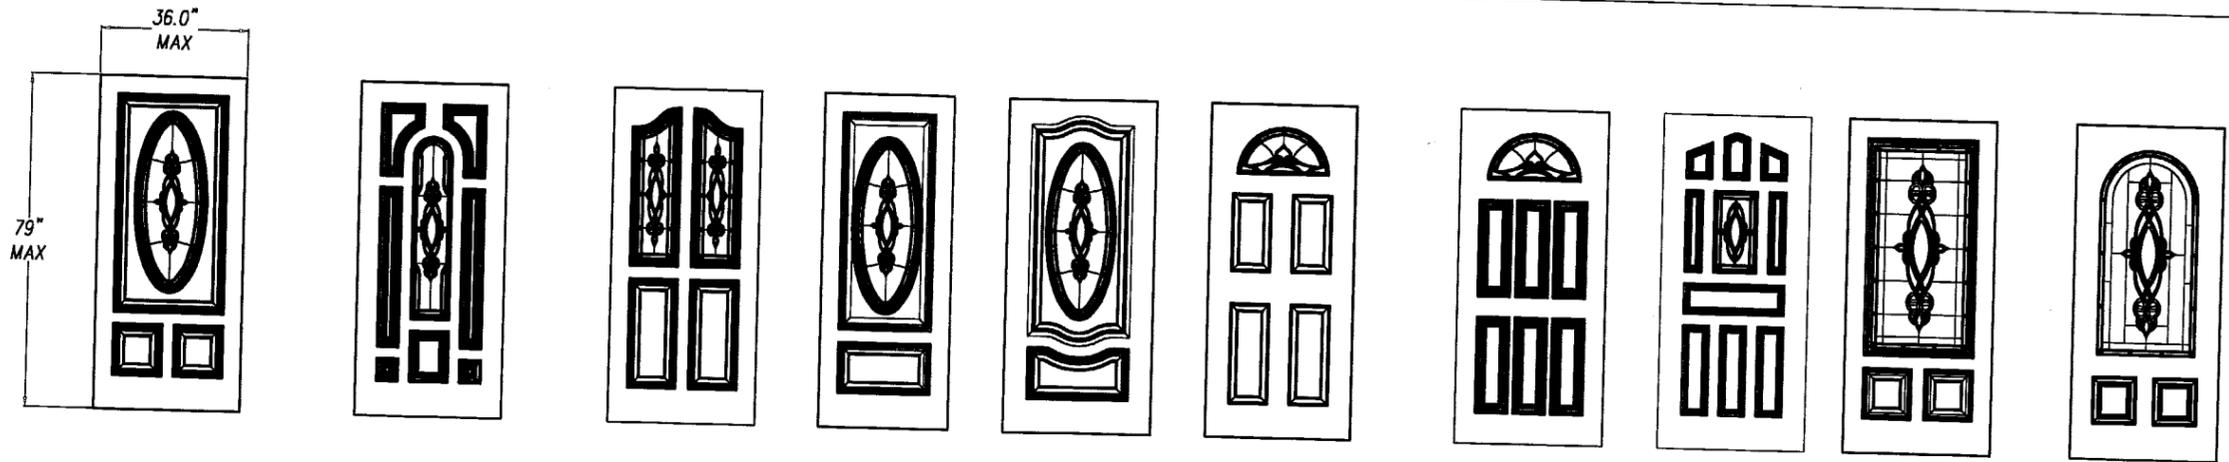

OTHER GLAZED W/DECORATIVE GLASS DOOR PANEL OPTIONS

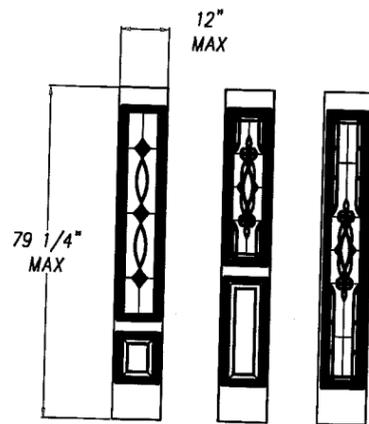

OTHER SIDELITE PANEL OPTIONS

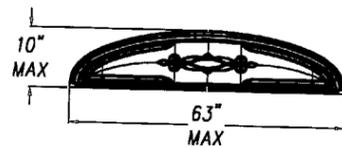

OTHER TRANSOME GLASS LITE OPTIONS

PRODUCT RENEWED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 04-1213-03  
 Expiration Date DEC 20 2009  
 By Ishaq I. Chanda  
 Miami Dade Product Control  
 Division

APPROVED AS COMPLYING WITH THE  
 SOUTH FLORIDA BUILDING CODE  
 DATE DECEMBER 20, 2001  
 BY Ishaq I. Chanda  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 01-1127-18

LIMITS: UNLESS NOTED, FRAC. : DEC. : ANG. :		A		DADE COUNTY MODIFICATIONS	11/8/00	JD
EXTRUSIONS: UNLESS NOTED, STD. COM'L. TOL'S.		LTR.		REVISIONS	DATE	BY
APPR. BY	DATE	AREA	PART NAME:			
CK. BY	DATE	WT./FT.	MAT'L:			
DR. BY JD	DATE 10-6-99			SCALE:		

PREMDOR ENTRY SYSTEMS  
 PITTSBURG, KANSAS

ROYAL is1  
 SHEET 6 OF 6

REVISION LETTER A