



MIAMI-DADE COUNTY, FLORIDA

BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

www.buildingcodeonline.com

Miami Wall Systems, Inc.
701 West 25 Street
Hialeah, FL 33010

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series 101 Aluminum Fixed Window Wall System – Small Missile

APPROVAL DOCUMENT: Drawing No. MWS-101, titled "Window Wall Series 101", sheets 1 through 6 of 6, dated 1/3/98, with revision #4 dated 04/05, prepared by manufacturer, signed and sealed by Kelvyn Whitfield, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 01-1108.04 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No 05-0420.01
Expiration Date: December 2, 2006
Approval Date: May 26, 2005
Page 1

Miami Wall Systems, Inc.


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **W01-22**, Sheets 1 through 10 of 10, titled "Ultra, Heritage Wood & Clad Fixed Window", prepared by Al-Farooq Corporation, dated 04/25/01 with revision A dated 02/25/02, signed and sealed by Humayoun Farooq, P.E.

B. TESTS

1. Test report on:
 - 1) Air Infiltration Test, per PA 202-94
 - 2) Uniform Static Air Pressure Test, Loading per PA 202-94
 - 3) Water Resistance Test, per PA 202-94
 - 4) Small Missile Impact Test per SFBC PA 201-94
 - 5) Cyclic Wind Pressure Test per SFBC PA 203-94along with marked-up drawings and installation diagram of an aluminum window wall system with a heavy duty mullion, prepared by Fenestration Testing Laboratory Inc., Test Report No. **FTL-1779**, dated Aug. 28, 1997, signed and sealed by Gilbert Diamond, P.E. (*From old approval 97-1027.04*)
2. Test report on:
 - 1) Uniform Static Air Pressure Test, Loading per PA 202-94.
 - 2) Small Missile Impact Test per SFBC PA 201-94
 - 3) Cyclic Wind Pressure Test per SFBC PA 203-94along with marked-up drawings and installation diagram of an aluminum window wall system with a light duty mullion, prepared by Fenestration Testing Laboratory Inc., Test Report No. **FTL-1784**, dated Aug. 28, 1997, signed and sealed by Gilbert Diamond, P.E. (*Submitted under NOA#99-1119.08*)
3. Test report on:
 - 1) Uniform Static Air Pressure Test, Loading per PA 202-94.
 - 2) Small Missile Impact Test per SFBC PA 201-94
 - 3) Cyclic Wind Pressure Test per SFBC PA 203-94along with marked-up drawings and installation diagram of an alum. window wall system with a non-reinforced mullion, prepared by Fenestration Testing Laboratory Inc., Test Report No. **FTL-1785**, dated Aug. 28, 1997, signed and sealed by Gilbert Diamond, P.E. (*Submitted under NOA#99-1119.08*)
4. **SBCCI Report only used as reference.**
Test reports on:
 - 1) Air Infiltration Test, per ASTM E283
 - 2) Uniform Static Air Pressure Test, Loading per ASTM E330
 - 3) Water Resistance Test, per ASTM E547/E331
 - 4) Small Missile Impact Test ball bearings,
 - 5) Cyclic Wind Pressure Loading per 4,500 cycles.
 - 6) Forced Entry Test, per AAMA 1303.5-1975 Test Gof an aluminum sliding glass door with reinforcement, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-2454**, dated October 4, 1999, signed and sealed by Aldo Pablo Gonzalez, P.E.

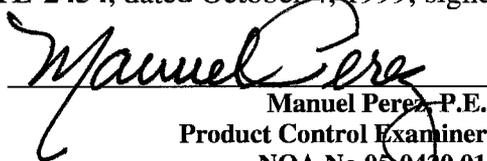
Manuel Perez, P.E.

Product Control Examiner
NOA No 05-0420.01

Expiration Date: December 2, 2006
Approval Date: May 26, 2005

Miami Wall Systems, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. Anchor Calculations and structural analysis and Comparative analysis prepared Applied Engineering Concepts, dated Nov. 11, 1997, signed and sealed by K.A. Whithfield, P.E.

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS

1. None.


F. STATEMENTS

1. Statement letter of conformance, dated November 20, 1997, signed by Kelvyn Whitfield, P.E.
2. Statement letter of no financial interest, dated November 20, 1997, signed by Kelvyn Whitfield, P.E.
3. Lab compliance letters for test reports No: FTL-1779, FTL-1784 & FTL-1785 issued by Fenestration Testing Laboratory, Inc. dated September 26, 1998, signed and sealed by Gilbert Diamond, P.E.

G. OTHER

1. Notice of Acceptance No. **01-1108.04**, issued to Miami Wall Systems, Inc. for their 101 Series Fixed Window 9/16 18m, approved on 12/20/01 and expiring on 12/20/06.


Manuel Perez, P.E.
Product Control Examiner
NOA No 05-0420.01
Expiration Date: December 2, 2006
Approval Date: May 26, 2005

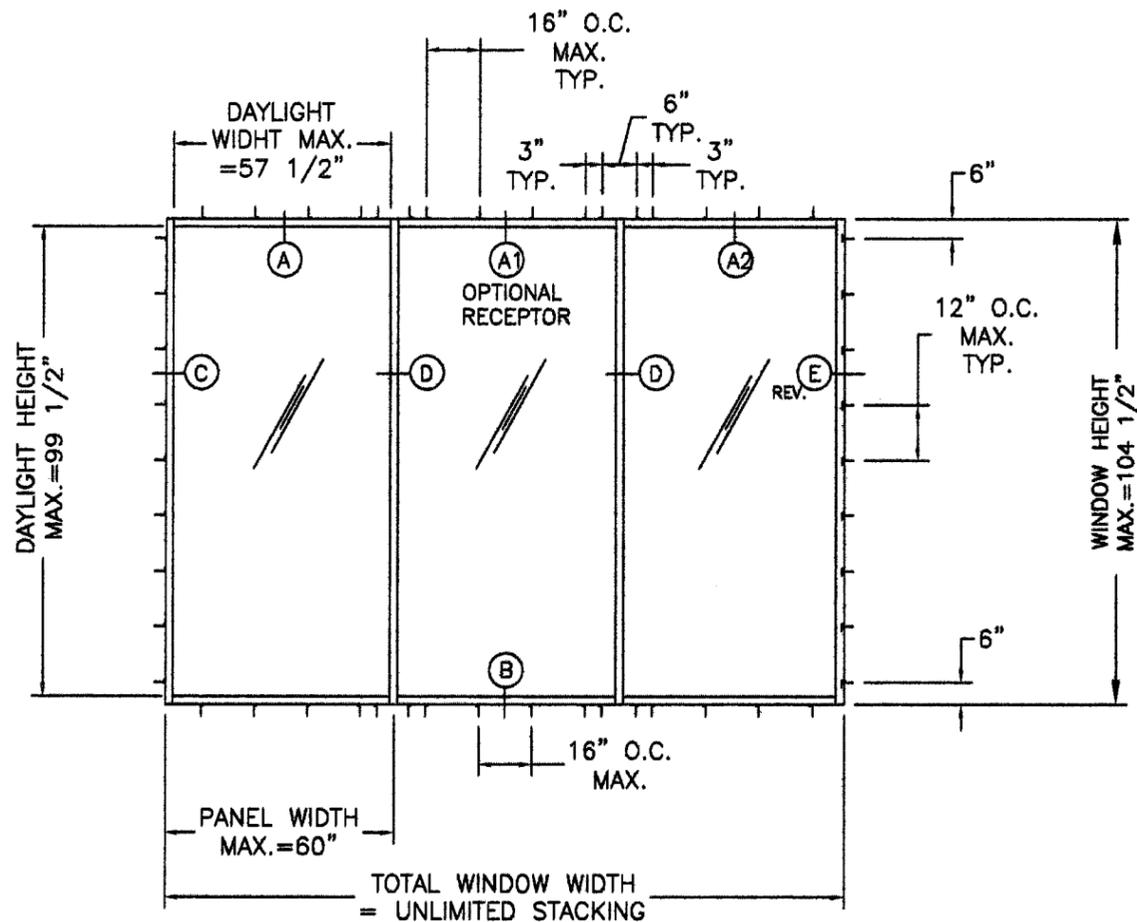

TYPICAL ELEVATION

MIAMI WALL SYSTEMS, INC.

SERIES 101
 ALUMINUM WINDOW WALL SYSTEM
 BASE ON FTL #'S: 1779; 1784; 1785 (SMALL MISSILE IMPACT)
 GLASS: 9/16" LAMINATED
 D.P. 110.0; 100.0; 60.0 PSF (POSITIVE & NEGATIVE)
 W.T.P.: 20 PSF

NOA LABEL

Miami Wall Systems 701 W. 25th Street Hialeah, FL 33010	Lab Test # Approval Type Product Series Impact	FTL-1779, 1784, 1785 Dade Co. NOA 01-1108.04 101 Fixed Small Missile SHUTTERS NOT REQUIRED ABOVE 30 FEET ABOVE GRADE
---	---	---

DWG.No.	DESIGNATION	REINFORCEMENT	LOCATION
MWS-101, SHEET 2	NO REINFORCEMENT	NONE	NONE
MWS-101, SHEET 3	LIGHT REINFORCEMENT	1/4" STEEL BAR *	VERT. MULL
MWS-101, SHEET 4	HEAVY REINFORCEMENT	(2) 1/2x2 1/2" STEEL BAR* (1) 3/4x1 1/2"x1/8" ALUM. CHANNEL*	VERT. MULL

*NOTE: ALL REINFORCEMENTS MEMBERS ARE FULL LENGTH (BAR, TUBE, AND CHANNEL)

PANEL SIZE INCHES	DESIGN PRESSURE PSF		NO. OF ANCHOR SCREWS IN FRAME	
	EXTERIOR	INTERIOR	HEAD & SILL	ALL JAMBS
GLASS: 1/4" TEMP-0.060 PVB*-1/4" TEMP. NO REINFORCEMENT				
36 x 79 1/8	60.0	60.0	4	6
48 x 79 1/8	60.0	60.0	4	6
60 x 79 1/8	60.0	60.0	4	6
36 x 95 1/8	60.0	60.0	4	8
48 x 95 1/8	60.0	60.0	4	8
60 x 95 1/8	60.0	60.0	4	8
36 x 103 1/8	60.0	60.0	4	9
48 x 103 1/8	60.0	60.0	4	9
50 x 103 1/8	60.0	60.0	4	9
GLASS: 1/4" TEMP-0.060 PVB*-1/4" TEMP. LIGHT REINFORCEMENT				
36 x 79 1/8	100.0	100.0	4	6
48 x 79 1/8	100.0	100.0	4	6
60 x 79 1/8	100.0	100.0	4	6
36 x 95 1/8	100.0	100.0	4	8
48 x 95 1/8	100.0	100.0	4	8
60 x 95 1/8	100.0	100.0	4	8
36 x 103 1/8	100.0	100.0	4	9
48 x 103 1/8	100.0	100.0	4	9
50 x 103 1/8	100.0	100.0	4	9
GLASS: 1/4" TEMP-0.060 PVB*-1/4" TEMP. HEAVY REINFORCEMENT				
36 x 79 1/8	110.0	110.0	4	6
48 x 79 1/8	110.0	110.0	4	6
60 x 79 1/8	110.0	110.0	4	6
36 x 95 1/8	110.0	110.0	4	8
48 x 95 1/8	110.0	110.0	4	8
60 x 95 1/8	110.0	110.0	4	8
36 x 103 1/8	110.0	110.0	4	9
48 x 103 1/8	110.0	110.0	4	9
50 x 103 1/8	110.0	110.0	4	9

* LAMINATE = .060 SAFLEX III PVB by SOLUTIA

GENERAL NOTES:

- (1) FRAME HEAD AND SILL USE SAME FASTENER SPACING.
- (2) MAX. PANEL SIZE: 60 7/8"x103 1/8"

PRODUCT REVISED as complying with the Florida Building Code
 Acceptance No. 05-0A-20.01
 Expiration Date DEC 2, 2006
 By: *Manuel Perez*
 Miami/Dade Product Control Division

Kelvyn Whitfield, P.E. 24140
[Signature]
 05/6/05

revisions:
 no. date description
 1 11/99 GLASS TO 9/16 LAMI.
 2 03/00 GLASS IDENTIFY
 3 03/00 MATERIAL REQ'D
 4 04/05 N.O.A. REVISION

checked by: G.L.
 drawing no. MWS-101
 sheet 1 of 6




Miami Wall Systems, Inc.
 701 West 25th Street
 Hialeah, Florida 33010
 Phone: (305) 888-2300 Fax: (305) 888-3058

WINDOW WALL SERIES 101
 WALL ELEVATION
 REINFORCEMENT SUMMARY
 GENERAL NOTES


1/4" TAPCON WITH 1 1/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5" FROM EA. END AND 3" FROM EA. SIDE OF VERT. MULL. AND BALANCE 16" O.C. (TYP.)

1/4" TAPCON WITH 1 1/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5" FROM EA. END AND 3" FROM EA. SIDE OF VERT. MULL. AND BALANCE 16" O.C. (TYP.)

1/4" TAPCON WITH 1 1/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5" FROM EA. END AND 3" FROM EA. SIDE OF VERT. MULL. AND BALANCE 16" O.C. (TYP.)

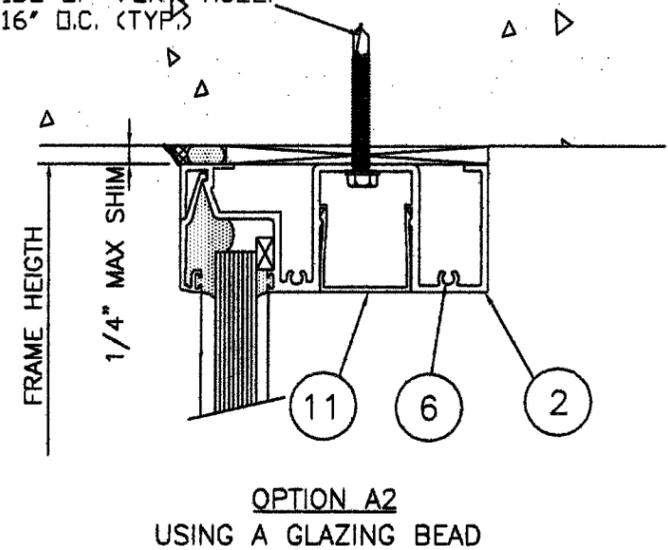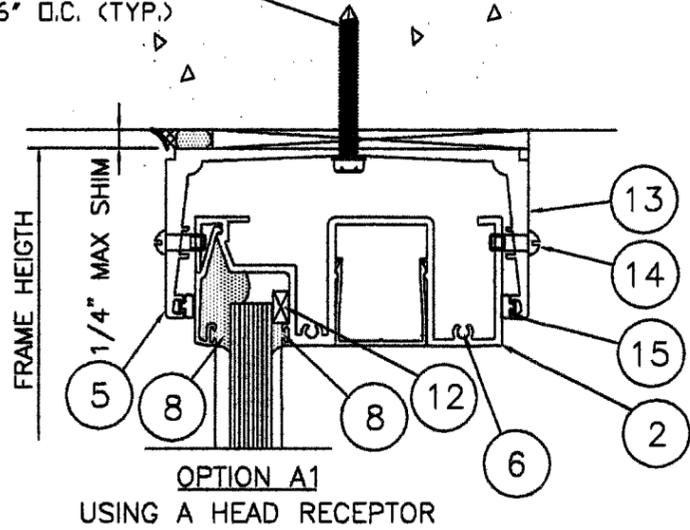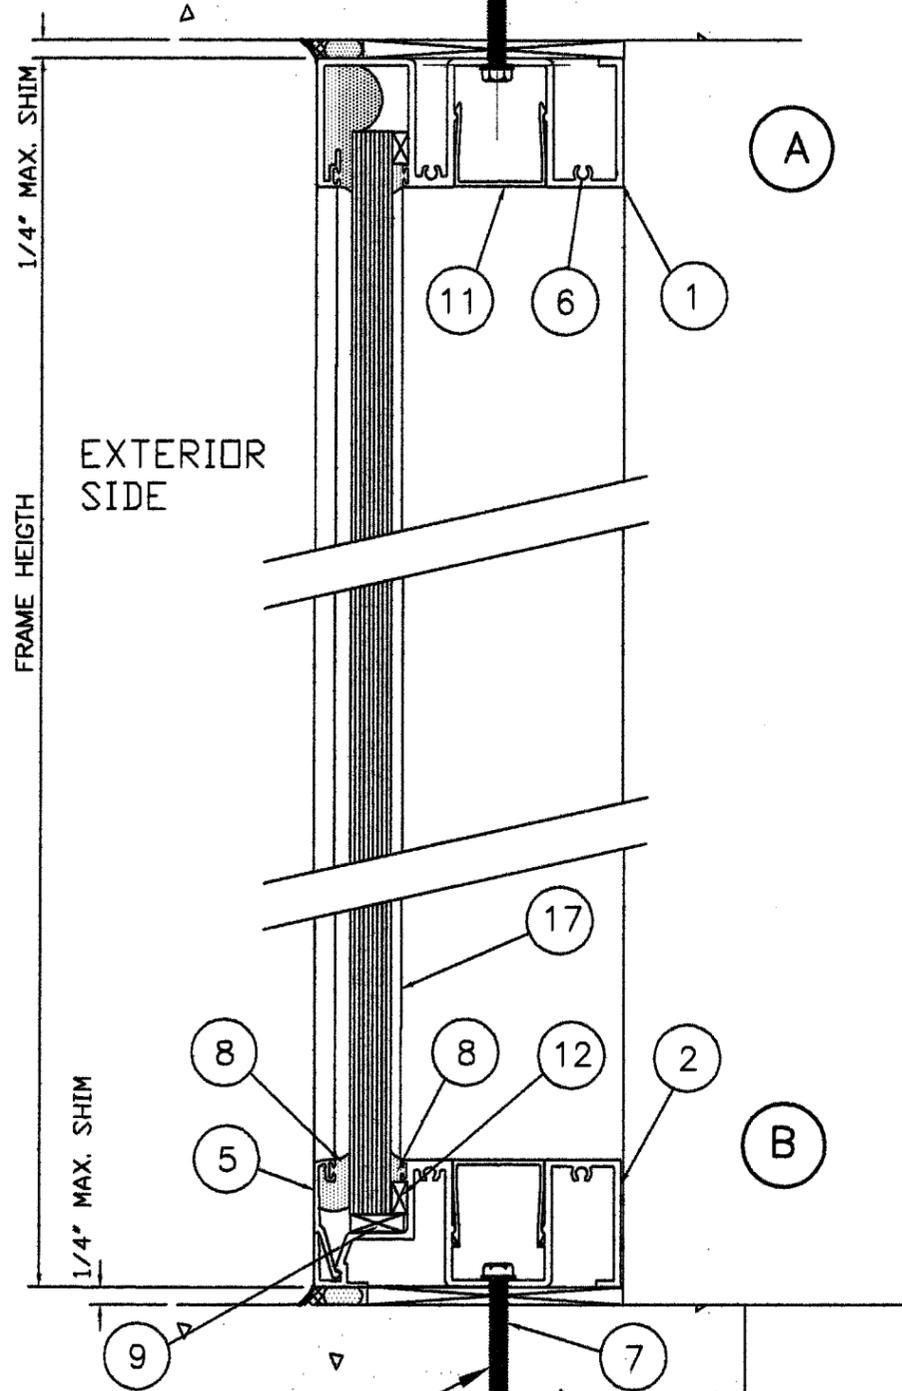

1/4" TAPCON WITH 1 1/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 6" FROM ENDS AND 12" O.C. (TYP.)

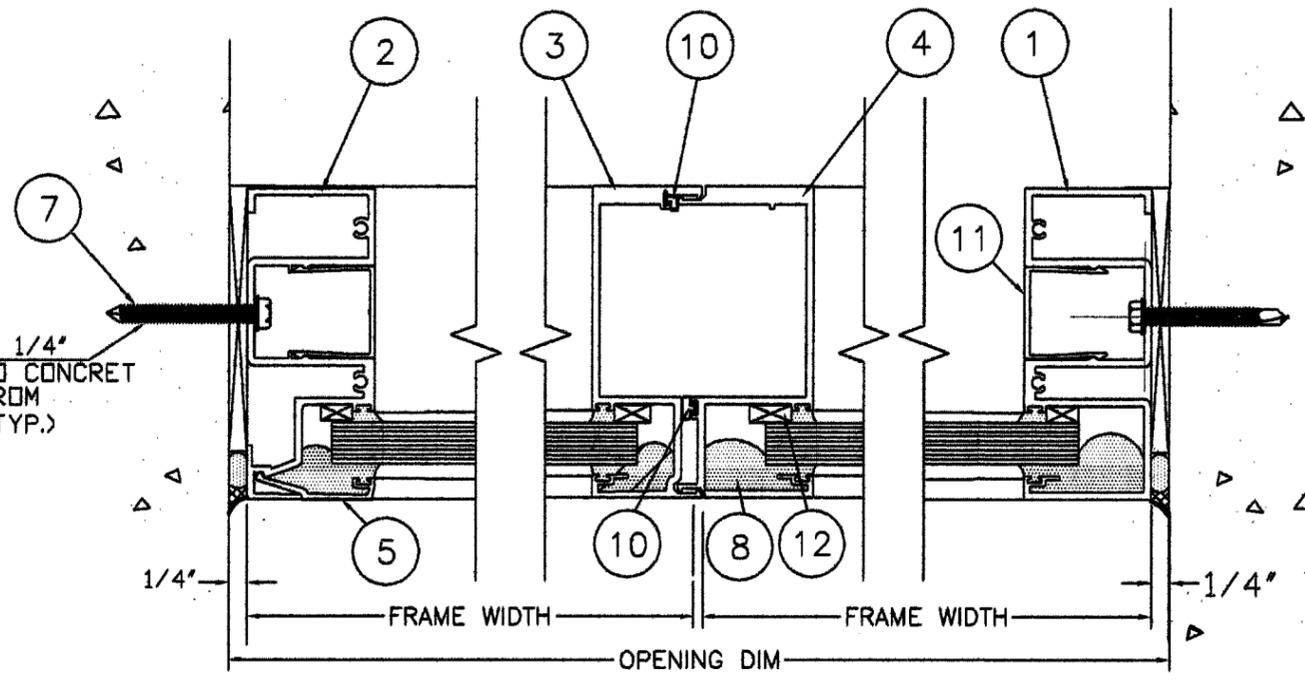

TYPICAL JAMB DETAIL WITH GLAZING BEAD

TYPICAL JAMB DETAIL WITHOUT GLAZING BEAD

1/4" TAPCON WITH 1 1/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5" FROM EA. END AND 3" FROM EA. SIDE OF VERT. MULL. AND BALANCE 16" O.C. (TYP.)

GLASS: 1/4 TEMP - .060 PVB - 1/4" TEMP

TEST#	DESIGNATION	D.P. (PSF)	W.T.P.
FTL# 1785	NO REINFORCEMENT	+60.0 -60.0	20.0 PSF

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 05-0420.01 Expiration Date DEC. 2, 2006
By *Maurice...*
Miami Dade Product Control Division

Kelvyn Whitfield, P.E. 24140

[Signature]
05/16/05

Miami Wall Systems, Inc.
701 West 25th street
Hialeah, Florida. 33010
Phone: (305) 888-2300 Fax: (305) 888-3058

WINDOW WALL SERIES 101
WALL ELEVATION
REINFORCEMENT SUMMARY
GENERAL NOTES

revisions:

no	date	description
1	11/99	GLASS TO 9/16 LAMI.
2	03/00	GLASS IDENTIFY
3	03/00	MATERIAL REQ'D
4	04/05	N.O.A. REVISION

date: 11/3/98
scale: HLF
design by: L.S.
drawn by: L.S.
checked by: G.L.




drawing no.
MWS-101

sheet 2 of 6


1/4" TAPCON WITH 1 1/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5' FROM EA. END AND 3' FROM EA. SIDE OF VERT. MULL. AND BALANCE 16" O.C. (TYP.)

1/4" TAPCON WITH 1 1/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5' FROM EA. END AND 3' FROM EA. SIDE OF VERT. MULL. AND BALANCE 16" O.C. (TYP.)

1/4" TAPCON WITH 1 1/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5' FROM EA. END AND 3' FROM EA. SIDE OF VERT. MULL. AND BALANCE 16" O.C. (TYP.)

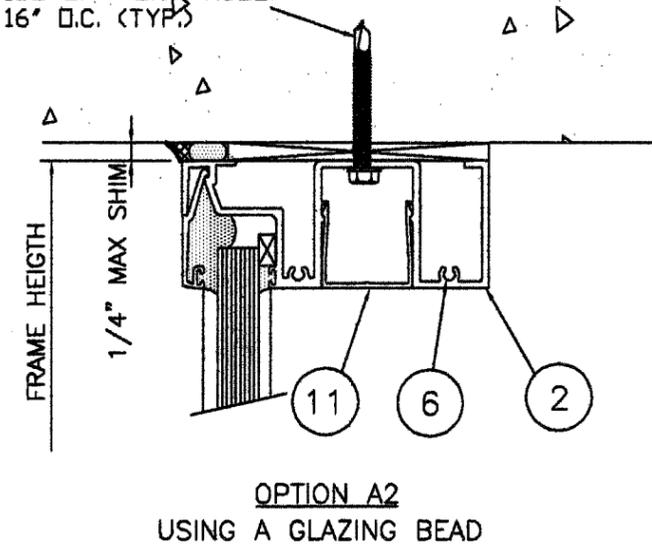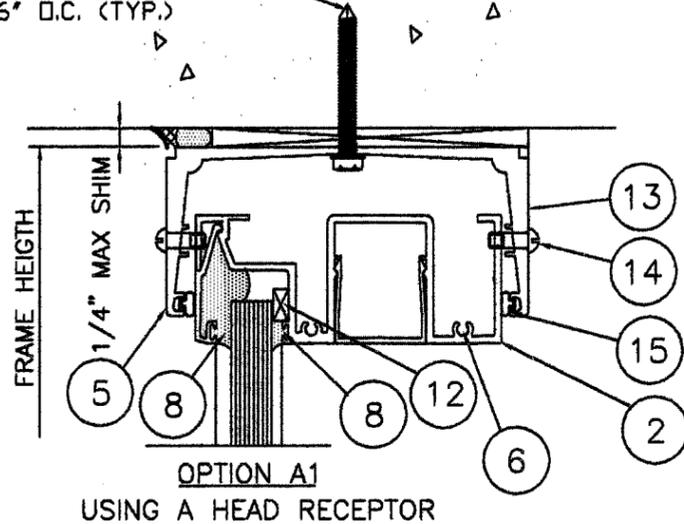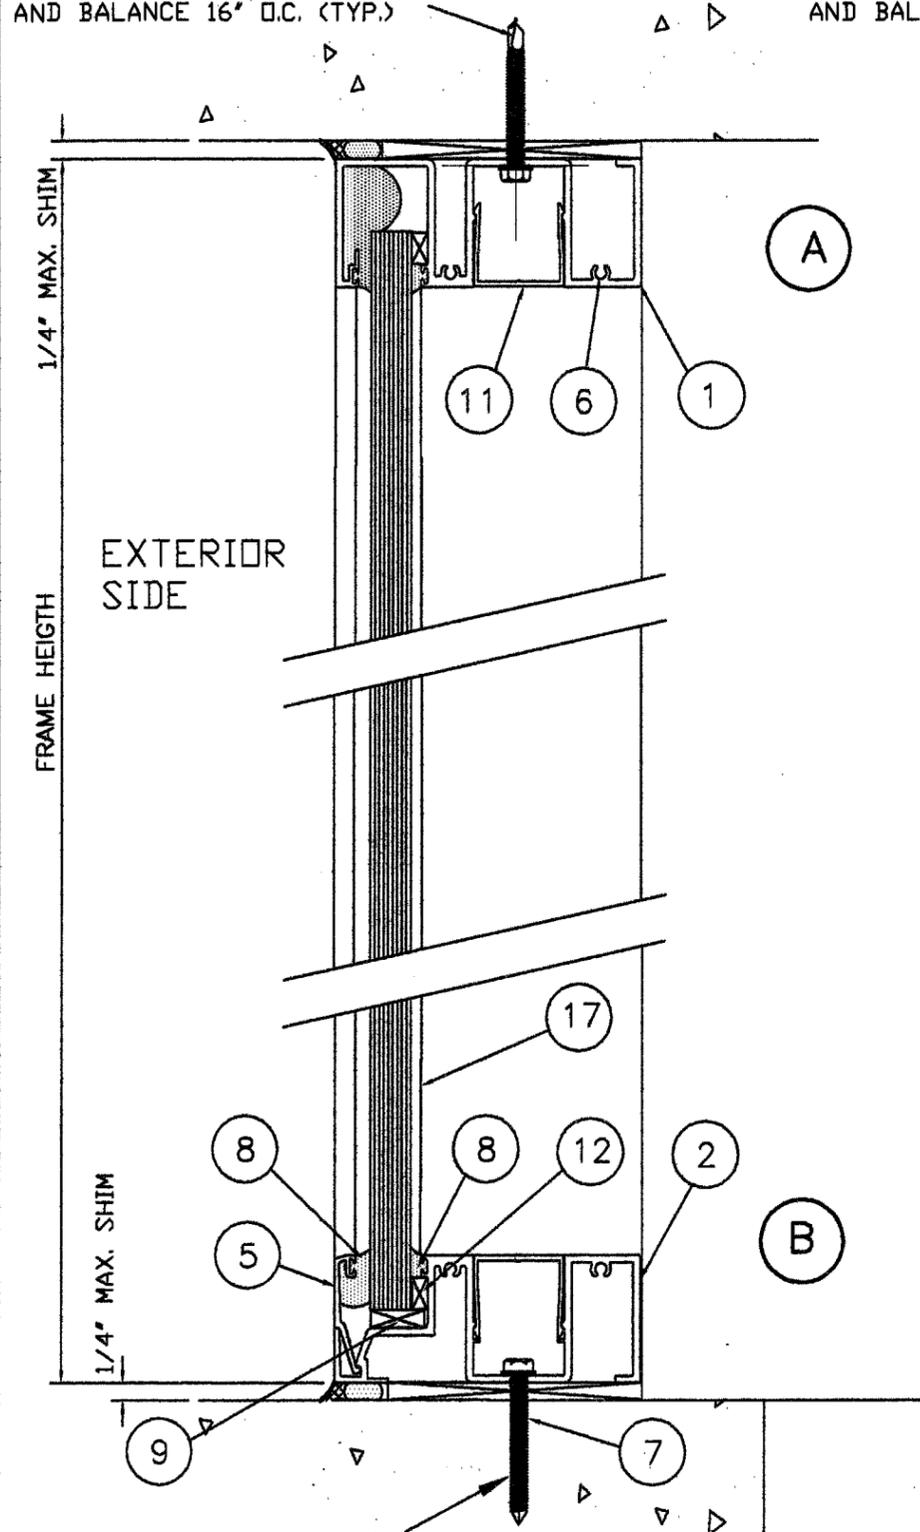

1/4" TAPCON WITH 1 1/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 6' FROM ENDS AND 12" O.C. (TYP.)

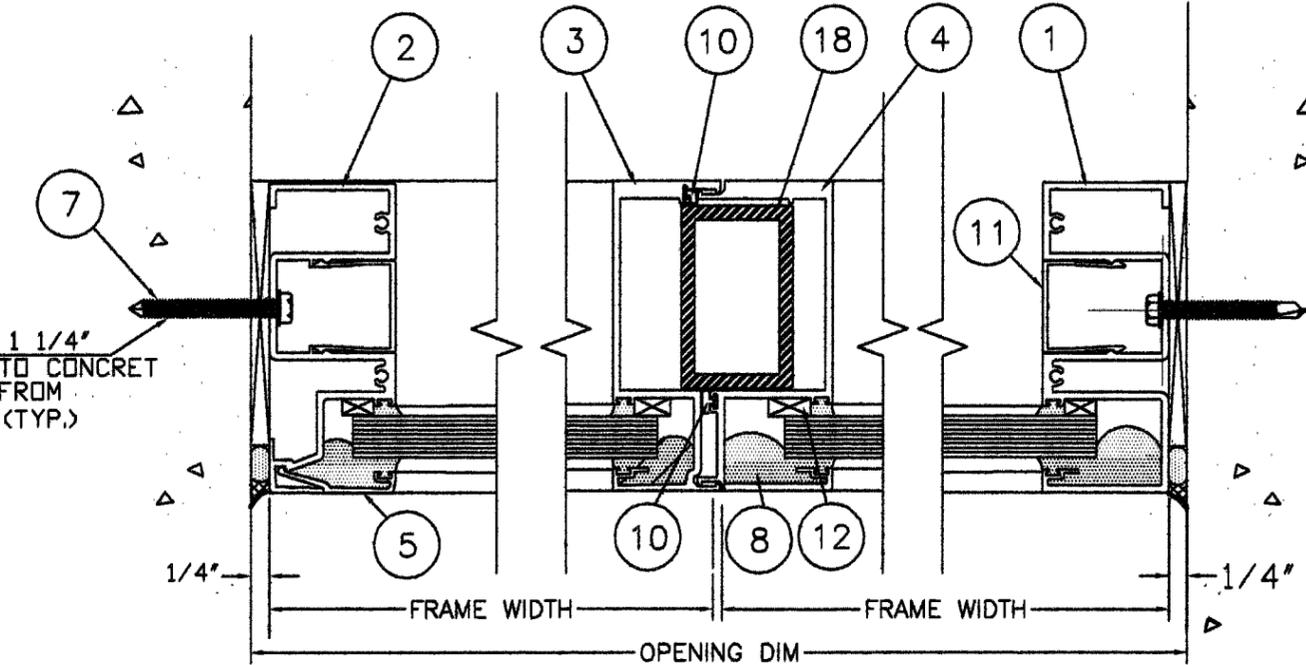

TYPICAL JAMB DETAIL WITH GLAZING BEAD

TYPICAL JAMB DETAIL WITHOUT GLAZING BEAD

1/4" TAPCON WITH 1 1/4" MIN. EMBEDMENT INTO CONCRETE MAX. SPACING= 5' FROM EA. END AND 3' FROM EA. SIDE OF VERT. MULL. AND BALANCE 16" O.C. (TYP.)

GLASS: 1/4 TEMP - .060 PVB - 1/4" TEMP

TEST#	DESIGNATION	D.P. (PSF)	W.T.P.
FTL# 1784	LIGHT REINFORCEMENT	+100.0 -100.0	20.0 PSF

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 05-0420.01 Expiration Date DEC. 2, 2006
By *Manuel Perez*
Miami Dade Product Control Division

Kelvyn Whitfield, P.E. 24140

Manuel Perez
05/6/05

Miami Wall Systems, Inc.
701 West 25th street
Hialeah, Florida. 33010
Phone: (305) 888-2300 Fax: (305) 888-3058

WINDOW WALL SERIES 101
WALL ELEVATION
REINFORCEMENT SUMMARY
GENERAL NOTES

no	date	description
1	11/99	GLASS TO 9/16 LAMI.
2	03/00	GLASS IDENTIFY
3	03/00	MATERIAL REQ'D
4	04/05	N.O.A. REVISION

date: 1/3/06
scale: FULL
design by: L.C.
drawn by: L.C.
checked by: G.L.




drawing no.
MWS-101

sheet 3 of 6


1/4" TAPCON WITH 1 1/4" MIN. EMBEDMENT INTO CONCRETE
MAX. SPACING= 5" FROM EA. END AND 3" FROM EA. SIDE OF VERT. MULL.
AND BALANCE 16" O.C. (TYP.)

1/4" TAPCON WITH 1 1/4" MIN. EMBEDMENT INTO CONCRETE
MAX. SPACING= 5" FROM EA. END AND 3" FROM EA. SIDE OF VERT. MULL.
AND BALANCE 16" O.C. (TYP.)

1/4" TAPCON WITH 1 1/4" MIN. EMBEDMENT INTO CONCRETE
MAX. SPACING= 5" FROM EA. END AND 3" FROM EA. SIDE OF VERT. MULL.
AND BALANCE 16" O.C. (TYP.)

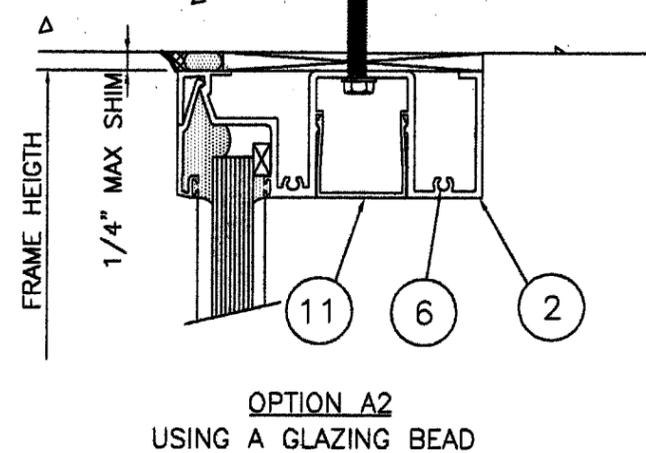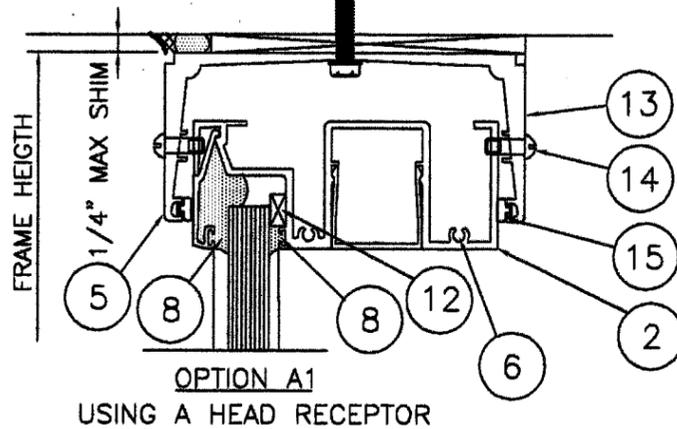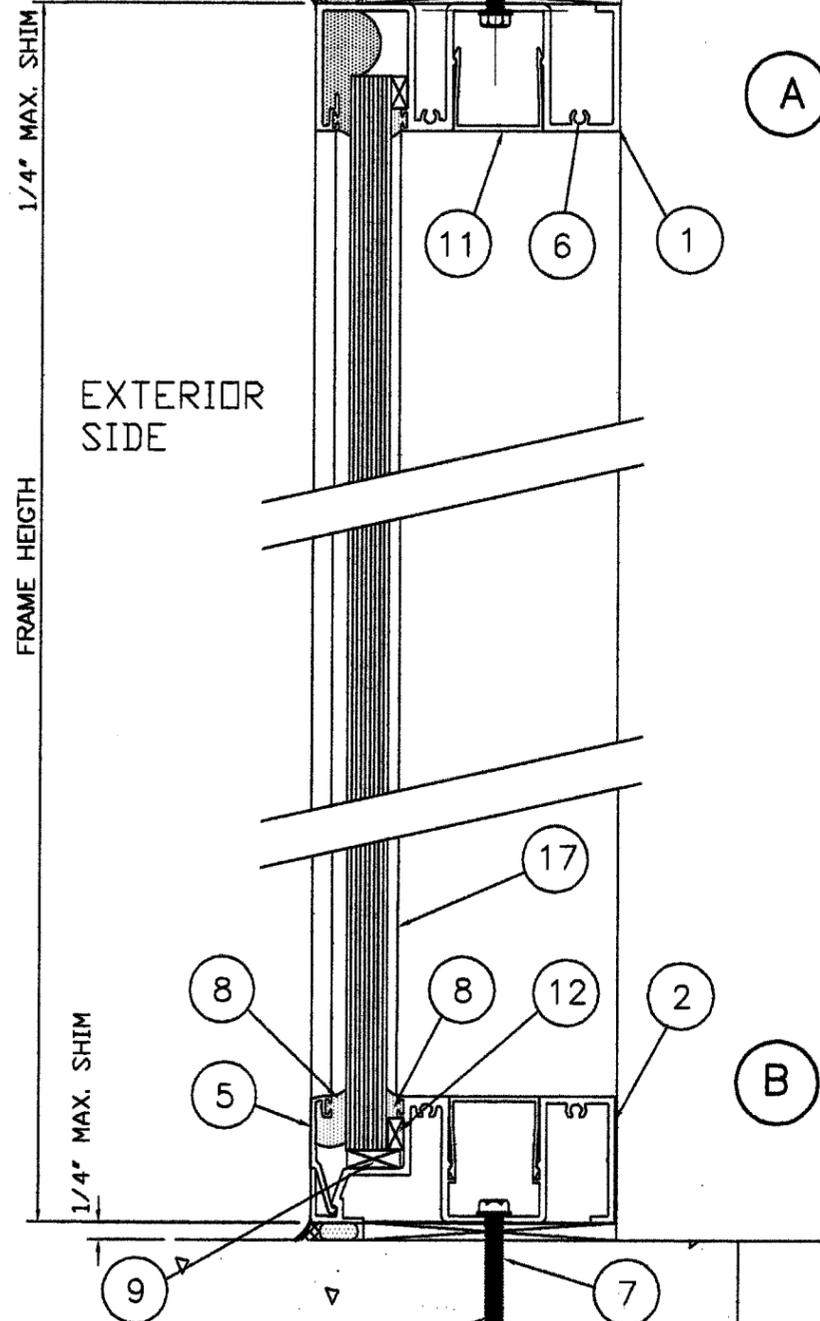

1/4" TAPCON WITH 1 1/4" MIN. EMBEDMENT INTO CONCRETE
MAX. SPACING= 6" FROM ENDS AND 12" O.C. (TYP.)

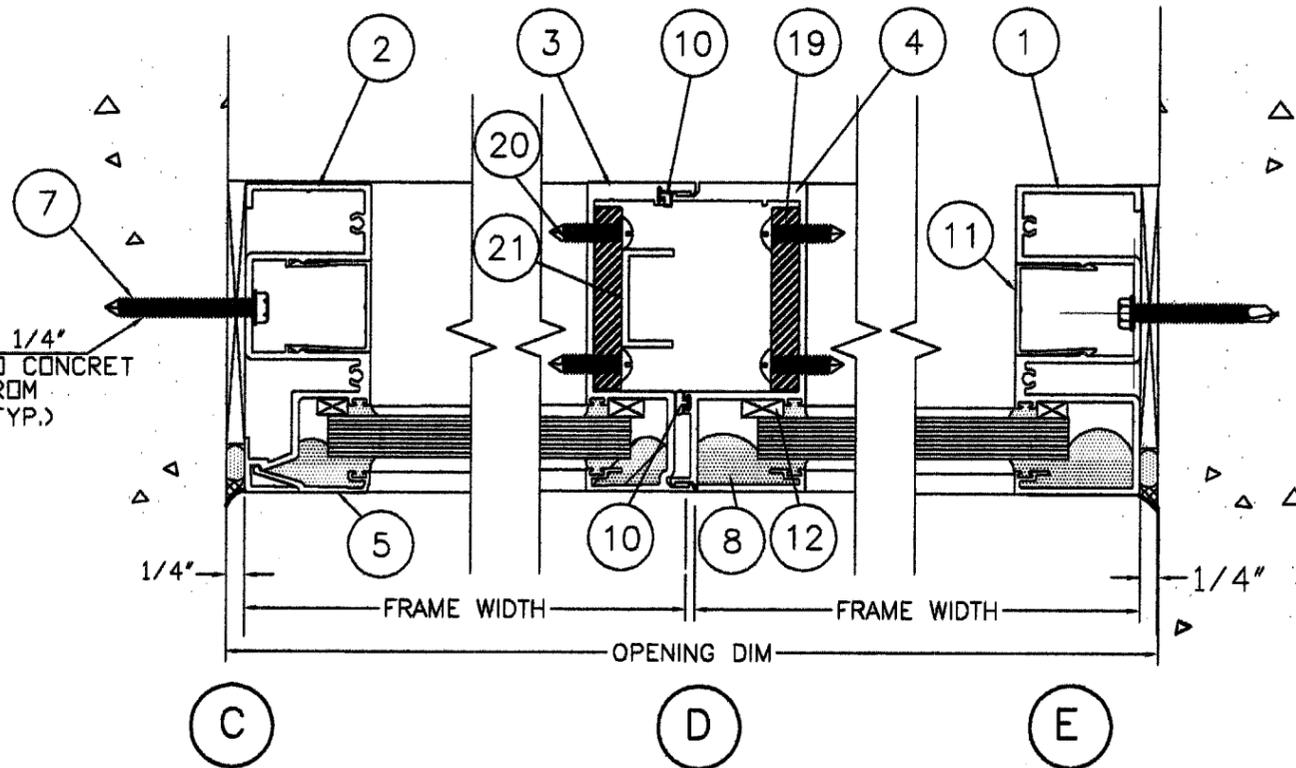

TYPICAL JAMB DETAIL WITH GLAZING BEAD

TYPICAL JAMB DETAIL WITHOUT GLAZING BEAD

1/4" TAPCON WITH 1 1/4" MIN. EMBEDMENT INTO CONCRETE
MAX. SPACING= 5" FROM EA. END AND 3" FROM EA. SIDE OF VERT. MULL.
AND BALANCE 16" O.C. (TYP.)

GLASS: 1/4" TEMP - .060 PVB - 1/4" TEMP

TEST#	DESIGNATION	D.P. (PSF)	W.T.P.
FTL# 1779	HEAVY REINFORCEMENT	+110.0 -110.0	20.0 PSF

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 05-0420.01
Expiration Date DEC 2, 2006
By *Manuel Perez*
Miami Made Product Control
Division

Kelvyn Whitfield, P.E. 24140

[Signature]
05/6/05

Miami Wall Systems, Inc.
701 West 25th street
Hialeah, Florida. 33010
Phone: (305) 888-2300 Fax: (305) 888-3058




WINDOW WALL SERIES 101
WALL ELEVATION
REINFORCEMENT SUMMARY
GENERAL NOTES

Revisions:


no	date	description
1	11/99	GLASS TO 9/16 LAMI.
2	03/00	GLASS IDENTIFY
3	03/00	MATERIAL REQ'D
4	04/05	N.O.A. REVISION

date: 11/3/98
scale: 1/4"
design by: L.C.
drawn by: L.B.
checked by: C.L.
drawing no.
MWS-101
sheet 4 of 6


MATERIALS LIST				
ITEM NO.	DESCRIPTION	REQ'D	PART NO.	COMMENTS
1	HEAD /SILL /JAMB	1	101-206	
2	HEAD /SILL /JAMB	1	100-201	
3	FEMALE VERT. MULL.	1	101-205	
4	MALE VERT. MULL.	1	101-204	
5	GLAZING BEAD	FULL DIM.	101-202	
6	FRAME ASSEMBLY SCREW	8		10 X 1 SMS
7	INSTALLION FASTENER	AS REQ'D		1/4" TAPCON
8	GLAZING SILICONE	AS REQ'D		GE 4000
9	SETTING BLOCK	2 PER LITE		1/4" X 3/4" X 4" LG
10	BULB VYNIL	SNG'L ROW	G-119-A	VERT. MULL.
11	FASTENER COVER	FULL DIM.	101-007	
12	GLASS SPACER	AS REQ'D		3/16" X 1/2" 2"
13	HEAD RECEPTOR FASTENER	1		
14	FRAME HEAD RECEPTOR	AS REQ'D	101-010	14 X 1 SMS
15	VYNIL BULB	DB'L ROW	G-117	HEAD RECEPTOR
16				
17	GLASS			9/16 LAMI. (SEE PAGE1)
18	STEEL TUBE (LIGHT REINFORC.)	1 PER MULL.		1 1/2" X 2 1/2" X 3/16" X HEIGHT
19	STEEL BAR (HEAVY REINFORC.)	2 PER MULL.		1/2" X 2 1/2" X HEIGHT
20	FASTENER	4 PER BAR		14 X 1 SMS
21	ALUMINUM CHANNEL	1 PER MULL.		3/4" X 1 1/2" X 3/4" X 1.8" X HEIGHT

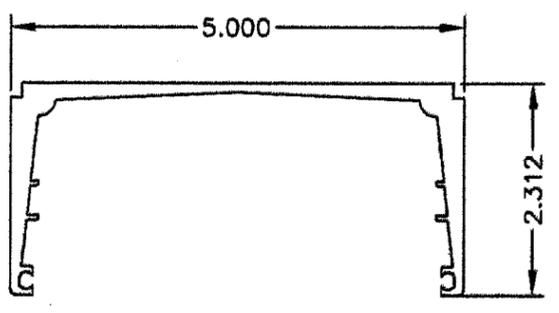


13 HEAD RECEPTOR DIE# 101-010
 MATERIAL: ALUMINUM
 ALLOY: 6005-T5
 TYPICAL WALL: .100"-.188"




5 GLAZING BEAD DIE #101-202
 MATERIAL: ALUMINUM
 ALLOY: 6063-T6
 TYPICAL WALL: .062




11 FRAME JAMB COVER DIE# 101-007
 MATERIAL: ALUMINUM
 ALLOY: 6063-T6
 TYPICAL WALL: .050"

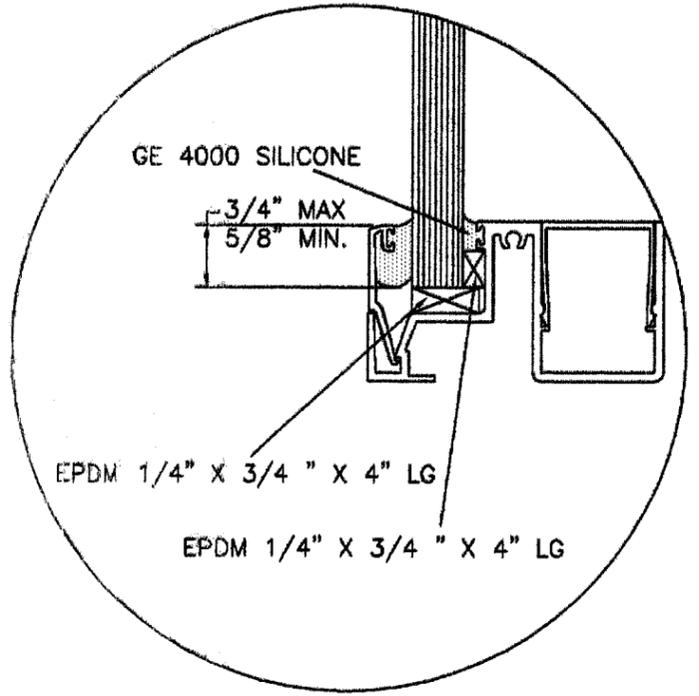


TYPICAL GLAZING DETAIL
 HALF SCALE

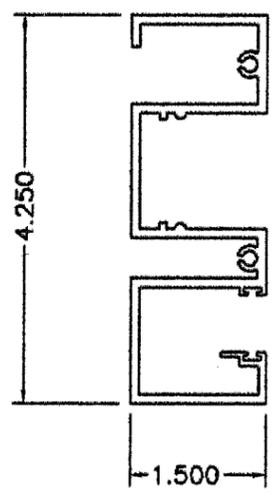


1 FRAME JAMB DIE# 101-206
 MATERIAL: ALUMINUM
 ALLOY: 6063-T5
 TYPICAL WALL: .100"

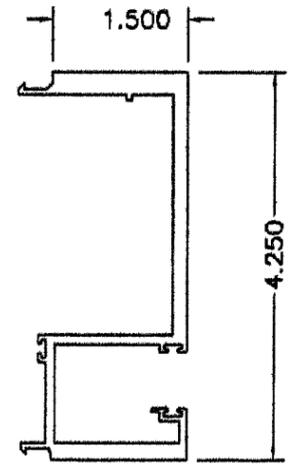

4 MALE VERT. MULLION DIE# 101-204
 MATERIAL: ALUMINUM
 ALLOY: 6063-T5
 TYPICAL WALL: .100"

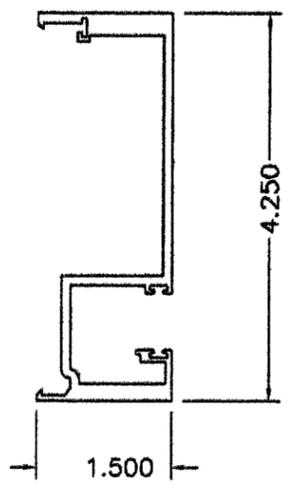

3 FEMALE VERT. MULLION DIE# 101-205
 MATERIAL: ALUMINUM
 ALLOY: 6063-T5
 TYPICAL WALL: .100"

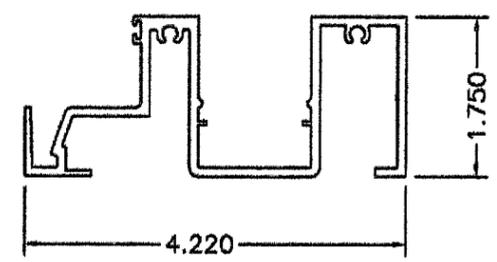

2 FRAME SILL DIE# 101-201
 MATERIAL: ALUMINUM
 ALLOY: 6063-T5
 TYPICAL WALL: .094"

PRODUCT REVISED as complying with the Florida Building Code
 Acceptance No. 05-0420.01
 Expiration Date DEC. 2, 2006
 By *Manuel Perry*
 Miami Dade Product Control Division

Keivyn Whitfield, P.E. 24140
05/6/05

Miami Wall Systems, Inc.
 701 West 25th street
 Hialeah, Florida. 33010
 Phone: (305) 888-2300 Fax: (305) 888-3058

WINDOW WALL SERIES 101
 BILL OF MATERIAL
 EXTRUSION SUMMARY

no	date	description
1	11/99	CLASS TO 9/16 LAMI.
2	03/00	CLASS IDENTIFY
3	03/00	MATERIAL REVD
4	04/05	N.O.A. REVISION

date: 11/3/98
 scale: HALF
 design by: L.G.
 drawn by: L.G.
 checked by: G.L.

drawing no.
 MWS-101

sheet 5 of 6

ASSY. SCREW
ITEM #6

FRAME TOP CORNER

FRAME TOP CORNER

#14x1" PH SMS
ITEM #20
(HEAVY REINFORCEMENT ONLY)

SHOP APPLIED SEALANT
THE INSIDE PERIMETER OF
JAMB DURING ASSEMBLY

ASSY. SCREW
ITEM #6

REINFORM'T BAR
ITEM #19
(HEAVY REINFORCEMENT ONLY)

ASSY. SCREW
ITEM #6

ASSY. SCREW
ITEM #6

SHOP APPLIED SEALANT
THE INSIDE PERIMETER OF
JAMB DURING ASSEMBLY

FRAME BOTTOM CORNER

#14x1" PH SMS
ITEM #20

FRAME BOTTOM CORNER

Miami Wall Systems, Inc.
701 West 25th street
Hialeah, Florida. 33010
Phone: (305) 888-2300 Fax: (305) 888-3058



WINDOW WALL SERIES 101

CORNER DETAIL

no	date	description
1	11/99	GLASS TO 9/16 LAMI.
2	03/00	GLASS IDENTIFY
3	03/00	MATERIAL REQ'D
4	04/05	N.O.A. REVISION

date: 11/2/98	scale: HMF
design by: L.E.	drawn by: L.E.
checked by: G.L.	

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 05-0420.01
Expiration Date DEC. 2, 2006
By: *Manuel Perez*
Miami Dade Product Control
Division

Kelvyn Whitfield, P.E. 24140

[Signature]
05/6/05

drawing no.
MWS-101
sheet 6 of 6