



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

**Canplas Industries, Ltd.  
500 Veteran's Drive  
P.O. Box 1800  
Barrie, Ontario, Canada L4M4V3**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by the BCCO and accepted by the Building Code and Product Review Committee to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The BCCO (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BCCO reserves the right to revoke this acceptance, if it is determined by BCCO that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code and the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: DURAFLOW WEATHERPRO SHINGLE OVER RIDGE VENT**

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 4.

The submitted documentation was reviewed by Jorge L. Acebo



**NOA No: 05-0516.06  
Expiration Date: 05/24/12  
Approval Date: 05/24/07  
Page 1 of 4**

**ROOFING ASSEMBLY APPROVAL**

**Category:** Roofing  
**Sub-Category:** Roof Ventilators  
**Materials:** Plastic

**TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:**

<u>Product</u>	<u>Dimensions</u>	<u>Test Specification</u>	<u>Product Description</u>
DuraFlow WeatherPro Shingle Over Ridge Vent	H= 0.8" W=15-3/4" L=48"	TAS 100(A)	Plastic low profile attic ridge vent for installation in shingle roof systems without filter.

**TRADE NAMES OF PRODUCTS MANUFACTURED BY OTHERS:**

<u>Product</u>	<u>Dimensions</u>	<u>Test Specification</u>	<u>Product Description</u>	<u>Manufacturer</u>
Asphalt Roof Cement		ASTM D 4586	Asbestos-free, asphalt based roof cement.	generic
Asphalt Primer		ASTM D 41	Asphalt Primer	generic
Roofing Nails	11 gauge 2-3/8" long head dia. 3/8"	TAS114	Corrosion resistant annular ring shank nails	generic

**EVIDENCE SUBMITTED:**

<u>Test Agency/Identifier</u>	<u>Name</u>	<u>Report</u>	<u>Date</u>
ETC Laboratories, Inc.	ASTM D 1929 ASTM D635 ASTM D 2843	ETC-06-718-18119.0	09/16/06
PRI Asphalt Technologies, Inc.	ASTM G 638 ASTM G155 & D2565 TAS 100(A)	CANP-006-02-01 CANP-003-02-01	03/21/07 12/10/04



NOA No: 05-0516.06  
 Expiration Date: 05/24/12  
 Approval Date: 05/24/07  
 Page 2 of 4


## APPROVED APPLICATIONS:

### Slot:

Determine whether the rafters are truss or ridgepole construction. Chalk a cut line on each side of ridge and cut a 2" wide slot along the apex of the roof by cutting 1" on each side of the ridge. The slot shall terminate 1 foot shorter at each end than the total length of ridge vent used and be covered to prevent water infiltration.

### Vent Installation:

Place the first piece of ridge vent with female end  $\frac{1}{2}$ " from the gable end. Fasten using nails at each end and in the middle sections using 11 gauge corrosion resistant ringshank roofing nails of  $2\frac{3}{8}$ " minimum length. Continue installing additional pieces along ridge connecting the female end over the male end and fastening as described for the first piece. When reaching the ridge end, the last vent section may need to be cut to length. Use the moulded in end caps every  $2\frac{1}{2}$ " on the underside of the vent; measure and cut amount needed to install within  $\frac{1}{2}$ " of ridge end.

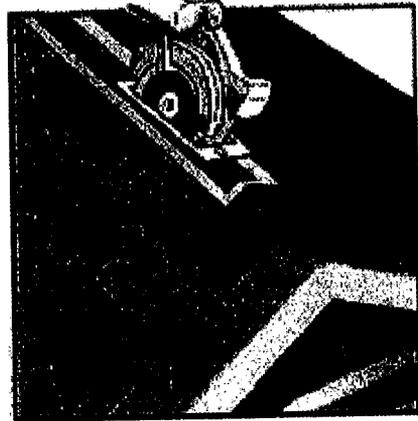

### Ridge Shingle Installation:

Nail cap shingles in place with a 5" exposure through the vent using 11 gauge corrosion resistant ringshank roofing nails of  $2\frac{3}{8}$ " minimum length using 2 nails per cap shingle.



**Latch Connectors  
to assure secure placement**

**Net Free Area:**

Refer to manufacturers published literature

**Minimum Slope:**

**2:12**


### LIMITATIONS:

1. Refer to applicable building codes for required ventilation.
2. The Shingle Over Ridge Vents in this NOA shall not be installed on roof mean heights greater than 33 feet.



NOA No: 05-0516.06  
Expiration Date: 05/24/12  
Approval Date: 05/24/07  
Page 3 of 4

**DURAFLOW WEATHERPRO SHINGLE OVER RIDGE VENT**

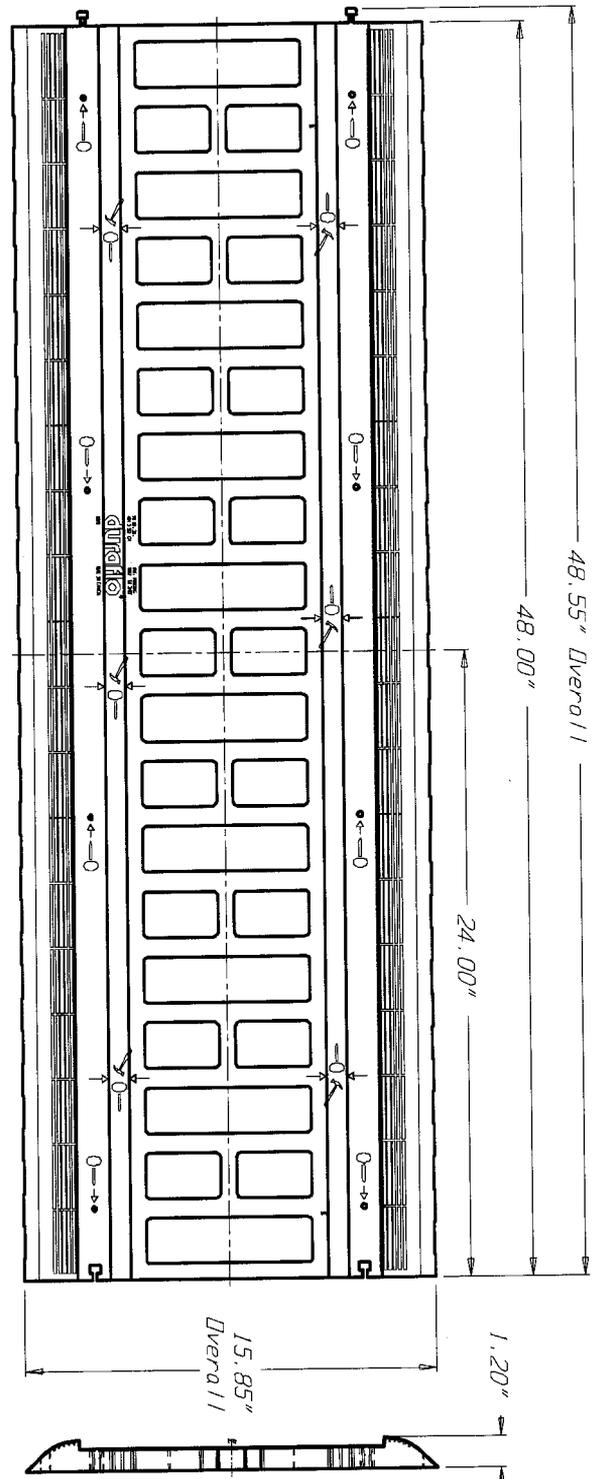

**END OF THIS ACCEPTANCE**



NOA No: 05-0516.06  
Expiration Date: 05/24/12  
Approval Date: 05/24/07  
Page 4 of 4