



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**NOTICE OF ACCEPTANCE (NOA)**

[www.buildingcodeonline.com](http://www.buildingcodeonline.com)

**La Finestra**  
7620 N.W. 25 Street, Unit 6  
Miami, FL 33122

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "EKU-53" Outswing Aluminum Casement Window - L.M.I.**

**APPROVAL DOCUMENT:** Drawing No. **FIN-B16/06**, titled "Series EKU-53 Aluminum Casement Window (Hi - Load)", sheets 1 through 6 of 6, dated 01/29/06, prepared by Bromley-Cook Engineering, Inc., signed and sealed by William D. Cook, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA **revises and supersedes** NOA # **05-0203.02** consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No 05-0725.03**  
**Expiration Date: February 27, 2008**  
**Approval Date: April 6, 2006**  
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No. **FIN-B16/06**, titled "Series EKU-53 Aluminum Casement Window", sheets 1 through 6 of 6, dated 01/29/06, prepared by Bromley-Cook Engineering, Inc., signed and sealed by William D. Cook, P.E.

**B. TESTS**

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94  
along with marked-up drawings and installation diagram of an outswing wood door, prepared by Hurricane Test Laboratory, Inc., Test Report No. **FTL-3881**, dated August 23, 2004, witnessed by Edmundo Largaespada, P.E.  
*(Submitted under NOA # 05-0203.02)*
2. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94  
along with marked-up drawings and installation diagram of an Aluminum Out-Swinging Entrance Door, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4531**, dated June 1, 2005, witnessed by Edmundo Largaespada, P.E.

**C. CALCULATIONS**


1. Anchor verification calculations and structural analysis, complying with FBC-2004, dated 02/08/06, prepared by Bromley-Cook Engineering, Inc, signed and sealed by William D. Cook, P.E.  
**Complies with ASTM E1300 -98**

**D. QUALITY ASSURANCE**

1. Miami Dade Building Code Compliance Office (BCCO)

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **01-0205.02** issued to Solutia Inc. for their "Saflex /Keepsafe Maximum" dated 05/17/01, expiring on 05/21/06.
2. Notice of Acceptance No. **03-1223.04** issued to Surface Specialties, Inc. for their "Uvekol - a Laminate Glass Component" dated 02/05/04, expiring on 02/08/09.

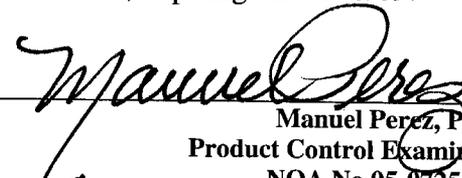  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No 05-0725.03  
Expiration Date: February 27, 2008  
Approval Date: April 6, 2006

La Finestra

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**F. STATEMENTS**

1. Statement letter of conformance, dated February 8, 2006, signed and sealed by William D. Cook, P.E.
2. Statement letter of no financial interest, dated February 8, 2006, signed and sealed by William D. Cook, P.E.
3. Laboratory compliance letter for Test Report No. **FTL- 4531**, issued by Fenestration Testing Laboratory, Inc., dated July 11, 2005, signed and sealed by Edmundo Largaespada, P.E.
4. Laboratory compliance letter for Test Report No. **FTL- 3881**, issued by Fenestration Testing Laboratory, Inc., dated October 18, 2004, signed and sealed by Edmundo Largaespada, P.E.  
*(Submitted under NOA # 05-0203.02)*

**G. OTHER**


1. Notice of Acceptance No. **05-0203.02**, issued to **La Finestra** for their "Series "EKU-53" Outswing Aluminum Casement Window – Impact", approved on 06/23/05 and expiring on 02/27/08.

  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No 05-0725.03

Expiration Date: February 27, 2008  
Approval Date: April 6, 2006

LA FINESTRA, LC

SERIES: EKU 53 CASEMENT WINDOW (HIGH LOAD)

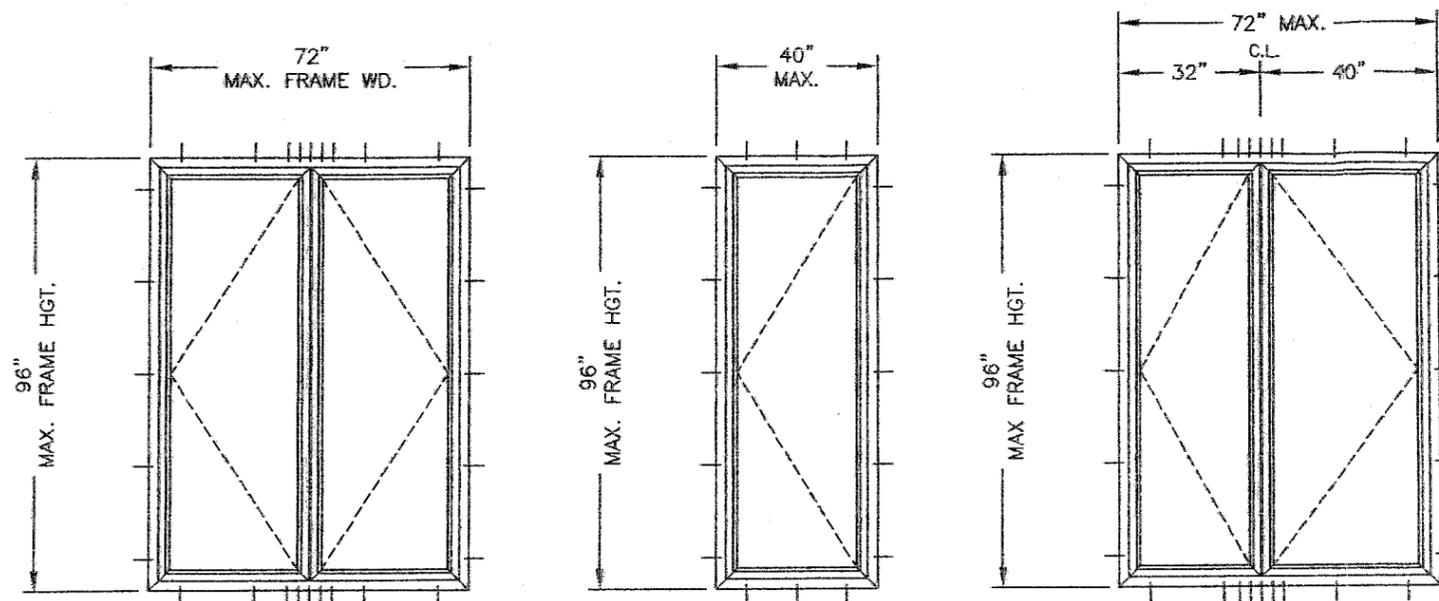


TYPICAL CONFIGURATIONS

MAX. WINDOW SIZES SHOWN


MULTIPLE UNITS STACKED SIDE BY SIDE MUST HAVE APPROVED MULLIONS BETWEEN EACH WINDOW FRAME (SEE ALTERNATE CONFIGURATIONS BELOW)

SEE ANCHOR SCHEDULE ON PG. 4 FOR ANCHOR TYPES & SPACING


MIAMI-DADE CO. APPROVED MULLION BETWEEN UNITS  
NOTE: MUST USE MULLION ANCHOR CLIPS AS PER N.O.A.




MIAMI-DADE CO. APPROVED MULLION BETWEEN UNITS  
NOTE: MUST USE MULLION ANCHOR CLIPS AS PER N.O.A.

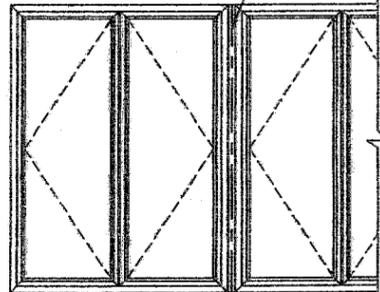

MIAMI-DADE CO. APPROVED MULLION BETWEEN UNITS  
NOTE: MUST USE MULLION ANCHOR CLIPS AS PER N.O.A.



MIAMI-DADE CO. APPROVED MULLION BETWEEN UNITS  
NOTE: MUST USE MULLION ANCHOR CLIPS AS PER N.O.A.

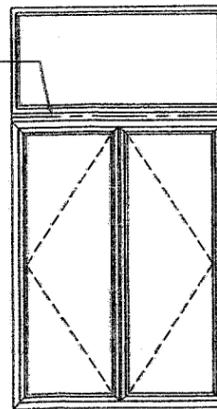

ALTERNATE CONFIGURATIONS

UNITS MAY BE INSTALLED SIDE BY SIDE OR STACKED WITH MIAMI-DADE COUNTY APPROVED MULLIONS BETWEEN EACH WINDOW FRAME AND OR TRANSOM FRAME

GLASS SCHEDULE

LARGE MISSILE IMPACT RESISTANT

GL-1 = 7/16" (.454") LAMINATED  
3/16" (.182") ANNEALED - .090" P.V.B.  
INTERLAYER (DUPONT BUTACITE)-  
3/16" (.182") ANNEALED.

GL-2 = 7/16" (.454") LAMINATED  
3/16" HEAT STRENGTHENED - .090" P.V.B.  
INTERLAYER (DUPONT BUTACITE)-  
3/16" HEAT STRENGTHENED

GLASS CHART

TYPE	MAX. D.L.O.	MAX. DESIGN PRESSURE
GL-1	21 3/4" X 85"	+110.0, -110.0 P.S.F.
GL-2	30" X 85"	+110.0, -110.0 P.S.F.


WATER INFILTRATION TEST PRESSURE = 16.5 P.S.F.

NOTES:

- THIS SYSTEM HAS BEEN DESIGNED TO COMPLY WITH THE REQUIREMENTS OF THE HIGH VELOCITY HURRICANE ZONE AS DESCRIBED IN THE "2004 FLORIDA BUILDING CODE"
- THIS WINDOW SYSTEM HAS BEEN TESTED, ENGINEERED AND APPROVED FOR DESIGN PRESSURES NOT TO EXCEED THOSE SHOWN IN SCHEDULE.
- BUCK, OPENINGS & BUCK FASTENERS MUST BE DESIGNED & INSTALLED TO WITHSTAND WIND LOADS FOR EACH APPLICATION. THE DESIGN & ENGINEERING OF BUCKS SHALL BE PROVIDED BY "THE ENGINEER OF RECORD"
- BUCK FASTENERS MAY NOT EXCEED 16" O.C. SPACING AROUND OPENINGS.
- THE SYSTEM SHOWN HEREIN WAS TESTED FOR WATER, AIR, IMPACT, CYCLIC & UNIFORM STATIC AIR PRESSURE TESTING IN CONFORMANCE WITH DADE COUNTY PROTOCOLS PA-201, 202 & 203.
- ONE-THIRD INCREASE IN ALLOWABLE MATERIAL STRESS LIMITS FOR SHORT DURATION WIND LOAD NOT USED IN THE DESIGN CALCULATIONS.

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 05-0725.03  
Expiration Date FEB. 27, 2008  
By *Manuel Perez*  
Miami Dade Product Control  
Division

LA FINESTRA, L.C.  
ITALIAN WINDOWS & DOORS  
7620 N.W. 25th Street, Unit 6  
Miami, FL 33122  
Phone (305) 599-8093  
Fax (305) 592-4671



APR 10 2006

BROMLEY-COOK ENGINEERING, INC.  
STRUCTURAL ENGINEERING SERVICES  
5440 N.W. 33RD AVENUE SUITE 100  
FORT LAUDERDALE, FL 33309  
EB #009944  
WILLIAM D. COOK, P.E. #49904  
S.I. #0006



PRODUCT:  
SERIES EKU-53  
ALUMINUM CASEMENT  
WINDOW (HI-LOAD)

REVISIONS	No.	DATE	BY	DESCRIPTION

DATE: 1/29/2006  
SCALE: AS NOTED  
DWG. BY: R.P.  
CHK. BY:

DRAWING No.:  
FIN-B16/06

SHEET 1 OF 6

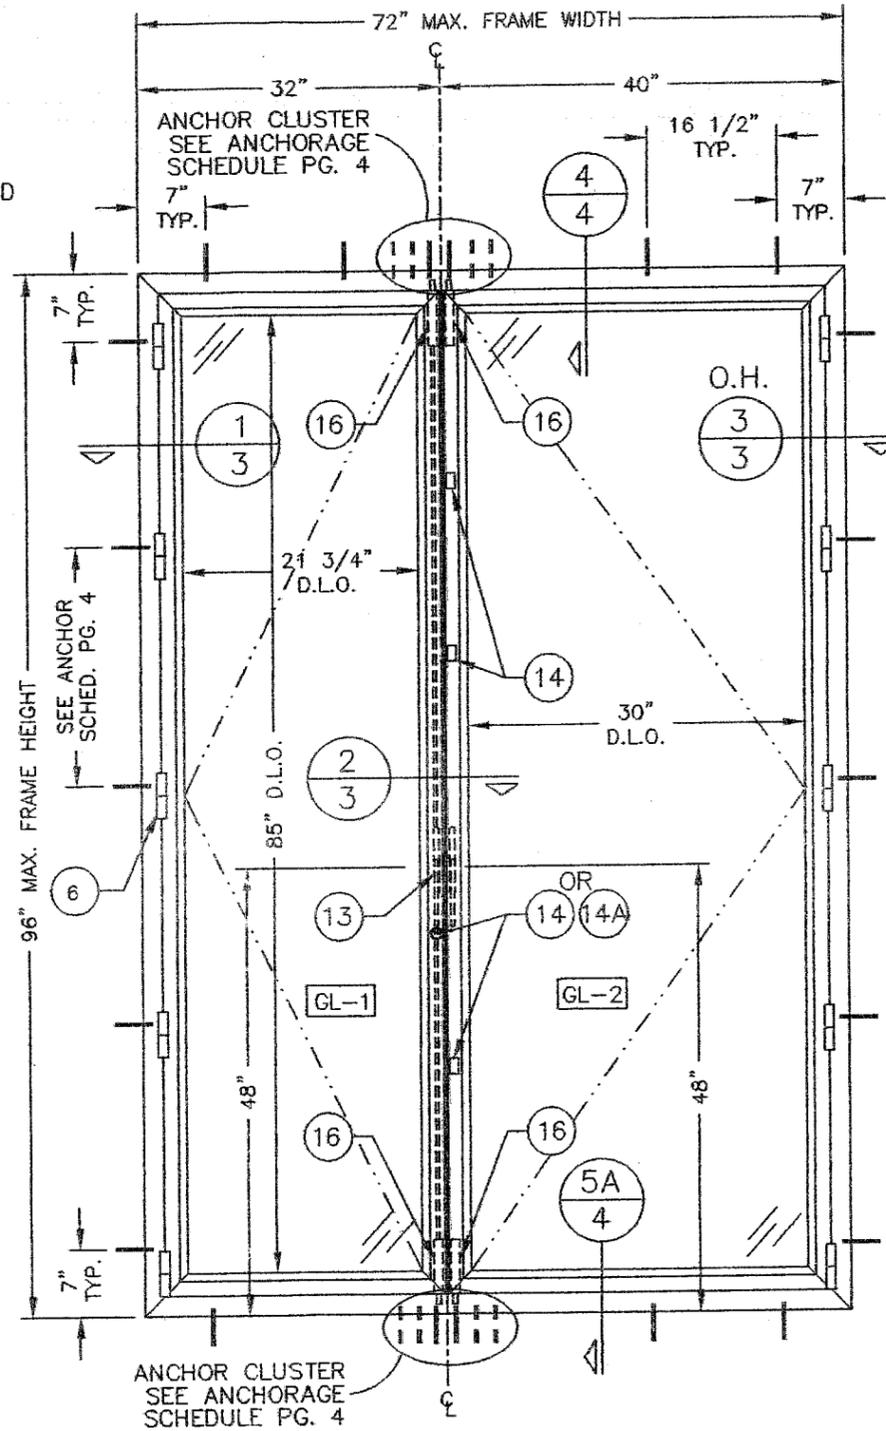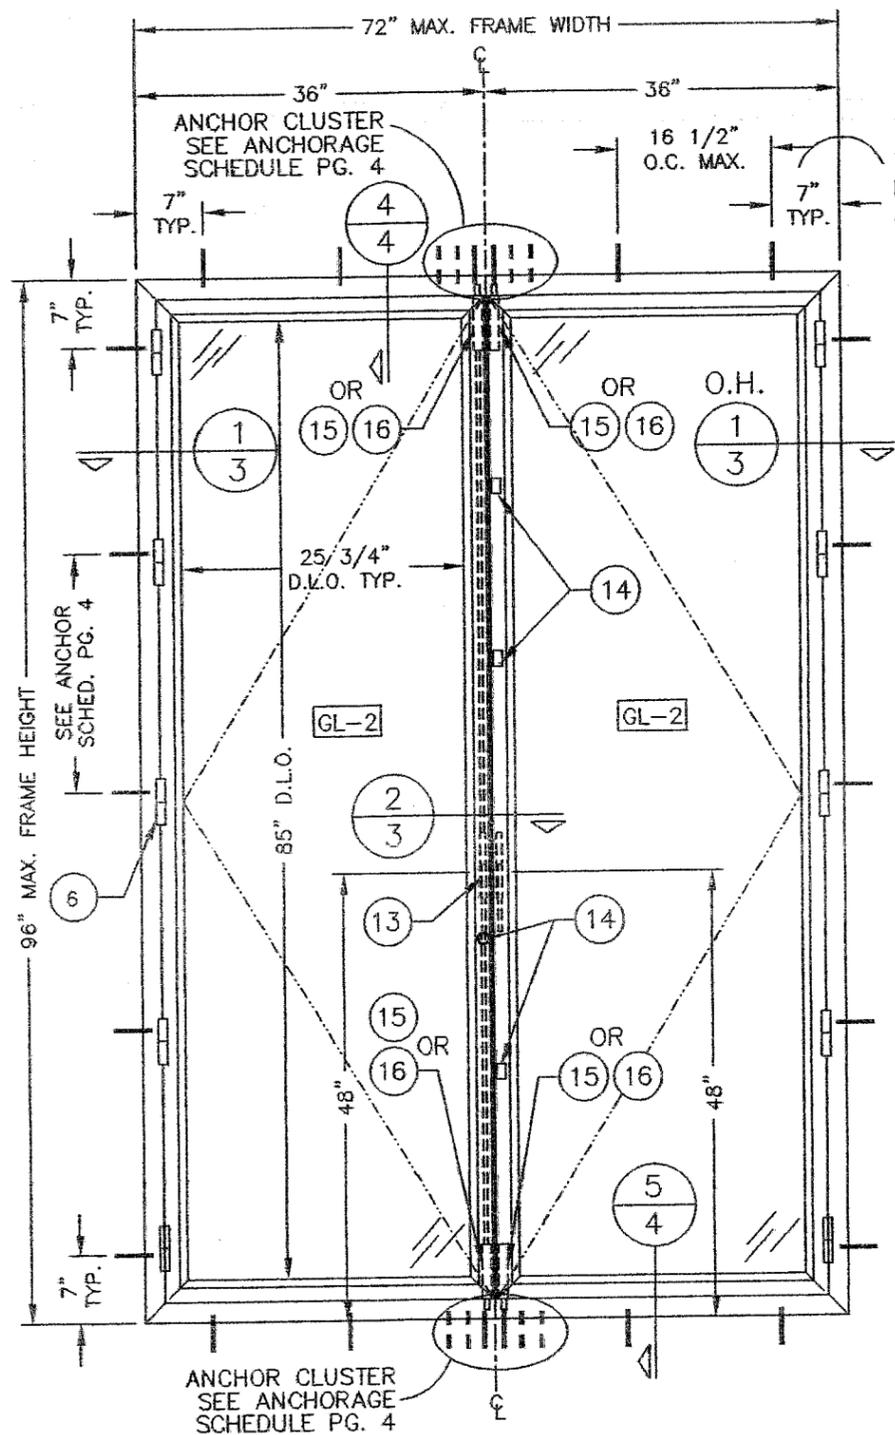

- HARDWARE:**
- ⑥ HINGES: 100-120X 4" LG. TWO PIECE HINGE ASS'Y AS MANUFACTURED BY "G.S.G."
  - ⑬ TRANSMISSION: 1025 TRANSMISSION MOVEMENT DEVICE AS MANUFACTURED BY "G.S.G."
  - LOCKING:
  - ⑭ AT ACTIVE LEAF- AS 6570 5-POINT LOCK SYSTEM AS MANUFACTURED BY "K.F.V."
  - ⑮ AT INACTIVE LEAF- STEEL FLUSH BOLTS AT TOP & BOTTOM OF DOOR LEAF AS MANUFACTURED BY "A.G.B."

**SERIES Eku-53 ALUMINUM CASEMENT WINDOW**  
 (UNIT ELEVATIONS VIEWED FROM EXTERIOR)  
 SCALE: N.T.S.

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. **05-0725.03**  
 Expiration Date **FEB. 27, 2008**  
 By *Manuel Perry*  
 Miami Code Product Control  
 Division

**LA FINESTRA, L.C.**  
 ITALIAN WINDOWS & DOORS  
 7620 N.W. 25th Street, Unit 6  
 Miami, FL 33122  
 Phone (305) 599-8093  
 Fax (305) 592-4671

**BROMLEY-COOK ENGINEERING, INC.**  
 STRUCTURAL ENGINEERING SERVICES  
 6440 N.W. 35RD AVENUE SUITE 100  
 FORT LAUDERDALE, FL 33309  
 EB #00009124  
 WILLIAM D. COOK P.E. #43804  
 S.I. #2008


PRODUCT:  
**SERIES Eku-53  
 ALUMINUM CASEMENT  
 WINDOW (HI-LOAD)**

REVISIONS	
NO.	DESCRIPTION

DATE: 01/28/2006  
 SCALE: AS NOTED  
 DWG. BY: R.P.  
 CHK. BY:  

DRAWING No.:  
**FIN-B16/06**

SHEET 2 OF 6

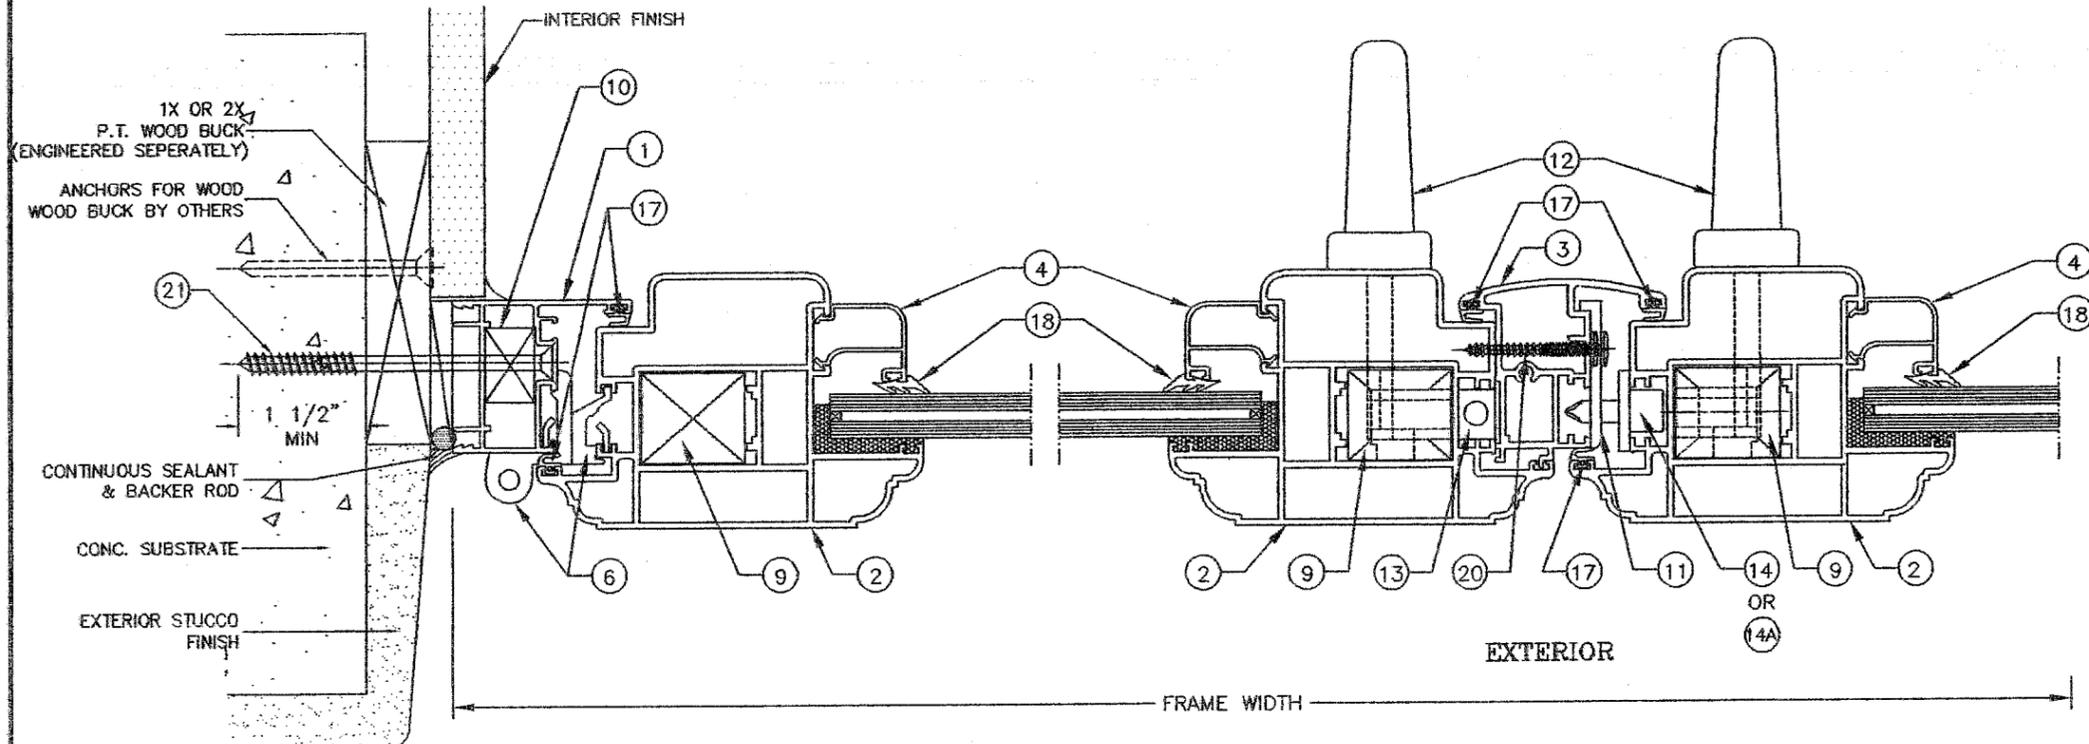


1 JAMB DETAIL  
3 (CONC. SUBSTRATE)


2 ASTRAGAL DETAIL  
3

HORIZONTAL SECTION (1/2"=1" SCALE)


PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. **05-0125.03**  
Expiration Date **FEB. 27, 2008**  
By *Manuel Cruz*  
Miami Trade Product Control  
Division

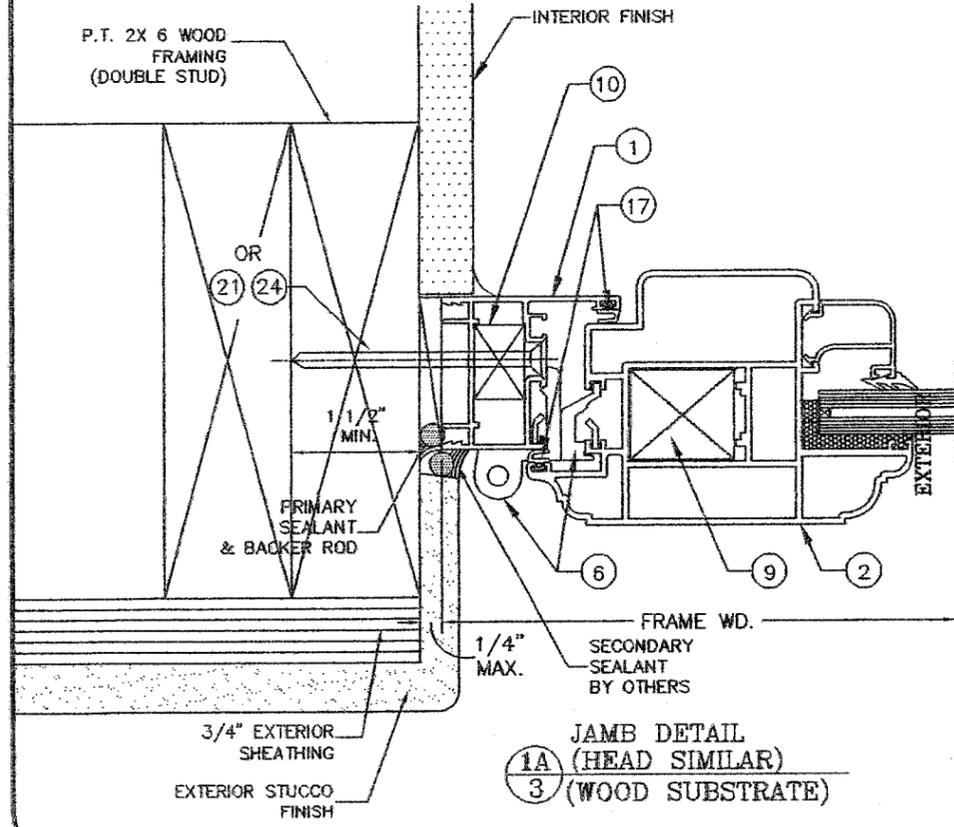

1A JAMB DETAIL (HEAD SIMILAR)  
3 (WOOD SUBSTRATE)

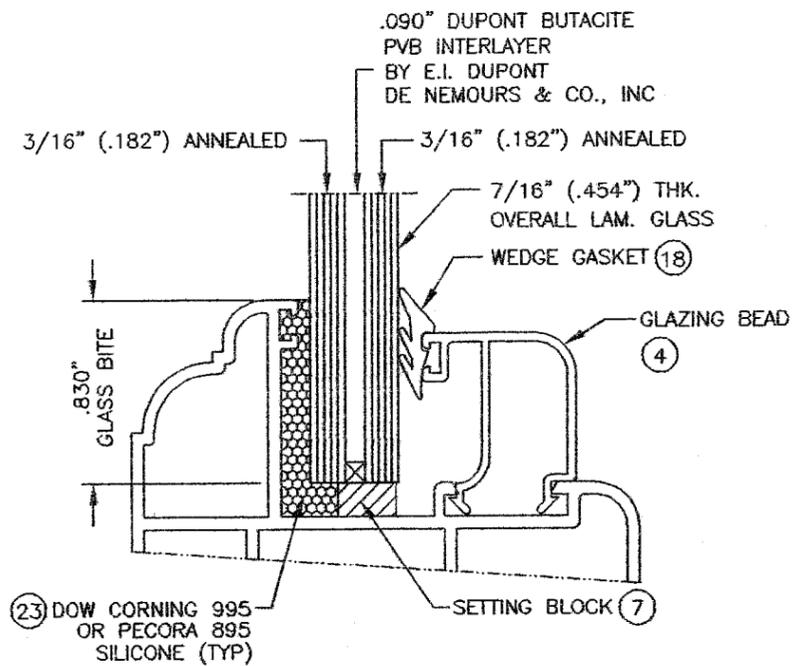

GLAZING DETAIL G-1  
SCALE: FULL SIZE

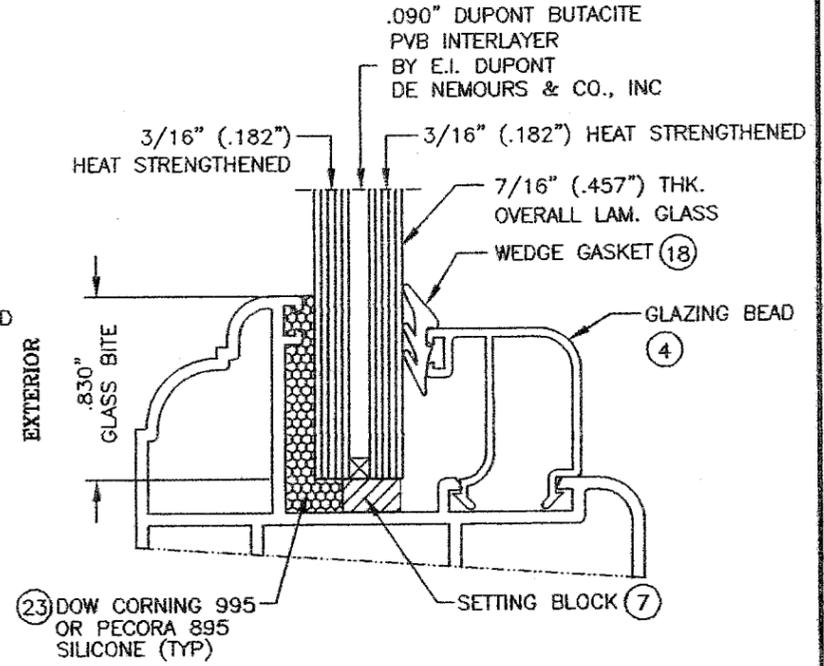

GLAZING DETAIL G-2  
SCALE: FULL SIZE


**I.A. FINESTRA, L.C.**  
ITALIAN WINDOWS & DOORS  
7620 N.W. 25th Street, Unit 6  
Miami, FL 33122  
Phone (305) 599-8093  
Fax (305) 592-4671

BROMLEY-COOK ENGINEERING, INC.  
STRUCTURAL ENGINEERING SERVICES  
5440 N.W. 33RD AVENUE SUITE 100  
FORT LAUDERDALE, FL 33309  
EB #00009124  
WILLIAM D. COOK P.E.  
S.I. #2008

PRODUCT:  
SERIES EKV-53  
ALUMINUM CASEMENT  
WINDOW (HI-LOAD)

REVISIONS	DATE	DESCRIPTION
No.		

DATE: 1/28/2006  
SCALE: AS NOTED  
DWG. BY: R.P.  
CHK. BY:  
DRAWING No.:  
FIN-B16/06  
SHEET 3 OF 6

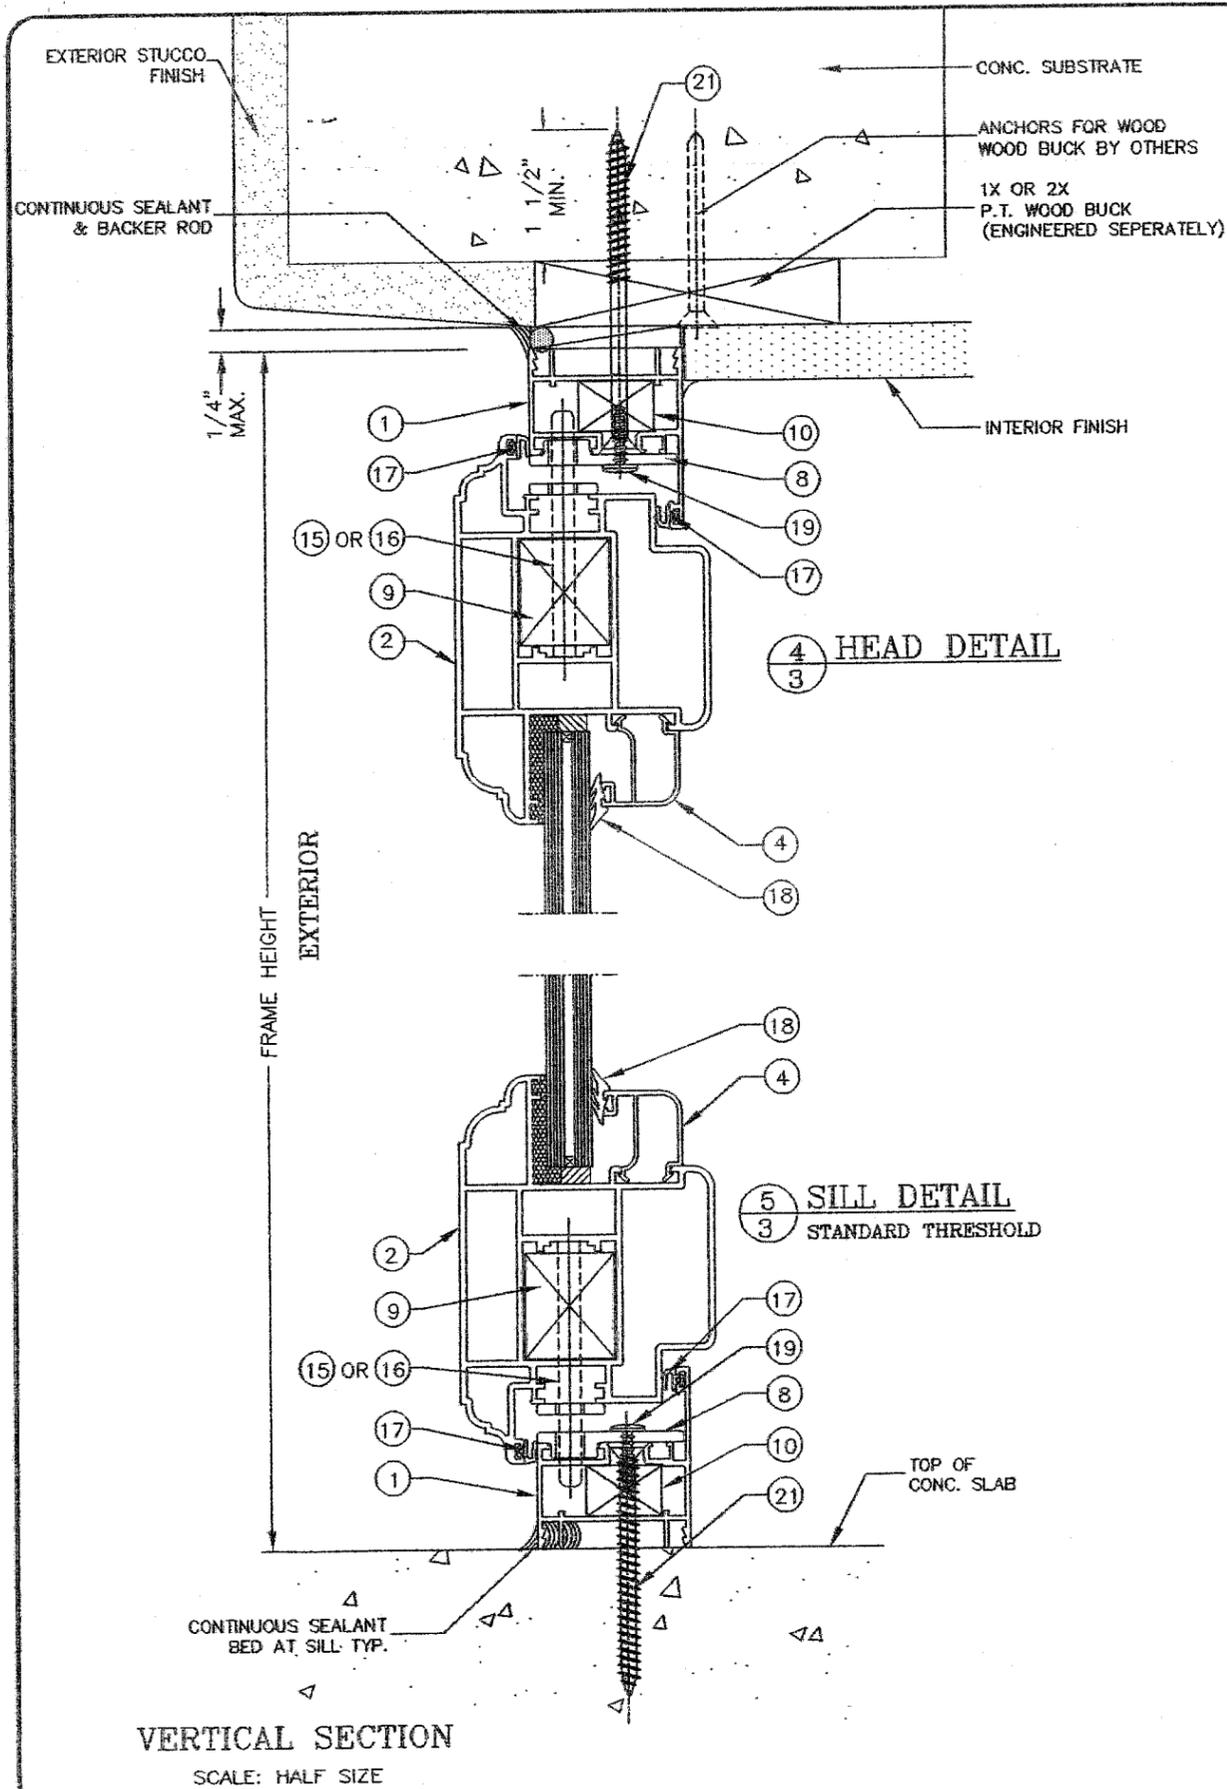

### ANCHOR TYPES

ANCHOR TYPE	SUBSTRATE	MAXIMUM ALLOWABLE ANCHOR SPACING	MAXIMUM ALLOWABLE ANCHOR SPACING
		HEAD - SILL	JAMBS
1/4" X REQ'D. LENGTH TAPCON OR EQUAL 1 1/2" MIN. EMBED INTO CONC.	CONCRETE (2000 PSI MIN.) CBS (GROUT FILLED)	7" FROM ENDS BALANCE @ 16 1/2" C/C MAX.	7" FROM ENDS BALANCE @ 20 1/2" C/C MAX.
#14 X REQ'D. LENGTH P.H.S.M.S. OR SELF-DRILLING	METAL STRUCTURES A-36 STEEL OR ALUMINUM 1/8" MIN. THICKNESS	7" FROM ENDS BALANCE @ 16 1/2" C/C MAX.	7" FROM ENDS BALANCE @ 20 1/2" C/C MAX.
#14 X REQ'D LENGTH P.H.S.M.S. OR #14 WOOD SCREWS 1 1/2" MIN. EMBED INTO WOOD	WOOD FRAMING NO.2 S.Y.P.	7" FROM ENDS & AS PER ANCHOR CAPACITY CHART BELOW	7" FROM ENDS & AS PER ANCHOR CAPACITY CHART BELOW

### ANCHOR CAPACITY CHART (CONC. & STEEL)

QTY. ANCHORS AT MID-POINT (CLUSTER) INTO STEEL	QTY. ANCHORS AT MID-POINT (CLUSTER) INTO CONC.	MAXIMUM ALLOWABLE DESIGN PRESSURE
2	2 SPACED 2 1/2" APART	≤ 60 P.S.F.
2 SPACED 2 1/2" APART	3 SPACED 2 1/2" APART	≤ 70 P.S.F.
2 SPACED 2 1/2" APART	3 SPACED 2 1/2" APART	≤ 80 P.S.F.
2 SPACED 2 1/2" APART	3 SPACED 2 1/2" APART	≤ 90 P.S.F.
3 SPACED 2 1/2" APART	4 SPACED 2 1/2" APART	>90-110 P.S.F.

ANCHOR CLUSTERS AT MID-POINT OF FRAME TYPICAL AT HEAD & SILL

### ANCHOR CAPACITY CHART (WOOD SUBSTRATE)

QTY. ANCHORS AT MID-POINT (CLUSTER)	ANCHORS AT JAMBS (MAX C/C SPACING)	MAXIMUM ALLOWABLE DESIGN PRESSURE
4 SPACED 2 1/2" APART	20 1/2" C/C	≤ 60 P.S.F.
5 SPACED 2 1/2" APART	18" C/C	≤ 70 P.S.F.
6 SPACED 2 1/2" APART	16" C/C	≤ 80 P.S.F.
6 SPACED 2 1/2" APART	14" C/C	≤ 90 P.S.F.
7 SPACED 2 1/2" APART	12" C/C	>90-110 P.S.F.

ANCHOR CLUSTERS AT MID-POINT OF FRAME TYPICAL AT HEAD & SILL

PRODUCT REVISED as complying with the Florida Building Code  
 Acceptance No. **05-0125.03**  
 Expiration Date **FEB. 27, 2008**  
 By *Manuel Serrano*  
 Miami Trade Product Control Division

**L.A. FINESTRA, L.C.**  
**ITALIAN WINDOWS & DOORS**  
 7620 N.W. 25th Street, Unit 6  
 Miami, FL 33122  
 Phone (305) 599-8093  
 Fax (305) 592-4671


**BROMLEY-COOK ENGINEERING, INC.**  
 STRUCTURAL ENGINEERING SERVICES  
 6440 N.W. 33RD AVENUE, SUITE 100  
 FORT LAUDERDALE, FL 33309  
 EB #00008124  
 WILLIAM D. COOK P.E. #43904  
 S.I. #2008

PRODUCT:  
**SERIES EKV-53**  
**ALUMINUM CASEMENT**  
**WINDOW (HI-LOAD)**


NO.	DATE	BY	DESCRIPTION

DATE: 1/28/2006  
 SCALE: AS NOTED  
 DWG. BY: R.P.  
 CHK. BY:  
 DRAWING No.:  
**FIN-B16/06**  
 SHEET 4 OF 6

**VERTICAL SECTION**  
 SCALE: HALF SIZE

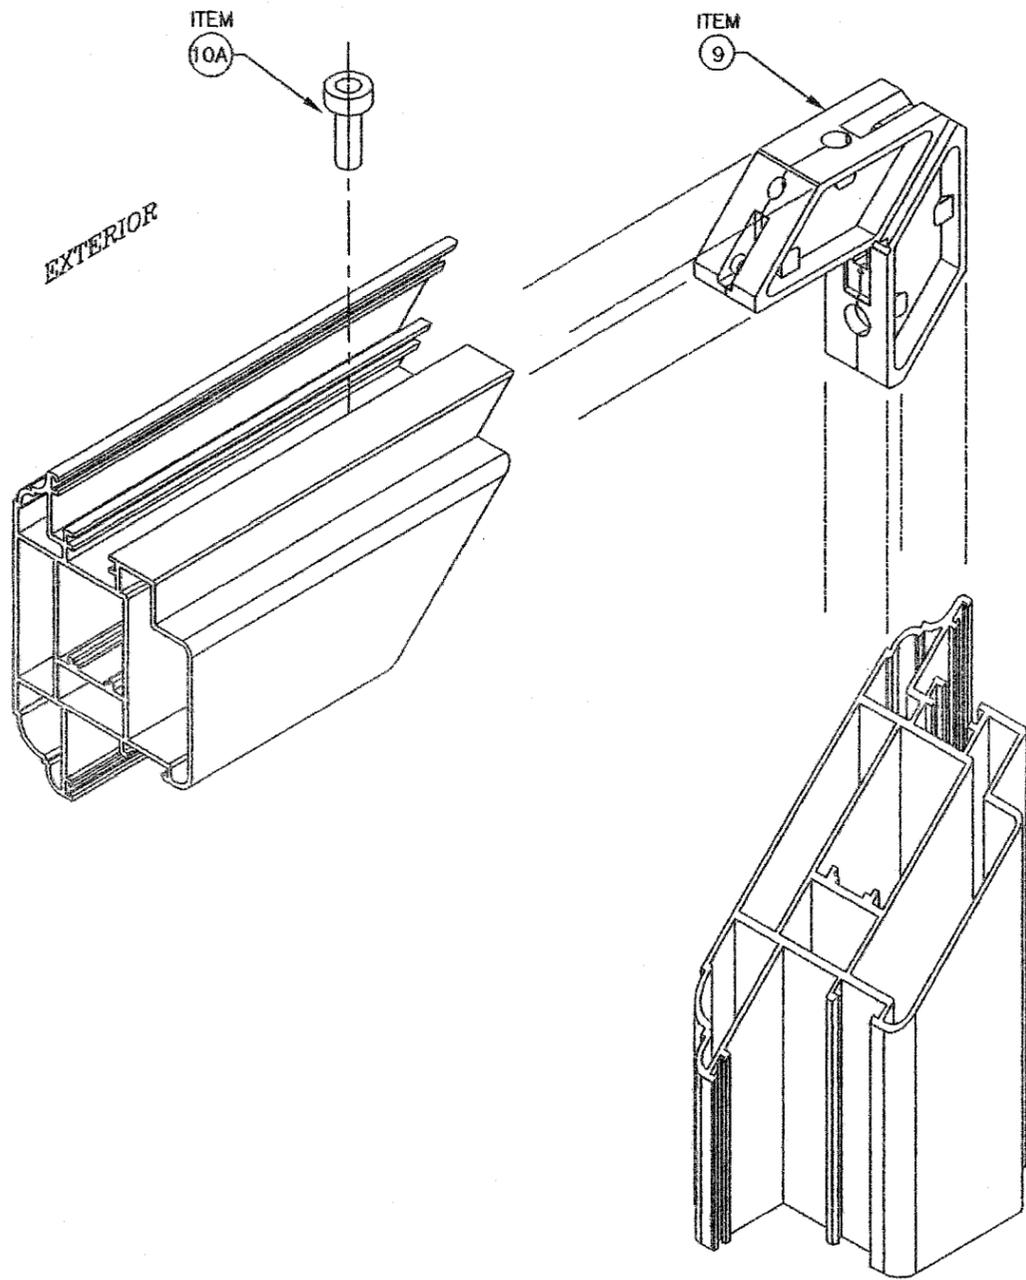

DOOR PANEL CORNER DETAIL

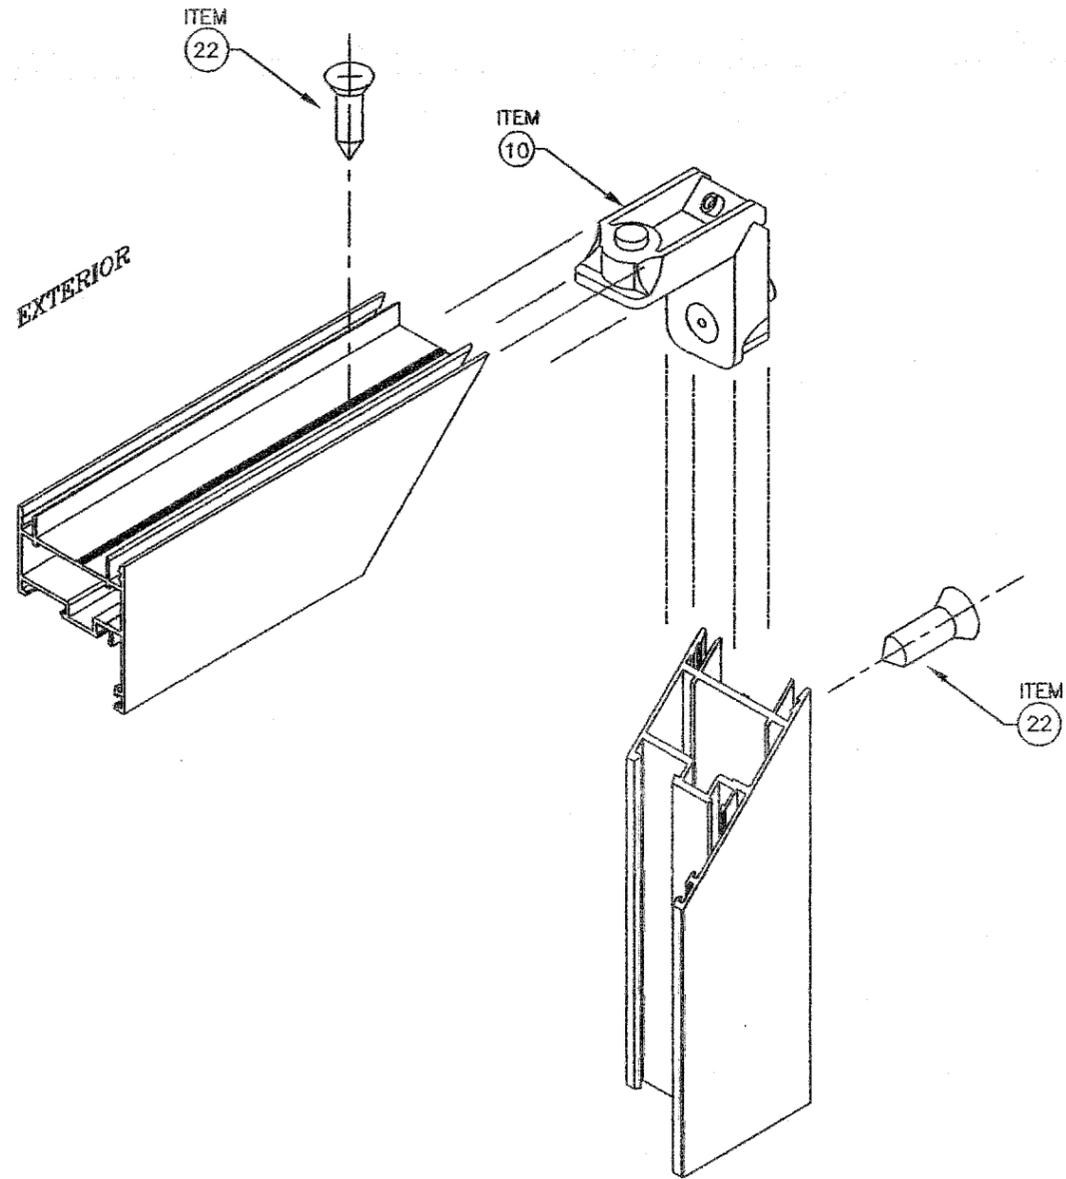

DOOR FRAME CORNER DETAIL

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. **05-0725.03**  
 Expiration Date **FEB. 27, 2008**  
 By *Manuel Perez*  
 Miami Dade Product Control  
 Division

REVISIONS	
No.	DESCRIPTION

DATE: 1/28/2006  
 SCALE: AS NOTED  
 DWG. BY: R.P.  
 CHK. BY:  
 DRAWING No.:  
 FIN-B16/06  
 SHEET 5 OF 8


PRODUCT:  
 SERIES EKV-53  
 ALUMINUM CASEMENT  
 WINDOW (HI-LOAD)

BROMLEY-COOK ENGINEERING, INC.  
 STRUCTURAL ENGINEERING SERVICES  
 6440 N.W. 33RD AVENUE, SUITE 7100  
 FORT LAUDERDALE, FL 33309  
 EB #00009124  
 WILLIAM D. COOK FL. P.E. #38904  
 S.I. #2008


**LA FINESTRA, L.C.**  
 ITALIAN WINDOWS & DOORS  
 7620 N.W. 25th St.  
 Miami, FL 33122  
 Phone (305) 598-8093  
 Fax (305) 592-4671

**BILL OF MATERIALS**


ITEM	PART No.	QUANTITY	DESCRIPTION	MATERIAL	LOCATION	MANUFACTURER
1	7011	4	FRAME HEAD/JAMB/ SILL	EN AW-6060-T5	DOOR FRAME	PROFILATI SpA
2	Z16012	4	SASH HEAD/JAMB/SILL	EN AW-6060-T5	DOOR PANEL	PROFILATI SpA
3	Z16014	1	ASTRAGAL	EN AW-6060-T5	INACTIVE LEAF PANEL JAMB	PROFILATI SpA
4	4195	4/VENT	GLAZING BEAD	EN AW-6060-T5	PANEL PERIMETER	PROFILATI SpA
5	N/A					
6	100-120X	5/VENT	4" LG. TWO-PIECE HINGE ASSY.	EN AW-6060-T5	PANEL AND FRAME JAMBS	GSG
7	N/A	2 EA. LITE OF GLASS	1/4" X 1/2" X 3" LG. SETTING BLOCK	EXTRUDED SILICONE	@ 6" FROM ENDS	GENERIC
8	2509	2	FLUSHBOLT STRIKE PLATE (4" LONG)	EN AW-6060-T5	FLUSHBOLTS (TOP/BOTTOM)	PROFILATI SpA
9	0409	1 EA. CORNER	PANEL CORNER KEY	CAST ALUMINUM	FRAME CORNERS	MONTICELLI
10	5004	1 EA. CORNER	FRAME CORNER KEY	CAST ALUMINUM	PANEL CORNERS	MONTICELLI
10A	0706	2 EA. CORNER	.370" DIA. METTALIC PIN	CAST ALUMINUM	FRAME CORNERS	MONTICELLI
11	Z17173	1	STRIKE PLATE FOR LOCK SYSTEM	EN AW-6060-T5	ASTRAGAL	PROFILATI SpA
12	SERIES 800	1/VENT	OPERATING HANDLE	ALUMINUM	AT EACH PANEL JAMB	PASSINI
13	1025	1	TRANSMISSION MOVEMENT DEVISE	ZAMA/S.S.	PANEL JAMB (ASTRAGAL SIDE ONLY)	GSG
14	AS 6570	1/VENT	FIVE POINT LOCK SYSTEM	ZINC/IRON/S.S.	PANEL JAMB	KFV
14A	AGB	1/VENT	MULTIPLE POINT LOCK SYSTEM	ZINC/IRON/S.S.	PANEL JAMB	AGB
15	AGB	2/VENT	FLUSH BOLT	ZINC/IRON/S.S.	PANEL JAMB AT TOP & BOTTOM	GSG
16	KFV	2/VENT	FLUSH BOLT (HEAVY DUTY)	STAINLESS STEEL	PANEL JAMB AT TOP & BOTTOM	KFV
17	2666	AS REQ'D.	WEATHERSTRIP GASKET	EPDM	FRAME JAMB/ASTRAGAL/FRAME PANEL	PROFILATI SpA
18	2195	AS REQ'D.	WEDGE GASKET	EPDM	PANEL GLAZING PERIM. (INTERIOR)	PROFILATI SpA
19	---	2/EACH	# 10 x 2 1/2" FH.SMS. (ASSEMBLY)	PLATED STEEL	FLUSHBOLT STRIKE PLATE	---
20	---	SEE ELEV.	# 8 x 1 1/2" FH.SMS. (ASSEMBLY)	PLATED STEEL	ASTRAGAL (SINGLE ROW)	---
21	---	SEE ELEV.	1/4" DIA. TAPCONS (INSTALLATION)	COATED STEEL	FRAME PERIMETER (SINGLE ROW)	ELCO OR BUILDDEX
22	---	2 EA. CORNER	#14 X 3/4" FH. SMS. (PANEL ASS'Y)	PLATED STEEL	PANEL CORNERS	---
23	895/995	CONTINUOUS	STRUCTURAL SILICONE	SILICONE	PERIMETER GLASS TO METAL	PECORA OR DOW CORNING
24	---	SEE ELEV.	#14 F.H. WD. SCREWS (INSTALLATION)	COATED STEEL	FRAME PERIMETER (SINGLE ROW)	ISC




① 7011 - FRAME HEAD-JAMB-SILL

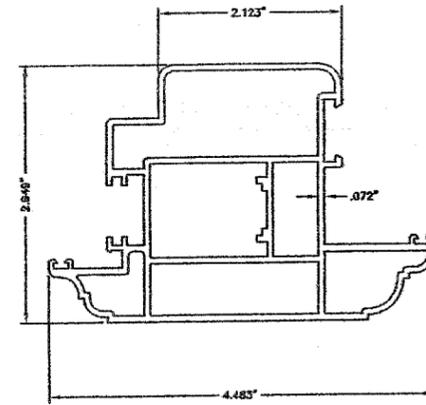


② Z16012 PANEL HEAD/JAMB/SILL




④ 4195 GLAZING BEAD




③ Z16014 ASTRAGAL




⑤ 6009 COMMERCIAL THRESHOLD



①A 7011 - RESIDENTIAL SILL



⑱ 2195 WEDGE GASKET



⑰ 2666 WEATHERSTRIP GASKET

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 05-0725.03  
Expiration Date FEB. 27, 2008  
By: *Manuel Perez*  
Miami Trade Product Control  
Division

**LA FINESTRA, L.C.**  
ITALIAN WINDOWS & DOORS  
7620 N.W. 25th Street, Unit 6  
Miami, FL 33122  
Phone (305) 599-8033  
Fax (305) 592-4871

**BROMLEY-COOK ENGINEERING, INC.**  
STRUCTURAL ENGINEERING SERVICES  
5440 N.W. 38RD AVENUE SUITE 100  
FORT LAUDERDALE, FL 33309  
EB #00009124  
WILLIAM D. COOK FL. P.E. #12304  
S.I. #2008

PRODUCT:  
**SERIES EKV-53**  
**ALUMINUM CASEMENT**  
**WINDOW (HI-LOAD)**

NO.	DATE	BY	DESCRIPTION

DATE: 1/28/2006  
SCALE: AS NOTED  
DWG. BY: R.P.  
CHK. BY:

DRAWING No.:  
FIN-B16/06  
SHEET 6 OF 6