



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

[www.buildingcodeonline.com](http://www.buildingcodeonline.com)

**NOTICE OF ACCEPTANCE (NOA)**

R.C. Aluminum Industries, Inc.  
2085 NW 75<sup>th</sup> Ave  
Miami, FL 33122

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "RW-240" Aluminum Sliding Glass Door-L.M.I.**

**APPROVAL DOCUMENT:** Drawing No. **W04-11**, titled "Series-RW240 Alum Sliding Glass Door (L.M.I.)", sheets 1 through 7 of 7, prepared by AL-Farooq Corporation, dated 02/19/04 with revision "C" on 11/01/05, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # **04-0401.02** and page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above

The submitted documentation was reviewed by **Herminio F. Gonzalez, P.E., Director, BCCO**



NOA No 05-0815.16  
Expiration Date: June 24, 2009  
Approval Date: January 05, 2006  
Page 1

R.C. Aluminum Industries, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No. **W04-11**, titled "Series -RW240 Alum Sliding Glass Door (L.M.I.)", sheets 1 through 7 of 7, prepared by AL-Farooq Corporation, dated 02/19/04 with revision "C" on 11/01/05, signed and sealed by Humayoun Farooq, P.E.

**B. TESTS**

1. Test reports on
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 20294
  - 3) Water Resistance Test, per FBC, TAS 202-94
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
  - 6) Forced Entry Test, per FBC 2411.3.2.1 and TAS 202-94along with marked-up drawings and installation diagram of an aluminum sliding glass door, prepared by Fenestration Testing Laboratories, Inc. Test Report No. **FTL-4080** dated 01/26/04, signed and sealed by Edmundo J. Largaespada, P.E.  
*"Submitted under NOA# 04-0401.02"*

**C. CALCULATIONS**

1. Revised Anchor Calculations, and Structural Analysis, prepared by AL-Farooq Corporation, dated 08/04/05, signed and sealed by Humayoun Farooq, P.E.  
**Complies with ASTM E1300-98**  
**No 1/3 stress increase used in anchors into masonry or steel substrate.**
2. Anchor Calculations, ASTM E-1300-98, and structural analysis, prepared by AL-Farooq Corporation, dated 03/18/04, signed and sealed by Humayoun Farooq, P.E.  
*"Submitted under NOA# 04-0401.02"*

**D. QUALITY ASSURANCE**


1. Miami Dade Building Code Compliance Office (BCCO).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **05-1208.02** issued to "E.I. Dupont DeNemours" for "Dupont Butacite ® PVB" dated 01/05/06 and expiring on 12/11/10"

**F. STATEMENTS**

1. Statement letter of conformance, and no financial interest, dated 08/04/04, signed and sealed by Humayoun Farooq, P.E.

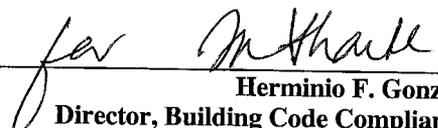
  
\_\_\_\_\_  
Herminio F. Gonzalez, P.E.  
Director, Building Code Compliance Office  
NOA No 05-0815.16  
Expiration Date: June 24, 2009  
Approval Date: January 05, 2006


**R.C. Aluminum Industries, Inc.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**G. OTHER**

1. Letter from consultant, dated 11/15/05, stating that the product is in compliance with the Florida Building Code (FBC).
2. Notice of Acceptance No. **04-0401.02**, issued to R.C. Aluminum Industries, Inc. for their "Series RW240 Aluminum Sliding Glass Door", approved on 06/24/04 and expiring on 06/24/09.

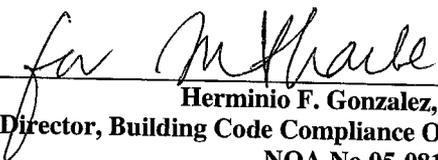  
\_\_\_\_\_  
**Herminio F. Gonzalez, P.E.**  
**Director, Building Code Compliance Office**  
**NOA No 05-0815.16**  
**Expiration Date: June 24, 2009**  
**Approval Date: January 05, 2006**

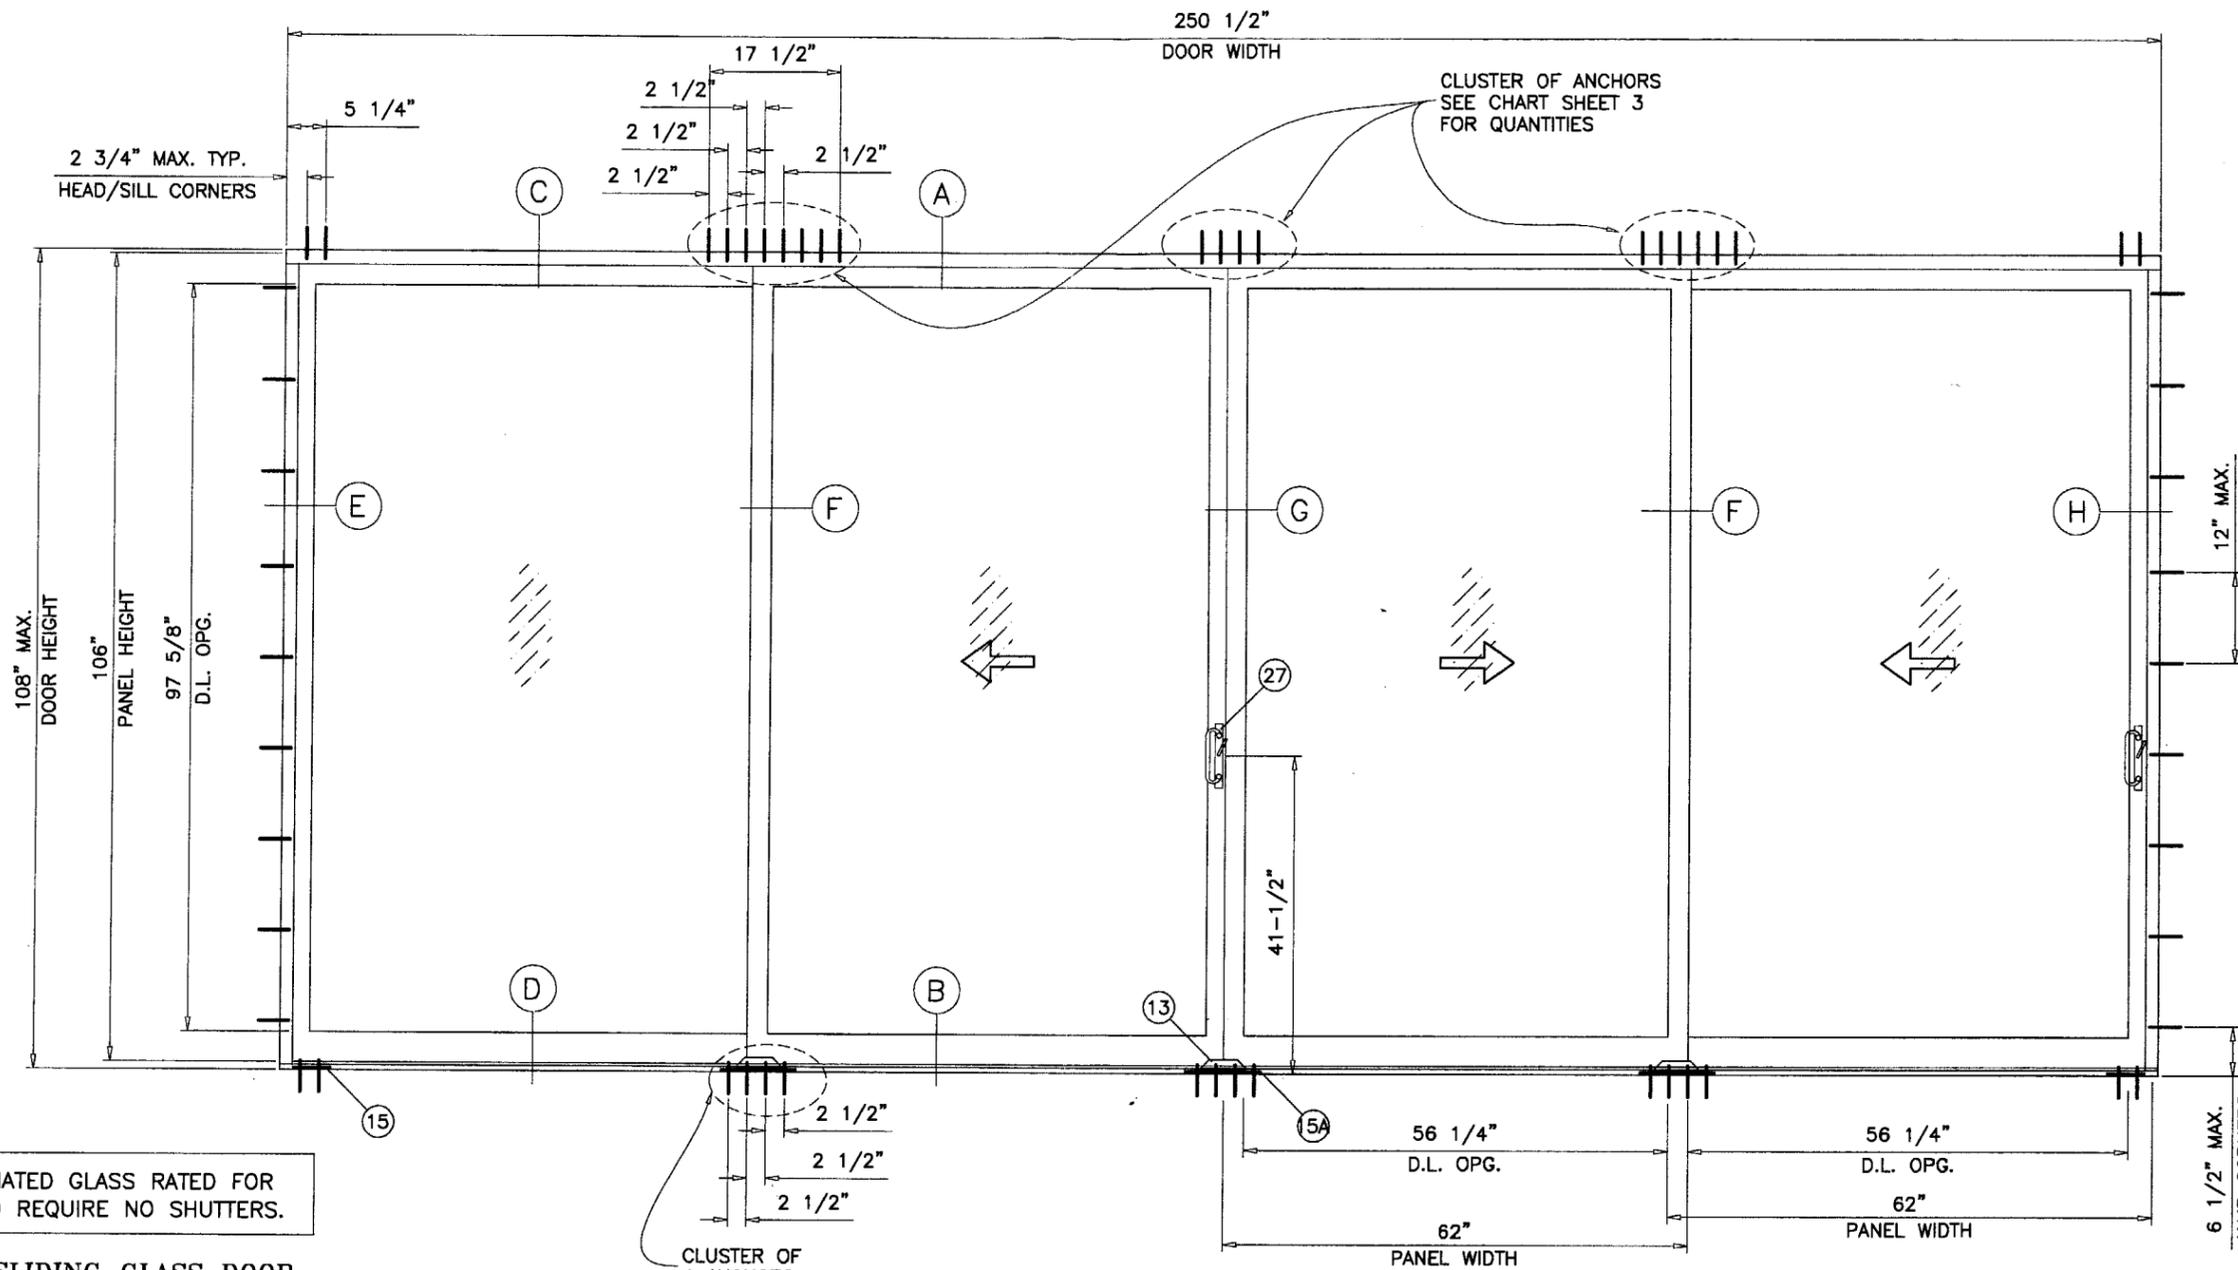

DOORS GLAZED WITH LAMINATED GLASS RATED FOR LARGE MISSILE IMPACT AND REQUIRE NO SHUTTERS.

**SERIES-RW240 ALUM SLIDING GLASS DOOR**

SEE SHEET 2 FOR DESIGN LOAD CAPACITY OF DESIRED GLASS SIZE. USING CHART ON SHEET 3 SELECT ANCHOR OPTION WITH DESIGN RATING MORE THAN DESIGN LOADS REQUIRED. LOWER DESIGN PRESSURES FROM GLASS OR ANCHOR CHARTS WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004 EDITION FOR THE HIGH VELOCITY HURRICANE ZONE.


WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.


ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF WOOD ANCHORS ONLY.


ALL STEEL IN CONTACT WITH ALUMINUM TO BE PAINTED OR PLATED.




XO (SHOWN)  
OX



OXO (SHOWN)

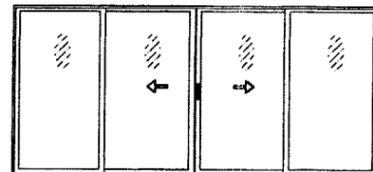

OXXO (SHOWN)

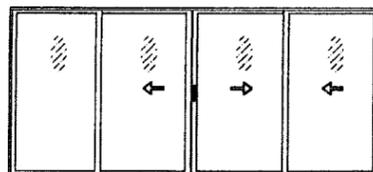

OXXX

**APPROVED CONFIGURATIONS**

TWO OR THREE TRACK FRAME DOOR CONFIGURATIONS OF MORE THAN FOUR PANELS USING STILE COMBINATIONS SHOWN IN THESE DETAILS MAY ALSO BE APPROVED (EXAMPLE OOXO).

**PRODUCT REVIEWED**  
as complying with the Florida Building Code  
Acceptance No. 05-0815.16  
Expiration Date 06/24/09  
By: *M. Smith*  
Miami Dade Product Control Division

Engr. DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

*[Signature]*  
NOV 08 2005



**AL-FAROOQ CORPORATION**  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W04-11RC

**SERIES-RW240 ALUM SLIDING GLASS DOOR (L.M.I.)**  
**R.C. ALUMINUM INDUSTRIES INC.**  
2805 N.W. 75 TH AVE.  
MIAMI, FL. 33122  
TEL. (305) 592-1515 FAX. (305) 592-2184

no	date	by	description
A	05.04.04	REV. PER BCOO COMMENTS	
B	08.05.05	UPDATED FOR 2004 FBC	
C	11.01.05	NOTE REV.	



date: 02-19-04  
scale: 1/2"=1'-0"  
dr. by: HAMID  
chk. by:

drawing no.  
**W04-11**

sheet 1 of 7

DESIGN LOAD CAPACITY - PSF (GLASS)					
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	GLASS TYPE 'A'		GLASS TYPE 'B'	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
30	80	80.0	80.0	80.0	80.0
36		80.0	80.0	80.0	80.0
42		80.0	80.0	80.0	80.0
48		80.0	80.0	80.0	80.0
54		80.0	80.0	80.0	80.0
60		80.0	80.0	80.0	80.0
62-5/8		80.0	80.0	80.0	80.0
66		80.0	80.0	80.0	80.0
30	96	80.0	80.0	80.0	80.0
36		80.0	80.0	80.0	80.0
42		80.0	80.0	80.0	80.0
48		80.0	80.0	80.0	80.0
54		80.0	80.0	77.5	77.5
60		80.0	80.0	69.6	69.6
62-5/8		80.0	80.0	79.9	79.9
66		80.0	80.0	77.9	77.9
30	102	80.0	80.0	80.0	80.0
36		80.0	80.0	80.0	80.0
42		80.0	80.0	80.0	80.0
48		80.0	80.0	80.0	80.0
54		80.0	80.0	72.6	72.6
60		80.0	80.0	65.1	65.1
62-5/8		80.0	80.0	75.1	75.1
66		80.0	80.0	72.0	72.0
30	108	80.0	80.0	80.0	80.0
36		80.0	80.0	80.0	80.0
42		80.0	80.0	80.0	80.0
48		80.0	80.0	80.0	80.0
54		80.0	80.0	68.4	68.4
60		80.0	80.0	61.5	61.5
62-5/8		80.0	80.0	71.1	71.1

NOTE:  
GLASS CAPACITIES ON THIS SHEET ARE  
BASED ON ASTM E1300-98 (60 SEC. WIND)

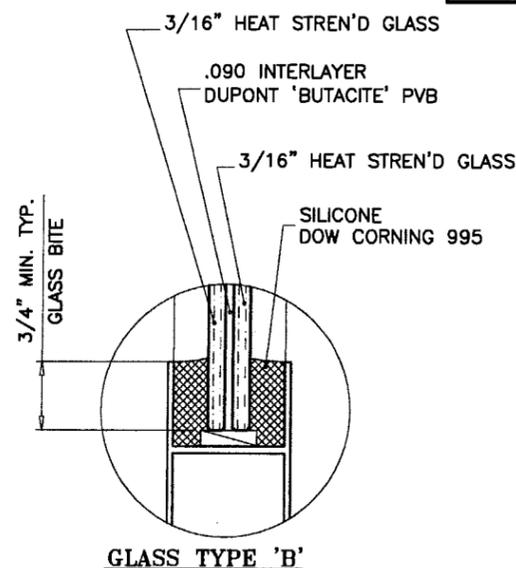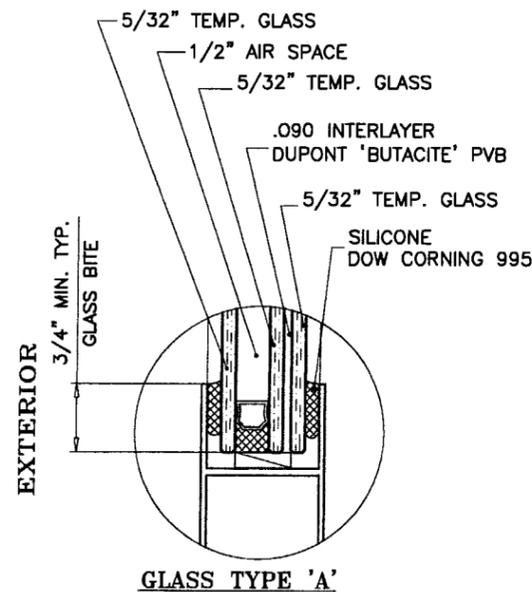

GLAZING OPTIONS

ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	2400ST-038	1	FRAME HEAD	6005-T5	-
2	2400ST-051	1	FRAME SILL	6005-T5	-
3	2400ST-042	2	FRAME JAMB	6063-T6	-
4	2400ST-048	1/MOV. PANEL	MOVING HORIZ. BOTT. RAIL	6063-T6	-
4A	2400ST-054	1/MOV. PANEL	ALT. MOVING HORIZ. BOTT. RAIL	6063-T6	-
5	2400ST-050	1/FIX. PANEL	FIXED HORIZ. BOTT. RAIL	6063-T6	-
5A	2400ST-055	1/FIX. PANEL	ALT. FIXED HORIZ. BOTT. RAIL	6063-T6	-
6	2400ST-047	1/MOV. PANEL	TOP MOVING RAIL	6063-T6	-
7	2400ST-049	1/FIX. PANEL	TOP FIXED RAIL	6063-T6	-
8	-	-	-	-	-
9	2400ST-022	1	LOCK STILE	6063-T6	-
10	2400ST-041	1/ PANEL	INTERLOCK	6063-T6	-
11	2400ST-025	1	MEETING STILE	6063-T6	-
12	2400ST-052	1	THRESHOLD COVER	6063-T6	-
13	2400ST-011	-	SILL TRACK ANCHOR	6005-T5	6" LONG
14	2400ST-053	1	HEAD COVER	6063-T6	-
15	2400ST-031	2	SILL TRACK PLATE (5-1/4" X 1/4" X 5" LONG	6061-T6	AT EACH END
15A	2400ST-031	3	SILL TRACK PLATE (5-1/4" X 1/4" X 10" LONG	6061-T6	AT INTERLOCK/ASTRAGAL STILES
16	2400ST-032	-	MTG. RAIL THRESHOLD SEAL	6063-T5	6" LONG
17	#10 X 1/2"	2	WEATHERSTRIP FASTENERS	-	-
18	V-027	-	BULB W'STRIPPING	VINYL	FP-712 PROTOTYPE
19	WV-2310	-	FLAP WEATHER SEAL	VINYL	WIBORG
20	V-026	-	BULB W'STRIPPING	VINYL	FP-198 PROTOTYPE
21	W31265NK	-	FIN PILE W'STRIPPING	-	ULTRAFAB
22	Q250X270	-	Q-LON W'STRIPPING	-	SCHLEGEL
26	100-7101	2/MOV. PANEL	TANDEM WHEEL ASSEMBLY	-	WORLD IND. PRODUCTS INTL.
27	10-0018XX	1	STANDARD SLIDE SET LOCK	-	WORLD IND. PRODUCTS INTL.
28	-	1	LOCK KEEPER	-	-
29	-	-	DOOR BUMPER	-	1" DIA. X 3/4" LONG
30	2400ST-040	AS REQD.	INSIDE SCREEN TRACK	6063-T6	-
31	#10 X 1-1/4"	2/ PANEL	PANEL ASSBY. SCREWS	ST/ST	-
32	#10 X 1-1/4"	2/ CORNER	FRAME ASSBY. SCREWS	ST/ST	-
33	-	2	4-1/4" X .060" X 6" LONG PLATE	ALUMINUM	AT FRAME JAMB BOTTOM
34	-	-	5/8" X 1-1/2" X .1" PLATE @ LOCK STILE BOTTOM	ALUMINUM	FASTENED WITH #8 X 3/8" FH SMS
35	-	-	-	-	-
36	W21205NK	AS REQD.	VERTICAL W'STRIPPING	PILE	ULTRAFAB

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No 05-0815.16  
Expiration Date 06/24/09  
By *M. Khalil*  
Miami Dade Product Control  
Division

Engr: DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

NOV 08 2005

**afc**

**AL-FAROOQ CORPORATION**  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978

---

SERIES-RW240 ALUM SLIDING GLASS DOOR (L.M.I.)

**R.C. ALUMINUM INDUSTRIES INC.**  
2805 N.W. 75 TH AVE.  
MIAMI, FL. 33122  
TEL. (305) 592-1515 FAX. (305) 592-2184

no	date	description
A	05.04.04	NO CHANGE THIS SHEET
B	08.05.05	GLASS CHART ADDED
C	11.01.05	NO CHANGE THIS SHEET

date: 02-19-04	scale: 1/2" = 1"	dr. by: HAMID	chk. by:
----------------	------------------	---------------	----------

drawing no. **W04-11**

sheet 2 of 7

DESIGN LOAD CAPACITY - PSF (ANCHORS)

PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	3/8" MAX. SHIM SPACE						1/2" MAX. SHIM SPACE						5/8" MAX. SHIM SPACE						
		CLUSTER OF 4 ANCHORS		CLUSTER OF 6 ANCHORS		CLUSTER OF 8 ANCHORS		CLUSTER OF 4 ANCHORS		CLUSTER OF 6 ANCHORS		CLUSTER OF 8 ANCHORS		CLUSTER OF 4 ANCHORS		CLUSTER OF 6 ANCHORS		CLUSTER OF 8 ANCHORS		
		ANCHORS A & B	ANCHORS C																	
		EXT. (+) INT. (-)	EXT. (+) INT. (-)																	
30	80"	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	
36		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	78.8	70.4	80.0	80.0	80.0	80.0
42		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	71.3	80.0	80.0	80.0	80.0	67.5	60.3	80.0	80.0	80.0	80.0
48		80.0	76.5	80.0	80.0	80.0	80.0	80.0	70.5	62.4	80.0	80.0	80.0	80.0	59.1	52.8	80.0	79.2	80.0	80.0
54		77.9	68.0	80.0	80.0	80.0	80.0	80.0	62.7	55.5	80.0	80.0	80.0	80.0	52.5	46.9	78.8	70.4	80.0	80.0
60		70.1	61.2	80.0	80.0	80.0	80.0	80.0	56.4	49.9	80.0	74.9	80.0	80.0	47.3	42.2	70.9	63.4	80.0	80.0
62-5/8		67.1	58.6	80.0	80.0	80.0	80.0	80.0	54.0	47.8	80.0	71.7	80.0	80.0	45.3	40.5	67.9	60.7	80.0	80.0
66		63.7	55.6	80.0	80.0	80.0	80.0	80.0	51.3	45.4	76.9	68.1	80.0	80.0	43.0	38.4	64.5	57.6	80.0	76.8
30	96"	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	
36		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	78.3	69.3	80.0	80.0	80.0	80.0	65.7	58.7	80.0	80.0	
42		80.0	72.9	80.0	80.0	80.0	80.0	80.0	80.0	80.0	67.1	59.4	80.0	80.0	80.0	80.0	56.3	50.3	80.0	80.0
48		73.0	63.8	80.0	80.0	80.0	80.0	80.0	80.0	80.0	58.8	52.0	80.0	80.0	80.0	80.0	49.3	44.0	73.9	66.0
54		64.9	56.7	80.0	80.0	80.0	80.0	80.0	80.0	80.0	52.2	46.2	78.3	69.3	80.0	80.0	43.8	39.1	65.7	58.7
60		58.4	51.0	80.0	76.5	80.0	80.0	80.0	80.0	80.0	47.0	41.6	70.5	62.4	80.0	80.0	39.4	35.2	59.1	52.8
62-5/8		56.0	48.9	80.0	73.3	80.0	80.0	80.0	80.0	80.0	45.0	39.9	67.5	59.8	80.0	79.7	37.7	33.7	56.6	50.6
66		53.1	46.4	79.6	69.5	80.0	80.0	80.0	80.0	80.0	42.7	37.8	64.1	56.7	80.0	75.6	35.8	32.0	53.7	48.0
30	102"	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	78.3	80.0	80.0	80.0	80.0	74.2	66.3	80.0	80.0	
36		80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	73.7	65.3	80.0	80.0	80.0	80.0	61.8	55.2	80.0	80.0
42		78.5	68.6	80.0	80.0	80.0	80.0	80.0	80.0	80.0	63.2	55.9	80.0	80.0	80.0	80.0	53.0	47.3	79.5	71.0
48		68.7	60.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	55.3	48.9	80.0	73.4	80.0	80.0	46.4	41.4	69.5	62.1
54		61.1	53.3	80.0	80.0	80.0	80.0	80.0	80.0	80.0	49.2	43.5	73.7	65.3	80.0	80.0	41.2	36.8	61.8	55.2
60		55.0	48.0	80.0	72.0	80.0	80.0	80.0	80.0	80.0	44.2	39.2	66.4	58.7	80.0	78.3	37.1	33.1	55.6	49.7
62-5/8		52.7	46.0	79.0	69.0	80.0	80.0	80.0	80.0	80.0	42.4	37.5	63.6	56.3	80.0	75.0	35.5	31.7	53.3	47.6
66		50.0	43.6	75.0	65.5	80.0	80.0	80.0	80.0	80.0	40.2	35.6	60.3	53.4	80.0	71.2	33.7	30.1	50.6	45.2
30	108"	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	80.0	74.0	80.0	80.0	80.0	80.0	80.0	70.0	62.6	80.0	80.0
36		80.0	75.6	80.0	80.0	80.0	80.0	80.0	80.0	80.0	69.6	61.6	80.0	80.0	80.0	80.0	58.4	52.1	80.0	78.2
42		74.2	64.8	80.0	80.0	80.0	80.0	80.0	80.0	80.0	59.7	52.8	80.0	79.2	80.0	80.0	50.0	44.7	75.0	67.0
48		64.9	56.7	80.0	80.0	80.0	80.0	80.0	80.0	80.0	52.2	46.2	78.3	69.3	80.0	80.0	43.8	39.1	65.7	58.7
54		57.7	50.4	80.0	75.6	80.0	80.0	80.0	80.0	80.0	46.4	41.1	69.6	61.6	80.0	80.0	38.9	34.8	58.4	52.1
60		51.9	45.3	77.9	68.0	80.0	80.0	80.0	80.0	80.0	41.8	37.0	62.7	55.5	80.0	74.0	35.0	31.3	52.5	46.9
62-5/8		49.7	43.4	74.6	65.1	80.0	80.0	80.0	80.0	80.0	40.0	35.4	60.0	53.1	80.0	70.9	33.6	30.0	50.3	45.0

PRODUCT REVIEWED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 05-0815-16  
 Expiration Date 06/24/09  
 By: *M. Hamid*  
 Miami Dade Product Control  
 Division

Engr: DR. HUMAYOUN FAROOQ  
 STRUCTURES  
 FLA. PE # 16557  
 C.A.N. 3538

NOV 08 2005

af




AL-FAROOQ CORPORATION  
 ENGINEERS, PLANNERS & PRODUCT DESIGN  
 1235 SW 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W04-11RC

SERIES-RW240 ALUM SLIDING GLASS DOOR (L.M.I.)  
 R.C. ALUMINUM INDUSTRIES INC.  
 2805 N.W. 75 TH AVE.  
 MIAMI, FL. 33122  
 TEL. (305) 592-1515 FAX. (305) 592-2184

revisions:	no	date	by	description
	A	05.04.04		NO CHANGE THIS SHEET
	B	08.05.05		CHART REV.
	C	11.01.05		NO CHANGE THIS SHEET

date: 02-19-04  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W04-11**  
 sheet 3 of 7

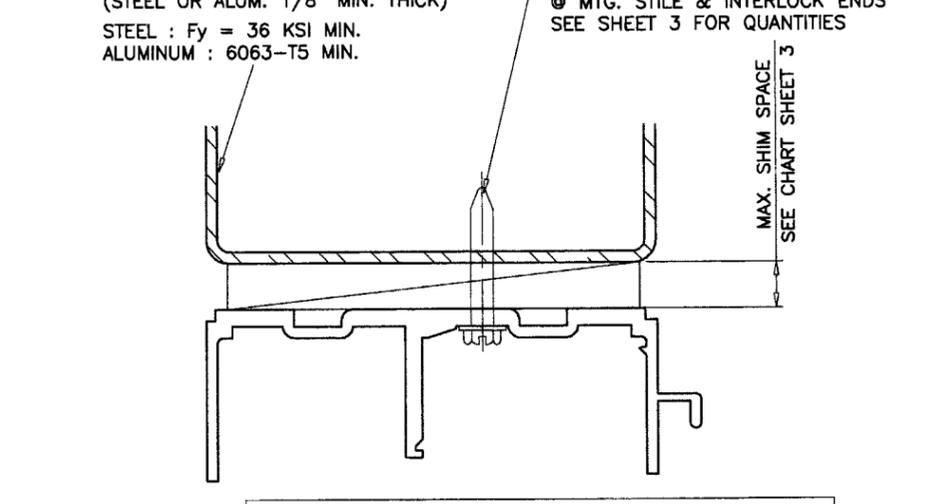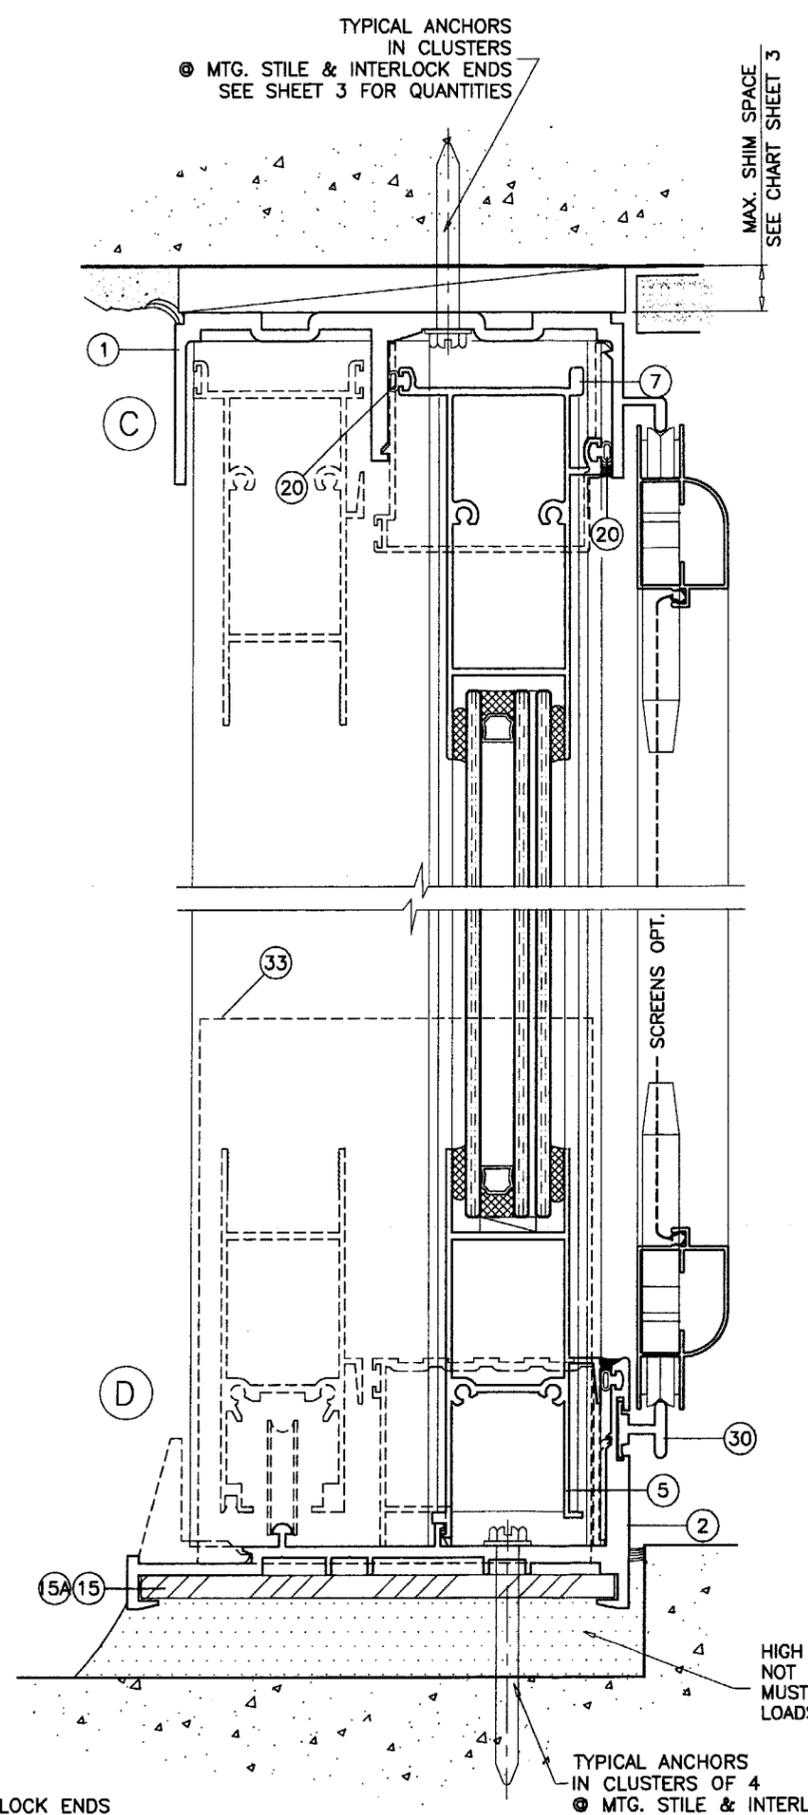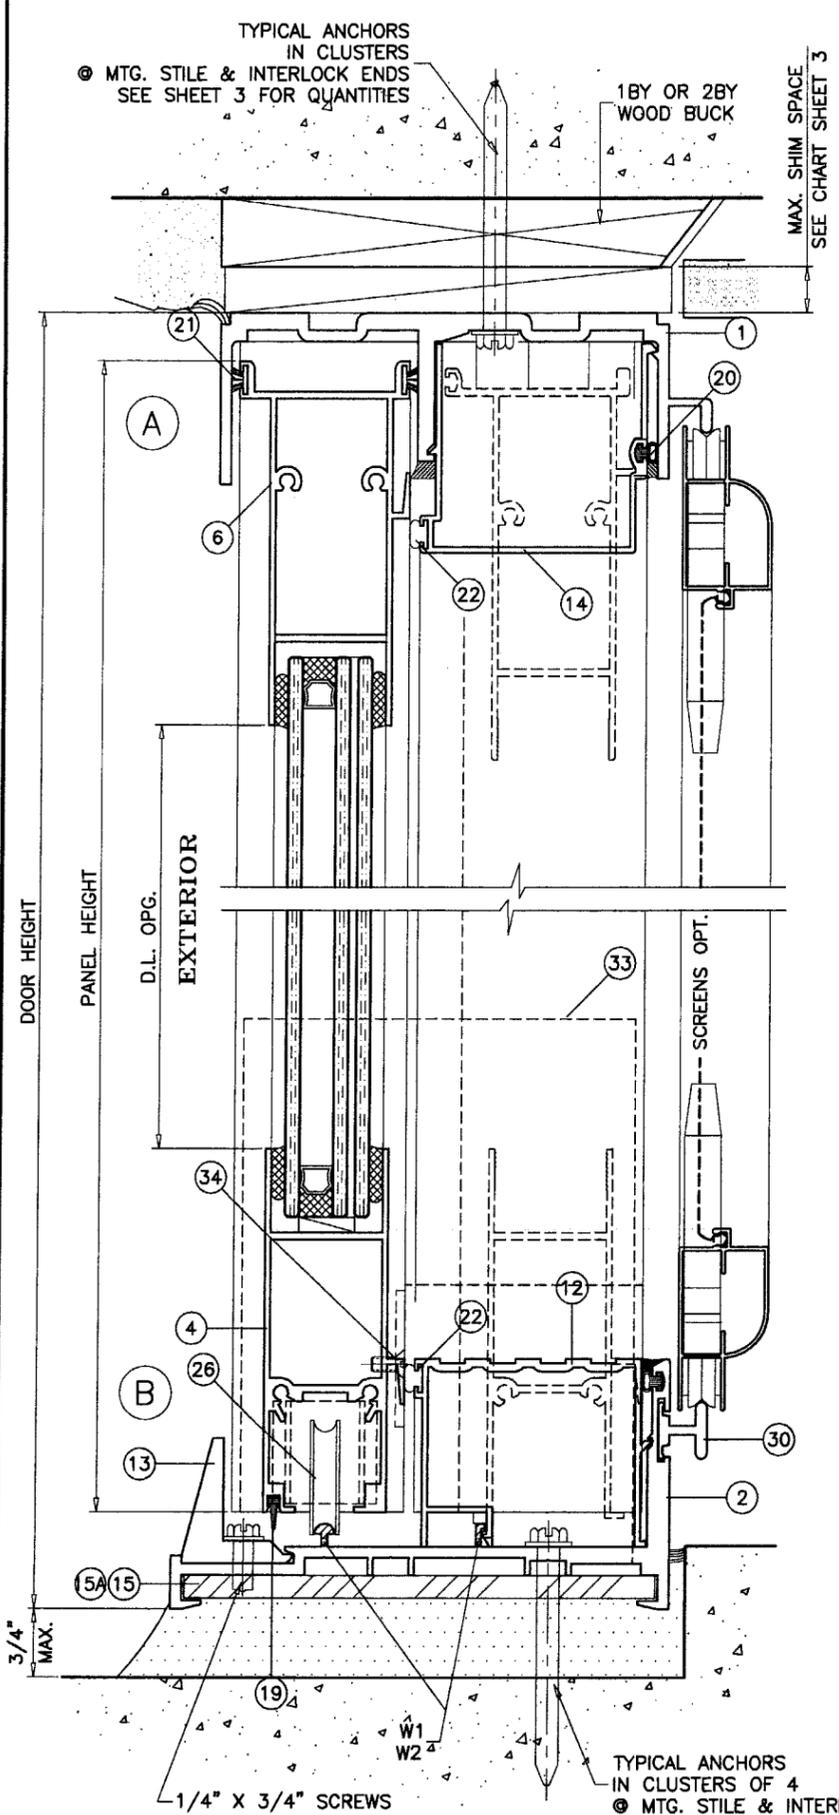

METAL STRUCTURES  
 (STEEL OR ALUM. 1/8" MIN. THICK)  
 STEEL : Fy = 36 KSI MIN.  
 ALUMINUM : 6063-T5 MIN.

TYPICAL ANCHORS IN CLUSTERS  
 Ⓞ MTG. STILE & INTERLOCK ENDS  
 SEE SHEET 3 FOR QUANTITIES

WOOD BUCKS NOT BY RC ALUMINUM, MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE 'A' 1/4" DIA. HILTI KWIK-CON II  
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES  
 1-1/2" MIN. WOOD PENETRATION  
 THRU 1BY WOOD BUCKS INTO MASONRY OR CONC.  
 1-1/4" MIN. EMBED INTO MASONRY OR CONC.

TYPE 'B' 1/4" DIA. HILTI KWIK-CON II  
 DIRECTLY INTO MASONRY OR CONCRETE  
 1-1/2" MIN. EMBED INTO CONCRETE

TYPE 'C' #14" TEKS OR SELF DRILLING SCREWS  
 INTO METAL STRUCTURES (1/8" MIN. THICKNESS)  
 INTO APPROVED MULLIONS (NO SHIM SPACE)

TYPICAL EDGE DISTANCE  
 INTO CONCRETE AND MASONRY = 3" MIN.  
 INTO WOOD STRUCTURE = 1" MIN.  
 INTO METAL STRUCTURE = 3/4" MIN.

SEALANTS:  
 ALL FRAME AND PANEL JOINT, INSTALLATION SCREWS AND HEADS OF ANCHOR SCREWS AT SILL TO BE SEALED WITH WHITE/ALUM COLORED SEALANT.

LOCKS:  
 SURFACE MOUNT THREE PLY HOOK LOCK BY 'WORLD INDUSTRIAL PRODUCTS' AT 41-1/2" FROM BOTTOM WITH KEEPERS AT LOCK POSITION.

WEEPS:  
 W1 = 2-1/2" WEEP NOTCH AT SILL CENTER  
 W2 = 7/8" NOTCH AT EACH END

Engr. DR. HUMAYOUN FAROOQ  
 STRUCTURES  
 FLA. PE # 16557  
 C.A.N. 3538

NOV 08 2005

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 05-0815.16  
 Expiration Date 06/24/09  
 By M. Shabbir  
 Miami Back Product Control  
 Division

**AL-FAROOQ CORPORATION**  
 ENGINEERS, PLANNERS & PRODUCT DESIGN  
 1235 SW 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W04-11RC

**R.C. ALUMINUM INDUSTRIES INC.**  
 SERIES-RW240 ALUM SLIDING GLASS DOOR (L.M.I.)  
 2805 N.W. 75 TH AVE.  
 MIAMI, FL. 33122  
 TEL. (305) 592-1515 FAX. (305) 592-2184


no	date	description
A	05.04.04	REV. PER BCCO COMMENTS
B	08.05.05	ANCHOR EMBED REV.
C	11.01.05	METAL EDGE DIST. ADDED

revisions:




date: 02-19-04  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W04-11**

sheet 4 of 7

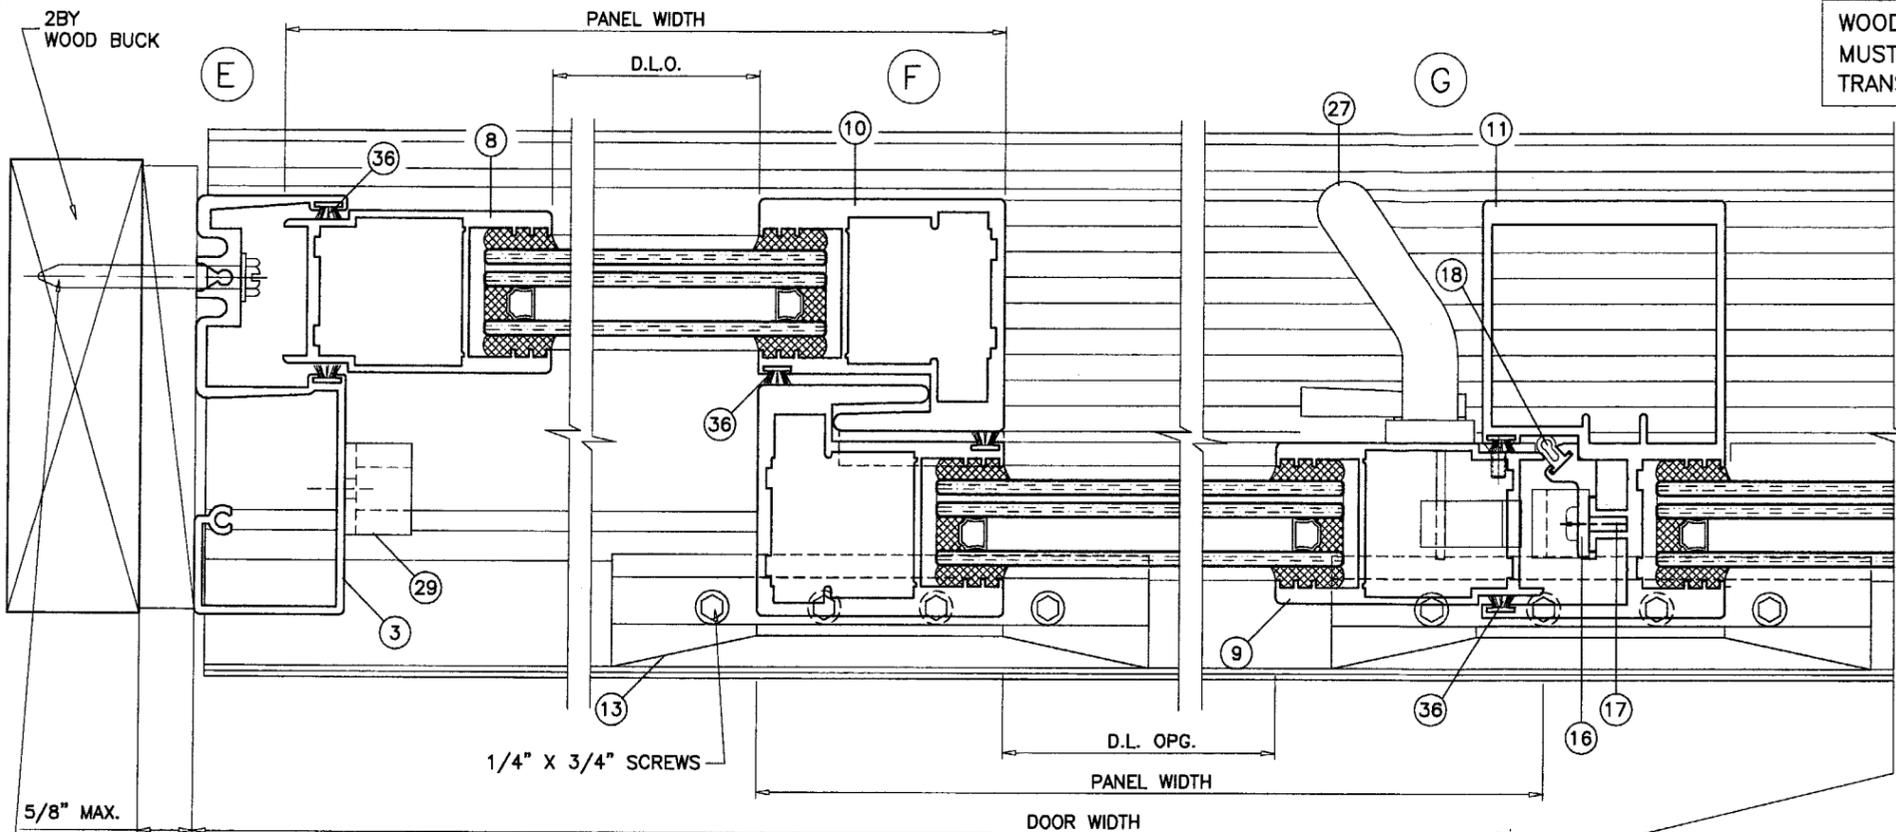

WOOD BUCKS AND METAL STRUCTURES NOT BY RC ALUMINUM MUST SUPPORT LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

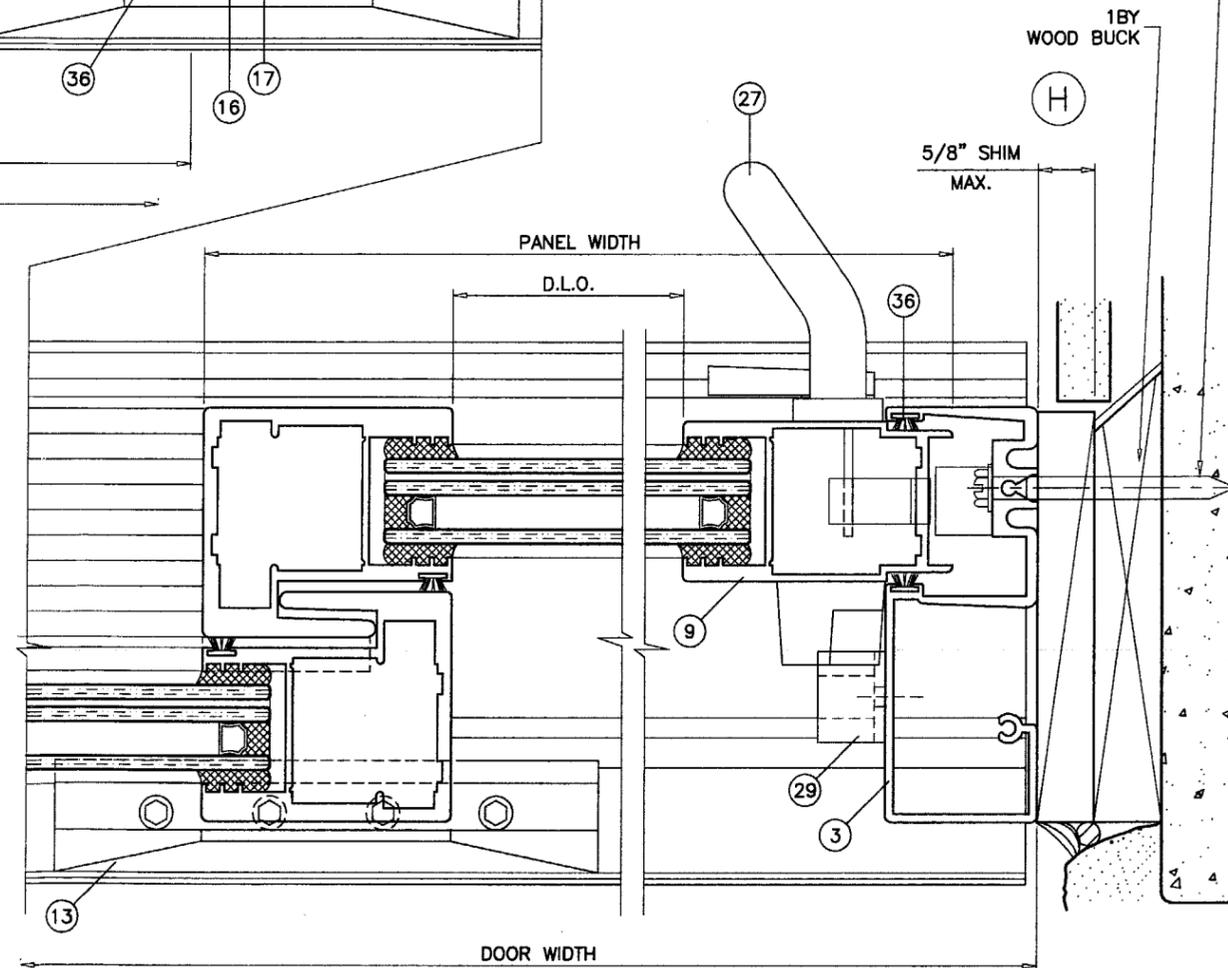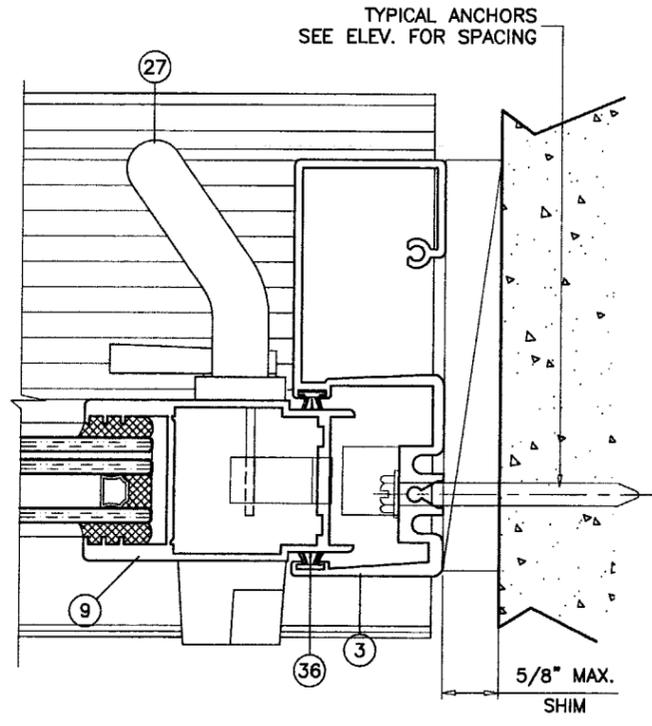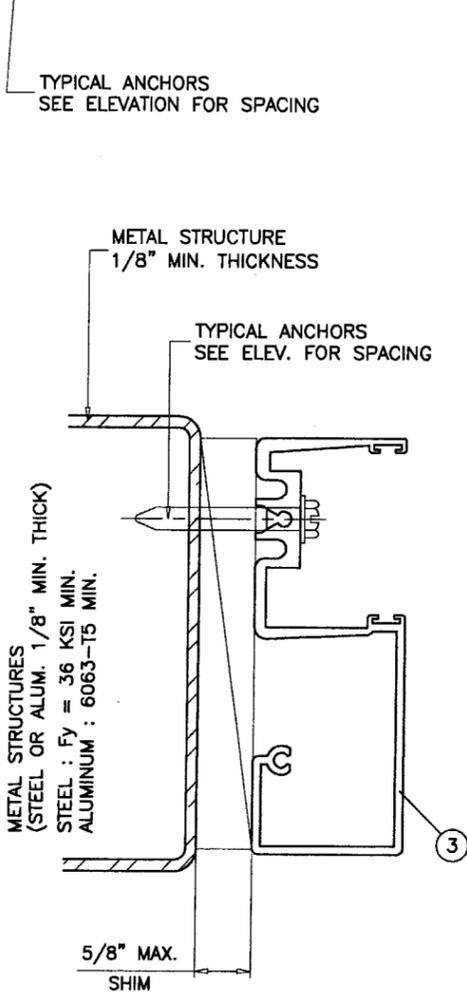

Engr. DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

08 2005

PRODUCT REVIEWED  
as complying with the Florida  
Building Code  
Acceptance No 05-0815.16  
Expiration Date 06/24/09  
By *M. H. H.*  
Miami Beach Product Control  
Division

**AL-FAROOQ CORPORATION**  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978

**R.C. ALUMINUM INDUSTRIES INC.**  
2805 N.W. 75 TH AVE.  
MIAMI, FL. 33122  
TEL. (305) 592-1515 FAX. (305) 592-2184

SERIES-RW240 ALUM SLIDING GLASS DOOR (L.M.I.)

















revisions:	no	date	by	description
	A	05.04.04	REV. PER BCCO COMMENTS	
	B	08.05.05	NO CHANGE THIS SHEET	
	C	11.01.05	NO CHANGE THIS SHEET	

date: 02-19-04  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W04-11**  
sheet 5 of 7

*afsc*

COMP-ANL W04-11RC

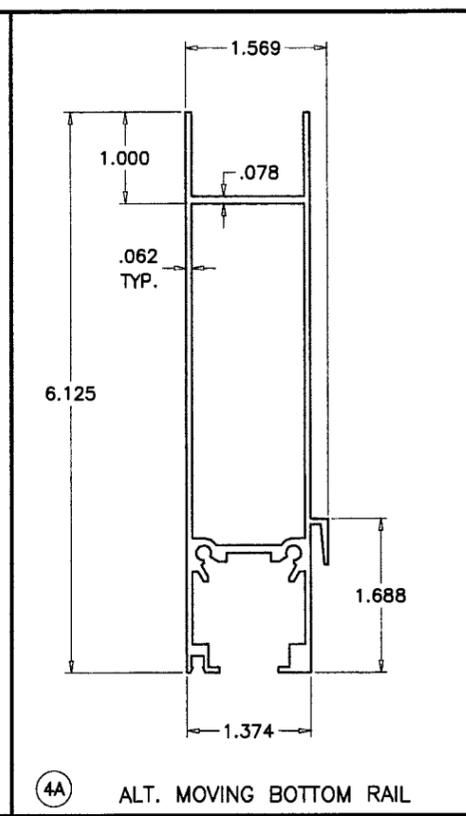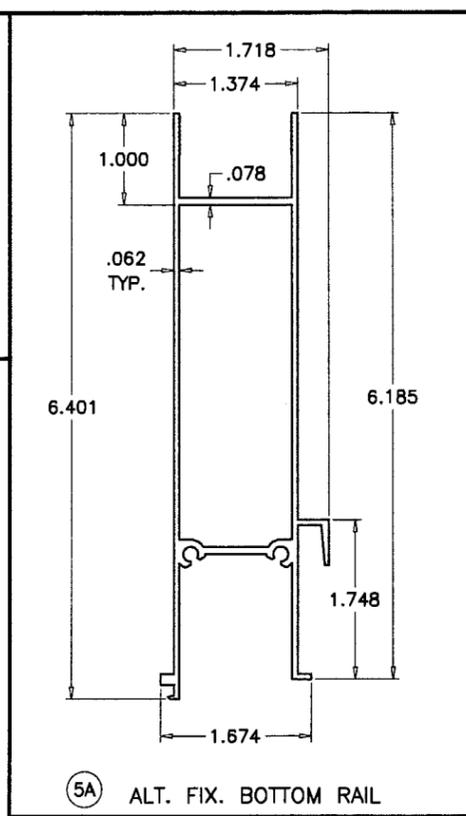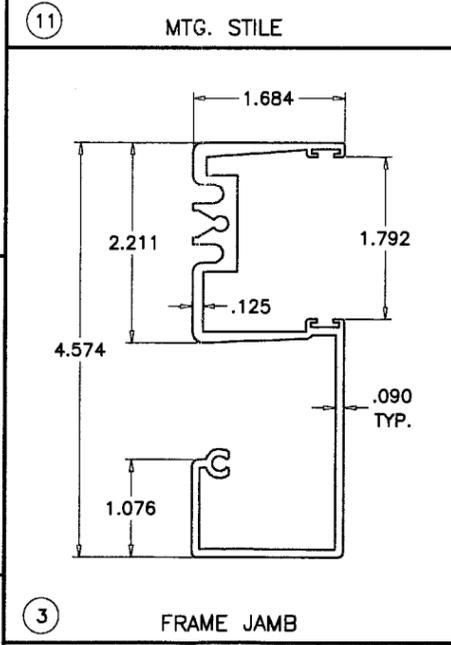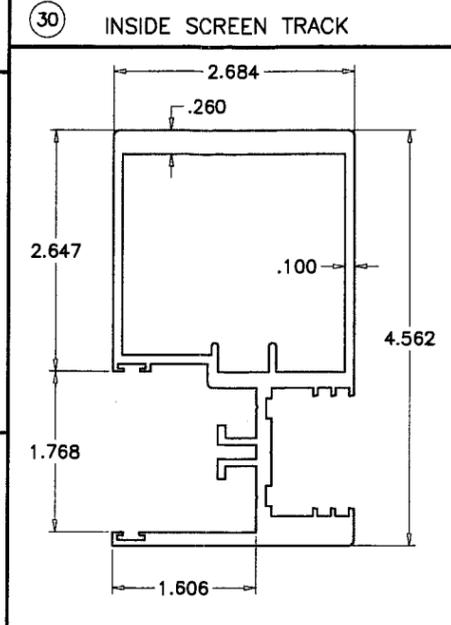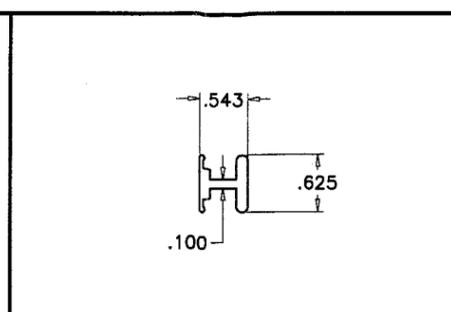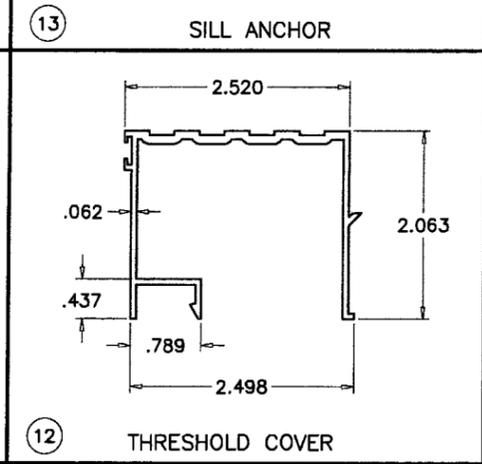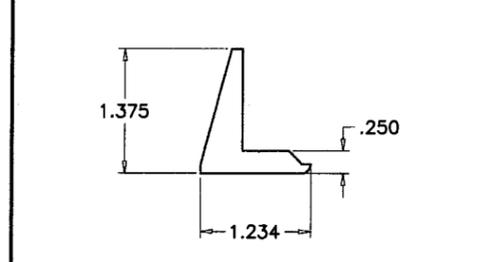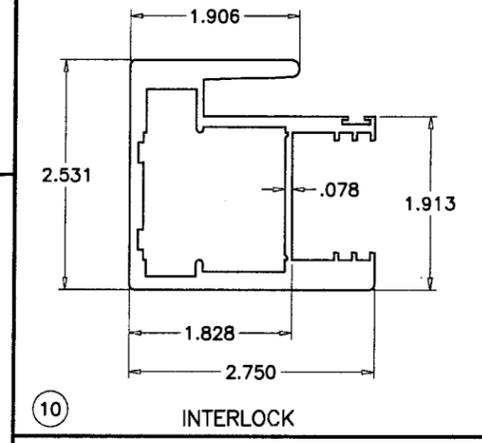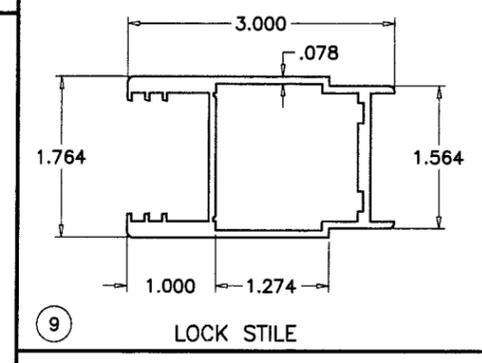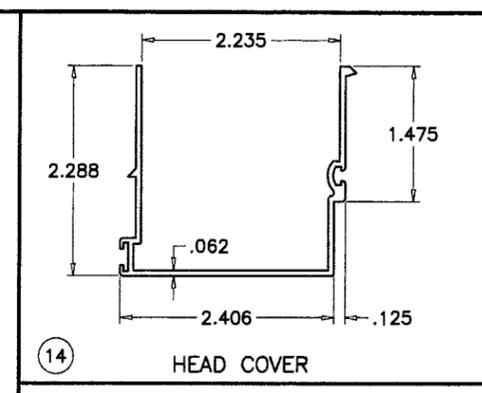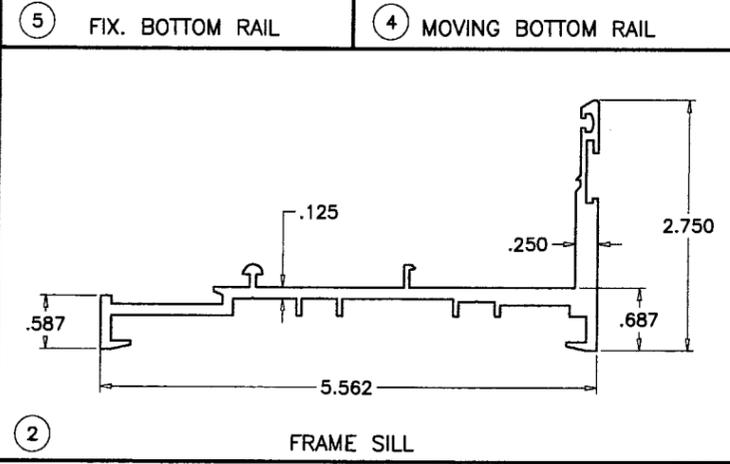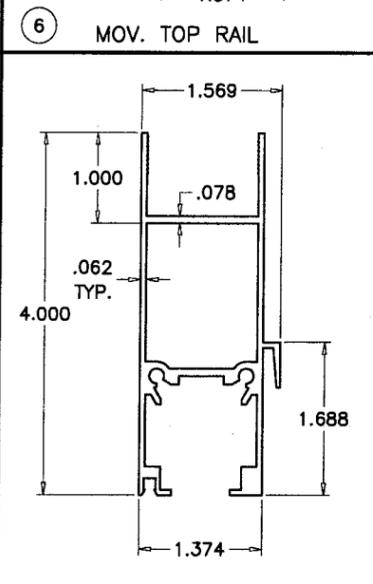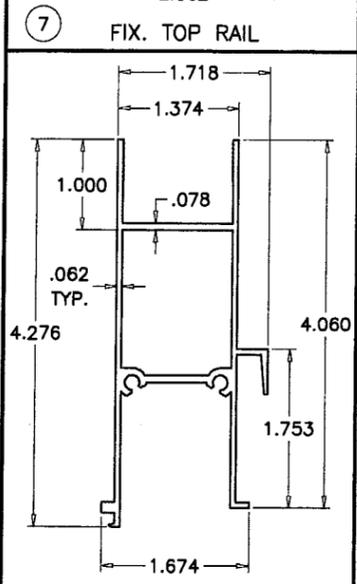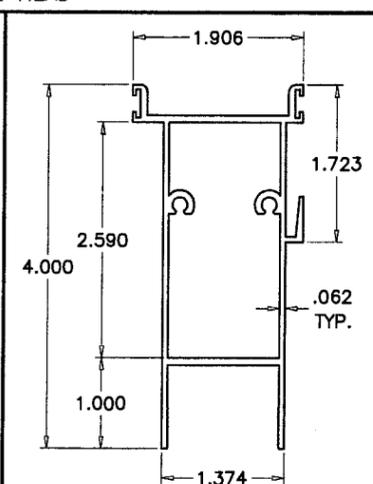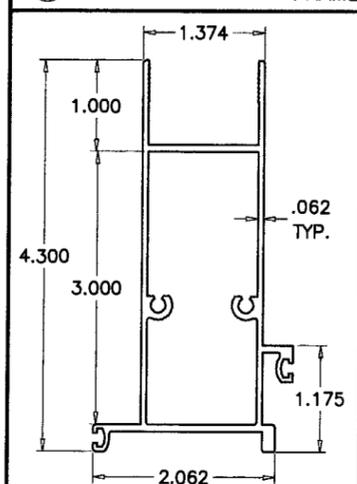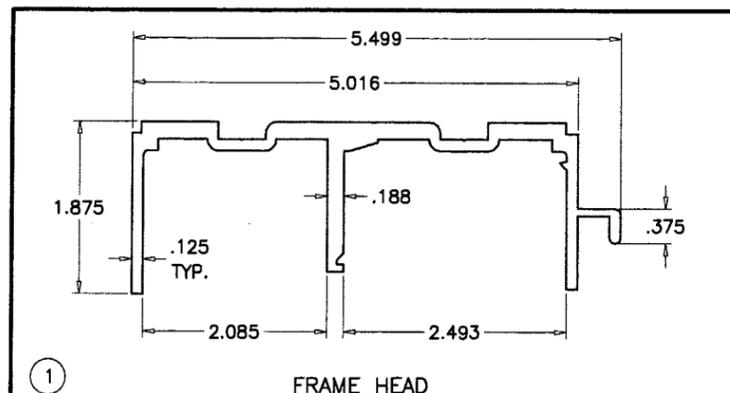

Engr: DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

NOV 08 2005

**PRODUCT REVISED**  
to comply with the Florida  
Building Code  
Acceptance No. 05-0815-16  
Expiration Date 06/24/09  
Missi Dade Product Control  
Division

**afsc**

**AL-FAROOQ CORPORATION**  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978

**SERIES-RW240 ALUM SLIDING GLASS DOOR (L.M.I.)**

**R.C. ALUMINUM INDUSTRIES INC.**  
2805 N.W. 75 TH AVE.  
MIAMI, FL. 33122  
TEL. (305) 592-1515 FAX. (305) 592-2184


no	date	description
A	05.04.04	REV. PER BCCO COMMENTS
B	08.05.05	ALT. BOTTOM RAILS ADDED
C	11.01.05	NO CHANGE THIS SHEET

revisions:


date: 02-19-04  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W04-11**


sheet 6 of 7

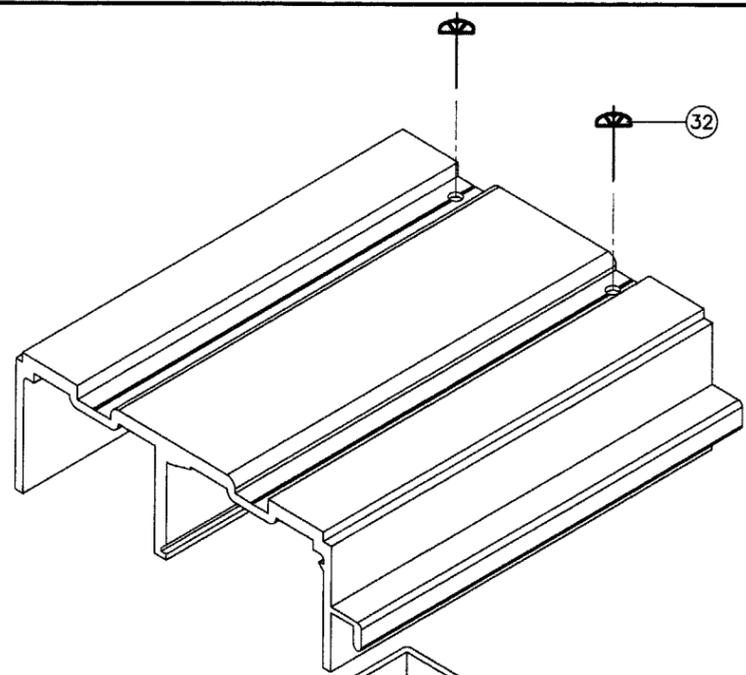


FRAME TOP CORNER

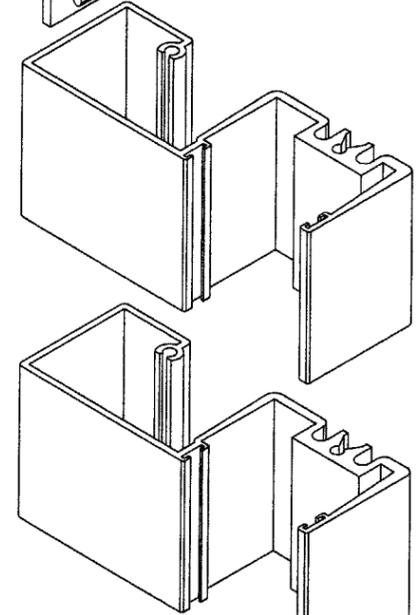

FRAME BOTTOM CORNER

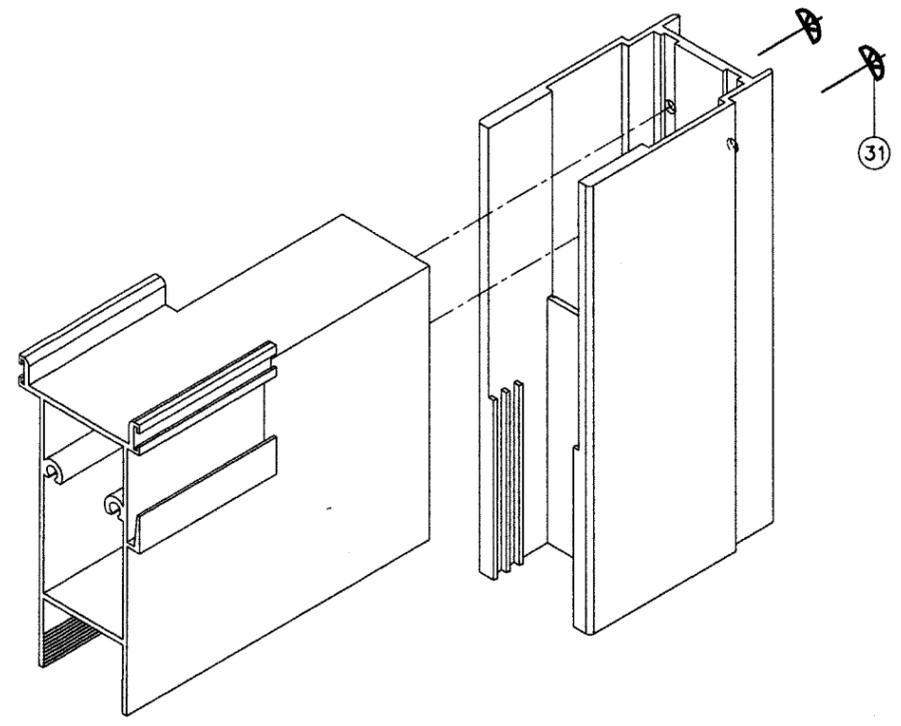

PANEL TOP CORNER

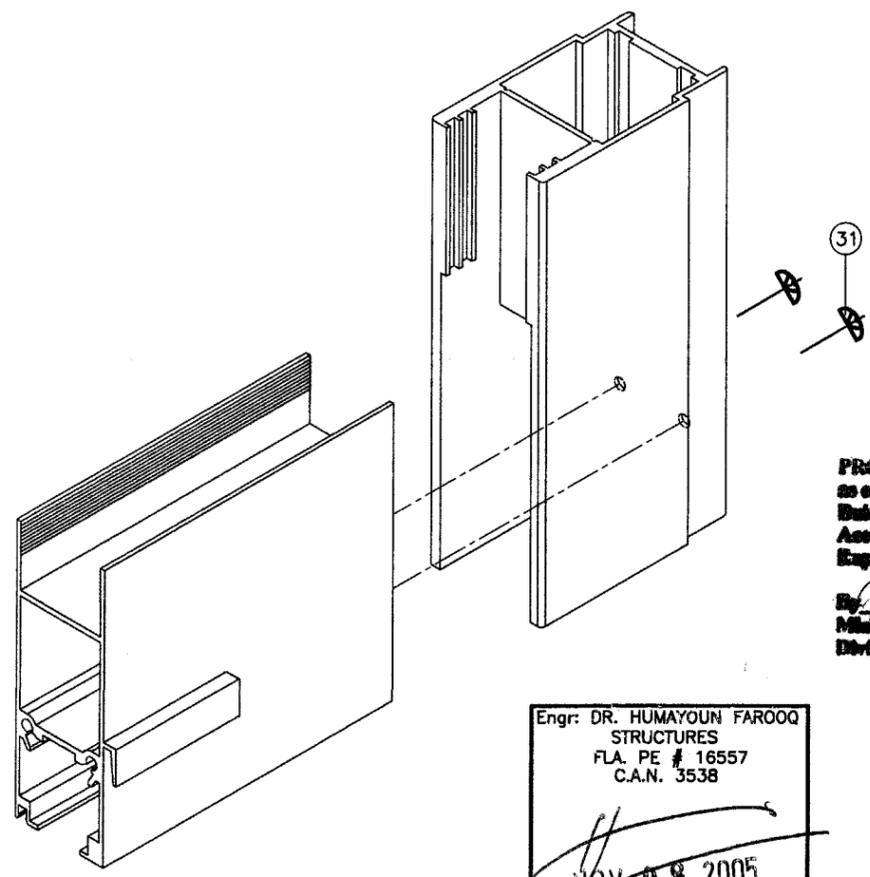

PANEL BOTTOM CORNER

Engr: DR. HUMAYOON FAROOQ  
STRUCTURES  
FLA. PE # 16557  
C.A.N. 3538

*[Signature]*  
NOV 08 2005

**PRODUCT REVISED**  
to comply with the Florida  
Building Code  
Acceptance No. 05-0815/16  
Expiration Date 06/24/09  
By: *[Signature]*  
Miami State Product Control  
Division

**AL-FAROOQ CORPORATION**  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978

**R.C. ALUMINUM INDUSTRIES INC.**  
2805 N.W. 75 TH AVE.  
MIAMI, FL. 33122  
TEL. (305) 592-1515 FAX. (305) 592-2184

revisions:

no.	date	by	description
A	05.04.04		NO CHANGE THIS SHEET
B	08.05.05		NO CHANGE THIS SHEET
C	11.01.05		NO CHANGE THIS SHEET

date: 02-19-04  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W04-11**  
sheet 7 of 7

*afc*

COMP-ANL\W04-11TRC