



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

www.buildingcodeonline.com

R.C. Aluminum
2805 NW 75th Avenue
Miami, FL 33122

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "HP3060/3070" Aluminum Projected Window - L.M.I.

APPROVAL DOCUMENT: Drawing No. **W04-99**, titled "HP3060 Alum. Projected Window (L.M.I.)", sheets 1 through 7 of 7, prepared by AL- Farooq Corporation, dated 11/26/04 with revision "C" on 12/02/05, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # **05-0120.04** and, consists of this page 1 and evidence page E-1, and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Herminio F. Gonzalez, P.E., Director, BCCO**



NOA No 05-0817.12
Expiration Date: March 31, 2010
Approval Date: February 09, 2006
Page 1

R.C. Aluminum

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturers die drawings and sections.
2. Drawing No. **W04-99**, titled "HP3060 Alum. Projected Window (L.M.I.)", sheets 1 through 7 of 7, prepared by AL- Farooq Corporation, dated 11/26/04 with revision "C" on 12/02/05, signed and sealed by Humayoun Farooq, P.E.

B. TESTS

1. Test reports on 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of aluminum projected window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4309**, dated 09/28/04, signed and sealed by Edumundo Largaespada, P.E.
"Submitted under NOA# 05-0120.04"
2. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, Per FBC 2411.3.2.1 (b) TAS202-94
5) Large Missile Impact Test per FBC, TAS 201-94
6) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of aluminum window wall system with projected window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-3945**, dated 10/20/03, signed and sealed by Edmundo Largaespada, P.E.
"Submitted under NOA# 05-0120.04"
3. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, Per FBC 2411.3.2.1 (b) TAS202-94
5) Large Missile Impact Test per FBC, TAS 201-94
6) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of aluminum window wall system with projected, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4313**, dated 09/28/04, signed and sealed by Edmundo Largaespada, P.E.
"Submitted under NOA# 05-0120.04"



Herminio F. Gonzalez, P.E.
Director, Building Code Compliance Office
NOA No 05-0817.12
Expiration Date: March 31, 2010
Approval Date: February 09, 2006

R.C. Aluminum

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. Revised Anchor Calculations and structural analysis, prepared by AL-Farooq Corporation, dated 11/08/05, signed and sealed by Humayoun Farooq, P.E.
Complies with ASTM E1300-02

D. QUALITY ASSURANCE

1. Miami Dade Building Code Compliance Office (BCCO).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. 01-1204.01 issued to "E.I. DuPont DeNemours" for "Sentry Glass R Plus" dated 01/17/02, expiring on 1/14/07.

F. STATEMENTS

1. Statement letter of conformance and no financial interest, dated November 23, 2004, signed and sealed by Humayoun Farooq, P.E.


G. OTHER

1. Letter from the consultant, dated 11/14/05, stating that the product is in compliance with the Florida Building Code (FBC).
2. Notice of Acceptance No. **05-0120.04**, issued to R.C. Aluminum Industries, Inc., "Series -HP 3060 Aluminum Window Wall with Projected Window", approved on 03/31/05 and expiring on 03/31/10.

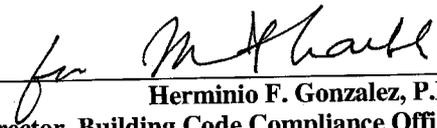


Herminio F. Gonzalez, P.E.
Director, Building Code Compliance Office
NOA No 05-0817.12
Expiration Date: March 31, 2010
Approval Date: February 09, 2006

DESIGN LOAD CAPACITY - PSF SINGLE VENT PROJECTED WINDOW			
VENT SIZES		1/2" LAM. GLASS	
WIDTH	HEIGHT	EXT. (+)	INT. (-)
24"	24"	120.0	120.0
30"		120.0	120.0
36"		120.0	120.0
42"		120.0	120.0
48"		87.5	87.5
54"		60.1	60.1
60"	43.1	43.1	
24"	30"	120.0	120.0
30"		120.0	120.0
36"		120.0	120.0
42"		117.2	117.2
48"		74.4	74.4
54"		35.6	39.1
60"	25.3	27.8	
24"	36"	120.0	120.0
30"		120.0	120.0
36"		120.0	120.0
42"		108.4	108.4
48"		47.3	52.0
54"		31.5	34.6
60"	22.1	24.3	
24"	42"	100.0	110.0
30"		100.0	110.0
36"		100.0	110.0
42"		74.3	81.8
48"		44.5	49.0
54"		29.0	31.9
60"	20.1	22.1	
24"	48"	100.0	110.0
30"		100.0	110.0
36"		100.0	110.0
42"		74.3	81.8
48"		43.6	47.9
54"		27.7	30.5
60"	18.8	20.7	
24"	54"	100.0	110.0
30"		100.0	110.0
36"		100.0	110.0
42"		74.3	81.8
48"		43.6	47.9
54"		27.2	29.9
24"	60"	100.0	110.0
30"		100.0	110.0
36"		100.0	110.0
42"		74.3	81.8
48"		43.6	47.9
54"		27.2	29.9
24"	66"	100.0	110.0
30"		100.0	110.0
36"		100.0	110.0
42"		74.3	81.8
48"		43.6	47.9
54"		27.2	29.9
24"	72"	100.0	110.0
30"		100.0	110.0
36"		100.0	110.0
42"		74.3	81.8
48"		43.6	47.9
54"		27.2	29.9
24"	78"	100.0	110.0
30"		100.0	110.0
36"		100.0	110.0
42"		74.3	81.8
48"		43.6	47.9
54"		27.2	29.9

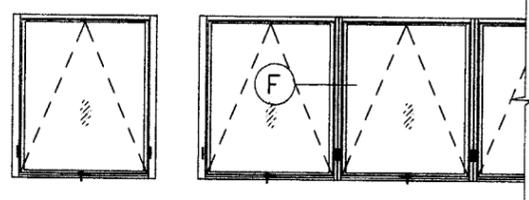

APPROVED CONFIGURATIONS

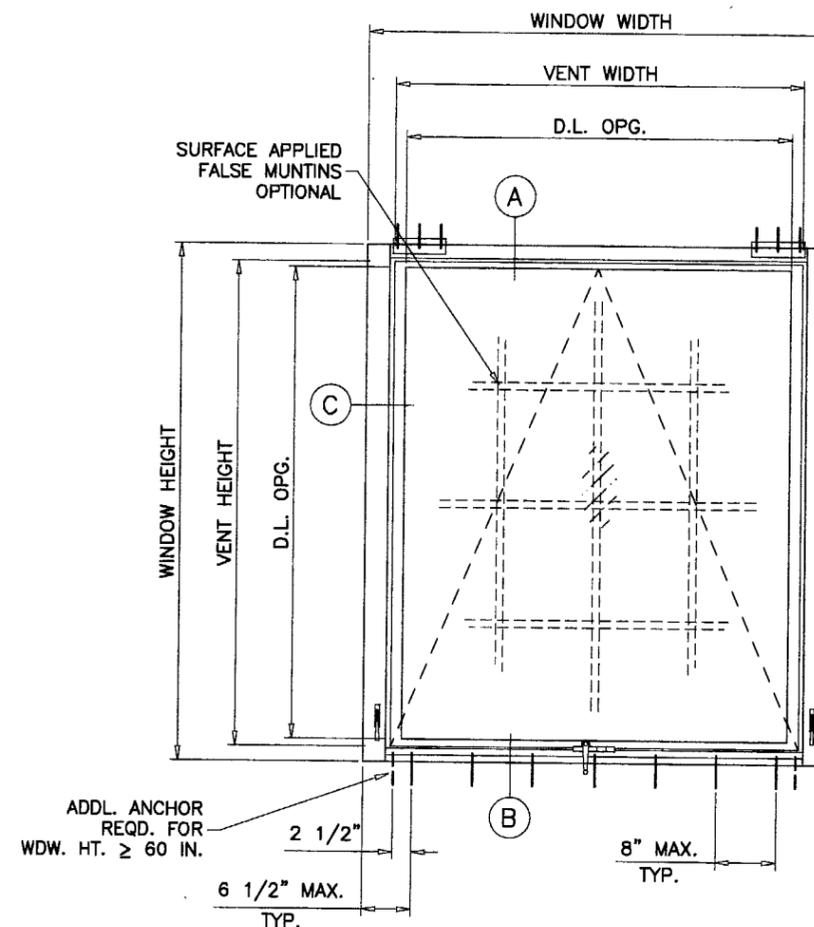


'X' SIZES

VENT WIDTH = WINDOW WIDTH - 7 1/4"
 GLASS D.L.O. WIDTH = VENT WIDTH - 3"
 VENT HEIGHT = WINDOW HEIGHT - 4 1/4"
 GLASS D.L.O. HEIGHT = VENT HEIGHT - 1 3/4"

TYPICAL ELEVATION

(SEE CHART FOR MAX. APPROVED SIZES)
 SEE SHEET 2 FOR SPECIAL CONFIGURATIONS

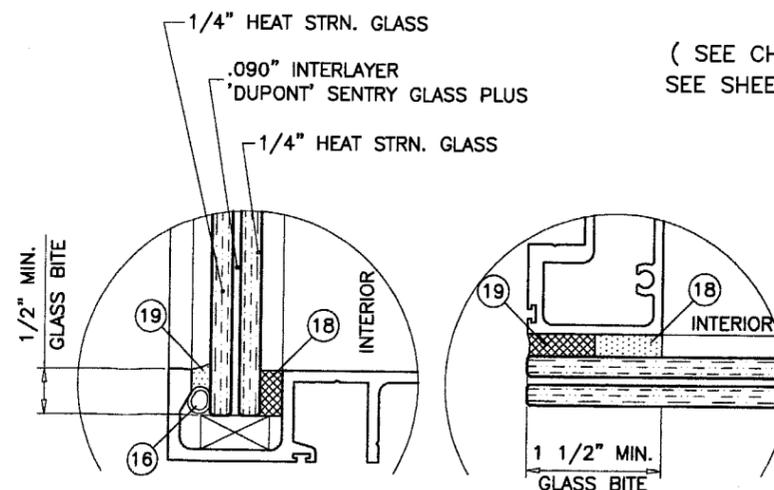

GLAZING DETAIL

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 05-0817.12
 Expiration Date 03/31/10
 By: *M. Khan*
 Miami Dade Product Control
 Division

LAMINATED GLASS
 LARGE MISSILE IMPACT

Engr: DR. HUMAYOUM FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

DEC 06 2005

HP3060/3070 ALUMINUM PROJECTED WINDOW

APPROVAL APPLIES TO:
 SINGLE VENT PROJECTED WINDOWS OF X CONFIGURATION.
 PROJECTED/FIXED COMBINATIONS OF X/O, O/X OR O/X/O ETC.
 ALSO SIDE BY SIDE COMBINATIONS OF TWO OR MORE WINDOWS.

WINDOWS GLAZED WITH LAMINATED GLASS RATED FOR
 LARGE MISSILE IMPACT AND REQUIRE NO SHUTTERS.

CODE REQUIREMENTS FOR SAFE GUARDS MUST BE OBSERVED.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
 REQUIREMENTS OF THE FLORIDA BUILDING CODE 2004 EDITION INCLUDING
 HIGH VELOCITY HURRICANE ZONE.

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER
 LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS.
 ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL
 DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS
 ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF
 WOOD ANCHORS ONLY.

ALUMINUM IN CONTACT WITH DISSIMILAR MATERIALS SHALL MEET THE
 REQUIREMENTS OF 2004 FLORIDA BUILDING CODE SECTION 2003.8.4.

AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978

R.C. ALUMINUM INDUSTRIES INC.
 2805 N.W. 75 TH AVE.
 MIAMI, FL. 33122
 TEL. (305) 592-1515 FAX. (305) 592-2184

HP3060/3070 ALUM. PROJECTED WINDOW (L.M.I.)


no	date	by	description
A	05.10.05		NOTES REV.
B	11.02.05		NOTE REV.
C	12.02.05		REV. PER BCCO COMMENTS

revisions:

date: 11-28-04
 scale: 1/2"=1'-0"
 dr. by: HAMID
 chk. by:


drawing no.
W04-99

sheet 1 of 7

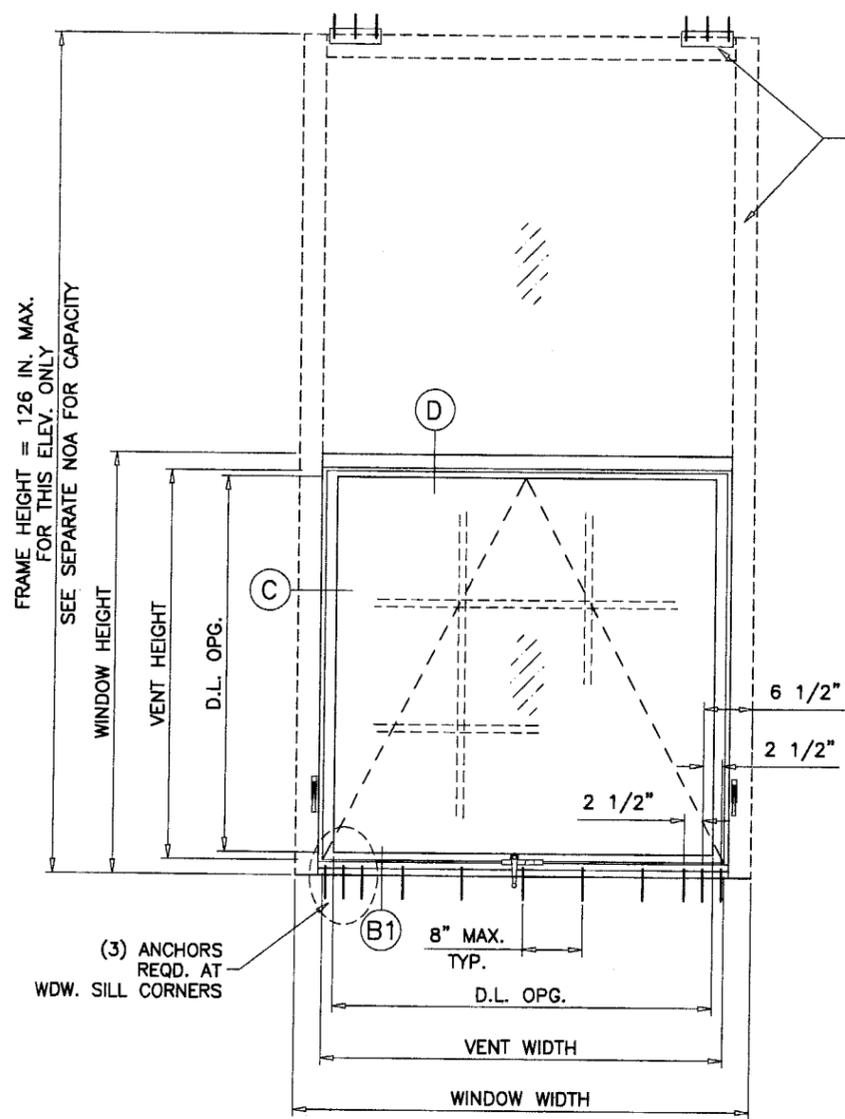


Q/X

SEE SEPARATE NOA FOR STOREFRONT CAPACITY AND DETAILS

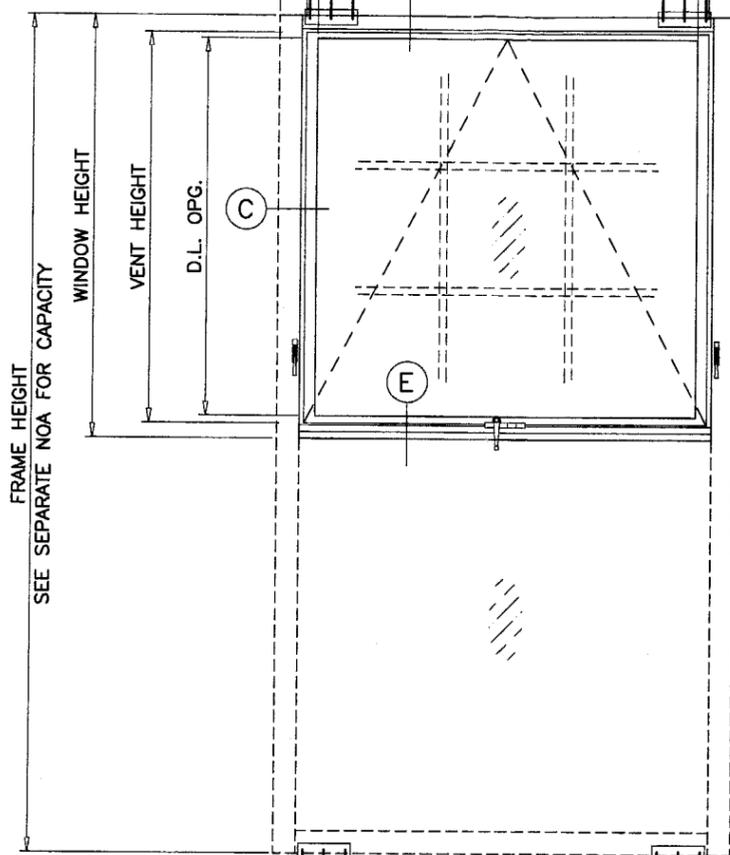


SEE SEPARATE NOA FOR CAPACITY

X/O

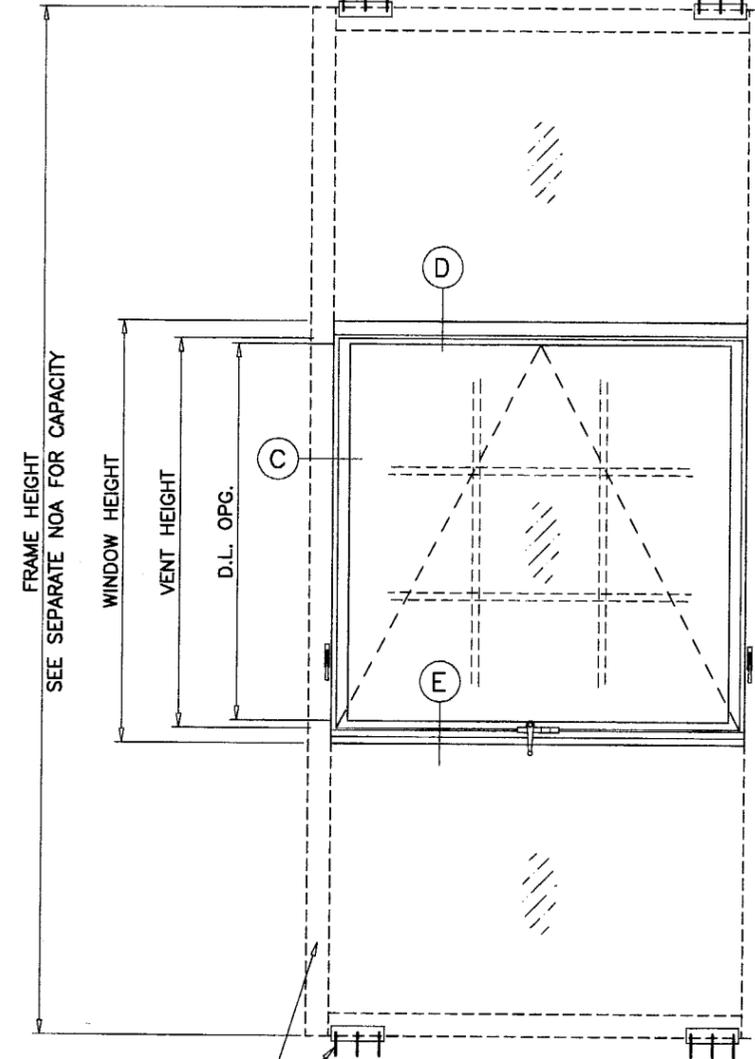

SEE SEPARATE NOA FOR STOREFRONT CAPACITY, ANCHORS AND DETAILS

O/X/O

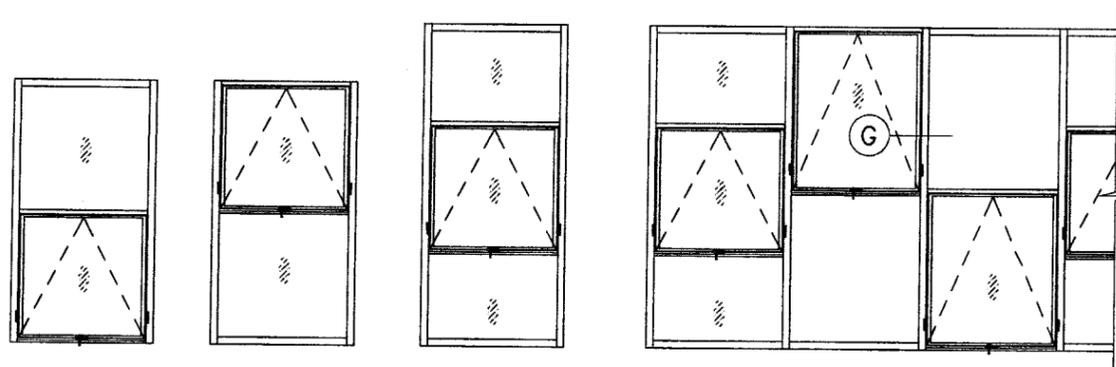

APPROVED CONFIGURATIONS

SEE SEPARATE NOA FOR HP3060 OR HP3070 WINDOW WALL SYSTEM DESIGN LOADS AND ANCHORS.

LOWER VALUES FROM PROJECTED WINDOW CAPACITY CHART OR WINDOW WALL SYSTEM NOA WILL APPLY TO ENTIRE SYSTEM.

Engr: DR. HUMAYUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 05-0817-12
Expiration Date 03/31/10
By: *M. Shail*
Minimal Trade Product Control
Division

DEC 06 2005



afc
AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
STORE/W04-99RC

HP3060/3070 ALUM. PROJECTED WINDOW (L.M.I.)
R.C. ALUMINUM INDUSTRIES INC.
2805 N.W. 75 TH AVE.
MIAMI, FL. 33122
TEL. (305) 592-1515 FAX. (305) 592-2184

no	date	description
A	05.10.05	NOTES REV.
B	11.02.05	NO CHANGE THIS SHEET
C	12.02.05	NO CHANGE THIS SHEET

date:	11-26-04
scale:	1/2"=1'-0"
dr. by:	HAMID
chk. by:	

drawing no.	W04-99
sheet	2 of 7

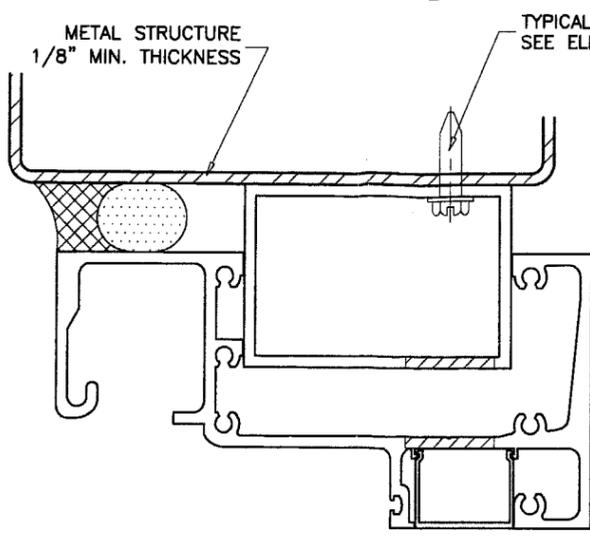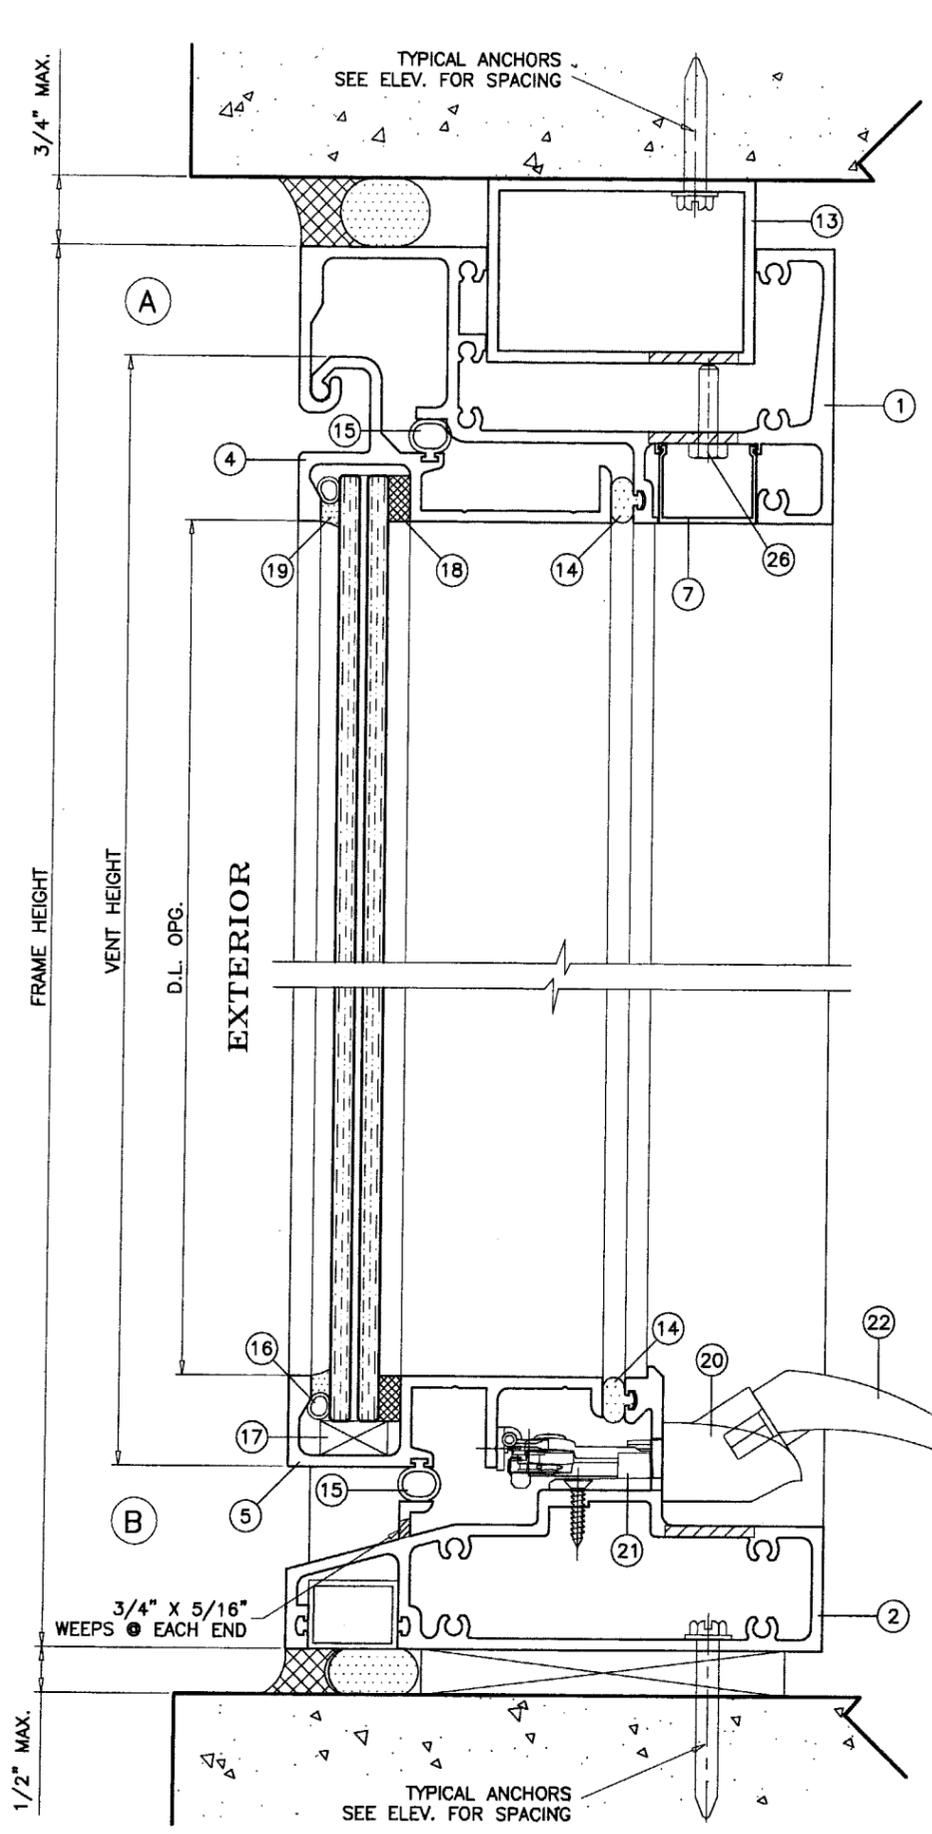


WOOD BUCKS AND METAL STRUCTURES NOT BY RC ALUMINUM MUST SUPPORT LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

- A) 1/4" HILTI KWIK CON II
DIRECTLY INTO CONC.
WITH 1-1/4" MIN. EMBED INTO CONC.
- B) 1/4-20 KWIK-FLEX SELF DRILLING SCREWS BY 'HILTI'
INTO METAL STRUCTURES
(STEEL OR ALUMINUM 1/8" MIN. THICK.)
STEEL : Fy = 36 KSI MIN.
ALUMINUM : 6063-T5 MIN.

TYPICAL EDGE DISTANCE
INTO CONCRETE AND MASONRY = 3" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

SEALANTS:
ALL FRAME CORNERS AND MULLION SEAMS SEALED WITH SILICONE.

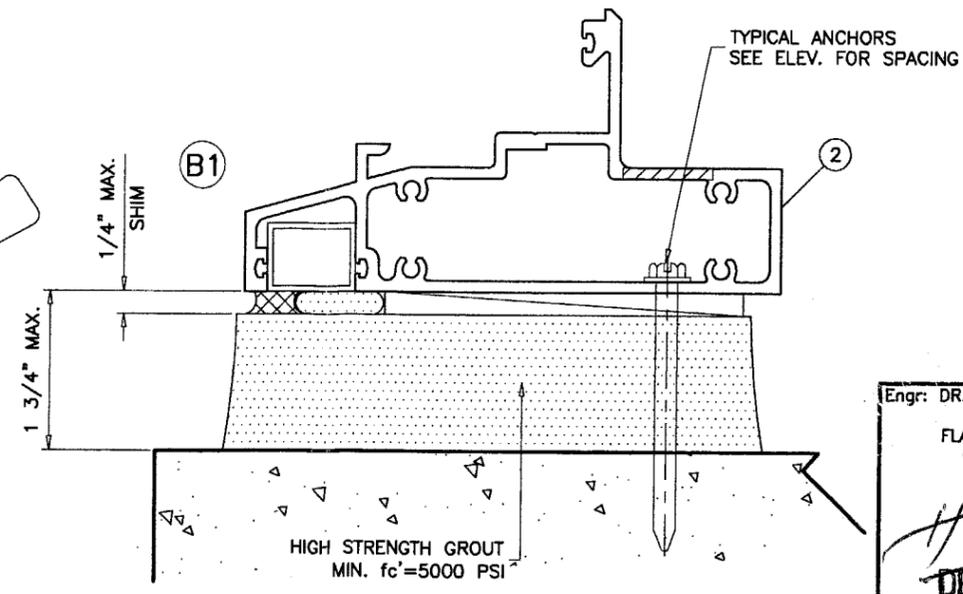

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No. 05-0817-12
Expiration Date 03/31/10
By *M. Khan*
Miami Dade Product Control Division

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557
C.A.N. 3538

DEC 06 2005

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978


HP3060/3070 ALUM. PROJECTED WINDOW (L.M.I.)
R.C. ALUMINUM INDUSTRIES INC.
2805 N.W. 75 TH AVE.
MIAMI, FL. 33122
TEL. (305) 592-1515 FAX. (305) 592-2184

no	date	description
A	05.10.05	SHIMS REV.
B	11.02.05	METAL EDGE DIST. ADDED
C	12.02.05	NO CHANGE THIS SHEET

date: 11-26-04
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W04-99
sheet 3 of 7

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	HP3060-049	1	FRAME HEAD	6063-T6	-
2	HP3060-050	1	FRAME SILL/ INTERMEDIATE SILL	6063-T6	-
3	HP3060-036	2	WINDOW JAMB/STOREFRONT JAMB	6063-T6	-
4	HP3060-053	1	VENT HEAD	6063-T6	-
5	HP3060-054	1	VENT SILL	6063-T6	-
6	HP3060-069	2	VENT JAMB	6063-T6	-
7	HP3060-055	1	SNAP COVER HEAD	6063-T6	-
8	HP3060-056	2	VENT JAMB ADAPTER	6063-T6	-
9	HP3060-063	1	INTERMEDIATE HEAD	6063-T6	-
10	-	-	-	-	-
11	-	-	ALUM TUBE SHIM	-	3/4 X 3/4 X 1/16" X 2-1/4" LONG
12	-	-	ALUM TUBE SHIM	-	3/4 X 3/4 X 1/16" X 2-7/8" LONG
13	-	-	ALUM TUBE	-	2 X 3 X 1/8" X 7" LONG
14	V-045	AS REQD.	BULB W'STRIPPING	NEOPRENE	SPONGE
15	V-046	AS REQD.	BULB W'STRIPPING	VINYL	-
16	-	-	5/16" DIA. SPLINE	-	-
17	-	AS REQD.	SETTING BLOCKS AT 6" FROM ENDS	NEOPRENE	1/4 X 3/4 X 4" LONG
18	V2100	AS REQD.	GLAZING TAPE	FOAM	1/4 X 1/2" SINGLE FACE, NORTON
19	795	AS REQD.	GLAZING COMPOUND	SILICONE	DOW CORNING
20	OP05-7540	1	AWNING OPERATOR	-	-
21	OP05-8021	1	OPERATOR SURFACE MOUNT BRACKET	-	-
22	OP05-7800	1	CRANK HANDLE	-	-
23	LU08-7510	2	LOCKING HANDLE	-	-
24	G2-HNDPLT-02	-	LOCKING HANDLE PLATE	-	-
25	GT-555	-	GUIDE HOUSING	-	-
26	-	AS REQD.	LEVELING SCREWS	-	1/4-20 X 3/4" HH MS
27	#8 X 1-1/4"	-	F.H. SMS	ST. STEEL	-
28	#8 X 3/4"	-	F.H. SMS	ST. STEEL	-
29	#10 X 3/4"	2/ JAMB	JAMB ADAPTER SCREWS	ST. STEEL	HEX H. SMS
30	#12 X 1-1/4"	-	FRAME/VENT ASSEMBLY SCREWS	ST. STEEL	HEX H. SMS

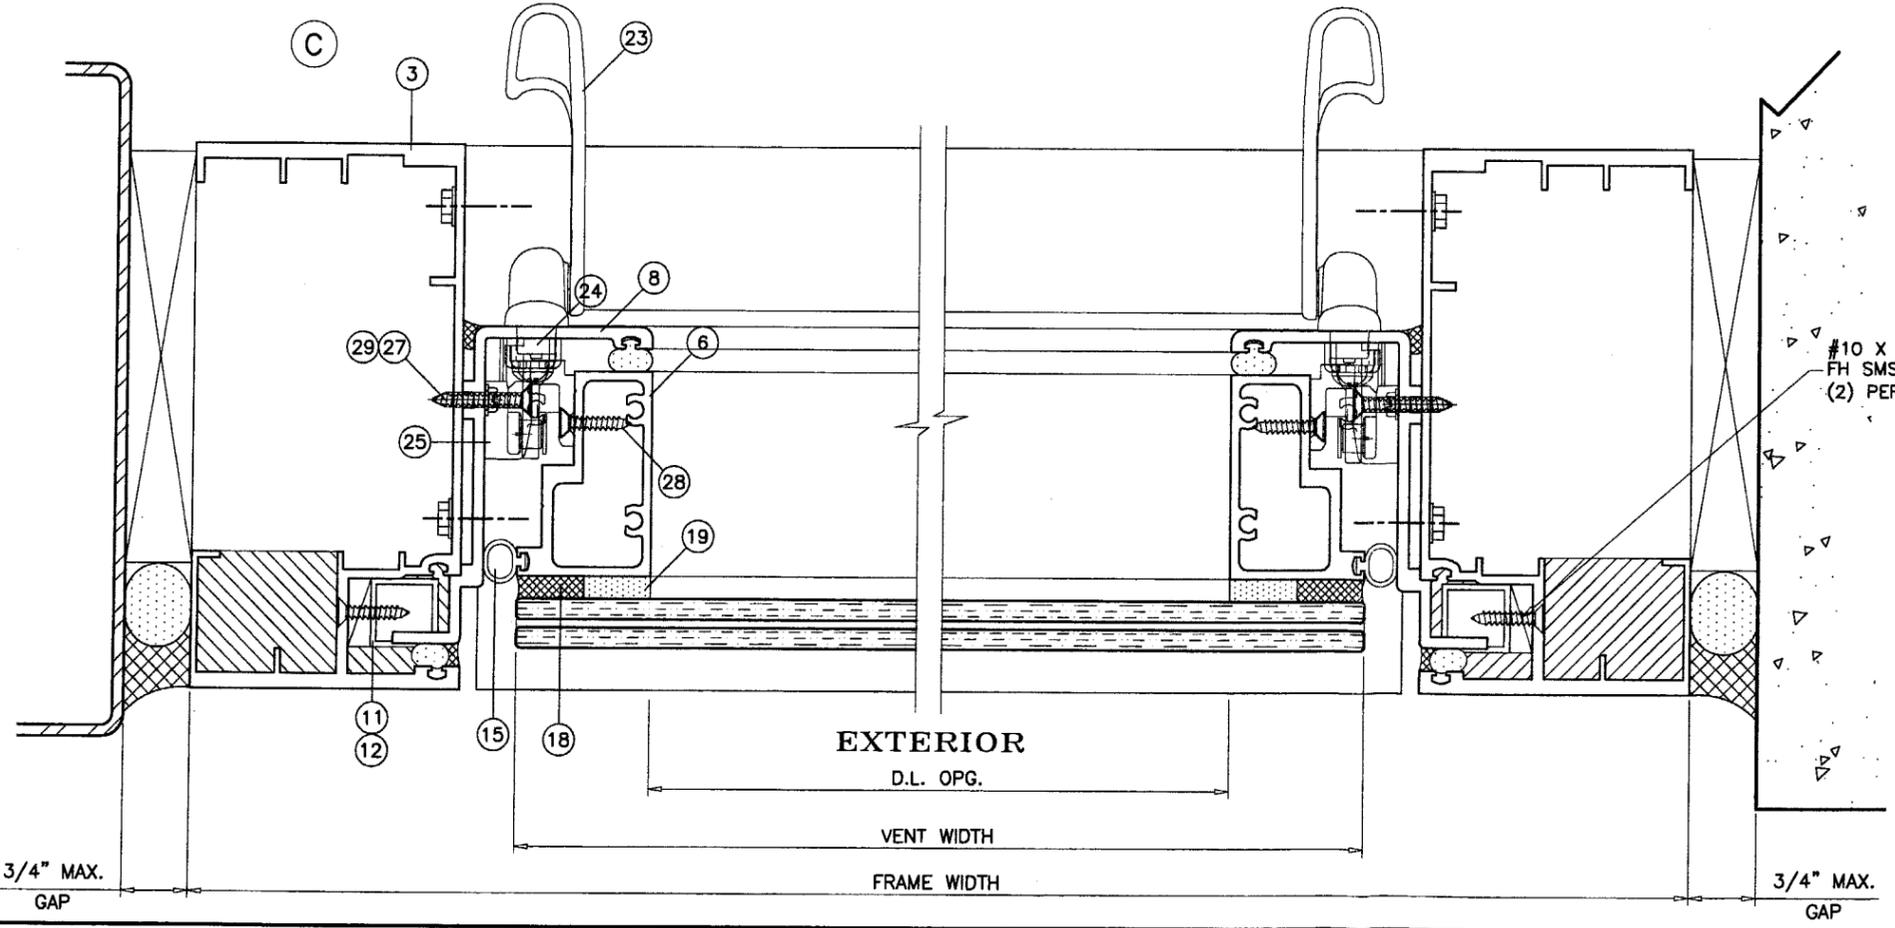

#10 X 1" FH SMS (2) PER TUBE

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No. 05-0817.12
 Expiration Date 03/31/10
 By M. Hail
 Miami Dade Product Control Division

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

DEC 06 2005

afc

AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 STORE/W04-99RC



HP3060/3070 ALUM. PROJECTED WINDOW (L.M.I.)

R.C. ALUMINUM INDUSTRIES INC.
 2805 N.W. 75 TH AVE.
 MIAMI, FL. 33122
 TEL. (305) 592-1515 FAX. (305) 592-2184

no	date	description	by
A	05.10.05	VENT JAMB REV.	
B	11.02.05	NOTE ADDED	
C	12.02.05	NO CHANGE THIS SHEET	



date: 11-26-04
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W04-99
 sheet 4 of 7

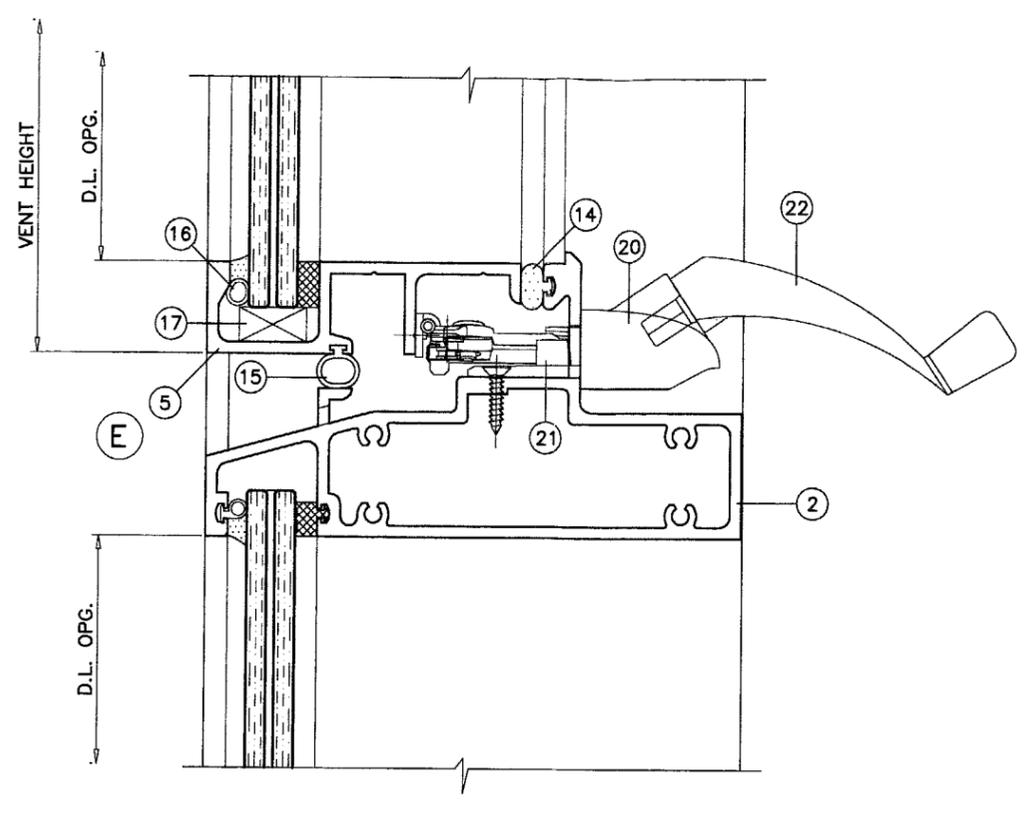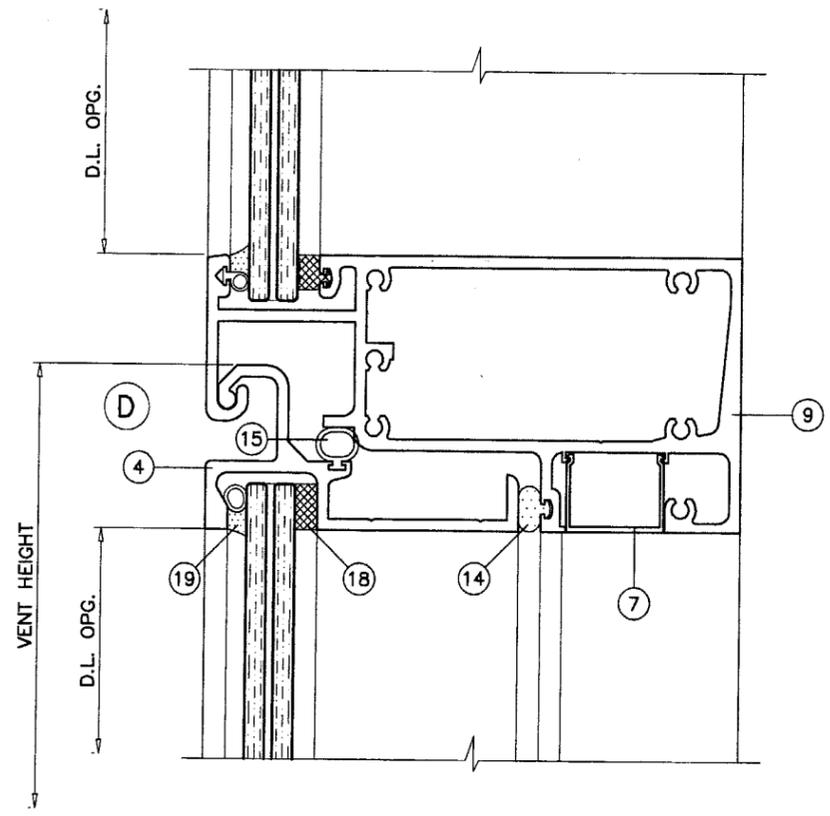

SEE SEPARATE NOA
FOR STOREFRONT
CAPACITY AND DETAILS

SEE SEPARATE NOA
FOR STOREFRONT
CAPACITY AND DETAILS

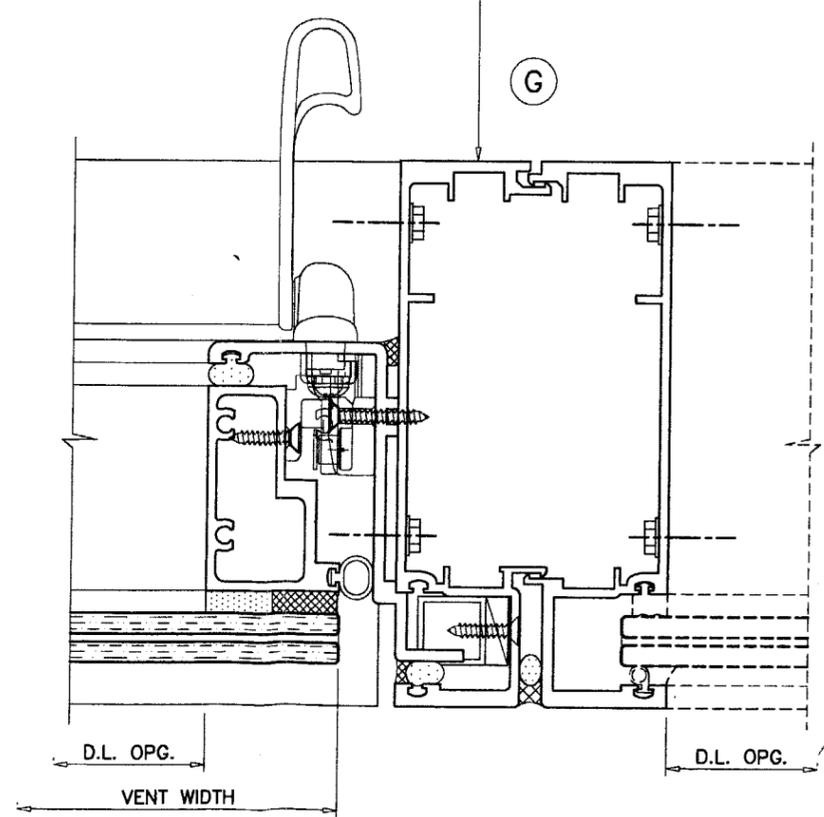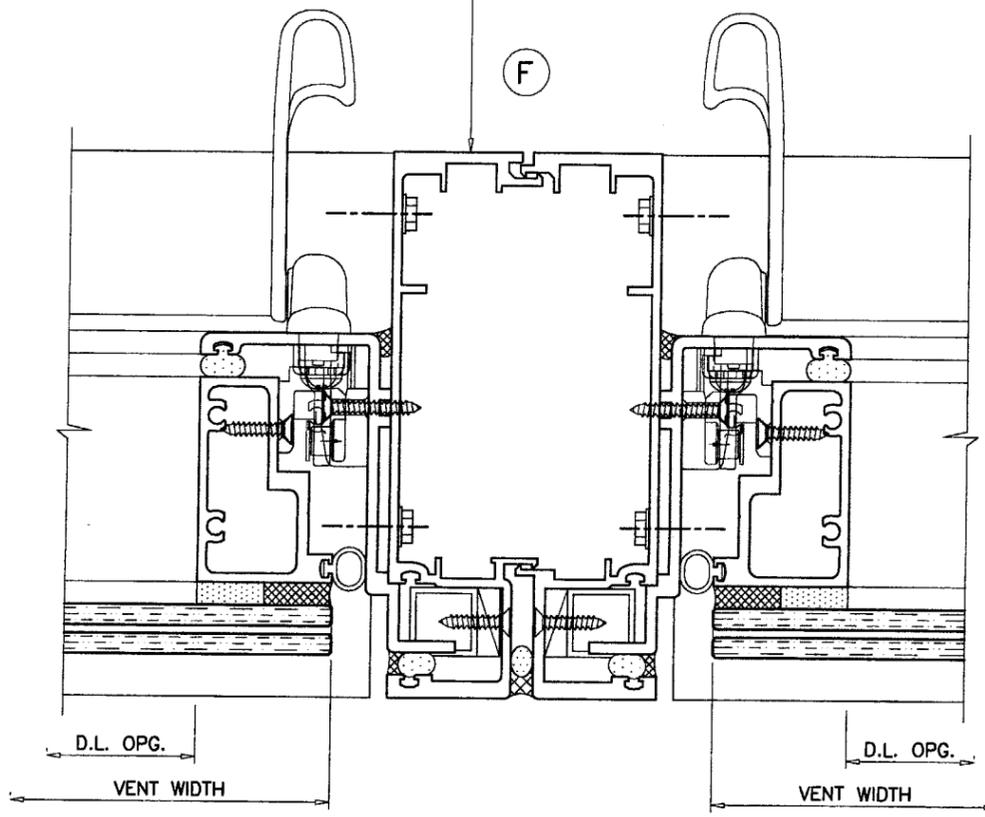

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 05-0812.12
Expiration Date 03/31/10
By *M. Khair*
Miami Dade Product Control
Division

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 18557
C.A.N. 3538

[Signature]
DEC 06 2005

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

HP3060/3070 ALUM. PROJECTED WINDOW (L.M.I.)
R.C. ALUMINUM INDUSTRIES INC.
2805 N.W. 75 TH AVE.
MIAMI, FL. 33122
TEL. (305) 592-1515 FAX. (305) 592-2184


no	date	by	description
A	05.10.05	VENT JAMB REV.	NO CHANGE THIS SHEET
B	11.02.05		NO CHANGE THIS SHEET
C	12.02.05		NO CHANGE THIS SHEET

date: 11-26-04
scale: 1/2" = 1"
dr. by: H-AMID
chk. by:


drawing no.
W04-99

sheet 5 of 7


STORE\W04-99RC

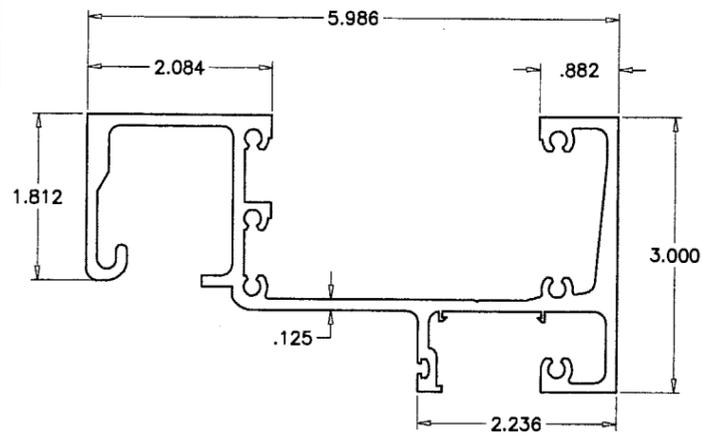


① FRAME HEAD

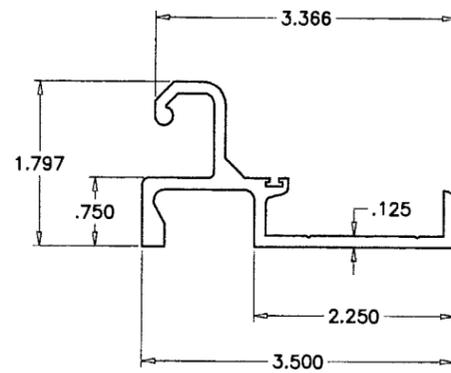


④ VENT HEAD

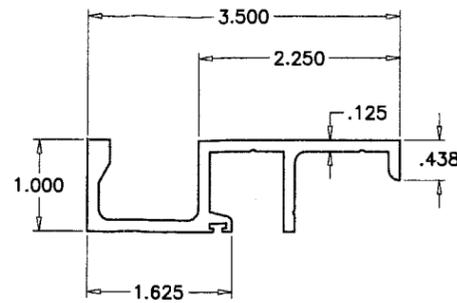


⑤ VENT SILL

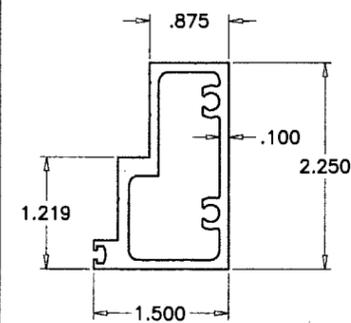


⑥ VENT JAMB

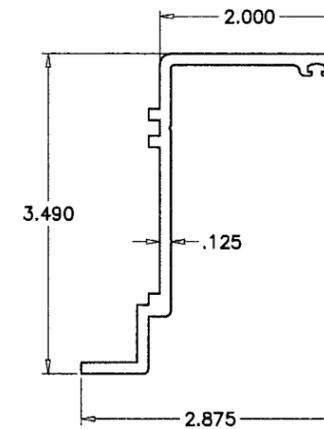


⑧ VENT JAMB ADAPTER

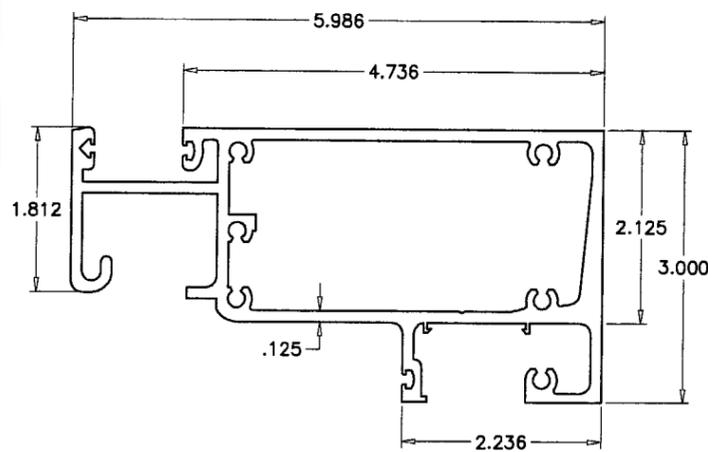


⑨ INTERMEDIATE HEAD

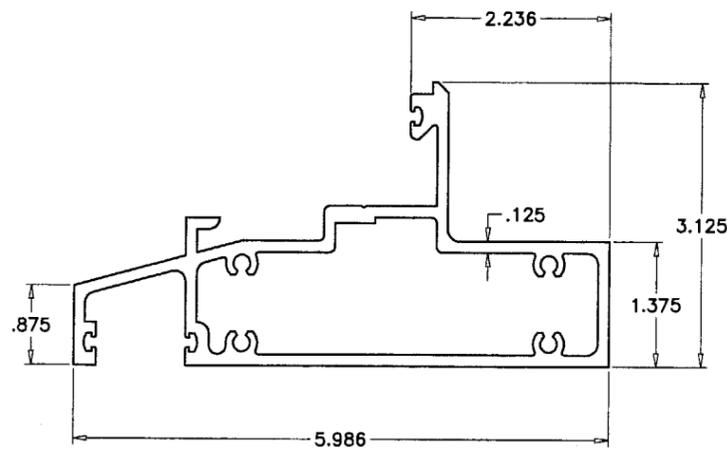


② FRAME SILL/INTERMEDIATE SILL

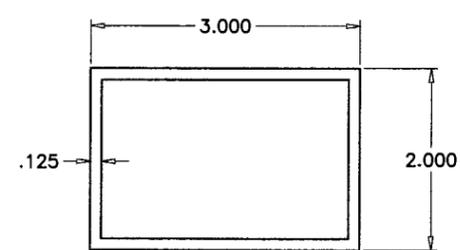

⑬ ALUMINUM TUBE



⑦ SNAP-IN COVER

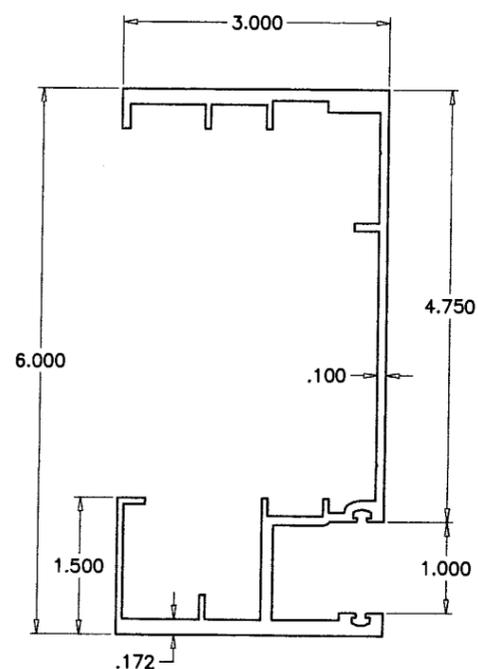

③ FRAME JAMB

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 05-0812.12
 Expiration Date 02/31/10
 By [Signature]
 Miami Dade Product Control
 Division

Engr. DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 C.A.N. 3538

DEC 06 2005

afc

AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978

HP3060/3070 ALUM. PROJECTED WINDOW (L.M.I.)
R.C. ALUMINUM INDUSTRIES INC.
 2805 N.W. 75 TH AVE.
 MIAMI, FL. 33122
 TEL. (305) 592-1515 FAX. (305) 592-2184


no	date	description	by
A	05.10.05	VENT JAMB REV.	
B	11.02.05	NO CHANGE THIS SHEET	
C	12.02.05	NO CHANGE THIS SHEET	

date: 11-26-04
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:


drawing no.
W04-99

sheet 6 of 7

STORE W04-99RC

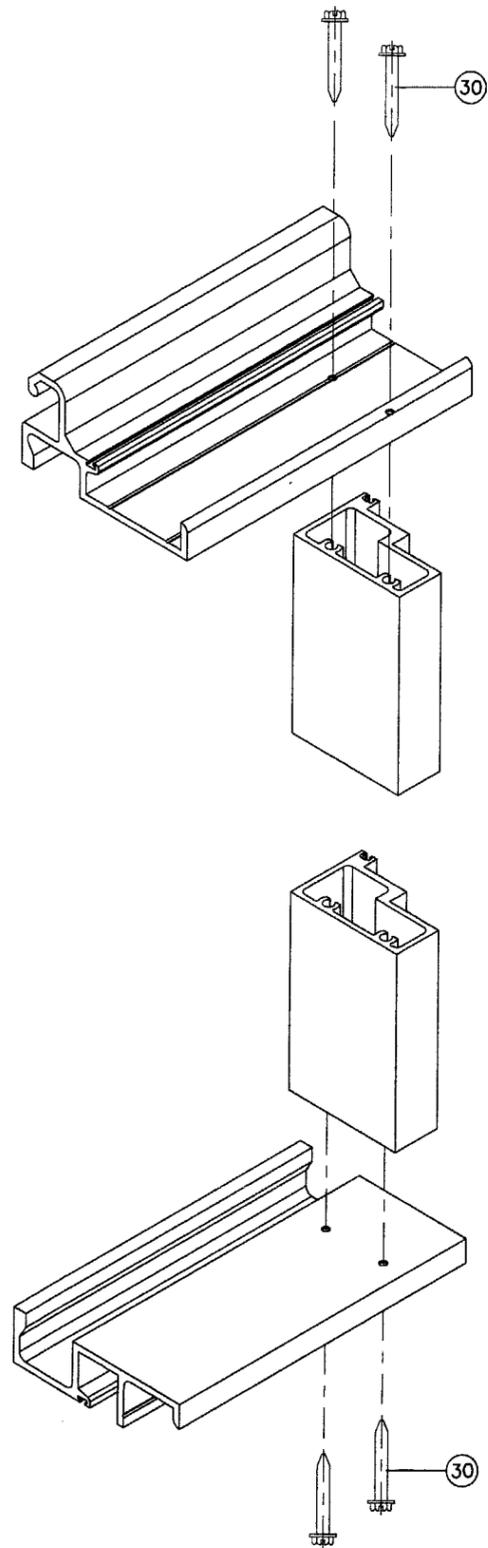

VENT CORNER

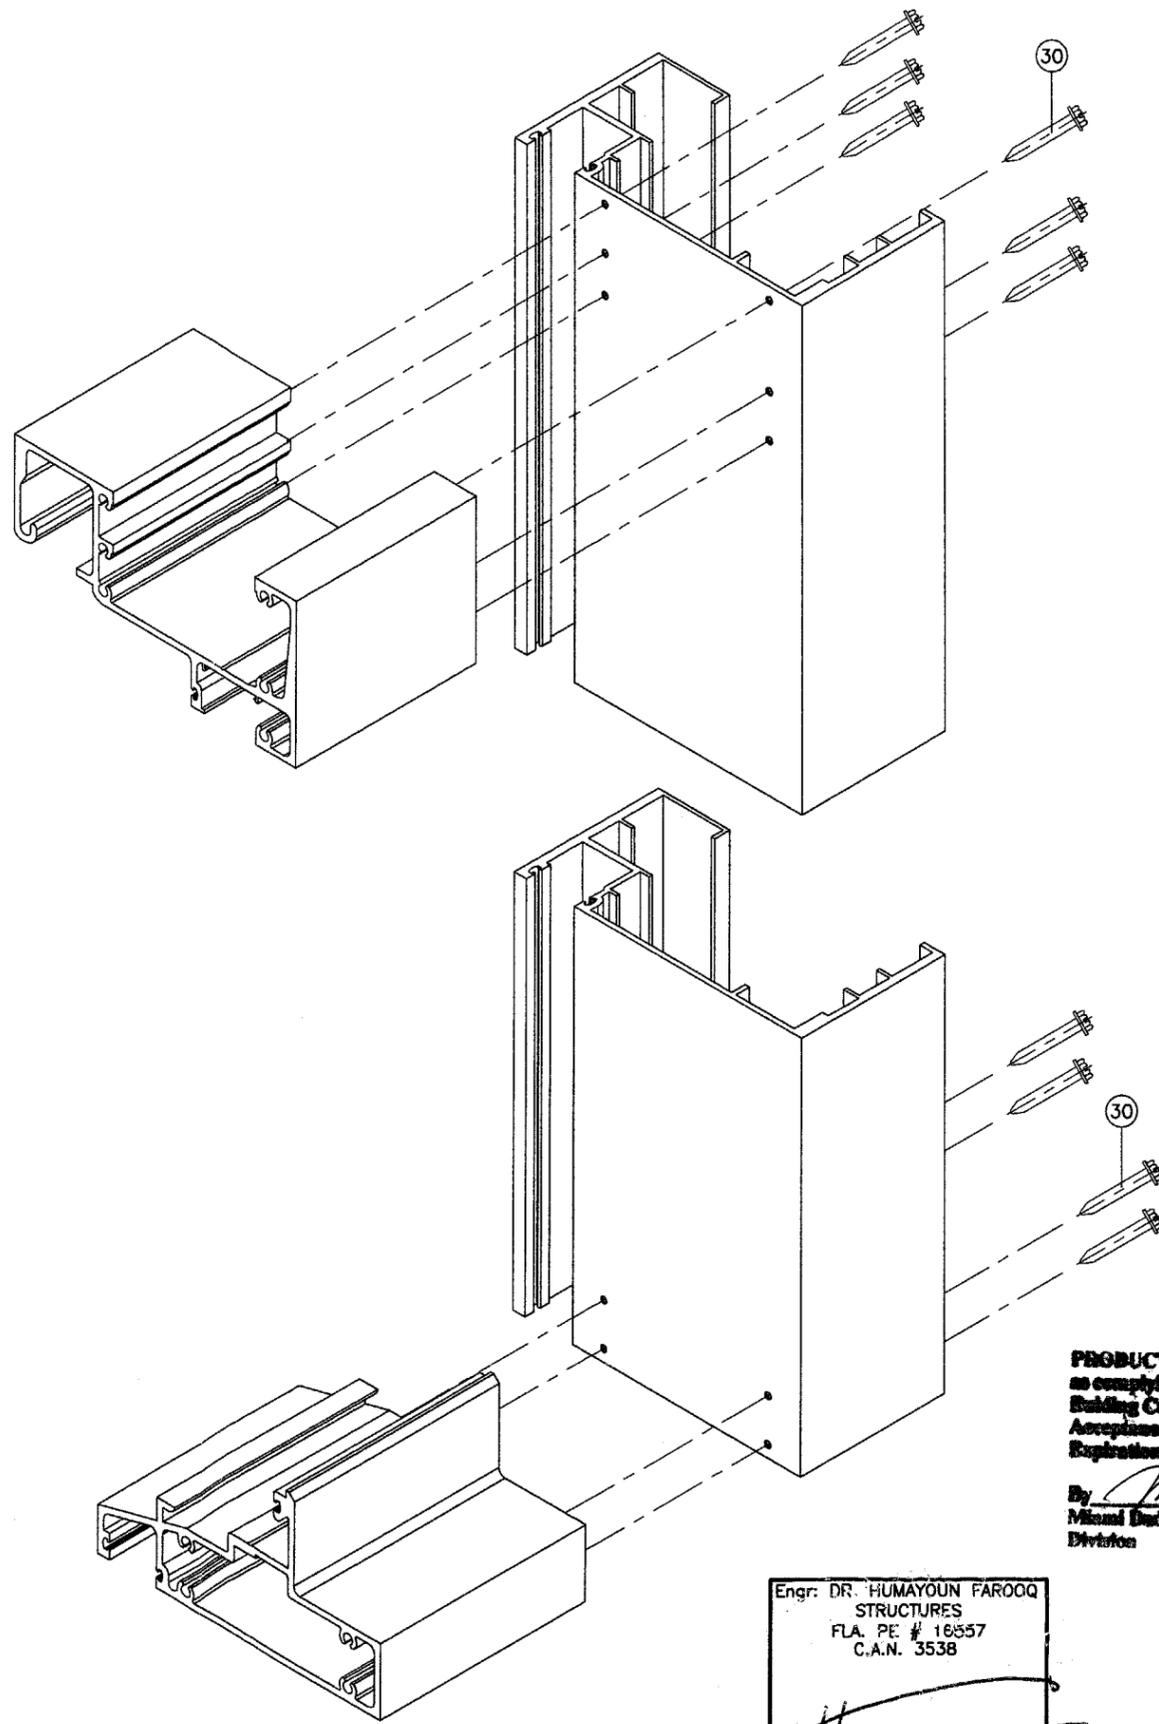


FRAME CORNER

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 05-0817-12
 Expiration Date 03/31/10
 By: *M. Strain*
 Miami Dade Product Control
 Division

Engr. DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE. # 18857
 C.A.N. 3538

H
 DEC 06 2005



AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978

STORE\W04-99RC

HP3060/3070 ALUM. PROJECTED WINDOW (L.M.I.)
R.C. ALUMINUM INDUSTRIES INC.
 2805 N.W. 75 TH AVE.
 MIAMI, FL. 33122
 TEL. (305) 592-1515 FAX. (305) 592-2184

revisions:	
no	description
A	05.10.05 VENT JAMB REV.
B	11.02.05 NO CHANGE THIS SHEET
C	12.02.05 NO CHANGE THIS SHEET

date: 11-26-04
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W04-99

sheet 7 of 7