



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Headrick Building Products, Inc.
5775 Bethelview Road
Cumming, GA 30040**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by the BCCO and accepted by the Building Code and Product Review Committee to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The BCCO (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BCCO reserves the right to revoke this acceptance, if it is determined by BCCO that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the South Florida Building Code, 1994 Edition for Miami-Dade County or Florida Building Code.

**DESCRIPTION: FullFlow Shingle Over Ridge Vent-SORVBL/FSORBL
FullFlow Shingle Over Ridge Vent-SONNBL/FSNNBL
RidgePro Shingle Over Ridge Vent-FRPNNL**

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA No. 01-0814.01 and consists of pages 1 through 5.
The submitted documentation was reviewed by Jorge L. Acebo



**NOA No: 05-0817.18
Expiration Date: 10/18/06
Approval Date: 12/22/05
Page 1 of 5**

ROOFING ASSEMBLY APPROVAL

Category: Roofing
Sub-Category: Roof Ventilators

Materials: Plastic

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:

<u>Product</u>	<u>Dimensions</u>	<u>Test Specification</u>	<u>Product Description</u>
FullFlow Shingle Over Ridge Vent (SORVBL) (FSORBL)	H= 7/8" W=13-13/16" L=48"	TAS 100	Plastic low profile attic ridge vent for installation in shingle roof systems. With or without filter. (Maze 3" ring shank corrosion resistant nails supplied)
FullFlow Shingle Over Ridge Vent (SONNBL) (FSNNBL)	H= 7/8" W=13-13/16" L=48"	TAS 100	Plastic low profile attic ridge vent for installation in shingle roof systems. With or without filter. (No nails supplied with ridge vent)
RidgePro Shingle Over Ridge Vent (FRPNNL)	H= 7/8" W=13-13/16" L=48"	TAS 100	Plastic low profile attic ridge vent for installation in shingle roof systems. (No nails supplied with ridge vent)

TRADE NAMES OF PRODUCTS MANUFACTURED BY OTHERS:

<u>Product</u>	<u>Dimensions</u>	<u>Test Specification</u>	<u>Product Description</u>	<u>Manufacturer</u>
Asphalt Roof Cement		ASTM D 4586	Asbestos-free, asphalt based roof cement.	generic
Asphalt Primer		ASTM D 41	Asphalt Primer	generic
Roofing Nails (SONNBL, FSNNBL & FRPNNL)	2-1/2" long head dia. 3/8"	TAS114	Corrosion resistant annular ring shank nails	generic
Roofing Nails (SORVBL & FSORBL)	3" long head dia. 3/8"	TAS 114	Corrosion resistant annular ring shank nails	Maze Nails (Supplied)






NOA No: 05-0817.18
Expiration Date: 10/18/06
Approval Date: 12/22/05
Page 2 of 5

EVIDENCE SUBMITTED:

<u>Test Agency/Identifier</u>	<u>Name</u>	<u>Report</u>	<u>Date</u>
ETC Laboratories, Inc.	ASTM D 1929 ASTM D635 ASTM D 2843	ETC-01-718-10379.0	1/16/2000
PRI Asphalt Technologies, Inc.	ASTM G 638 ASTM G 85/ PA 114 PA 100	HBP-002-02-01 HBP-003-02-01 HBP-01-02-01	06/06/01 08/03/01 11/02/00
Architectural Testing, Inc.	TAS 100 ASTM D 1929/ D 635	60172.01-122-18 59665.02-106-31	10/07/05 09/16/05


APPROVED APPLICATIONS:

Slot: Determine whether the rafters are truss or ridgepole construction. Chalk a cut line of each side of ridge. Cut a 1-3/4" (truss) or 3-1/4" (ridge pole) slot along the apex of the roof by cutting 7/8" on each side of the ridge. The slot shall terminate 1 foot shorter at each end than the total length of ridge vent used.

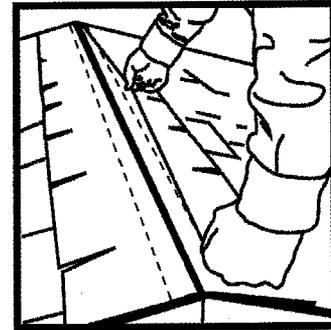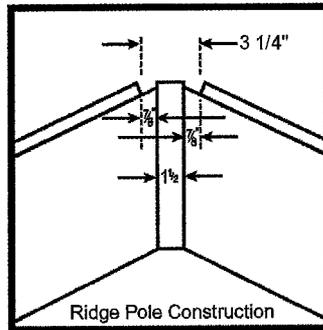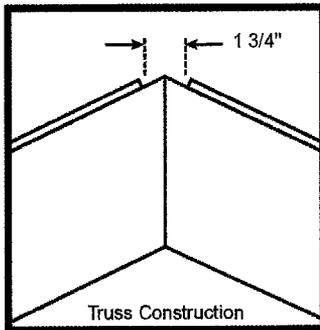

NOA No: 05-0817.18
 Expiration Date: 10/18/06
 Approval Date: 12/22/05
 Page 3 of 5

Installation: Place, center and conform the end of a piece of ridge vent at each end of slots. Mark the location of the end of the baffle. Strike a chalk line on both sides of the ridge to produce baffle alignment. Place a 1/8" wide bead of caulk along the along the chalk line. Place vent sections centered over the slot using a chalk line. Place nails 3" from every end at pre-marked locations on the vent and then at 9" o.c. on both sides of the vent. For part numbers, SONNBL, FSNNBL AND FRPNNL, the installer must source minimum 2½" long generic corrosion resistant ring shank roofing nails.

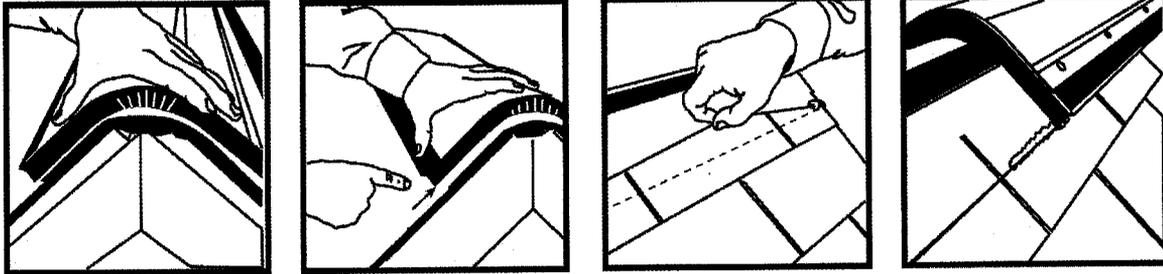

Ridge Shingle: Using nail lines provided on top of vent. Nail cap shingles in place through vent using corrosion resistant roofing nails of sufficient length to penetrate through the roof sheathing a minimum of 3/16".

Net Free Area: Refer to manufacturers published literature

Minimum Slope: 3:12

LIMITATIONS:

1. Refer to applicable building codes for required ventilation.
2. The Shingle Over Ridge Vents in this NOA shall not be installed on roof mean heights greater than 33 feet.





NOA No: 05-0817.18
Expiration Date: 10/18/06
Approval Date: 12/22/05
Page 4 of 5

DETAIL DRAWINGS

**FULLFLOW SHINGLE OVER RIDGE VENT (SORVBL)
 FULLFLOW SHINGLE OVER RIDGE VENT (FSORBL)
 BOTH WITH MAZE 3" NAILS ATTACHED**

**FULLFLOW SHINGLE OVER RIDGE VENT (SONNBL)
 FULLFLOW SHINGLE OVER RIDGE VENT (FSNNBL)
 RIDGEPRO SHINGLE OVER RIDGE VENT (FRPNNL)**

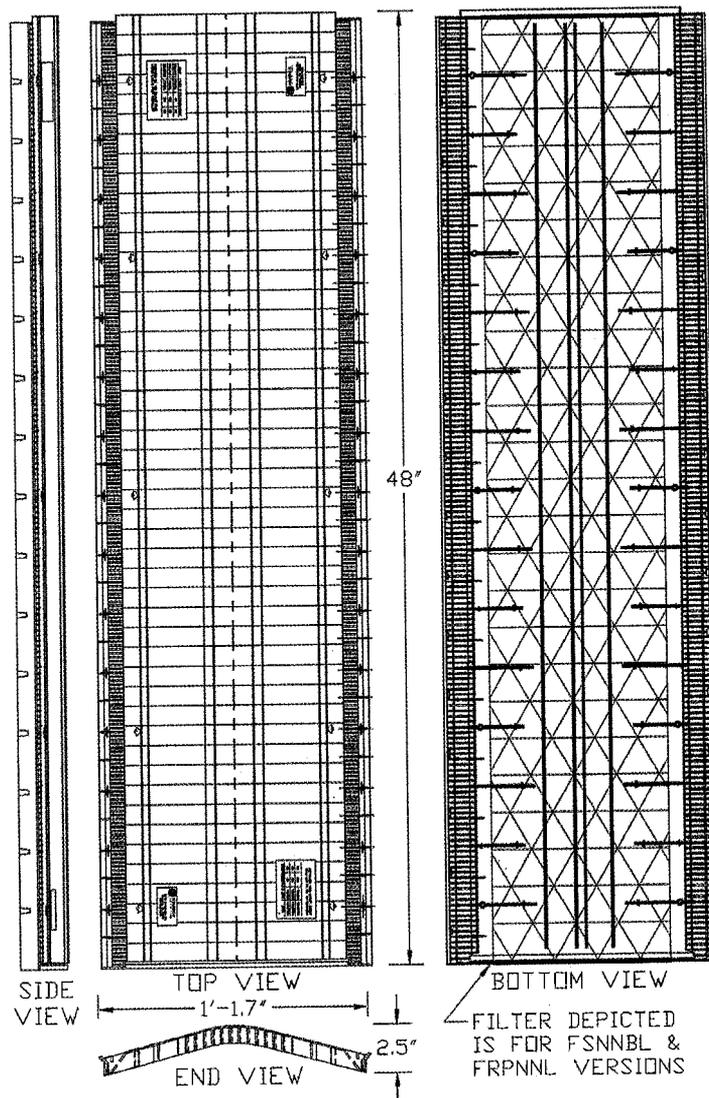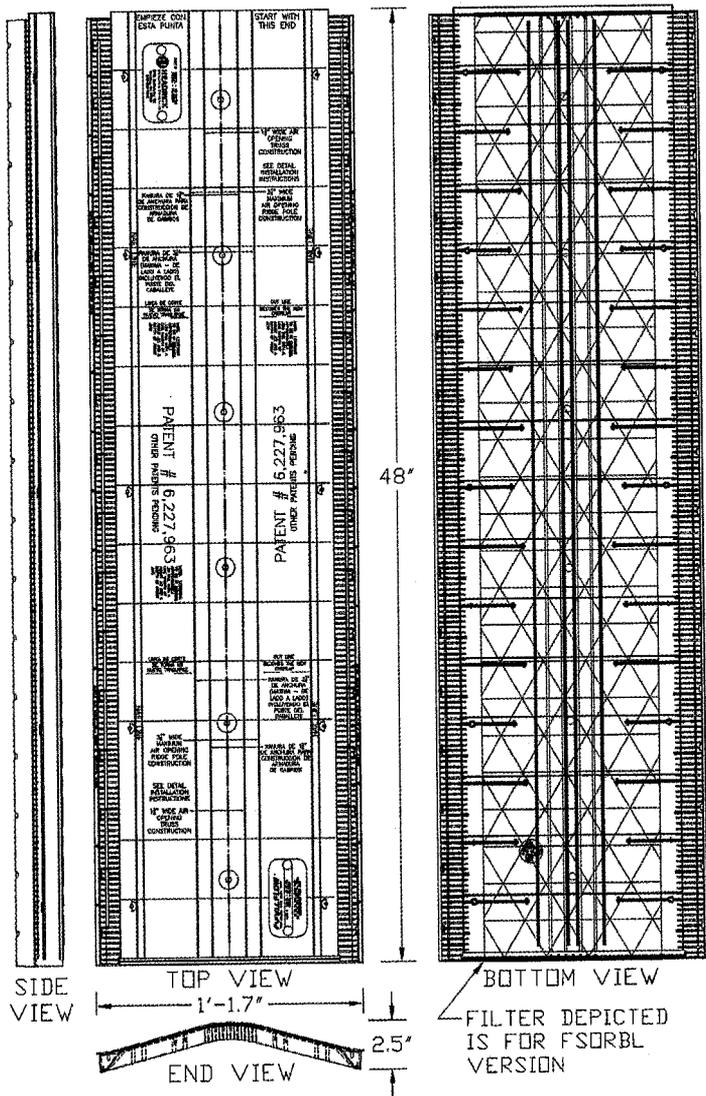

END OF THIS ACCEPTANCE



NOA No: 05-0817.18
 Expiration Date: 10/18/06
 Approval Date: 12/22/05
 Page 5 of 5